

APPLICATION OF STANDARD PLANS

This book is a compilation of Standard Plans prepared by the Colorado Department of Transportation for use on CDOT construction projects. Others who use the CDOT Standard Plans do so at their own risk.

These Standard Plans are essential contract documents as described in subsection 105.09 of the CDOT Standard Specifications for Road and Bridge Construction book.

Standard Plans that are applicable to a specific project will be identified on the project plans and will not be physically attached to those plans. The designer who specifies any of these Standard Plans for a specific project accepts the responsibility of determining their applicability. Additional information concerning the Standards Plans are available in the CDOT Standard Specifications for Road and Bridge Construction book.

Standard Plans adopted or revised subsequent to the adoption of this book will be listed on the index of the project plans and will be physically included in the plans. The New and Revised Standards Plans may be accessed on the CDOT website here: <https://www.codot.gov/business/designsupport/mstandards>.

These Standard Plans are adopted for use as of July 31, 2019.


PHOTO CREDITS:

FRONT COVER:

- 1. GAME RAMP | CDOT, COLORADO PARKS & WILDLIFE, ECO RESOLUTIONS | 2016 | STATE HIGHWAY 9, KREMMLING, CO.
- 2. WELCOME TO COLORFUL COLORADO SIGN INSTALLATION | CDOT | 2019 | JULESBURG, CO.
- 3. FEDERAL BOULEVARD BRIDGE OVER COLFAX AVENUE | CDOT | 2011 | DENVER, CO.
- 4. GRAND AVENUE BRIDGE OPENING | CDOT | 2017 | GLENWOOD SPRINGS, CO.
- 5. DENVER PANORAMIC | STEPHEN MARTINEZ - CDOT | 2019 | DENVER, CO.

BACK COVER:

- 6. HANGING LAKE TUNNELS, WEST | STEPHEN MARTINEZ - CDOT | 2015 | I-70, GLENWOOD CANYON, CO.

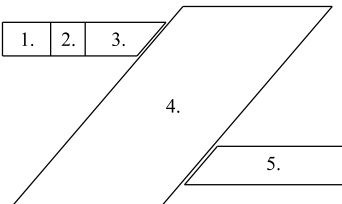

Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	APPLICATION OF STANDARD PLANS		STANDARD PLAN NO.
Creation Date: 07/31/19		Date:	Comments		APPLICATION OF STANDARD PLANS		
Designer Initials: JBK	(R-X)				Standard Sheet No. 1 of 1		
Last Modification Date: 07/31/19	(R-X)				Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						







PLAN NUMBER	M STANDARD TITLE	PAGE NUMBER
☐ M-100-1	STANDARD SYMBOLS (3 SHEETS).....	1-3
☐ M-100-2	ACRONYMS AND ABBREVIATIONS (4 SHEETS).....	4-7
☐ M-203-1	APPROACH ROADS	8
☐ M-203-2	DITCH TYPES.....	9
☐ M-203-11	SUPERELEVATION CROWNED AND DIVIDED HIGHWAYS.....	10-12 (3 SHEETS)
☐ M-203-12	SUPERELEVATION STREETS (2 SHEETS).....	13-14
☐ M-206-1	EXCAVATION AND BACKFILL FOR STRUCTURES	15-16 (2 SHEETS)
☐ M-206-2	EXCAVATION AND BACKFILL FOR BRIDGES (2 SHEETS)...	17-18
☐ M-208-1	TEMPORARY EROSION CONTROL (11 SHEETS)	19-29
☐ M-210-1	MAILBOX SUPPORTS (2 SHEETS)	30-31
☐ M-214-1	NURSERY STOCK DETAILS	32
☐ M-216-1	SOIL RETENTION COVERING (2 SHEETS)	33-34
☐ M-412-1	CONCRETE PAVEMENT JOINTS (5 SHEETS).....	35-39
☐ M-510-1	STRUCTURAL PLATE PIPE H-20 LOADING.....	40
☐ M-601-1	SINGLE CONCRETE BOX CULVERT (CAST-IN-PLACE).....	41-42 (2 SHEETS)
☐ M-601-2	DOUBLE CONCRETE BOX CULVERT (CAST-IN-PLACE).....	43-44 (2 SHEETS)
☐ M-601-3	TRIPLE CONCRETE BOX CULVERT (CAST-IN-PLACE).....	45-46 (2 SHEETS)
☐ M-601-10	HEADWALL FOR PIPES	47
☐ M-601-11	TYPE "S" SADDLE HEADWALLS FOR PIPE.....	48
☐ M-601-12	HEADWALLS AND PIPE OUTLET PAVING	49
☐ M-601-20	WINGWALLS FOR PIPE OR BOX CULVERTS (2 SHEETS) ..	50-51
☐ M-603-1	METAL PIPE (4 SHEETS).....	52-55
☐ M-603-2	REINFORCED CONCRETE PIPE	56
☐ M-603-3	PRECAST CONCRETE BOX CULVERT	57
☐ M-603-4	CORRUGATED POLYETHYLENE PIPE (AASHTO M294)	58 AND POLYPROPYLENE PIPE (AASHTO M330)
☐ M-603-5	POLYVINYL CHLORIDE (PVC) PIPE (AASHTO M304)	59
☐ M-603-6	STEEL REINFORCED POLYETHYLENE	60 AND POLYPROPYLENE PIPE (AASHTO M330)
☐ M-603-10	CONCRETE AND METAL END SECTIONS	61
☐ M-603-12	TRAVERSABLE END SECTIONS AND SAFETY GRATES.....	62-64 (3 SHEETS)
☐ M-604-10	INLET, TYPE C	65
☐ M-604-11	INLET, TYPE D	66
☐ M-604-12	CURB INLET TYPE R (2 SHEETS).....	67-68
☐ M-604-13	CONCRETE INLET TYPE 13.....	69
☐ M-604-20	MANHOLES (3 SHEETS).....	70-72
☐ M-604-25	VANE GRATE INLET (5 SHEETS).....	73-77
☐ M-605-1	SUBSURFACE DRAINS	78

PLAN NUMBER	M STANDARD TITLE	PAGE NUMBER
☐ M-606-1	MIDWEST GUARDRAIL SYSTEM TYPE 3 W-BEAM.....	79-97 31 INCHES (19 SHEETS)
☐ M-606-13	GUARDRAIL TYPE 7 F-SHAPE BARRIER (4 SHEETS).....	98-101
☐ M-606-14	PRECAST TYPE 7 CONCRETE BARRIER (3 SHEETS).....	102-104
☐ M-606-15	GUARDRAIL TYPE 9 SINGLE SLOPE BARRIER	105-115 (11 SHEETS)
☐ M-607-1	WIRE FENCES AND GATES (3 SHEETS).....	116-118
☐ M-607-2	CHAIN LINK FENCE (3 SHEETS).....	119-121
☐ M-607-3	BARRIER FENCE.....	122
☐ M-607-4	DEER FENCE, GATES, AND GAME RAMPS (5 SHEETS).....	123-127
☐ M-607-10	PICKET SNOW FENCE	128
☐ M-607-15	ROAD CLOSURE GATE (9 SHEETS).....	129-137
☐ M-608-1	CURB RAMPS (10 SHEETS).....	138-147
☐ M-609-1	CURBS, GUTTERS, AND SIDEWALKS (4 SHEETS).....	148-151
☐ M-611-1	CATTLE GUARD (2 SHEETS).....	152-153
☐ M-611-2	DEER GUARD (2 SHEETS).....	154-155
☐ M-614-1	RUMBLE STRIPS (3 SHEETS).....	156-158
☐ M-614-2	SAND BARREL ARRAYS (2 SHEETS).....	159-160
☐ M-615-1	EMBANKMENT PROTECTOR TYPE 3	161
☐ M-615-2	EMBANKMENT PROTECTOR TYPE 5	162
☐ M-616-1	INVERTED SIPHON.....	163
☐ M-620-1	FIELD LABORATORY CLASS 1.....	164
☐ M-620-2	FIELD LABORATORY CLASS 2 (2 SHEETS)	165-166
☐ M-620-11	FIELD OFFICE CLASS 1.....	167
☐ M-620-12	FIELD OFFICE CLASS 2.....	168
☐ M-629-1	SURVEY MONUMENTS (2 SHEETS).....	169-170

COLORADO
DEPARTMENT OF TRANSPORTATION
TABLE OF CONTENTS
M&S STANDARDS
JULY 31, 2019

PLAN NUMBER	S STANDARD TITLE	PAGE NUMBER
☐ S-612-1	DELINEATOR INSTALLATIONS (8 SHEETS)	171-178
☐ S-613-1	ROADWAY LIGHTING (8 SHEETS).....	179-186
☐ S-614-1	TYPICAL GROUND SIGN PLACEMENT (2 SHEETS)	187-188
☐ S-614-2	CLASS I SIGNS	189
☐ S-614-3	CLASS II SIGNS	190
☐ S-614-4	CLASS III SIGNS (3 SHEETS)	191-193
☐ S-614-5	BREAK-AWAY SIGN SUPPORT DETAILS	194-195 FOR CLASS III SIGNS (2 SHEETS)
☐ S-614-6	CONCRETE FOOTINGS AND SIGN ISLANDS.....	196-197 FOR CLASS III SIGNS (2 SHEETS)
☐ S-614-8	TUBULAR STEEL SIGN SUPPORT DETAILS (7 SHEETS).....	198-204
☐ S-614-9	PEDESTRIAN PUSH BUTTON POST ASSEMBLY (2 SHEETS).	205-206
☐ S-614-10	MARKER ASSEMBLY INSTALLATIONS	207
☐ S-614-11	MILEPOST SIGN DETAIL FOR HIGH SNOW AREAS	208
☐ S-614-12	STRUCTURE NUMBER INSTALLATION (2 SHEETS)	209-210
☐ S-614-14	FLASHING BEACON AND SIGN INSTALLATIONS (4 SHEETS).	211-214
☐ S-614-20	TYPICAL POLE MOUNT SIGN INSTALLATIONS.....	215
☐ S-614-21	CONCRETE BARRIER SIGN POST INSTALLATIONS.....	216-217 (2 SHEETS)
☐ S-614-22	TYPICAL MULTI-SIGN INSTALLATIONS.....	218
☐ S-614-40	TYPICAL TRAFFIC SIGNAL 30'-75' DOUBLE MAST ARMS....	219-223 65'-75' SINGLE MAST ARMS (5 SHEETS)
☐ S-614-40A	ALTERNATIVE TRAFFIC SIGNAL	224-227 25'-55' SINGLE MAST ARMS (4 SHEETS)
☐ S-614-41	TEMPORARY SPAN WIRE SIGNALS (13 SHEETS)	228-240
☐ S-614-42	CABINET FOUNDATION DETAIL (4 SHEETS).....	241-244
☐ S-614-43	TRAFFIC LOOP AND MISCELLANEOUS SIGNAL DETAILS.....	245-252 (8 SHEETS)
☐ S-614-44	PEDESTAL POLE SIGNALS (2 SHEETS).....	253-254
☐ S-614-50	STATIC SIGN MONOTUBE STRUCTURES (12 SHEETS).....	255-266
☐ S-614-60	DYNAMIC SIGN MONOTUBE STRUCTURES (14 SHEETS).....	267-280
☐ S-627-1	PAVEMENT MARKINGS (9 SHEETS).....	281-289
☐ S-630-1	TRAFFIC CONTROLS FOR HIGHWAY CONSTRUCTION.....	290-313 (24 SHEETS)
☐ S-630-2	BARRICADES, DRUMS, CONCRETE BARRIERS (TEMP).....	314 AND VERTICAL PANELS
☐ S-630-3	FLASHING BEACON (PORTABLE) DETAILS	315
☐ S-630-4	STEEL SIGN SUPPORT (TEMPORARY) INSTALLATION.....	316-317 DESIGN (2 SHEETS)
☐ S-630-5	PORTABLE RUMBLE STRIPS (TEMPORARY) (2 SHEETS)	318-319
☐ S-630-6	EMERGENCY PULL-OFF AREA (TEMPORARY)	320
☐ S-630-7	ROLLING ROADBLOCKS FOR TRAFFIC CONTROL	321-323 (3 SHEETS)

Computer File Information		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development BranchJBK	TABLE OF CONTENTS		STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)				TABLE OF CONTENTS	
Designer Initials: JBK					Standard Sheet No. 1 of 1	
Last Modification Date: 07/31/19						
Detailer Initials: LTA						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English					Issued by the Project Development Branch: July 31, 2019	
				Project Sheet Number:		

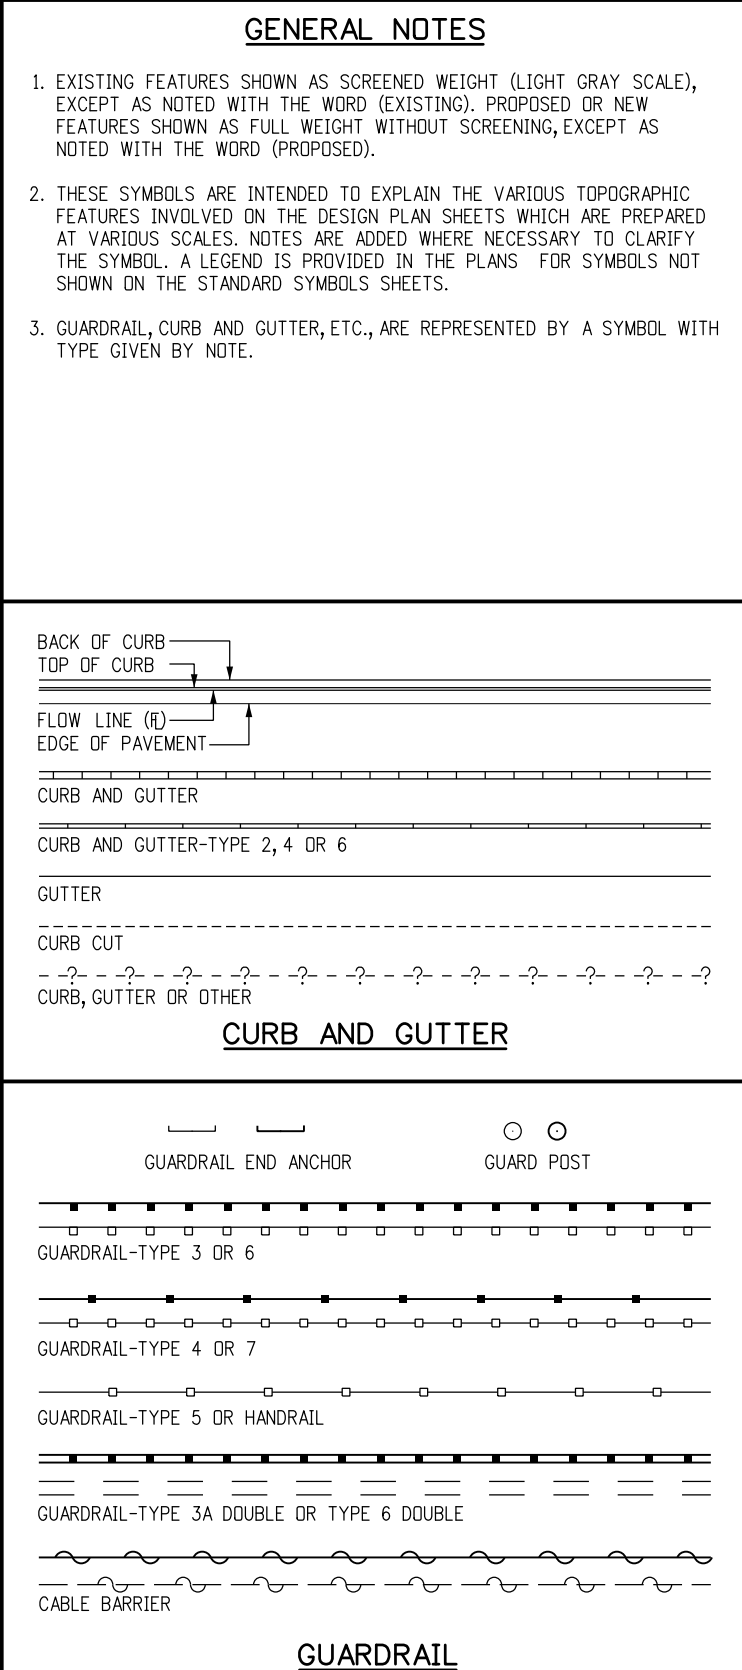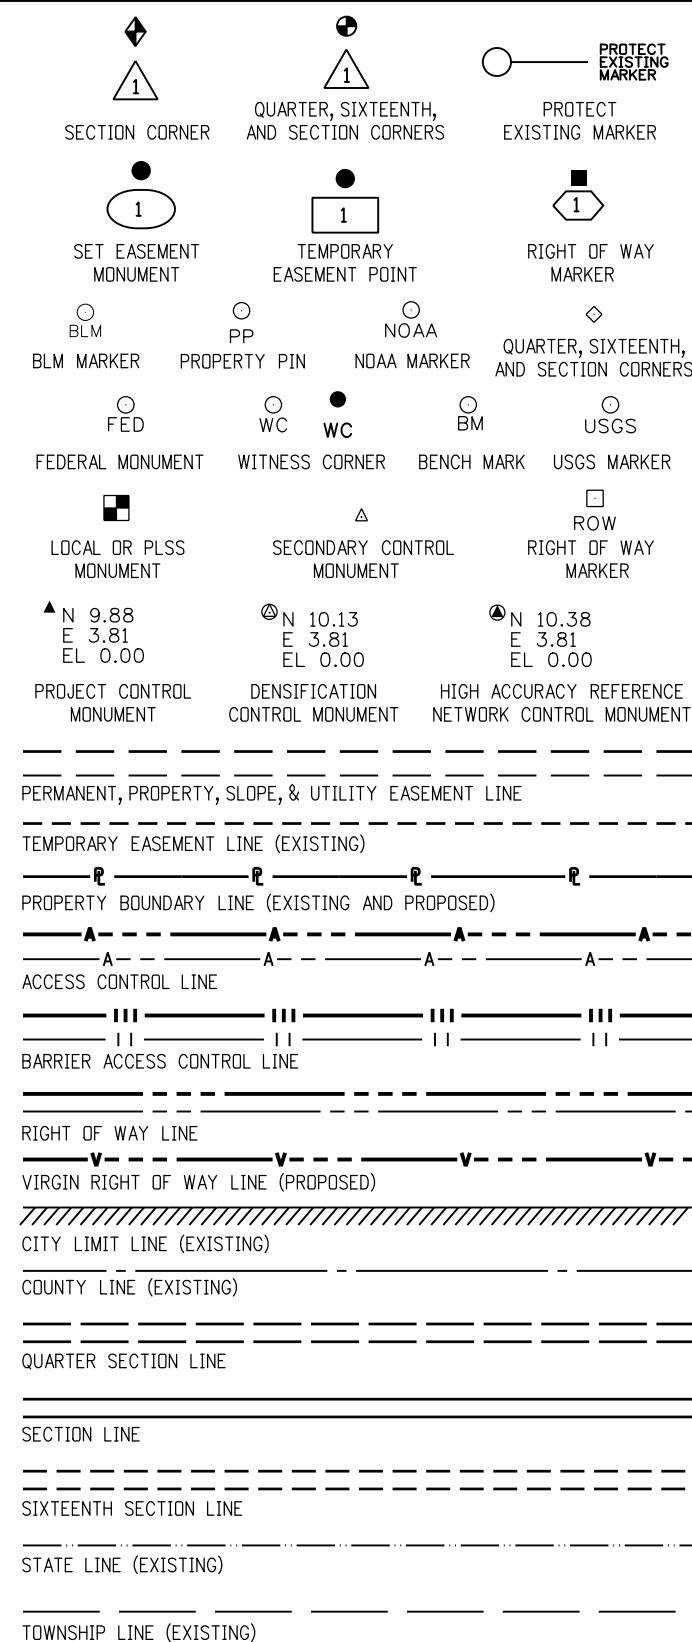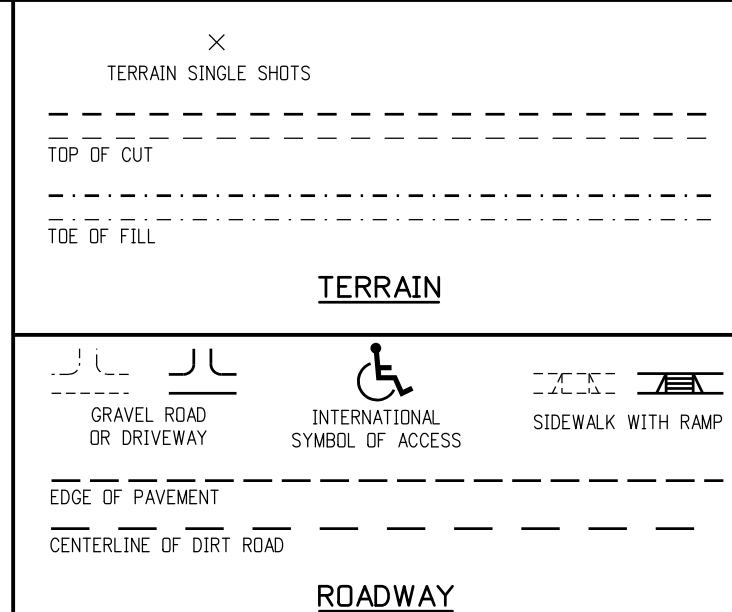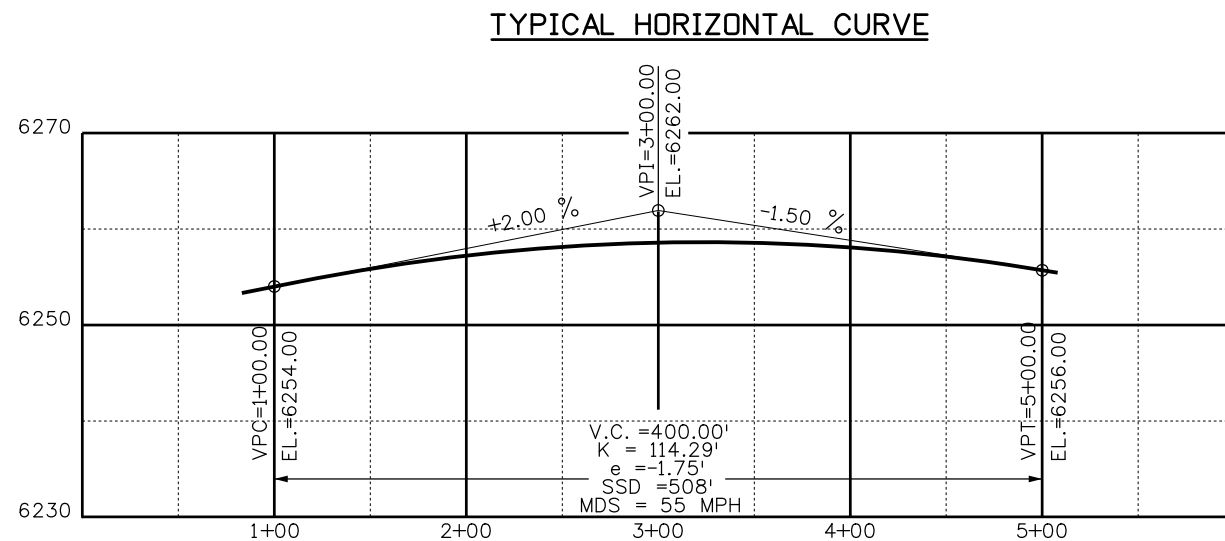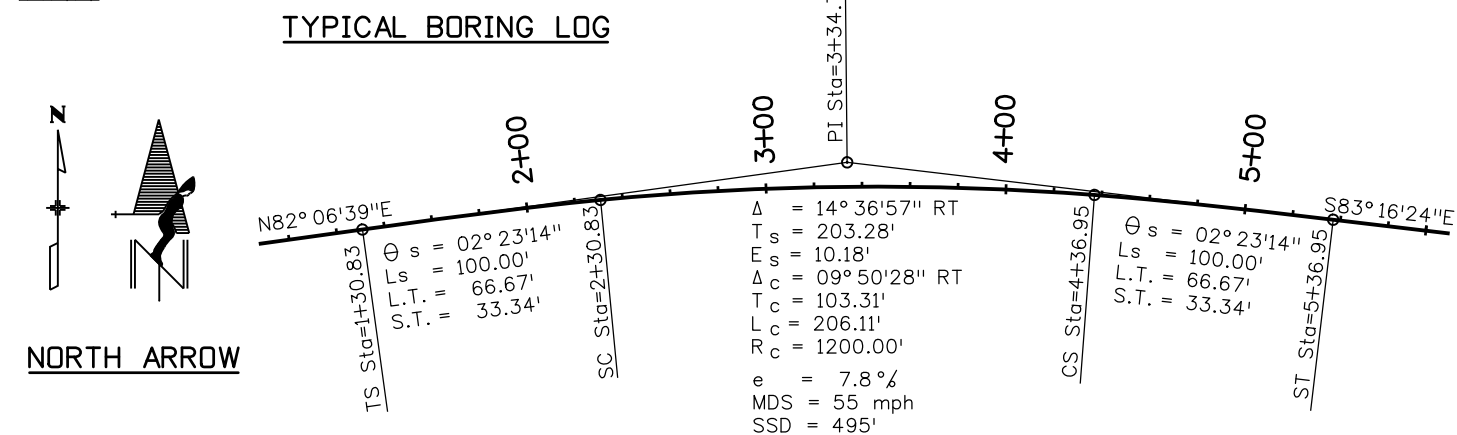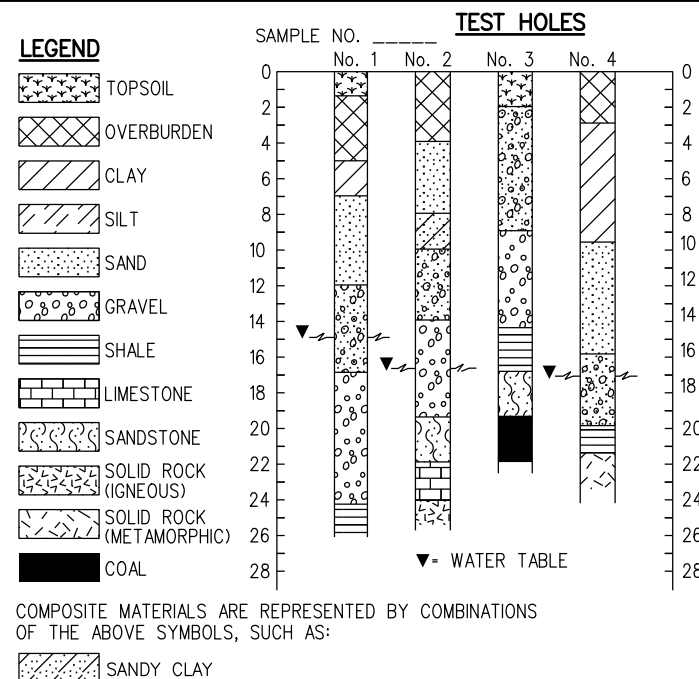

Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDDT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK		STANDARD SYMBOLS		STANDARD PLAN NO.	
Date: Comments			M-100-1							
Creation Date: 07/31/19							Issued by the Project Development Branch: July 31, 2019		Standard Sheet No. 1 of 3	
Designer Initials: JBK										
Last Modification Date: 07/31/19										
Detailer Initials: LTA				Project Sheet Number:						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English										

ROCK, MASONRY OR MECHANICALLY STABILIZED WALL (FACE)

BRIDGE CURB

BRIDGE RAIL

BRIDGE RAIL-TYPE 3A

FLOW LINE CBC

STRUCTURES MISCELLANEOUS

STRUCTURE

MISCELLANEOUS BUILDING STRUCTURE (PRIMARY)

MISCELLANEOUS STRUCTURE (SECONDARY)

FOUNDATION OR PAD (CONCRETE OR BLOCK)

BUILDING STRUCTURES

RR TELEGRAPH POLE

RR SWITCH

RR GUY POLE

RR SIGNALS WITH OR WITHOUT GATE

RR CROSS BUCK SIGN

RR SIGNAL CONTROLLER CABINET

RR MISCELLANEOUS SYMBOL

RR TRACK CENTERLINE

RAILROAD

BOULDER UNDER 6FT

GEOLOGY MISC SYMBOL

MINESHAFT SYMBOL

ROCK OUTCROP

BOULDER FIELD OR ROCK OVERHANG

GEOLOGY

COMBINATION WIRE FENCE WITH GATE

CHAIN LINK FENCE WITH GATE

BARBED WIRE FENCE WITH GATE

SOUND OR BARRIER FENCE WITH GATE

DEER FENCE WITH GATE

WOOD FENCE WITH GATE

SNOW FENCE WITH GATE

PLASTIC FENCE

SILT FENCE

DEBRIS FENCE

FENCE

MISCELLANEOUS TREES

BENCH

SPRINKLER HEAD

DECIDUOUS TREE

TEETER TOTTER SYMBOL

CONIFEROUS TREE

DECIDUOUS SHRUB

SWING SET SYMBOL

CONIFEROUS SHRUB

TREES GROVE

HEDGE OR SHRUB GROVE

EDGE OF WETLANDS

LANDSCAPING

HAZARD WASTE MONITORING WELL

ENVIRONMENTAL CONCERN SITE

EROSION LOG

ROCK CHECK DAM

CONCRETE WASHOUT STRUCTURE

DROP INLET EROSION PROTECTION

TEMPORARY BERM

SOIL RETENTION BLANKET

PIPE INLET EROSION PROTECTION

RIGID INLET PROTECTION

STORM DRAIN INLET PROTECTION

EROSION CHECK

EROSION LOG DITCH CHECK

SILT DIKE

SEDIMENT TRAP/DEWATERING STRUCTURE

EXISTING WETLAND PATTERN

TEMPORARY SLOPE DRAIN

STABILIZED CONSTRUCTION ENTRANCE

LIMITS OF DISTURBED AREA

ENVIRONMENTAL CONCERN

HAZARDOUS WASTE SITE

NOXIOUS WEED

FLOW ARROW

ENVIRONMENTAL

SANITARY SEWER MANHOLE

SANITARY SEWER MISCELLANEOUS SYMBOL

SANITARY SEWER PIPE

SANITARY SEWER PIPE MISCELLANEOUS

SANITARY SEWER

METAL PIPE WITH END SECTION

CONCRETE PIPE MISCELLANEOUS

HEADWALL

CHECK DAM UNDER 4 FT

DIVERSION BOX SYMBOL

FLOW GAUGE

HEADGATE 1

SPRING SYMBOL

MISCELLANEOUS WATERWAYS

EDGE OF WATER, CANALS, PONDS, STREAM OR RIVER

DITCHES AND WATERWAY

INLET TYPE 13

INLET TYPE C

INLET TYPE D

INLET VANE GRATE

INLET TYPE R XX FT LENGTH

STORM SEWER MANHOLE

MANHOLE EXISTING

STORM SEWER MISCELLANEOUS

STORM SEWER PIPE

STORM SEWER PIPE MISCELLANEOUS

STORM SEWER

WATER SPIGOT

FIRE HYDRANT

WATER VALVE

WATER METER

WATER MANHOLE

WATER WELL SYMBOL

WATER LINE

WATER MISCELLANEOUS LINE

WATER

Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		CDOT Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch	STANDARD SYMBOLS Issued by the Project Development Branch: July 31, 2019	STANDARD PLAN NO.	
Creation Date: 07/31/19			M-100-1					
Designer Initials: JBK			Standard Sheet No. 2 of 3					
Last Modification Date: 07/31/19			Project Sheet Number:					
Detailer Initials: LTA								
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English								

Computer File Information		Sheet Revisions		Colorado Department of Transportation		STANDARD SYMBOLS		STANDARD PLAN NO.	
Creation Date: 07/31/19		Date:	Comments	2829 West Howard Place				M-100-1	
Designer Initials: JBK		(R-X)		CDOT HQ, 3rd Floor				Standard Sheet No. 3 of 3	
Last Modification Date: 07/31/19		(R-X)		Denver, CO 80204					
Detailer Initials: LTA		(R-X)		Phone: 303-757-9021 FAX: 303-757-9868					
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English		(R-X)		Project Development Branch JBK		Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:	

A

AAC	Aluminum Arch Culvert
AADT	Annual Average Daily Traffic
ABC	Aggregate Base Course
Abut	Abutment
ACM	Asbestos Containing Materials
ADA	Americans with Disabilities Act
ADT	Average Daily Traffic
AE	Architect-Engineer, Architecture, Engineering
AEC	Architecture, Engineering and Construction
AGA	American Gas Association
Alt	Alternate
API	American Petroleum Institute
APL	Approved Products List
Approx	Approximate
APWA	American Public Works Association
AQCC	Air Quality Control Commission
ARE	Additional Requested Element (Design/Build Terminology)
AREMA	American Railway Engineering & Maintenance-of-Way Association
AHSTA	Ahead Station
ARA	Asphalt Rejuvenating Agent
ASBI	American Segmental Bridge Institute
ASD	Allowable Stress Design
ASDP	American Society of Photogrammetry
ASR	Alkali Silica Reactivity
ASSE	American Society of Sanitary Engineering, American Society of Safety Engineers
Asst	Assistant
ATB	Asphalt Treated Base
ATM	Active Traffic Management
AUTS	Actual Ultimate Tensile Strength

B

Bk to Bk	Back to Back
BEI	By Equal Increments
BM	Bench mark
BPF	Blows per Foot
BAFO	Best and Final Offer
Bbl	Barrels
BC	Bolt Circle
Beg	Begin
Bk	Back
Bldg	Building
BLM	Bureau of Land Management

Blvd	Boulevard
BMP	Best Management Practice
BNSF	Burlington Northern & Santa Fe Railroad
Bott	Bottom
BP	Bearing Pressure
Brg	Bearing
Bk Sto	Back Station
BT	Beginning of Transition
Btwn	Between

C

CL	Centerline
C&G	Curb and Gutter
CA	Concrete Arch
CAC	Concrete Arch Culvert
CAD	Computer Aided Design, Computer Aided Drafting
CADD	Computer Aided Design and Drafting
CBC	Concrete Box Culvert
CBG	Concrete Box Girder
CBGC	Concrete Box Girder Continuous
CBGCP	Concrete Box Girder Continuous Prestressed
CBGP	Concrete Box Girder Prestressed
CBGS	Concrete Box Girder Segmented
CBR	California Bearing Ratio
CCR	Code of Colorado Regulations, as amended
CDTPG	Concrete Double-Tee Prestressed Girder
CE	Construction Engineering
CF	Cubic Feet
CFS	Cubic Feet per Second
CG	Center of Gravity
CHP	Colorado Highway Patrol
CI	Cast Iron or Concrete on Rolled I-Beam
CIC	Concrete on Rolled I-Beam Continuous
CICK	Concrete on Rolled I-Beam Continuous & Composite
CICKP	Concrete on Rolled I-Beam Continuous & Composite Prestressed
CIK	Concrete on Rolled I-Beam Composite
CIKP	Concrete on Rolled I-Beam Composite Prestressed
CIP	Cast-in-Place or Cost in Place
CIR	Cold In-Place Recycling
Clr	Clear
cm	Centimeters
CM	Corrugated Metal

CMAQ	Congestion Mitigation Air Quality
CMP	Corrugated Metal Pipe
CMU	Concrete Masonry Unit
COC	Certificate of Compliance
Col	Column
Comp	Composite
Conc	Concrete
Conn	Connection
Const	Construction
Const Jt	Construction Joint
Cont	Continuous
Corr	Corrugated
CPE	Corrugated Polyethylene Pipe
CPG	Concrete Prestressed Girder (Precast)
CPGC	Concrete Prestressed Girder Continuous (Precast)
CPT	Corrugated Polyethylene Tubing
CR	County Road
CRF	Concrete Rigid Frame
CS	Curve to Spiral, Commercial Standard, Concrete Slab
CSC	Concrete Slab Continuous
CSG	Concrete Slab & Girder (Poured in Place)
CSGC	Concrete Slab & Girder Continuous (Poured in Place)
CSGCP	Concrete Slab & Girder Continuous Prestressed (Poured in Place)
CSGP	Concrete Slab & Girder Prestressed (Poured in Place)
Csk	Countersunk
CSL	Cross Hole Sonic Logging
CSP	Corrugated Steel Pipe or Concrete Slab Prestressed
CSPC	Concrete Slab Prestressed Continuous
CTB	Cement Treated Base
CTR	Certified Test Reports
Ctr	Center
CY	Cubic Yards
CZ	Clear Zone

D

D	Degree of Curvature, or Density
DB	Design Build
DAS	Deformed Anchor Stud
dB	decibels
DBA	Deformed Bar Anchor
Dbl	Double

GENERAL NOTES

1. ABBREVIATIONS SHOULD BE UPPER AND LOWER CASE LETTERS EXCEPT WHERE ALL UPPER CASE LETTERS ARE REQUIRED.
Const Jt = Construction Joint
2. ACRONYMS SHALL BE ALL UPPER CASE LETTERS.
CBC = Concrete Box Culvert
3. ABBREVIATIONS SHALL BE USED ONLY WHEN THE WORDS CANNOT BE COMPLETELY SPELLED OUT DUE TO MULTIPLE FACTORS, SUCH AS A LACK OF SPACE ON THE SHEET.


Deg, °F, °C,	Degrees (Thermal) - Degrees Fahrenheit, Degrees Celsius
Dgn	Design or MicroStation Drawing
DH	Design Height or Avg height for qty calculations
DHV	Design Hour Volume
DHW	Design High Water
DI	Ductile Iron
Dia	Diameter
DNR	Department of Natural Resources
DOW	Division of Wildlife (Colorado)
DRCOG	Denver Regional Council of Governments
DTD	Division of Transportation Development (CDOT)
DTM	Digital Terrain Model
Dwg	AutoCAD Drawing

E

e.g.	Exempli Gratia (For Example)
EA	Environmental Assessment
EATB	Emulsified Asphalt Treated Base
EB	Eastbound
EF	Each Face
Elev	Elevation
Engr	Engineer
EPA	Environmental Protection Agency
EPDM	Ethylene Propylene Diene Monomer-class rubber
Eq	Equal
ESAL	Equivalent Single Axle Load
Est	Estimate
ET	Ending of Transition
EVT	Event Point (InRoads Terminology)
EW	Each Way
E	Expansion Bearing
Exc	Excavation
Exp Jt	Expansion Joint
Ext	Exterior

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English



Sheet Revisions

Date:	Comments

Colorado Department of Transportation



2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch JBK

ACRONYMS AND ABBREVIATIONS

Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.

M-100-2

Standard Sheet No. 1 of 4

Project Sheet Number:

F		H		J			
F	Fixed Bearing	HAS	Headed Anchor Stud	JB	Junction Box	MFBM	Thousand Foot Board Measure
FL	Flow Line	HAZMAT	Hazardous Materials	JPCP	Jointed Plain Concrete Pavement	Mfg	Manufactured or Manufacturer
FAA	Federal Aviation Administration	HC	Horizontal Clearance	Jt	Joint	MHT	Method of Handling Traffic
FASB	Foamed Asphalt Stabilized Base	HCL	Horizontal Control Line			Mi	Mile
FCM	Fracture Critical Member	HCM	Highway Capacity Manual	K		Min	Minimum
FDR	Full Depth Reclamation	Hd	Head			Misc	Miscellaneous
Fed	Federal	HDPE	High Density Polyethylene			mm	Millimeters
FEMA	Federal Emergency Management Agency	HDPP	High Density Polypropylene	Kip	Thousand Pounds	MP	Milepost
FES	Flared End Section	Hex Hd	Hexagonal Head	KSF	kips per square foot	MPH	Miles Per Hour
FF	Far Face or Front Face	HID	High Intensity Discharge (Lamps)	KSI	Kips per square inch	MR	Resilient Modulus
Fig	Figure	HIR	Hot In-Place Recycling	KW	Kilowatt	MR	Modulus of Rupture
Fin	Finished	HLMR	Highload Multi-Rotational				
Fl	Floor	HMA	Hot Mix Asphalt	L		N	
Flg	Flange	Horiz	Horizontal				
FM	Factory Mutual	HQV	High-Occupancy Vehicle	L	Length, Angle (steel)	NAD	North American Datum
FMM	Field Materials Manual	HP	Horsepower	Lb	Pounds	NAVD	North American Vertical Datum
FPM	Feet Per Minute	HPC	High Performance Concrete	Lb/Ft	pound per foot	NB	Northbound, Total Number of Blocks
FPS	Feet Per Second	HS	High Strength	Lb/SY	Pounds per square yard	N _{DES}	Recommended SuperPave™ Gyratory Design Revolution
FRA	Federal Railroad Administration	Ht	Height	Lb-Ft	pound foot	NDT	Nondestructive Testing
Freq	Frequency	HW	High Water	LCCA	Life Cycle Cost Analysis	NECA	National Electrical Contractors Association
FRP	Fiber Reinforced Polymer	Hwy	Highway	LED	Light Emitting Diode	NEPA	National Environmental Policy Act
FS	Planned Finish Surface	Hyd	Hydraulic	LEED	Leadership in Energy and Environmental Design	NESC	National Electric Safety Code
Ft	Feet	I		LF	Linear Feet	NF	Near Face
Ft Kip	Foot Kips			LFD	Load Factor Design	NFPA	National Fire Protection Association
Ft Lb	Foot Pounds			LL	Liquid Limit	NGS	National Geodetic Survey
FTA	Federal Transit Administration			LLDPE	Linear Low-Density Polyethylene	NGVD	National Geodetic Vertical Datum of 1929
Ftg	Footing	ICEA	Insulated Cable Engineers Association	LRFD	Load and Resistance Factor Design	NHS	National Highway System
FWD	Falling Weight Deflectometer	ID	Inside Diameter	LS	Lump Sum or Length of Spiral	NICET	National Institute for Certification of Engineering Technologies
G		IMP	Incident Management Plan	Lt	Left	NIP	Nail in Place
		In. Kips	Inch Kips	LTB	Lime Treated Base	NMAS	Nominal Maximum Aggregate Size
		In. Lb.	Inch Pounds	LTDS	Required Long Term Design Strength	No	Number
		In.	Inches	Lum	Luminaire	Nom	Nominal
Ga	Gage or Gauge	Incl	Included	M		NPDES	National Pollutant Discharge Elimination System
Gal	Gallons	Int	Interior			NPT	National Pipe Thread
Galv	Galvanized	Inv	Invert			NS	Near Side
Gd	Guided expansion bearing	IRI	International Roughness Index	m	Meters	NTCIP	National Transportation Communications for ITS Protocol
Gir, G	Girder	ISO	International Organization for Standards	MA	Mobile Attenuator	NTP	Notice to Proceed
GIS	Geographical Information System	ITAA	Information Technology Association of America	Maint	Maintenance	NTS	Not to Scale
GL	Girt Line	ITS	Intelligent Transportation System	MARV	Minimum Average Roll Value		
GPM	Gallons Per Minute	IVHS	Intelligent Vehicle Highway System	Matl	Material		
GPS	Global Positioning System			Max	Maximum		
GRI	Geosynthetic Research Institute			MBTA	Migratory Bird Treaty Act		
GRS	Geosynthetic Reinforced Soil						
GSI	Geosynthetic Institute						

Computer File Information		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development BranchJBK	Sheet Revisions		ACRONYMS AND ABBREVIATIONS		STANDARD PLAN NO.	
Creation Date: 07/31/19			Date:	Comments	M-100-2 Standard Sheet No. 2 of 4		Project Sheet Number:	
Designer Initials: JBK	(R-X)							
Last Modification Date: 07/31/19	(R-X)							
Detailer Initials: LTA	(R-X)							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)				Issued by the Project Development Branch: July 31, 2019			

O

OC	On Center
OD	Outside Diameter
OGFC	Open Grade Friction Course
OJT	On-the-Job Trainee or On-the-Job Training
Opp Hand	Opposite Hand
oz	Ounces

P

PC	Point of Curve
PCA	Portland Cement Association
PCBC	Concrete Box Culvert Precast
PCC	Point of Compound Curve
PCCP	Portland Cement Concrete Pavement
PDA	Pile Driving Analyzer
PE	Preliminary Engineering, or Professional Engineer or Permanent Easement
Ped	Pedestrian
PG	Profile Grade or Performance Grade
PGL	Profile Grade Line
PI	Point of Intersection
PL, PI	Plate
PLS	Professional Land Surveyor
PM	Project Manager
PMBB	Plant Mix Bituminous Base
PMBP	Plant Mix Bituminous Pavement
PMSC	Plant Mix Seal Coat
PDC	Point on Curve
PDSS	Point of Slope Selection
PDT	Point on Tangent
PPE	Personal Protective Equipment
PRC	Point of Reverse Curve
Proj	Project or Projection
psf	Pounds per square foot
psi	Pounds per square inch
PT	Point of Tangent
PTFE	Polytetrafluoroethylene
PTI	Post-Tensioning Institute
PUC	Public Utilities Commission
PVC	Poly Vinyl Chloride (pipe), Point of Vertical Curve
PVI	Point of Vertical Intersection
Pvmt	Pavement
PVT	Point of Vertical Tangency

Q

Q	Peak Discharge or Flow Volume
QA	Quality Assurance
QC	Quality Control
QMP	Quality Management Plan
QML	Qualified Manufacturers List

R

R	Radius
RA	Rubble Arch
RAC	Rubble Arch Culvert
rad	radians
RAP	Reclaimed Asphalt Pavement
RAS	Reclaimed Asphalt Shingles
RC	Reverse Crown
RCC	Roller Compacted Concrete
RCP	Reinforced Concrete Pipe
RCPC	Reinforced Concrete Pipe Culvert
Rdwy	Roadway
RE	Resident Engineer or Railroad Easement
Ref	Reference
Reinf	Reinforcing
Rem	Remove or Removal
Repl	Replace
Req	Required
Rev	Revised, Revision
RG	Riveted Plate Girder
RGC	Riveted Plate Girder Continuous
RL	Reinforcement Length
RME	Region Materials Engineer
rpm	Revolutions Per Minute
RSC	Rigid Steel Conduit
RSS	Reinforced Soil Slope
Rt	Right
RTD	Region Transportation Director or Regional Transportation District
RWIS	Road Weather Information System


S

SA	Steel Arch
SAC	Steel Arch Culvert
San	Sanitary
SB	Southbound
SBA	Small Business Administration
SBG	Steel Box Girder
SBGC	Steel Box Girder Continuous
SC	Spiral to Curve
Sch	Schedule
SCS	Spiral Curve Spiral
SDG	Steel Deck Girder
SDGC	Steel Deck Girder with Floor Beam System
SDGCK	Steel Deck Girder Continuous & Composite
SDI	Steel Decks Institute
SDT	Steel Deck Truss
Sdwk	Sidewalk
Sect	Section
SF	Square Feet
SH	State Highway
Shldr	Shoulder
SHPD	State Historic Preservation Office
SHRP	Strategic Highway Research Program
Sht	Sheet
SIGN	Overhead Sign
SIGNB	Overhead Sign-Butterfly
SIGNC	Overhead Sign-Cantilever
SIGND	Overhead Sign + Cantilever
Sim	Similar
SIP	Stay in Place
SJI	Steel Joists Institute
SLT	Steel Low Truss
SMA	Stone Matrix Asphalt
SN	Structural Number
Spa	Spaces or Spaced
Specs	Specifications
SpG	Specific Gravity
Spl	Splice
Sq In	Square Inches
Sq Mi	Square Miles
Sq	Square

SRW	Segmental Retaining Walls
SSE	Steel Stringer-Earth Filled
SSM	Steel Stringer-Metal Plank Deck
SSMC	Steel Stringer-Metal Plank Deck Continuous
SSPC	Society for Protective Coatings
SSS	Steel Stringer-Timber Deck
SSSC	Steel Stringer-Timber Deck Continuous
ST	Spiral to Tangent
St	Straight or Street
Sta	Station
Std	Standard
STG	Steel Thru Girder
Str	Structure, Structural
STT	Steel Thru Truss
SUSP	Suspension Bridge
SY	Square Yards
Sym	Symmetrical

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English



Sheet Revisions

Date:	Comments



Colorado Department of Transportation
2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch

JBK

ACRONYMS AND ABBREVIATIONS

Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.

M-100-2

Standard Sheet No. 3 of 4

Project Sheet Number:

T

T&B	Top and Bottom
T&E	Threatened & Endangered Species
T	Tons
TAS	Threaded Anchor Stud
TBC	Timber Box Culvert
TC	Tangent to Curve
TCD	Traffic Control Devices
TCP	Traffic Control Plan
TD	Timber Stringer (Untreated) Concrete Deck
TDH	Total Dynamic Head
Temp	Temporary or Temperature
Thd	Thread
THHN	Thermoplastic High Heat-resistant Nylon coated (Insulation designation for wire)
THWN	Thermoplastic High Water-resistant Nylon coated (Insulation designation for wire)
TIG	Tungsten Inert Gas (Welding)
TLA	Timber Laminated Arch (Gluelam)
TLS	Timber Laminated Stringer (Gluelam)
TLT	Timber Low Truss
TM	Timber Stringer (Untreated) Metal Deck
TMP	Transportation Management Plan
Tot	Total
TPI	Threads per Inch
TS	Tangent to Spiral, Timber Stringer (Untreated) Timber Deck
TSLAB	Timber Slab
TTC	Timber Culvert
TTD	Timber Stringer-Concrete Deck
TTM	Timber Stringer- Metal Deck
TTS	Timber Stringer- Timber Deck
TTT	Timber Thru Truss
TUNC	Tunnel-Concrete Lined
TUNR	Tunnel-Thru Rock-No Lining
Typ	Typical

U

UG	Underground
UNC	Uniform National Coarse (screw thread)
UNCC	Utility Notification Center of Colorado
UNF	Uniform National Fine (screw thread)
UNO	Unless Noted Otherwise
UPRR	Union Pacific Railroad
UPS	Uninterruptible Power Supply
USACE	United States Army Corp of Engineers
USCS	Unified Soil Classification System
USDA	United States Department of Agriculture
USDDT	United States Department of Transportation
USFWS	United States Fish and Wildlife Service
USGS	US Geological Survey
Util	Utility or Utilities
UV	Ultraviolet

V

VC	Vertical Curve
VCP	Vitrified Clay Pipe
Veh	Vehicle
Vert	Vertical
VFA	Voids Filled With Asphalt
VMA	Voids in the Mineral Aggregate
VMS	Variable Message Sign
Vol	Volume
VPC	Vertical Point of Curvature
VPI	Vertical Point of Intersection
VPT	Vertical Point of Tangency

W

W/C	Water-Cement Ratio
WALL	Retaining Wall
WB	Westbound
WBS	Work Breakdown Structure
WF	Wide Flange (Steel section)
WG	Welded Girder
WGC	Welded Girder Continuous
WGCK	Welded Girder Continuous & Composite
WGCKP	Welded Girder Continuous, Composite Prestressed
WGK	Welded Girder Composite
WGKP	Welded Girder Composite Prestressed
WIMS	Weigh-In-Motion Station
WP	Work Point
WQCD	Water Quality Control Division (Colorado Department of Public Health and Environment)
WRI	Wire Reinforcement Institute
WS	Water Surface
WSN	Weighted Structural Number
Wt	Weight
WWF	Welded Wire Fabric, typically referred to very light gauge wire for crack control
WWR	Welded Wire Reinforcement


Y

Yd	Yard
----	------


SYMBOLS

400	#4 REBAR BENDING SHAPE
500	#5 REBAR BENDING SHAPE
600	#6 REBAR BENDING SHAPE
@	at
&	and
φ ∅	Diameter
°, ', "	Degrees, Minutes, Seconds
', "	Feet, inches
#	Number or Pound
ⓔ	Epoxy Coated Rebar
Ⓝ	Non-Epoxy Coated Rebar
ⓧⓧ	Girder Label
°F	Fahrenheit
°C	Celsius
≈	Approximate
Ⓢ	Interstate Highway
Ⓢ	US Highway
Ⓢ	State Highway

Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development BranchJBK	ACRONYMS AND ABBREVIATIONS	STANDARD PLAN NO.	
Creation Date: 07/31/19	Date:		Comments	M-100-2				
Designer Initials: JBK				Standard Sheet No. 4 of 4				
Last Modification Date: 07/31/19				Issued by the Project Development Branch: July 31, 2019				
Detailer Initials: LTA								
C-D Ver.: MicroStation V8 Scale: Not to Scale Units: English								

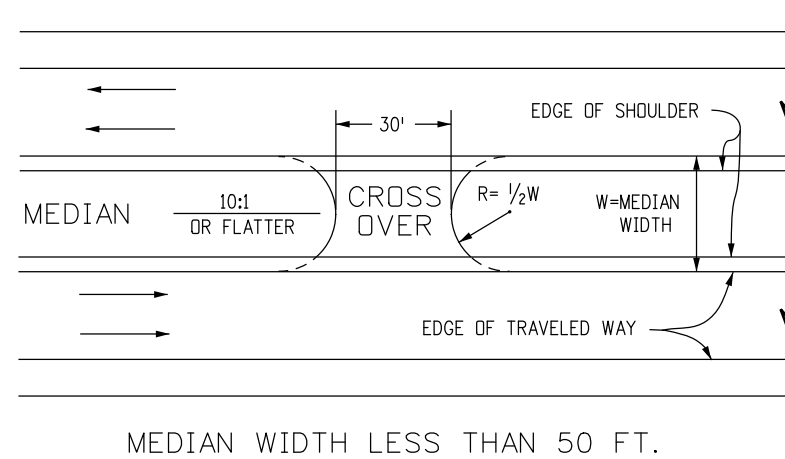


MEDIAN WIDTH LESS THAN 50 FT.

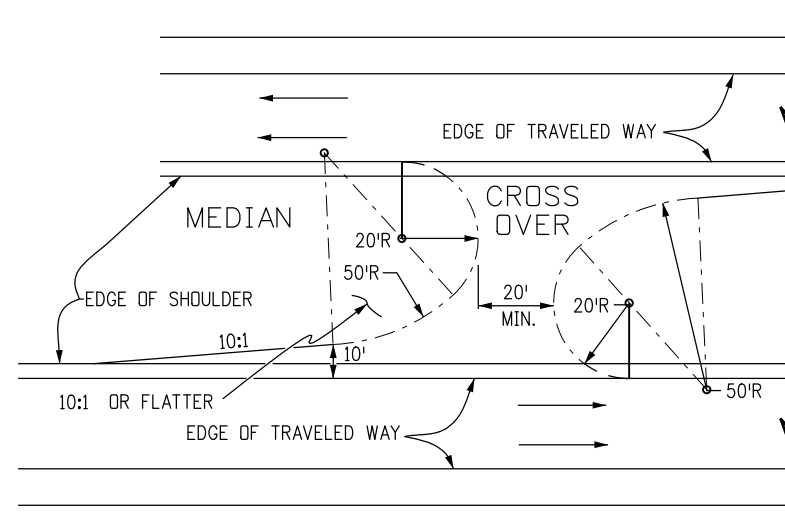

MEDIAN WIDTH GREATER THAN 50 FT.


TYPICAL PLANS FOR EMERGENCY MEDIAN CROSS OVER

LOCATION OF RADIUS POINTS MAY BE ADJUSTED FOR BEST FIT




TYPICAL SECTION FOR MEDIAN CROSS OVER

ANY REQUIRED PIPE OR INLET FOR MEDIAN DRAINAGE SHALL HAVE A TRAVERSABLE DESIGN AS SPECIFIED ON THE PLANS

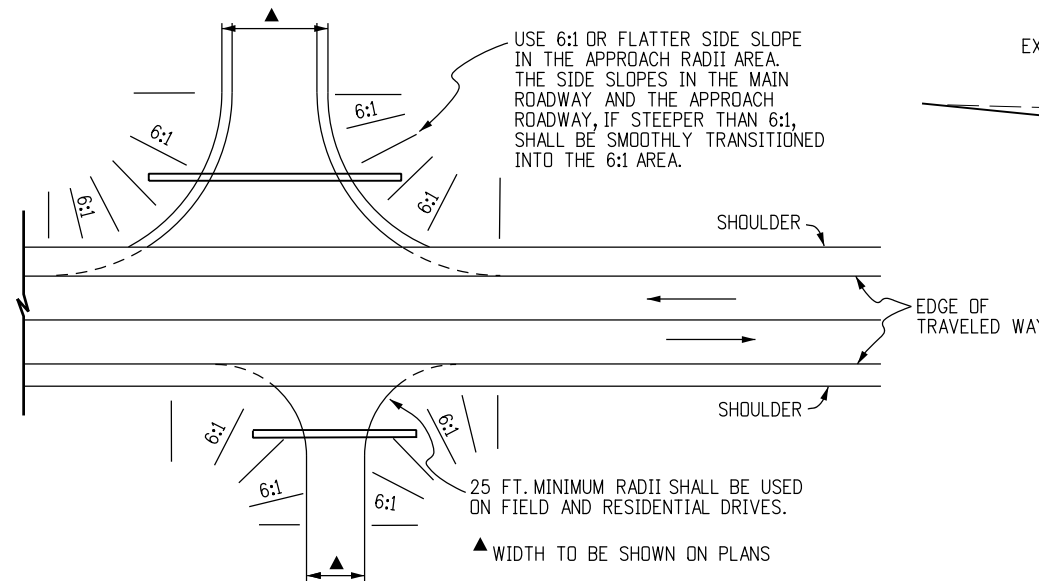

SIDE DRAINS SHALL BE LOCATED BEYOND THE CLEAR ZONE, OR WHEN WITHIN THE CLEAR ZONE, THEY SHALL BE INSTALLED WITH END SECTIONS CONFORMING TO A 6:1 SLOPE. FIFTY FT. RADII SHALL BE USED ON INTERSECTING ROADS, EXCEPT FOR FIELD AND RESIDENTIAL DRIVES OR UNLESS OTHERWISE SPECIFIED ON PLANS. RADII MAY BE VARIED TO SUIT FIELD CONDITIONS.


TYPICAL PLANS FOR SIDE APPROACH ROAD

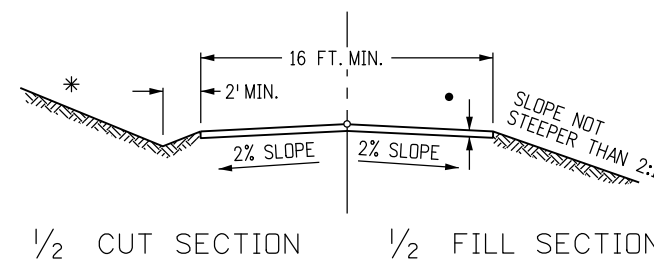


TYPICAL SECTION FOR APPROACH (ACCESS) ROAD

NOTE: ROAD APPROACHES WHICH REQUIRE HMA (ASPHALT) PAVEMENT SHALL BE PLACED AT THE FOLLOWING DISTANCES BACK FROM THE ROADWAY EDGE OF PAVEMENT:


1. RESIDENTIAL OR AGRICULTURAL FIELD ENTRANCES - PAVE 4 FEET BACK.
2. THREE OR MORE RESIDENCES OR COMMERCIAL PROPERTY - PAVE 20 FEET BACK OR TO ROW LINE, WHICHEVER IS LESS.
3. PUBLIC STREET - PAVE 50 FEET BACK OR TO ROW LINE, WHICHEVER IS LESS.
4. IF EXISTING ACCESS IS PAVED, THEN FEATHER NEW ASPHALT OVERLAY A MINIMUM OF 2 FEET BACK OR AS DIRECTED BY THE ENGINEER.

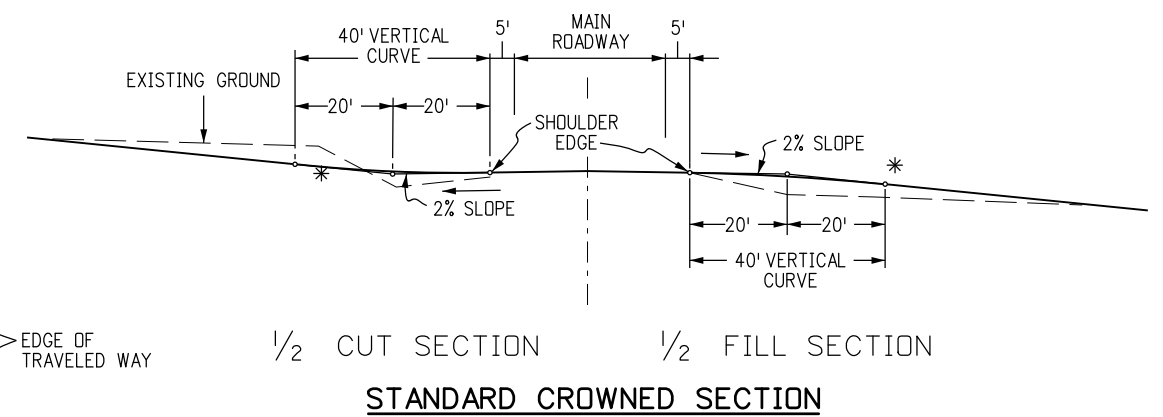

STANDARD CROWNED SECTION

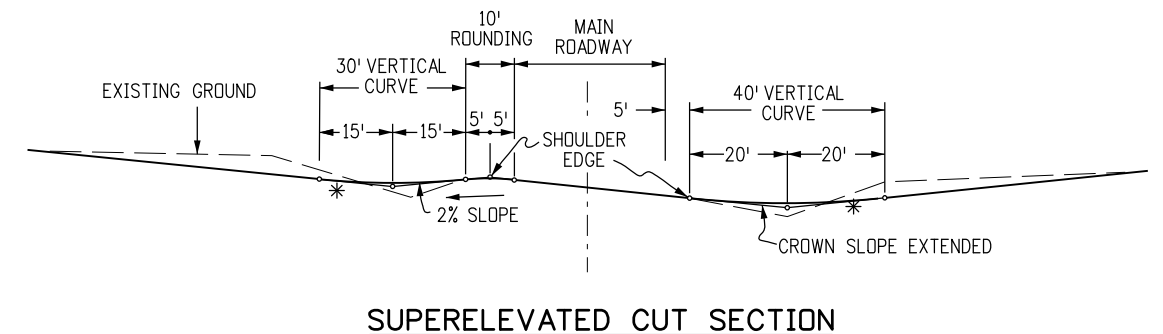

SUPERELEVATED CUT SECTION

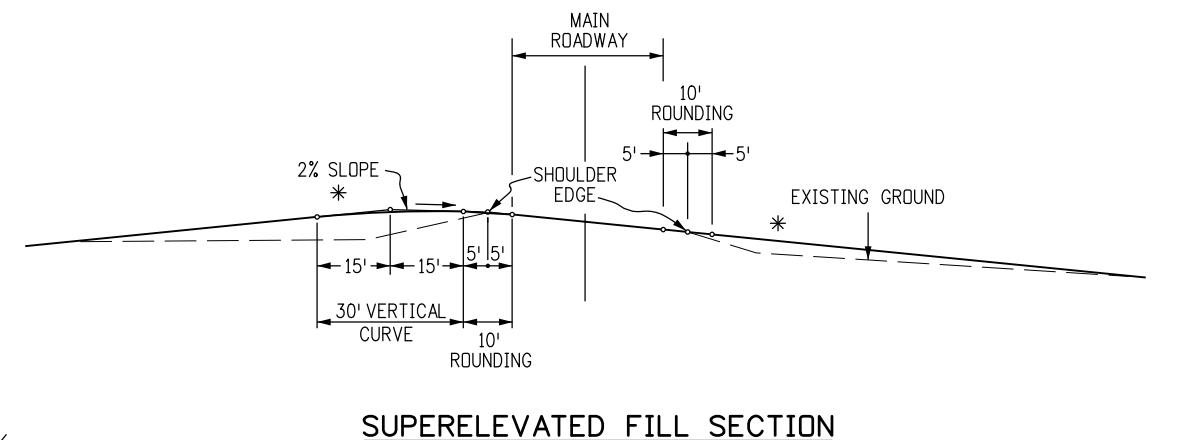


SUPERELEVATED FILL SECTION

VERTICAL ALIGNMENT SIDE APPROACH ROADS INTERSECTING MAIN ROADWAY

* TANGENT SLOPE NOT STEEPER THAN 8% BEYOND THE VERTICAL CURVE. THE SLOPE MAY BE STEEPER, IF REQUIRED, TO MEET EXISTING APPROACH SLOPE. HOWEVER, APPROACH ROAD SLOPE SHOULD NOT BE STEEPER THAN EXISTING SLOPE.


Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	APPROACH ROADS	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-203-1	
Designer Initials: JBK	(R-X)					Standard Sheet No. 1 of 1	
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:	
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)				Issued by the Project Development Branch: July 31, 2019		

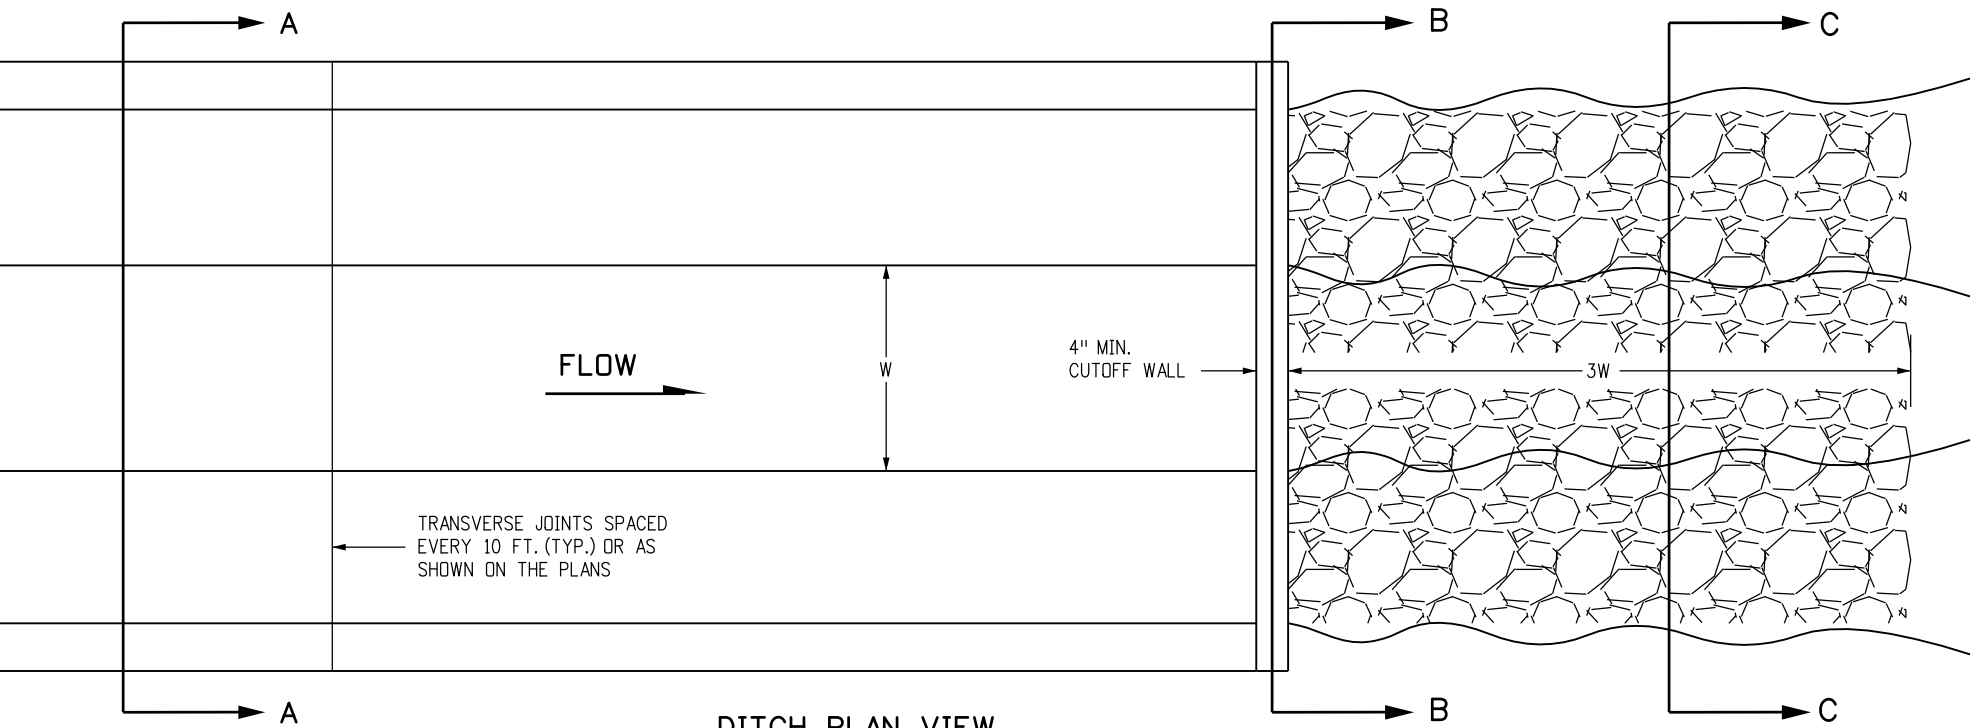

DITCH PLAN VIEW

GENERAL NOTES

- 1. ALL DITCHES SHALL BE CONSTRUCTED TO THE LINES AND GRADES AS SHOWN ON THE PLANS, USING THE DITCH SECTION AS SHOWN ON THE PLANS, OR AS SPECIFIED BY THE ENGINEER.
- 2. CONCRETE LINING WILL BE PAID FOR AS CONCRETE SLOPE AND DITCH PAVING.
- 3. PROVIDE A CUTOFF WALL AND RIPRAP AT THE END OF CONCRETE-LINED DITCH.

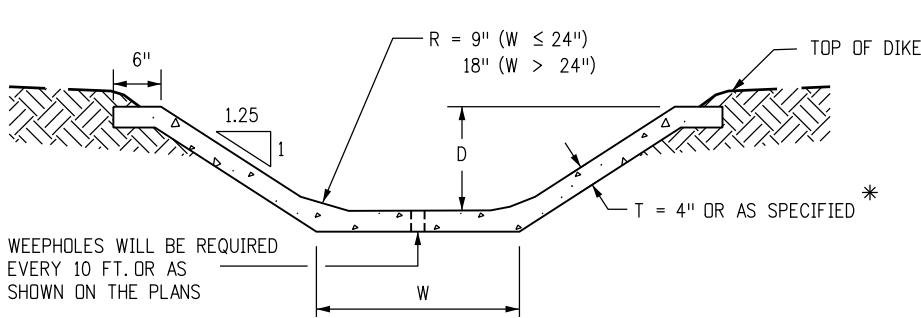


SECTION A-A
CONCRETE-LINED DITCH


* FOR SECTIONS WHERE $W \leq 18"$
AND $D \leq 18"$ USE $T = 3"$

D (INCHES)	CU. YDS. PER 100 LIN. FT.				
	W (INCHES)				
	12	18	24	36	48
18	6.3*	6.7*	9.6	10.8	12.0
24	9.9	10.5	11.6	12.8	14.0
30	12.3	12.9	13.5	14.8	16.0
36	14.3	14.9	15.5	16.7	18.0
48			19.4	20.7	21.9

CONCRETE-LINED DITCH
QUANTITIES

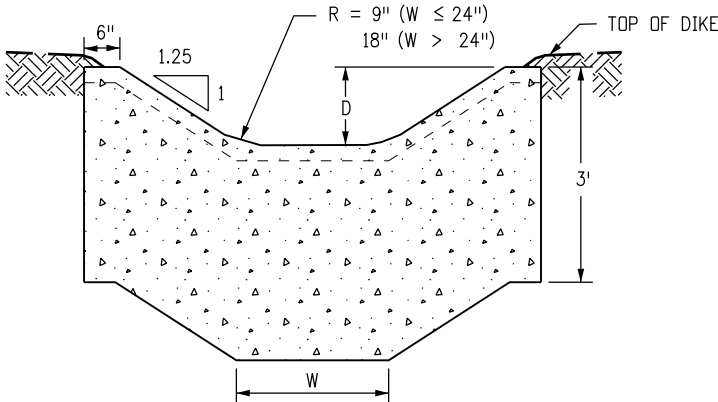


SECTION B-B
CUTOFF WALL

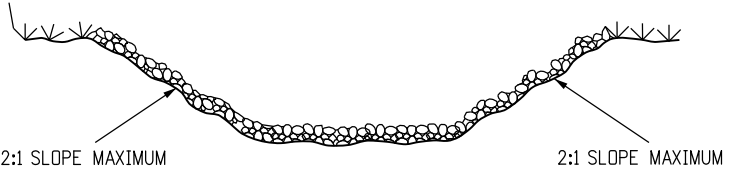


SECTION C-C
RIPRAP-LINED DITCH

RIPRAP GRADATION SHALL BE AS SPECIFIED IN THE CONTRACT.

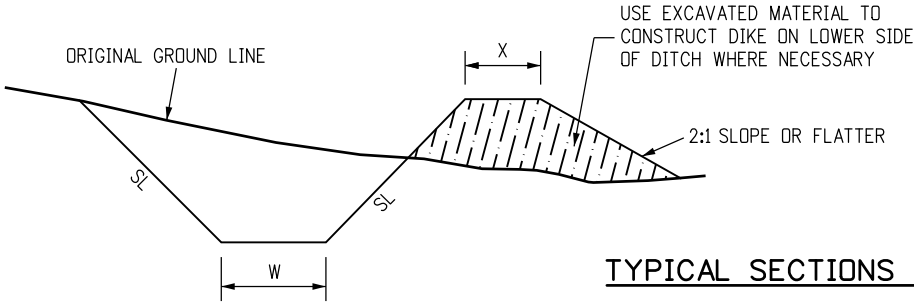

CUT SECTIONS

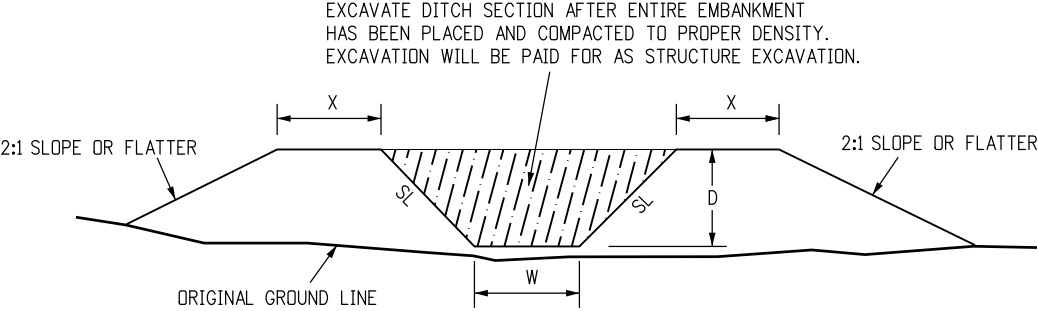

EMBANKMENT SECTIONS

NOTE: SEE STRUCTURE NOTES ON THE PLANS FOR DIMENSIONS W, D, AND SL.
DIMENSION X = W/2 WITH MINIMUM OF 2 FT. UNLESS OTHERWISE
SHOWN ON THE PLANS, W = 1 FT., SL = 2:1 OR FLATTER.

Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	DITCH TYPES	STANDARD PLAN NO.	
Creation Date: 07/31/19		Date:	Comments			M-203-2	
Designer Initials: JBK	(R-X)					Standard Sheet No. 1 of 1	
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:	
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						
				Issued by the Project Development Branch: July 31, 2019			

SUPERELEVATION NOTES

1. THIS STANDARD PLAN SHOWS THE REQUIRED RATES OF SUPERELEVATION FOR THE VARIOUS RADIUS LENGTHS AT DIFFERENT DESIGN SPEEDS FOR THE MAXIMUM SUPERELEVATION RATE OF 8%. ALTERNATIVE MAXIMUM RATE OF SUPERELEVATION SHALL BE USED FOR CROWNED HIGHWAYS WHEN SPECIFIED ON THE PLANS.
2. VALUES ARE FOR DESIGN ELEMENTS RELATED TO DESIGN SPEED AND HORIZONTAL CURVATURE FOR 2-LANE AND 4-LANE HIGHWAYS.
3. NUMBER OF LANES ROTATED:

A. ONE LANE ROTATED IS TYPICAL FOR A TWO-LANE HIGHWAY.

B. TWO LANES ROTATED ARE TYPICAL FOR A FOUR-LANE HIGHWAY.
4. SPIRALS ARE RECOMMENDED BELOW THE HEAVY LINE IN THE TABLES. SPIRALS ARE PERMISSIBLE BUT NOT RECOMMENDED ABOVE THE HEAVY LINE. SPIRAL LENGTHS MAY BE ROUNDED TO MULTIPLES OF 50 FEET FOR CALCULATION CONVENIENCE.

e max = 8% TABLE CONTINUES ON SHEET 2.

	Vd=15 mph			Vd=20 mph			Vd=25 mph			Vd=30 mph			Vd=35 mph			Vd=40 mph			Vd=45 mph			Vd=50 mph			
		L (FT.)			L (FT.)			L (FT.)			L (FT.)			L (FT.)			L (FT.)			L (FT.)			L (FT.)		
e (%)	R (FT.)	1 LN	2 LNS	R (FT.)	1 LN	2 LNS	R (FT.)	1 LN	2 LNS	R (FT.)	1 LN	2 LNS	R (FT.)	1 LN	2 LNS	R (FT.)	1 LN	2 LNS	R (FT.)	1 LN	2 LNS	R (FT.)	1 LN	2 LNS	e (%)
2.0	676<932	31	46	1190<1640	32	49	1720<2370	34	51	2370<3240	36	55	3120<4260	39	58	3970<5410	41	62	4930<6710	44	67	5990<8150	48	72	2.0
2.2	605<676	34	51	1070<1190	36	54	1550<1720	38	57	2130<2370	40	60	2800<3120	43	64	3570<3970	46	68	4440<4930	49	73	5400<5990	53	79	2.2
2.4	546<605	37	55	959<1070	39	58	1400<1550	41	62	1930<2130	44	65	2540<2800	46	70	3240<3570	50	74	4030<4440	53	80	4910<5400	58	86	2.4
2.6	496<546	40	60	872<959	42	63	1280<1400	45	67	1760<1930	47	71	2320<2540	50	75	2960<3240	54	81	3690<4030	58	87	4490<4910	62	94	2.6
2.8	453<496	43	65	796<872	45	68	1170<1280	48	72	1610<1760	51	76	2130<2320	54	81	2720<2960	58	87	3390<3690	62	93	4130<4490	67	101	2.8
3.0	415<453	46	69	730<796	49	73	1070<1170	51	77	1480<1610	55	82	1960<2130	58	87	2510<2720	62	93	3130<3390	67	100	3820<4130	72	108	3.0
3.2	382<415	49	74	672<730	52	78	985<1070	55	82	1370<1480	58	87	1820<1960	62	93	2330<2510	66	99	2900<3130	71	107	3550<3820	77	115	3.2
3.4	352<382	52	78	620<672	55	83	911<985	58	87	1270<1370	62	93	1690<1820	66	99	2170<2330	70	106	2700<2900	76	113	3300<3550	82	122	3.4
3.6	324<352	55	83	572<620	58	88	845<911	62	93	1180<1270	65	98	1570<1690	70	105	2020<2170	74	112	2520<2700	80	120	3090<3300	86	130	3.6
3.8	300<324	58	88	530<572	62	92	784<845	65	98	1100<1180	69	104	1470<1570	74	110	1890<2020	79	118	2360<2520	84	127	2890<3090	91	137	3.8
4.0	277<300	62	92	490<530	65	97	729<784	69	103	1030<1100	73	109	1370<1470	77	116	1770<1890	83	124	2220<2360	89	133	2720<2890	96	144	4.0
4.2	255<277	65	97	453<490	68	102	678<729	72	108	955<1030	76	115	1280<1370	81	122	1660<1770	87	130	2080<2220	93	140	2560<2720	101	151	4.2
4.4	235<255	68	102	418<453	71	107	630<678	75	113	893<955	80	120	1200<1280	85	128	1560<1660	91	137	1960<2080	98	147	2410<2560	106	158	4.4
4.6	215<235	71	106	384<418	75	112	585<630	79	118	834<893	84	125	1130<1200	89	134	1470<1560	95	143	1850<1960	102	153	2280<2410	110	166	4.6
4.8	193<215	74	111	349<384	78	117	542<585	82	123	779<834	87	131	1060<1130	93	139	1390<1470	99	149	1750<1850	107	160	2160<2280	115	173	4.8
5.0	172<193	77	115	314<349	81	122	499<542	86	129	727<779	91	136	991<1060	97	145	1310<1390	103	155	1650<1750	111	167	2040<2160	120	180	5.0
5.2	154<172	80	120	284<314	84	126	457<499	89	134	676<727	95	142	929<991	101	151	1230<1310	108	161	1560<1650	116	173	1930<2040	125	187	5.2
5.4	139<154	83	125	258<284	88	131	420<457	93	139	627<676	98	147	870<929	105	157	1160<1230	112	168	1480<1560	120	180	1830<1930	130	194	5.4
5.6	126<139	86	129	236<258	91	136	387<420	96	144	582<627	102	153	813<870	108	163	1090<1160	116	174	1390<1480	124	187	1740<1830	134	202	5.6
5.8	115<126	89	134	216<236	94	141	358<387	99	149	542<582	105	158	761<813	112	168	1030<1090	120	180	1320<1390	129	193	1650<1740	139	209	5.8
6.0	105<115	92	138	199<216	97	146	332<358	103	154	506<542	109	164	713<761	116	174	965<1030	124	186	1250<1320	133	200	1560<1650	144	216	6.0
6.2	97<105	95	143	184<199	101	151	308<332	106	159	472<506	113	169	669<713	120	180	909<965	128	192	1180<1250	138	207	1480<1560	149	223	6.2
6.4	89<97	98	148	170<184	104	156	287<308	110	165	442<472	116	175	628<669	124	186	857<909	132	199	1110<1180	142	213	1400<1480	154	230	6.4
6.6	82<89	102	152	157<170	107	161	267<287	113	170	413<442	120	180	590<628	128	192	808<857	137	205	1050<1110	147	220	1330<1400	158	238	6.6
6.8	76<82	105	157	146<157	110	165	248<267	117	175	386<413	124	185	553<590	132	197	761<808	141	211	990<1050	151	227	1260<1330	163	245	6.8
7.0	70<76	108	162	135<146	114	170	231<248	120	180	360<386	127	191	518<553	135	203	716<761	145	217	933<990	156	233	1190<1260	168	252	7.0
7.2	64<70	111	166	125<135	117	175	214<231	123	185	336<360	131	196	485<518	139	209	672<716	149	223	878<933	160	240	1120<1190	173	259	7.2
7.4	59<64	114	171	115<125	120	180	198<214	127	190	312<336	135	202	451<485	143	215	628<672	153	230	822<878	164	247	1060<1120	178	266	7.4
7.6	54<59	117	175	105<115	123	185	182<198	130	195	287<312	138	207	417<451	147	221	583<628	157	236	765<822	169	253	980<1060	182	274	7.6
7.8	48<54	120	180	94<105	126	190	164<182	134	201	261<287	142	213	380<417	151	226	533<583	161	242	701<765	173	260	901<980	187	281	7.8
8.0	38<48	123	185	76<94	130	195	134<164	137	206	214<261	145	218	314<380	155	232	444<533	166	248	587<701	178	267	758<901	192	288	8.0

e = SUPERELEVATION RATE


R - RADIUS OF CURVE

Vd - ASSUMED DESIGN SPEED

L - LENGTH OF SUPERELEVATION
RUNOFF OR SPIRAL LENGTH

LN - TRAVEL LANE

Computer File Information				Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development BranchJBK	SUPERELEVATION CROWNED AND DIVIDED HIGHWAYS		STANDARD PLAN NO.		
Creation Date: 07/31/19				Date:	Comments				M-203-11		
Designer Initials: JBK				(R-X)							
Last Modification Date: 07/31/19				(R-X)							
Detailer Initials: LTA				(R-X)							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English				(R-X)				Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:	

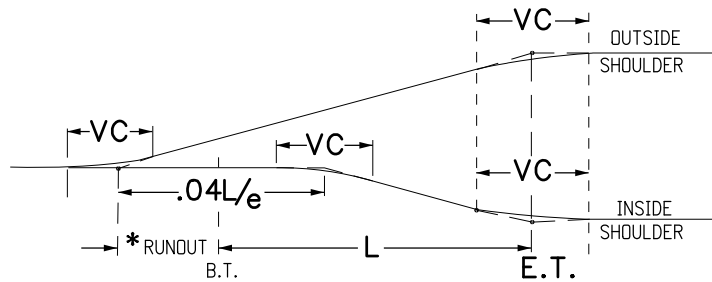


VC - TO OBTAIN SMOOTH PROFILES ON PAVEMENT EDGES, VERTICAL CURVES MAY BE INSERTED AT THE ANGULAR BREAK POINTS. UNLESS RESTRAINING CONDITIONS EXIST, THE LENGTH OF VERTICAL CURVE SELECTED, IN FEET, SHOULD BE AT LEAST NUMERICALLY EQUAL TO THE DESIGN SPEED, AND NO MORE THAN $.04L/e$.

* RUNOUT LENGTH SHOULD USUALLY BE $.02L/e$. WHEN CONDITIONS ARE SUCH THAT THIS LENGTH IS NOT SUITABLE, THE DESIGNER SHALL CHOOSE ANOTHER LENGTH TO SUIT CONDITIONS.

○ = PIVOT

◆ = WHEN CURVE IS NOT SPIRALED.


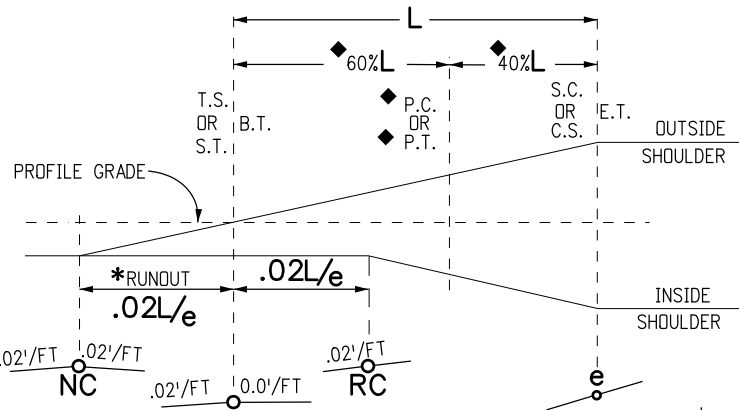


e = MAXIMUM RATE OF SUPERELEVATION IN FEET (PER FOOT OF WIDTH) FOR THE GIVEN RADIUS OF CURVE AND DESIGN SPEED.

SUPERELEVATION DIAGRAMS FOR CROWNED HIGHWAYS

e max = 8% TABLE CONTINUED FROM SHEET 1.

e (%)	V_d =50 mph				V_d =55 mph				V_d =60 mph				V_d =65 mph				V_d =70 mph				V_d =75 mph				V_d =80 mph				e (%)
	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	
2.0	5990<8150	48	72		7150<9720	51	77		8440<11500	53	80		9510<12900	56	84		10700<14500	60	90		12000<16100	63	95		13300<17800	69	103		2.0
2.2	5400<5990	53	79		6450<7150	56	84		7620<8440	59	88		8600<9510	61	92		9660<10700	66	99		10800<12000	69	104		12000<13300	75	113		2.2
2.4	4910<5400	58	86		5870<6450	61	92		6930<7620	64	96		7830<8600	67	100		8810<9660	72	108		9850<10800	76	114		11000<12000	82	123		2.4
2.6	4490<4910	62	94		5370<5870	66	100		6350<6930	69	104		7180<7830	73	109		8090<8810	78	117		9050<9850	82	123		10100<11000	89	134		2.6
2.8	4130<4490	67	101		4950<5370	71	107		5850<6350	75	112		6630<7180	78	117		7470<8090	84	126		8370<9050	88	133		9340<10100	96	144		2.8
3.0	3820<4130	72	108		4580<4950	77	115		5420<5850	80	120		6140<6630	84	126		6930<7470	90	135		7780<8370	95	142		8700<9340	103	154		3.0
3.2	3550<3820	77	115		4250<4580	82	123		5040<5420	85	128		5720<6140	89	134		6460<6930	96	144		7260<7780	101	152		8130<8700	110	165		3.2
3.4	3300<3550	82	122		3970<4250	87	130		4700<5040	91	136		5350<5720	95	142		6050<6460	102	153		6800<7260	107	161		7620<8130	117	175		3.4
3.6	3090<3300	86	130		3710<3970	92	138		4400<4700	96	144		5010<5350	100	151		5680<6050	108	162		6400<6800	114	171		7180<7620	123	185		3.6
3.8	2890<3090	91	137		3480<3710	97	146		4140<4400	101	152		4710<5010	106	159		5350<5680	114	171		6030<6400	120	180		6780<7180	130	195		3.8
4.0	2720<2890	96	144		3270<3480	102	153		3890<4140	107	160		4450<4710	112	167		5050<5350	120	180		5710<6030	126	189		6420<6780	137	206		4.0
4.2	2560<2720	101	151		3080<3270	107	161		3670<3890	112	168		4200<4450	117	176		4780<5050	126	189		5410<5710	133	199		6090<6420	144	216		4.2
4.4	2410<2560	106	158		2910<3080	112	169		3470<3670	117	176		3980<4200	123	184		4540<4780	132	198		5140<5410	139	208		5800<6090	151	226		4.4
4.6	2280<2410	110	166		2750<2910	117	176		3290<3470	123	184		3770<3980	128	193		4310<4540	138	207		4890<5140	145	218		5530<5800	158	237		4.6
4.8	2160<2280	115	173		2610<2750	123	184		3120<3290	128	192		3590<3770	134	201		4100<4310	144	216		4670<4890	152	227		5280<5530	165	247		4.8
5.0	2040<2160	120	180		2470<2610	128	191		2960<3120	133	200		3410<3590	140	209		3910<4100	150	225		4460<4670	158	237		5050<5280	171	257		5.0
5.2	1930<2040	125	187		2350<2470	133	199		2820<2960	139	208		3250<3410	145	218		3740<3910	156	234		4260<4460	164	246		4840<5050	178	267		5.2
5.4	1830<1930	130	194		2230<2350	138	207		2680<2820	144	216		3110<3250	151	226		3570<3740	162	243		4090<4260	171	256		4640<4840	185	278		5.4
5.6	1740<1830	134	202		2120<2230	143	214		2550<2680	149	224		2970<3110	156	234		3420<3570	168	252		3920<4090	177	265		4460<4640	192	288		5.6
5.8	1650<1740	139	209		2010<2120	148	222		2430<2550	155	232		2840<2970	162	243		3280<3420	174	261		3760<3920	183	275		4290<4460	199	298		5.8
6.0	1560<1650	144	216		1920<2010	153	230		2320<2430	160	240		2710<2840	167	251		3150<3280	180	270		3620<3760	189	284		4140<4290	206	309		6.0
6.2	1480<1560	149	223		1820<1920	158	237		2210<2320	165	248		2600<2710	173	260		3020<3150	186	279		3480<3620	196	294		3990<4140	213	319		6.2
6.4	1400<1480	154	230		1730<1820	163	245		2110<2210	171	256		2490<2600	179	268		2910<3020	192	288		3360<3480	202	303		3850<3990	219	329		6.4
6.6	1330<1400	158	238		1650<1730	169	253		2010<2110	176	264		2380<2490	184	276		2790<2910	198	297		3240<3360	208	313		3720<3850	226	339		6.6
6.8	1260<1330	163	245		1560<1650	174	260		1910<2010	181	272		2280<2380	190	285		2690<2790	204	306		3120<3240	215	322		3600<3720	233	350		6.8
7.0	1190<1260	168	252		1480<1560	179	268		1820<1910	187	280		2180<2280	195	293		2580<2690	210	315		3010<3120	221	332		3480<3600	240	360		7.0
7.2	1120<1190	173	259		1400<1480	184	276		1720<1820	192	288		2070<2180	201	301		2470<2580	216	324		2900<3010	227	341		3370<3480	247	370		7.2
7.4	1060<1120	178	266		1320<1400	189	283		1630<1720	197	296		1970<2070	207	310		2350<2470	222	333		2780<2900	234	351		3250<3370	254	381		7.4
7.6	980<1060	182	274		1230<1320	194	291		1530<1630	203	304		1850<1970	212	318		2230<2350	228	342		2650<2780	240	360		3120<3250	261	391		7.6
7.8	901<980	187	281		1140<1230	199	299		1410<1530	208	312		1720<1850	218	327		2090<2230	234	351		2500<2650	246	369		2970<3120	267	401		7.8
8.0	758<901	192	288		960<1140	204	306		1200<1410	213	320		1480<1720	223	335		1810<2090	240	360		2210<2500	253	379		2670<2970	274	411		8.0

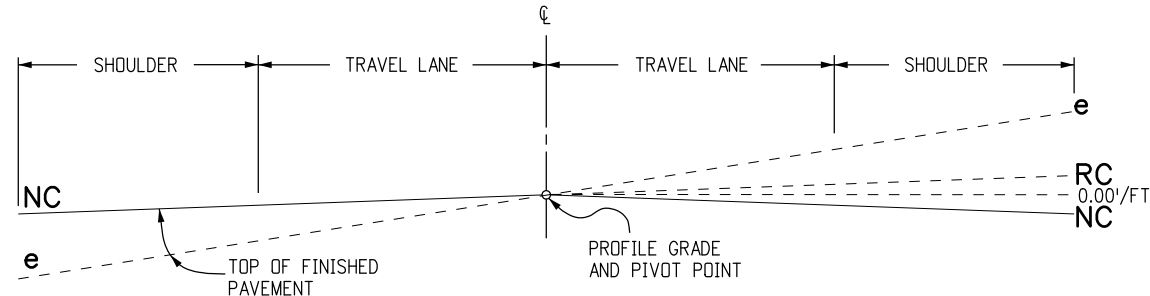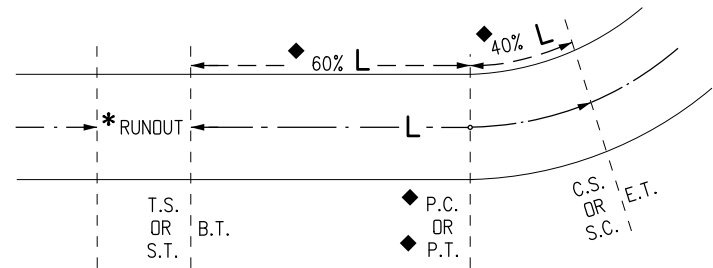

R - RADIUS OF CURVE

V_d - ASSUMED DESIGN SPEED

L - LENGTH OF SUPERELEVATION
RUNOFF OR SPIRAL LENGTH

NC - NORMAL CROWN SECTION

RC - REMOVE ADVERSE CROWN,
SUPERELEVATE AT NORMAL
CROWN SLOPE

VC - VERTICAL CURVE

LN - TRAVEL LANE

BT - BEGINNING OF TRANSITION

ET - ENDING OF TRANSITION

TS - TANGENT TO SPIRAL

ST - SPIRAL TO TANGENT

PC - POINT OF CURVATURE

PI - POINT OF INTERSECTION

PT - POINT OF TANGENT

CS - CURVE TO SPIRAL

SC - SPIRAL TO CURVE

SUPERELEVATION NOTES

- THIS STANDARD PLAN SHOWS THE REQUIRED RATES OF SUPERELEVATION FOR THE VARIOUS RADIUS LENGTHS AT DIFFERENT DESIGN SPEEDS FOR THE MAXIMUM SUPERELEVATION RATE OF 8%. ALTERNATIVE MAXIMUM RATE OF SUPERELEVATION SHALL BE USED FOR CROWNED HIGHWAYS WHEN SPECIFIED ON THE PLANS.
- VALUES ARE FOR DESIGN ELEMENTS RELATED TO DESIGN SPEED AND HORIZONTAL CURVATURE FOR 2-LANE AND 4-LANE HIGHWAYS.
- NUMBER OF LANES ROTATED:
 - ONE LANE ROTATED IS TYPICAL FOR A TWO-LANE HIGHWAY.
 - TWO LANES ROTATED ARE TYPICAL FOR A FOUR-LANE HIGHWAY.
- SPIRALS ARE RECOMMENDED BELOW THE HEAVY LINE IN THE TABLES. SPIRALS ARE PERMISSIBLE BUT NOT RECOMMENDED ABOVE THE HEAVY LINE. SPIRAL LENGTHS MAY BE ROUNDED TO MULTIPLES OF 50 FEET FOR CALCULATION CONVENIENCE.

Computer File Information

Creation Date: 07/31/19

Designer Initials: JBK

Last Modification Date: 07/31/19

Detailer Initials: LTA

CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

Sheet Revisions

Date:

Comments

(R-X)

(R-X)

(R-X)

(R-X)

Colorado Department of Transportation



2829 West Howard Place
CDDT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch

JBK

SUPERELEVATION CROWNED AND DIVIDED HIGHWAYS


Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.


M-203-11

Standard Sheet No. 2 of 3

Project Sheet Number:

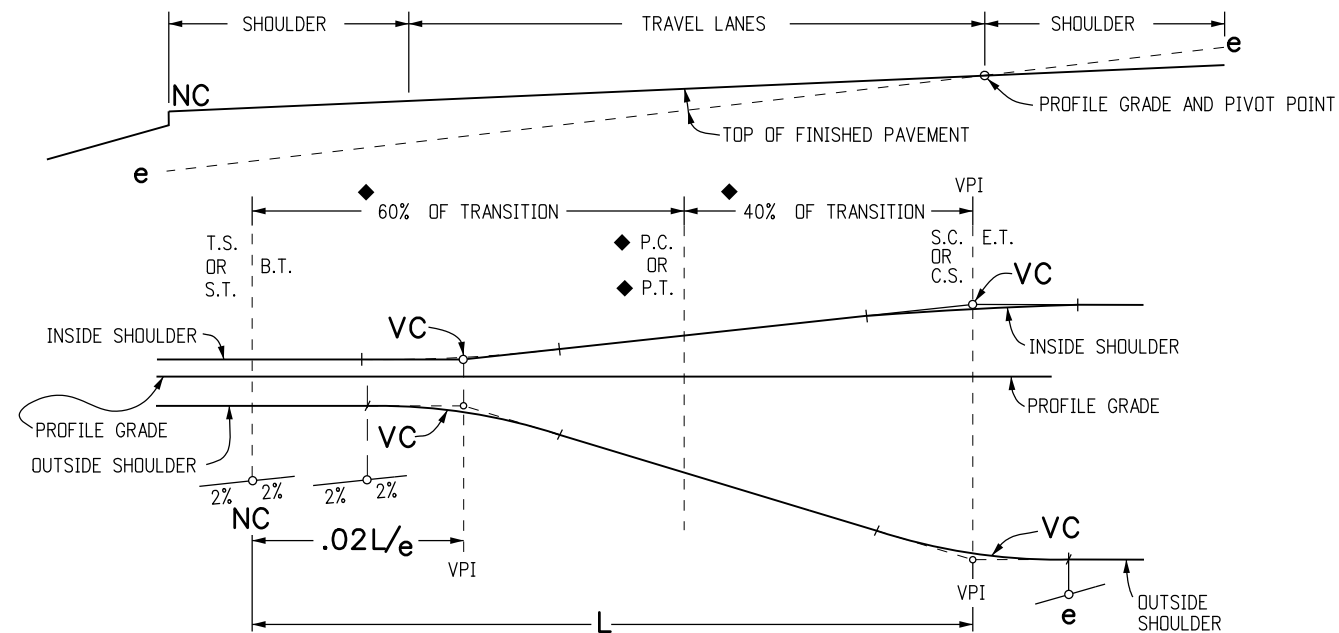

DIAGRAMMATIC PROFILE FOR SUPERELEVATION OF INSIDE LANES

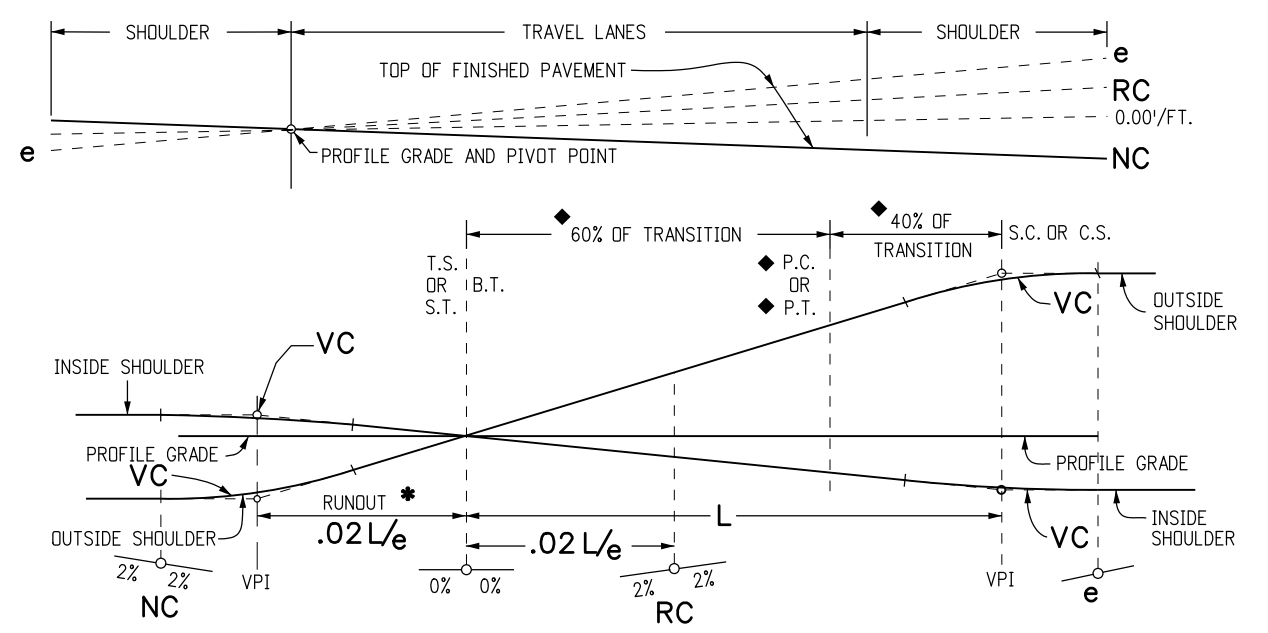

DIAGRAMMATIC PROFILE FOR SUPERELEVATION OF OUTSIDE LANES

SUPERELEVATION DIAGRAMS FOR DIVIDED HIGHWAYS SHOULDER PIVOT


VC - TO OBTAIN SMOOTH PROFILES ON PAVEMENT EDGES, VERTICAL CURVES MAY BE INSERTED AT THE ANGULAR BREAK POINTS. UNLESS RESTRAINING CONDITIONS EXIST, THE LENGTH OF VERTICAL CURVE SELECTED, IN FEET, SHOULD BE AT LEAST NUMERICALLY EQUAL TO THE DESIGN SPEED, AND NO MORE THAN $.04L/e$.

R - RADIUS OF CURVE
 V_d - ASSUMED DESIGN SPEED
 L - LENGTH OF SUPERELEVATION RUNOFF OR SPIRAL LENGTH
 NC - NORMAL CROWN SECTION
 RC - REMOVE ADVERSE CROWN, SUPERELEVATE AT NORMAL CROWN SLOPE

VC - VERTICAL CURVE
 BT - BEGINNING OF TRANSITION
 ET - ENDING OF TRANSITION
 TS - TANGENT TO SPIRAL
 ST - SPIRAL TO TANGENT
 PC - POINT OF CURVATURE
 PI - POINT OF INTERSECTION



PT - POINT OF TANGENT
 CS - CURVE TO SPIRAL
 SC - SPIRAL TO CURVE
 LN - TRAVEL LANE

○ = PIVOT
 ◆ = WHEN CURVE IS NOT SPIRALED.
 e = MAXIMUM RATE OF SUPERELEVATION IN FEET (PER FOOT OF WIDTH) FOR THE GIVEN RADIUS OF CURVE AND DESIGN SPEED.
 * RUNOUT LENGTH SHOULD USUALLY BE $.02 L/e$. WHEN CONDITIONS ARE SUCH THAT THIS LENGTH IS NOT SUITABLE, THE DESIGNER SHALL CHOOSE ANOTHER LENGTH TO SUIT CONDITIONS.

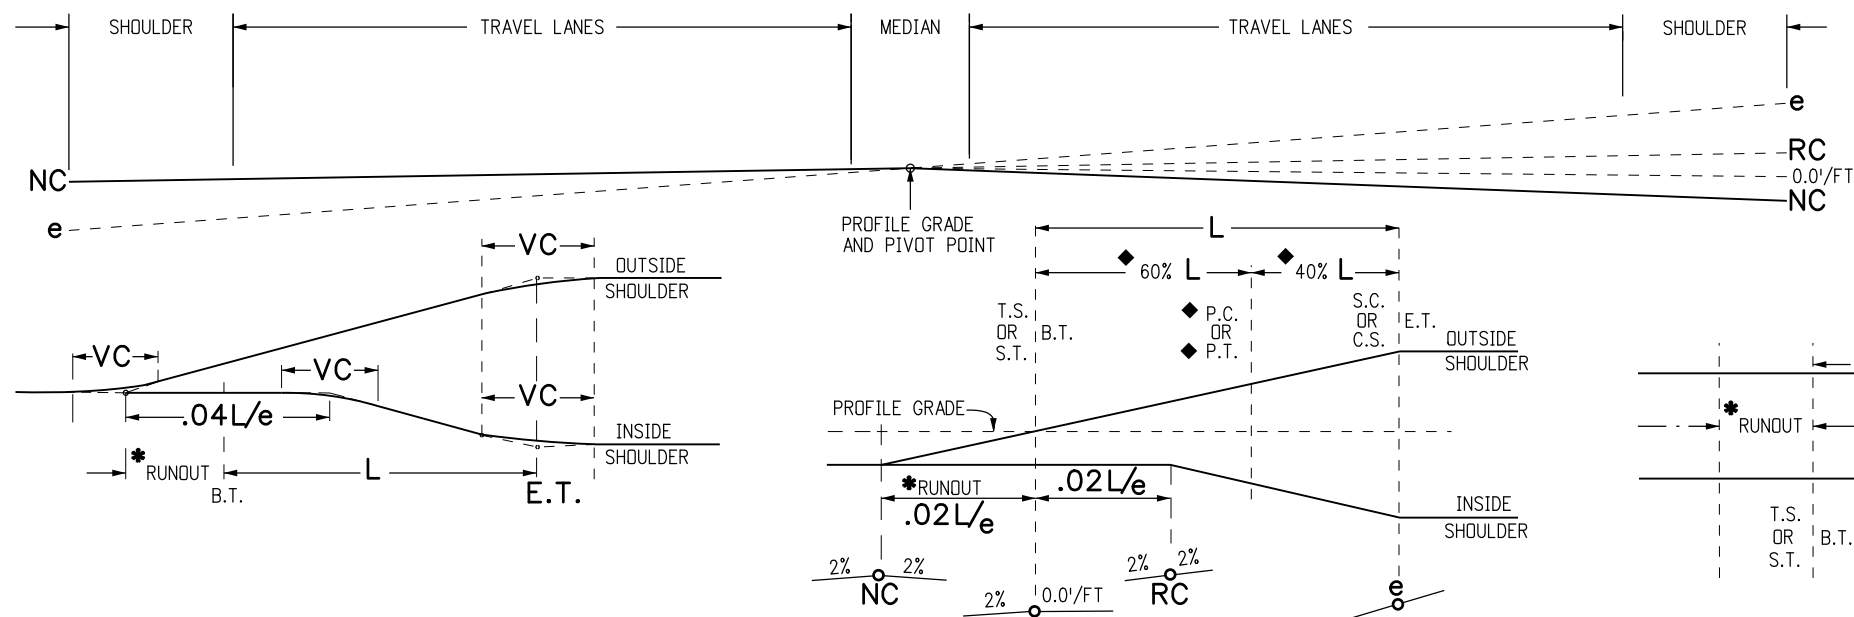


SUPERELEVATION DIAGRAMS FOR DIVIDED HIGHWAY CENTER PIVOT

Computer File Information		Sheet Revisions		 Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	SUPERELEVATION CROWNED AND DIVIDED HIGHWAYS		STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)	Date:	Comments		M-203-11		Standard Sheet No. 3 of 3
Designer Initials: JBK							
Last Modification Date: 07/31/19							
Detailer Initials: LTA							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English					Issued by the Project Development Branch: July 31, 2019	Project Sheet Number:	

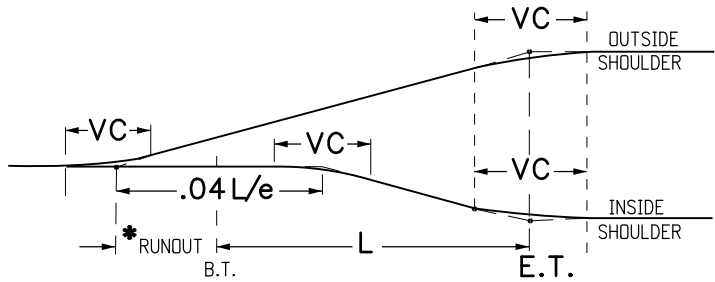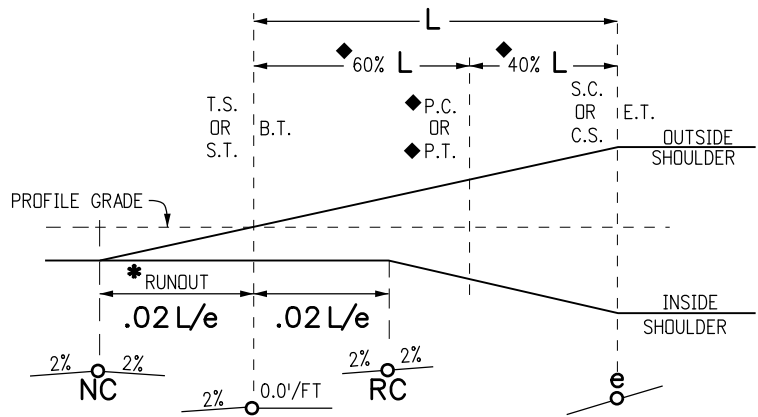


VC - TO OBTAIN SMOOTH PROFILES ON PAVEMENT EDGES, VERTICAL CURVES MAY BE INSERTED AT THE ANGULAR BREAK POINTS. UNLESS RESTRAINING CONDITIONS EXIST, THE LENGTH OF VERTICAL CURVE SELECTED, IN FEET, SHOULD BE AT LEAST NUMERICALLY EQUAL TO THE DESIGN SPEED, AND NO MORE THAN $.04L/e$.

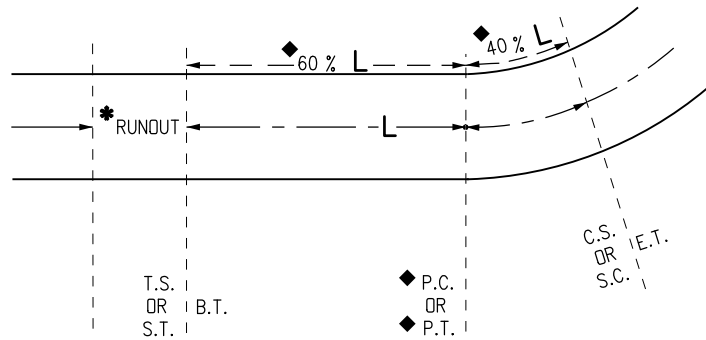

- = PIVOT
- ◆ = WHEN CURVE IS NOT SPIRALLED.
- e = MAXIMUM RATE OF SUPERELEVATION IN FEET (PER FOOT OF WIDTH) FOR THE GIVEN RADIUS OF CURVE AND DESIGN SPEED.
- * RUNOUT LENGTH SHOULD USUALLY BE $.02L/e$ WHEN CONDITIONS ARE SUCH THAT THIS LENGTH IS NOT SUITABLE, THE DESIGNER SHALL CHOOSE ANOTHER LENGTH TO SUIT CONDITIONS.

- R - RADIUS OF CURVE
- Vd - ASSUMED DESIGN SPEED
- L - LENGTH OF SUPERELEVATION RUNOFF OR SPIRAL LENGTH
- NC - NORMAL CROWN SECTION
- RC - REMOVE ADVERSE CROWN, SUPERELEVATE AT NORMAL CROWN SLOPE
- LN - TRAVEL LANE
- VC - VERTICAL CURVE
- BT - BEGINNING OF TRANSITION
- ET - ENDING OF TRANSITION
- TS - TANGENT TO SPIRAL
- ST - SPIRAL TO TANGENT
- PC - POINT OF CURVATURE
- PI - POINT OF INTERSECTION
- PT - POINT OF TANGENT
- CS - CURVE TO SPIRAL
- SC - SPIRAL TO CURVE

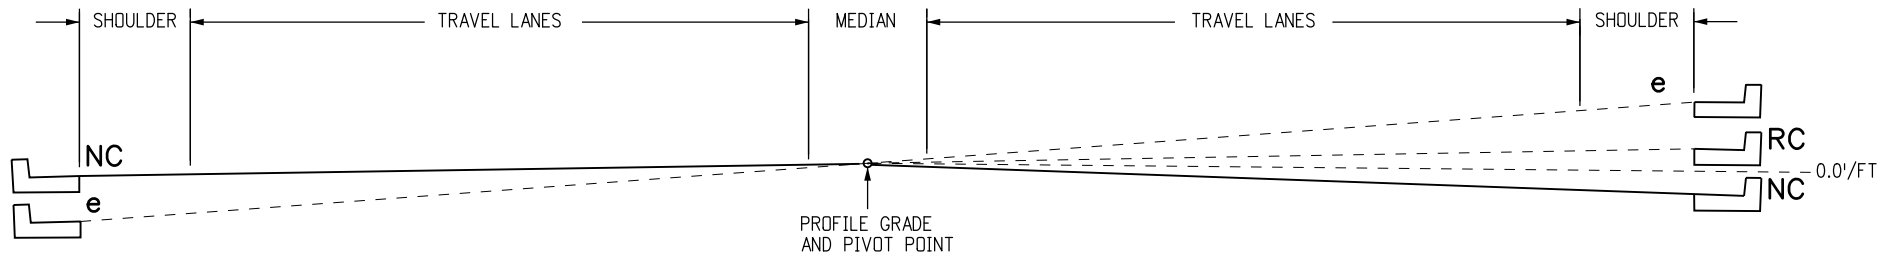

SUPERELEVATION DIAGRAMS

$e_{max} = 4\%$

IF THE CALCULATED RADIUS FALLS BETWEEN TWO RADII, GO TO THE NEXT LOWEST RADIUS VALUE.

e (%)	Vd=15 mph				Vd=20 mph				Vd=25 mph				Vd=30 mph				Vd=35 mph				Vd=40 mph				Vd=45 mph				Vd=50 mph				Vd=55 mph				Vd=60 mph				e (%)
	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	
2.0	506<796	31	46		902<1410	32	49		1340<2050	34	51		1880<2830	36	55		2490<3730	39	58		3220<4770	41	62		4040<5930	44	67		4940<7220	48	72		5950<8650	51	77		7080<10300	53	80		2.0
2.2	399<506	34	51		723<902	36	54		1110<1340	38	57		1580<1880	40	60		2120<2490	43	64		2760<3220	46	68		3480<4040	49	73		4280<4940	53	79		5180<5950	56	84		6190<7080	59	88		2.2
2.4	271<399	37	55		513<723	39	58		838<1110	41	62		1270<1580	44	65		1760<2120	46	70		2340<2760	50	74		2980<3480	53	80		3690<4280	58	86		4500<5180	61	92		5410<6190	64	96		2.4
2.6	201<271	40	60		388<513	42	63		650<838	45	67		1000<1270	47	71		1420<1760	50	75		1930<2340	54	81		2490<2980	58	87		3130<3690	62	94		3870<4500	66	100		4700<5410	69	104		2.6
2.8	157<201	43	65		308<388	45	68		524<650	48	72		817<1000	51	76		1170<1420	54	81		1620<1930	58	87		2100<2490	62	93		2660<3130	67	101		3310<3870	71	107		4060<4700	75	112		2.8
3.0	127<157	46	69		251<308	49	73		433<524	51	77		681<817	55	82		982<1170	58	87		1370<1620	62	93		1800<2100	67	100		2290<2660	72	108		2860<3310	77	115		3530<4060	80	120		3.0
3.2	105<127	49	74		209<251	52	78		363<433	55	82		576<681	58	87		835<982	62	93		1180<1370	66	99		1550<1800	71	107		1980<2290	77	115		2490<2860	82	123		3090<3530	85	128		3.2
3.4	88<105	52	78		175<209	55	83		307<363	58	87		490<576	62	93		714<835	66	99		1010<1180	70	106		1340<1550	76	113		1720<1980	82	122		2170<2490	87	130		2700<3090	91	136		3.4
3.6	73<88	55	83		147<175	58	88		259<307	62	93		416<490	65	98		610<714	70	105		865<1010	74	112		1150<1340	80	120		1480<1720	86	130		1880<2170	92	138		2350<2700	96	144		3.6
3.8	61<73	58	88		122<147	62	92		215<259	65	98		348<416	69	104		512<610	74	110		730<865	79	118		970<1150	84	127		1260<1480	91	137		1600<1880	97	146		2010<2350	101	152		3.8
4.0	42<61	62	92		86<122	65	97		154<215	69	103		250<348	73	109		371<512	77	116		533<730	83	124		711<970	89	133		926<1260	96	144		1190<1600	102	153		1500<2010	107	160		4.0



SUPERELEVATION NOTES

- THIS STANDARD PLAN SHOWS THE REQUIRED RATES OF SUPERELEVATION FOR THE VARIOUS RADIUS LENGTHS AT DIFFERENT DESIGN SPEEDS FOR THE MAXIMUM SUPERELEVATION RATE OF 4%. ALTERNATIVE MAXIMUM RATE OF SUPERELEVATION SHALL BE USED FOR STREETS WHEN SPECIFIED ON THE PLANS.
- USE OF $e_{max} = 4\%$ SHOULD BE LIMITED TO URBAN CONDITIONS.
- VALUES ARE FOR DESIGN ELEMENTS RELATED TO DESIGN SPEED AND HORIZONTAL CURVATURE FOR TWO LANE AND FOUR LANE STREETS.
- WHERE SIDE STREETS OR ROADS INTERSECT, THE RATE OF SUPERELEVATION MAY BE REDUCED TO FACILITATE A SMOOTH INTERSECTION OF THE PROFILE GRADES.
- NUMBER OF LANES ROTATED:
 - ONE LANE ROTATED IS TYPICAL FOR A TWO-LANE HIGHWAY.
 - TWO LANES ROTATED ARE TYPICAL FOR A FOUR-LANE HIGHWAY.
- SPIRALS ARE RECOMMENDED BELOW THE HEAVY LINE IN THE TABLES. SPIRALS ARE PERMISSIBLE BUT NOT RECOMMENDED ABOVE THE HEAVY LINES. SPIRAL LENGTHS MAY BE ROUNDED TO MULTIPLES OF 50 FEET FOR CALCULATION CONVENIENCE.


Computer File Information				(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	SUPERELEVATION STREETS	STANDARD PLAN NO.		
Creation Date: 07/31/19					Date:	Comments			M-203-12		
Designer Initials: JBK											
Last Modification Date: 07/31/19										Standard Sheet No. 1 of 2	
Detailer Initials: LTA											
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English										Issued by the Project Development Branch: July 31, 2019	
										Project Sheet Number:	

SUPERELEVATION STREETS

Issued by the Project Development Branch: July 31, 2019

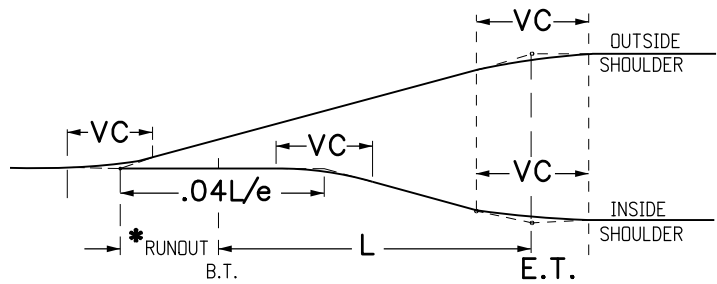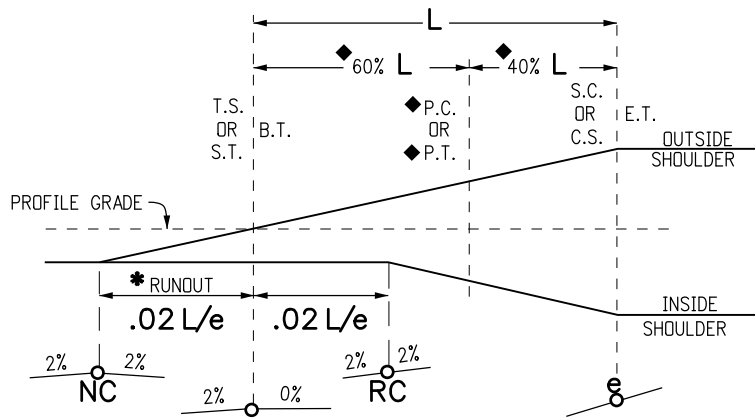


VC - TO OBTAIN SMOOTH PROFILES ON PAVEMENT EDGES, VERTICAL CURVES MAY BE INSERTED AT THE ANGULAR BREAK POINTS. UNLESS RESTRAINING CONDITIONS EXIST, THE LENGTH OF VERTICAL CURVE SELECTED, IN FEET, SHOULD BE NO LESS THAN NUMERICALLY EQUAL TO THE DESIGN SPEED, AND NO MORE THAN $.04 L/e$.

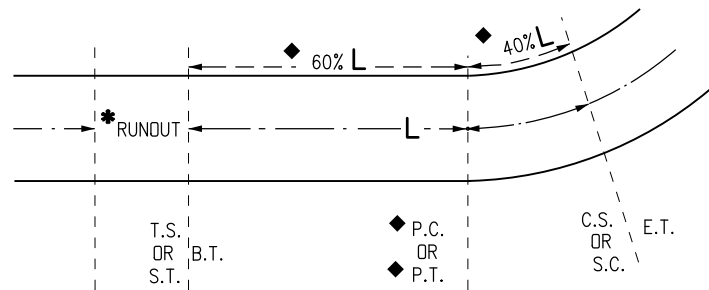

- = PIVOT
- ◆ = WHEN CURVE IS NOT SPIRALLED.
- e = MAXIMUM RATE OF SUPERELEVATION IN FEET (PER FOOT OF WIDTH) FOR THE GIVEN RADIUS OF CURVE AND DESIGN SPEED.
- * RUNOUT LENGTH SHOULD USUALLY BE $.02 L/e$ WHEN CONDITIONS ARE SUCH THAT THIS LENGTH IS NOT SUITABLE, THE DESIGNER SHALL CHOOSE ANOTHER LENGTH TO SUIT CONDITIONS.

- R - RADIUS OF CURVE
- Vd - ASSUMED DESIGN SPEED
- L - LENGTH OF SUPERELEVATION RUNOFF OR SPIRAL LENGTH
- NC - NORMAL CROWN SECTION
- RC - REMOVE ADVERSE CROWN, SUPERELEVATE AT NORMAL CROWN SLOPE
- LN - TRAVEL LANE
- VC - VERTICAL CURVE
- BT - BEGINNING OF TRANSITION
- ET - ENDING OF TRANSITION
- TS - TANGENT TO SPIRAL
- ST - SPIRAL TO TANGENT
- PC - POINT OF CURVATURE
- PI - POINT OF INTERSECTION
- PT - POINT OF TANGENT
- CS - CURVE TO SPIRAL
- SC - SPIRAL TO CURVE

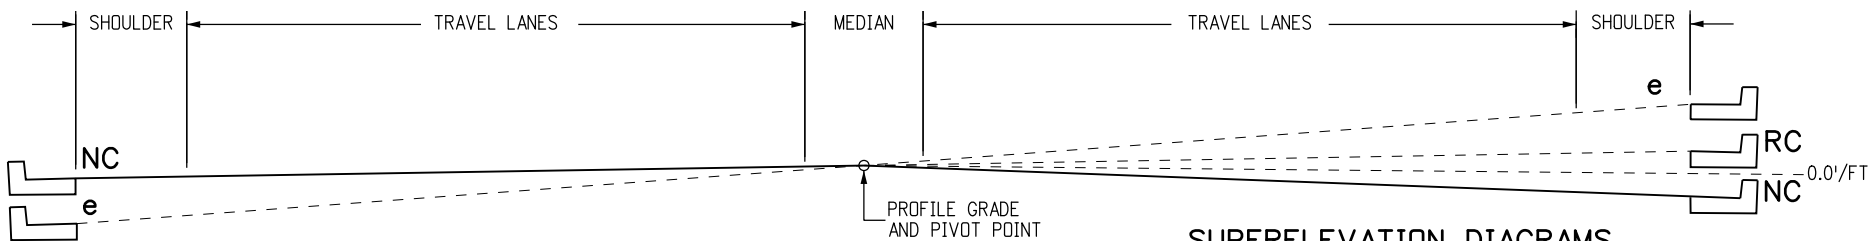

SUPERELEVATION DIAGRAMS

$e_{max} = 6\%$

e (%)	Vd =15 mph				Vd =20 mph				Vd =25 mph				Vd =30 mph				Vd =35 mph				Vd =40 mph				Vd =45 mph				Vd =50 mph				Vd =55 mph				Vd =60 mph				e (%)
	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	R (FT.)	1 LN	2 LNS	L (FT.)	
2.0	614-<868	31	46		1120-<1580	32	49		1630-<2290	34	51		2240-<3130	36	55		2950-<4100	39	58		3770-<5230	41	62		4680-<6480	44	67		5700-<7870	48	72		6820-<9410	51	77		8060-<11100	53	80		2.0
2.2	543-<614	34	51		991-<1120	36	54		1450-<1630	38	57		2000-<2240	40	60		2630-<2950	43	64		3370-<3770	46	68		4190-<4680	49	73		5100-<5700	53	79		6110-<6820	56	84		7230-<8060	59	88		2.2
2.4	482-<543	37	55		884-<991	39	58		1300-<1450	41	62		1790-<2000	44	65		2360-<2630	46	70		3030-<3370	50	74		3770-<4190	53	80		4600-<5100	58	86		5520-<6110	61	92		6540-<7230	64	96		2.4
2.6	430-<482	40	60		791-<884	42	63		1170-<1300	45	67		1610-<1790	47	71		2130-<2360	50	75		2740-<3030	54	81		3420-<3770	58	87		4170-<4600	62	94		5020-<5520	66	100		5950-<6540	69	104		2.6
2.8	384-<430	43	65		709-<791	45	68		1050-<1170	48	72		1460-<1610	51	76		1930-<2130	54	81		2490-<2740	58	87		3110-<3420	62	93		3800-<4170	67	101		4580-<5020	71	107		5440-<5950	75	112		2.8
3.0	341-<384	46	69		635-<709	49	73		944-<1050	51	77		1320-<1460	55	82		1760-<1930	58	87		2270-<2490	62	93		2840-<3110	67	100		3480-<3800	72	108		4200-<4580	77	115		4990-<5440	80	120		3.0
3.2	300-<341	49	74		566-<635	52	78		850-<944	55	82		1200-<1320	58	87		1600-<1760	62	93		2080-<2270	66	99		2600-<2840	71	107		3200-<3480	77	115		3860-<4200	82	123		4600-<4990	85	128		3.2
3.4	256-<300	52	78		498-<566	55	83		761-<850	58	87		1080-<1200	62	93		1460-<1600	66	99		1900-<2080	70	106		2390-<2600	76	113		2940-<3200	82	122		3560-<3860	87	130		4250-<4600	91	136		3.4
3.6	209-<256	55	83		422-<498	58	88		673-<761	62	93		972-<1080	65	98		1320-<1460	70	105		1740-<1900	74	112		2190-<2390	80	120		2710-<2940	86	130		3290-<3560	92	138		3940-<4250	96	144		3.6
3.8	176-<209	58	88		358-<422	62	92		583-<673	65	98		864-<972	69	104		1190-<1320	74	110		1590-<1740	79	118		2010-<2190	84	127		2490-<2710	91	137		3040-<3290	97	146		3650-<3940	101	152		3.8
4.0	151-<176	62	92		309-<358	65	97		511-<583	69	103		766-<864	73	109		1070-<1190	77	116		1440-<1590	83	124		1840-<2010	89	133		2300-<2490	96	144		2810-<3040	102	153		3390-<3650	107	160		4.0
4.2	131-<151	65	97		270-<309	68	102		452-<511	72	108		684-<766	76	115		960-<1070	81	122		1310-<1440	87	130		1680-<1840	93	140		2110-<2300	101	151		2590-<2810	107	161		3140-<3390	112	168		4.2
4.4	116-<131	68	102		238-<270	71	107		402-<452	75	113		615-<684	80	120		868-<960	85	128		1190-<1310	91	137		1540-<1680	98	147		1940-<2110	106	158		2400-<2590	112	169		2920-<3140	117	176		4.4
4.6	102-<116	71	106		212-<238	75	112		360-<402	79	118		555-<615	84	125		788-<868	89	134		1090-<1190	95	143		1410-<1540	102	153		1780-<1940	110	166		2210-<2400	117	176		2710-<2920	123	184		4.6
4.8	91-<102	74	111		189-<212	78	117		324-<360	82	123		502-<555	87	131		718-<788	93	139		995-<1090	99	149		1300-<1410	107	160		1640-<1780	115	173		2050-<2210	123	184		2510-<2710	128	192		4.8
5.0	82-<91	77	115		169-<189	81	122		292-<324	86	129		456-<502	91	136		654-<718	97	145		911-<995	103	155		1190-<1300	111	167		1510-<1640	120	180		1890-<2050	128	191		2330-<2510	133	200		5.0
5.2	73-<82	80	120		152-<169	84	126		264-<292	89	134		413-<456	95	142		595-<654	101	151		833-<911	108	161		1090-<1190	116	173		1390-<1510	125	187		1750-<1890	133	199		2160-<2330	139	208		5.2
5.4	65-<73	83	125		136-<152	88	131		237-<264	93	139		373-<413	98	147		540-<595	105	157		759-<833	112	168		995-<1090	120	180		1280-<1390	130	194		1610-<1750	138	207		1990-<2160	144	216		5.4
5.6	58-<65	86	129		121-<136	91	136		212-<237	96	144		335-<373	102	153		487-<540	108	163		687-<759	116	174		903-<995	124	187		1160-<1280	134	202		1470-<1610	143	214		1830-<1990	149	224		5.6
5.8	51-<58	89	134		106-<121	94	141		186-<212	99	149		296-<335	105	158		431-<487	112	168		611-<687	120	180		806-<903	129	193		1040-<1160	139	209		1320-<1470	148	222		1650-<1830	155	232		5.8
6.0	39-<51	92	138		81-<106	97	146		144-<186	103	154		231-<296	109	164		340-<431	116	174		485-<611	124	186		643-<806	133	200		833-<1040	144	216		1060-<1320	153	230		1330-<1650	160	240		6.0

SUPERELEVATION NOTES

- THIS STANDARD PLAN SHOWS THE REQUIRED RATES OF SUPERELEVATION FOR THE VARIOUS RADIUS LENGTHS AT DIFFERENT DESIGN SPEEDS FOR THE MAXIMUM SUPERELEVATION RATE OF 6%. MAXIMUM RATE OF SUPERELEVATION SHALL BE USED FOR STREETS WHEN SPECIFIED ON THE PLANS.
- VALUES ARE FOR DESIGN ELEMENTS RELATED TO DESIGN SPEED AND HORIZONTAL CURVATURE FOR TWO LANE AND FOUR LANE STREETS.
- WHERE SIDE STREETS OR ROADS INTERSECT, THE RATE OF SUPERELEVATION MAY BE REDUCED TO FACILITATE A SMOOTH INTERSECTION OF THE PROFILE GRADES.
- NUMBER OF LANES ROTATED:
 - A. ONE LANE ROTATED IS TYPICAL FOR A TWO-LANE HIGHWAY.
 - B. TWO LANES ROTATED ARE TYPICAL FOR A FOUR-LANE HIGHWAY.
- SPIRALS ARE RECOMMENDED BELOW THE HEAVY LINE IN THE TABLES. SPIRALS ARE PERMISSIBLE BUT NOT RECOMMENDED ABOVE THE HEAVY LINES. SPIRAL LENGTHS MAY BE ROUNDED TO MULTIPLES OF 50 FEET FOR CALCULATION CONVENIENCE.

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

(R-X)
(R-X)
(R-X)
(R-X)

Sheet Revisions

Date:	Comments



Colorado Department of Transportation
2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868
Project Development Branch JBK

SUPERELEVATION STREETS


Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.

M-203-12


Standard Sheet No. 2 of 2

Project Sheet Number:

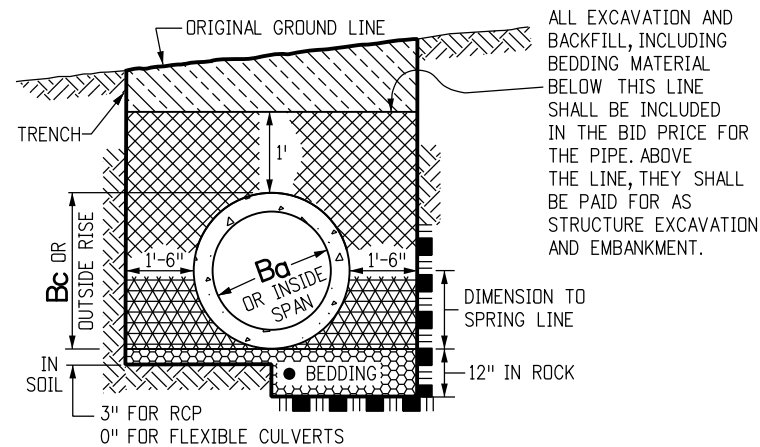


PIPE IN TRENCH


- THE BEDDING MATERIAL FOR RIGID PIPE IN SOIL SHALL BE 3 IN. OF LOOSE STRUCTURE BACKFILL (CLASS 1 OR 2). BEDDING IS NOT REQUIRED FOR FLEXIBLE PIPE IN SOIL. BEDDING MATERIAL FOR RIGID OR FLEXIBLE PIPE IN ROCK SHALL BE 12 IN. OF LOOSE STRUCTURE BACKFILL, CLASS 1.

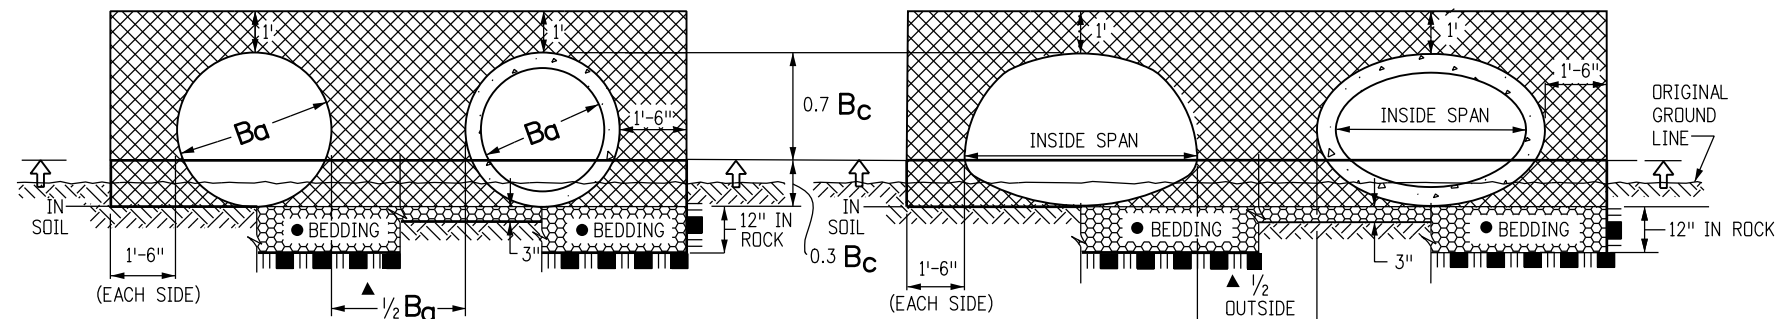


CIRCULAR PIPE IN FILL

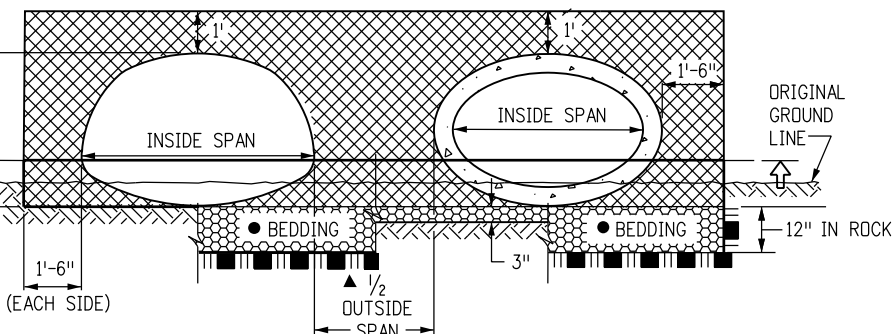

ARCH OR ELLIPTICAL PIPE IN FILL

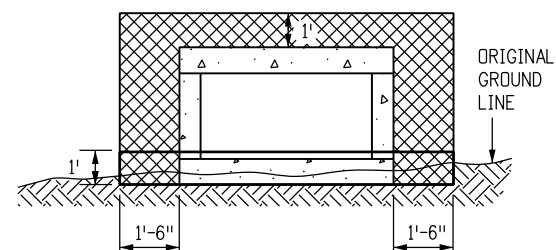


APPLIES WHEN THE ORIGINAL GROUND LINE IS LESS THEN 1 FT. ABOVE THE BOTTOM OF THE BOX CULVERT. THE EMBANKMENT SHALL BE BUILT UP TO 1 FT. ABOVE THE BOTTOM OF THE BOX CULVERT AND THEN EXCAVATED TO THE BOTTOM OF THE BOX CULVERT. THIS EMBANKMENT AND EXCAVATION WILL NOT BE MEASURED AND PAID FOR SEPARATELY BUT SHALL BE INCLUDED IN THE COST OF THE WORK.

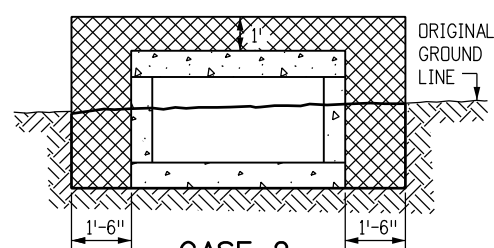

APPLIES WHEN THE ORIGINAL GROUND LINE
IS MORE THAN 1 FT. ABOVE THE
BOTTOM OF THE BOX CULVERT.

CONCRETE BOX CULVERT

IN BOTH CASES, THE TRENCH (OUTLINED BY THE THICK SOLID LINE)
SHALL THEN BE EXCAVATED TO ACCOMMODATE CONSTRUCTION OF THE BOX CULVERT.

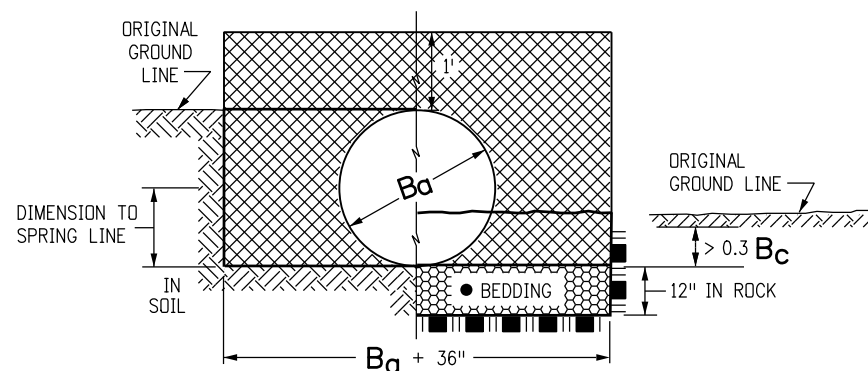

CIRCULAR PIPE


(WHERE ORIGINAL GROUND LINE IS BETWEEN
0.3 B_c AND $B_c + 1$ FT. ABOVE FLOWLINE)

- ▲ WHEN TWO OR MORE CONDUITS ARE LAID SIDE-BY-SIDE, THEY SHALL BE PLACED SO THAT THEY ARE 1/2" OUTSIDE DIAMETER, OR 1/2" OUTSIDE SPAN, OR 3 FT. APART, WHICHEVER IS LESS. HOWEVER, IF END SECTIONS ARE USED, THE MINIMUM SPACING SHALL BE 1 FT. BETWEEN END SECTIONS.


GENERAL NOTES

1. EXCAVATION AND BACKFILL PATTERNS DIFFERENT FROM THOSE INDICATED ON THESE SHEETS WILL BE SHOWN ELSEWHERE ON THE PLANS.
2. EXCAVATION FOR CHANNEL CHANGE OR CHANNEL IMPROVEMENT WILL BE EITHER UNCLASSIFIED EXCAVATION OR MUCK EXCAVATION AND WILL BE NOTED ON THE PLANS. EXCAVATION FROM THE CHANNEL FLOWLINE TO THE DEPTH REQUIRED FOR THE NEW STRUCTURE AND INCIDENTAL CHANNEL EXCAVATION WILL BE PAID FOR AS STRUCTURE EXCAVATION.
3. STRUCTURE FOOTINGS WHICH ARE LOCATED IN ROCK SHALL BE POURED OUT TO UNDISTURBED ROCK WITHOUT FORMING IN CONFORMANCE WITH SUBSECTION 601.09(b).
4. STRUCTURAL PLATE CULVERTS SHALL BE CONSTRUCTED AS SHOWN ON THE PLANS.
5. **B_a** EQUALS THE INSIDE DIAMETER OF A PIPE AND **B_c** EQUALS THE OUTSIDE DIAMETER OF A PIPE. FOR THIN WALLED PIPES, IT IS ASSUMED THAT **B_a = B_c**.
6. APPROXIMATE STRUCTURE EXCAVATION AND BACKFILL QUANTITIES, UP TO 1 FT. OVER THE PIPE WILL BE SHOWN ON THE PLANS, FOR INFORMATION ONLY.


LEGEND

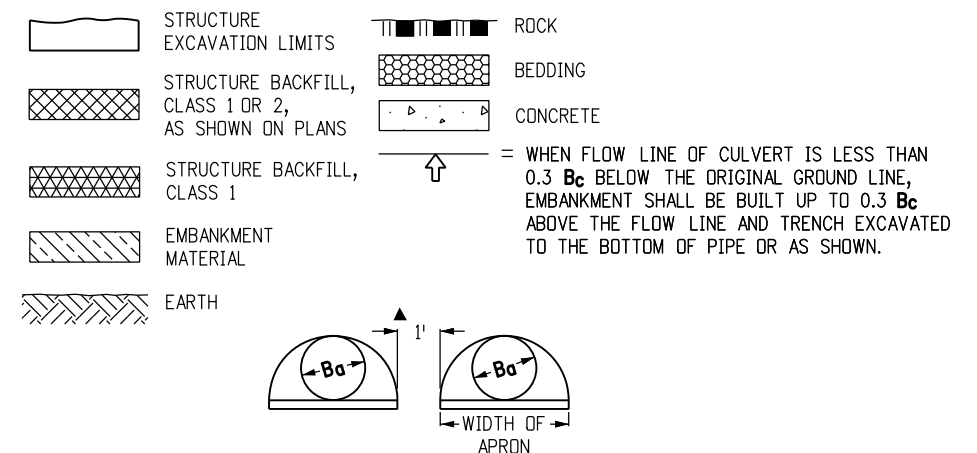

CONDUIT WITH END SECTIONS

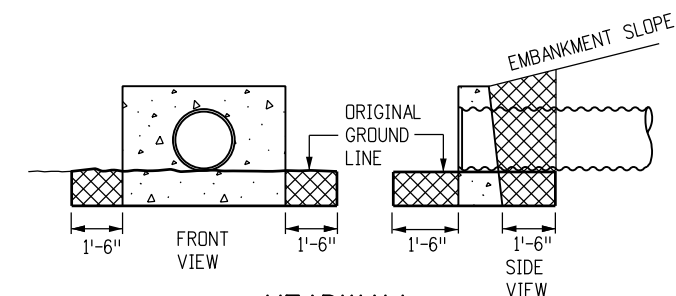


HEADWALL

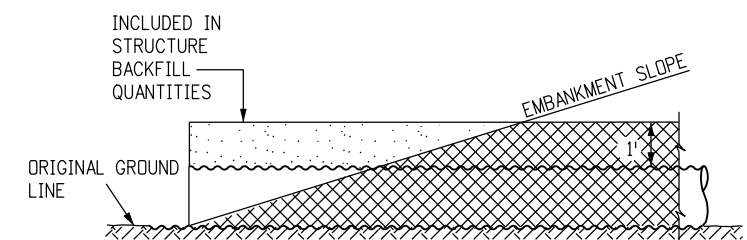


END OF PIPE


Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDDT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	EXCAVATION AND BACKFILL FOR STRUCTURES		STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)	Date:	Comments		M-206-1		Standard Sheet No. 1 of 2	
Designer Initials: JBK								
Last Modification Date: 07/31/19								
Detailer Initials: LTA								
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English					Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:	

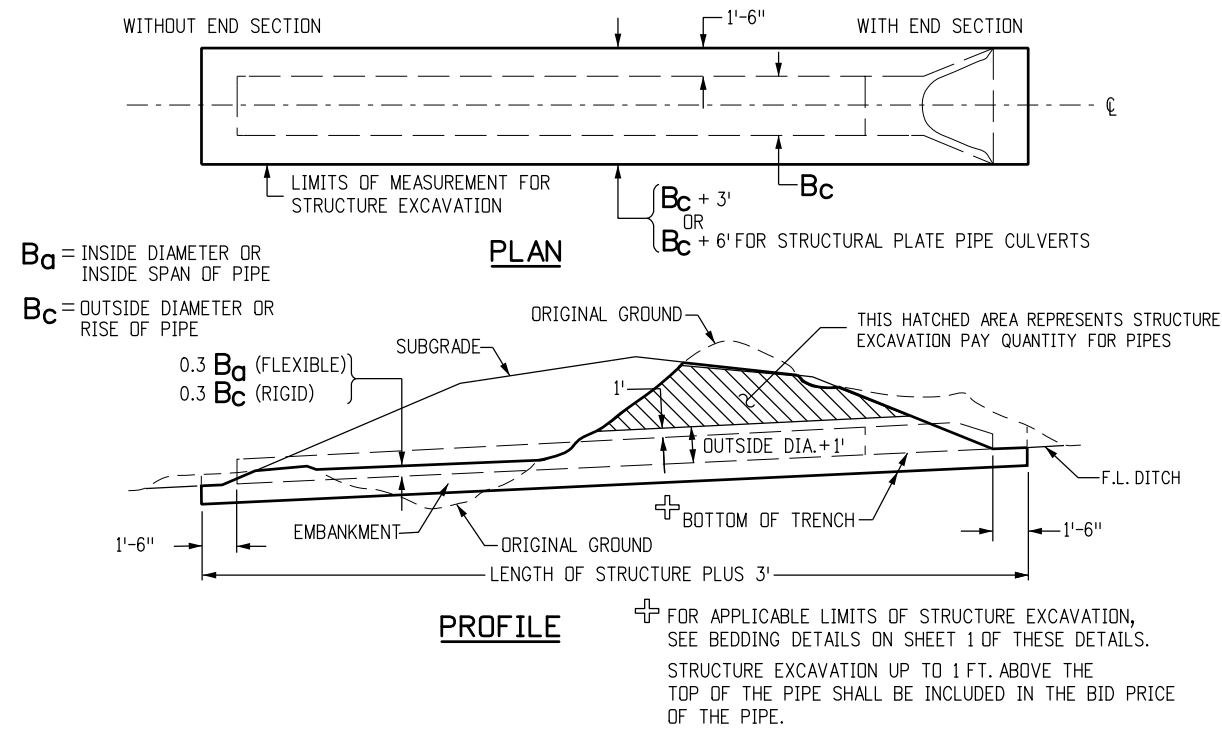


STRUCTURE EXCAVATION MEASUREMENT FOR PIPE CULVERTS

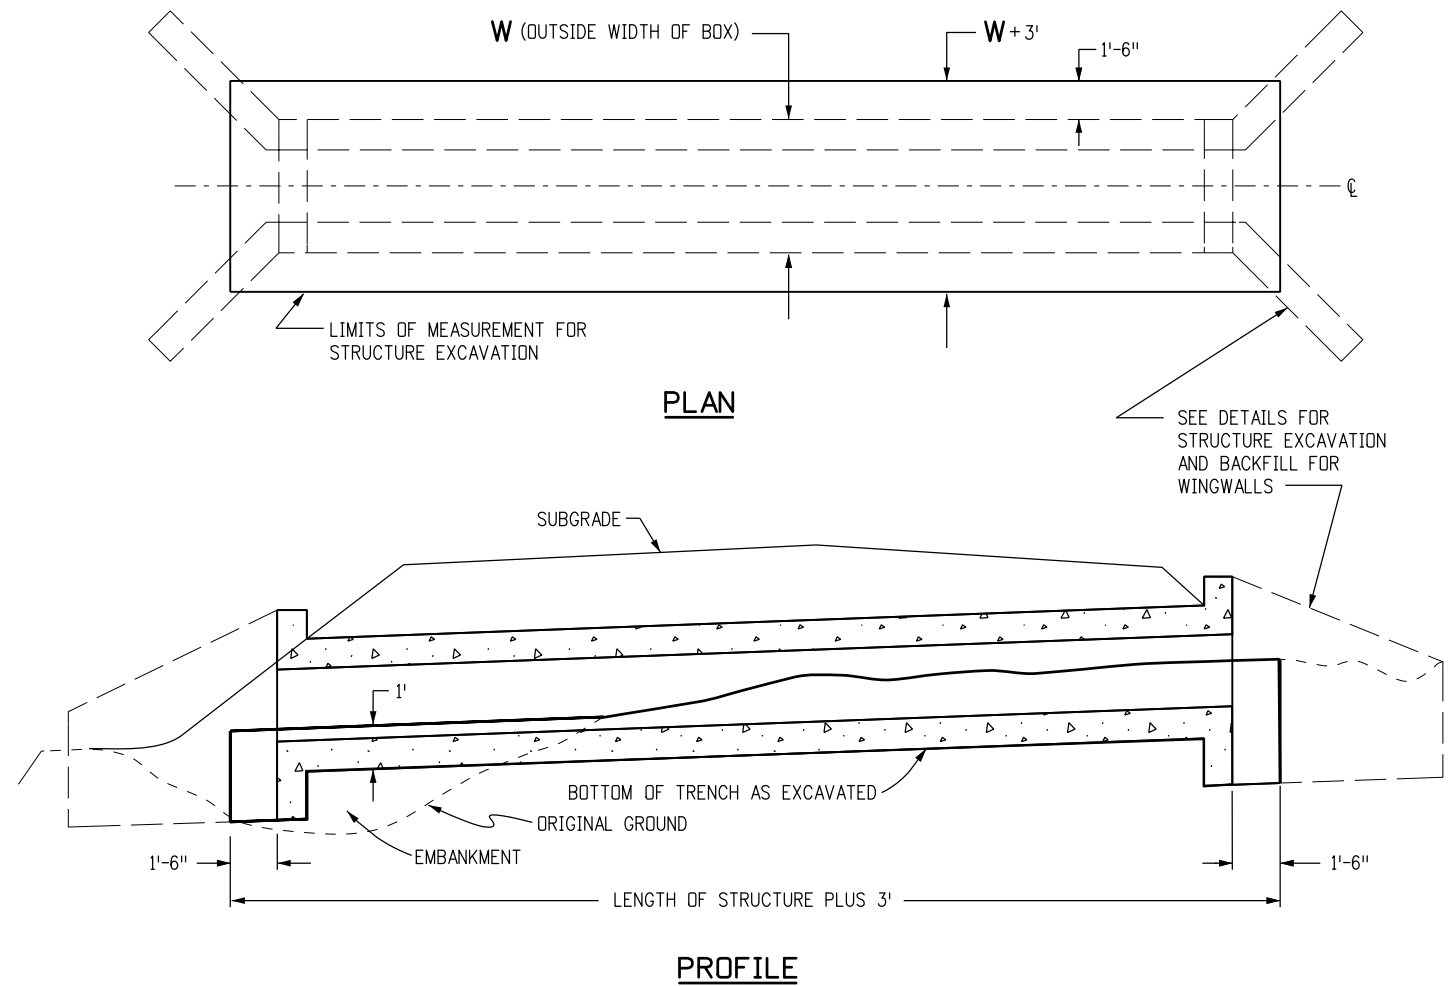

STRUCTURE EXCAVATION MEASUREMENT FOR CONCRETE BOX CULVERTS

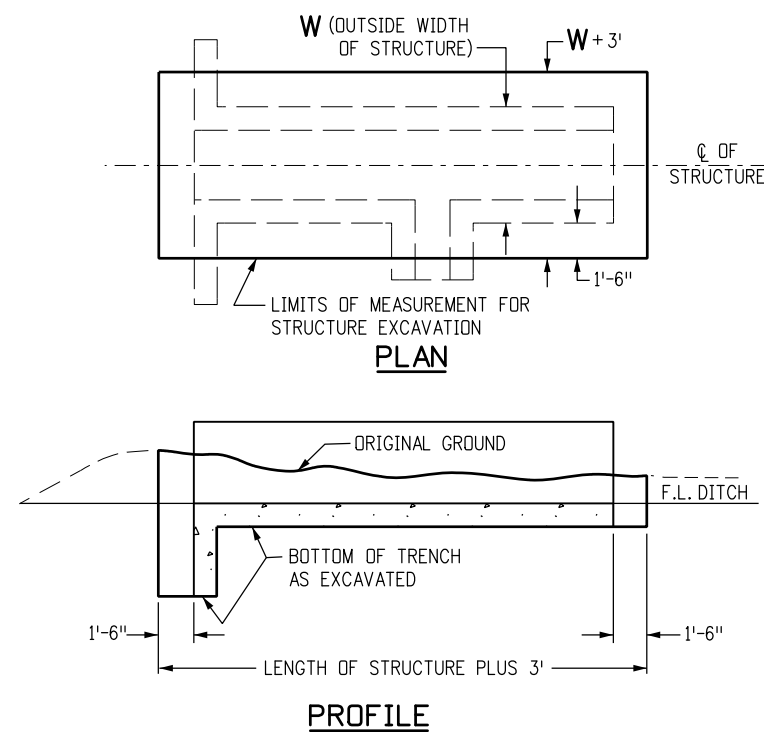

STRUCTURE EXCAVATION MEASUREMENT FOR DIVISION BOXES

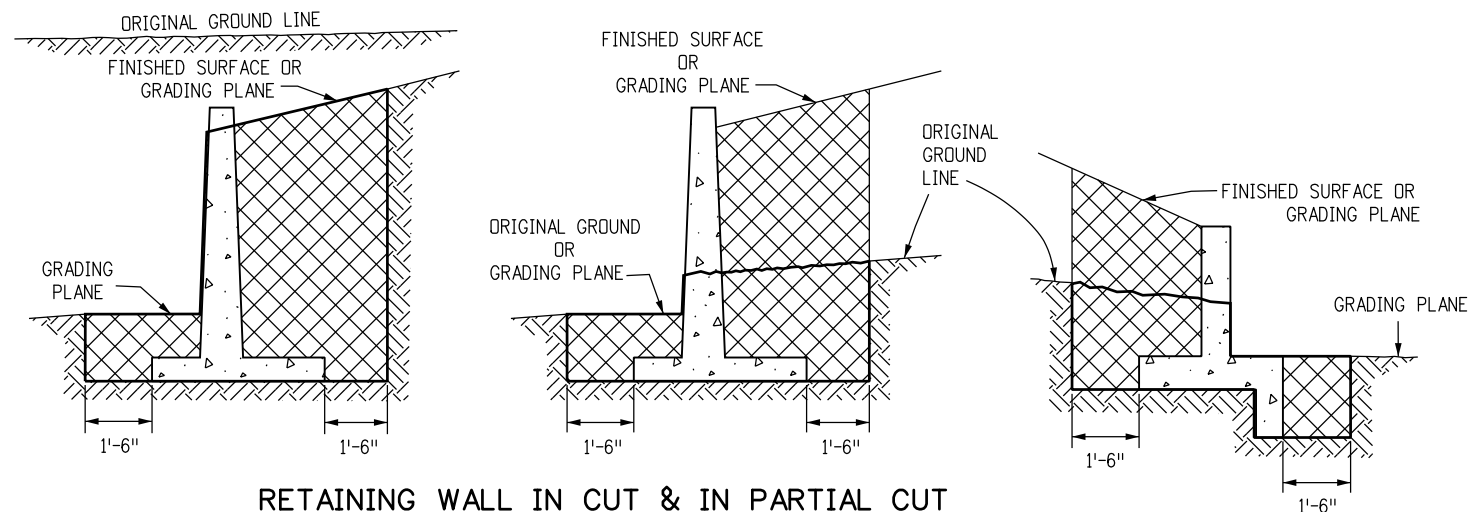

RETAINING WALL IN CUT & IN PARTIAL CUT



ANY ADDITIONAL EXCAVATION BEHIND THE LIMITS SHOWN SHALL BE FILLED WITH CLASS I BACKFILL MATERIAL. THE ADDITIONAL EXCAVATION AND BACKFILL WILL NOT BE MEASURED AND PAID FOR.

LEGEND


- STRUCTURE EXCAVATION LIMITS
- STRUCTURE BACKFILL, CLASS 1 OR 2, AS SHOWN ON PLANS
- CONCRETE

WINGWALL




Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	EXCAVATION AND BACKFILL FOR STRUCTURES		STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments				M-206-1
Designer Initials: JBK	(R-X)						Standard Sheet No. 2 of 2
Last Modification Date: 07/31/19	(R-X)				Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English							

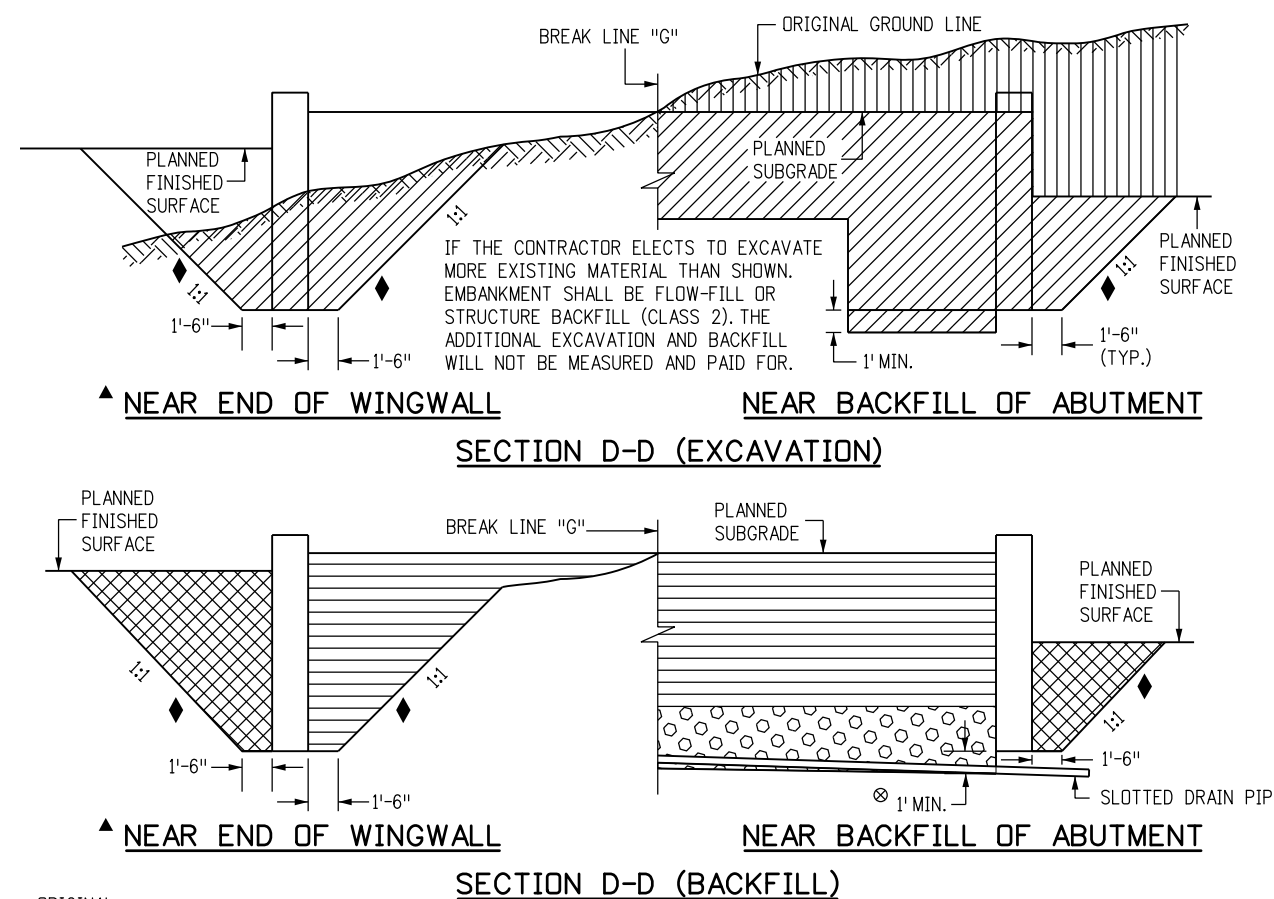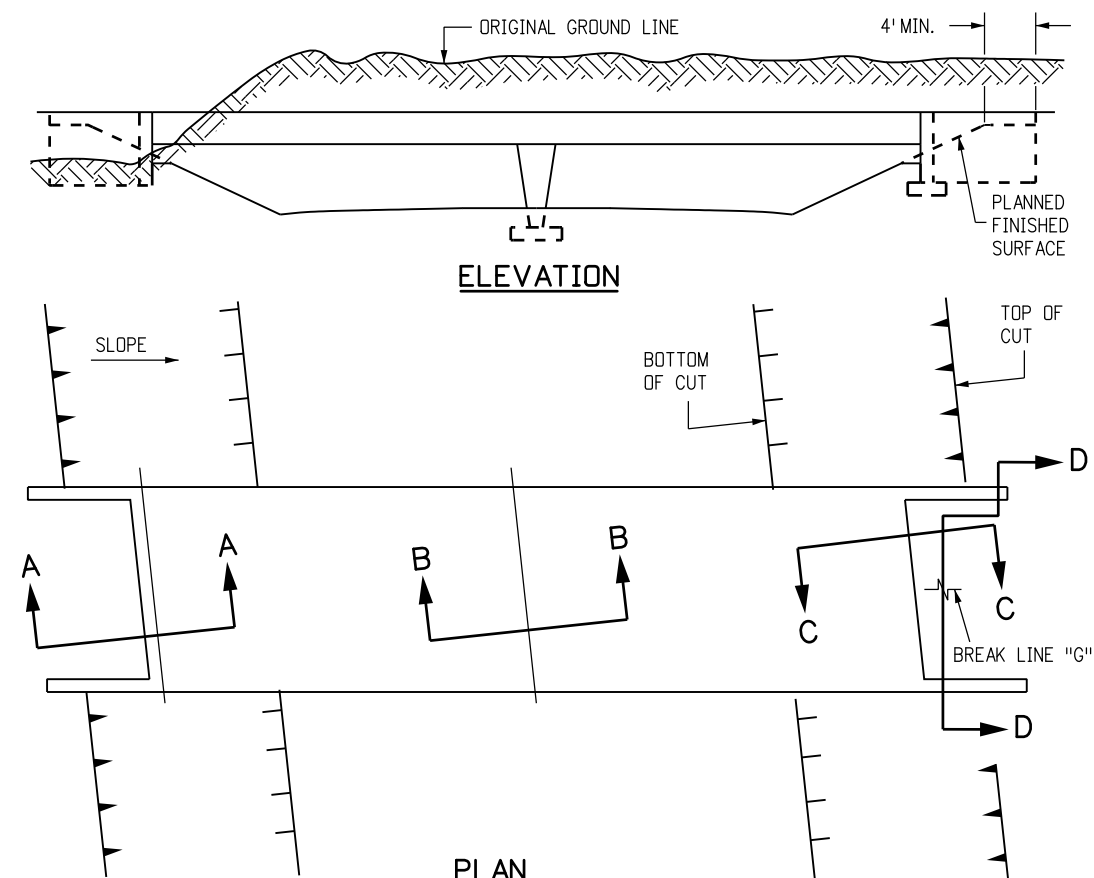

- GENERAL NOTES**
- EXCAVATION AND BACKFILL PATTERNS DIFFERENT FROM THOSE INDICATED ON THIS SHEET WILL BE SHOWN ON THE PLANS.
 - STRUCTURE FOOTINGS WHICH ARE LOCATED IN ROCK SHALL BE POURED OUT TO UNDISTURBED ROCK WITHOUT FORMING, IN CONFORMANCE WITH SUBSECTION 601.09(b).
 - STRUCTURE EXCAVATION FOR SLOPE PAVING NOT SHOWN.

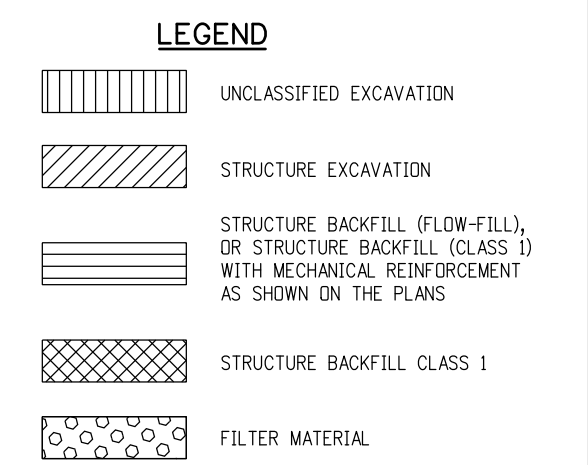


- ▲ FOR PURPOSES OF QUANTITY CALCULATIONS THIS TEMPLATE APPLIES TO END OF WINGWALL.
- ⊗ SLOPE TO DRAIN.
- ◆ SLOPE FOR PAY LIMITS OF EXCAVATION AND BACKFILL.

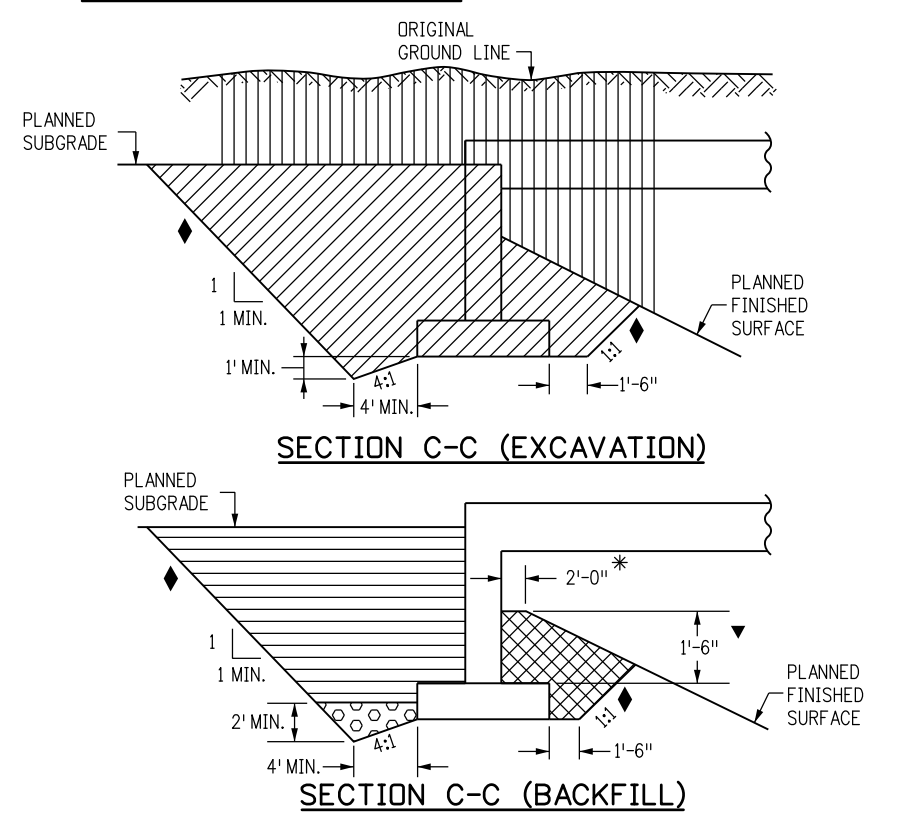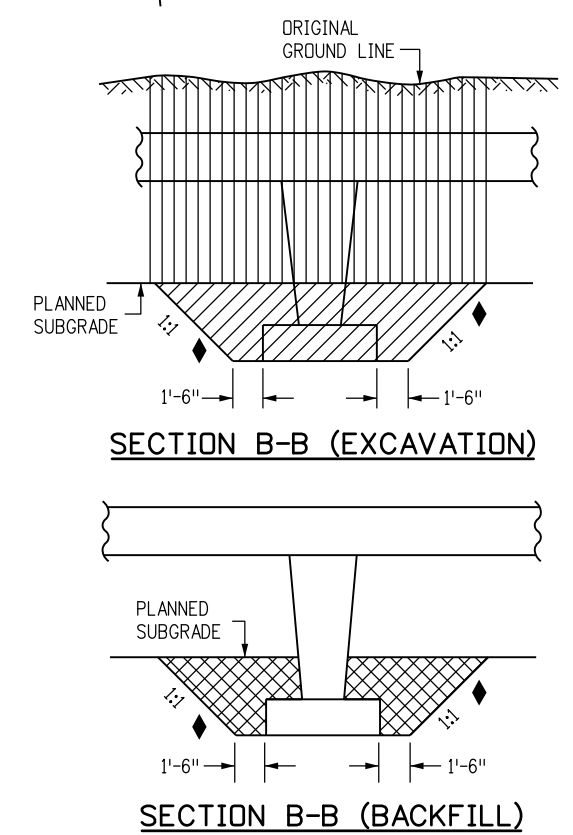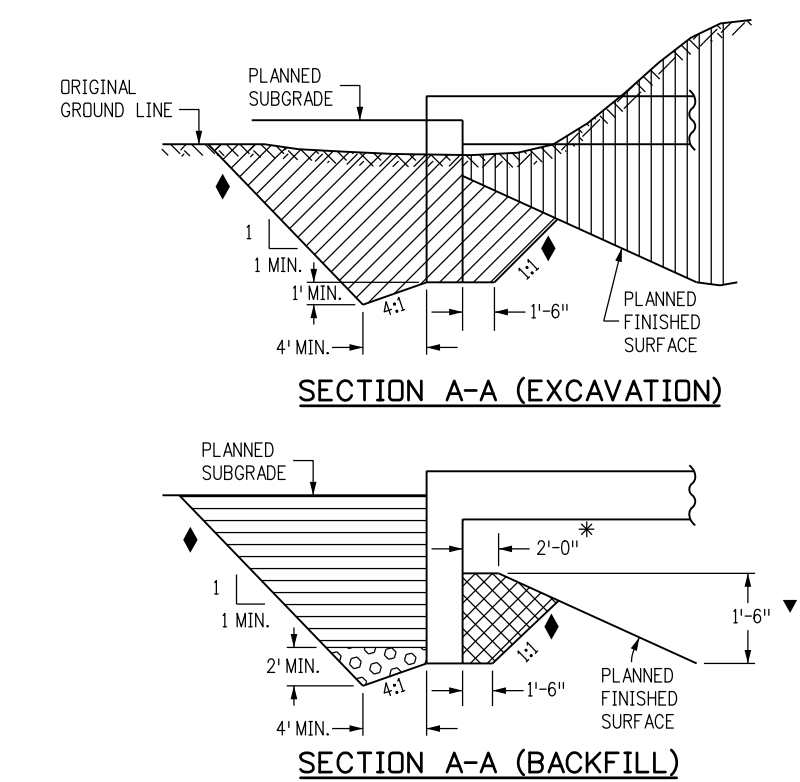


- * MINIMUM BERM DIMENSION
- ▼ MINIMUM EMBEDMENT OF ABUTMENT, IN STRUCTURE BACKFILL


Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	EXCAVATION AND BACKFILL FOR BRIDGES		STANDARD PLAN NO.	
Creation Date: 07/31/19			Date:	Comments		M-206-2		Standard Sheet No. 1 of 2	
Designer Initials: JBK									
Last Modification Date: 07/31/19									
Detailer Initials: LTA									
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English						Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:	

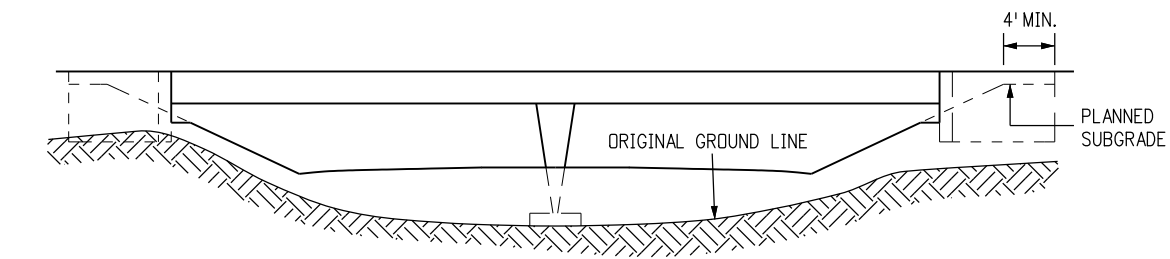

ELEVATION

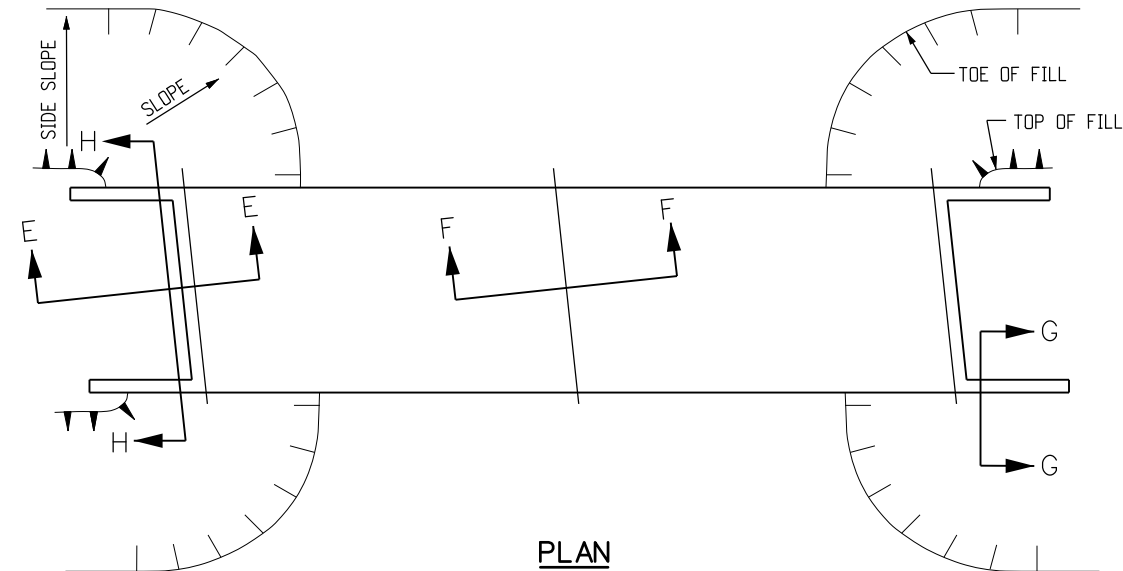

PLAN

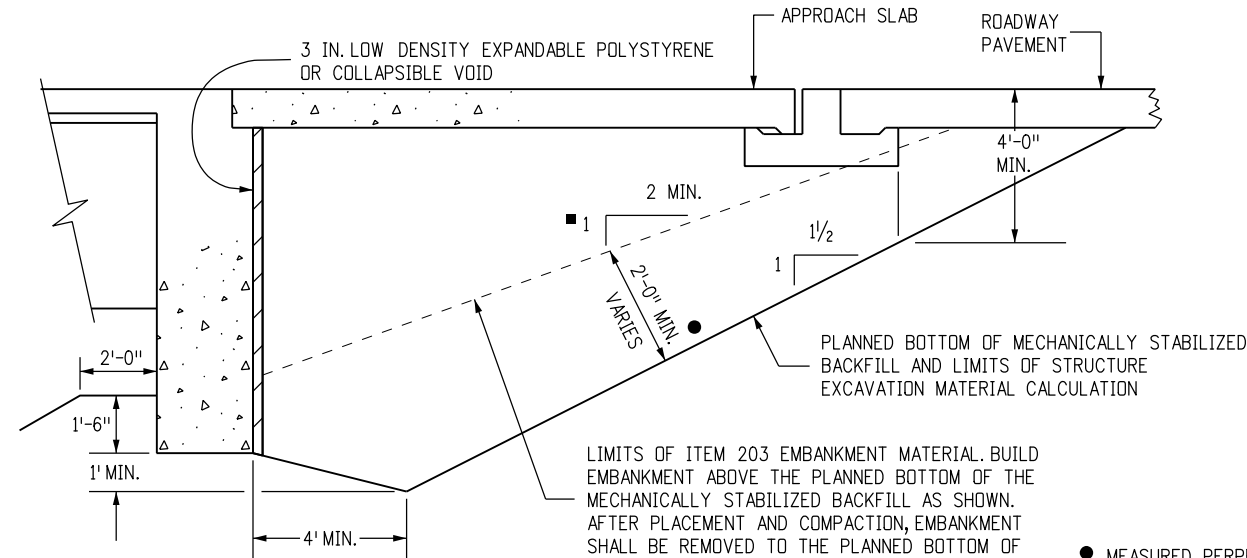


DETAIL 1


(WITH APPROACH SLAB)

LIMITS OF ITEM 203 EMBANKMENT MATERIAL. BUILD EMBANKMENT ABOVE THE PLANNED BOTTOM OF THE MECHANICALLY STABILIZED BACKFILL AS SHOWN. AFTER PLACEMENT AND COMPACTION, EMBANKMENT SHALL BE REMOVED TO THE PLANNED BOTTOM OF THE MECHANICALLY STABILIZED BACKFILL. REMOVAL WILL BE PAID FOR AS STRUCTURE EXCAVATION.


- MEASURED PERPENDICULAR TO PLANNED BOTTOM OF MECHANICALLY STABILIZED BACKFILL.
- PAYMENT BASED ON 2:1 SLOPE. ADDITIONAL QUANTITIES SHALL BE INCLUDED IN THE WORK.

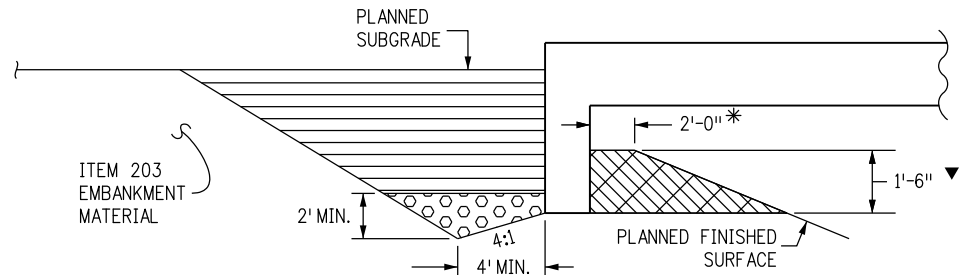

SECTION E-E (BACKFILL)

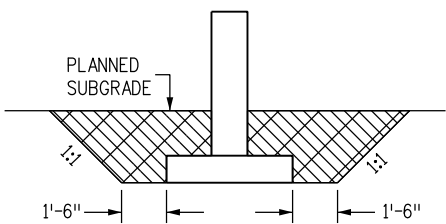


SECTION F-F (BACKFILL)

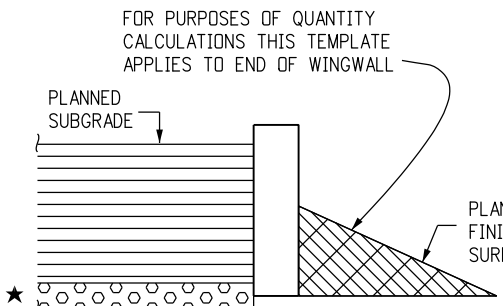

SECTION G-G (BACKFILL)

★ FILTER MATERIAL IS ONLY USED IN AREA NEAR THE ABUTMENT AND NOT AT THE END OF THE WINGWALL

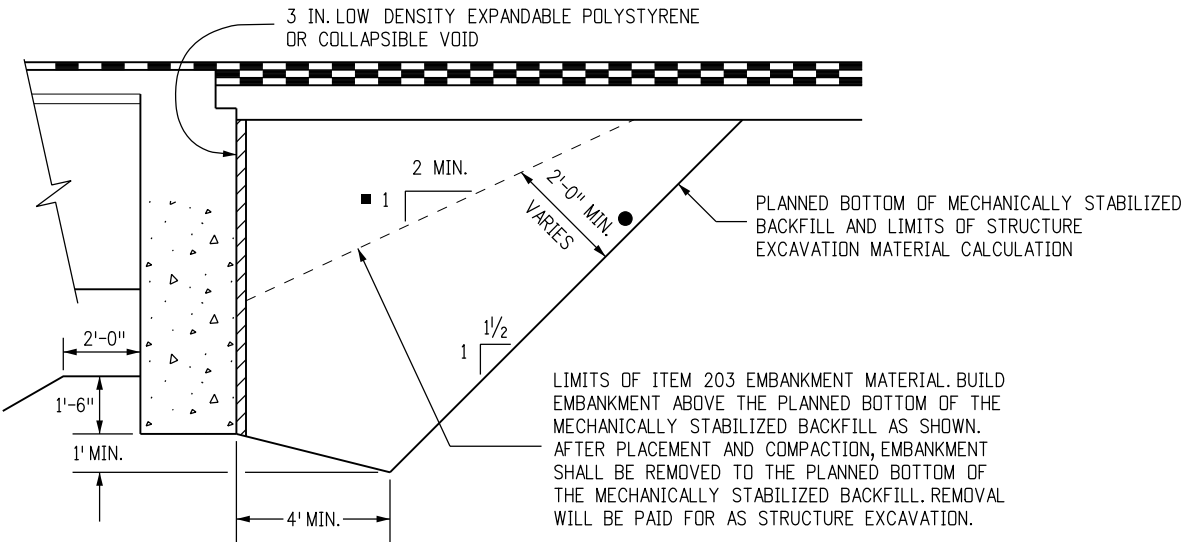

DETAIL 2


(WITHOUT APPROACH SLAB)

LIMITS OF ITEM 203 EMBANKMENT MATERIAL. BUILD EMBANKMENT ABOVE THE PLANNED BOTTOM OF THE MECHANICALLY STABILIZED BACKFILL AS SHOWN. AFTER PLACEMENT AND COMPACTION, EMBANKMENT SHALL BE REMOVED TO THE PLANNED BOTTOM OF THE MECHANICALLY STABILIZED BACKFILL. REMOVAL WILL BE PAID FOR AS STRUCTURE EXCAVATION.

GENERAL NOTES



- EXCAVATION AND BACKFILL PATTERNS DIFFERENT FROM THOSE INDICATED ON THIS SHEET WILL BE SHOWN ELSEWHERE ON THE PLANS.
- STRUCTURE FOOTINGS WHICH ARE LOCATED IN ROCK SHALL BE POURED OUT TO UNDISTURBED ROCK WITHOUT FORMING IN CONFORMANCE WITH SUBSECTION 601.09.
- STRUCTURE EXCAVATION FOR SLOPE PAVING NOT SHOWN.

LEGEND

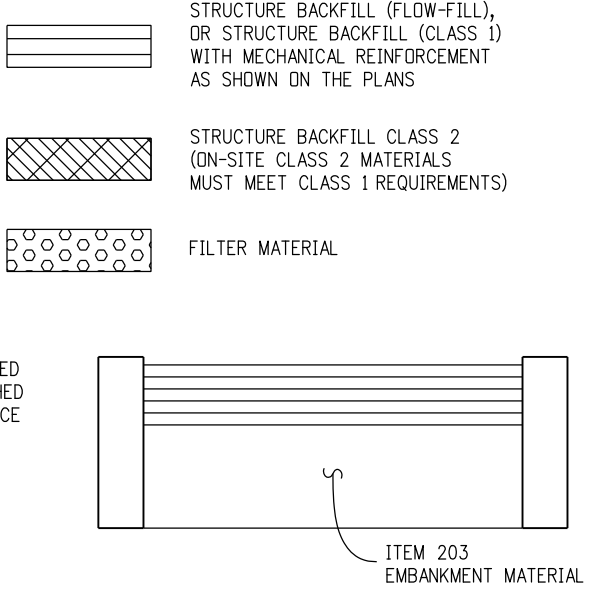

SECTION H-H (BACKFILL)




Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	EXCAVATION AND BACKFILL FOR BRIDGES	STANDARD PLAN NO.	
Creation Date: 07/31/19		Date:	Comments			M-206-2	
Designer Initials: JBK	(R-X)					Standard Sheet No. 2 of 2	
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:	
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)				Issued by the Project Development Branch: July 31, 2019		

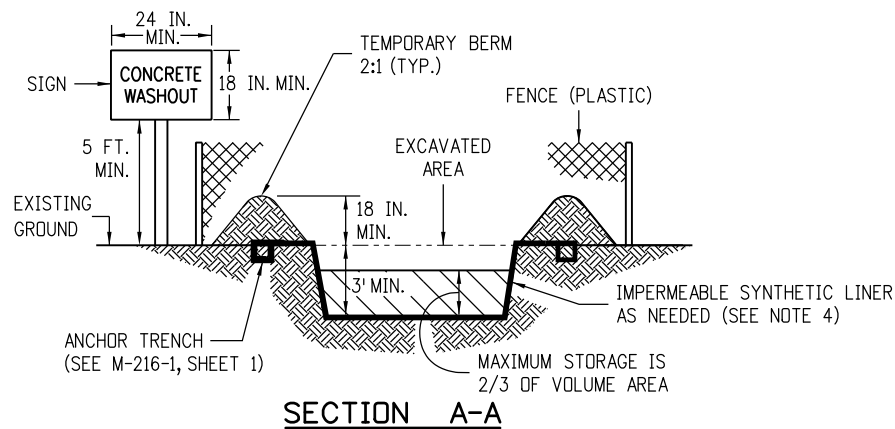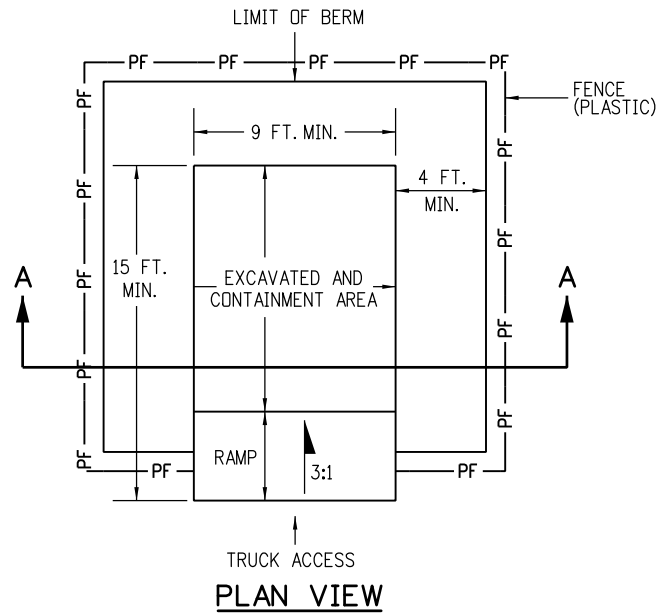

NOTES:

1. A FENCE (PLASTIC) CONFORMING TO SECTION 607 SHALL BE INSTALLED AROUND THE CONCRETE WASHOUT AREA, EXCEPT AT THE OPENING.
2. THE CONCRETE WASHOUT SIGN SHALL HAVE LETTERS AT LEAST 3 INCHES HIGH AND CONFORM TO SUBSECTION 630.02.
3. ALL MATERIALS AND LABOR TO COMPLETE THE CONCRETE WASHOUT STRUCTURE SHALL BE INCLUDED IN THE COST OF WORK AND NOT PAID FOR SEPARATELY.
4. THE BOTTOM OF EXCAVATION SHALL BE A MINIMUM OF FIVE FEET ABOVE GROUND WATER. IF NOT, THE BOTTOM OF EXCAVATION SHALL BE IN ACCORDANCE WITH 208.02 (j).
5. THE PAY ITEM NUMBER FOR CONCRETE WASHOUT STRUCTURE (EACH) IS 208-00045.

CONCRETE WASHOUT STRUCTURE

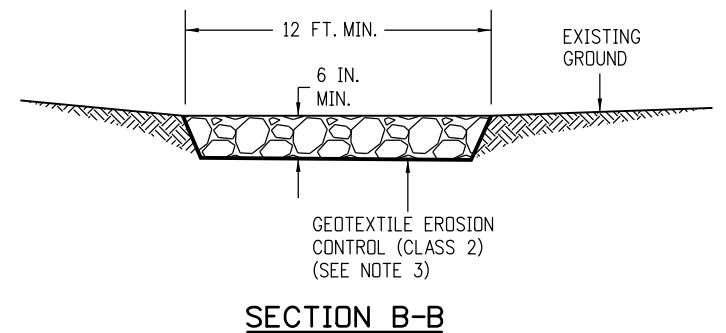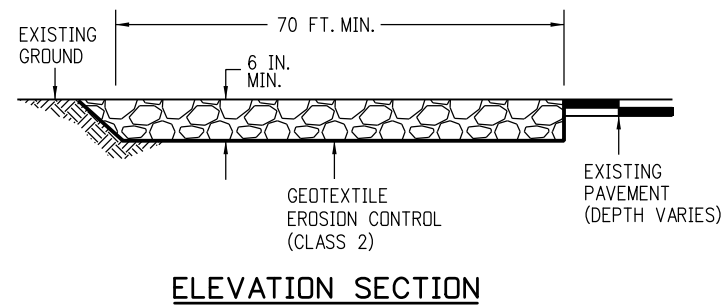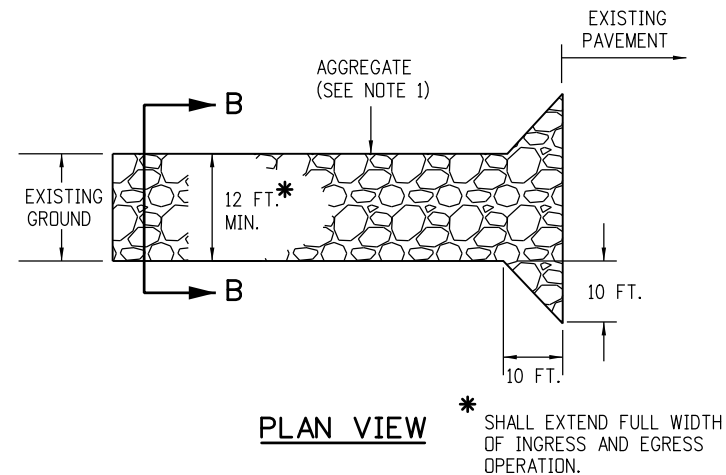


NOTES:


1. AGGREGATE SHALL CONFORM TO SUBSECTION 208.02 (i).
2. THE CONTRACTOR SHALL PROTECT CURB AND GUTTER THAT CROSSES THE ENTRANCE FROM DAMAGE, WHILE NOT BLOCKING FLOW OF WATER THRU STRUCTURE. PROTECTION OF THE CURB AND GUTTER SHALL BE INCLUDED IN THE COST OF WORK AND NOT PAID FOR SEPARATELY.
3. GEOTEXTILE SHALL CONFORM TO SUBSECTION 712.08.
4. ALL MATERIALS AND LABOR TO COMPLETE THE VEHICLE TRACKING PAD SHALL BE INCLUDED IN THE COST OF WORK AND NOT PAID FOR SEPARATELY.
5. THE PAY ITEM NUMBER FOR VEHICLE TRACKING PAD (EACH) IS 208-00070.

VEHICLE TRACKING PAD

Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	TEMPORARY EROSION CONTROL Issued by the Project Development Branch: July 31, 2019		STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments				M-208-1
Designer Initials: JBK	(R-X)						Standard Sheet No. 1 of 11
Last Modification Date: 07/31/19	(R-X)						Project Sheet Number:
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						

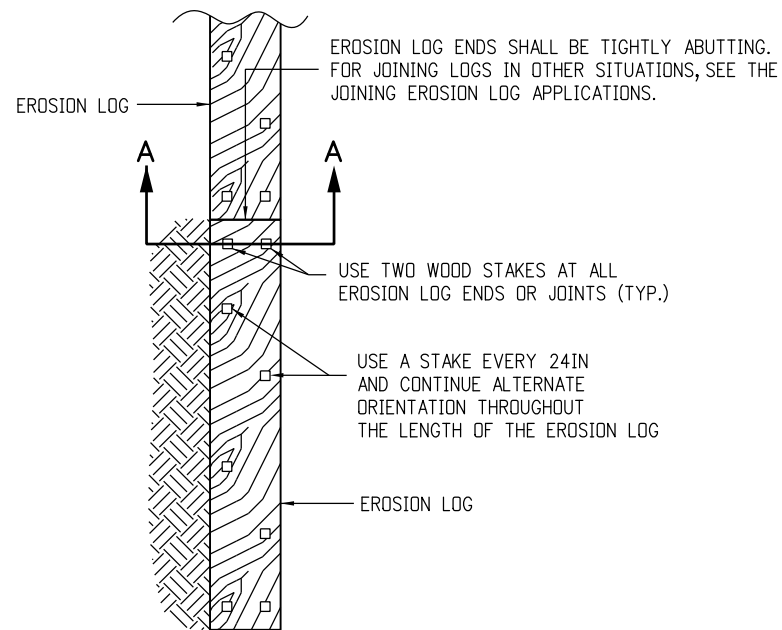


PLAN VIEW

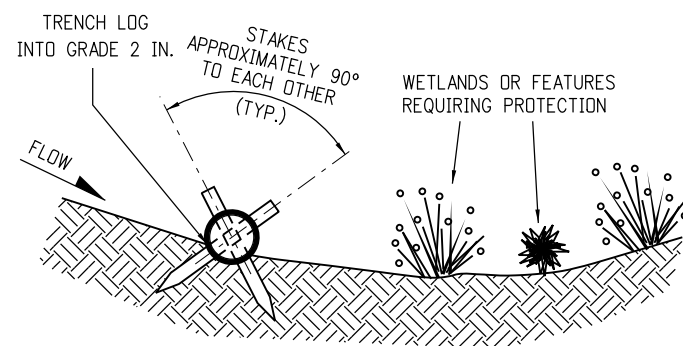


SECTION A-A

TYPICAL STAKE INSTALLATION

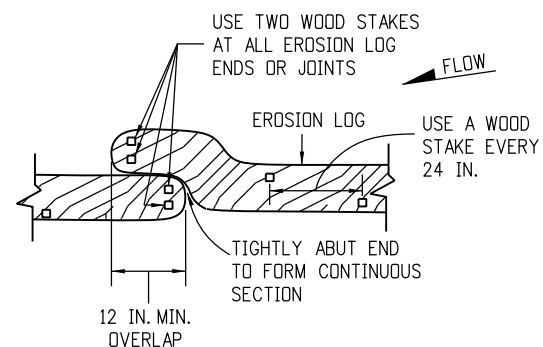


OVERLAP JOINING DETAIL

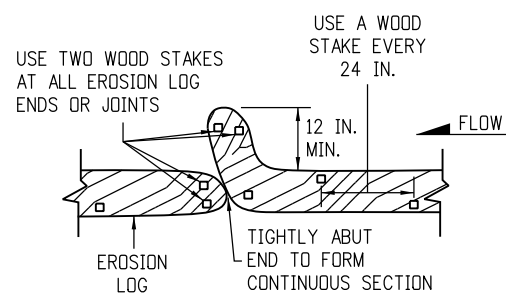


J-HOOK JOINING DETAIL

JOINING EROSION LOG APPLICATIONS

EROSION LOGS PAY ITEMS	
NUMBER	DESCRIPTION
208-00012	TYPE 1 (9 IN.)
208-00002	TYPE 1 (12 IN.)
208-00013	TYPE 1 (20 IN.)
208-00007	TYPE 2 (8 IN.)
208-00008	TYPE 2 (12 IN.)
208-00009	TYPE 2 (18 IN.)
208-00022	TYPE 3 (9 IN.)
208-00023	TYPE 3 (12 IN.)
208-00024	TYPE 3 (20 IN.)

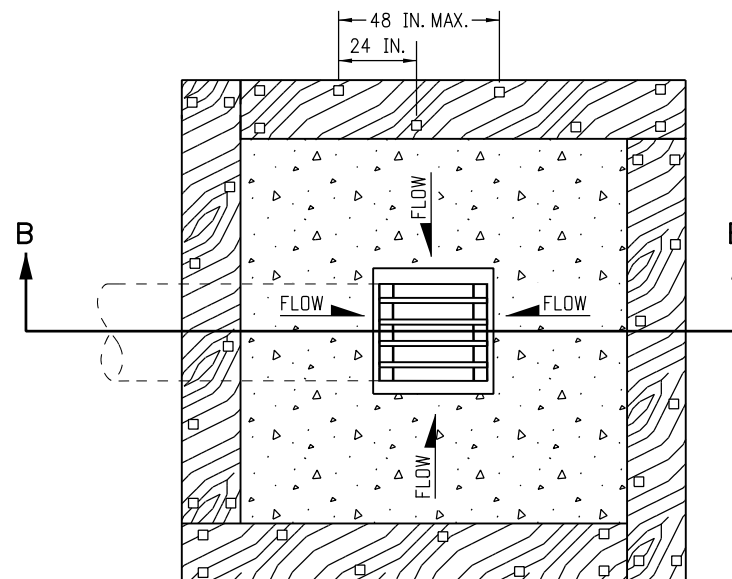


PLAN VIEW

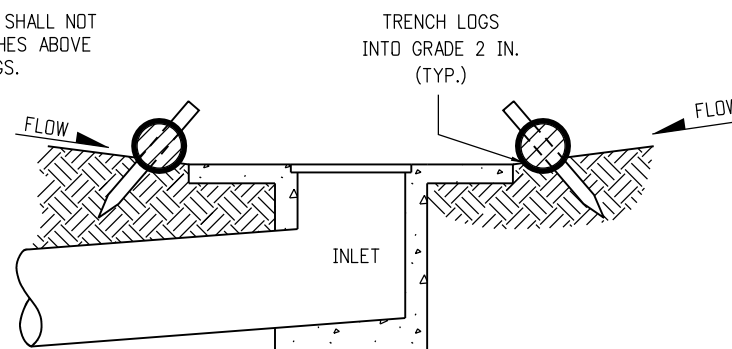


SECTION B-B

NOTE: LOCATE EROSION LOGS AT THE OUTSIDE EDGE OF THE CONCRETE APRON.

EROSION LOG FILTER AT DROP INLET

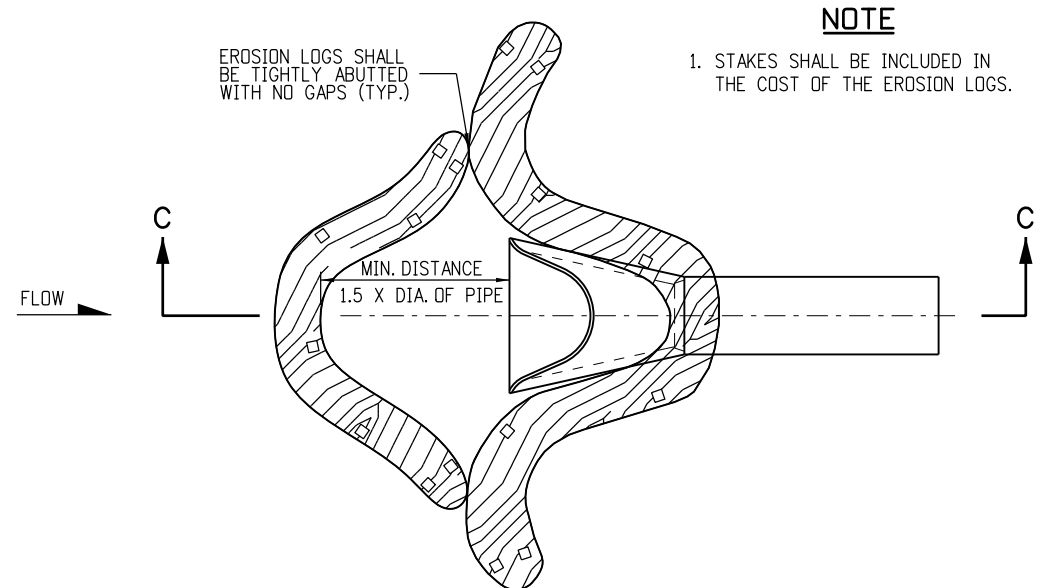


PLAN VIEW

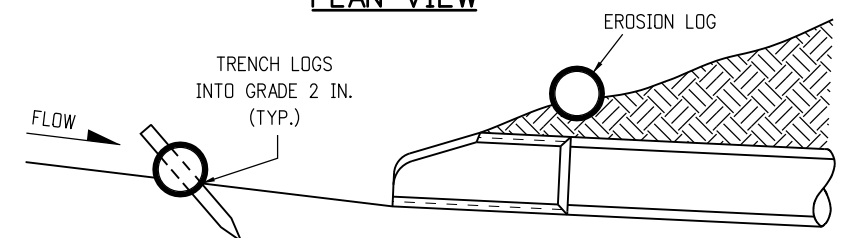

SECTION C-C
(NOT ALL LOGS SHOWN)


EROSION LOG CULVERT INLET PROTECTION

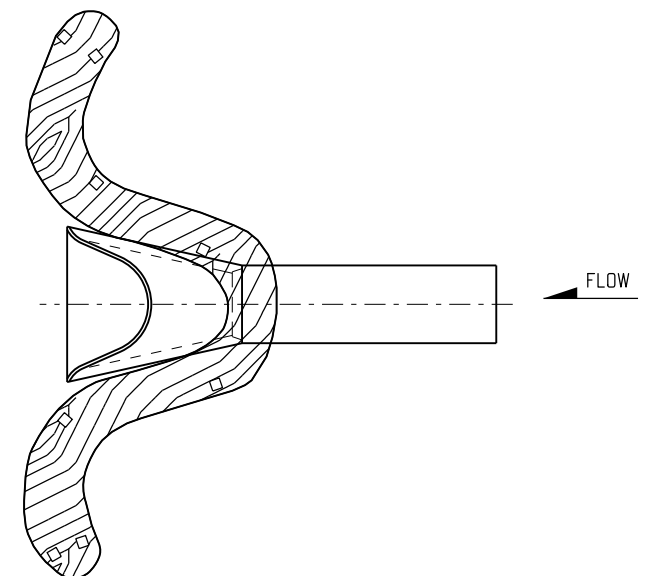


EROSION LOG CULVERT OUTLET PROTECTION

EROSION LOG APPLICATIONS

Computer File Information			Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	TEMPORARY EROSION CONTROL		STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)		Date:	Comments		M-208-1		Standard Sheet No. 2 of 11	
Designer Initials: JBK	(R-X)								
Last Modification Date: 07/31/19	(R-X)								
Detailer Initials: LTA	(R-X)					Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:	
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English		(R-X)							

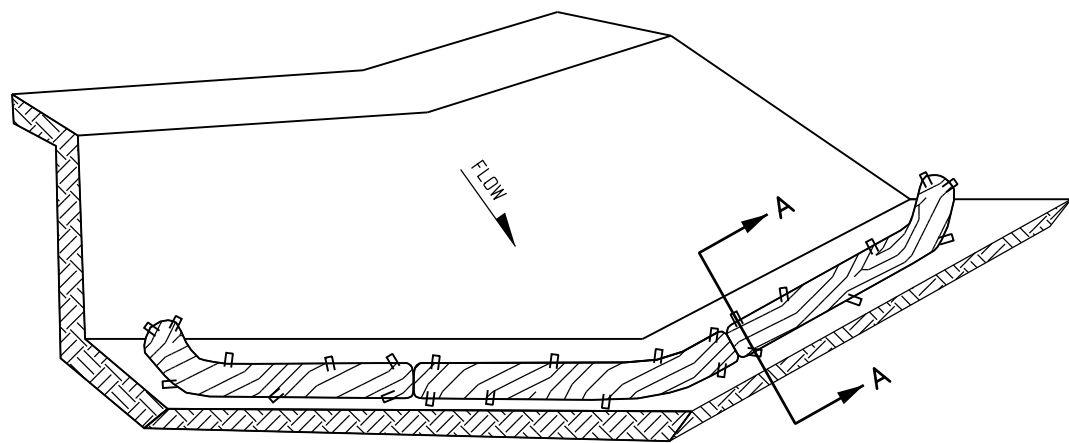

ISOMETRIC VIEW

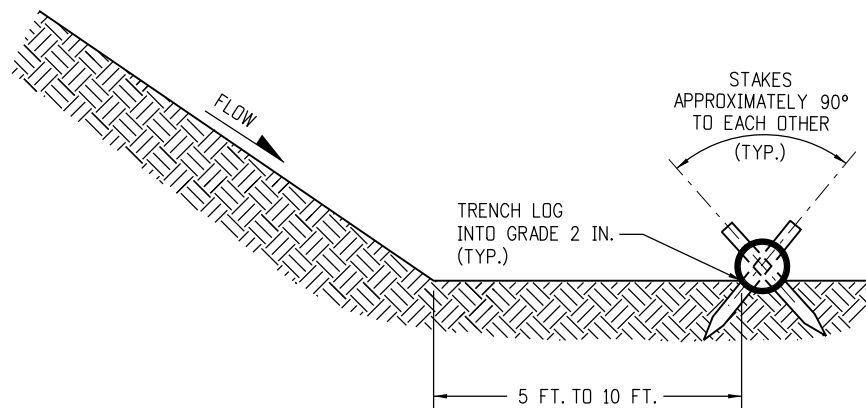


SECTION A-A

NOTE: THE TOPS OF ALL STAKES SHALL NOT EXTEND MORE THAN 2 INCHES ABOVE THE TOPS OF EROSION LOGS.


EROSION LOGS PAY ITEMS	
NUMBER	DESCRIPTION
208-00012	TYPE 1 (9 IN.)
208-00002	TYPE 1 (12 IN.)
208-00013	TYPE 1 (20 IN.)
208-00007	TYPE 2 (8 IN.)
208-00008	TYPE 2 (12 IN.)
208-00009	TYPE 2 (18 IN.)
208-00022	TYPE 3 (9 IN.)
208-00023	TYPE 3 (12 IN.)
208-00024	TYPE 3 (20 IN.)

- NOTES:
1. EROSION LOGS USED AT TOE OF SLOPE SHALL BE PLACED 5 TO 10 FEET BEYOND TOE OF SLOPE TO PROVIDE STORAGE CAPACITY.
 2. EROSION LOGS SHALL BE PLACED ON THE CONTOUR WITH ENDS FLARED UP SLOPE.
 3. SEE SHEET 2 OF 11 FOR JOINING LOGS DETAIL.

EROSION LOG TOE OF SLOPE PROTECTION

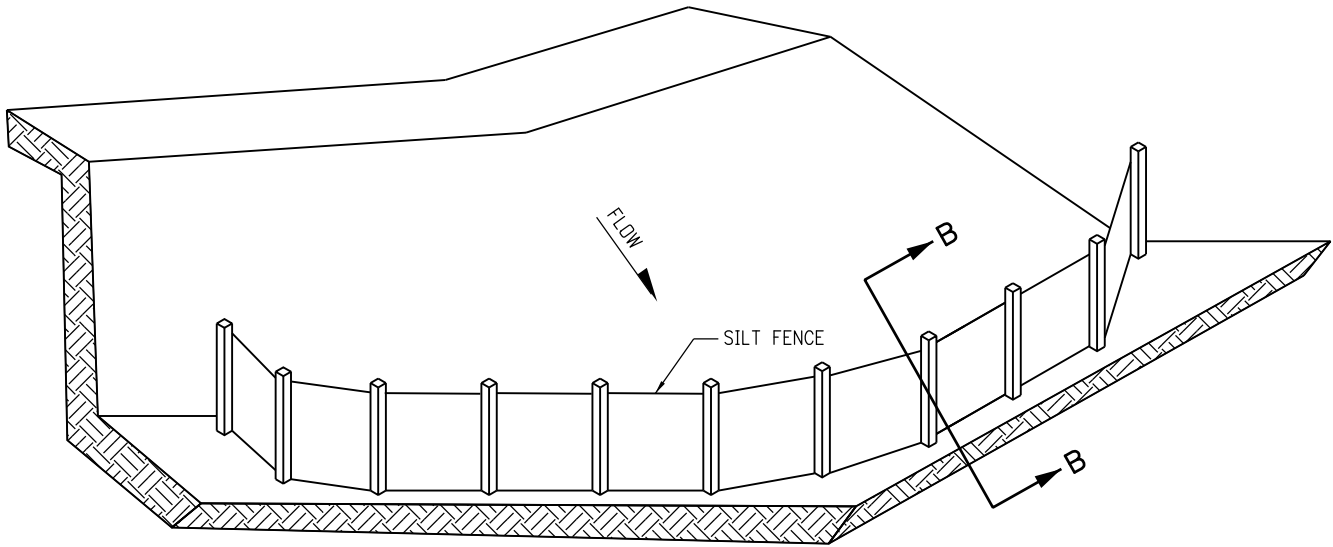

ISOMETRIC VIEW

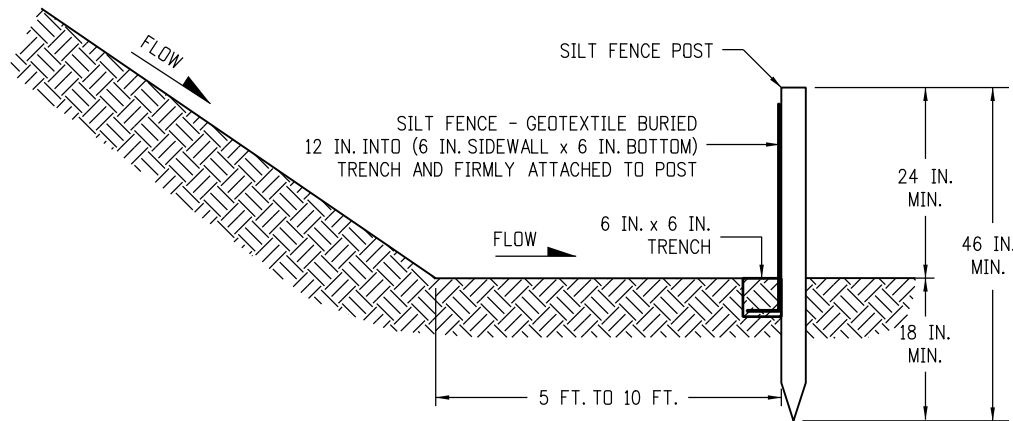

SECTION B-B

SILT FENCE TOE OF SLOPE PROTECTION


NOTE: THE PAY ITEM NUMBER FOR SILT FENCE (LF) IS 208-00020.

NOTES

1. SILT FENCE SHALL HAVE A MAXIMUM DRAINAGE AREA OF ONE-QUARTER ACRE PER 100 FEET OF SILT FENCE LENGTH; MAXIMUM SLOPE LENGTH BEHIND BARRIER IS 100 FEET.
2. SILT FENCE USED AT TOE OF SLOPE SHALL BE PLACED 5 TO 10 FEET BEYOND TOE OF SLOPE TO PROVIDE STORAGE CAPACITY.
3. SILT FENCE SHALL BE PLACED PARALLEL TO THE CONTOUR WITH ENDS FLARED UP SLOPE.
4. THE MAXIMUM LENGTH OF EROSION LOGS OR SILT FENCES WITHOUT A FLARED END TURNING UPSLOPE IS 150 FEET.

TOE OF SLOPE PROTECTION APPLICATIONS

Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	TEMPORARY	STANDARD PLAN NO.	
Creation Date: 07/31/19	Date:		Comments	M-208-1				
Designer Initials: JBK				Standard Sheet No. 3 of 11				
Last Modification Date: 07/31/19				Project Sheet Number:				
Detailer Initials: LTA								
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English								

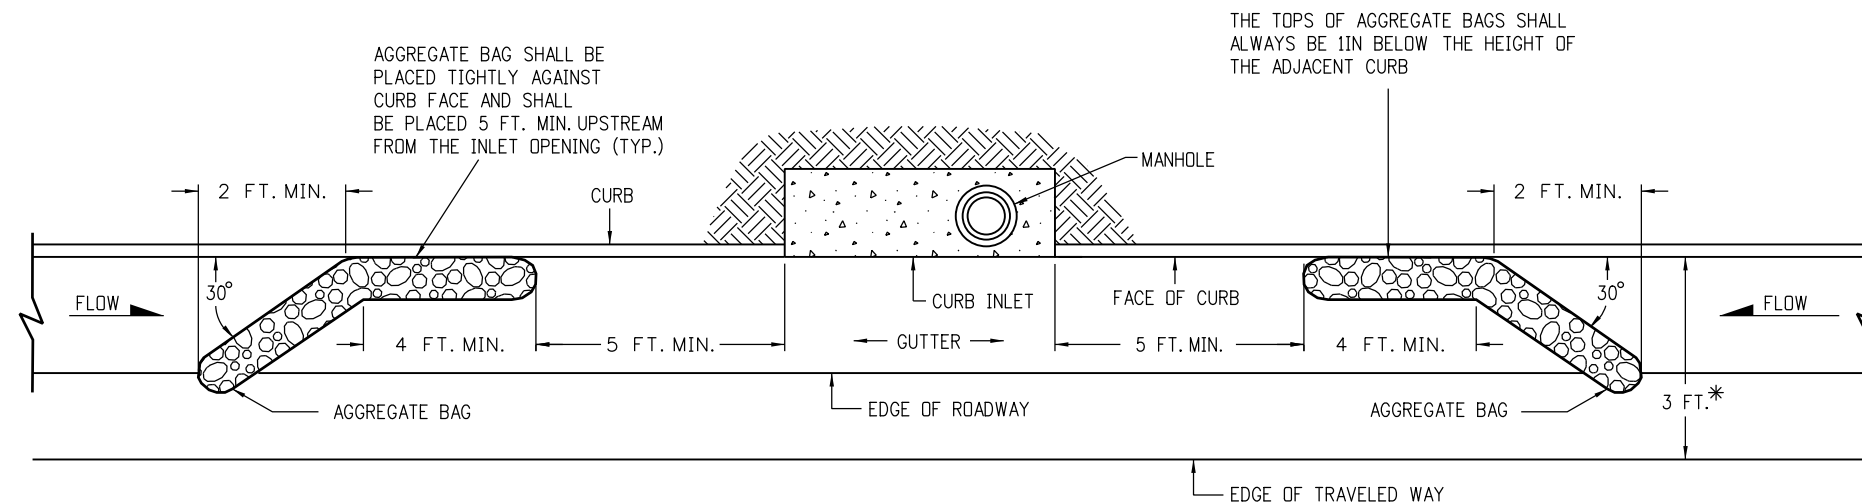


PLAN VIEW


* NOTE: USE AGGREGATE BAGS ONLY WHEN THERE IS A MINIMUM CLEARANCE OF 3 FEET FROM THE EDGE OF THE TRAVELED WAY (INCLUDING CONDITIONS DURING DETOURS) TO THE FACE OF CURB.

LENGTH (L) OF INLET FT.	NUMBER OF AGGREGATE BAGS UPSTREAM OF INLET
0 - 5	1
6 - 10	2
L > 10	3

AGGREGATE BAGS AT STORM DRAIN INLET (TYPE I)

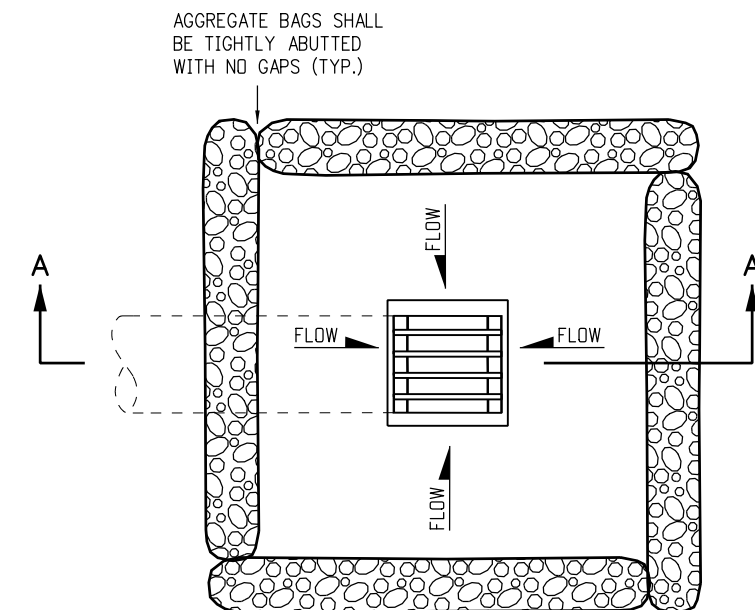

PLAN VIEW

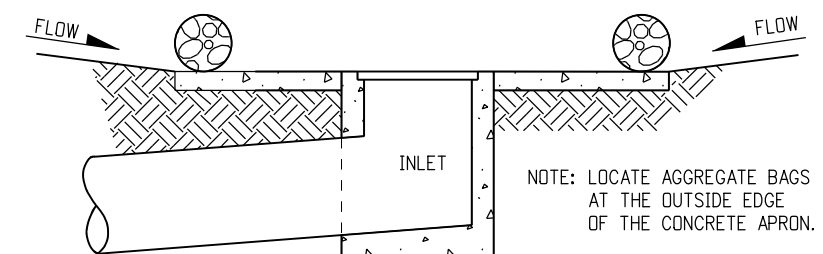


SECTION A-A

AGGREGATE BAGS AT DROP INLET


AGGREGATE BAG APPLICATIONS

NOTE: THE PAY ITEM NUMBER FOR AGGREGATE BAG (LF) IS 208-00035

Computer File Information		Sheet Revisions		 Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	TEMPORARY EROSION CONTROL		STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments				M-208-1
Designer Initials: JBK	(R-X)						Standard Sheet No. 4 of 11
Last Modification Date: 07/31/19	(R-X)						Project Sheet Number:
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)				Issued by the Project Development Branch: July 31, 2019		

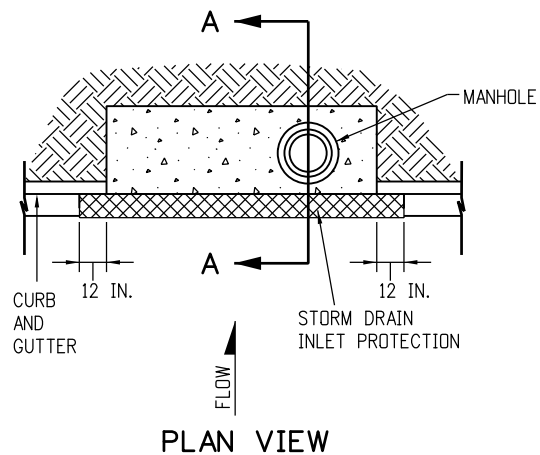


PLAN VIEW

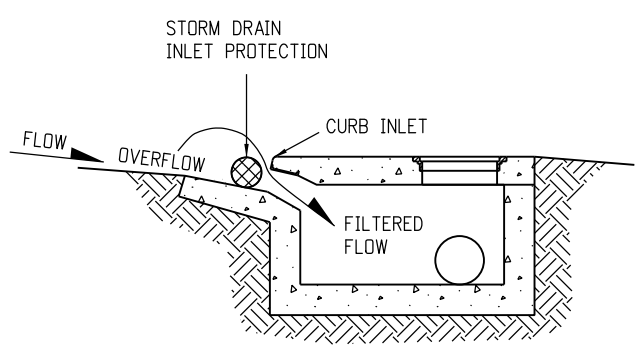


SECTION A-A

STORM DRAIN INLET PROTECTION (TYPE I)

- NOTES:
1. INLET PROTECTION DEVICE SHALL EXTEND 12 INCHES PAST EACH END OF THE INLET.
 2. THE PAY ITEM NUMBERS FOR STORM DRAIN INLET PROTECTION (TYPE I) ARE 208-00051 (LF), 208-00053 84 INCHES (EACH), 208-00057 144 INCHES (EACH), AND 208-00058 204 INCHES (EACH).
 3. FOR STORM DRAIN INLET TYPES I AND II, IF THERE IS A MINIMUM CLEARANCE OF 3 FEET FROM THE EDGE OF THE TRAVELED WAY TO THE FACE OF CURB, USE THE AGGREGATE BAGS AT STORM DRAIN INLET (TYPE I) DETAIL ON SHEET 4 INSTEAD.

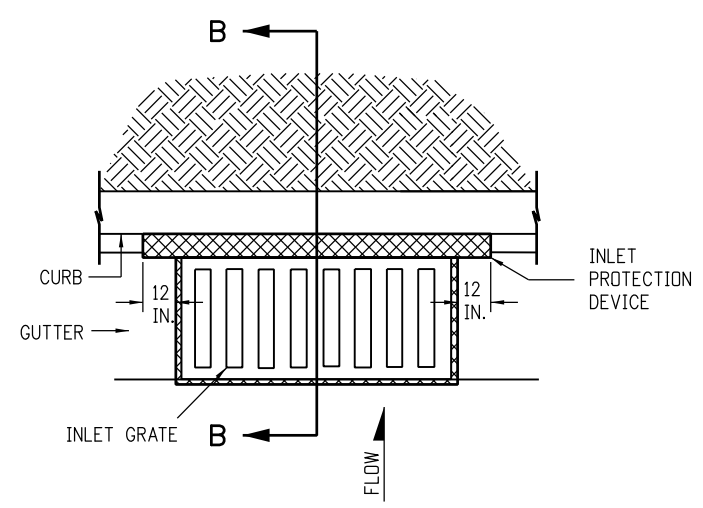


PLAN VIEW

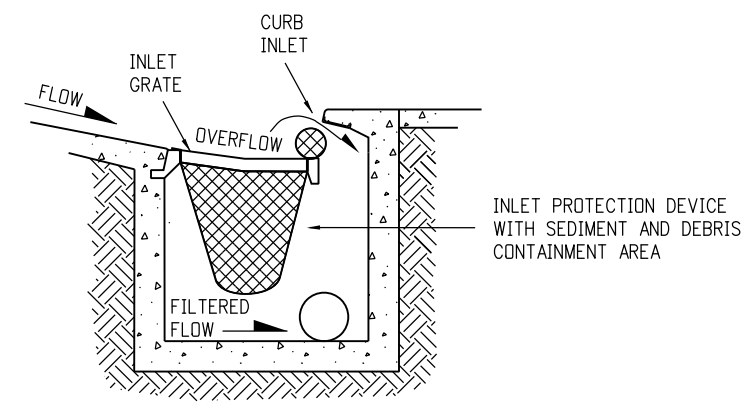

SECTION B-B

OPTION A

STORM DRAIN INLET PROTECTION (TYPE II)

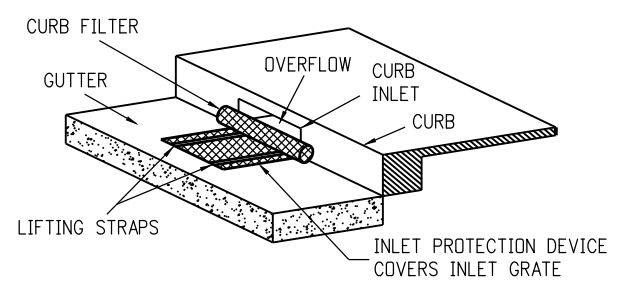


ISOMETRIC VIEW

OPTION B


STORM DRAIN INLET PROTECTION (TYPE II)

NOTE: THE PAY ITEM NUMBERS FOR STORM DRAIN INLET PROTECTION (TYPE II) ARE 208-00054 (EACH).

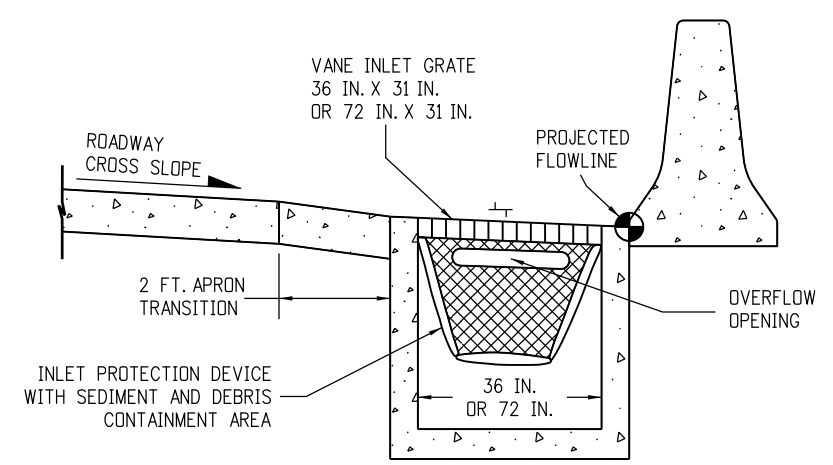

OPTION A

STORM DRAIN INLET PROTECTION (TYPE III)

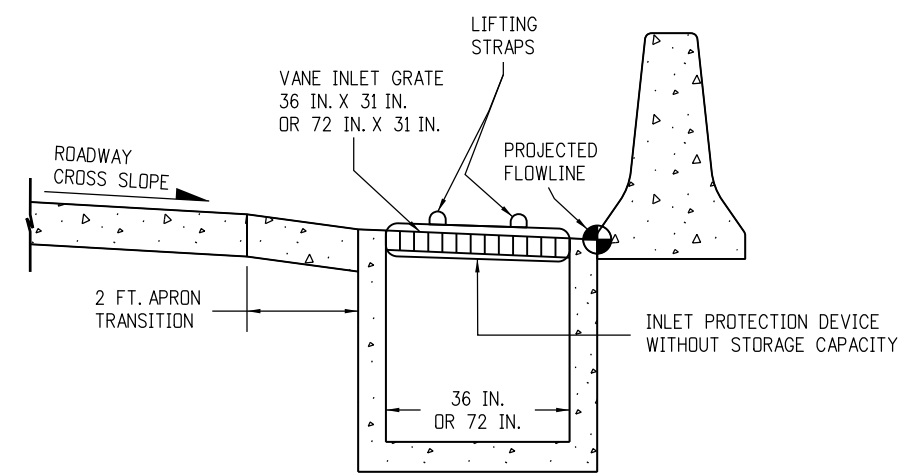


OPTION B

STORM DRAIN INLET PROTECTION (TYPE III)

NOTE: THE PAY ITEM NUMBER FOR STORM DRAIN INLET PROTECTION (TYPE III) (EACH) IS 208-00056.


STORM DRAIN INLET PROTECTION TYPES

Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	TEMPORARY EROSION CONTROL Issued by the Project Development Branch: July 31, 2019		STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments				M-208-1
Designer Initials: JBK	(R-X)						Standard Sheet No. 5 of 11
Last Modification Date: 07/31/19	(R-X)						Project Sheet Number:
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						

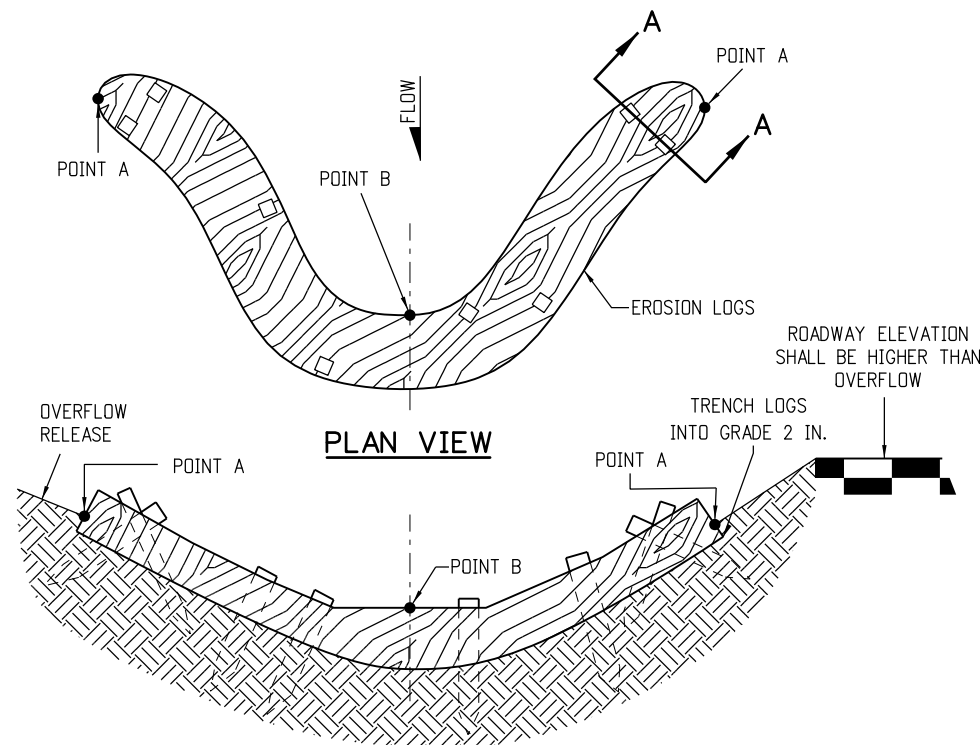

NOTE: POINTS "A" SHALL BE A MINIMUM 4 IN. HIGHER THAN POINT "B".

ELEVATION

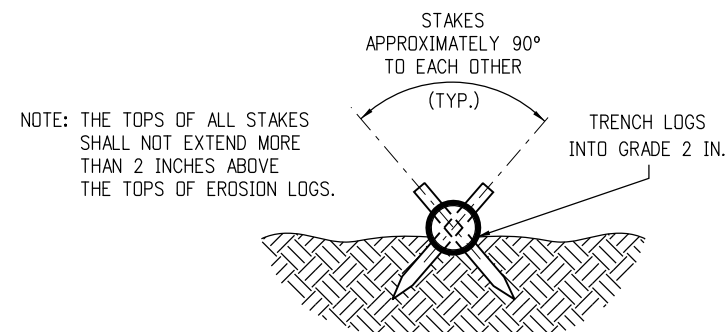


SECTION A-A


NOTES:

1. EROSION LOGS SHALL BE EMBEDDED 2 INCHES INTO THE SOIL.
2. EROSION LOGS SHALL BE TIGHTLY ABUTTED WITH NO GAPS.
3. V-SHAPED TEMPORARY DITCHES SHALL NOT BE USED. DITCHES SHALL BE GRADED IN A PARABOLIC OR TRAPEZOIDAL SHAPE.


EROSION LOG INSTALLATION

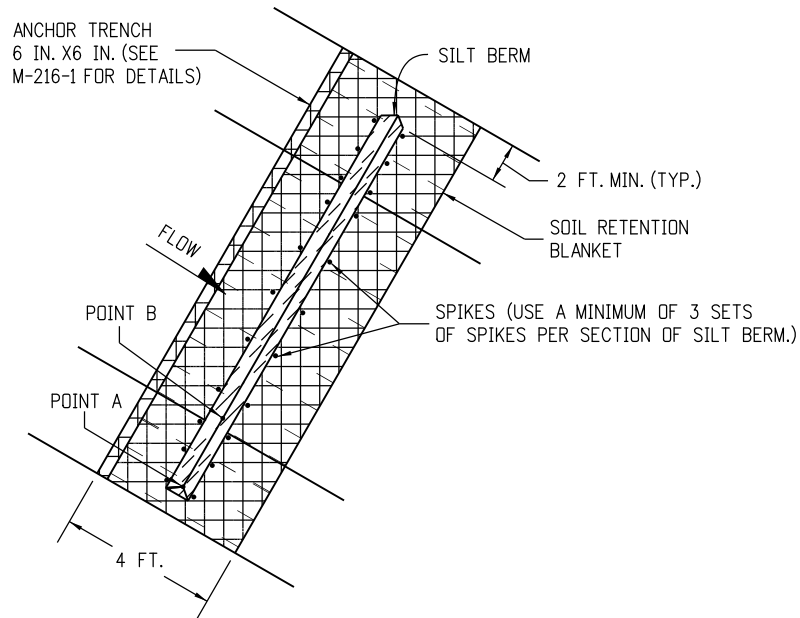

PLAN VIEW

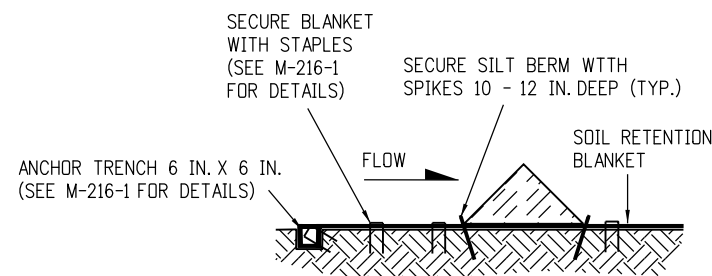


SILT BERM (1) SECTION VIEW

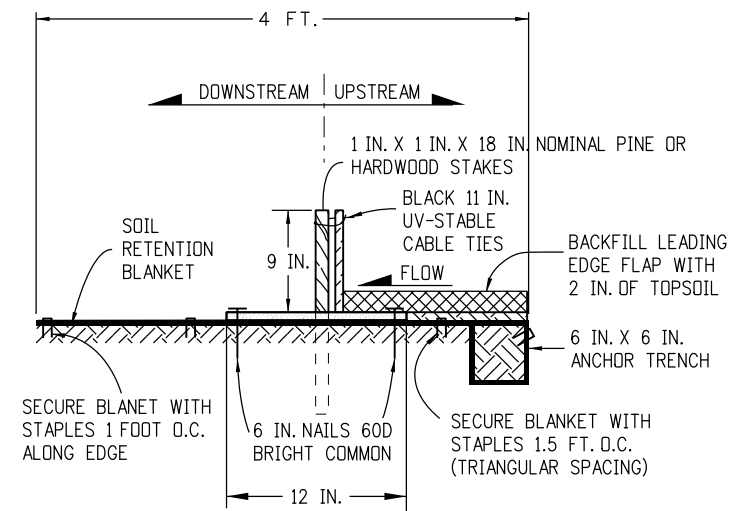

NOTES:

1. MINIMUM 4 NAILS PER SEGMENT (UPSTREAM).
2. MINIMUM 2 NAILS PER SEGMENT (DOWNSTREAM).
3. MINIMUM 2 WOOD STAKES PER SEGMENT.

SILT BERM (2) SECTION VIEW

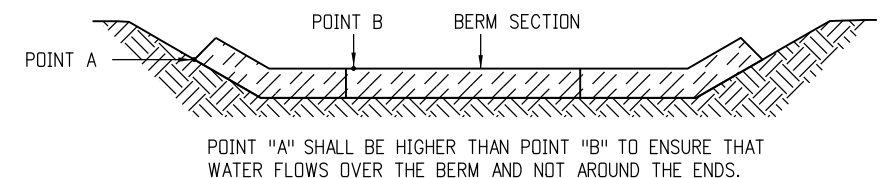

FRONT VIEW


NOTES:

1. ANCHOR SOIL RETENTION BLANKET INTO TRENCH WITH 8 INCHES MIN. STAPLES PLACED AT 1 FOOT INTERVALS ALONG EDGE.
2. FILL AND COMPACT TRENCH.
3. SECTIONS OF THE SILT BERM SHALL BE OVERLAPPED WITH NO GAPS.
4. FOR SLOPE AND CHANNEL SPACING SEE THE "SECTION VIEW ALONG DITCH FLOWLINE" DETAIL ON SHEET 11 OF 11.
5. SOIL RETENTION BLANKET SHALL ALWAYS BE REQUIRED.
6. THE PAY ITEM NUMBER FOR SILT BERM (LF) IS 208-00004.

SILT BERM INSTALLATION

DRAINAGE DITCH APPLICATIONS


Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	TEMPORARY EROSION CONTROL	STANDARD PLAN NO.	
Creation Date: 07/31/19		Date:	Comments			M-208-1	
Designer Initials: JBK	(R-X)					Standard Sheet No. 6 of 11	
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:	
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)				Issued by the Project Development Branch: July 31, 2019		

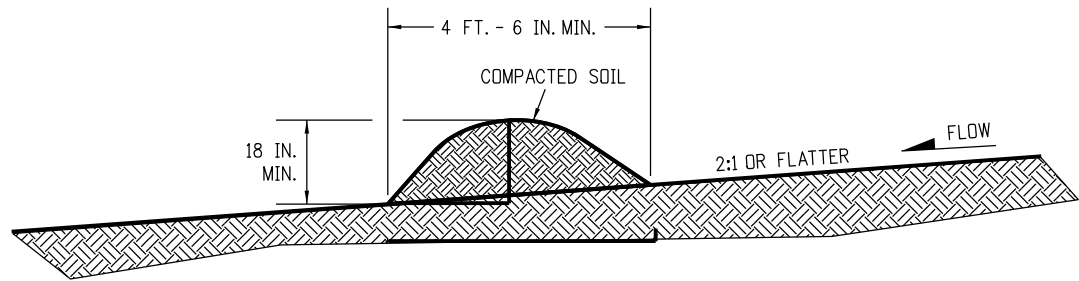

NOTES:

- 1. BERMS SHALL HAVE A HEIGHT OF 18 INCHES, SIDE SLOPES OF 2:1 OR FLATTER AND A MINIMUM BASE WIDTH OF 4 FT.-6 IN.
- 2. BERMS SHALL BE USED TO INTERCEPT AND DIVERT DRAINAGE TO A DESIGNATED OUTLET.
- 3. BERMS SHALL NOT BE USED WHERE DRAINAGE AREA EXCEEDS 10 ACRES.
- 4. BERMS SHALL BE CONSTRUCTED OUT OF ACCEPTABLE MATERIAL THAT CAN BE COMPACTED AND RECEIVE AT A MINIMUM HEAVY EQUIPMENT WHEEL ROLLED COMPACTION.
- 5. TEMPORARY BERMS SHALL BE CONSTRUCTED OUT OF EMBANKMENT (SUBSOIL) AND IN NO CIRCUMSTANCE CONSTRUCTED OUT OF SALVAGED TOPSOIL.
- 6. THE PAY ITEM NUMBER FOR TEMPORARY BERM (LF) IS 208-00300.

TEMPORARY BERM

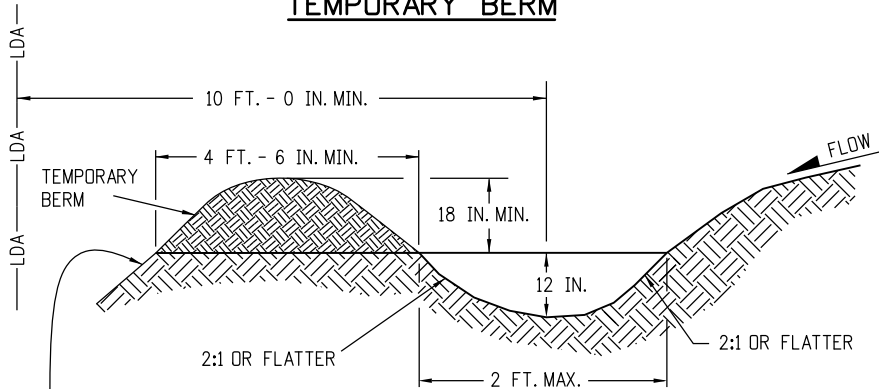


FOR BERMS TALLER THAN 2 FT.,
INSTALL TOE OF SLOPE CONTOL MEASURES.
SEE SHEET 3 OF 11 FOR DETAILS.

NOTES:

- 1. TEMPORARY DIVERSION DITCHES SHALL BE CONSTRUCTED ACROSS THE SLOPE TO INTERCEPT RUNOFF AND DIRECT IT TO A STABLE OUTLET OR SEDIMENT TRAP.
- 2. USE THE TEMPORARY DIVERSION DITCH IMMEDIATELY ABOVE A NEW CUT, FILL SLOPE, OR AROUND THE PERIMETER OF A DISTURBED AREA.
- 3. THE GRADIENT ALONG THE FLOW PATH SHALL HAVE A POSITIVE GRADE TO ASSURE DRAINAGE, BUT SHALL NOT BE SO STEEP AS TO RESULT IN EROSION DUE TO HIGH VELOCITY.
- 4. THE DIVERSION FLOWLINE SHALL ALWAYS BE LOCATED A MINIMUM 10 FEET FROM THE OUTSIDE LIMITS OF DISTURBED AREA BOUNDARY.
- 6. DIVERSION BERMS SHALL BE CONSTRUCTED OUT OF EMBANKMENT (SUBSOIL) AND IN NO CIRCUMSTANCE CONSTRUCTED OUT OF SALVAGED TOPSOIL.
- 5. THE PAY ITEM NUMBER FOR TEMPORARY DIVERSION (LF) IS 208-00301.

TEMPORARY DIVERSION

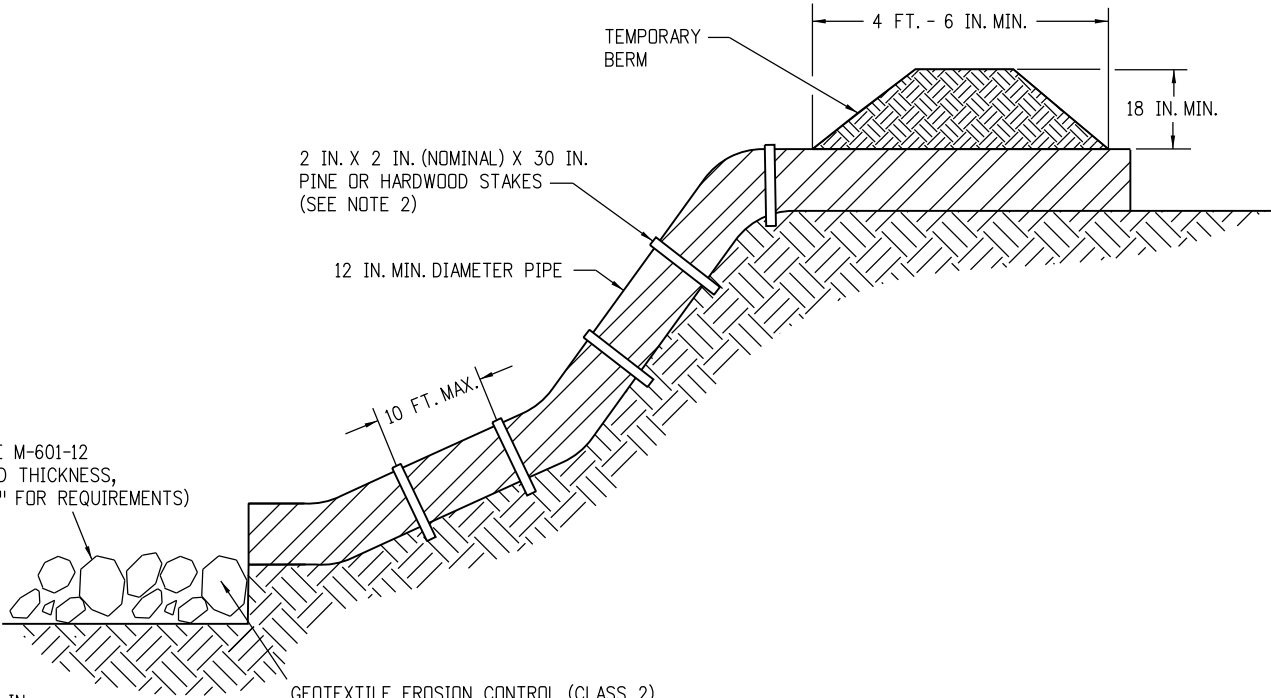

* RIPRAP OUTLET PROTECTION (SEE M-601-12
FOR MIN. HORIZONTAL LAYOUT AND THICKNESS,
AND SPECIFICATION 506 "RIPRAP" FOR REQUIREMENTS)

* RIPRAP SIZE D₅₀ = 6 IN.
OR AS SHOWN ON THE PLANS.


GEOTEXTILE EROSION CONTROL (CLASS 2)
SHALL ALWAYS BE REQUIRED



NOTES:

- 1. ANCHOR SIZE VARIES ACCORDING TO PIPE SIZE
- 2. TO SECURE THE PIPE, DRIVE STAKES INTO GROUND, THEN TIE A 12 GAUGE WIRE BETWEEN THEM ABOVE AND ACROSS THE PIPE'S WIDTH.
- 3. THE OUTLET SHALL BE ALIGNED WITH THE FLOW DIRECTION OF THE EXISTING GRADE. PERPENDICULAR DISCHARGE TO A CHANNEL SHALL NOT BE ACCEPTABLE.
- 4. THE GRADE AROUND THE INLET TO THE PIPE SHALL BE COMPACTED.
- 5. THE PAY ITEM NUMBER FOR TEMPORARY SLOPE DRAINS (LF) IS 208-00060.

TEMPORARY SLOPE DRAINS

GRADING APPLICATIONS

Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	TEMPORARY EROSION CONTROL	STANDARD PLAN NO.	
Creation Date: 07/31/19	Date:		Comments	M-208-1				
Designer Initials: JBK				Standard Sheet No. 7 of 11				
Last Modification Date: 07/31/19				Project Sheet Number:				
Detailer Initials: LTA								
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English				Issued by the Project Development Branch: July 31, 2019				

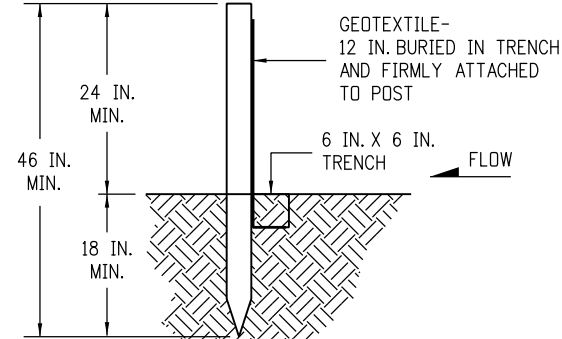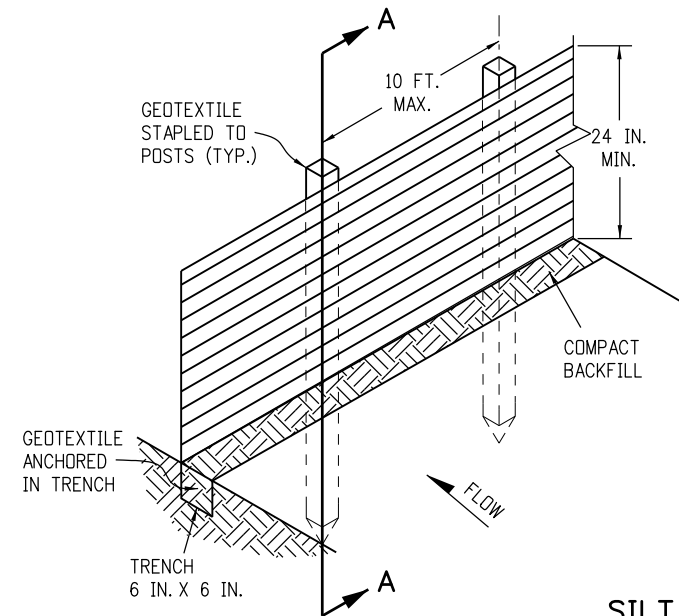


SECTION A-A

SILT FENCE

NOTES:


1. GEOTEXTILE SHALL BE ATTACHED TO WOOD POSTS WITH THREE OR MORE STAPLES PER POST. STAPLES SHALL BE HEAVY DUTY WIRE AND AT LEAST 1 INCH LONG.
2. WOOD POST SHALL BE 1 IN. X 1 IN. NOMINAL.
3. THE PAY ITEM NUMBER FOR SILT FENCE (LF) IS 208-00020.
4. THE SILT FENCE SHALL BE PLACED ON THE CONTOUR (AT THE SAME ELEVATION ± 6 IN.). THE ENDS SHALL BE FLARED UP SLOPE (MINIMUM ELEVATION GAIN OF 18 IN.).

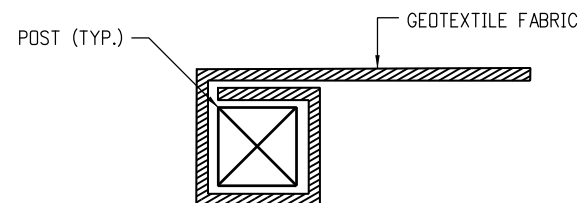

END SECTION DETAIL (PLAN VIEW)

NOTE:


1. THE END OF THE SILT FENCE FABRIC SHALL BE WRAPPED APPROX. 6 INCHES AROUND A WOODEN POST ONE FULL TURN, THEN SECURED ALONG THE POST WITH 6 HEAVY DUTY WIRE STAPLES AT LEAST 1 INCH LONG.

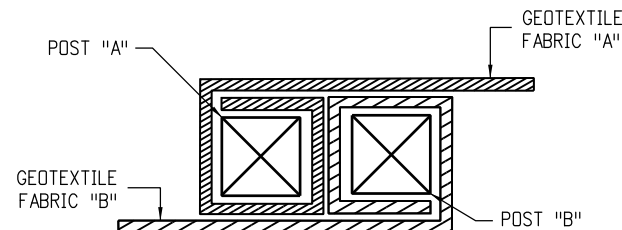


JOINING SECTION DETAIL (PLAN VIEW)

NOTES:

1. THE ENDS OF THE SILT FENCE FABRIC SHALL BE JOINED TOGETHER BY WRAPPING APPROX. 6 INCHES OF EACH END AROUND A WOODEN POST ONE FULL TURN, THEN SECURED ALONG THE POST WITH 6 HEAVY DUTY WIRE STAPLES AT LEAST 1 INCH LONG.
2. POSTS SHALL BE TIGHTLY ABUTTED WITH NO GAPS TO PREVENT POTENTIAL FLOW-THROUGH OF SEDIMENT AT JOINT.

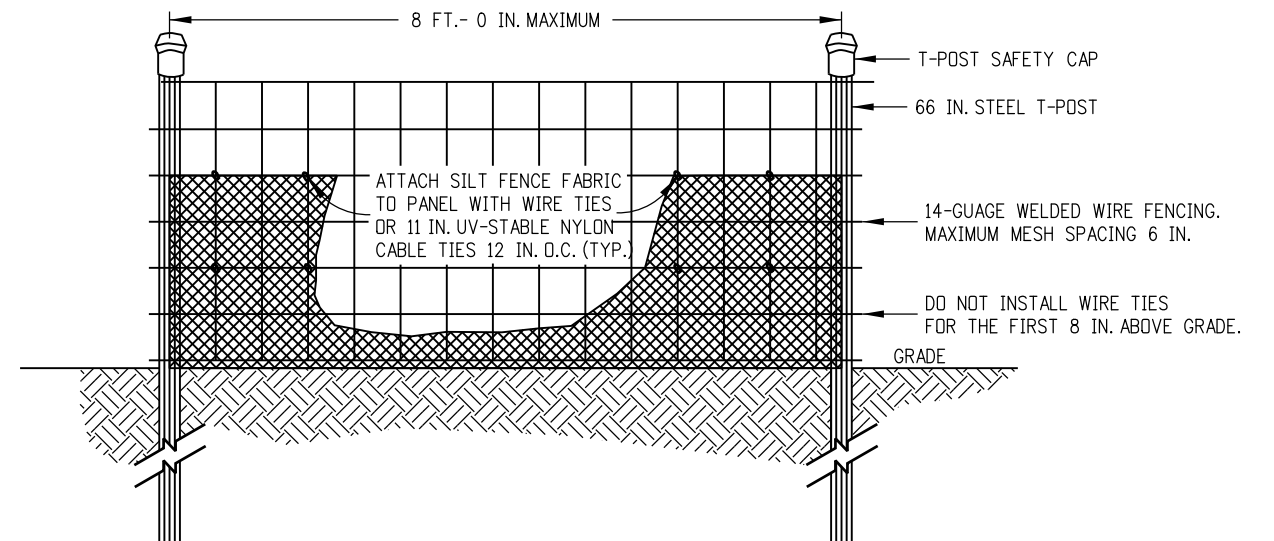

ELEVATION VIEW

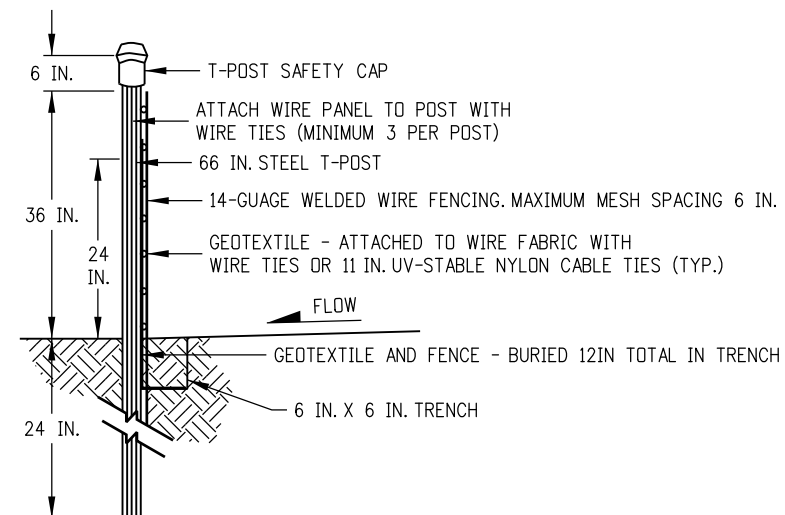

SIDE VIEW


NOTES:

1. THE ENDS OF THE SILT FENCE FABRIC SHALL BE JOINED TOGETHER BY WRAPPING APPROX. 6 INCHES OF EACH END AROUND A STEEL T-POST, THEN SECURED ALONG THE POST WITH WIRE TIES (MINIMUM 3 PER POST).
2. POSTS SHALL BE TIGHTLY ABUTTED WITH NO GAPS TO PREVENT POTENTIAL FLOW-THROUGH OF SEDIMENT AT JOINT.
3. SILT FENCES SHALL NOT BE USED FOR CHECK DAMS.
4. THE PAY ITEM NUMBER FOR SILT FENCE (REINFORCED) (LF) IS 208-00021.



SILT FENCE (REINFORCED)

SILT FENCE APPLICATIONS

Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	TEMPORARY EROSION CONTROL	STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-208-1
Designer Initials: JBK						Standard Sheet No. 8 of 11
Last Modification Date: 07/31/19						
Detailer Initials: LTA						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)				Issued by the Project Development Branch: July 31, 2019	Project Sheet Number:

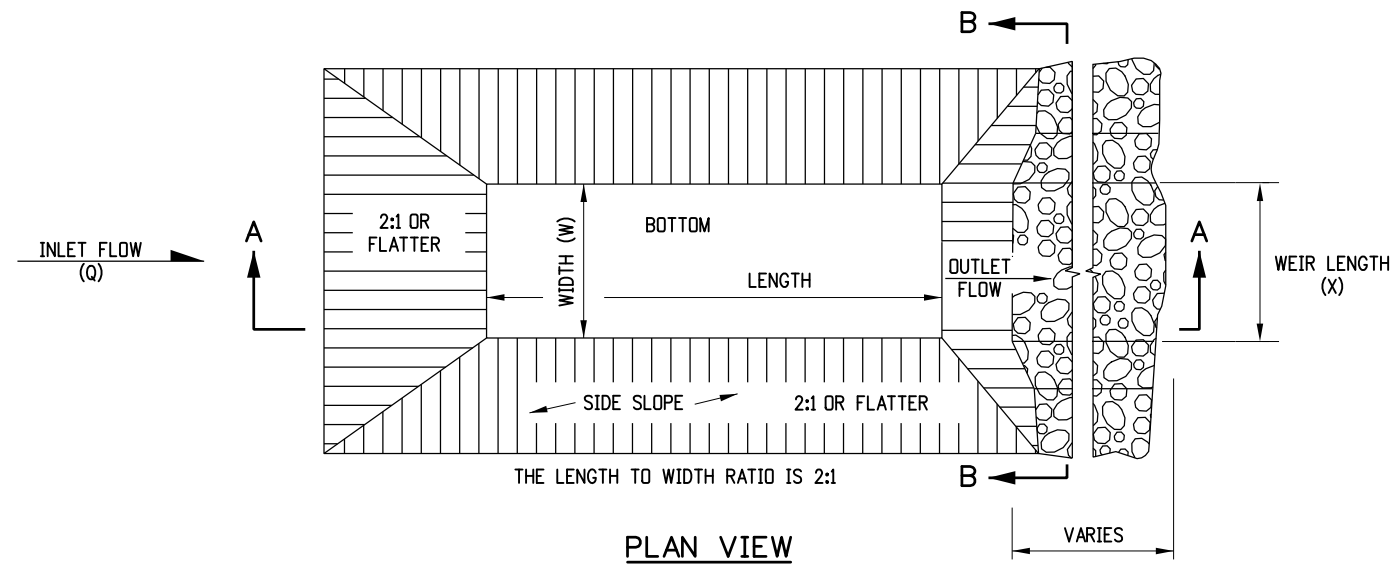

- NOTES**
1. THE MAXIMUM DRAINAGE AREA IS 5 ACRES.
 2. THE MAXIMUM STRUCTURE LIFE IS 2 YEARS.
 3. THE STORAGE AREA IS 1800 CUBIC FEET PER ACRE.
 4. THE MAXIMUM EMBANKMENT HEIGHT SHALL BE 5 FT. MEASURED ON THE DOWNSTREAM SIDE.
 5. THE LENGTH/WIDTH RATIO MAY BE ADJUSTED TO MEET SITE CONDITIONS WHEN APPROVED BY THE ENGINEER.
 6. WIDTH (W) OF SEDIMENT TRAP IS APPROXIMATELY EQUAL TO THE WEIR LENGTH (X).
 7. SEDIMENT TRAP DESIGN SHALL BE APPROVED BY THE ENGINEER.
 8. THE DOWN GRADE FROM WEIR SHALL BE STABLE AND NON-ERODIBLE.
 9. THE PAY ITEM NUMBER FOR SEDIMENT TRAP (LF) IS 208-00033.


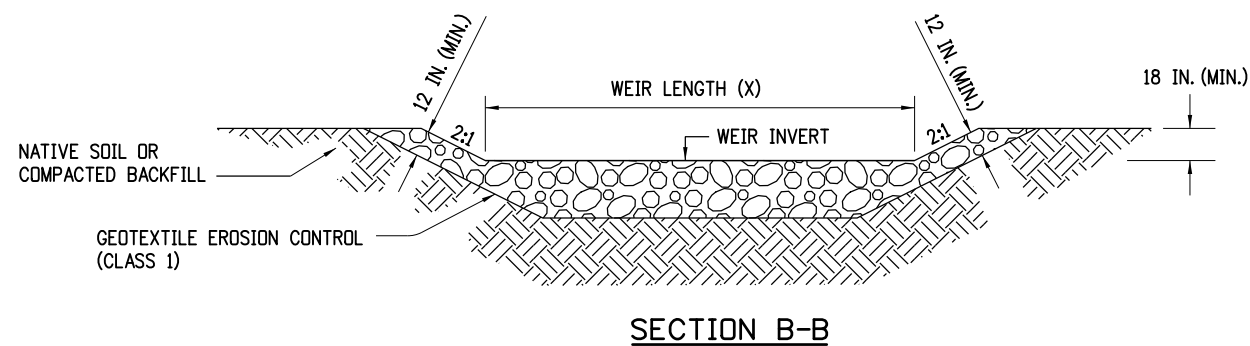
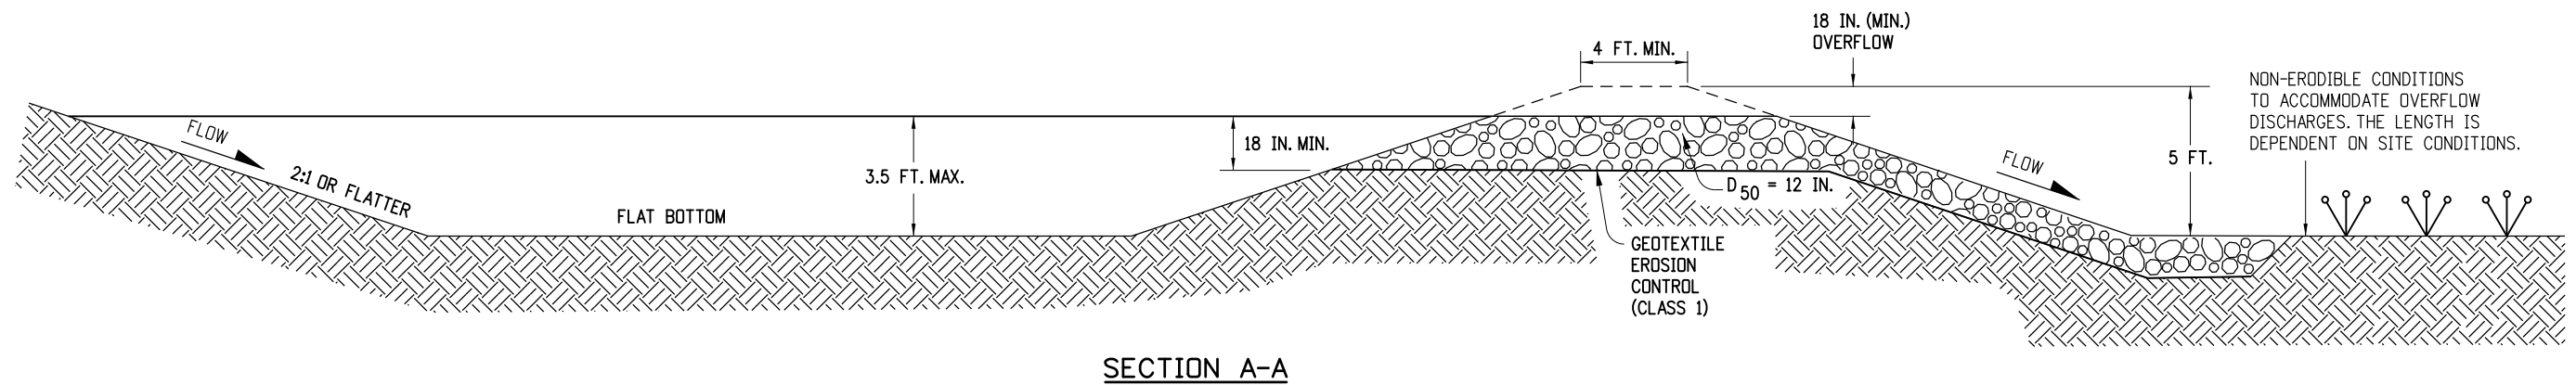


DRAINAGE AREA (ACRES)	WEIR LENGTH (FEET)
1	4
2	6
3	8
4	10
5	12

WEIR LENGTH TABLE


SEDIMENT TRAP

Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	TEMPORARY EROSION CONTROL Issued by the Project Development Branch: July 31, 2019	STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-208-1
Designer Initials: JBK	(R-X)					Standard Sheet No. 9 of 11
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:
Detailer Initials: LTA	(R-X)					
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)					

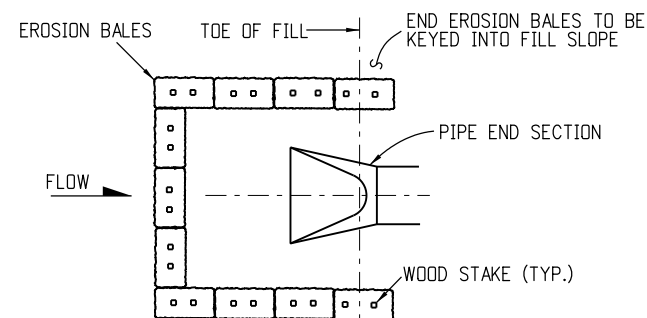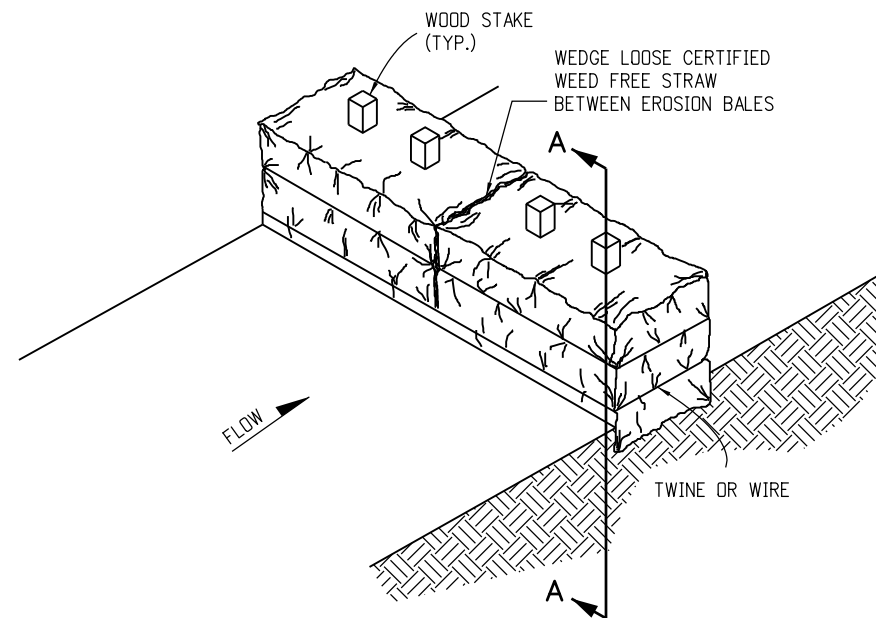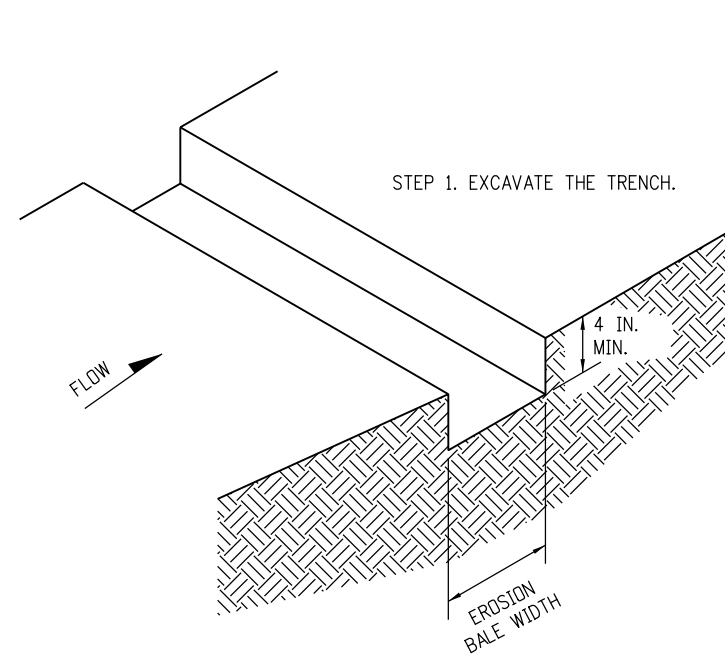


PLAN VIEW

EROSION BALE CULVERT INLET PROTECTION

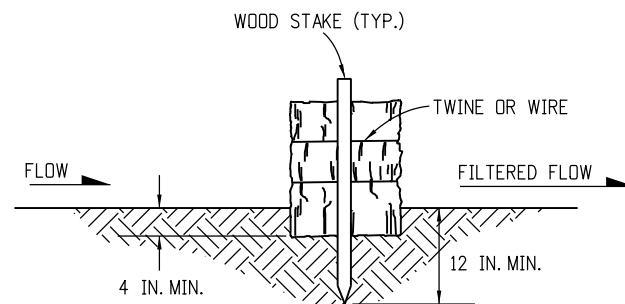


SECTION A-A

EROSION BALE TRENCHING AND STAKING

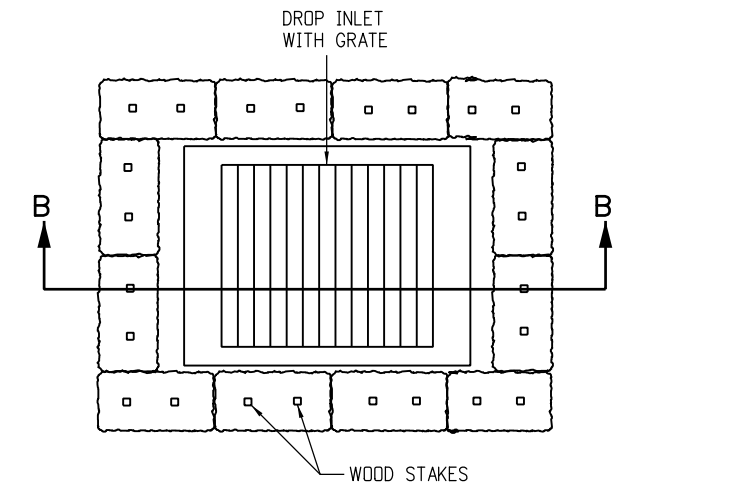

PLAN VIEW

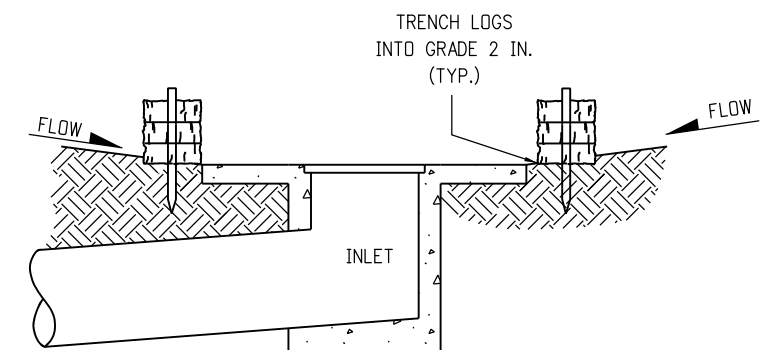

SECTION B-B

NOTE: LOCATE EROSION BALES AT THE OUTSIDE EDGE OF THE CONCRETE APRON.


EROSION LOG FILTER AT DROP INLET

NOTES


1. STAKES SHALL BE WOOD AND SHALL BE 2 IN. X 2 IN. X 30 IN. NOMINAL.
2. EROSION BALES SHALL BE 18 IN. X 18 IN. X 36 IN.
3. EROSION BALES SHALL BE ENTRENCHED 4 IN. MINIMUM INTO THE SOIL, THIGHTLY ABUTTED WITH NO GAPS, STAKED, AND BACKFILLED AROUND THE ENTIRE OUTSIDE PERIMETER.
4. EROSION BALES CANNOT BE USED FOR CHECK DAMS.
5. EROSION BALE FILTER SHALL BE LOWER THAN BERM ELEVATION OR USED IN A SUMP CONDITION.
6. THE PAY ITEM NUMBER FOR EROSION BALES (WEED FREE) (EA) IS 208-00011.

EROSION BALE APPLICATIONS

Computer File Information		Sheet Revisions		 Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	TEMPORARY EROSION CONTROL		STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)	Date:	Comments		M-208-1		Standard Sheet No. 10 of 11	
Designer Initials: JBK								
Last Modification Date: 07/31/19								
Detailer Initials: LTA								
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English					Issued by the Project Development Branch: July 31, 2019	Project Sheet Number:		

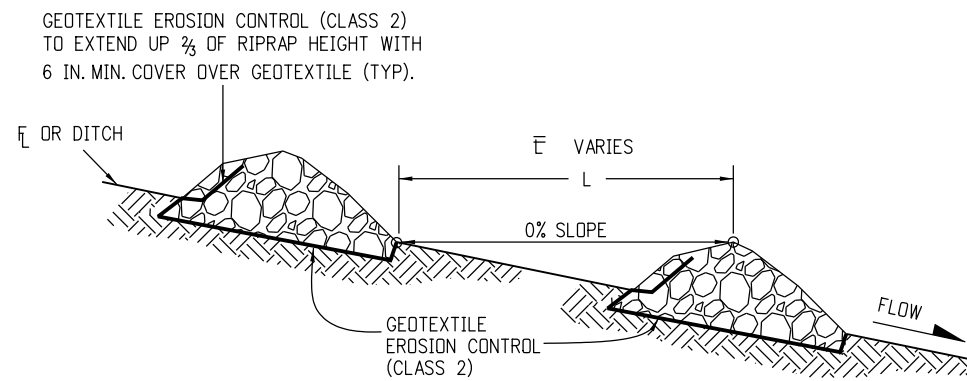

SECTION VIEW ALONG DITCH FLOWLINE

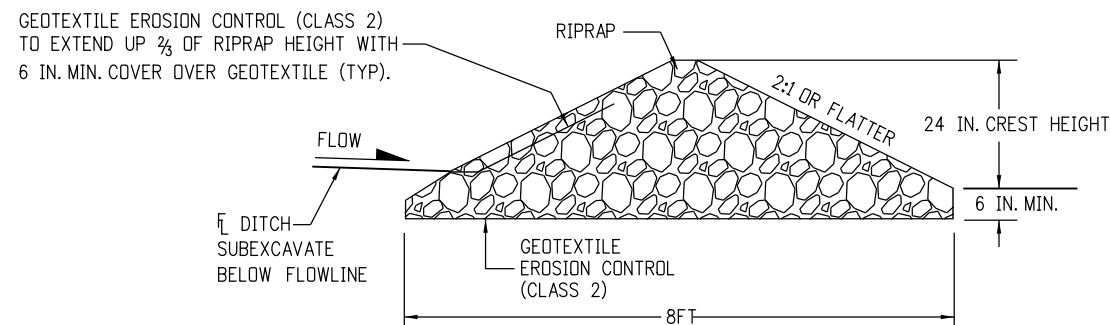


SECTION A-A

NOTES:

1. RIPRAP SIZE D_{50} = 6IN OR AS SHOWN ON THE PLANS.
2. THE GEOTEXTILE EROSION CONTROL SHALL BE CLASS 2 AND CONFORM TO THE REQUIREMENTS OF SUBSECTION 712.08.
3. THE ENDS OF RIPRAP CHECK DAM SHALL BE A MINIMUM OF 6 IN. HIGHER THAN CENTER OF CHECK DAM.
4. FOR USE AS TEMPORARY CHECK DAMS ONLY AND NOT FOR PERMANENT INSTALLATIONS.
5. THE PAY ITEM NUMBER FOR ROCK CHECK DAM (EA) IS 208-00041.


NOTE: ALL MATERIALS AND LABOR TO COMPLETE THE ROCK CHECK DAM SHALL BE INCLUDED IN THE COST OF WORK.

ROCK CHECK DAM

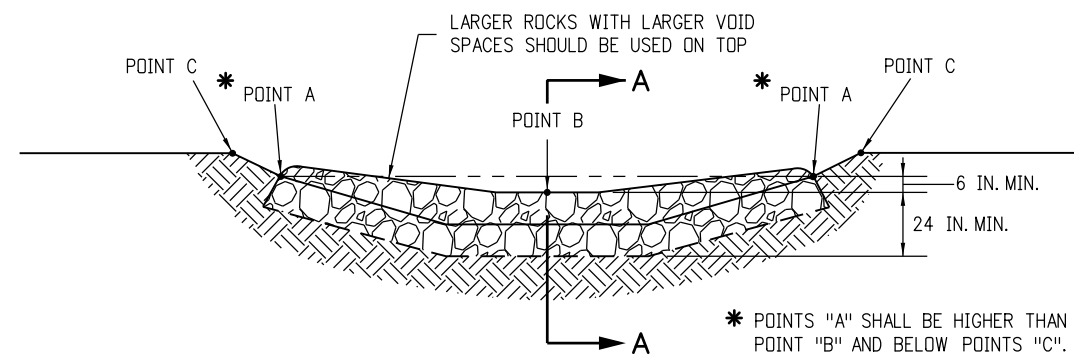


TYPICAL SECTION VIEW


Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	TEMPORARY EROSION CONTROL		STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments		M-208-1		Standard Sheet No. 11 of 11	
Designer Initials: JBK					Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:	
Last Modification Date: 07/31/19								
Detailer Initials: LTA								
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English								

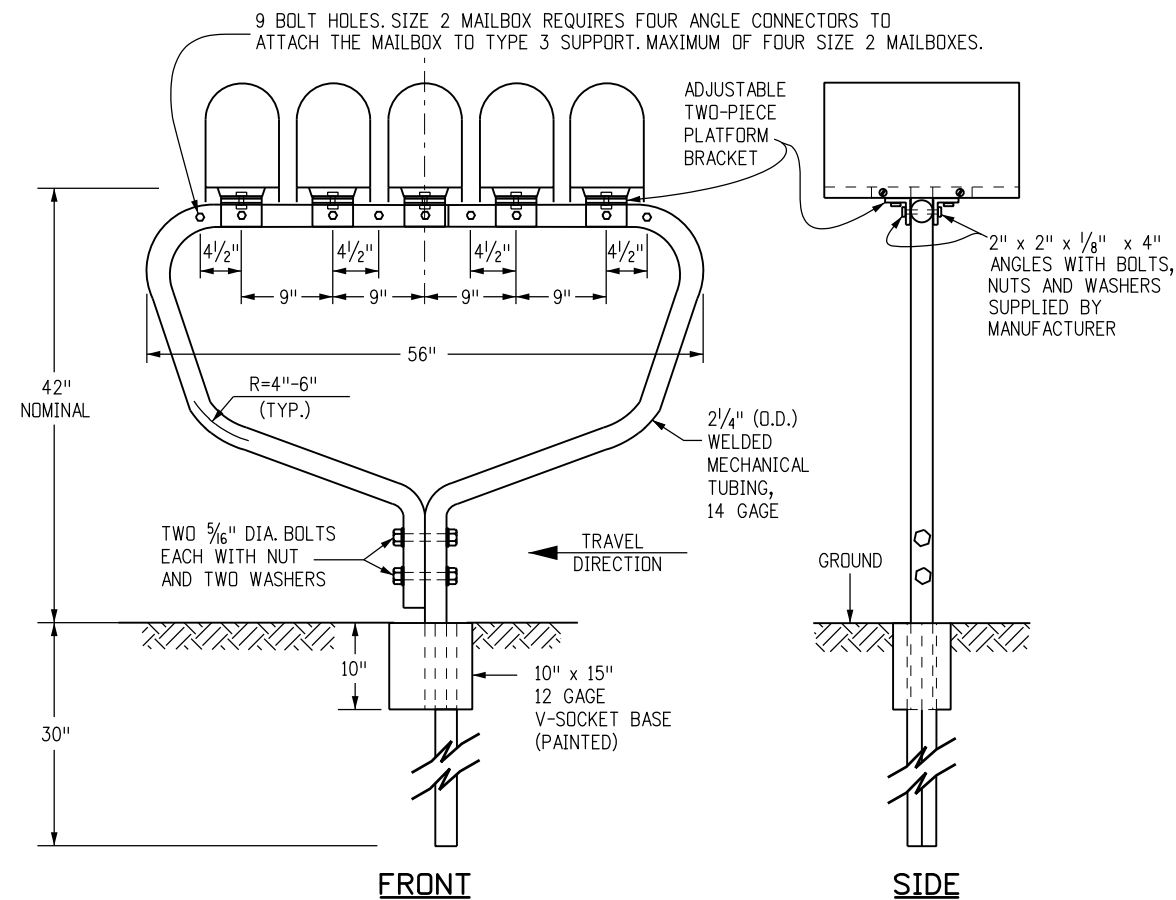


**MULTIPLE (TYPE 3) MAILBOX SUPPORT
FOR 3, 4, OR 5 MAILBOXES OR APPROVED EQUAL**
FIVE SIZE 1 MAILBOXES SHOWN

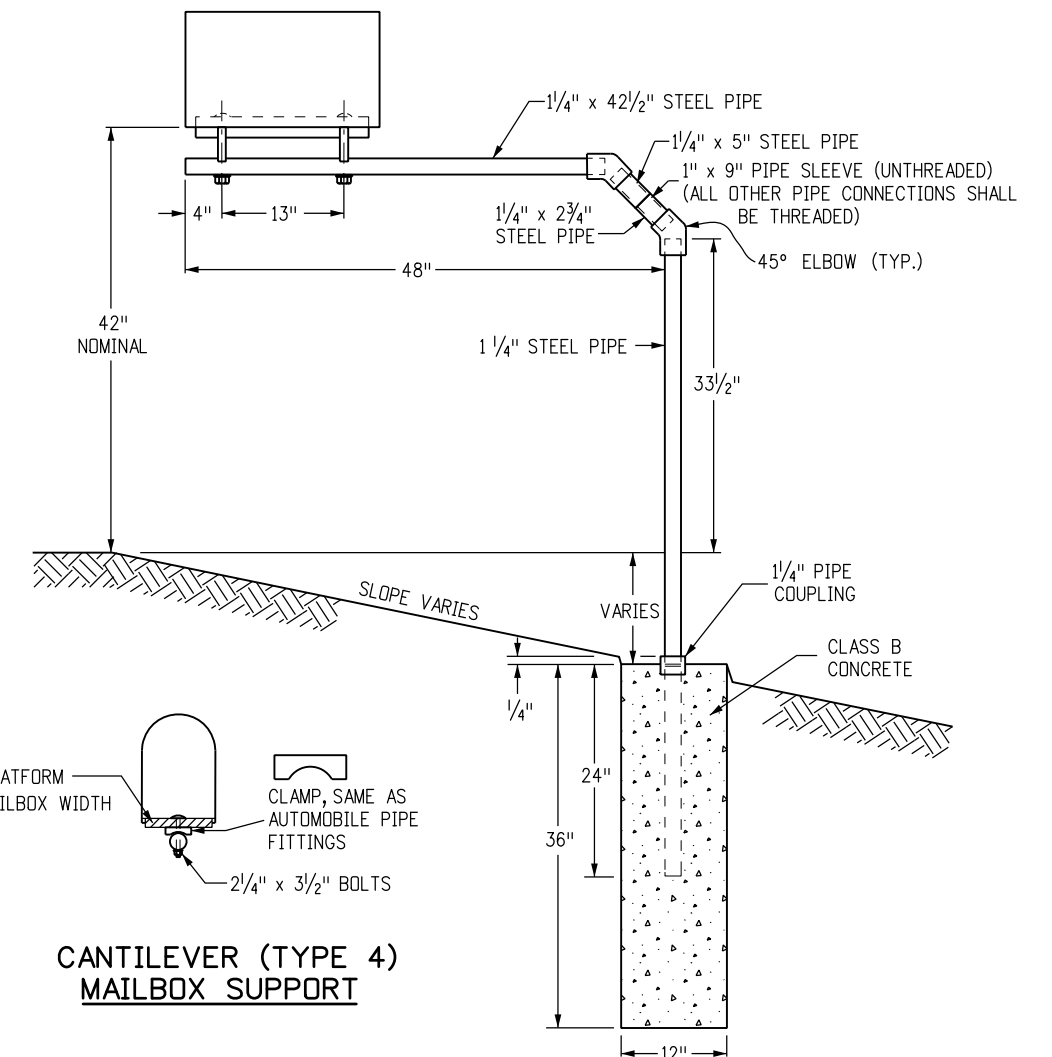


- INCREASE LENGTH 3 FT. FOR EACH ADDITIONAL SINGLE OR DOUBLE MAILBOX SUPPORT, PLUS AN ADDITIONAL 5 FT. FOR EACH MULTIPLE MAILBOX SUPPORT (ie. 2 MULTIPLE AND 1 DOUBLE; ADD 13 FT.)

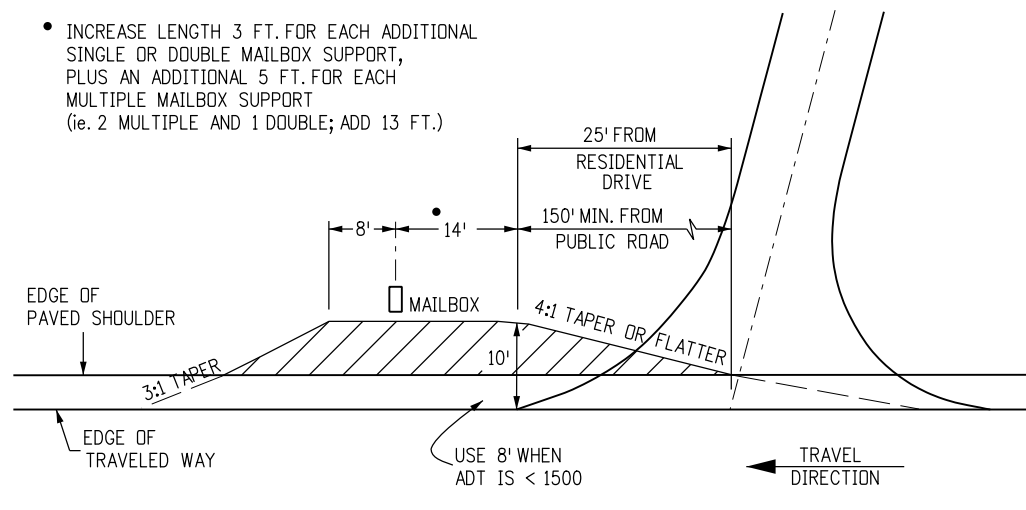

MAILBOX TURNOUT

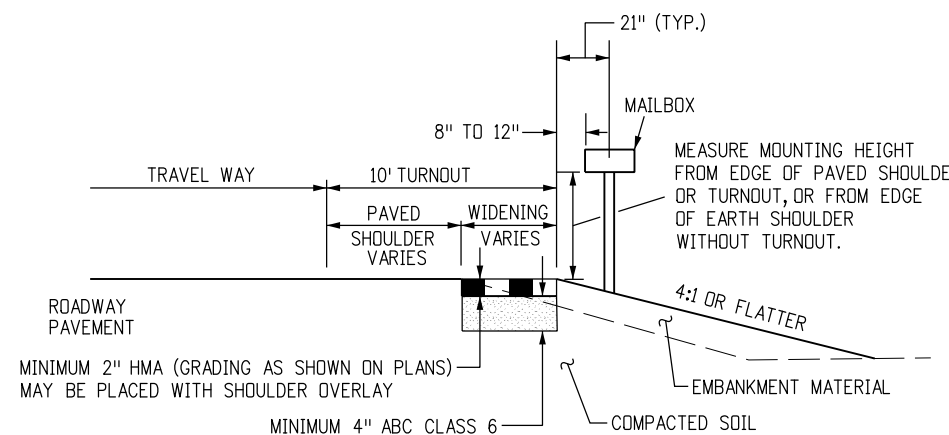


TURNOUT TYPICAL SECTION

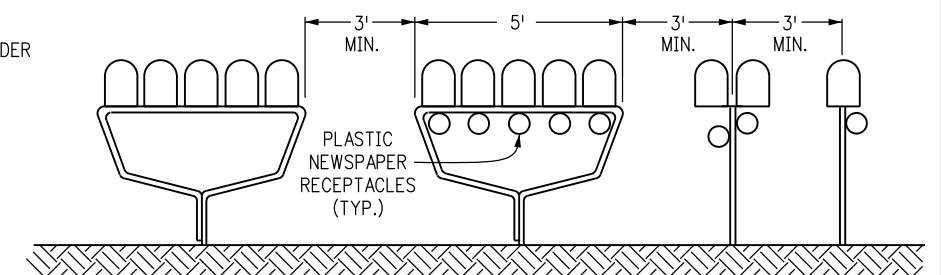




SUPPORT SPACING

NOTE: SEE SHEET 1, GENERAL NOTE 7, FOR MOUNTING PLASTIC NEWSPAPER RECEPTACLES.


Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	MAILBOX SUPPORTS		STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments				M-210-1
Designer Initials: JBK	(R-X)						Standard Sheet No. 2 of 2
Last Modification Date: 07/31/19	(R-X)						Project Sheet Number:
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)					Issued by the Project Development Branch: July 31, 2019	

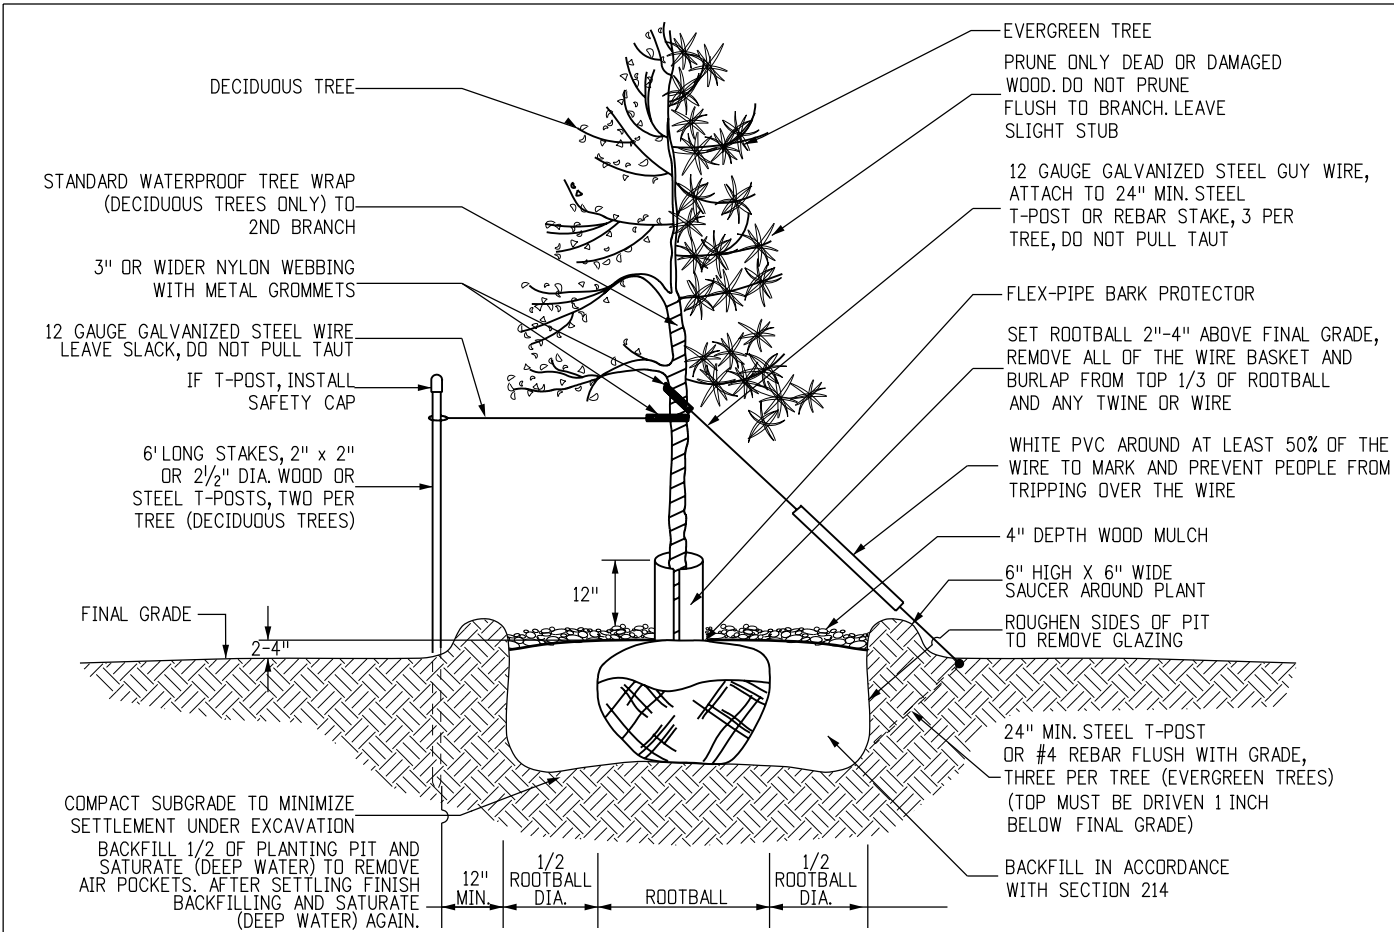


DECIDUOUS AND EVERGREEN BALLED AND BURLAPPED TREE PLANTING AND GUYING DETAIL
(GUY AND STAKE DECIDUOUS TREES 2" AND LARGER CALIPER AND EVERGREEN TREES OVER 4' HEIGHT.)
NOT TO SCALE

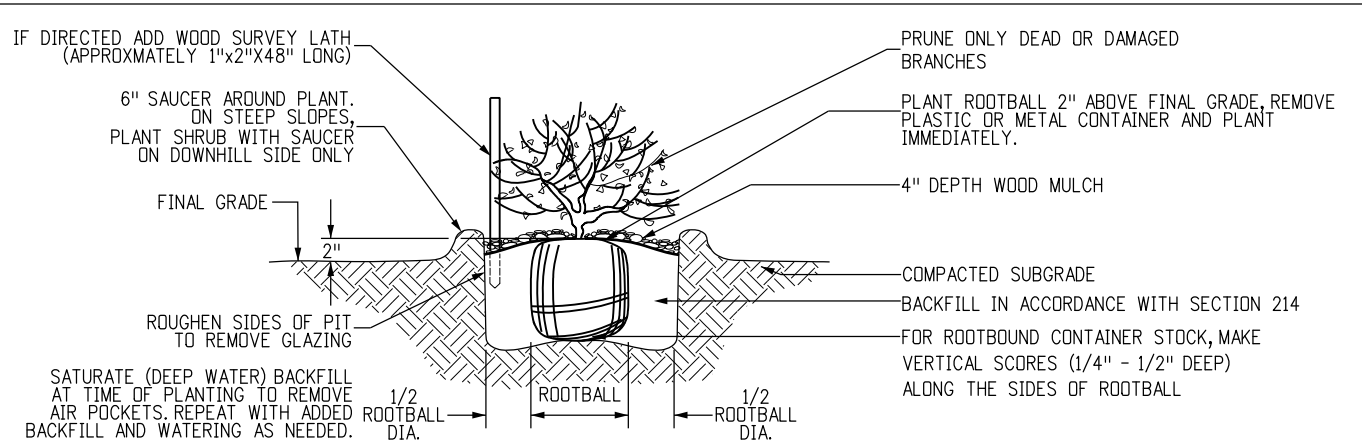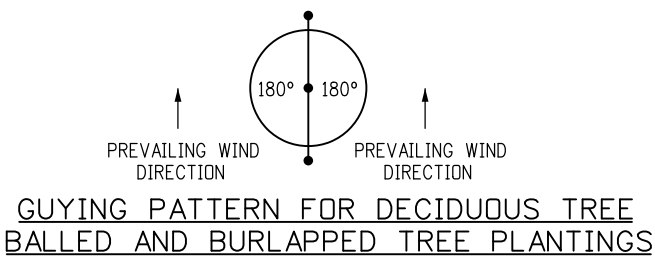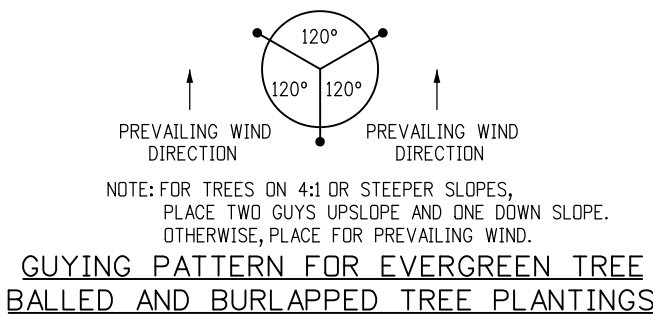


STANDARD NURSERY STOCK CONTAINERS (#5, #10 AND #20) PLANTING DETAIL
NOT TO SCALE

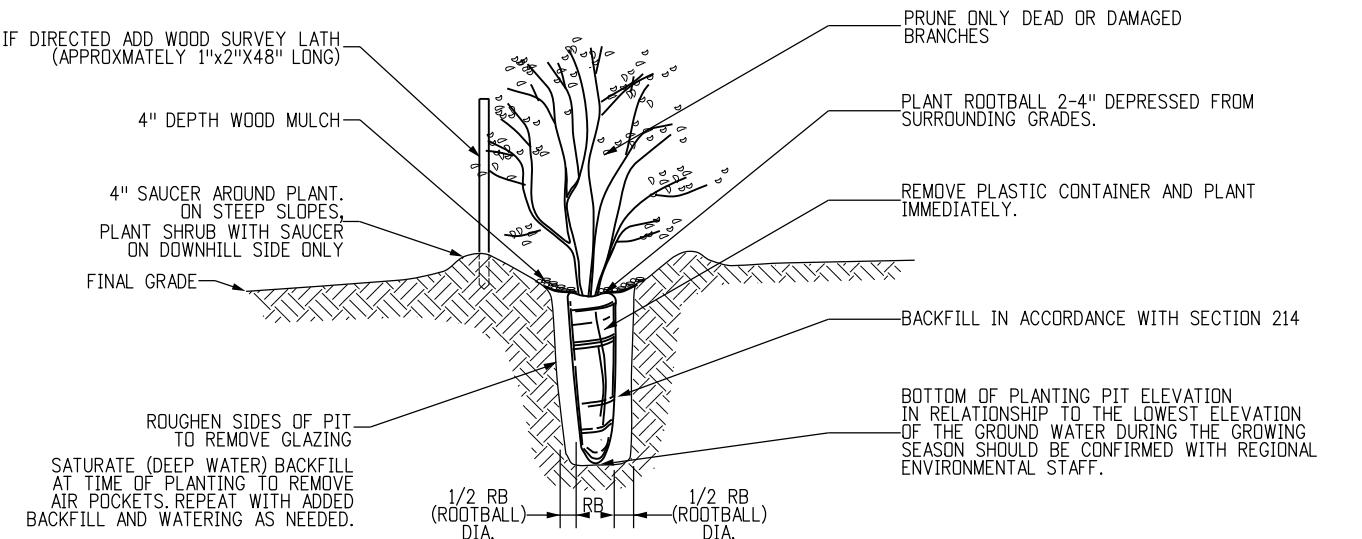

DEEP ROOTED UPLAND NURSERY CONTAINERS (DRC #10, #40, #60 AND #180) PLANTING DETAIL
NOT TO SCALE

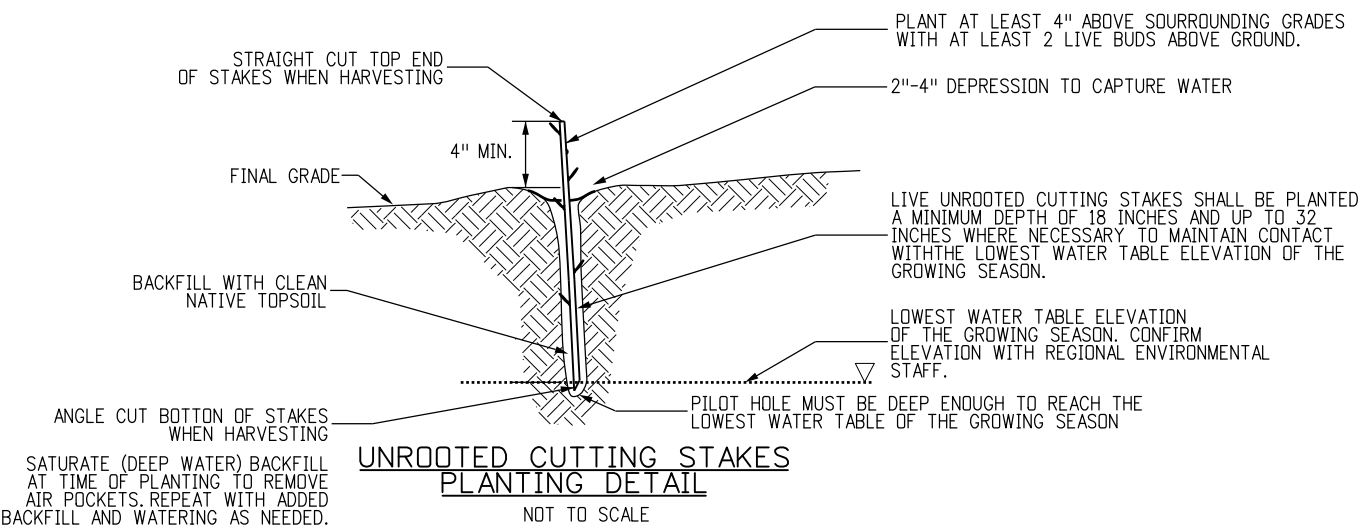


Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, Denver, CO 80204 Phone: 303-757-9542 Project Development Branch JBK	NURSERY STOCK DETAILS	STANDARD PLAN NO.	
Creation Date: 07/31/19	Date:		Comments	M-214-1				
Designer Initials: MP				Standard Sheet No. 1 of 1				
Last Modification Date: 07/31/19				Issued by the Project Development Branch: July 31, 2019				
Detailer Initials: LTA								
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English								
			Project Sheet Number:					

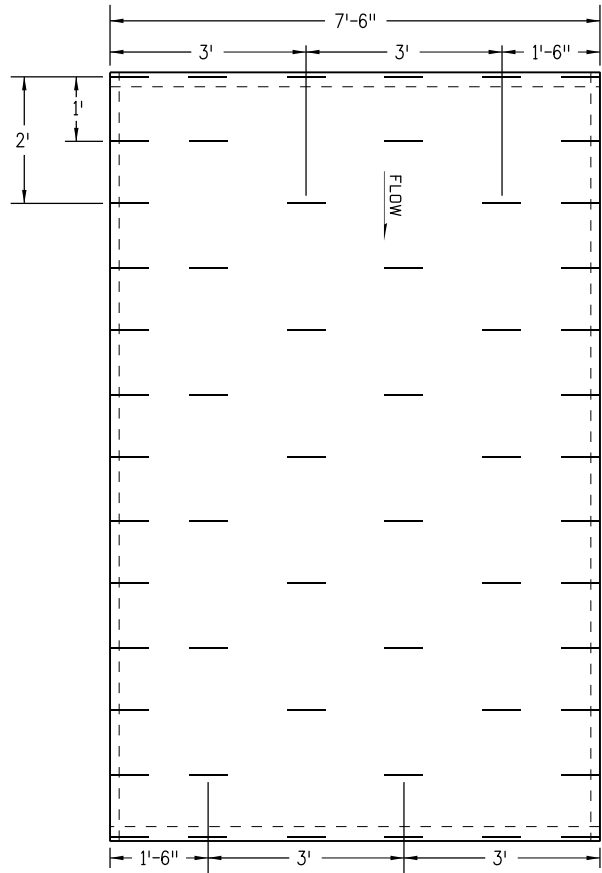


TYPICAL STAPLE PATTERN FOR CHANNEL APPLICATION

SEE SUBSECTION 216.05.

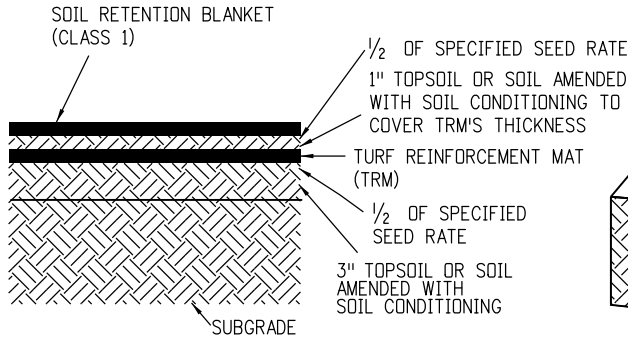


SOIL FILLED TRM APPLICATION

1. PLACE 3" TOPSOIL OR SOIL AMENDED WITH SOIL CONDITIONING.
2. APPLY HALF OF THE SPECIFIED SEED AT THE BROADCAST RATE AND RAKE IT INTO THE SOIL.
3. INSTALL TRM.
4. PLACE 1" TOPSOIL OR SOIL AMENDED WITH SOIL CONDITIONING INTO THE MATRIX TO COVER THE PRODUCT'S THICKNESS.
5. APPLY THE REMAINING HALF OF THE SPECIFIED SEED AT THE BROADCAST RATE AND RAKE IT INTO THE SOIL.
6. INSTALL SOIL RETENTION BLANKET (CLASS 1).

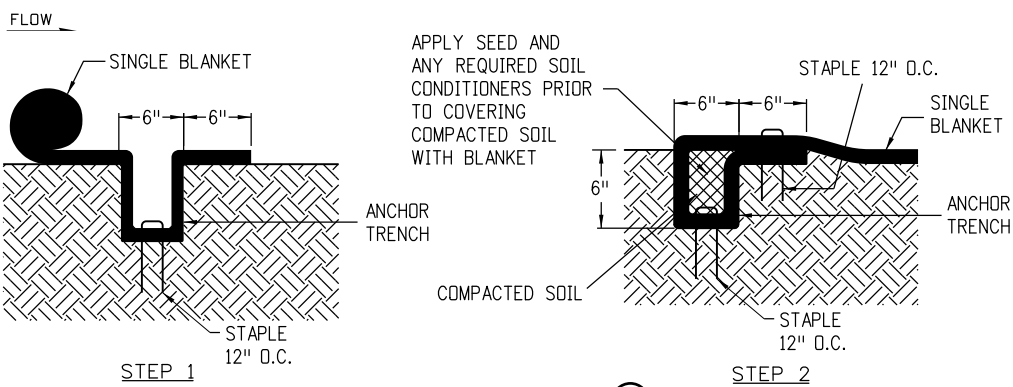


ANCHOR TRENCH (A)

TO BE USED AT THE BEGINNING AND END OF THE CHANNEL ACROSS IT'S ENTIRE WIDTH.

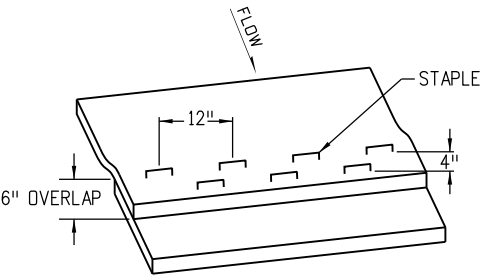


CONSECUTIVE ROLL OVERLAP (B)

TO BE USED WHEREVER ONE ROLL OF BLANKET ENDS AND ANOTHER BEGINS WITH UPSTREAM BLANKET PLACED ON TOP OF THE BLANKET ON THE DOWNSTREAM SIDE.

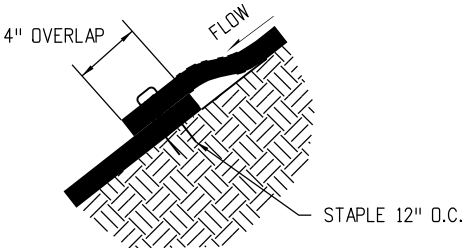


SIDE SEAM OVERLAP (C)

TO BE USED FOR OVERLAP WHEN 2 WIDTHS OF BLANKET ARE APPLIED SIDE BY SIDE WITH THE UPHILL BLANKET PLACED ON TOP OF THE BLANKET ON THE DOWNHILL SIDE.

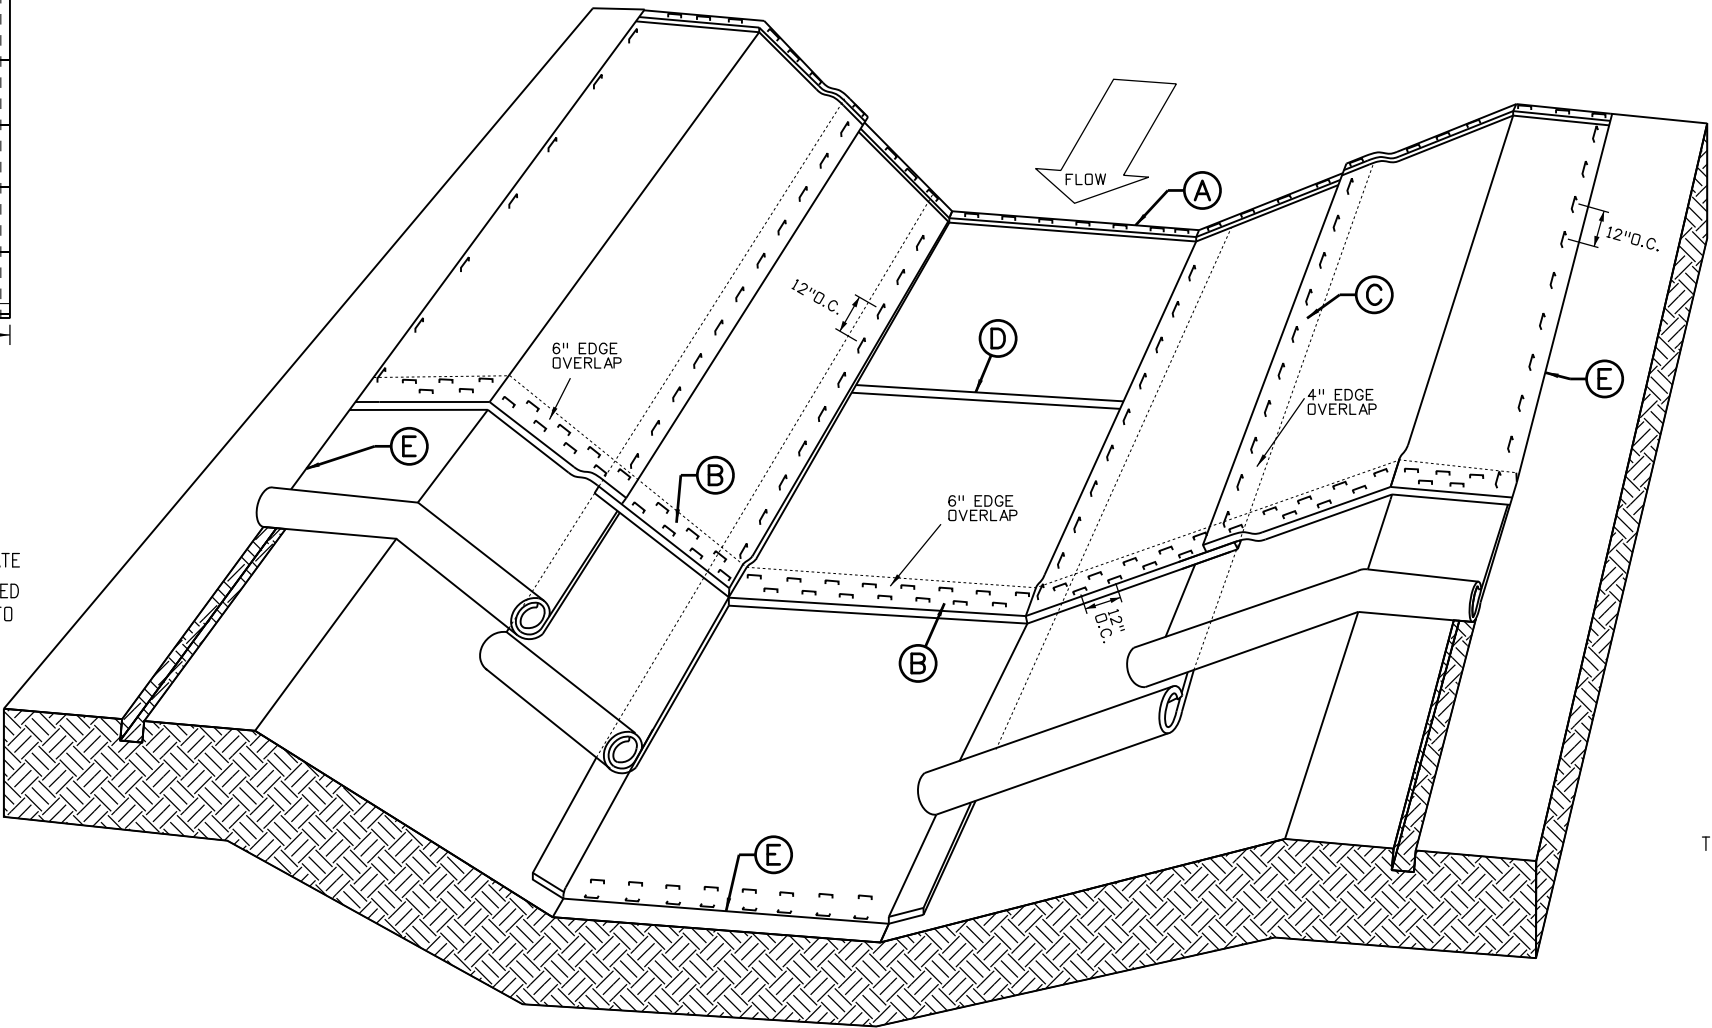


SOIL RETENTION BLANKETS/TURF REINFORCEMENT MATS (TRM) CHANNEL APPLICATION

IN ACCORDANCE WITH SECTION 216.

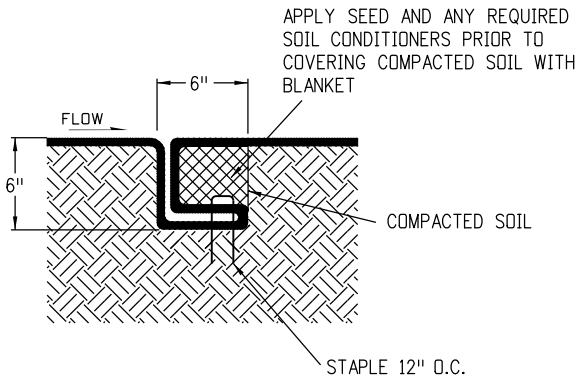

CHANNEL CHECK SLOT (D)

TO BE USED AT 30' INTERVALS IN CHANNEL FLOWLINE.

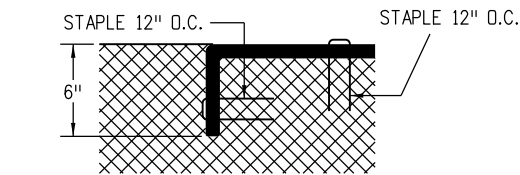


TERMINATION OF CHANNEL (E)

GENERAL NOTES


1. Z SHAPED FOLD TO BE USED ON SLOPE EVERY 35 FEET MAXIMUM.
2. STAPLE CHECK LOCATIONS SHOULD BE AT LEAST 15 FEET FROM THE BOTTOM OF SLOPE.

Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	SOIL RETENTION COVERING	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-216-1	
Designer Initials: JBK	(R-X)					Standard Sheet No. 1 of 2	
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:	
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English					Issued by the Project Development Branch: July 31, 2019		

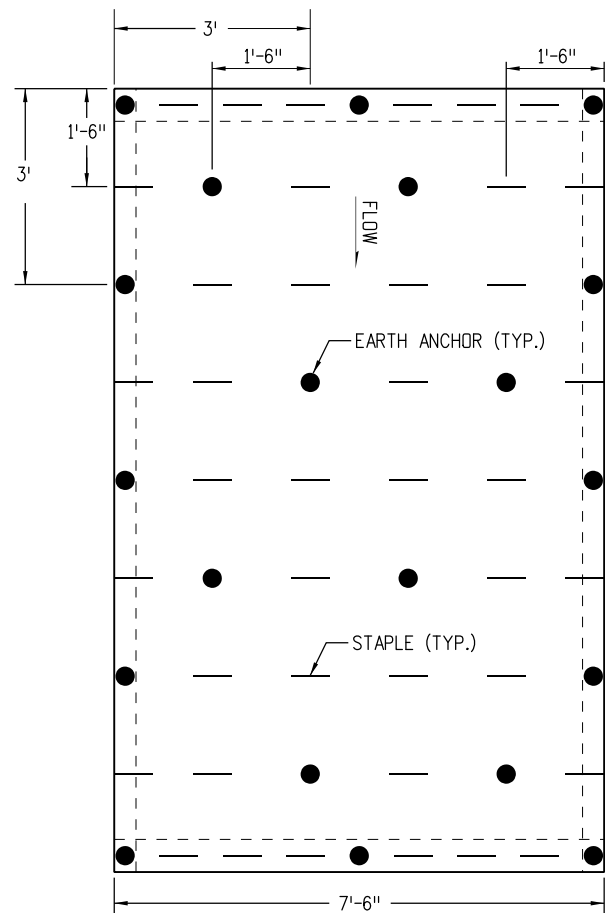


TYPICAL STAPLE OR EARTH ANCHOR PATTERN FOR SLOPE APPLICATION

IF EARTH ANCHORS ARE NOT SPECIFIED ON THE PLANS, ONLY STAPLES SHALL BE USED. SEE SUBSECTION 216.04

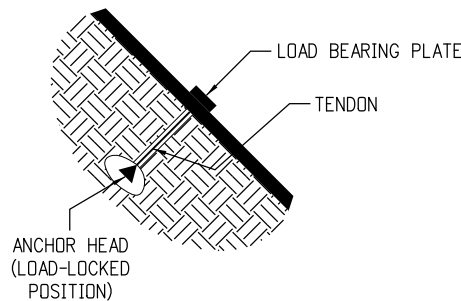


EARTH ANCHOR

- NOTES: 1. EARTH ANCHORS WILL BE USED INSTEAD OF STAPLES WHEN SPECIFIED IN THE PLANS.
2. EARTH ANCHORS SHALL BE PAID FOR SEPERATLY AS SPECIFIED IN SECTION 216.

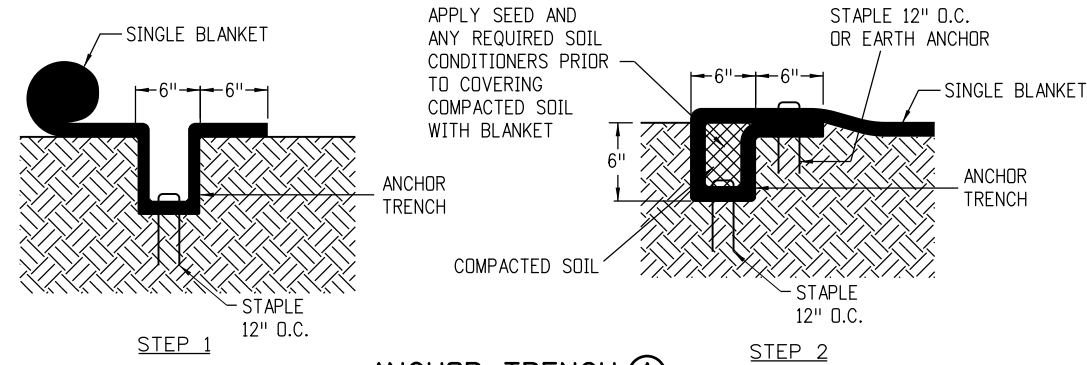


ANCHOR TRENCH ①

TO BE USED AT THE UPSLOPE AND DOWNSLOPE ENDS OF BLANKET ACROSS THE ENTIRE WIDTH OF SLOPE UNLESS SLOPE RUNS INTO RECEIVING WATER. (SEE DOWNSLOPE END STAPLE CHECK).

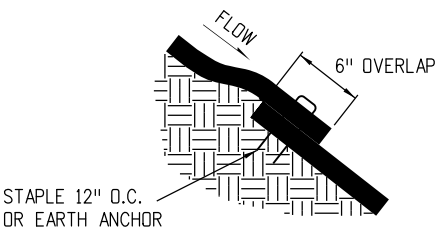


CONSECUTIVE ROLL OVERLAP ②

TO BE USED WHEREVER ONE ROLL OF BLANKET ENDS AND ANOTHER BEGINS WITH THE UPHILL BLANKET PLACED ON TOP OF THE BLANKET ON THE DOWNHILL SIDE.

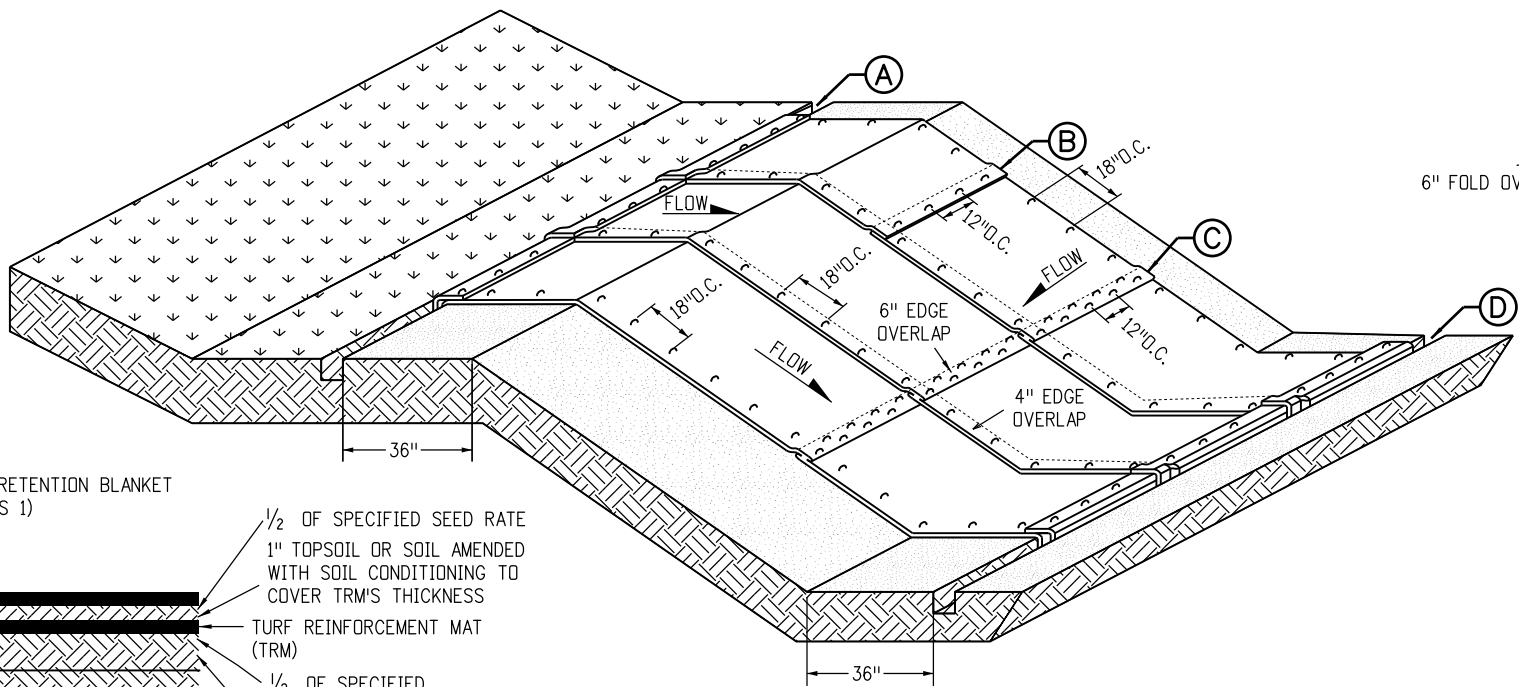


SOIL RETENTION BLANKETS/TURF REINFORCEMENT MATS (TRM) SLOPE APPLICATION

IN ACCORDANCE WITH SECTION 216.

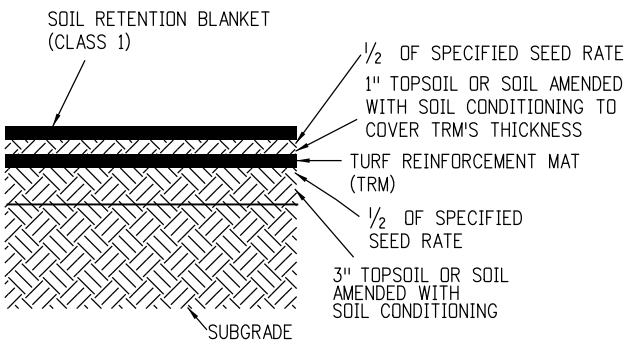


SOIL FILLED TRM APPLICATION


1. PLACE 3" TOPSOIL OR SOIL AMENDED WITH SOIL CONDITIONING.
2. APPLY HALF OF THE SPECIFIED SEED AT THE BROADCAST RATE AND RAKE IT INTO THE SOIL.
3. INSTALL TRM.
4. PLACE 1" TOPSOIL OR SOIL AMENDED WITH SOIL CONDITIONING INTO THE MATRIX TO COVER THE PRODUCT'S THICKNESS.
5. APPLY THE REMAINING HALF OF THE SPECIFIED SEED AT THE BROADCAST RATE AND RAKE IT INTO THE SOIL.
6. INSTALL SOIL RETENTION BLANKET (CLASS 1).

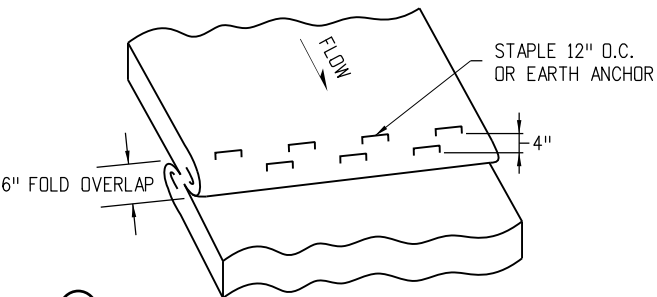

STAPLE CHECK ③

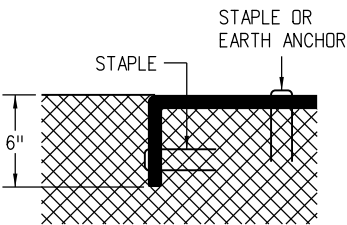


TERMINATION OF CHANNEL ④

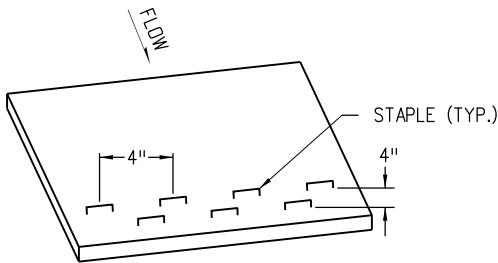


DOWNSLOPE END STAPLE CHECK

TO BE USED WHEN SLOPE RUNS INTO A RECEIVING WATER AND CANNOT BE EXTENDED 3 FEET BEYOND SLOPE.


Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	SOIL RETENTION COVERING	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-216-1	
Designer Initials: JBK	(R-X)					Standard Sheet No. 2 of 2	
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:	
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English					Issued by the Project Development Branch: July 31, 2019		

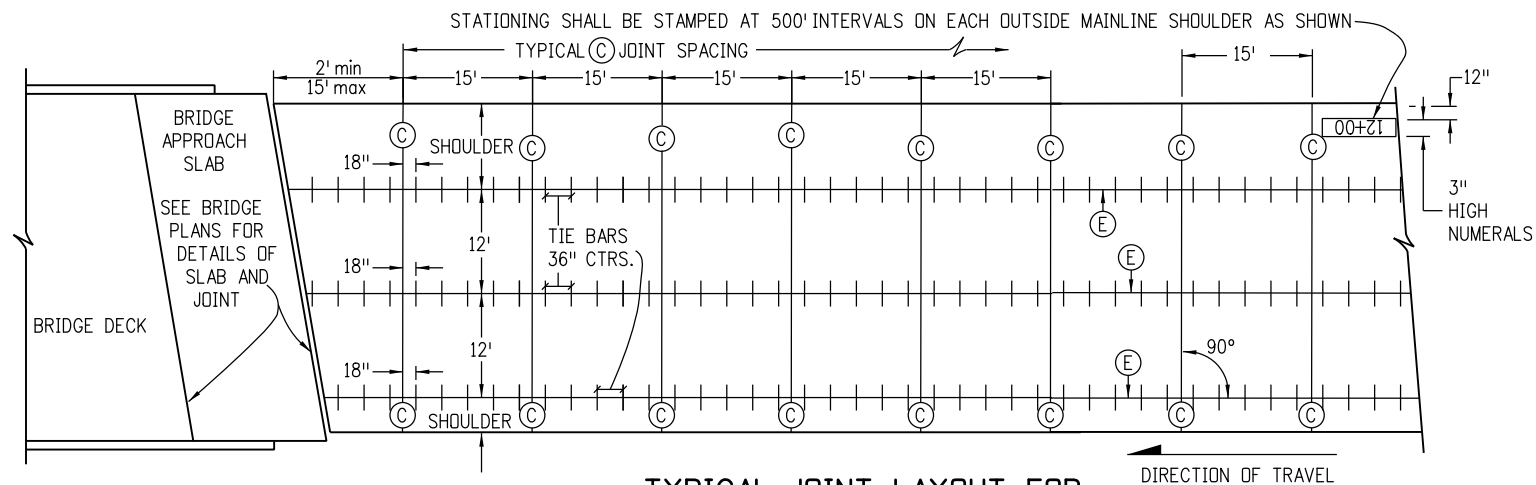

**TYPICAL JOINT LAYOUT FOR
CONCRETE ROADWAY WITH CONCRETE SHOULDERS**

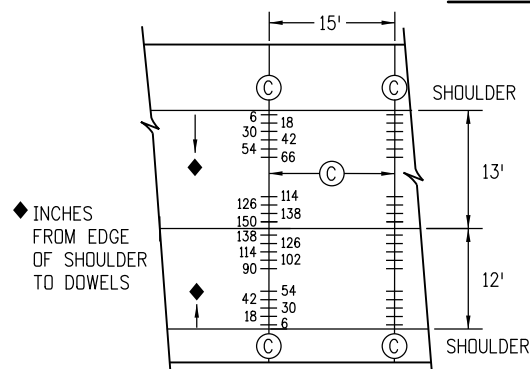


**DOWEL BAR DETAIL
FOR C JOINT WITH 13 FT. AND 12 FT. WIDE SLABS**

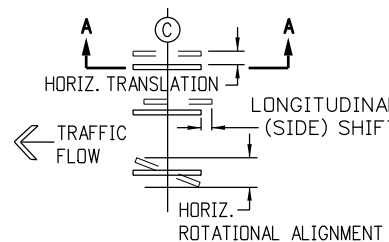


PLAN VIEW

SHOWING HORIZ. TRANSLATION,
LONGITUDINAL (SIDE) SHIFT AND
HORIZ. ROTATIONAL ALIGNMENT



SECTION A-A

SHOWING VERTICAL
TRANSLATION TOLERANCE




SECTION A-A


SHOWING VERTICAL
ROTATIONAL ALIGNMENT

DETAILS ILLUSTRATING DOWEL PLACEMENT TOLERANCES


SEE SUBSECTION 412.13(b)2 FOR ALLOWED TOLERANCE VALUES.

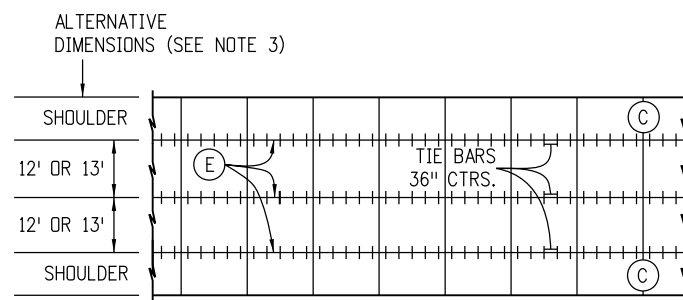

RURAL TWO-LANE

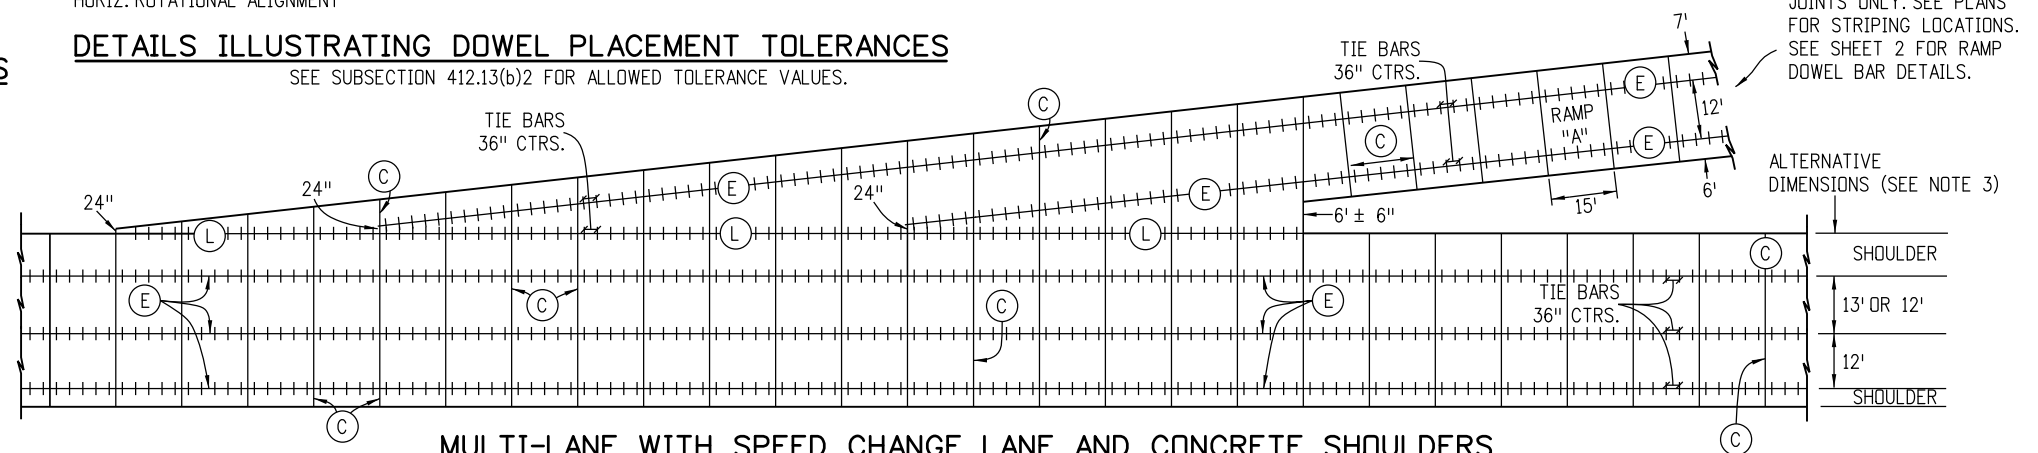

MULTI-LANE WITH SPEED CHANGE LANE AND CONCRETE SHOULDERS

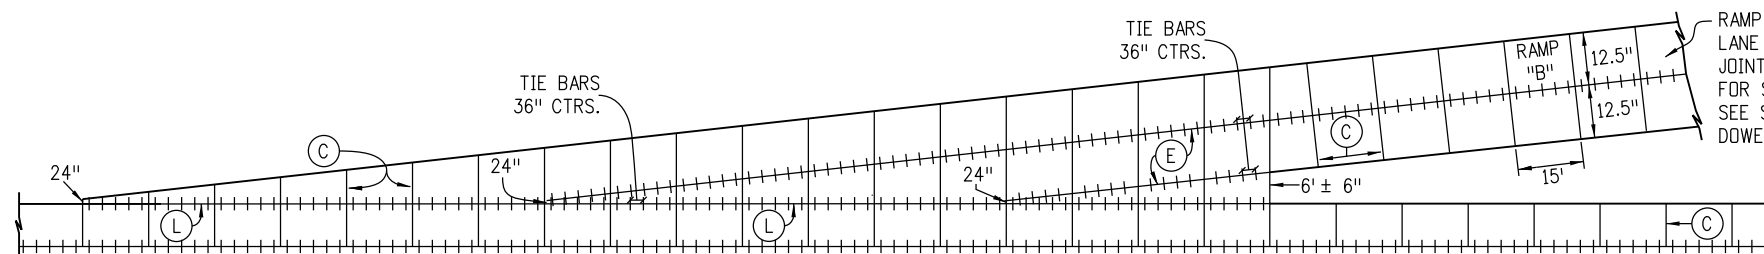


OPTIONAL LONGITUDINAL JOINT IN CENTER FOR SINGLE LANE SPEED CHANGE LANE

GENERAL NOTES

- THIS STANDARD PLAN DOES NOT APPLY TO THIN CONCRETE OVERLAYS (WHITETOPPING).
- TRANSVERSE CONSTRUCTION JOINTS SHALL BE LOCATED AT A C JOINT.
- THIS JOINT LAYOUT SHALL BE USED AS A STANDARD OF THE JOINT LAYOUT FOR THE PROJECT. IF THE CONTRACTOR PROPOSES VARIATIONS FROM THIS STANDARD OR THE PROJECT HAS UNUSUAL OR IRREGULAR CONDITIONS NOT COVERED HEREIN, THE CONTRACTOR SHALL PREPARE A PAVEMENT JOINT LAYOUT FOR APPROVAL BY THE ENGINEER. SLABS 13 FT. IN WIDTH SHALL BE CONSTRUCTED ONLY WHERE DESIGNATED ON THE PLANS.
- ON MULTILANE DIVIDED HIGHWAYS, THE MULTILANE DIRECTIONAL PAVEMENT AND BOTH SHOULDERS SHALL BE PLACED WITH E LONGITUDINAL SAWED CONTRACTION JOINTS.
- ON MULTILANE DIVIDED HIGHWAYS SEPARATED BY A CONCRETE BARRIER, A D JOINT SHALL BE CONSTRUCTED AT ONE OF THE BARRIER FACES.
- D JOINTS SHALL BE CONSTRUCTED BETWEEN THE TWO OPPOSING DIRECTIONS OF TRAVEL ON A MULTILANE UNDIVIDED HIGHWAY WHEN ALL OF THE FOLLOWING APPLY:
 - PAVEMENT IS CONTINUOUS ACROSS BOTH DIRECTIONS OF TRAVEL.
 - THERE IS NO MEDIAN BARRIER.
 - THE WIDTH OF THE PAVEMENT IN ONE DIRECTION IS GREATER THAN 80 FEET.
- ON VARIABLE WIDTH SLABS, THE 2 FT. OR 4 FT. END OF SLAB WIDTH DIMENSION MAY VARY ±6 INCHES.
- L JOINTS ARE TO BE USED WHEN A TRAFFIC LANE IS ADDED SEPARATELY, OR FOR TAPERS, OR FOR SPEED CHANGE LANES. ALTERNATIVE LONGITUDINAL JOINT LOCATIONS AT SPEED CHANGE LANES MAY BE USED IF APPROVED.
- WHERE C JOINTS ARE SHOWN IN THE SHOULDER, THE DOWEL BARS WILL BE PLACED ON 12" CENTERS STARTING 6" FROM THE ROADWAY E JOINT.

JOINT LEGEND

(SEE SHEET 5 FOR JOINT DETAILS)

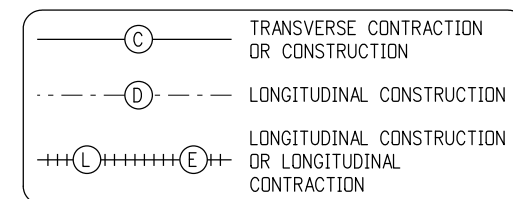

RAMP AND SPEED CHANGE
LANE DIMENSIONING FOR
JOINTS ONLY. SEE PLANS
FOR STRIPING LOCATIONS.
SEE SHEET 2 FOR RAMP
DOWEL BAR DETAILS.

ALTERNATIVE
DIMENSIONS (SEE NOTE 3)

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

Sheet Revisions

Date:	Comments
(R-X)	
(R-X)	
(R-X)	
(R-X)	

Colorado Department of Transportation



2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch

JBK

**CONCRETE
PAVEMENT JOINTS**


Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.


M-412-1

Standard Sheet No. 1 of 5

Project Sheet Number:

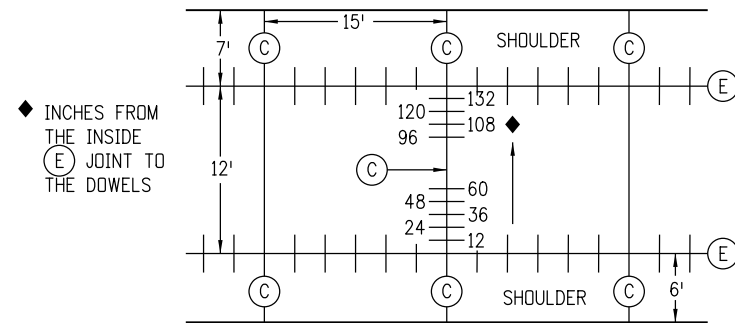


RAMP "A" DOWEL BAR DETAIL
FOR C JOINT WITH A 12 FT. LANE

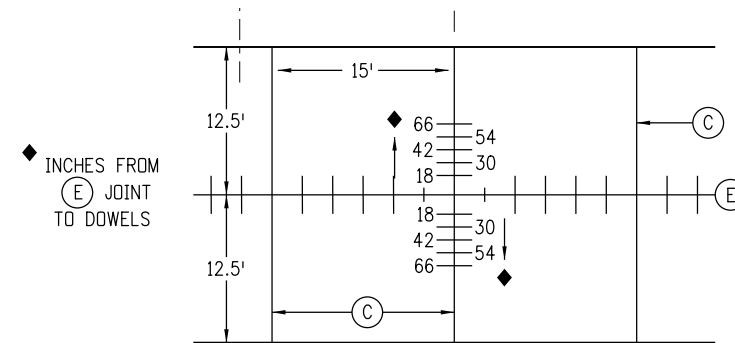


RAMP "B" DOWEL BAR DETAIL FOR C JOINT
WITH CENTER LONGITUDINAL SPLIT LANE

JOINT LEGEND
(SEE SHEET 5 FOR JOINT DETAILS)

- (C) TRANSVERSE CONTRACTION OR CONSTRUCTION
- (D) LONGITUDINAL CONSTRUCTION
- (L) LONGITUDINAL CONSTRUCTION OR LONGITUDINAL CONTRACTION

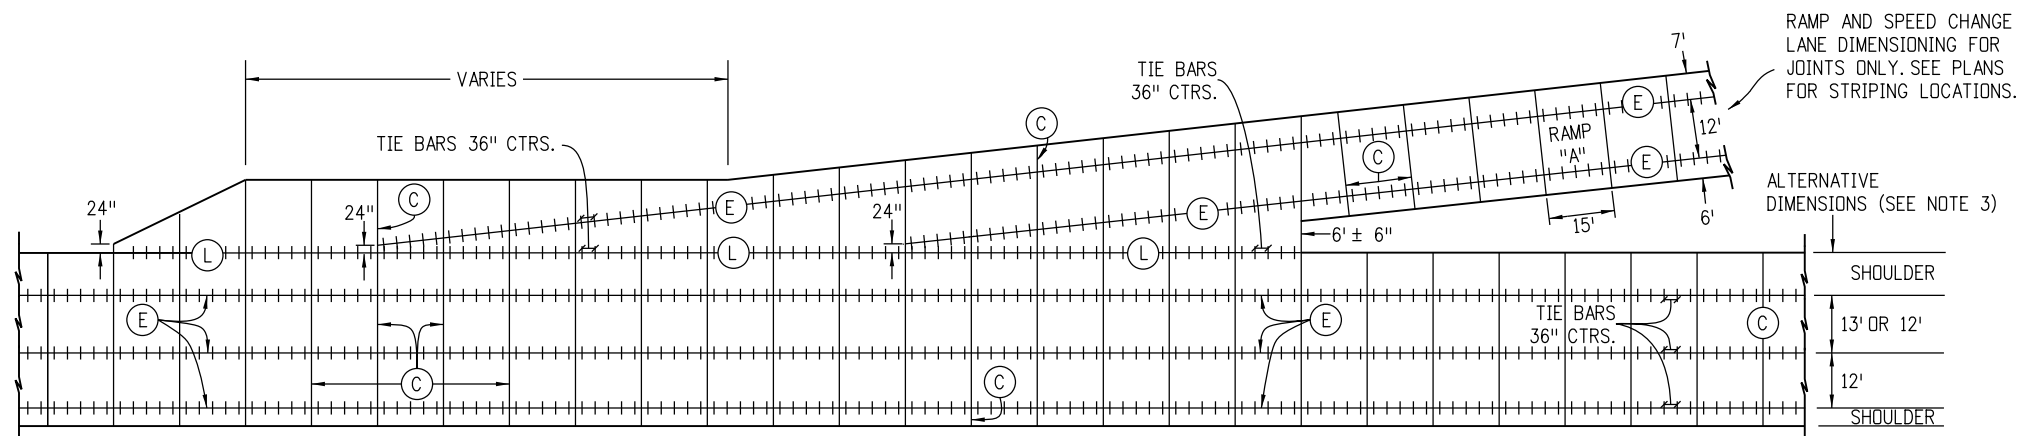


MULTI-LANE WITH ACCELERATION AND DECELERATION LANES AND CONCRETE SHOULDERS

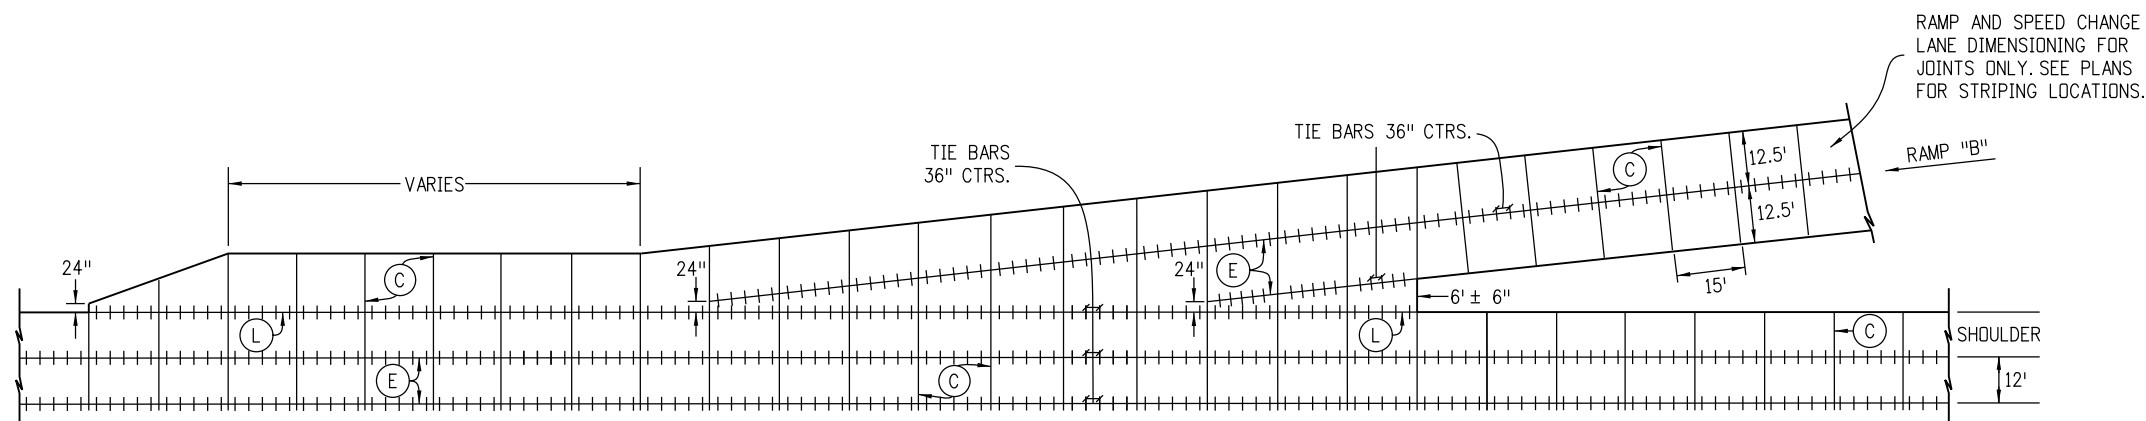


OPTIONAL LONGITUDINAL JOINT IN CENTER FOR SINGLE LANE ACCELERATION AND DECELERATION LANE

Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	CONCRETE PAVEMENT JOINTS Issued by the Project Development Branch: July 31, 2019	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-412-1	
Designer Initials: JBK	(R-X)					Standard Sheet No. 2 of 5	
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:	
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English							

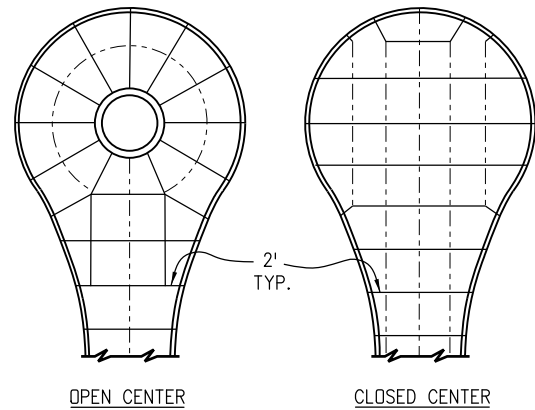


CUL-DE-SAC

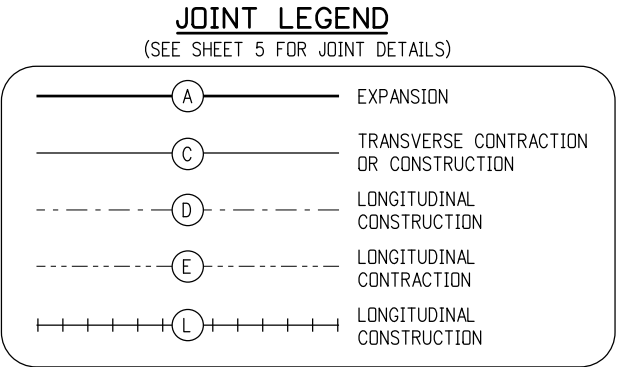

NOTES

1. LONGITUDINAL JOINTS SHALL BE PLACED ADJACENT TO LANE MARKINGS WHEN POSSIBLE, AND HAVE A MAXIMUM SPACING OF 13 FT. (15 FT. IS PERMITTED WITH MONOLITHIC CURB AND GUTTER).
2. CONSTRUCT TRANSVERSE JOINTS PERPENDICULAR TO THE CENTERLINE OF PAVEMENT AND EXTEND THROUGH THE CURB OR CURB AND GUTTER.
- * 3. PLACE 1/2 IN. MIN. EXPANSION JOINT FILLER IN TOP 6 IN. OF CURB JOINT AT INTERSECTION RETURN RADIUS POINTS.
4. THE CONTRACTOR SHALL, UNLESS OTHERWISE SHOWN ON THE PLANS, SELECT AND USE A BOND BREAKER AT INLETS, MANHOLES AND SIMILAR SIZE STRUCTURES. SMALLER STRUCTURES SUCH AS VALVE AND MONUMENT BOXES SHALL NOT REQUIRE A BOND BREAKER.
5. WHERE A LONGITUDINAL JOINT PASSES LESS THAN 1 FT. FROM A CAST-IN-PAVEMENT MANHOLE OR SIMILAR SIZE STRUCTURE, A TYPICAL 2 FT. RADIAL JOINT, AS SHOWN IN THE DETAILS, SHALL BE USED.
6. TRANSVERSE JOINTS SHALL EITHER INTERSECT THE CENTER OF CIRCULAR MANHOLES AND INLETS OR BE AT LEAST 4 FT. AWAY FROM THE EDGE OF CIRCULAR MANHOLES. SEE CURB INLET BOXOUT DETAIL ON SHEET 5.
7. TRANSVERSE CONSTRUCTION JOINTS SHALL BE LOCATED AT A (C) JOINT.
6. THE ENGINEERS SHALL HAVE AN OPTION TO USE INDIVIDUAL DOWELS IN THE (C) JOINT ON SHORT RUN (2' ± 6") TO CURB RADIUS RETURNS.

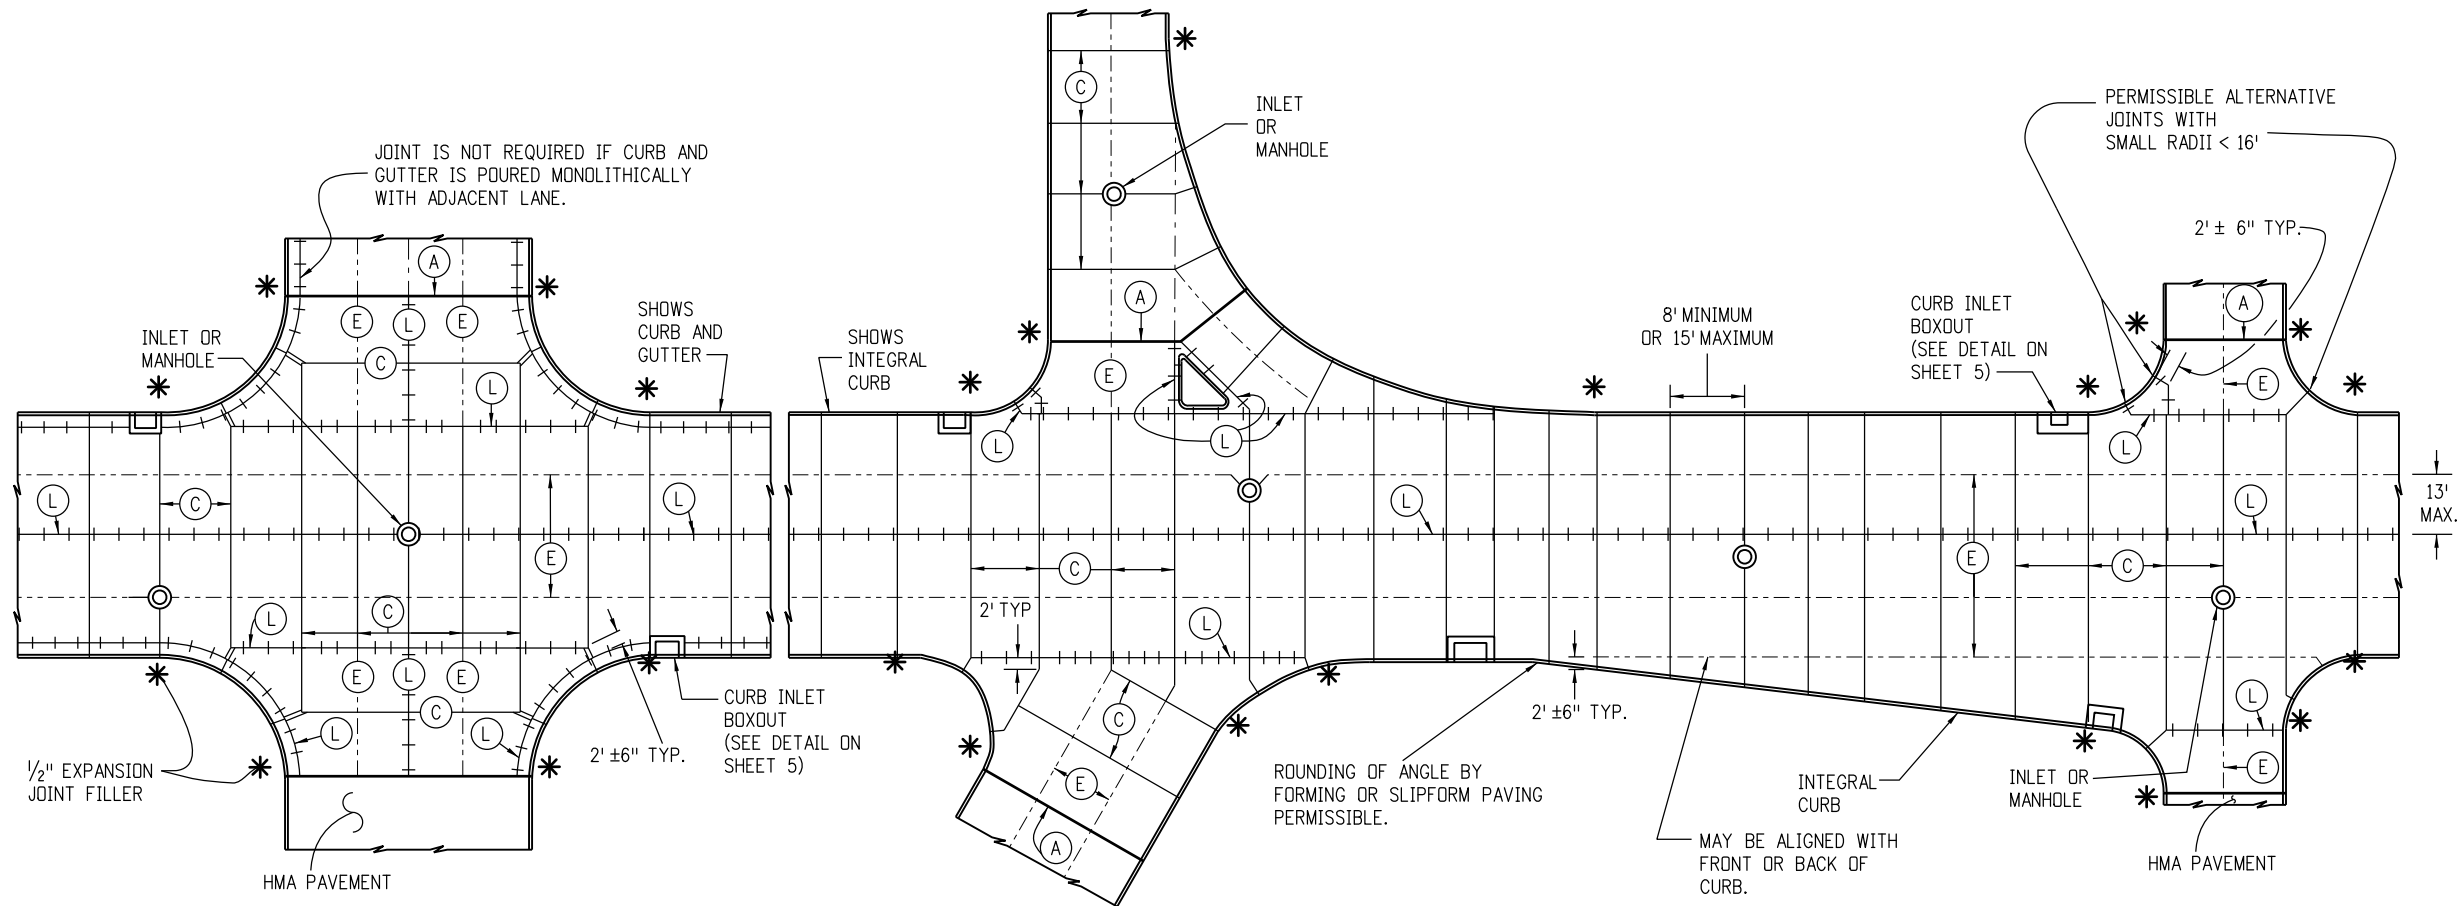


TYPICAL CURBED PAVEMENT JOINT LAYOUT

Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		 Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	CONCRETE PAVEMENT JOINTS		STANDARD PLAN NO.		
Date: Comments			M-412-1							
			Standard Sheet No. 3 of 5							
Creation Date: 07/31/19							Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:	
Designer Initials: JBK										
Last Modification Date: 07/31/19										
Detailer Initials: LTA										
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English										


JOINT LEGEND

(SEE SHEET 5 FOR JOINT DETAILS)

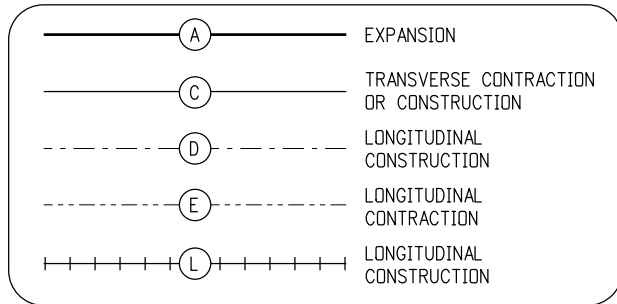

NOTES

1. LONGITUDINAL JOINTS SHALL BE PLACED ADJACENT TO LANE MARKINGS WHEN POSSIBLE, AND HAVE A MAXIMUM SPACING OF 13 FT. (15 FT. IS PERMITTED WITH MONOLITHIC CURB AND GUTTER).
2. CONSTRUCT TRANSVERSE JOINTS PERPENDICULAR TO THE CENTERLINE OF PAVEMENT AND EXTEND THROUGH THE CURB OR CURB AND GUTTER.
- * 3. PLACE 1/2 IN. MIN. EXPANSION JOINT FILLER IN TOP 6 IN. OF CURB JOINT AT INTERSECTION RETURN RADIUS POINTS.
4. THE CONTRACTOR SHALL, UNLESS OTHERWISE SHOWN ON THE PLANS, SELECT AND USE A BOND BREAKER AT INLETS, MANHOLES AND SIMILAR SIZE STRUCTURES. SMALLER STRUCTURES SUCH AS VALVE AND MONUMENT BOXES DO NOT REQUIRE A BOND BREAKER.
5. WHERE A LONGITUDINAL JOINT WOULD PASS LESS THAN 1 FT. FROM A CAST-IN-PAVEMENT MANHOLE OR SIMILAR SIZE STRUCTURE, A TYPICAL 2 FT. RADIAL JOINT, AS SHOWN IN THE DETAILS, SHALL BE USED.
6. TRANSVERSE JOINTS SHALL EITHER INTERSECT THE CENTER OF CIRCULAR MANHOLES AND INLETS OR BE AT LEAST 4 FT. AWAY FROM THE EDGE OF CIRCULAR MANHOLES. SEE CURB INLET BOXOUT DETAIL ON SHEET 5.

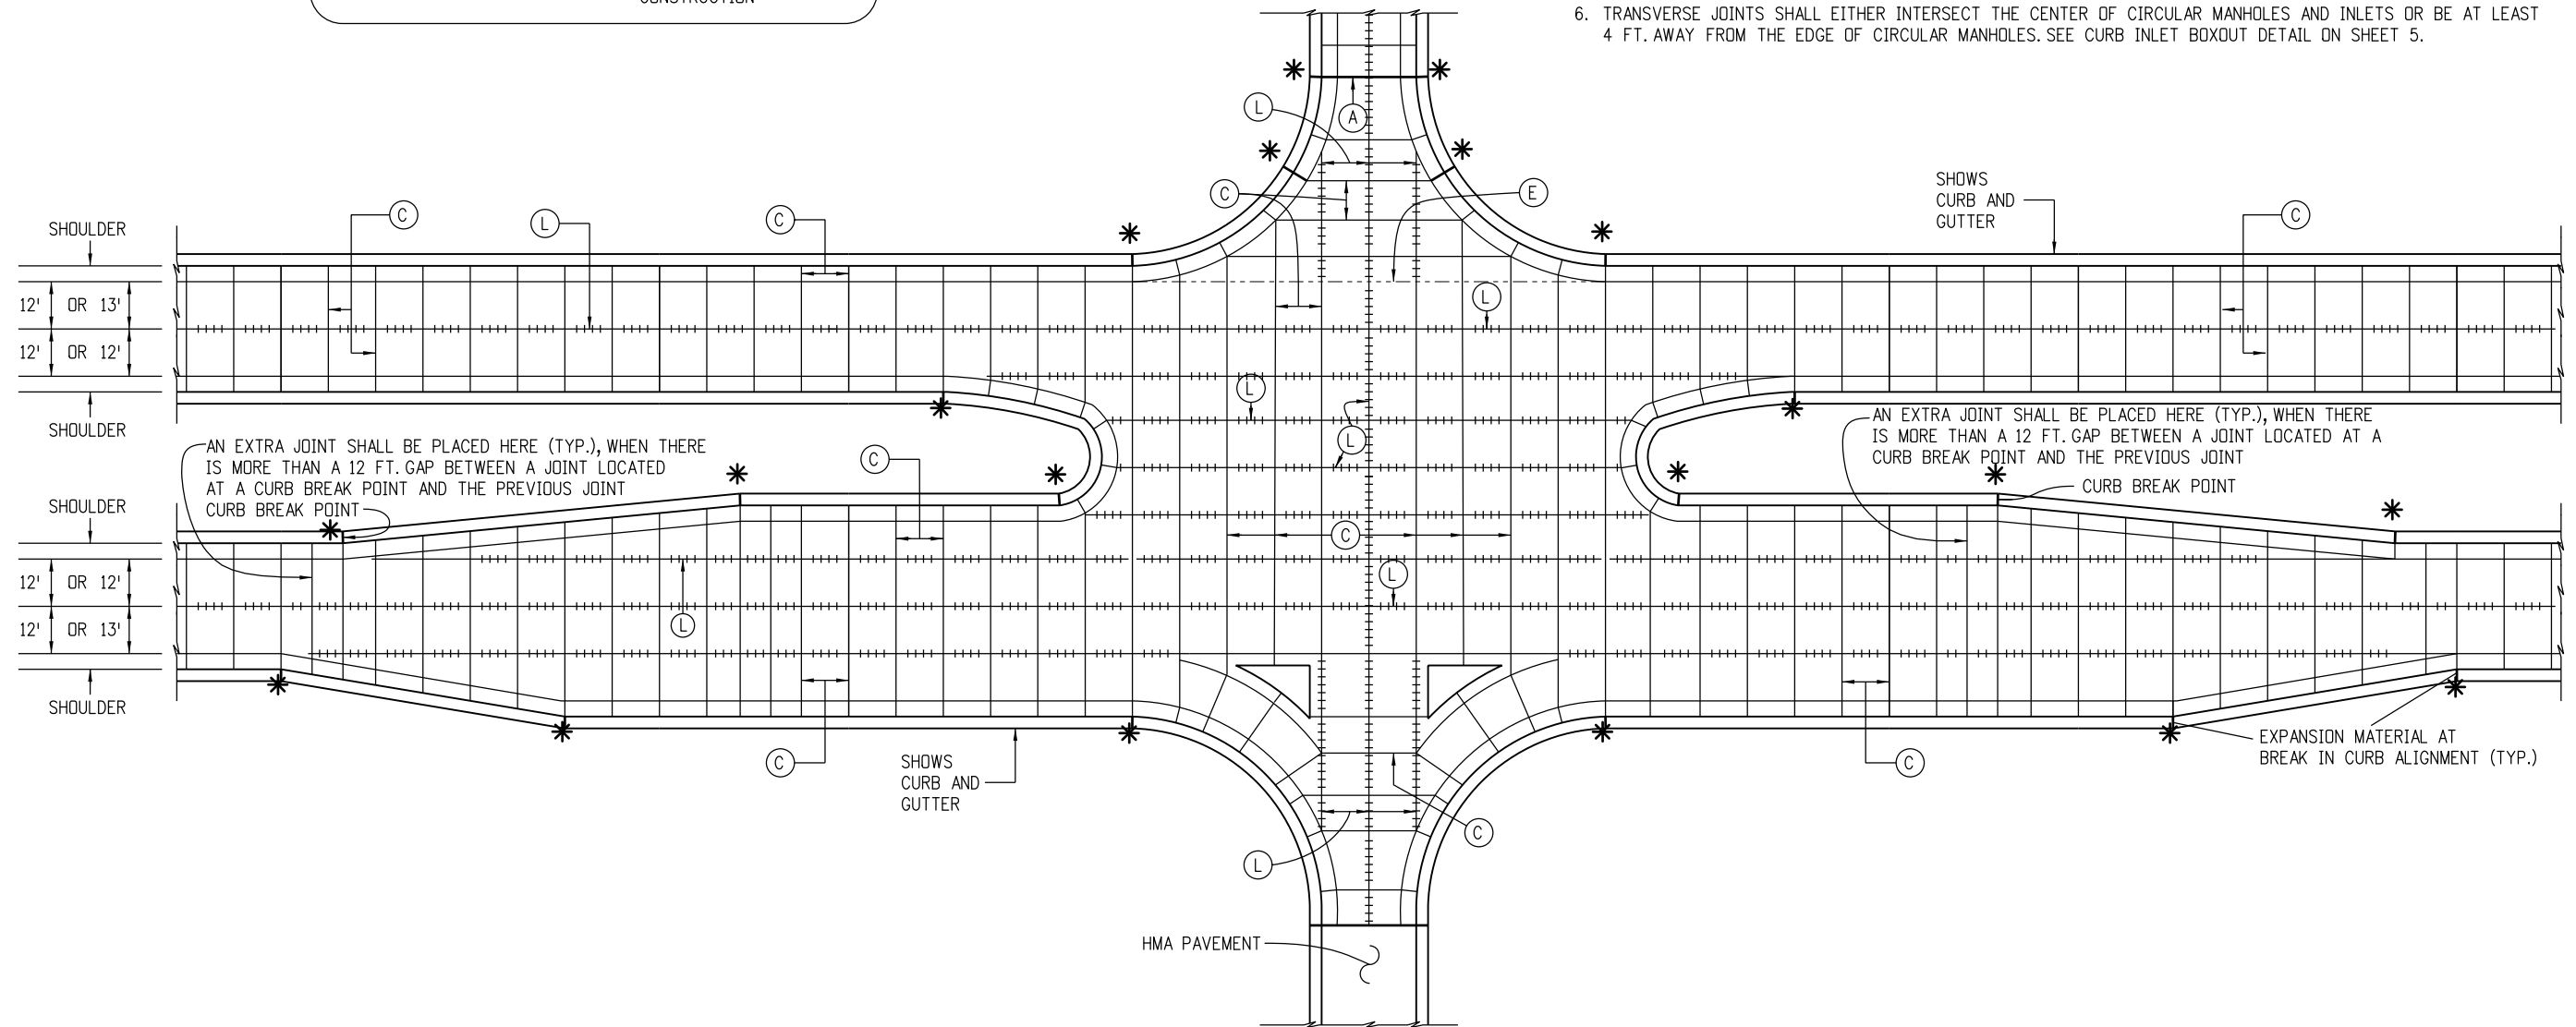

MULTI-LANE INTERSECTION WITH SPEED CHANGE LANE AND CONCRETE SHOULDERS

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

Sheet Revisions

Date:	Comments
(R-X)	
(R-X)	
(R-X)	
(R-X)	

Colorado Department of Transportation



2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch

JBK

CONCRETE PAVEMENT JOINTS


Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.


M-412-1

Standard Sheet No. 4 of 5

Project Sheet Number:

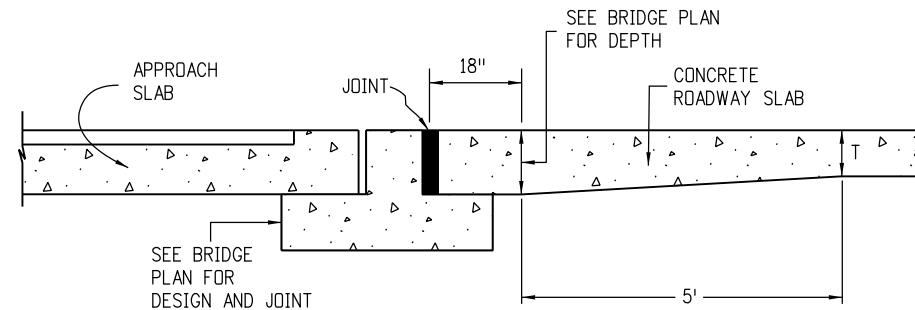

BRIDGE APPROACH

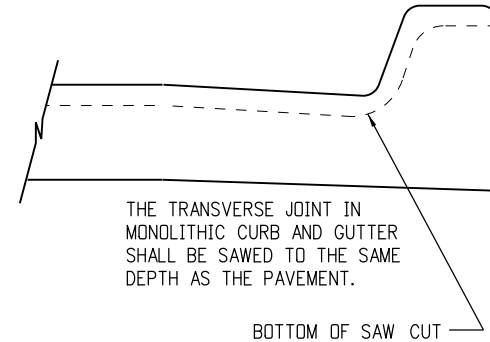

NOTE


1. PAVEMENT THICKNESS (T), SHALL BE AS SHOWN ON THE PLANS.

PAVEMENT THICKNESS (T)	DOWEL BAR DIAMETER
7 IN. $\leq$ T < 8 IN.	1 IN.
8 IN. $\leq$ T $\leq$ 10 IN.	1.25 IN.
10 IN. < T $\leq$ 15 IN.	1.50 IN.


REINFORCING SIZE TABLE

TIE BAR SIZE IS NO. 5 WHEN PAVEMENT IS PLACED ON UNBOUND BASES.

TIE BAR IS NO. 6 WHEN PAVEMENT IS PLACED ON LIME TREATED SOIL, ASPHALT OR CEMENT TREATED, MILLED ASPHALT, OR RECYCLED ASPHALT BASES.

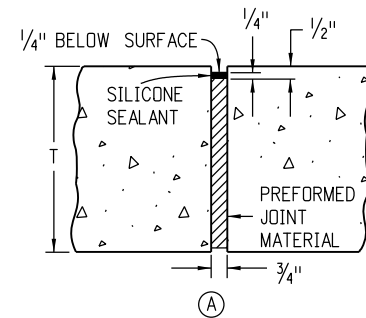


EXPANSION JOINT

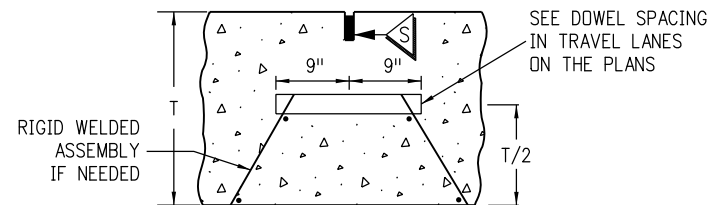


DOWELED TRANSVERSE CONSTRUCTION OR CONTRACTION JOINT

(TRANSVERSE WEAKENED PLANE JOINT)




LONGITUDINAL CONTRACTION JOINT

(LONGITUDINAL WEAKENED PLANE JOINT)

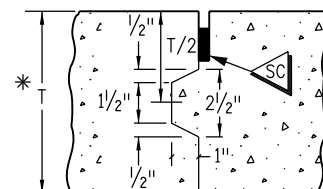


LONGITUDINAL CONSTRUCTION JOINT

* USE ONLY IF T ≥ 8 IN.
FORM ONLY FEMALE KEYWAY

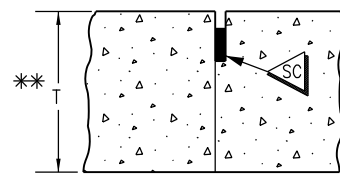


LONGITUDINAL CONSTRUCTION JOINT

** USE ONLY IF T < 8 IN.

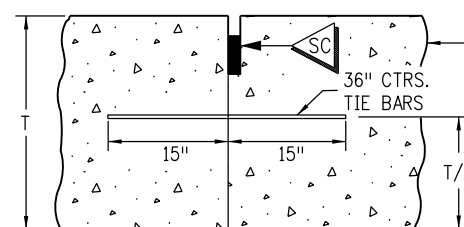


LONGITUDINAL CONSTRUCTION JOINT

A KEYWAY IS ALLOWED TO FACILITATE USE OF BENT TIE BARS OR APPROVED TWO PIECE CONNECTORS

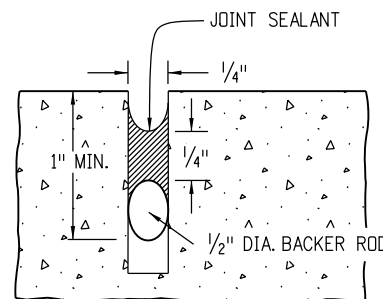


SEAL AT CONSTRUCTION JOINT


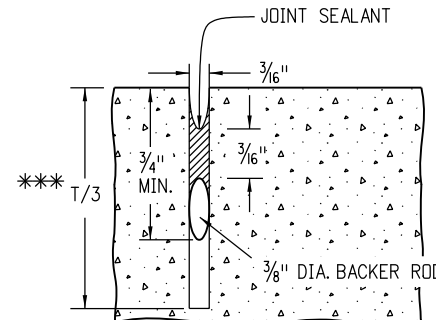


SAWED JOINT

*** USE T/4 WHEN T < 8 IN.




INLET OR MANHOLE CAST IN PAVEMENT

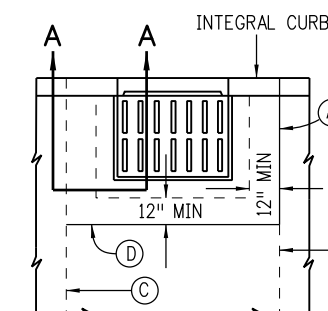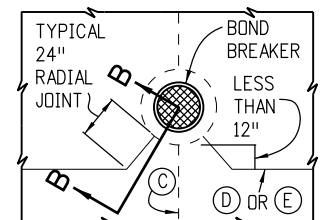


CURB INLET BOXOUT

INSTALL TRANSVERSE JOINT AT BOTH BOXOUT CORNERS IF BOXOUT IS 8 FT. OR LONGER.

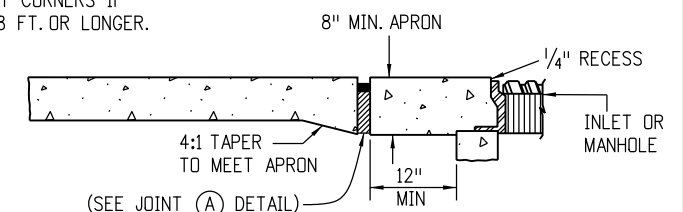

SECTION A-A

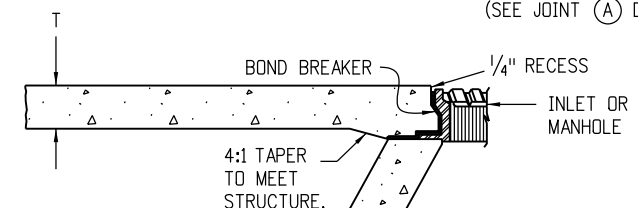

SECTION B-B

BOND BREAKER SHALL BE COMPOSED OF PLASTIC SHEET, BUILDING PAPER OR OTHER APPROVED MATERIAL THAT PREVENTS BONDING.

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

(R-X)
(R-X)
(R-X)
(R-X)

Sheet Revisions

Date:	Comments

Colorado Department of Transportation

2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch

JBK

CONCRETE PAVEMENT JOINTS

Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.


M-412-1

Standard Sheet No. 5 of 5

Project Sheet Number:

PIPE DIA.	MIN. COVER	MAX. HEIGHT OF COVER H (FT.)						
		WALL THICKNESS (IN.)						
IN.		0.109	0.138	0.168	0.188	0.218	0.249	0.280
60 66	12 12	47 43	68 62	90 81	100 93	100 100	100 100	100 100
72 76	12 12	39 36	57 52	75 69	86 79	100 95	100 100	100 100
84 90	12 12	34 31	49 45	64 60	73 68	88 82	100 97	100 100
96 102	12 18	29 28	43 40	56 52	64 60	77 73	91 86	100 94
108 114	18 18	26 25	38 36	50 47	57 54	69 65	81 77	88 84
120 126	18 18	23 22	34 32	45 42	51 49	62 59	73 69	80 76
132 138	18 18	21 20	31 29	40 39	46 44	56 54	66 63	72 69
144 150	18 24	19 19	28 27	37 36	43 41	51 49	61 58	66 64
156 162	24 24	18 17	26 25	34 33	39 38	47 46	56 54	61 59
168 174	24 24	17 16	24 23	32 31	36 35	44 42	52 50	57 55
180 186	24 24	15 15	22 22	30 29	34 33	41 40	48 47	53 51
192 198	24 30		21 20	28 27	32 31	38 37	45 44	50 48
204 210	30 30		20 19	26 25	30 29	36 35	43 41	47 45
216 222	30 30			25 24	28 27	34 33	40 39	44 43
228 234	30 30			23 23	27 26	32 31	38 37	42 41
240	30				25	31	36	40

TABLE I – 6 IN. x 2 IN. CORRUGATIONS
ROUND STEEL PIPE

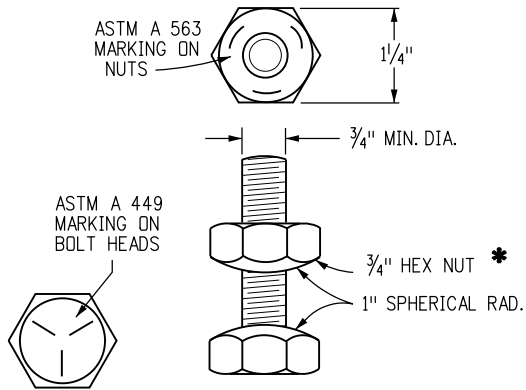

PIPE BOLT AND NUT

*INSTALL CULVERT NUTS AS SHOWN.
DO NOT INVERT.

NOTES:

- NUTS MADE IN CONFORMANCE WITH ASTM A 194, GRADE 2 OR GRADE 2H, AND MARKED WITH THE GRADE SYMBOL ARE ACCEPTABLE EQUIVALENTS FOR ASTM A 563, GRADE C NUTS.
- BOLTS SHALL BE PLACED LOOSE TO ALIGN PLATES, THEN TIGHTENED TO MAINTAIN STRUCTURE SHAPE.

PIPE SIZE SPAN x RISE	MIN. COVER	MIN. WALL THICKNESS	CORNER RADII	MAX. H
FT. – IN.		IN.		FT.
6- 1 x 4- 7 6- 4 x 4- 9	12 12	0.109 0.109	18 18	15 15
6- 9 x 4-11 7- 0 x 5- 1	12 12	0.109 0.109	18 18	14 14
7- 3 x 5- 3 7- 8 x 5- 5	12 12	0.109 0.109	18 18	13 13
7-11 x 5- 7 8- 2 x 5- 9	12 18	0.109 0.109	18 18	12 12
8- 7 x 5-11 8-10 x 6- 1	18 18	0.109 0.109	18 18	11 11
9- 4 x 6- 3 9- 6 x 6- 5	18 18	0.109 0.109	18 18	10 10
9- 9 x 6- 7 10- 3 x 6- 9	18 18	0.109 0.109	18 18	10 9
10- 8 x 6-11 10-11 x 7- 1	18 18	0.109 0.109	18 18	9 9
11- 5 x 7- 3 11- 7 x 7- 5	18 18	0.109 0.109	18 18	8 7
11-10 x 7- 7 12- 4 x 7- 9	18 30	0.109 0.109	18 18	7 6
12- 6 x 7-11 12- 8 x 8- 1	30 30	0.109 0.109	18 18	6 6
12-10 x 8- 4 13- 3 x 9- 4	30 30	0.109 0.109	18 31	6 13
13- 6 x 9- 6 14- 0 x 9- 8	30 30	0.109 0.109	31 31	12 12
14- 2 x 9-10 14- 5 x 10- 0	30 30	0.109 0.109	31 31	12 11
14-11 x 10- 2 15- 4 x 10- 4	30 30	0.109 0.109	31 31	11 11
15- 7 x 10- 6 15-10 x 10- 8	30 30	0.109 0.109	31 31	11 10
16- 3 x 10-10 16- 6 x 11- 0	30 30	0.138 0.138	31 31	10 10
17- 0 x 11- 2 17- 2 x 11- 4	30 30	0.138 0.138	31 31	10 10
17- 5 x 11- 6 17-11 x 11- 8	30 30	0.138 0.138	31 31	9 9
18- 1 x 11-10 18- 7 x 12- 0	30 30	0.168 0.168	31 31	9 9
18- 9 x 12- 2 19- 3 x 12- 4	30 30	0.168 0.168	31 31	9 8
19- 6 x 12- 6 19- 8 x 12- 8 19-11 x 12-10	30 30 30	0.168 0.168 0.168	31 31	8 7 7
20- 5 x 13- 0 20- 7 x 13- 2	36 36	0.188 0.188	31 31	7 6

TABLE II – 6 IN. x 2 IN. CORRUGATIONS
STEEL PIPE-ARCH

- PIPE-ARCH IS INTENDED FOR USE WHERE MINIMUM COVER REQUIREMENTS FOR ROUND PIPE CANNOT BE MET.
USE ROUND PIPE WHEN **H** EXCEEDS 15 FT.

PIPE SIZE SPAN x RISE	MIN. COVER	MIN. WALL THICKNESS	CORNER RADII	MAX. H
FT. – IN.		IN.		FT.
6- 2 x 5- 0 6- 7 x 4-11	21 21	0.100 0.100	27 27	15 15
6- 7 x 5- 8 6-11 x 5- 9	21 21	0.100 0.100	32 32	15 15
7- 3 x 5-11 7- 9 x 6- 0	21 24	0.100 0.100	32 32	15 15
8- 1 x 6- 1 8- 5 x 6- 3	24 24	0.100 0.100	32 32	15 15
8-10 x 6- 4 9- 3 x 6- 5	27 27	0.100 0.100	32 32	15 15
9- 7 x 6- 6 9-11 x 6- 8	27 27	0.100 0.100	32 32	15 15
10- 3 x 6- 9 10- 9 x 6-10	27 30	0.100 0.100	32 32	15 14
11- 1 x 7- 0 11- 5 x 7- 1	30 30	0.100 0.100	32 32	14 14
11- 9 x 7- 2 12- 3 x 7- 3	33 33	0.100 0.100	32 32	13 13
12- 7 x 7- 5 12-11 x 7- 6	33 33	0.100 0.100	32 32	12 12
13- 1 x 8- 2 13- 1 x 8- 4	33 33	0.100 0.100	32 32	12 12
13-11 x 8- 5 14- 0 x 8- 7	30 33	0.125 0.125	32 32	13 13
13-11 x 9- 5 14- 3 x 9- 7	30 33	0.125 0.125	32 32	13 12
14- 8 x 9- 8 14-11 x 9-10	33 33	0.125 0.125	32 32	12 12
15- 4 x 10- 0 15- 7 x 10- 2	33 30	0.125 0.150	32 32	12 11
16- 1 x 10- 4 16- 4 x 10- 6	33 33	0.150 0.150	32 32	11 11
16- 9 x 10- 8 17- 0 x 10-10	33 33	0.150 0.150	32 32	11 10
17- 3 x 11- 0 17- 9 x 11- 2	33 30	0.150 0.175	32 32	10 10
18- 0 x 11- 4 18- 5 x 11- 6	33 33	0.175 0.175	32 32	10 10
18- 8 x 11- 8 19- 2 x 11- 9	33 30	0.175 0.200	32 32	9 9
19- 5 x 11-11 19-10 x 12- 1	30 33	0.200 0.200	32 32	9 9
20- 1 x 12- 3 20- 1 x 12- 6	33 33	0.200 0.200	32 32	9 9
20-10 x 12- 7 21- 1 x 12- 9 21- 6 x 12-11	30 33 33	0.225 0.225 0.225	32 32 32	8 8 8

TABLE III – 9 IN. x 2 1/2 IN. CORRUGATIONS
ALUMINUM PIPE-ARCH

H - HEIGHT OF COVER LIMIT. MAXIMUM HEIGHT OF FILL OVER THE TOP OF THE PIPE TO THE BOTTOM OF THE PAVEMENT: HMA OR PCCP.
FILL HEIGHTS GREATER THAN MAXIMUM ALLOWED IN THE FILL HEIGHT TABLE REQUIRE SPECIAL DESIGN.

PIPE DIA.	MIN. COVER	MAX. HEIGHT OF COVER H (FT.)						
		WALL THICKNESS (IN.)						
IN.		0.100	0.125	0.150	0.175	0.200	0.225	0.250
60 66	15 18	31 28	45 41	60 54	70 64	81 74	92 84	100 94
72 78	21 21	25 23	37 35	50 46	58 54	67 62	77 71	86 79
84 90	21 24	22 20	32 30	42 40	50 47	58 54	66 61	73 68
96 102	24 24	19 18	28 26	37 35	44 41	50 47	57 54	64 60
108 114	27 27	17 16	25 23	33 31	39 37	45 42	51 48	57 54
120 126	27 30	15 14	22 21	30 28	35 33	40 38	46 44	51 49
132 138	30 30	14 13	20 19	27 26	32 30	37 35	42 40	46 44
144 150	33 30	12	18 18	25 24	29 28	33 32	38 36	42 40
156 162	30 30		17	23 22	27 26	31 30	35 34	38 37
168 174	30 30			21 20	25 24	29 28	32 31	35 34
180 186	27 27				23 22	27 26	30 29	33 31
192 198	27 27					25 24	28 27	30 29
204 210	27 27					23	26 25	28 27
216 222	27 27							26 25
228	27							25

TABLE IV – 9 IN. x 2 1/2 IN. CORRUGATIONS
ROUND ALUMINUM PIPE

GENERAL NOTES


- PIPE OR PIPE-ARCH WITH ENDS CUT TO FIT A SLOPE AND REPAIRED IN ACCORDANCE WITH SUBSECTION 707.09, SHALL BE REINFORCED AS SHOWN ON THE PLANS.
- WHERE MULTIPLE PIPES ARE USED, THEY SHALL BE SPACED SO THAT ADJACENT SIDES OF THE PIPE SHALL BE AT LEAST ONE-HALF DIAMETER OR ONE-HALF SPAN APART TO PERMIT CAREFUL TAMPING OF THE BACKFILL MATERIAL, EXCEPT THAT THE CLEAR DISTANCE BETWEEN ADJACENT SIDES SHALL NOT BE MORE THAN 3 FT.
- MINIMUM COVER FOR STRUCTURAL PLATE PIPE OR PIPE ARCH IS MEASURED FROM THE TOP OF THE PIPE TO THE BOTTOM OF THE PAVEMENT: HMA OR PCCP. DURING CONSTRUCTION, ADEQUATE COVER SHALL BE PROVIDED TO PROTECT THE STRUCTURE FROM DAMAGE. THE COVER DURING CONSTRUCTION SHALL BE AT LEAST 1 FT.

- PIPE ARCH WITH EQUAL PERIPHERY AND WITH SPAN AND RISE DIMENSIONS APPROXIMATELY EQUAL TO THOSE SPECIFIED ON THE PLANS WILL BE PERMITTED.

PIPE OR PIPE-ARCH CONFORMING TO SECTION 603 SHALL NOT BE SUBSTITUTED FOR STRUCTURAL PLATE PIPE OR PIPE-ARCH.

PIPE-ARCH DESIGN IS BASED ON CORNER BEARING PRESSURE ON THE SOIL OF 2 TONS PER SQUARE FT.

Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	STRUCTURAL PLATE PIPE H-20 LOADING	STANDARD PLAN NO.	
Creation Date: 07/31/19		Date:	Comments			M-510-1	
Designer Initials: JBK						Standard Sheet No. 1 of 1	
Last Modification Date: 07/31/19						Project Sheet Number:	
Detailer Initials: LTA							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English					Issued by the Project Development Branch: July 31, 2019		

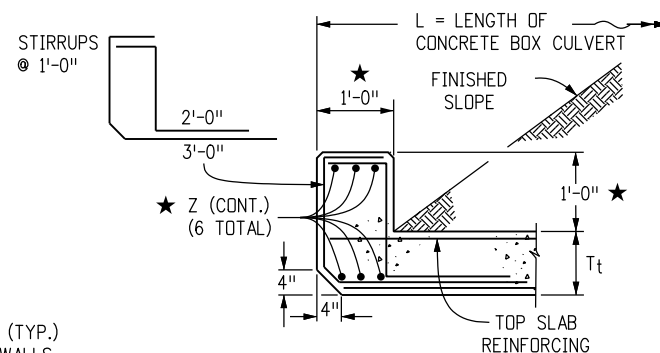

#4 BY 2'-0" @ 1'-6" WHEN AN APRON IS REQUIRED ON THE OUTLET END (PROJECTED OUT 1'-0")

MIN. S SPECIFIED THE PLANS

#4 (CONT.) (PLACE AS SHOWN) (2 TOTAL)

#4 @ 1'-0"

3" CLEAR

Z (CONT.) (3 TOTAL)

BOTTOM SLAB REINFORCING

t_b

MIN. LAP SPLICE LENGTH (TYP.)

3" 6" 6"

TOP SLAB REINFORCING (TYP.)

J BARS (SEE NOTE BELOW)

CONSTRUCTION JOINT (TYP.)


J BARS (SEE NOTE BELOW)

3" 6" 6"

BOTTOM SLAB REINFORCING (TYP.)

STAGE 2 ← ————— → STAGE 1

NOT TO SCALE

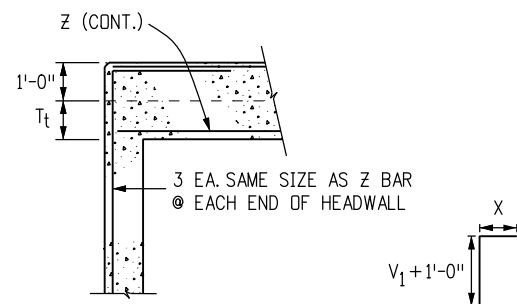

BAR SIZE (#)	EPOXY X (FT.-IN.)	BLACK X (FT.-IN.)
4	2-4	1-11
5	2-10	2-4
6	3-5	2-10
7	4-1	3-3
8	5-3	4-3
9	6-8	5-5

NOTE: THIS DETAIL IS FOR CONSTRUCTION JOINTS INSTALLED PERPENDICULAR TO THE ϕ OF THE BOX ONLY. THE CONTRACTOR CAN DESIGN AND INSTALL J BARS AT HIS EXPENSE TO SUPPORT TEMPORARY LIVE LOADS DURING STAGE 1 CONSTRUCTION. J BARS SHALL BE THE SAME SIZE AS THE TOP AND BOTTOM SLAB REINFORCING WHEN THERE ARE NO TEMPORARY LIVE LOADS TO SUPPORT.

- | | | | | | | | | |
|----------------|-------|-------|-------|--------|-------|-------|--------|-------|
| BAR SIZE: | #4 | #5 | #6 | #7 | #8 | #9 | #10 | #11 |
| SPLICE LENGTH: | 1'-3" | 1'-7" | 2'-5" | 2'-10" | 3'-8" | 4'-8" | 5'-11" | 7'-3" |

BAR SIZE:	#4	#5	#6	#7	#8	#9	#10	#11
SPLICE LENGTH:	1'-1"	1'-4"	1'-7"	1'-11"	2'-6"	3'-1"	3'-11"	4'-10"




S	6	8	10	12, 14, 16, 18, 20
BAR SIZE:	#5	#6	#6	#5
SPACING	1'-0"	1'-0"	0'-6"	0'-6"

18. SEE M-603-3 FOR PRECAST CONCRETE BOX CULVERT DETAILS.

Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	SINGLE CONCRETE BOX CULVERT (CAST-IN-PLACE)		STANDARD PLAN NO.	
Creation Date: 07/31/19			Date:	Comments				M-601-1	
Designer Initials: JBE								Standard Sheet No. 1 of 2	
Last Modification Date: 07/31/19									
Detailer Initials: LTA								Issued by the Project Development Branch: July 31, 2019	
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English								Project Sheet Number:	



SINGLE CONCRETE BOX CULVERT DIMENSIONS, QUANTITIES & RATING FACTORS (EXCLUDING HEADWALL & TOEWALL QUANTITIES)

BOX SIZE				FILL HEIGHT ALLOWED	SLAB & WALL THICKNESS (IN)HES			BAR SIZES						d1▲	DIMENSIONS					QUANTITIES			RATING FACTORS				
S	R	HT.	WIDTH		Tt	Tb	TW	t1* & b1	t2	b2	w1* & w2	c1*#	c2#		h1	h2	v1	v2	v3	CONCRETE	REBAR STL	WATERPROOFING	HL-93 INVENTORY	HL-93 OPERATING	COLORADO PERMIT	NRL VEHICLE	
FT	FT	FT-IN	FT-IN	FT-FT				#	#	#	#	#	NO.	FT-IN	FT-IN	FT-IN	FT-IN	FT-IN	CY/LF	LBS/LF	SY/LF						
6	7	8-8	7-8	< 2	10	10	10	4	6	6	4	5	5	64	3-5	4-4	7-7	3-1	1-11	0.905	215	1.185	1.23	1.59	2.03	2.09	
		8-4.5	7-8	2 TO 8	8.5	8	10	10	4	5	5	4	5	5	64	3-10	4-4	7-6	2-11	1-9	0.823	199	1.67	2.17	2.51	2.58	
		8-5	7-8	8 TO 15	8.5	8.5	10	10	4	5	5	4	5	5	64	3-8	2-4	7-6	3-0	1-9	0.834	190	◆	◆	◆	◆	
		8-5	7-8	15 TO 20	8.5	8.5	10	10	4	5	5	4	5	5	64	3-8	2-4	7-6	3-0	1-9	0.834	190	◆	◆	◆	◆	
8	6	7-9	9-8	< 2	11	10	10	4	7	7	4	5	5	68	4-9	2-4	6-8	3-1	1-11	0.997	251	1.407	1.10	1.43	1.65	1.63	
		7-6	9-8	2 TO 8	8.5	9.5	10	10	4	6	6	4	5	5	66	4-8	2-4	6-6	3-1	1-10	0.907	220	1.59	2.07	2.39	2.46	
		7-6	9-8	8 TO 15	8.5	9.5	10	10	4	6	6	4	5	5	66	3-7	2-4	6-6	3-1	1-10	0.907	216	◆	◆	◆	◆	
		7-6	9-8	15 TO 20	8.5	9.5	10	10	4	6	6	4	5	5	66	3-7	2-4	6-6	3-1	1-10	0.907	216	◆	◆	◆	◆	
	8	9-9.5	9-8	< 2	11.5	10	10	10	4	7	7	4	5	5	76	5-8	5-4	8-9	3-1	1-11	1.135	287	1.407	1.07	1.38	1.60	1.58
		9-7	9-8	2 TO 8	9	10	10	10	4	6	6	4	5	5	74	4-8	2-4	8-7	3-1	1-11	1.061	240	1.61	2.09	2.54	2.57	
		9-7	9-8	8 TO 15	9	10	10	10	4	6	6	4	5	5	74	3-7	2-4	8-7	3-1	1-11	1.061	235	◆	◆	◆	◆	
		9-7	9-8	15 TO 20	9	10	10	10	4	6	6	4	5	5	74	3-7	2-4	8-7	3-1	1-11	1.061	235	◆	◆	◆	◆	
	10	11-10	9-8	< 2	11.5	10.5	10	10	4	7	7	4	5	5	84	3-5	2-4	10-9	3-2	2-0	1.274	285	1.407	1.12	1.46	1.69	1.66
		11-7	9-8	2 TO 8	9	10	10	10	4	6	6	4	5	5	82	5-6	2-4	10-7	3-1	1-11	1.184	262	1.61	2.09	2.52	2.56	
		11-7	9-8	8 TO 15	9	10	10	10	4	6	6	4	5	5	82	4-6	2-4	10-7	3-1	1-11	1.184	258	◆	◆	◆	◆	
		11-9	9-11	15 TO 20	10	11	11.5	10	4	6	6	4	6	6	85	4-7	2-5	10-8	3-1	1-11	1.353	302	◆	◆	◆	◆	
10	6	7-11.5	11-8	< 2	12.5	11	10	10	4	8	8	4	5	5	87	5-8	2-7	6-10	3-2	2-0	1.217	321	1.630	1.05	1.36	1.49	1.48
		7-7	11-8	2 TO 10	10	10	10	10	4	6	6	4	5	5	72	5-5	2-7	6-7	3-1	1-11	1.055	246	1.25	1.62	1.88	1.84	
		7-8	11-8	10 TO 15	10	10	10	10	4	6	6	4	5	5	72	4-2	2-7	6-8	3-1	1-11	1.091	242	◆	◆	◆	◆	
		8-1	11-10	15 TO 20	13	12	11	10	4	6	6	4	5	5	75	4-7	2-9	6-11	3-3	2-1	1.320	251	◆	◆	◆	◆	
	8	9-11.5	11-8	< 2	12.5	11	10	10	4	9	9	4	5	5	95	5-8	2-7	8-10	3-2	2-0	1.340	383	1.630	1.02	1.32	1.44	1.43
		9-7.5	11-8	2 TO 10	9.5	10	10	10	4	6	6	4	5	5	80	5-5	2-7	8-7	3-1	1-11	1.196	265	1.21	1.57	1.82	1.78	
		9-8	11-8	10 TO 15	10	10	10	10	4	6	6	4	5	5	80	4-3	2-7	8-8	3-1	1-11	1.214	261	◆	◆	◆	◆	
		10-0	12-0	15 TO 20	12	12	12	10	4	6	6	4	5	5	83	4-7	2-10	8-10	3-3	2-1	1.481	271	◆	◆	◆	◆	
	10	12-0	11-8	< 2	12.5	11.5	10	10	4	9	9	4	5	5	103	6-7	6-5	10-10	3-3	2-1	1.481	423	1.630	1.07	1.39	1.51	1.50
		11-7.5	11-8	2 TO 10	9.5	10	10	10	4	6	6	4	5	5	88	5-5	2-7	10-7	3-1	1-11	1.319	285	1.16	1.51	1.74	1.71	
		11-9	11-10	10 TO 15	10	11	11	10	4	6	6	4	5	5	91	4-4	2-8	10-8	3-2	2-1	1.446	285	◆	◆	◆	◆	
		12-0.5	12-0	15 TO 20	12	12.5	12	10	4	6	6	5	5	5	91	4-7	2-10	10-10	3-4	2-6	1.648	315	◆	◆	◆	◆	
12	6	8-1.5	13-8	< 2	13.5	12	10	10	4	9	9	4	6	6	97	5-5	3-0	6-11	3-7	2-1	1.446	433	1.852	1.03	1.33	1.42	1.39
		7-7.5	13-8	2 TO 8	9.5	10	10	10	4	7	7	4	6	6	78	6-4	3-0	6-7	3-5	1-11	1.193	339	1.27	1.65	1.89	1.84	
		7-9	13-8	8 TO 12	9.5	11.5	10	10	4	7	7	4	6	6	78	5-1	3-0	6-7	3-7	2-0	1.256	333	2.28	2.95	3.25	3.54	
		8-0.5	13-10	12 TO 16	12	12.5	11	10	4	7	7	4	6	6	81	5-0	3-1	6-10	3-7	2-0	1.453	339	◆	◆	◆	◆	
	8	8-0.5	14-0	16 TO 20	12	12.5	12	10	5	7	7	5	6	6	81	5-2	3-2	6-10	3-8	2-6	1.503	361	1.852	1.00	1.29	1.37	1.35
		10-1.5	13-8	< 2	13.5	12	10	10	4	9	9	4	6	6	105	6-6	3-0	8-11	3-7	2-1	1.569	462	1.21	1.57	1.77	1.73	
		9-8	13-8	2 TO 8	9.5	10.5	10	10	4	7	7	4	6	6	86	5-1	3-0	8-7	3-6	1-11	1.337	355	2.32	3.01	3.31	3.60	
		9-9.5	13-8	8 TO 12	10	11.5	10	10	4	7	7	4	6	6	86	5-5	3-0	8-8	3-7	2-0	1.401	358	◆	◆	◆	◆	
	10	9-9.5	13-10	12 TO 16	10	11.5	11	10	4	7	7	4	6	6	89	5-0	3-1	8-8	3-7	2-0	1.461	360	◆	◆	◆	◆	
		10-0.5	14-0	16 TO 20	12	12.5	12	10	5	7	7	4	6	6	89	5-1	3-1	8-10	3-7	2-1	1.651	385	◆	◆	◆	◆	
		12-2	13-8	< 2	13.5	12.5	10	10	4	9	9	4	6	6	113	7-10	6-3	10-11	3-8	2-2	1.714	513	1.852	1.04	1.35	1.43	1.41
		11-8	13-8	2 TO 8	9.5	10.5	10	10	4	7	7	4	6	6	94	6-4	3-0	10-7	3-6	1-11	1.461	385	2.08	2.70	2.97	2.16	
14	6	11-9.5	13-8	8 TO 12	10	11.5	10	10	4	7	7	4	6	6	94	5-1	3-0	10-8	3-7	2-0	1.524	379	◆	◆	◆	◆	
		11-9.5	13-10	12 TO 16	10	11.5	11	10	5	7	7	4	7	7	97	5-1	3-2	10-8	4-0	2-0	1.597	456	◆	◆	◆	◆	
		12-1	14-0	16 TO 20	12.5	12.5	12	10	5	7	7	4	7	7	97	5-2	3-3	10-10	4-0	2-1	1.821	462	◆	◆	◆	◆	
		8-3.5	15-8	< 2	14	13.5	10	10	4	9	9	4	6	6	107	5-10	3-5	6-11	3-9	2-0	1.700	479	2.074	1.10	1.43	1.48	1.41
	8	7-8	15-8	2 TO 6	9.5	10.5	10	10	4	8	8	4	7	7	84	7-3	3-5	6-7	3-11	1-11	1.337	460	◆	1.13	1.47	1.65	1.59
		7-8.5	15-8	6 TO 8	9.5	11	10	10	4	8	8	4	7	7	84	5-9	3-5	6-7	3-11	2-0	1.362	448	1.67	2.16	2.50	3.01	
		7-10.5	15-8	8 TO 10	10.5	12	10	10	4	8	8	4	7	7	84	5-9	3-5	6-8	4-0	2-1	1.458	450	2.66	3.45	3.89	4.43	
		7-11.5	15-8	10 TO 12	11	12.5	10	10	4	8	8	4	7	7	84	5-9	3-5	6-9	4-1	2-1	1.507	452	2.65	3.44	3.79	4.11	
	10	8-1.5	15-8	12 TO 14	12	13.5	10	10	4	8	8	4	7	7	84	5-9	3-5	6-10	4-2	2-2	1.603	453	3.13	4.05	4.38	4.89	
		8-1.5	15-10	14 TO 18	12	13.5	11	10	5	8	8	5	7	7</													

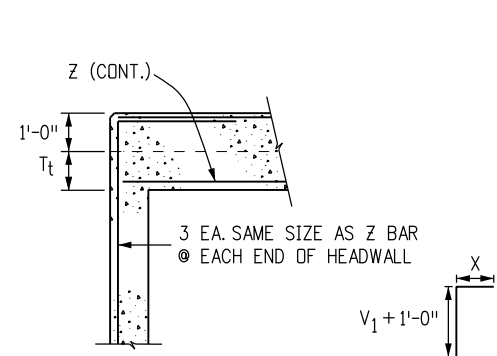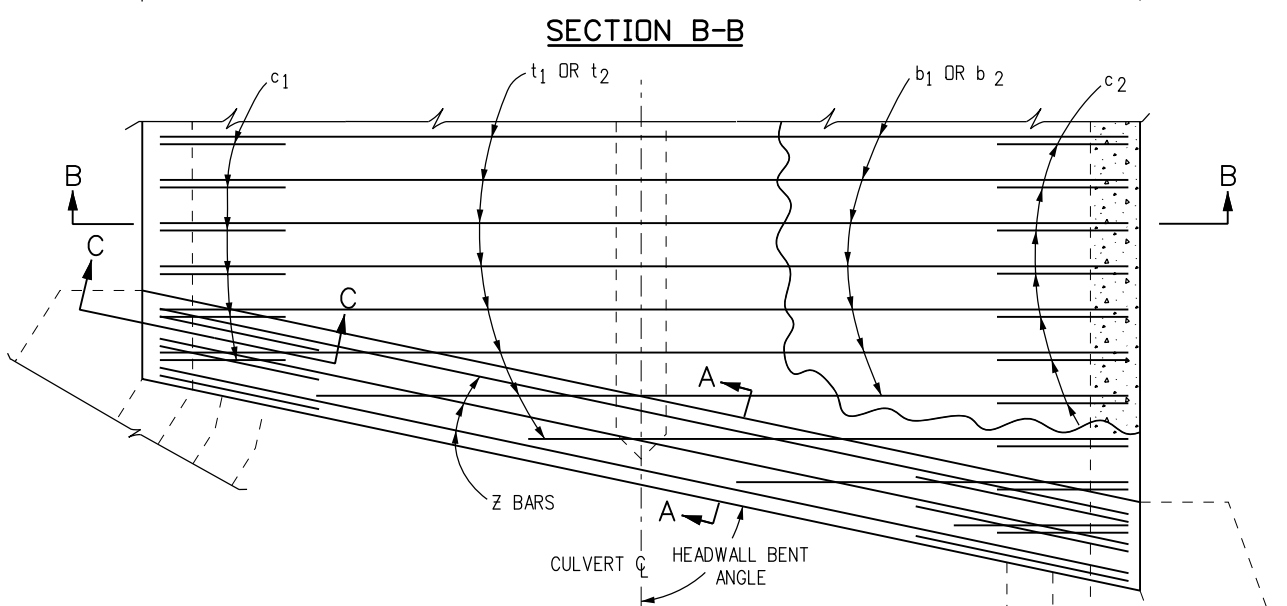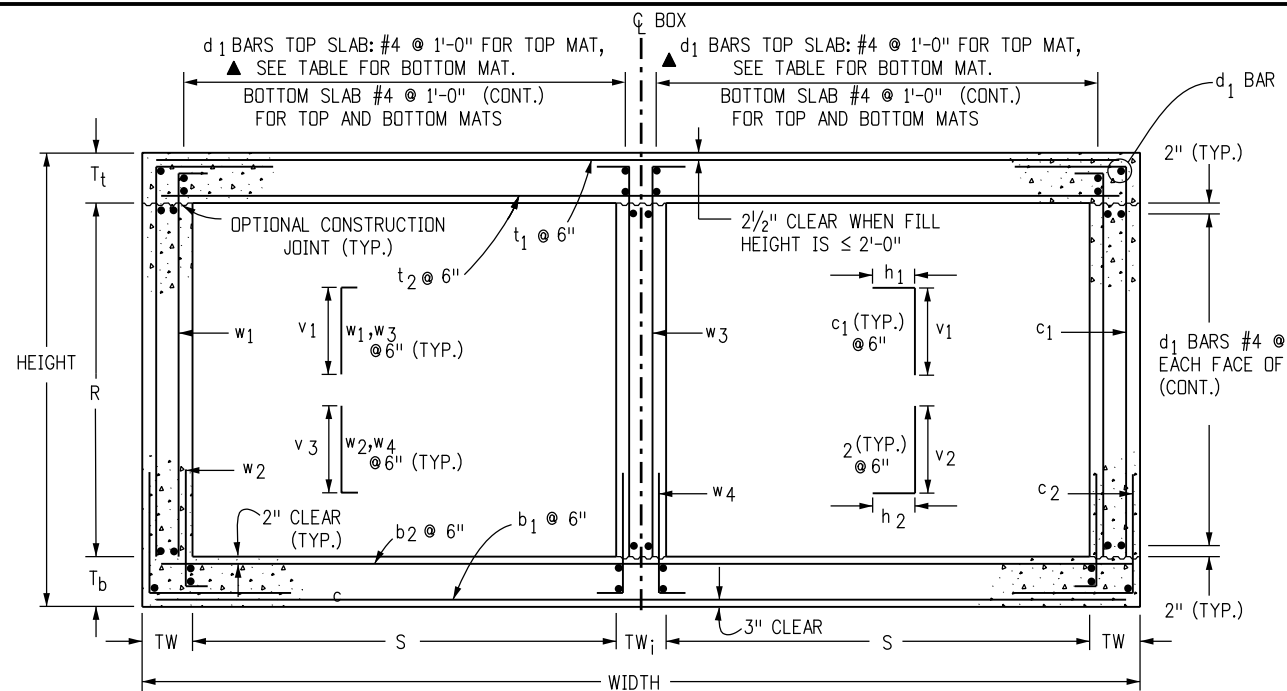

HEADWALL CORNER REINFORCING DETAIL

BAR SIZE (#)	EPOXY X (FT.-IN.)	BLACK X (FT.-IN.)
4	2-4	1-11
5	2-10	2-4
6	3-5	2-10
7	4-1	3-3
8	5-3	4-3
9	6-8	5-5

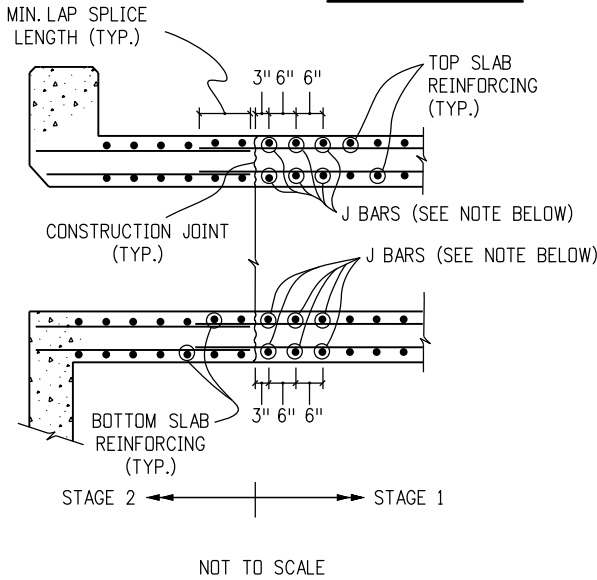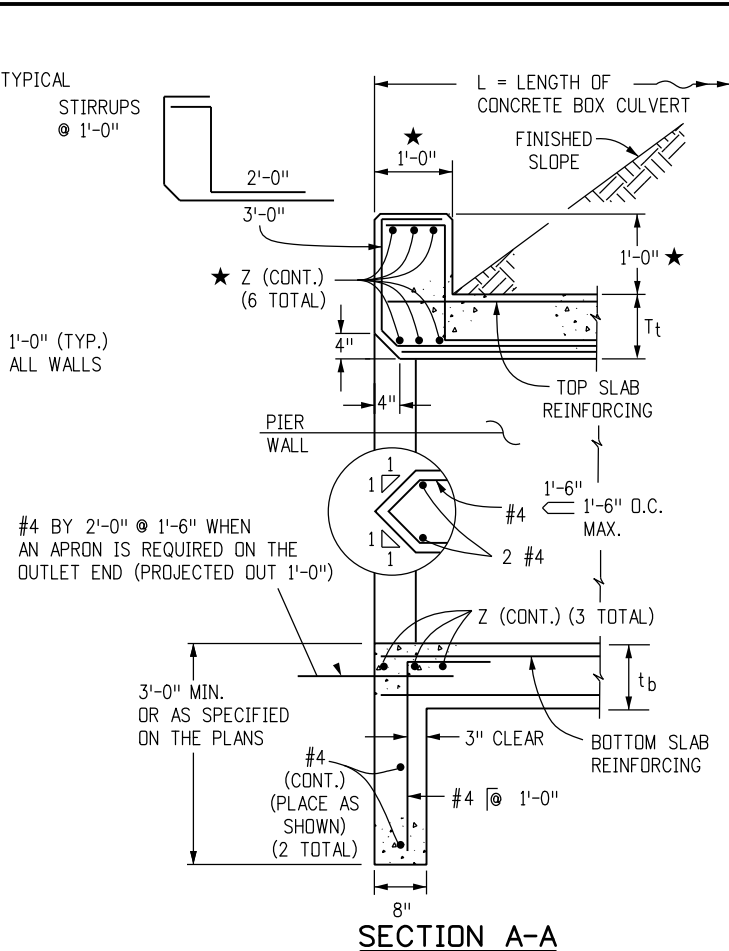

NOTE: THIS DETAIL IS FOR CONSTRUCTION JOINTS INSTALLED PERPENDICULAR TO THE C OF THE BOX ONLY. THE CONTRACTOR CAN DESIGN AND INSTALL J BARS AT HIS EXPENSE TO SUPPORT TEMPORARY LIVE LOADS DURING STAGE 1 CONSTRUCTION. J BARS SHALL BE THE SAME SIZE AS THE TOP AND BOTTOM SLAB REINFORCING WHEN THERE ARE NO TEMPORARY LIVE LOADS TO SUPPORT.

GENERAL NOTES

- ALL CONCRETE SHALL BE CLASS D (BOX CULVERT).
- ALL CONSTRUCTION JOINTS SHALL BE THOROUGHLY CLEANED BEFORE FRESH CONCRETE IS PLACED.
- ALL CONSTRUCTION JOINTS NOT SHOWN ON THE PLANS SHALL BE CONSTRUCTED ONLY IF APPROVED BY THE ENGINEER.
- THE CONTRACTOR SHALL MAINTAIN THE STABILITY OF THE STRUCTURE DURING CONSTRUCTION.
- STRUCTURE EXCAVATION AND BACKFILL SHALL BE IN ACCORDANCE WITH STANDARD PLAN M-206-1.
- FOR ANY CULVERT SPAN 20 FT. OR GREATER, A FOUNDATION INVESTIGATION AND REPORT ARE REQUIRED.
- BACKFILL SHALL NOT BEGIN UNTIL TOP SLAB HAS REACHED DESIGN STRENGTH, f'_c .
- SPLICE QUANTITIES FOR LONGITUDINAL AND TRANSVERSE BARS ARE NOT INCLUDED.
- REINFORCING STEEL SHALL BE GRADE 60.
- THE MINIMUM LAP SPLICE LENGTH FOR EPOXY COATED REINFORCING BARS SHALL BE:

BAR SIZE:	#4	#5	#6	#7	#8	#9	#10	#11
SPLICE LENGTH:	1'-3"	1'-7"	2'-5"	2'-10"	3'-8"	4'-8"	5'-11"	7'-3"

THE MINIMUM LAP SPLICE LENGTH FOR BLACK REINFORCING BARS SHALL BE:

BAR SIZE:	#4	#5	#6	#7	#8	#9	#10	#11
SPLICE LENGTH:	1'-1"	1'-4"	1'-7"	1'-11"	2'-6"	3'-1"	3'-11"	4'-10"

THE ABOVE SPLICE LENGTHS ARE FOR CLASS B SPLICES.

- ALL DIMENSIONS ARE PERPENDICULAR TO THE CENTERLINE OF THE BOX.
- WINGWALLS SHALL BE TIED TO CONCRETE BOX CULVERT IN ACCORDANCE WITH STANDARD PLAN M-601-20.
- ALL TRANSVERSE REINFORCING SHALL BE NORMAL TO THE CENTERLINE OF THE BOX.
- THE FILL HEIGHT IS THE DISTANCE MEASURED FROM THE TOP OF THE TOP SLAB TO THE TOP OF PAVEMENT.
- ALL EXPOSED CONCRETE CORNERS SHALL BE CHAMFERED $\frac{3}{4}$ ".
- FOR FILL HEIGHTS LESS THAN 2 FT, A WATERPROOFING MEMBRANE SHALL BE PROVIDED FOR THE TOP OF THE TOP SLAB AND 18" DOWN ALONG THE TOPS OF THE EXTERIOR WALLS.
- FOR FILL HEIGHTS LESS THAN 2 FT, THE d_1 BARS FOR THE BOTTOM MAT OF THE TOP SLAB SHALL BE AS FOLLOWS:

S	6, 8	10, 12, 16	14, 18	20
BAR SIZE:	#4	#5	#6	#7
SPACING	0'-6"	1'-0"	1'-2"	1'-2"

DESIGN DATA: 7TH EDITION, 2014, OF THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS

RATING DATA: 2ND EDITION, 2011, OF THE AASHTO MANUAL FOR BRIDGE EVALUATION

$f_y = 60,000$ psi.,

LOADING DATA: $f'_c = 4,500$ psi.,

LIVE LOAD = AASHTO LRFD, HL-93 TRUCK, HL-93 TANDEM, COLORADO PERMIT TRUCK AND NRL

DEAD LOAD CASE 1: VERTICAL EARTH LOAD = 120 LBS./CU. FT.
HORIZONTAL EARTH LOAD = 30 LBS./CU. FT.

DEAD LOAD CASE 2: VERTICAL EARTH LOAD = 120 LBS./CU. FT.
HORIZONTAL EARTH LOAD = 60 LBS./CU. FT.

WEARING SURFACE - 12 IN. THICK CONCRETE PAVEMENT.

DEAD LOAD - TYPE 7 BARRIER.

THRUST IS NOT CONSIDERED IN THIS STANDARD, I.E. THRUST = 0.

EXTREME HEADWATER TO DEPTH RATIO IS IN ACCORDANCE WITH THE CDOT DRAINAGE MANUAL.

EXTREME HEADWATER TO DEPTH RATIO WAS INCLUDED IN THE CULVERT DESIGNS BUT EXCLUDED FROM THE RATINGS AS PER THE AASHTO MANUAL FOR BRIDGE EVALUATION.

LIVE LOAD SURCHARGE ON EXTERIOR WALLS = 2 FT. OF EARTH

- IF HEADWALL MOUNT GUARDRAIL IS USED (SEE STANDARD PLAN M-606-1, SHEET 19) AND THE NOTES BELOW:

- ALL REINFORCING STEEL SHALL BE ACCORDING TO THIS BOX CULVERT PLAN.
- ANY SPECIAL DESIGN FOR STIRRUPS WILL NOT BE MEASURED AND PAID FOR SEPARATELY BUT SHALL BE INCLUDED IN THE WORK.
- HEADWALL DIMENSION AND CONCRETE QUANTITY SHALL BE ACCORDING TO STANDARD PLAN M-606-1, SHEET 19.
- POST ANCHORS SHALL BE PROVIDED ACCORDING TO STANDARD PLAN M-606-1, SHEET 19.
- POST ANCHORS AND CONCRETE FOR HEADWALL MOUNT OF GUARDRAIL WILL NOT BE MEASURED AND PAID FOR SEPARATELY BUT SHALL BE INCLUDED IN THE WORK.
- POST ANCHORS WHEN REQUIRED AND ENCASED IN HEADWALL CONCRETE, SHALL CONFORM TO ASTM A 36 OR AASHTO M 169 STEEL.

- SEE M-603-3 FOR PRECAST CONCRETE BOX CULVERT DETAILS.

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBE
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

(R-X)
(R-X)
(R-X)
(R-X)

Sheet Revisions

Date:	Comments

Colorado Department of Transportation

2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch

JBK

DOUBLE CONCRETE BOX CULVERT (CAST-IN-PLACE)

Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.


M-601-2

Standard Sheet No. 1 of 2



Project Sheet Number:

DOUBLE CONCRETE BOX CULVERT DIMENSIONS, QUANTITIES & RATING FACTORS (EXCLUDING HEADWALL & TOEWALL QUANTITIES)

BOX SIZE				FILL HEIGHT ALLOWED	SLAB & WALL THICKNESS (INHES)			BAR SIZES										DIMENSIONS					QUANTITIES			RATING FACTORS			
S	R	HT.	WIDTH					t1*	t2	b1	b2	w1*	w2	w3	w4	c1*	c2	d1▲	h1	h2	v1	v2	v3	CONCRETE	REBAR STL	MEMBRANE	HL-93 INVENTORY	HL-93 OPERATING	COLORADO PERMIT
FT	FT	FT-IN	FT-IN	FT-FT	Tt	Tb	TW & TWt	#	#	#	#	#	#	#	NO.	FT-IN	FT-IN	FT-IN	FT-IN	FT-IN	CY/LF	LBS/LF	CY/LF						
6	6	7-9	14-6	< 2	11	10	10	5	6	5	6	4	4	5	5	114	3-5	2-4	6-8	3-1	1-11	1.495	338	1.944	1.27	1.65	2.09	2.05	
		7-7.5	14-6	2 TO 10	10	9.5	10	5	5	5	5	4	4	5	5	102	2-6	2-4	6-8	3-1	1-11	1.428	300		1.81	2.35	2.90	2.82	
		7-7.5	14-6	10 TO 12.8	10	9.5	10	4	4	4	4	4	4	5	5	102	2-6	2-4	6-8	3-1	1-11	1.428	258		4.53	5.88	6.42	7.36	
		7-8	14-6	12.8 TO 20	10	10	10	4	4	4	4	4	4	5	5	102	2-6	2-4	6-8	3-1	1-11	1.451	258		◆	◆	◆	◆	
		9-9	14-6	< 2	11	10	10	5	6	5	6	4	4	5	5	126	3-5	2-4	8-8	3-1	1-11	1.681	365	1.944	1.28	1.66	2.10	2.05	
		9-7.5	14-6	2 TO 10	10	9.5	10	5	5	5	5	4	4	5	5	114	2-6	2-4	8-8	3-1	1-11	1.613	327		1.82	2.36	2.85	2.77	
	8	9-7.5	14-6	10 TO 12.8	10	9.5	10	4	4	4	4	4	4	5	5	114	2-6	2-4	8-8	3-1	1-11	1.613	285		4.66	6.04	6.82	5.08	
		9-8	14-6	12.8 TO 20	10	10	10	4	5	5	5	4	4	5	5	114	2-6	2-4	8-8	3-1	1-11	1.636	317		◆	◆	◆	◆	
		11-9	14-6	< 2	11	10	10	5	6	5	6	4	4	5	5	138	3-5	2-4	10-8	3-1	1-11	1.866	392	1.944	1.28	1.67	1.00	2.06	
		11-7.5	14-6	2 TO 10	10	9.5	10	5	5	5	5	4	4	5	5	126	2-6	2-4	10-8	3-1	1-11	1.799	354		1.83	2.38	1.00	2.78	
		11-7.5	14-6	10 TO 12.8	10	9.5	10	4	4	4	4	4	4	5	5	126	2-6	2-4	10-8	3-1	1-11	1.799	312		2.22	2.88	2.79	1.96	
		11-8.5	14-10.5	12.8 TO 20	10	10.5	11.5	4	5	4	5	4	4	5	5	126	2-6	2-4	10-8	3-2	2-0	2.006	336		◆	◆	◆	◆	
8	6	7-10.5	18-6	< 2	12.5	10	10	5	6	5	6	4	4	5	5	134	3-5	2-4	6-10	3-1	1-11	1.840	394	2.389	1.20	1.56	1.76	1.65	
		7-8	18-6	2 TO 10	10	10	10	5	5	5	5	4	4	5	5	118	2-6	2-4	6-8	3-1	1-11	1.698	344		1.47	1.90	2.19	2.15	
		7-10	18-6	10 TO 15	10	12	10	5	4	5	5	4	4	5	5	118	2-6	2-4	6-8	3-3	2-1	1.812	332		2.89	3.74	4.00	4.38	
		7-11	18-9	15 TO 16.8	10.5	12.5	11	5	4	5	5	4	4	5	5	118	2-6	2-5	6-8	3-4	2-2	1.942	335		3.37	4.37	4.60	4.86	
		7-11	18-9	16.8 TO 20	10.5	12.5	11	5	4	5	5	4	4	5	5	118	2-6	2-4	6-8	3-4	2-2	1.942	335		◆	◆	◆	◆	
		9-10.5	18-6	< 2	12.5	10	10	5	6	5	6	4	4	5	5	146	3-5	2-4	8-10	3-1	1-11	2.025	421	2.389	1.21	1.57	1.71	1.61	
	8	9-8	18-6	2 TO 10	10	10	10	5	5	5	5	4	4	5	5	130	2-6	2-4	8-8	3-1	1-11	1.883	371		1.46	1.89	2.18	2.13	
		9-10	18-6	10 TO 15	10	12	10	5	4	5	5	4	4	5	5	130	2-6	2-4	8-8	3-3	2-1	1.997	359		2.96	3.83	4.10	4.37	
		9-11	18-9	15 TO 16.8	10.5	12.5	11	5	4	5	5	4	4	5	5	130	2-6	2-5	8-8	3-4	2-2	2.146	362		3.44	4.46	4.70	4.96	
		9-11	18-9	16.8 TO 20	10.5	12.5	11	5	4	5	5	4	4	5	5	130	2-6	2-5	8-8	3-4	2-2	2.146	362		◆	◆	◆	◆	
		10	8-0.5	22-6	< 2	13.5	11	10	5	6	5	6	4	4	5	5	134	3-5	2-4	6-11	3-2	2-0	2.257	444	2.833	1.15	1.49	1.65	1.49
			8-1.5	22-6	2 TO 5	13	12.5	10	5	6	5	6	4	4	5	5	134	2-6	2-4	6-11	3-4	2-2	2.326	434		1.52	1.98	1.82	1.84
8-2	22-6		5 TO 10	13	13	10	5	4	6	6	4	4	5	5	134	2-6	2-4	6-11	3-5	2-2	2.361	417		1.77	2.29	2.65	3.77		
8-2.5	22-9		10 TO 15	13	13.5	11	6	5	6	6	5	5	5	5	134	2-6	2-5	6-11	3-5	2-7	2.472	495		3.57	4.63	4.62	5.05		
8-5.5	23-0		15 TO 20	14	15.5	12	6	5	6	6	5	5	5	5	134	2-6	2-6	7-0	3-7	2-9	2.761	501		3.36	4.36	4.38	4.52		
10-1	22-6		< 2	14	11	10	5	6	5	6	4	4	5	5	146	3-5	2-5	8-11	3-2	2-0	2.477	472	2.833	1.22	1.58	1.60	1.44		
10	8	10-1.5	22-6	2 TO 5	13	12.5	10	5	6	5	6	4	4	5	5	146	2-6	2-4	8-11	3-4	2-2	2.512	461		1.52	1.97	1.79	1.79	
		10-3	22-6	5 TO 10	13	14	10	5	4	5	6	4	4	5	5	146	2-6	2-4	8-11	3-5	2-3	2.616	425		1.74	2.25	2.61	3.53	
		10-3	22-9	10 TO 15	13	14	11	6	5	6	5	5	5	5	5	146	2-6	2-5	8-11	3-5	2-7	2.711	508		3.95	5.12	5.26	5.69	
		10-5.5	23-0	15 TO 20	14	15.5	12	6	5	6	6	6	6	5	5	146	2-6	2-6	9-0	3-7	2-9	2.983	588		3.46	4.48	4.51	4.64	
		12-2	22-6	< 2	14	12	10	5	6	5	6	4	4	5	5	158	3-5	2-5	10-11	3-3	2-1	2.731	499	2.833	1.24	1.60	1.79	1.61	
		12-2	22-6	2 TO 5	13	13	10	5	6	5	6	4	4	5	5	158	2-6	2-4	10-11	3-4	2-2	2.731	488		1.64	2.12	1.89	1.88	
	10	12-3	22-6	5 TO 10	13	14	10	5	4	5	6	4	4	5	5	158	2-6	2-4	10-11	3-5	2-3	2.801	452		1.72	2.23	2.58	2.74	
		12-5.5	22-9	10 TO 15	14	15.5	11	5	6	6	4	5	5	5	5	158	2-6	2-5	11-0	3-7	2-9	3.090	527		2.42	3.14	3.18	2.25	
		12-5.5	23-0	15 TO 20	14	15.5	12	6	5	6	6	5	5	5	5	158	2-6	2-5	11-0	3-7	2-9	3.205	567		2.11	2.73	2.64	1.86	
		8-3.5	26-6	< 2	14.5	13	10	5	6	5	6	4	4	5	5	150	3-5	2-5	7-0	3-4	2-2	2.805	500	3.278	1.16	1.51	1.51	1.59	
		8-5	26-6	2 TO 5	14	15	10	5	6	6	6	4	4	5	5	150	2-6	2-4	7-0	3-6	2-4	2.927	512		1.22	1.59	1.43	1.54	
		8-5.5	26-6	5 TO 10	14	15.5	10	6	5	6	6	4	4	5	5	150	2-6	2-4	7-0	3-6	2-5	2.968	488		2.10	2.72	3.13	3.89	
12	8	8-6.5	26-9	10 TO 15	15	15.5	11	6	6	7	6	5	5	5	150	3-3	2-5	7-1	3-7	2-9	3.129	610		1.86	2.42	2.36	2.53		
		10-4	26-6	< 2	14.5	13.5	10	5	6	5	6	4	4	5	5	162	3-5	2-5	9-0	3-5	2-3	3.031	528	3.278	1.16	1.51	1.56	1.59	
		10-5.5	26-6	2 TO 5	14	15.5	10	5	6	5	6	4	4	5	5	162	2-6	2-4	9-0	3-7	2-5	3.154	515		1.22	1.58	1.43	1.51	
		10-7.5	26-6	5 TO 10	16	15.5	10	5	6	6	6	4	4	5	5	162	3-3	2-4	9-2	3-7	2-5	3.317	544		1.70	2.21	2.16	2.39	
		10-7.5	26-9	10 TO 15	16	15.5	11	6	6	7	6	5	5	5	5	162	3-3	2-5	9-2	3-7	2-9	3.416	644		2.83	3.67	3.54	3.80	
		12-5	26-6	< 2	15	14	10	5	6	5	6	4	4	5	5	174	3-9	2-5	11-0	3-5	2								

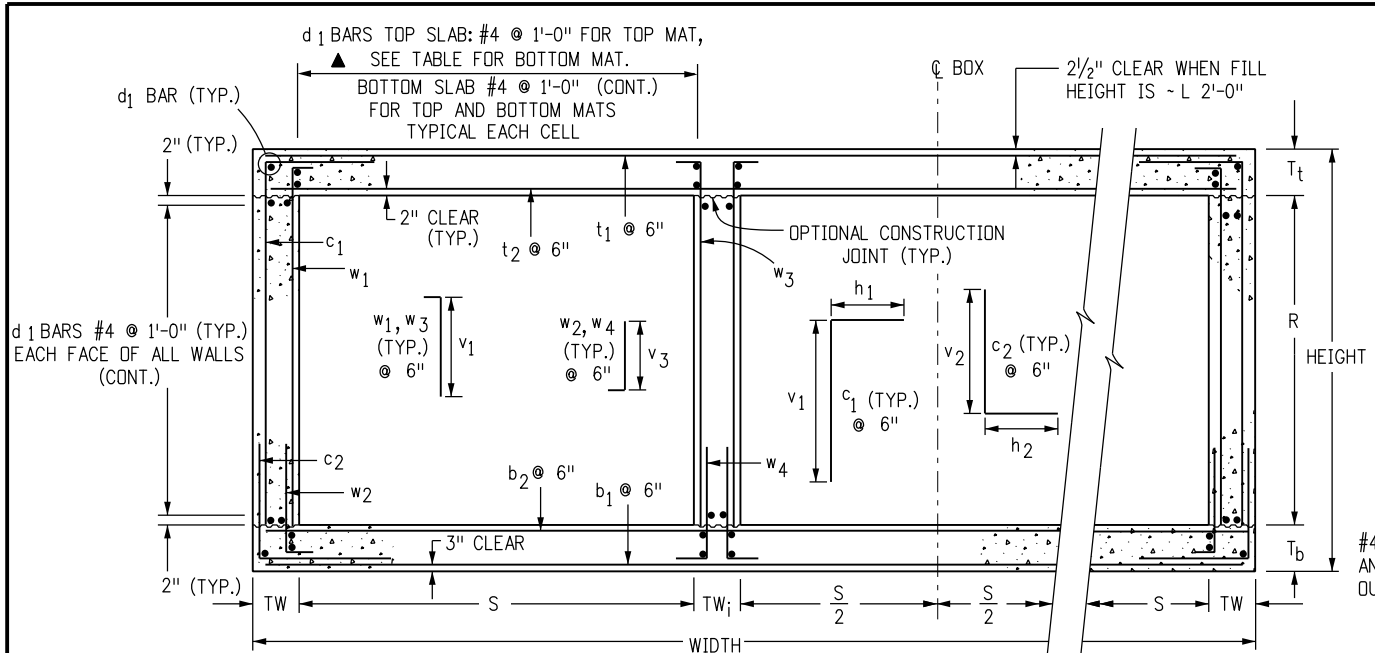

SECTION B-B

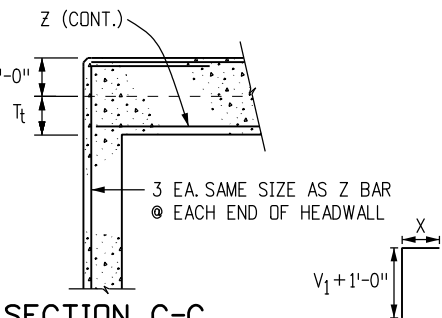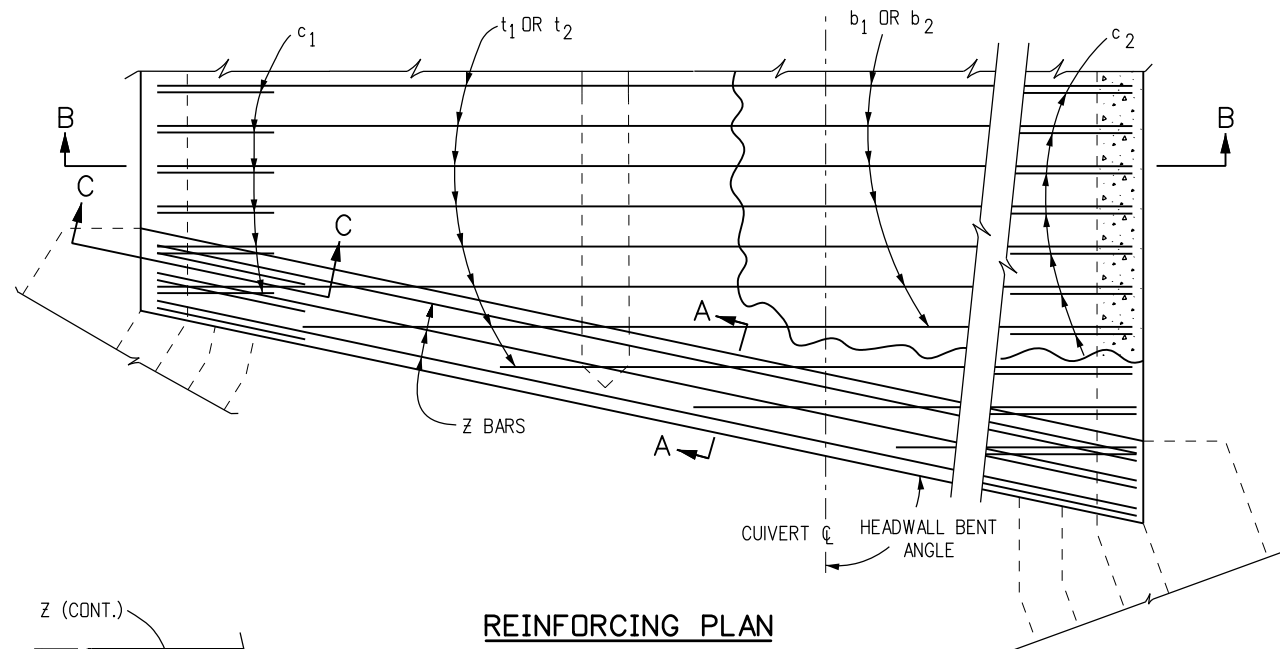


SECTION C-C


HEADWALL CORNER REINFORCING DETAIL

REINFORCING PLAN

BAR SIZE (#)	EPOXY X (FT.-IN.)	BLACK X (FT.-IN.)
4	2-4	1-11
5	2-10	2-4
6	3-5	2-10
7	4-1	3-3
8	5-3	4-3
9	6-8	5-5

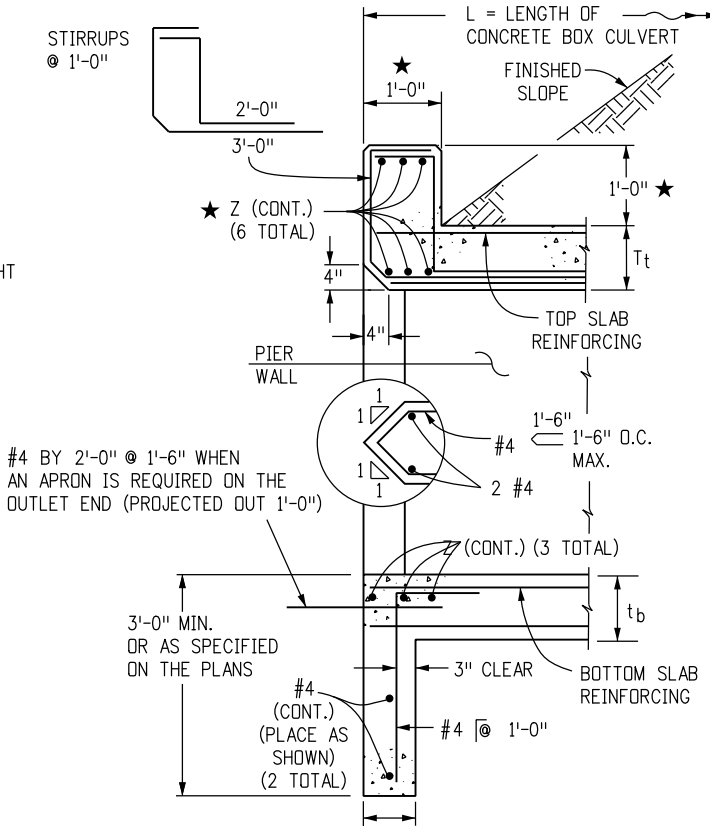

SECTION A-A

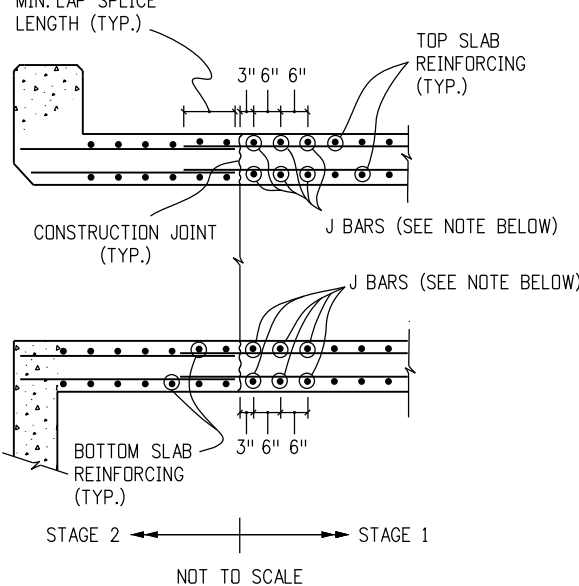

CONSTRUCTION JOINT DETAIL FOR STAGED CONSTRUCTION

NOTE: THIS DETAIL IS FOR CONSTRUCTION JOINTS INSTALLED PERPENDICULAR TO THE C OF THE BOX ONLY. THE CONTRACTOR CAN DESIGN AND INSTALL J BARS AT HIS EXPENSE TO SUPPORT TEMPORARY LIVE LOADS DURING STAGE 1 CONSTRUCTION. J BARS SHALL BE THE SAME SIZE AS THE TOP AND BOTTOM SLAB REINFORCING WHEN THERE ARE NO TEMPORARY LIVE LOADS TO SUPPORT.

GENERAL NOTES

1. ALL CONCRETE SHALL BE CLASS D (BOX CULVERT).
2. ALL CONSTRUCTION JOINTS SHALL BE THOROUGHLY CLEANED BEFORE FRESH CONCRETE IS PLACED.
3. ALL CONSTRUCTION JOINTS NOT SHOWN ON THE PLANS SHALL BE CONSTRUCTED ONLY IF APPROVED BY THE ENGINEER.
4. THE CONTRACTOR SHALL MAINTAIN THE STABILITY OF THE STRUCTURE DURING CONSTRUCTION.
5. STRUCTURE EXCAVATION AND BACKFILL SHALL BE IN ACCORDANCE WITH STANDARD PLAN M-206-1.
6. FOR ANY CULVERT SPAN 20 FT. OR GREATER, A FOUNDATION INVESTIGATION AND REPORT ARE REQUIRED.
7. BACKFILL SHALL NOT BEGIN UNTIL TOP SLAB HAS REACHED DESIGN STRENGTH, f_c .
8. SPLICE QUANTITIES FOR LONGITUDINAL AND TRANSVERSE BARS ARE NOT INCLUDED.
9. REINFORCING STEEL SHALL BE GRADE 60.
10. THE MINIMUM LAP SPLICE LENGTH FOR EPOXY COATED REINFORCING BARS SHALL BE:

BAR SIZE:	#4	#5	#6	#7	#8	#9	#10	#11
SPLICE LENGTH:	1'-3"	1'-7"	2'-5"	2'-10"	3'-8"	4'-8"	5'-11"	7'-3"

THE MINIMUM LAP SPLICE LENGTH FOR BLACK REINFORCING BARS SHALL BE:

BAR SIZE:	#4	#5	#6	#7	#8	#9	#10	#11
SPLICE LENGTH:	1'-1"	1'-4"	1'-7"	2'-6"	3'-1"	3'-11"	4'-10"	

THE ABOVE SPLICE LENGTHS ARE FOR CLASS B SPLICES.

11. ALL DIMENSIONS ARE PERPENDICULAR TO THE CENTERLINE OF THE BOX.
12. WINGWALLS SHALL BE TIED TO CONCRETE BOX CULVERT IN ACCORDANCE WITH STANDARD PLAN M-601-20.
13. ALL TRANSVERSE REINFORCING SHALL BE NORMAL TO THE CENTERLINE OF THE BOX.
14. THE FILL HEIGHT IS THE DISTANCE MEASURED FROM THE TOP OF THE TOP SLAB TO THE TOP OF PAVEMENT.
15. ALL EXPOSED CONCRETE CORNERS SHALL BE CHAMFERED $\frac{3}{4}$ IN.
16. FOR FILL HEIGHTS LESS THAN 2 FT, A WATERPROOFING MEMBRANE SHALL BE PROVIDED FOR THE TOP OF THE TOP SLAB AND 18" DOWN ALONG THE TOPS OF THE EXTERIOR WALLS.
17. FOR FILL HEIGHTS LESS THAN 2 FT. THE d_1 BARS FOR THE BOTTOM MAT OF THE TOP SLAB SHALL BE AS FOLLOWS:

S	8, 9, 10	14, 16, 18	20
BAR SIZE:	#5	#6	#7
SPACING	1'-0"	1'-0"	1'-0"

DESIGN DATA: 7TH EDITION, 2014, OF THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS

RATING DATA: 2ND EDITION, 2011, OF THE AASHTO MANUAL FOR BRIDGE EVALUATION

LOADING DATA: $f_y = 60,000$ psi,
 $f'_c = 4,500$ psi,
 LIVE LOAD = AASHTO LRFD, HL-93 TRUCK, HL-93 TANDEM, COLORADO PERMIT TRUCK AND NRL
 DEAD LOAD CASE 1: VERTICAL EARTH LOAD = 120 LBS./CU. FT.
 HORIZONTAL EARTH LOAD = 30 LBS./CU. FT.
 DEAD LOAD CASE 2: VERTICAL EARTH LOAD = 120 LBS./CU. FT.
 HORIZONTAL EARTH LOAD = 60 LBS./CU. FT.
 WEARING SURFACE - 12 IN. THICK CONCRETE PAVEMENT.
 DEAD LOAD - TYPE 7 BARRIER.
 THRUST IS NOT CONSIDERED IN THIS STANDARD, I.E. THRUST = 0.
 EXTREME HEADWATER TO DEPTH RATIO IS IN ACCORDANCE WITH THE CDOT DRAINAGE MANUAL.
 EXTREME HEADWATER TO DEPTH RATIO WAS INCLUDED IN THE CULVERT DESIGNS BUT EXCLUDED FROM THE RATINGS AS PER THE AASHTO MANUAL FOR BRIDGE EVALUATION.
 LIVE LOAD SURCHARGE ON EXTERIOR WALLS = 2 FT. OF EARTH


- ★ IF HEADWALL MOUNT GUARDRAIL IS USED (SEE STANDARD PLAN M-606-1, SHEET 19 AND NOTES BELOW):
 - ALL REINFORCING STEEL SHALL BE ACCORDING TO THIS BOX CULVERT PLAN.
 - ANY SPECIAL DESIGN FOR STIRRUPS WILL NOT BE MEASURED AND PAID FOR SEPARATELY BUT SHALL BE INCLUDED IN THE WORK.
 - HEADWALL DIMENSION AND CONCRETE QUANTITY SHALL BE ACCORDING TO STANDARD PLAN M-606-1, SHEET 19.
 - POST ANCHORS SHALL BE PROVIDED ACCORDING TO STANDARD PLAN M-606-1, SHEET 19.
 - POST ANCHORS AND CONCRETE FOR HEADWALL MOUNT OF GUARDRAIL WILL NOT BE MEASURED AND PAID FOR SEPARATELY BUT SHALL BE INCLUDED IN THE WORK.
 - POST ANCHORS WHEN REQUIRED AND ENCASED IN HEADWALL CONCRETE, SHALL CONFORM TO ASTM A 36 OR AASHTO M 169 STEEL.

18. SEE M-603-3 FOR PRECAST CONCRETE BOX CULVERT DETAILS.


Computer File Information		Sheet Revisions		Colorado Department of Transportation	TRIPLE CONCRETE BOX CULVERT (CAST-IN-PLACE)	STANDARD PLAN NO. M-601-3
Creation Date: 07/31/19		Date:	Comments			
Designer Initials: JBE	(R-X)			2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868	Issued by the Project Development Branch: July 31, 2019	Standard Sheet No. 1 of 2
Last Modification Date: 07/31/19	(R-X)					
Detailer Initials: LTA	(R-X)					
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)					
				Project Development Branch	JBK	Project Sheet Number:

TRIPLE CONCRETE BOX CULVERT DIMENSIONS, QUANTITIES & RATING FACTORS (EXCLUDING HEADWALL & TOEWALL QUANTITIES)


BOX SIZE				FILL HEIGHT ALLOWED	SLAB & WALL THICKNESS (INCHES)			BAR SIZES								d1▲	DIMENSIONS					QUANTITIES			RATING FACTORS				
S	R	HT.	WIDTH		Tt	Tb	TW&TWt	t1*	t2	b1	b2	w1*	w2	w3*	w4		c1*	c2	h1	h2	v1	v2	v3	CONCRETE	REBAR STL	WATERPROOFING	HL-93 INVENTORY	HL-93 OPERATING	COLORADO PERMIT
FT	FT	FT-IN	FT-IN	FT-FT				#	#	#	#	#	#	#	#	#	NO.	FT-IN	FT-IN	FT-IN	FT-IN	FT-IN	CY/LF	LBS/LF	SY/LF				
8	6	7-10.5	27-4	< 2	12.5	10	10	5	6	5	6	4	4	5	5	168	3-5	2-4	6-10	2-4	1-11	2,639	531	3,370	1.21	1.57	1.82	1.69	
		7-9.5	27-4	2 TO 8	10.5	11	10	4	5	4	5	4	4	5	5	168	2-6	2-4	6-8	3-2	2-0	2,555	429		1.47	1.90	2.07	1.83	
		8-0	27-4	8 TO 12	11	13	10	4	5	4	5	4	4	5	5	168	2-6	2-4	6-9	3-4	2-2	2,765	432		3.38	4.39	4.80	5.22	
		8-0	27-4	12 TO 16	11	13	10	5	4	4	4	5	5	5	5	168	2-6	2-4	6-9	3-4	2-2	2,765	462		6.80	8.81	9.35	8.63	
		8-0	27-4	16 TO 20	11	13	10	5	4	5	4	5	5	5	5	168	2-4	2-4	6-9	3-5	2-2	2,765	482		1.69	2.19	2.20	2.27	
		8-3.5	27-4	20 TO 25.9	13	14.5	10	5	5	5	5	5	5	5	5	168	2-6	2-4	6-11	2-4	2-3	3,061	523		6.80	8.82	8.50	5.95	
		8-4.5	27-10	26 TO 30	13.5	15	11.5	5	6	5	6	5	5	5	5	168	3-3	2-6	6-11	3-6	2-4	3,300	587		◆	◆	◆	◆	
	8	9-10.5	27-4	< 2	12.5	10	10	5	6	5	6	4	4	5	5	184	3-5	2-4	8-10	3-1	1-11	2,886	566	3,370	1.21	1.57	1.82	1.65	
		9-9.5	27-4	2 TO 8	10.5	11	10	4	5	4	5	4	4	5	5	175	2-6	2-4	8-8	3-2	2-0	2,801	461		1.46	1.89	2.00	1.82	
		10-0	27-4	8 TO 12	11	13	10	4	5	4	5	4	4	5	5	184	2-6	2-4	8-9	3-4	2-2	3,012	464		3.45	4.47	4.89	5.12	
		10-0	27-4	12 TO 16	11	13	10	5	4	4	5	4	4	5	5	184	2-6	2-4	8-9	3-4	2-2	3,012	460		2.53	3.27	3.47	3.73	
		10-4	27-4	16 TO 20	13.5	14.5	10	5	4	5	5	4	4	5	5	184	3-3	2-4	8-11	3-5	2-2	3,350	490		3.07	3.98	3.84	2.72	
		10-4	27-6	20 TO 25.9	13.5	14.5	10.5	5	6	5	5	5	6	6	5	184	3-3	2-4	8-11	3-6	2-3	3,414	675		1.78	2.32	2.23	1.56	
		10-4.5	27-10	26 TO 30	13.5	15	11.5	5	5	5	5	5	5	5	5	184	3-3	2-6	8-11	3-6	2-4	3,584	578		◆	◆	◆	◆	
12	6	8-0	33-4	< 2	14	10	10	6	7	6	7	5	5	5	5	192	3-5	2-4	6-11	3-1	1-11	3,210	796	4,037	1.20	1.55	1.44	1.37	
		7-9	33-4	2 TO 8	11	10	10	6	7	6	7	5	5	5	5	192	2-6	2-4	6-9	2-4	1-11	2,901	774		1.56	2.02	1.81	1.73	
		8-1	33-4	8 TO 12	11.5	13.5	10	5	7	5	7	5	5	5	5	192	2-6	2-4	6-9	3-4	2-2	3,313	721		2.81	3.65	3.73	4.04	
		8-2.5	33-4	12 TO 16	12	14.5	10	6	6	5	7	5	5	5	5	192	2-6	2-4	6-10	3-7	2-4	3,467	720		2.67	3.47	3.58	3.84	
		8-6	33-4	16 TO 22	14	16	10	6	5	6	5	5	5	5	5	192	2-6	2-4	7-0	3-7	2-5	3,827	658		2.44	3.17	3.04	3.14	
		10-0	33-6	< 2	14	10	10.5	6	7	6	7	5	5	5	5	208	3-5	2-4	8-11	3-1	1-11	3,519	840	4,056	1.20	1.56	1.40	1.33	
		9-11.5	33-4	2 TO 6	11.5	12	10	6	7	6	7	5	5	5	5	208	2-6	2-4	8-9	2-4	2-0	3,405	817		1.65	2.14	2.44	2.39	
	8	10-1	33-4	6 TO 8	11.5	13.5	10	5	7	5	7	5	5	5	5	208	2-6	2-4	8-9	3-3	2-0	3,560	760		3.11	4.04	3.99	4.60	
		10-1	33-4	8 TO 12	11.5	13.5	10	5	7	5	7	5	5	5	5	208	2-6	2-4	8-9	3-5	2-2	3,560	763		2.85	3.69	3.76	4.07	
		10-5	33-4	12 TO 16	13.5	15.5	10	5	7	5	7	5	5	5	5	208	2-6	2-4	8-11	3-7	2-4	3,971	768		3.36	4.36	4.60	4.04	
		10-6	33-4	16 TO 22	14	16	10	6	7	6	7	5	5	5	5	208	2-6	2-4	9-0	3-7	2-5	4,074	831		2.37	3.08	2.93	2.10	
		12-0	33-6	< 2	14	10	10.5	6	7	6	7	5	5	5	5	224	3-5	2-4	10-11	2-4	1-11	3,778	879	4,056	1.17	1.52	1.36	1.30	
		11-10.5	33-6	2 TO 8	11.5	11	10.5	6	7	6	7	5	5	5	5	224	2-6	2-4	10-9	3-2	2-0	3,623	864		1.65	2.14	2.15	2.06	
		12-0.5	33-8	8 TO 12	11.5	13	11	5	7	5	7	5	5	5	5	224	2-6	2-5	10-9	3-4	2-2	3,904	808		3.09	4.00	3.92	3.08	
10	12-3	33-4	12 TO 14	12.5	14.5	10	5	5	5	5	5	5	5	5	224	2-6	2-4	10-10	3-6	2-3	4,012	675		1.68	2.17	2.10	1.50		
	12-5	33-6	14 TO 16	13.5	15.5	10.5	5	7	5	7	5	5	5	5	224	2-6	2-4	10-11	3-7	2-4	4,295	812		1.59	2.06	1.99	1.41		
	12-6	34-0	16 TO 22	14	16	12	6	7	6	7	5	5	5	6	224	2-10	2-8	11-0	2-4	2-5	4,630	914		1.40	1.92	1.75	1.24		
	18	6	8-1	39-6	< 2	15	10	10.5	6	7	6	7	5	5	5	5	216	3-9	2-4	7-0	3-1	1-11	3,826	905	4,722	1.03	1.33	1.14	1.15
			7-11.5	39-4	2 TO 4	12.5	11	10	6	7	6	7	5	5	5	5	203	2-6	2-4	6-10	3-2	2-0	3,594	881		1.34	1.74	1.46	1.55
			8-2	39-4	4 TO 8	13.5	12.5	10	5	7	5	7	5	5	5	5	216	2-6	2-4	6-11	3-7	2-5	3,897	818		1.10	1.42	1.27	1.36
			8-6.5	39-4	8 TO 10	14.5	16	10	5	7	5	7	5	5	5	5	216	3-3	2-4	7-0	3-7	2-5	4,443	823		2.22	2.88	2.82	3.06
8-8			39-6	10 TO 12	16	16	10.5	6	5	6	5	5	5	5	5	216	3-3	2-4	7-2	2-4	2-3	4,679	735		3.48	4.51	4.97	5.27	
8-8			39-8	12 TO 16	16	16	11	6	5	6	5	5	5	5	5	216	3-3	2-5	7-2	3-7	2-5	4,733	745		2.48	3.22	3.40	3.59	
8-11			39-8	16 TO 18	17	18	11	6	5	6	5	5	5	5	5	216	3-3	2-4	7-3	3-9	2-7	5,100	748		2.09	2.71	2.79	2.86	
8		10-1.5	39-6	< 2	15	10.5	10.5	6	7	6	7	5	5	6	6	232	3-9	2-8	9-0	3-5	1-11	4,146	984	4,722	1.07	1.39	1.19	1.20	
		9-11.5	39-4	2 TO 4	12.5	11	10	6	7	6	7	5	5	5	5	232	2-6	2-4	8-10	3-2	2-0	3,841	923		1.31	1.70	1.44	1.52	
		10-2.5	39-4	4 TO 8	13.5	13	10	5	5	5	5	5	5	5	5	232	2-6	2-4	8-11	2-4	2-2	4,205	695		1.15	1.50	1.34	1.43	
		10-9.5	39-8	8 TO 12	16	17.5	11	5	5	5	5	5	5	5	5	232	3-3	2-5	9-2	3-9	2-6	5,188	716		2.51	3.26	2.93	3.11	
		10-11	39-8	12 TO 18	17	18	11	6	5	6	5	5	5	5	5	232	3-3	2-5	9-3	3-9	2-7	5,371	790		1.98	2.57	2.63	2.71	
		12-3	39-6	< 2	16	11	10.5	6	7	6	7	5	5	6	6	248	4-4	2-8	11-1	2-8	2-0	4,588	1030	4,722	1.11	1.44	1.23	1.24	
		11-11.5	39-4	2 TO 4	12.5	11	10	6	7	6	7	5	5	5	5	248	2-6	2-4	10-10	3-2	2-0	4,087	964		1.30	1.69	1.43	1.50	
10	12-4.5	39-4	4 TO 8	13.5	15	10	5	5	5	5	5	5	5	5	248	2-6	2-4	10-11	2-4	2-4	4,694	739		1.60	2.07	2.17	2.61		
	12-9.5	3																											

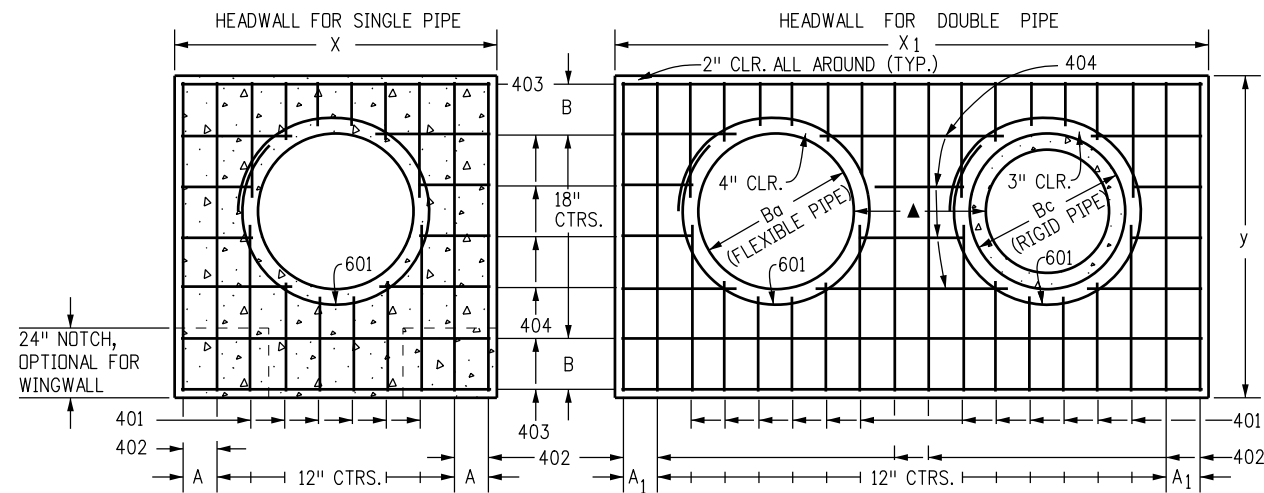

TYPICAL BAR LAYOUT FOR CONCRETE HEADWALLS

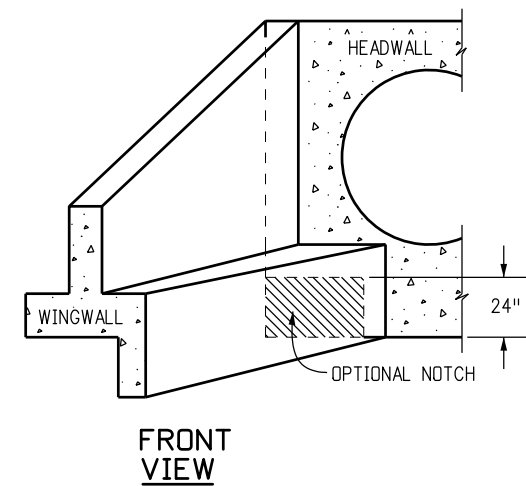


FRONT VIEW

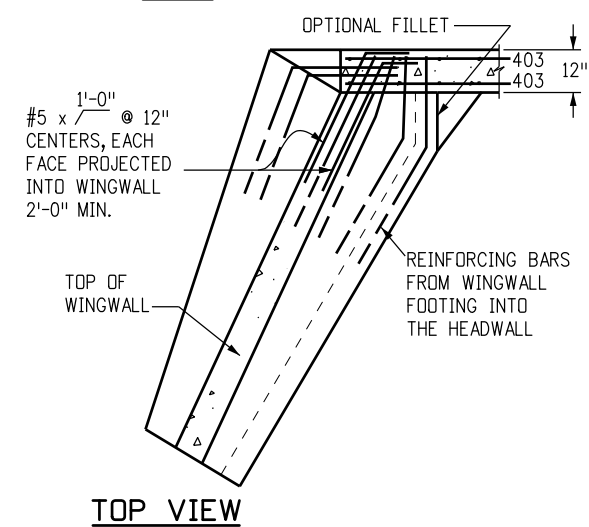


TOP VIEW

WINGWALL CONNECTION

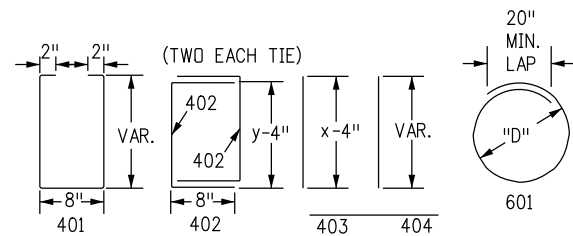

RIGID PIPE = $B_c + 6"$
 FLEXIBLE PIPE = $B_a + 8"$
 FLEXIBLE ARCH = $SPAN + 8"$
 STRUCTURAL PLATE ARCH = $RISE + 8"$

BAR BENDING

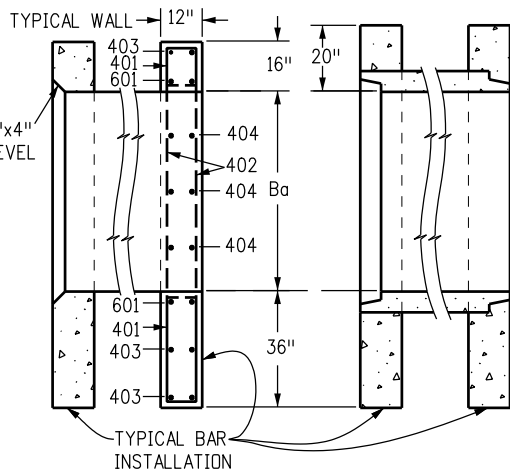


INLET OUTLET

ENDS OF FLEXIBLE PIPE

INLET OUTLET

ENDS OF RIGID PIPE

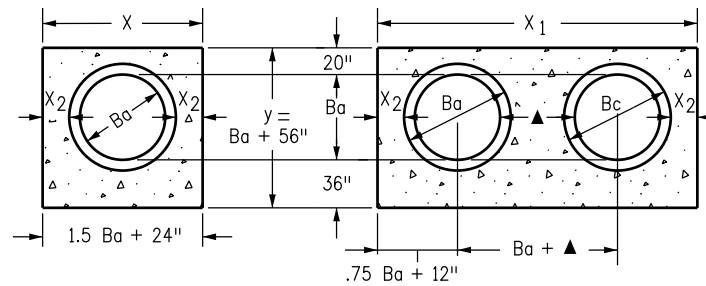


DIMENSIONS

Ba IN.	Bc IN.	X FT.-IN.	A IN.	X1 FT.-IN.	A1 IN.	y FT.-IN.	B IN.	X2 IN.	CONCRETE		STEEL ■	
									SGL CU. YD.	DBL CU. YD.	SGL LBS.	DBL LBS.
54	65	8-9	8 1/2	15-6	7	9-2	17	20	2.12	3.55	209	364
60	72	9-6	7	17-0	10	9-8	11	21	2.35	3.99	236	414
66	79	10-3	11 1/2	18-6	7	10-2	14	22	2.60	4.44	249	453
72	86	11-0	10	20-0	10	10-8	17	23	2.85	4.91	270	476
78	93	11-9	8 1/2	21-3	11	11-2	11	24	3.11	5.29	306	527
84	100	12-6	7	22-6	7	11-8	14	25	3.38	5.68	333	572
90	107	13-3	11 1/2	23-9	8 1/2	12-2	17	26	3.66	6.08	335	593
96	114	14-0	10	25-0	10	12-8	11	27	3.94	6.48	379	649
102	121	14-9	8 1/2	26-3	11 1/2	13-2	14	28	4.24	6.89	400	664
108	128	15-6	7	27-6	7	13-8	17	29	4.54	7.30	424	707

QUANTITIES

HEADWALL FOR RIGID ROUND PIPE

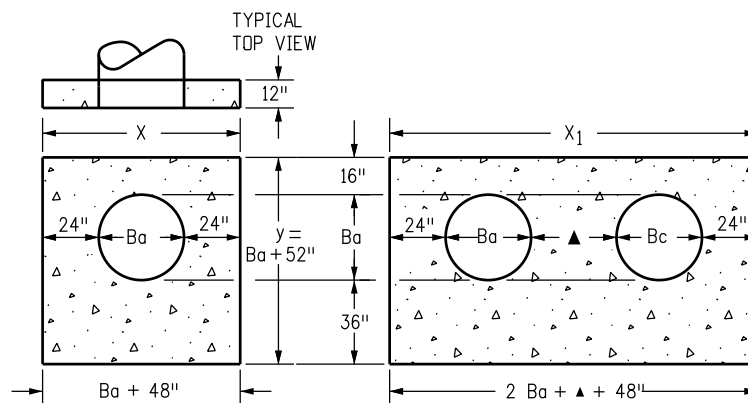


DIMENSIONS

Ba IN.	X FT.-IN.	A IN.	X1 FT.-IN.	A1 IN.	y FT.-IN.	B IN.	CONCRETE		STEEL ■	
							SGL CU. YD.	DBL CU. YD.	SGL LBS.	DBL LBS.
54	8-6	7	15-3	11 1/2	8-10	15	2.19	3.81	211	358
60	9-0	10	16-6	7	9-4	18	2.38	4.25	217	396
66	9-6	7	17-9	8 1/2	9-10	12	2.58	4.70	252	454
72	10-0	10	19-0	10	10-4	15	2.78	5.17	255	472
78	10-6	7	20-0	10	10-10	18	2.98	5.56	276	499
84	11-0	10	21-0	10	11-4	12	3.19	5.95	297	553
90	11-6	7	22-0	10	11-10	15	3.40	6.36	317	517
96	12-0	10	23-0	10	12-4	18	3.62	6.79	321	597
102	12-6	7	24-0	10	12-10	12	3.84	7.21	364	663
108	13-0	10	25-0	10	13-4	15	4.06	7.63	362	678

QUANTITIES


HEADWALL FOR FLEXIBLE ROUND PIPE

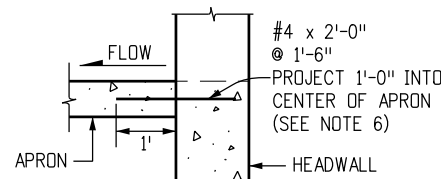

WHEN APRON IS REQUIRED

GENERAL NOTES

1. CONCRETE SHALL BE CLASS B.
 2. HEADWALL SHALL BE PERPENDICULAR TO THE PIPE ϕ UNLESS OTHERWISE SHOWN ON THE PLANS. TABULATED DIMENSIONS AND QUANTITIES MUST BE ADJUSTED FOR SKEWED INSTALLATIONS.
 3. FOR WINGWALL DETAILS, SEE STANDARD PLAN M-601-20.
 4. VOLUME OCCUPIED BY PIPE HAS BEEN DEDUCTED FROM STEEL AND CONCRETE QUANTITIES.
 5. EXPOSED CONCRETE CORNERS SHALL BE CHAMFERED $\frac{3}{4}$ IN.
 6. ALL REINFORCING BARS SHALL HAVE A 2 IN. MINIMUM CLEARANCE.
- ▲ WHEN TWO OR MORE PIPES ARE LAID SIDE BY SIDE, THEY SHALL BE PLACED SO THAT THE ADJACENT PIPES WILL BE $\frac{1}{2}$ INSIDE DIAMETER APART, OR $\frac{1}{2}$ INSIDE SPAN APART, OR 3 FT. APART (INCLUDING WALL THICKNESS), WHICHEVER IS LESS.
- ADD $0.89 \times (X \text{ OR } X_1) (\text{LB.})$ WHEN APRON IS REQUIRED.

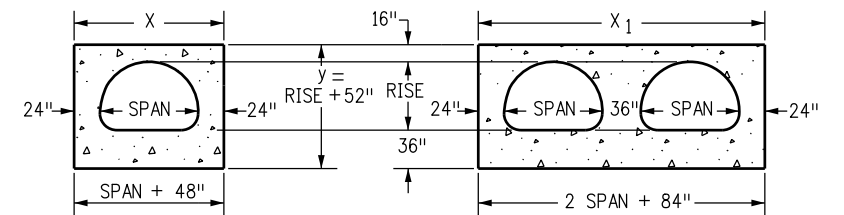

DIMENSIONS

EQUIV. Ba IN.	SPAN IN.	RISE IN.	X FT.-IN.	A IN.	X1 FT.-IN.	A1 IN.	y FT.-IN.	B IN.	CONCRETE		STEEL ■	
									SGL CU. YD.	DBL CU. YD.	SGL LBS.	DBL LBS.
72	81	59	10-9	8 1/2	20-6	7	9-3	17 1/2	2.72	5.10	250	467
78	87	63	11-3	11 1/2	21-6	7	9-7	10 1/2	2.85	5.34	275	531
84	95	67	11-9	8 1/2	22-10	9	9-11	12 1/2	3.08	5.79	290	547
90	103	71	12-7	7 1/2	24-2	11	10-3	15	3.30	6.21	321	591
96	112	75	13-4	12	25-8	8	10-7	16 1/2	3.52	6.65	314	606
102	117	79	13-9	8 1/2	26-6	7	10-11	9 1/2	3.63	6.86	356	672
108	128	83	14-8	8	28-4	12	11-3	11 1/2	3.96	7.51	376	699

QUANTITIES

HEADWALL FOR FLEXIBLE PIPE ARCH

EQUIV. Ba IN.	SPAN FT.-IN.	RISE FT.-IN.	X FT.-IN.	A IN.	X1 FT.-IN.	A1 IN.	y FT.-IN.	B IN.	CONCRETE		STEEL ■	
									SGL CU. YD.	DBL CU. YD.	SGL LBS.	DBL LBS.
66	6-1	4-7	10-1	10 1/2	19-2	11	8-11	15 1/2	2.52	4.70	232	424
75	7-0	5-1	11-0	10	21-0	10	9-5	9 1/2	2.80	5.25	282	509
84	7-11	5-7	11-11	9 1/2	22-10	9	9-11	12 1/2	3.08	5.79	291	540
93	8-10	6-1	12-10	9	24-8	8	10-5	15 1/2	3.36	6.33	309	622
102	9-9	6-7	13-9	8 1/2	26-6	7	10-11	9 1/2	3.63	6.86	379	673
111	10-11	7-1	14-11	9 1/2	28-10	9	11-5	12 1/2	4.05	7.67	377	711
120	11-10	7-7	15-10	9	30-8	8	11-11	15 1/2	4.36	8.28	395	731
132	12-10	8-4	16-10	9	32-8	8	12-8	11	4.75	9.03	441	839
141	14-1	8-9	18-1	10 1/2	35-2	11	13-1	13 1/2	5.17	9.86	448	931
150	15-4	9-3	19-4	12	37-8	8	13-7	16 1/2	5.69	10.88	490	953
159	15-10	9-10	19-10	9	38-8	8	14-2	11	5.89	11.25	534	1019

DIMENSIONS

QUANTITIES

HEADWALL FOR STRUCTURAL PLATE ARCH

SKEW ANGLE A°	90	85	80	75	70	65	60	55	50	45	40	35	30
FACTOR (cosecA°)	1.000	1.004	1.015	1.035	1.064	1.103	1.155	1.221	1.305	1.414	1.556	1.743	2.000

SKEW FACTOR TABLE

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

Sheet Revisions

Date:	Comments
(R-X)	
(R-X)	
(R-X)	
(R-X)	

Colorado Department of Transportation

2829 West Howard Place
 CDDT HQ, 3rd Floor
 Denver, CO 80204
 Phone: 303-757-9021 FAX: 303-757-9868
 Project Development Branch JBK

HEADWALL FOR PIPES

STANDARD PLAN NO.


M-601-10

Standard Sheet No. 1 of 1

Issued by the Project Development Branch: July 31, 2019



Project Sheet Number:

WWF 4 x 4 - W4 x W4 AT 85 LB./100 SQ. FT.
3" CLEARANCE AT TOP AND SIDES OF PIPE,
6" CLEARANCE AT BOTTOM. (TYP. ALL WALLS)

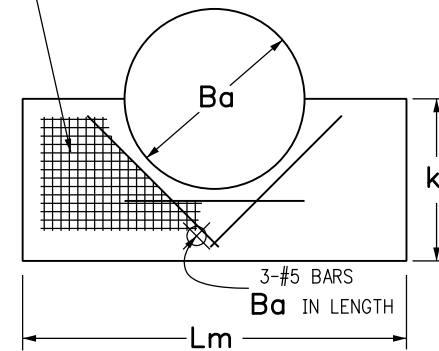


FLEXIBLE SINGLE PIPE

FLEXIBLE PIPE AND MPA SHALL
HAVE 3/4" DIA. GALV. ANCHOR BOLTS
EVENLY SPACED AT 19".

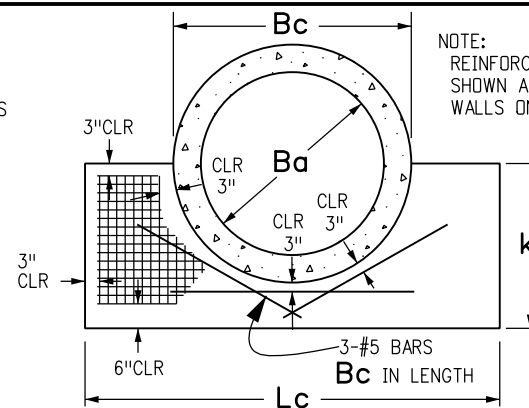


RIGID SINGLE PIPE

NOTE:
REINFORCEMENT CLEARANCES
SHOWN ARE TYPICAL FOR ALL
WALLS ON THIS SHEET.

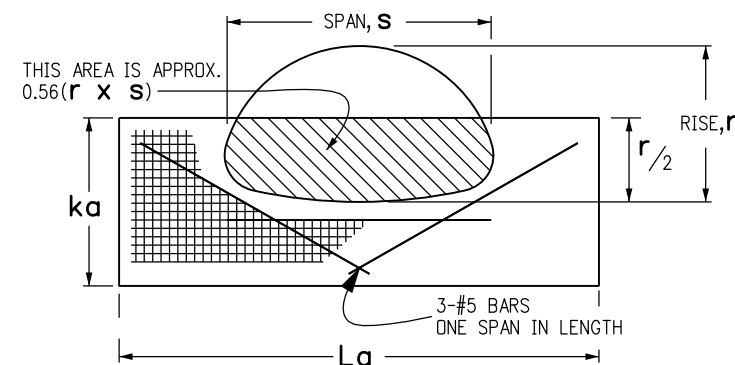


SINGLE MPA


- GENERAL NOTES**
1. CONCRETE SHALL BE CLASS B.
 2. EXPOSED CONCRETE CORNERS SHALL BE CHAMFERED 3/4 IN.
 3. IF A PRECAST HEADWALL IS USED, A PERMANENT EPOXY BOND, APPROVED BY THE ENGINEER, SHALL BE USED BETWEEN PIPE AND HEADWALL.
 4. HEADWALL SHALL BE PERPENDICULAR TO THE CULVERT CENTERLINE UNLESS OTHERWISE SPECIFIED. TABULATED DIMENSIONS AND QUANTITIES SHALL BE ADJUSTED FOR SKEWED INSTALLATIONS.
 5. HEADWALL ANCHOR BOLTS SHALL CONFORM TO AASHTO M 167 AND SHALL BE INCLUDED IN THE COST OF PIPE.
 6. HEADWALL ANCHOR BOLTS SHALL BE USED ONLY WITH FLEXIBLE PIPE, BOTH ROUND AND ARCH.

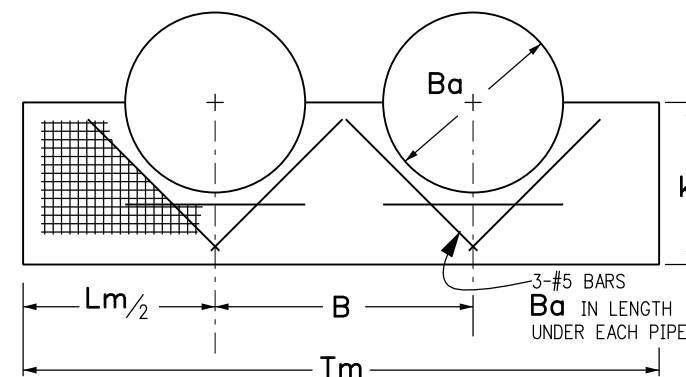

FLEXIBLE DOUBLE PIPE


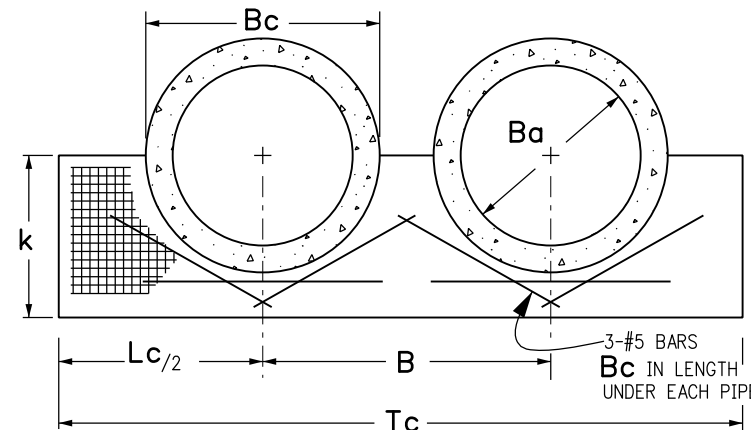


RIGID DOUBLE PIPE

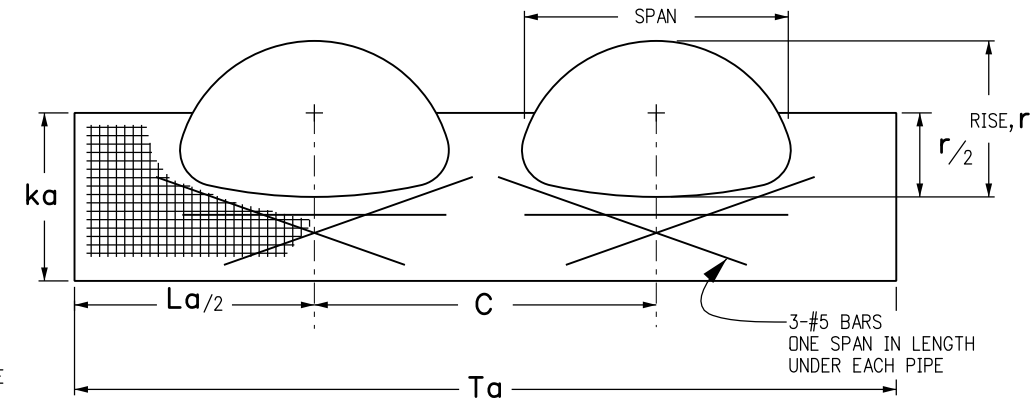

DOUBLE MPA

WHEN SHOWN ON THE PLANS,
BEVEL TOP HALF OF PIPE

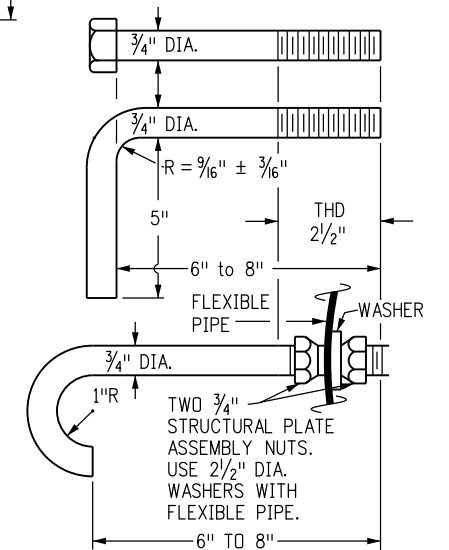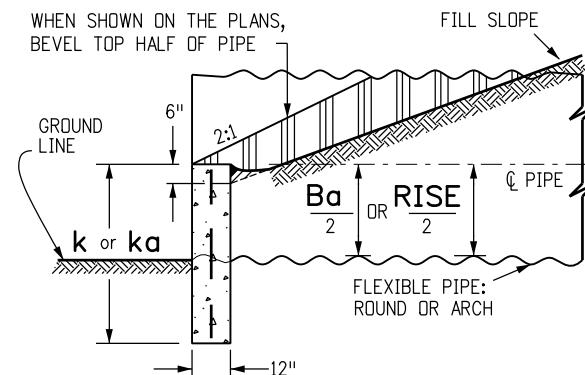

TYPICAL GALVANIZED ANCHOR BOLTS

RANGE OF EQUIV. DIAMS.	RANGE OF SPANS s	RANGE OF RISES r	ka	La	C	Ta	SINGLE		DOUBLE	
							CONCRETE	STEEL	CONCRETE	STEEL
							CU. YDS.	LBS.	CU. YDS.	LBS.
IN.										
36-42	39-47	30-36	36	94	71	165	0.72	26.2	1.22	49.8
42-48	48-59	31-41	41	118	89	207	1.04	36.5	1.77	68.7
54-60	60-71	40-51	51	142	107	249	1.53	52.2	2.61	97.2
60-75	72-83	44-69	69	166	119	285	2.49	78.3	4.14	142.0
72-81	84-95	63-72	72	190	131	321	2.93	93.1	4.76	166.5
84-90	96-107	69-76	76	214	143	357	3.42	110.1	5.45	194.6

NOTE: EACH LINE OF THE PIPE ARCH TABLE DESCRIBES A SINGLE HEADWALL THAT WILL ACCOMMODATE SEVERAL SIZES OF PIPE-ARCH. THE CONCRETE QUANTITIES IN THIS TABLE ARE BASED ON DEDUCTION OF CONCRETE FROM THE HEADWALL OF THE MEDIAN SIZE PIPE IN THE RANGE OF EQUIVALENT DIAMETERS SHOWN.


ADJUST L, B, T, C, #5 BAR LENGTH AND QUANTITIES WHEN SKEW IS < 90°

HEADWALL FOR METAL PIPE ARCH (MPA)


NOM. DIA. Ba	RCP O.D. Bc	k	Lm	Lc	B	Tm	Tc	FLEXIBLE PIPE				RIGID PIPE			
								SINGLE		DOUBLE		SINGLE		DOUBLE	
								CONCRETE	STEEL	CONCRETE	STEEL	CONCRETE	STEEL	CONCRETE	STEEL
								IN.							
36	44	36	81	99	56	137	155	0.62	21.3	1.01	39.6	0.72	26.3	1.04	46.2
42	51	42	94	114	63	157	177	0.84	28.1	1.34	51.3	0.97	34.3	1.39	59.8
48	58	48	108	130	72	180	202	1.10	36.0	1.76	64.4	1.27	43.6	1.81	75.3
54	65	54	121	146	81	202	227	1.39	44.6	2.22	80.1	1.60	54.1	2.30	92.5
60	72	60	134	161	90	224	251	1.70	54.1	2.73	96.8	1.96	65.7	2.83	111.2
66	79	66	148	177	99	247	276	2.07	64.9	3.31	115.4	2.37	78.1	3.42	131.9
72	86	72	161	193	108	269	301	2.46	76.4	3.93	135.2	2.83	91.9	4.08	154.4
78	93	78	175	208	114	289	322	2.90	89.1	4.57	155.8	3.30	106.5	4.71	177.1
84	100	84	188	224	120	308	344	3.35	102.4	5.23	177.4	3.83	122.5	5.41	201.6
90	107	90	202	240	126	328	366	3.86	117.1	5.96	200.8	4.40	139.7	6.16	227.8
96	114	96	215	255	132	347	387	4.38	132.3	6.71	225.1	4.98	157.5	6.93	254.9

HEADWALL FOR ROUND PIPE

SKEW°	FACTOR
90	1.000
85	1.004
80	1.015
75	1.035
70	1.064
65	1.103
60	1.155
55	1.221
50	1.305
45	1.414
40	1.556
35	1.743
30	2.000

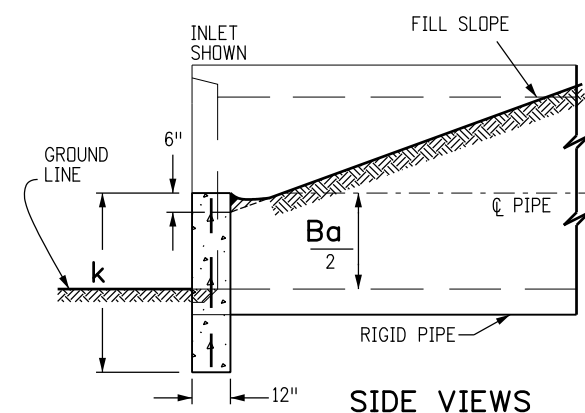

SIDE VIEWS

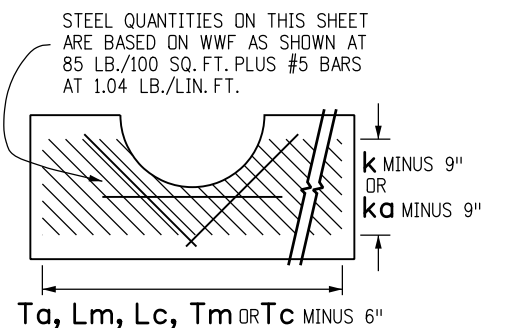

STEEL QUANTITIES ON THIS SHEET
ARE BASED ON WWF AS SHOWN AT
85 LB./100 SQ. FT. PLUS #5 BARS
AT 1.04 LB./LIN. FT.

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

Sheet Revisions

Date:	Comments
(R-X)	
(R-X)	
(R-X)	
(R-X)	

Colorado Department of Transportation



2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch

JBK

TYPE "S" SADDLE HEADWALLS FOR PIPE


Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.

M-601-11

Standard Sheet No. 1 of 1

Project Sheet Number:

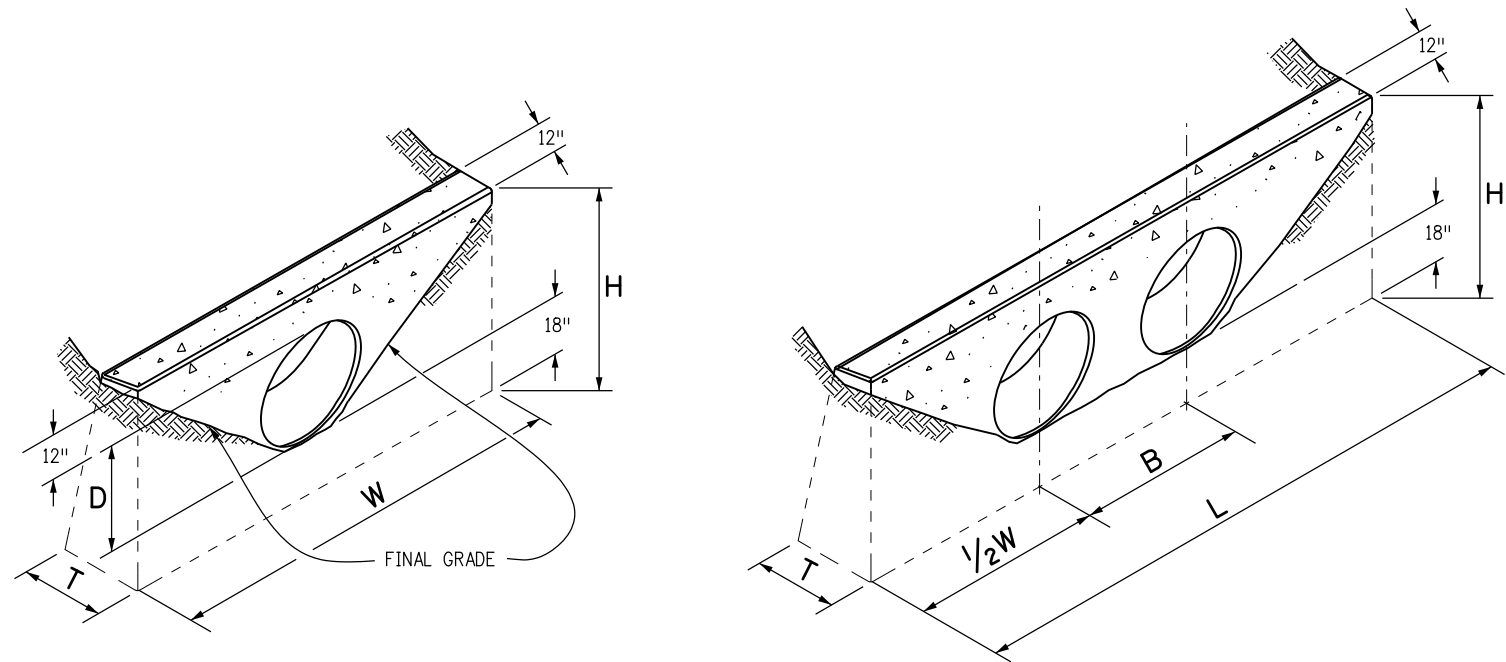

SINGLE PIPE

DOUBLE PIPE

CONCRETE HEADWALL INSTALLATIONS

SEE STANDARD PLAN M-601-10 FOR REINFORCING DETAILS.

PIPE		PIPE DIAMETER (AND EQUIVALENT DIAMETER) (IN.)											
		18		24		30		36		42		48	
TYPE	MATERIAL	SINGLE	DOUBLE	SINGLE	DOUBLE	SINGLE	DOUBLE	SINGLE	DOUBLE	SINGLE	DOUBLE	SINGLE	DOUBLE
CIRCULAR	RIGID	1.0	1.3	1.5	2.0	2.0	2.7	2.8	3.6	3.6	4.6	4.6	6.0
	FLEXIBLE	1.1	1.4	1.6	2.1	2.2	3.0	3.0	4.0	3.9	5.3	5.0	6.8
ELLIPTICAL	RIGID	23 x 14		30 x 19		38 x 24		45 x 29		53 x 34		60 x 38	
		0.9	1.2	1.3	1.6	1.7	2.2	2.3	2.9	2.9	3.7	3.5	4.4
ARCH	METAL	22 x 13		29 x 18		36 x 22		43 x 27		50 x 31		58 x 36	
		0.9	1.3	1.4	1.9	1.8	2.4	2.4	3.4	3.2	4.4	3.4	5.0

CONCRETE QUANTITIES FOR ONE CONCRETE HEADWALL (CUBIC YARDS)


THICKNESS	MATERIAL	PIPE DIAMETER (IN.)					
		18	24	30	36	42	48
4"	CONCRETE	0.4	0.8	1.2			
6"	CONCRETE				2.6	3.6	4.7
18"	RIPRAP	2.0	3.5	5.4	7.8	10.7	13.9

PIPE OUTLET PAVING (CUBIC YARDS)

NOTE: VOLUME OCCUPIED BY PIPE HAS BEEN DEDUCTED.


GENERAL NOTES

1. FOR SIZE AND LOCATION OF PIPES, SEE THE PLANS.
2. ALL CONCRETE SHALL BE CLASS B.
3. FOOTINGS IN ROCK SHALL BE POURED OUT TO ROCK AND NOT FORMED IN ACCORDANCE WITH SUBSECTION 601.09(b).
4. EXPOSED CONCRETE CORNERS SHALL BE CHAMFERED $\frac{3}{4}$ IN.
5. HEADWALL SHALL HAVE REINFORCING STEEL INSTALLED IN A PATTERN SIMILAR TO STANDARD PLAN M-601-10.
6. THE COST OF REINFORCING STEEL SHALL BE INCLUDED IN THE WORK UNLESS THE STEEL QUANTITIES ARE LISTED IN THE PLANS AND ARE PAID FOR SEPARATELY.

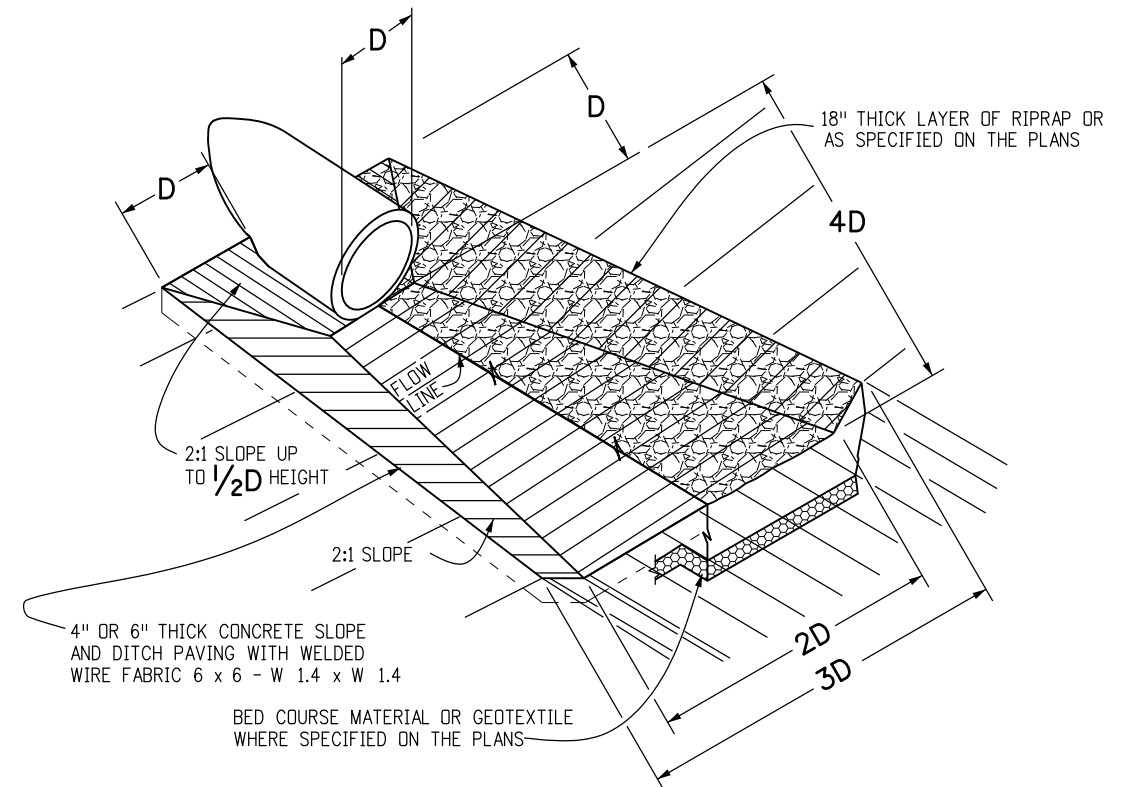


PIPE OUTLET PAVING

MAY BE USED WITH MULTIPLE PIPES.

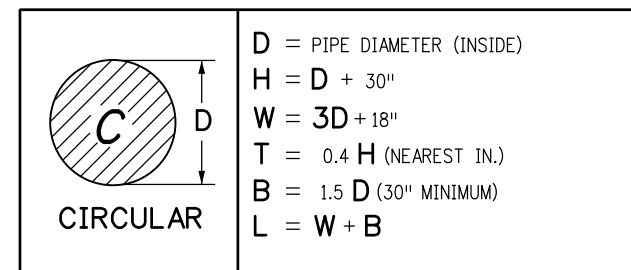

TYPE OF PIPE


HEADWALL DIMENSIONS

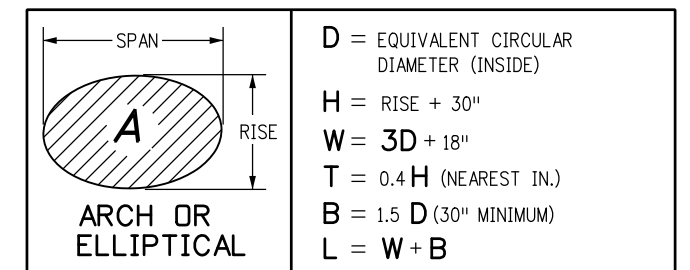

TYPE OF PIPE

HEADWALL DIMENSIONS




Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	HEADWALLS AND PIPE OUTLET PAVING	STANDARD PLAN NO.	
Creation Date: 07/31/19		Date:	Comments			M-601-12	
Designer Initials: JBK						Standard Sheet No. 1 of 1	
Last Modification Date: 07/31/19						Project Sheet Number:	
Detailer Initials: LTA							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English					Issued by the Project Development Branch: July 31, 2019		

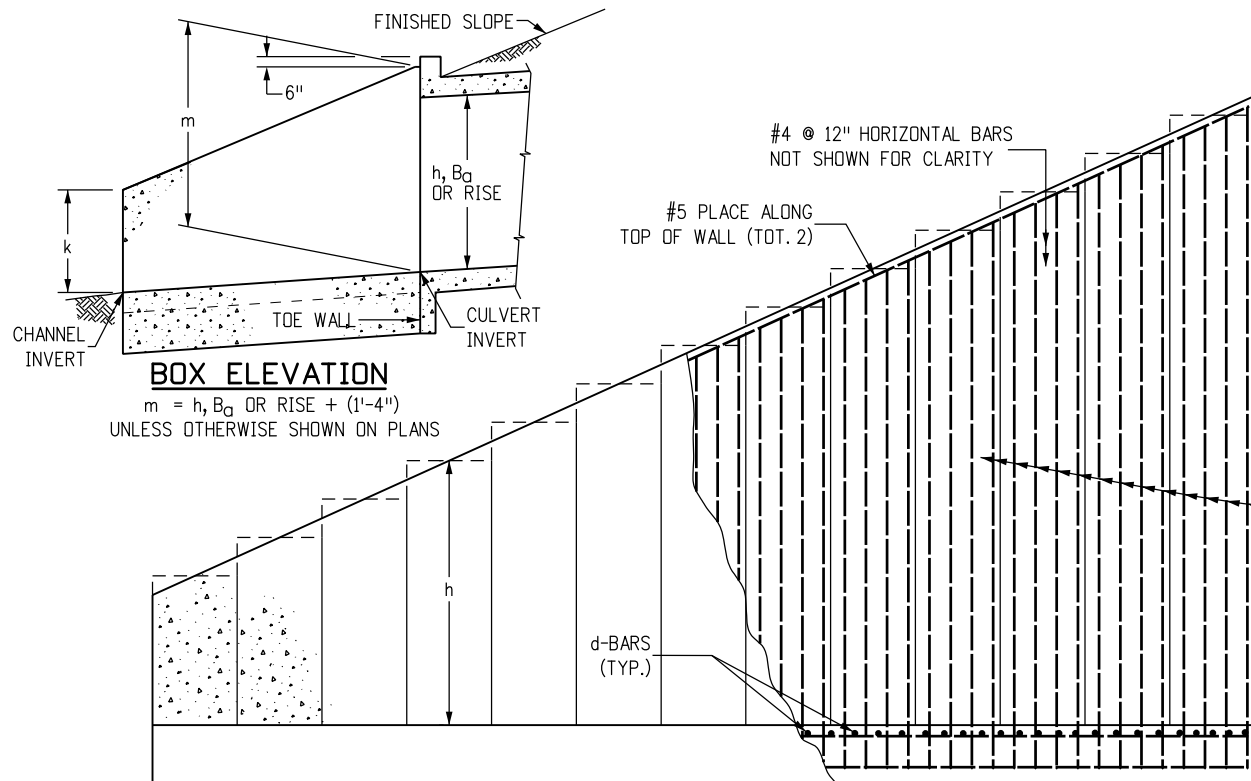


h =	2'	3'	4'	5'	6'	7'	8'	9'	10'	11'	12'	13'	14'
a =	1'-0"	1'-2"	1'-4"	1'-6"	1'-8"	1'-10"	2'-0"	2'-2"	2'-4"	2'-6"	2'-8"	2'-10"	3'-0"
b =	1'-8"	2'-0"	2'-4"	2'-8"	3'-0"	3'-4"	3'-8"	4'-0"	4'-4"	4'-8"	5'-0"	5'-4"	5'-8"
w =	2'-8"	3'-2"	3'-8"	4'-2"	4'-8"	5'-2"	5'-8"	6'-2"	6'-8"	7'-2"	7'-8"	8'-2"	8'-8"
d-BARS	#4 @ 9"	#4 @ 9"	#4 @ 9"	#4 @ 9"	#4 @ 9"	#4 @ 9"	#5 @ 11"	#5 @ 10"	#5 @ 10"	#5 @ 8"	#6 @ 8"	#7 @ 9"	#7 @ 7"
* CONC. CY/LF	0.161	0.210	0.259	0.309	0.358	0.407	0.457	0.506	0.556	0.605	0.654	0.704	0.753

* DOES NOT INCLUDE TOE WALL QUANTITIES
SEE SHEET 2 OF 2 FOR REINFORCING STEEL QUANTITY



■ REQUIRED DRAINAGE BEHIND WINGWALLS
SEE NOTE 6

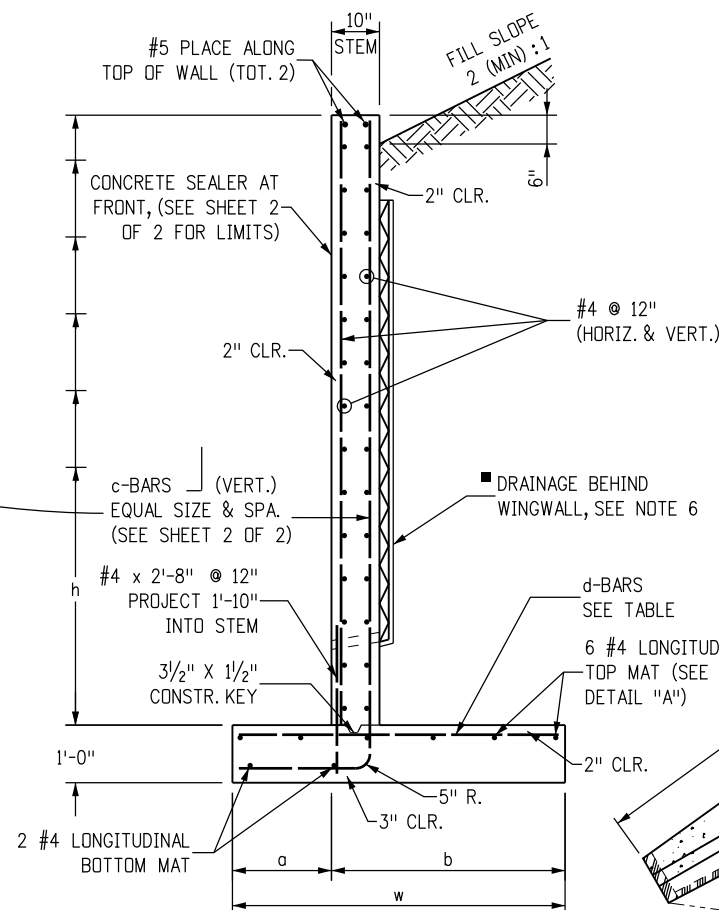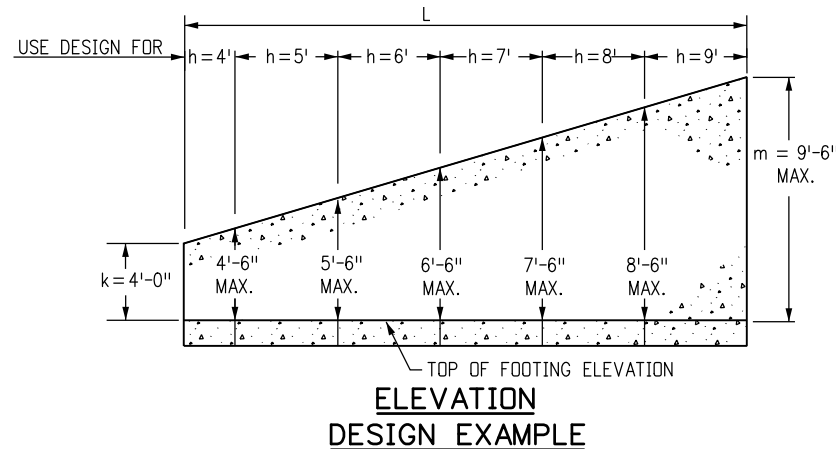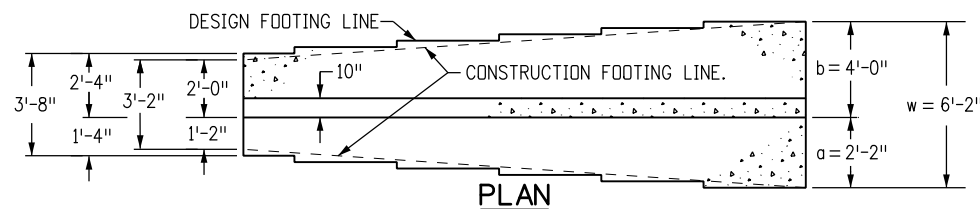

TYPICAL SECTION

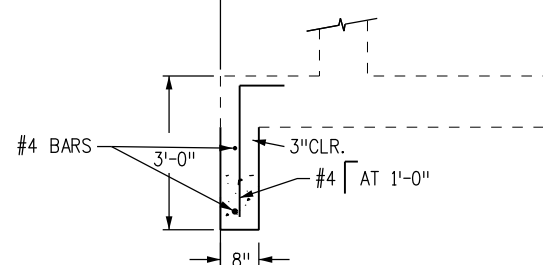

WITH TOE WALL

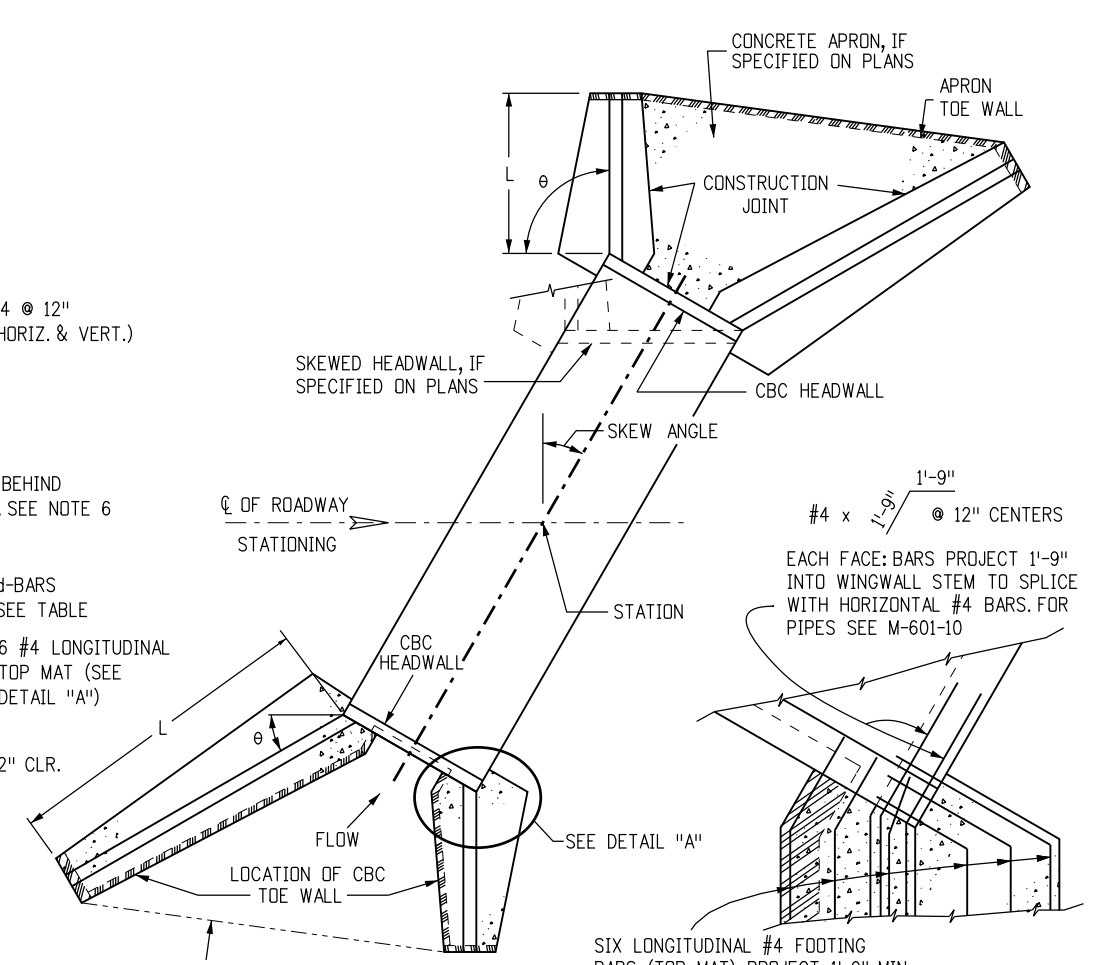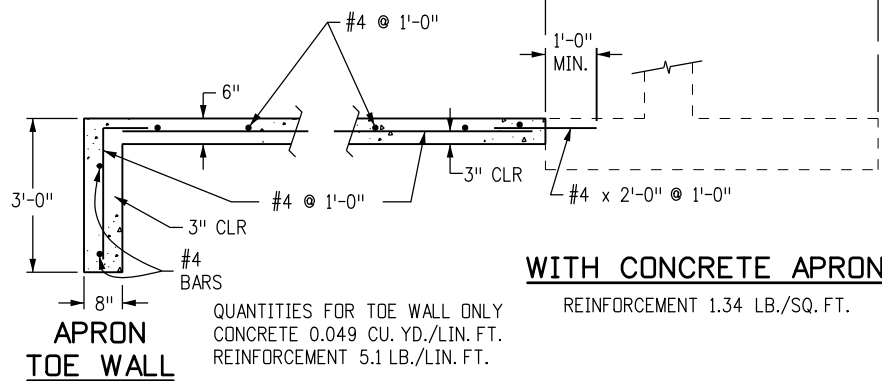

TYPICAL CULVERT LAYOUT

DETAIL "A"

DESIGN DATA:

AASHTO LRFD EIGHTH EDITION, 2017
DESIGN METHOD: LOAD AND RESISTANCE FACTOR DESIGN, YIELD LINE METHOD

REINFORCED CONCRETE:
CONCRETE CLASS D (BOX CULVERT): $f'_c = 4,500$ PSI
REINFORCING STEEL: $f_y = 60,000$ PSI

LOADING:
AT-REST EARTH (FLUID) PRESSURE FOR CONCRETE STEM DESIGN = 55 PCF FOR 2 (MIN.):1 SLOPED BACKFILL
ACTIVE EARTH (FLUID) PRESSURE FOR CONCRETE FOOTING DESIGN = 40 PCF FOR 2 (MIN.):1 SLOPED BACKFILL
LIVE LOAD SURCHARGE = 2'
MINIMUM RESISTANCE FOR SOIL BEARING = 5.5 KSF
SOIL BEARING RESISTANCE FACTOR = 0.45

GENERAL NOTES:

- ALL EXPOSED CONCRETE CORNERS SHALL BE CHAMFERED $\frac{3}{4}$ IN.
- WINGWALL FOOTING AND FLOOR OF BOX CULVERT SHALL BE PLACED MONOLITHICALLY.
- DIMENSIONS "h", "k", "L", "m" AND ANGLE "θ" FOR WINGWALL SHALL BE AS SHOWN ON THE PLANS.
- MINIMUM CLASS B LAP SPLICE LENGTH FOR BLACK REINFORCING BARS:

BAR SIZE:	#4	#5	#6	#7
SPLICE LENGTH:	1'-6"	1'-11"	2'-3"	2'-7"
- DESIGN DOES NOT CONSIDER ANY SCOUR EFFECTS.
- WINGWALL DRAIN SHALL BE REQUIRED IF "h" ≥ 12.0 FT., SEE SHEET 2 OF 2 FOR DETAILS.

Computer File Information		Sheet Revisions		Colorado Department of Transportation	WINGWALLS FOR PIPE OR BOX CULVERTS	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-601-20	
Designer Initials: JBK	(R-X)			2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868	Project Development Branch	Standard Sheet No. 1 of 2	
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:	
Detailer Initials: LTA	(R-X)					Issued by the Project Development Branch: July 31, 2019	
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						

c-BARS AND REINFORCING STEEL QUANTITY (EXCLUDE TOE WALL)

* REINFORCING STEEL QUANTITY INCLUDES STEM AND FOOTING QUANTITIES, BUT DOES NOT INCLUDE TOE WALL QUANTITIES.


L (MULTIPLE OF m)		≤ (1.0 x m)		≤ (1.25 x m)		≤ (1.5 x m)		≤ (1.75 x m)		≤ (2.0 x m)		≤ (2.25 x m)		≤ (2.5 x m)		≤ (2.75 x m)		≤ (3.0 x m)		≤ (3.25 x m)		≤ (3.5 x m)	
m (FT)	k (FT)	c-BARS	* REINF. LB./L.F.	c-BARS	* REINF. LB./L.F.	c-BARS	* REINF. LB./L.F.	c-BARS	* REINF. LB./L.F.	c-BARS	* REINF. LB./L.F.	c-BARS	* REINF. LB./L.F.	c-BARS	* REINF. LB./L.F.	c-BARS	* REINF. LB./L.F.	c-BARS	* REINF. LB./L.F.	c-BARS	* REINF. LB./L.F.	c-BARS	* REINF. LB./L.F.
14	4	#4 @ 10"	53.60	#5 @ 10"	57.95	#5 @ 10"	57.10	#5 @ 8"	60.22	#5 @ 7"	62.43	#5 @ 7"	62.09	#5 @ 6"	65.38	#5 @ 6"	65.15	#6 @ 8"	67.10	#6 @ 8"	66.94	#6 @ 7"	70.66
	5	#4 @ 10"	55.86	#5 @ 10"	60.46	#5 @ 10"	59.60	#5 @ 8"	62.89	#5 @ 7"	65.23	#5 @ 7"	64.88	#5 @ 6"	68.34	#5 @ 6"	68.11	#6 @ 8"	70.17	#6 @ 8"	70.00	#6 @ 7"	73.90
	6	#5 @ 10"	64.43	#6 @ 10"	70.60	#6 @ 10"	69.69	#6 @ 8"	74.93	#6 @ 8"	74.45	#6 @ 7"	78.30	#6 @ 6"	83.64	#6 @ 6"	83.40	#6 @ 6"	83.22	#6 @ 6"	83.05	#7 @ 7"	89.64
	7	#5 @ 10"	67.29	#6 @ 10"	73.76	#6 @ 10"	72.83	#6 @ 8"	78.32	#6 @ 8"	77.84	#6 @ 7"	81.87	#6 @ 6"	87.45	#6 @ 6"	87.21	#6 @ 6"	87.02	#6 @ 6"	86.86	#7 @ 7"	93.73
	8	#5 @ 8"	74.71	#6 @ 8"	83.46	#6 @ 7"	87.09	#6 @ 6"	92.54	#7 @ 7"	99.47	#7 @ 7"	99.08	#7 @ 6"	107.11	#7 @ 6"	106.86	#7 @ 6"	106.66	#7 @ 6"	106.49	#7 @ 6"	106.35
13	4	#4 @ 10"	50.51	#4 @ 10"	49.25	#5 @ 10"	53.71	#5 @ 10"	53.09	#5 @ 10"	52.36	#5 @ 9"	53.85	#5 @ 8"	55.54	#5 @ 7"	57.85	#5 @ 7"	57.67	#5 @ 7"	57.51	#6 @ 9"	59.93
	5	#4 @ 10"	52.66	#4 @ 10"	51.37	#5 @ 10"	56.09	#5 @ 10"	55.46	#5 @ 10"	54.99	#5 @ 9"	56.29	#5 @ 8"	58.08	#5 @ 7"	60.51	#5 @ 7"	60.33	#5 @ 7"	60.17	#6 @ 9"	62.72
	6	#4 @ 10"	54.92	#5 @ 10"	59.48	#5 @ 9"	60.31	#6 @ 9"	67.56	#6 @ 9"	67.08	#6 @ 9"	66.70	#6 @ 8"	69.53	#6 @ 8"	69.28	#6 @ 7"	73.12	#6 @ 7"	72.95	#6 @ 7"	72.81
	7	#4 @ 10"	57.36	#5 @ 10"	62.16	#5 @ 9"	63.05	#6 @ 9"	70.66	#6 @ 9"	70.16	#6 @ 9"	69.78	#6 @ 8"	72.75	#6 @ 8"	72.50	#6 @ 7"	76.52	#6 @ 7"	76.35	#6 @ 7"	76.20
	8	#5 @ 10"	66.39	#6 @ 10"	72.82	#6 @ 8"	77.97	#6 @ 7"	81.68	#6 @ 7"	81.19	#6 @ 6"	86.67	#6 @ 6"	86.37	#7 @ 7"	93.18	#7 @ 7"	92.97	#7 @ 7"	92.80	#7 @ 7"	92.64
12	2	#4 @ 10"	43.91	#4 @ 10"	42.65	#4 @ 10"	41.82	#4 @ 10"	41.22	#4 @ 10"	40.78	#4 @ 9"	41.29	#5 @ 10"	44.61	#5 @ 10"	44.37	#5 @ 10"	44.18	#5 @ 10"	44.01	#5 @ 10"	43.87
	3	#4 @ 10"	45.82	#4 @ 10"	44.55	#4 @ 10"	43.71	#4 @ 10"	43.11	#4 @ 10"	42.66	#4 @ 9"	43.22	#5 @ 10"	46.75	#5 @ 10"	46.51	#5 @ 10"	46.32	#5 @ 10"	46.15	#5 @ 10"	46.01
	4	#4 @ 10"	47.80	#4 @ 10"	46.51	#4 @ 10"	45.65	#5 @ 10"	50.06	#5 @ 10"	49.59	#5 @ 10"	49.23	#5 @ 10"	48.94	#5 @ 10"	48.69	#5 @ 9"	50.00	#5 @ 8"	51.72	#5 @ 8"	51.57
	5	#4 @ 10"	49.84	#4 @ 10"	48.53	#4 @ 10"	47.66	#5 @ 10"	52.33	#5 @ 10"	51.85	#5 @ 10"	51.48	#5 @ 10"	51.19	#5 @ 10"	50.94	#5 @ 9"	52.33	#5 @ 8"	54.14	#5 @ 8"	54.00
	6	#4 @ 10"	51.99	#4 @ 10"	50.65	#5 @ 10"	55.34	#5 @ 8"	58.41	#5 @ 8"	57.93	#6 @ 10"	60.60	#6 @ 10"	60.29	#6 @ 9"	62.42	#6 @ 9"	62.22	#6 @ 9"	62.04	#6 @ 8"	64.89
11	2	#4 @ 10"	41.70	#4 @ 10"	40.42	#4 @ 10"	39.57	#4 @ 10"	38.96	#4 @ 10"	38.50	#4 @ 10"	38.15	#4 @ 10"	37.87	#4 @ 10"	37.63	#4 @ 9"	38.25	#5 @ 10"	41.46	#5 @ 10"	41.31
	3	#4 @ 10"	43.57	#4 @ 10"	42.27	#4 @ 10"	41.40	#4 @ 10"	40.79	#4 @ 10"	40.33	#4 @ 10"	39.97	#4 @ 10"	39.69	#4 @ 10"	39.45	#4 @ 9"	40.12	#5 @ 10"	43.54	#5 @ 10"	43.39
	4	#4 @ 10"	45.48	#4 @ 10"	44.16	#4 @ 10"	43.28	#4 @ 10"	42.66	#4 @ 9"	43.09	#5 @ 10"	46.57	#5 @ 10"	46.27	#5 @ 10"	46.02	#5 @ 10"	45.82	#5 @ 10"	45.65	#5 @ 10"	45.50
	5	#4 @ 10"	47.46	#4 @ 10"	46.10	#4 @ 10"	45.21	#4 @ 10"	44.58	#4 @ 9"	45.06	#5 @ 10"	48.74	#5 @ 10"	48.44	#5 @ 10"	48.19	#5 @ 10"	47.99	#5 @ 10"	47.81	#5 @ 10"	47.67
	6	#4 @ 10"	49.52	#4 @ 10"	48.14	#4 @ 9"	48.23	#5 @ 10"	51.88	#5 @ 10"	51.38	#5 @ 9"	52.57	#5 @ 9"	52.27	#5 @ 8"	53.99	#5 @ 8"	53.79	#5 @ 7"	56.16	#5 @ 7"	56.01
10	2	#4 @ 10"	39.84	#4 @ 10"	38.53	#4 @ 10"	37.65	#4 @ 10"	37.03	#4 @ 10"	36.57	#4 @ 10"	36.20	#4 @ 10"	35.91	#4 @ 10"	35.67	#4 @ 10"	35.48	#4 @ 9"	36.07	#4 @ 9"	35.93
	3	#4 @ 10"	41.68	#4 @ 10"	40.35	#4 @ 10"	39.47	#4 @ 10"	38.84	#4 @ 10"	38.36	#4 @ 10"	38.00	#4 @ 10"	37.71	#4 @ 10"	37.46	#4 @ 10"	37.27	#4 @ 9"	37.91	#4 @ 9"	37.76
	4	#4 @ 10"	43.58	#4 @ 10"	42.22	#4 @ 10"	41.31	#4 @ 10"	40.67	#4 @ 10"	40.19	#4 @ 10"	39.82	#4 @ 10"	39.53	#4 @ 10"	39.28	#4 @ 10"	39.08	#4 @ 9"	39.77	#4 @ 9"	39.63
	5	#4 @ 10"	45.53	#4 @ 10"	44.14	#4 @ 10"	43.21	#4 @ 10"	42.56	#4 @ 10"	42.07	#5 @ 10"	46.44	#5 @ 10"	46.13	#5 @ 10"	45.87	#5 @ 10"	45.67	#5 @ 10"	45.49	#5 @ 10"	45.34
	6	#4 @ 10"	47.58	#4 @ 10"	46.14	#4 @ 10"	45.20	#4 @ 10"	44.53	#4 @ 10"	44.03	#5 @ 10"	48.67	#5 @ 10"	48.35	#5 @ 10"	48.08	#5 @ 10"	47.88	#5 @ 10"	47.69	#5 @ 10"	47.54
9	2	#4 @ 10"	38.01	#4 @ 10"	36.75	#4 @ 10"	35.85	#4 @ 10"	35.21	#4 @ 10"	34.73	#4 @ 10"	34.36	#4 @ 10"	34.06	#4 @ 10"	33.81	#4 @ 10"	33.61	#4 @ 10"	33.44	#4 @ 10"	33.30
	3	#4 @ 10"	39.93	#4 @ 10"	38.56	#4 @ 10"	37.64	#4 @ 10"	36.99	#4 @ 10"	36.51	#4 @ 10"	36.13	#4 @ 10"	35.83	#4 @ 10"	35.58	#4 @ 10"	35.38	#4 @ 10"	35.21	#4 @ 10"	35.06
	4	#4 @ 10"	41.81	#4 @ 10"	40.40	#4 @ 10"	39.47	#4 @ 10"	38.81	#4 @ 10"	38.31	#4 @ 10"	37.93	#4 @ 10"	37.63	#4 @ 10"	37.37	#4 @ 10"	37.17	#4 @ 10"	36.99	#4 @ 10"	36.84
	5	#4 @ 10"	43.75	#4 @ 10"	42.30	#4 @ 10"	41.35	#4 @ 10"	40.67	#4 @ 10"	40.17	#4 @ 10"	39.78	#4 @ 10"	39.47	#4 @ 10"	39.20	#4 @ 9"	39.86	#5 @ 10"	43.28	#5 @ 10"	43.12
	6	#4 @ 10"	45.79	#4 @ 10"	44.30	#4 @ 10"	43.31	#4 @ 10"	42.62	#4 @ 10"	42.10	#4 @ 10"	41.71	#4 @ 10"	41.39	#4 @ 10"	41.12	#4 @ 9"	41.82	#5 @ 10"	45.46	#5 @ 10"	45.30
8	2	#4 @ 10"	36.41	#4 @ 10"	35.01	#4 @ 10"	34.08	#4 @ 10"	33.42	#4 @ 10"	32.92	#4 @ 10"	32.54	#4 @ 10"	32.23	#4 @ 10"	31.97	#4 @ 10"	31.77	#4 @ 10"	31.59	#4 @ 10"	31.44
	3	#4 @ 10"	38.23	#4 @ 10"	36.80	#4 @ 10"	35.85	#4 @ 10"	35.18	#4 @ 10"	34.67	#4 @ 10"	34.28	#4 @ 10"	33.97	#4 @ 10"	33.70	#4 @ 10"	33.50	#4 @ 10"	33.32	#4 @ 10"	33.17
	4	#4 @ 10"	40.09	#4 @ 10"	38.61	#4 @ 10"	37.64	#4 @ 10"	36.95	#4 @ 10"	36.44	#4 @ 10"	36.04	#4 @ 10"	35.72	#4 @ 10"	35.45	#4 @ 10"	35.25	#4 @ 10"	35.07	#4 @ 10"	34.91
	5	#4 @ 10"	41.99	#4 @ 10"	40.47	#4 @ 10"	39.47	#4 @ 10"	38.76	#4 @ 10"	38.24	#4 @ 10"	37.83	#4 @ 10"	37.50	#4 @ 10"	37.23	#4 @ 10"	37.02	#4 @ 10"	36.84	#4 @ 10"	36.68
	6	#4 @ 10"	43.97	#4 @ 10"	42.40	#4 @ 10"	41.36	#4 @ 10"	40.64	#4 @ 10"	40.10	#4 @ 10"	39.68	#4 @ 10"	39.35	#4 @ 10"	39.07	#4 @ 9"	43.33	#5 @ 10"	43.13	#5 @ 10"	42.96
7	2	#4 @ 10"	34.90	#4 @ 10"	33.44	#4 @ 10"	32.47	#4 @ 10"	31.78	#4 @ 10"	31.27	#4 @ 10"	30.86	#4 @ 10"	30.54	#4 @ 10"	30.27	#4 @ 10"	30.06	#4 @ 10"	29.88	#4 @ 10"	29.72
	3	#4 @ 10"	36.73	#4 @ 10"	35.23	#4 @ 10"	34.23	#4 @ 10"	33.53	#4 @ 10"	33.00	#4 @ 10"	32.59	#4 @ 10"	32.26	#4 @ 10"	31.99	#4 @ 10"	31.78	#4 @ 10"	31.59	#4 @ 10"	31.43
	4	#4 @ 10"	38.59	#4 @ 10"	37.04	#4 @ 10"	36.01	#4 @ 10"	35.29	#4 @ 10"	34.75	#4 @ 10"	34.33	#4 @ 10"	33.99	#4 @ 10"	33.71	#4 @ 10"	33.50	#4 @ 10"	33.31	#4 @ 10"	33.14
	5	#4 @ 10"	40.48	#4 @ 10"	38.86	#4 @ 10"	37.80	#4 @ 10"	37.06	#4 @ 10"	36.50	#4 @ 10"	36.07	#4 @ 10"	35.73	#4 @ 10"	35.44	#4 @ 10"	35.22	#4 @ 10"	35.03	#4 @ 10"	34.86
	6	#4 @ 10"	42.39	#4 @ 10"	40.71	#4 @ 10"	39.61	#4 @ 10"	38.84	#4 @ 10"	38.26	#4 @ 10"	37.82	#4 @ 10"	37.47	#4 @ 10"	37.17	#4 @ 10"	36.95	#4 @ 10"	36.75	#4 @ 10"	36.58

EXAMPLE:

SELECT THE c-BARS SIZE, SPACING AND STEEL QUANTITY FOR A 25.0 FEET LONG WINGWALL WITH m = 11.8 FT. AND k = 6.3 FT.

SOLUTION:


1. DETERMINE WINGWALL LENGTH IN MULTIPLE OF m:
L / m = 25.0 / 11.8 = 2.12
L = (2.12 x m), USE L ≤ (2.25 x m)
2. ROUND TO REAREST WHOLE NUMBER FOR m AND k:
m = 11.8 FT., USE m = 12.0 FT.
k = 6.3 FT., USE k = 6.0 FT.
3. DETERMINE c-BARS BY USING THE TABLE:
L ≤ (2.25 x m)
m = 12
k = 6
c-BARS: #6 @ 10"
REINF. STEEL = 60.60 LB / LF
4. DETERMINE REINFORCING STEEL QUANTITY OF WHOLE WINGWALL:
REINFORCING STEEL QUANTITY = 25.0 x 60.60 = 1,515 LB.

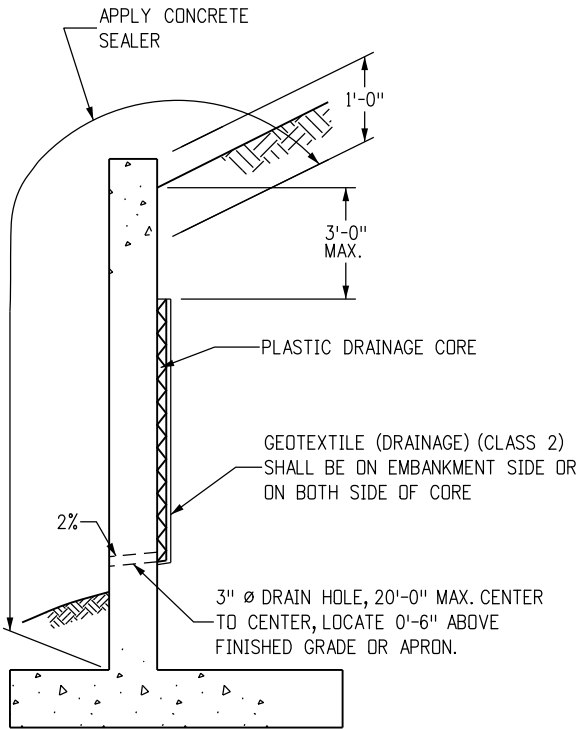


LIMITS OF CONCRETE SEALER AND WINGWALL DRAIN DETAILS

- NOTES: 1. THE GEOCOMPOSITE SHALL BE SECURED TO THE WALL TO PREVENT MOVEMENT DURING BACKFILLING.
2. COST OF GEOCOMPOSITE DRAIN AND CONCRETE SEALER SHALL BE INCLUDED IN THE WORK.

Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		 Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	WINGWALLS FOR PIPE OR BOX CULVERTS	STANDARD PLAN NO.	
Creation Date: 07/31/19			Date:	Comments			M-601-20	
Designer Initials: JBK							Standard Sheet No. 2 of 2	
Last Modification Date: 07/31/19							Project Sheet Number:	
Detailer Initials: LTA								
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English								

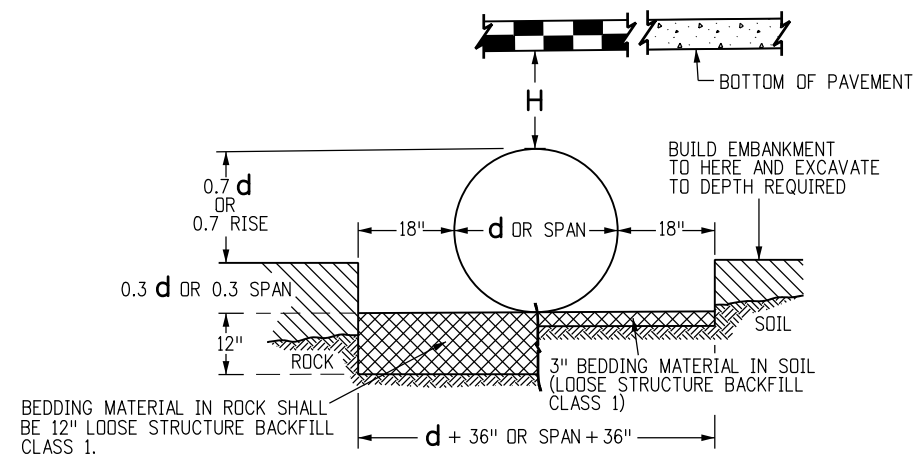


INSTALLATION OF METAL PIPE

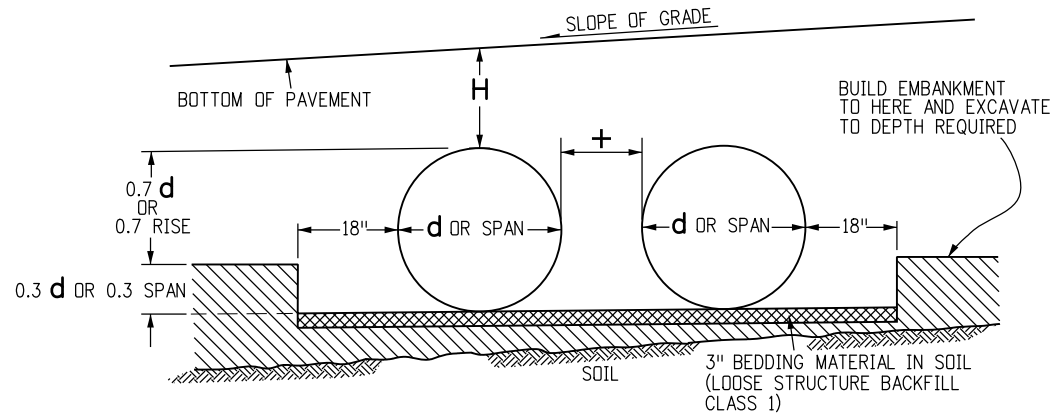

INSTALLATION OF MULTIPLE METAL PIPES


	MINIMUM COVER (IN.) FOR INDICATED AXLE LOADS, kips			
PIPE SPAN (IN.)	18.0 - 50.0	50.0 - 75.0	75.0 - 110.0	110.0 - 150.0
12.0 - 42.0	24	30	36	36
48.0 - 72.0	36	36	42	48
78.0 - 120.0	36	42	48	48
126.0 - 144.0	42	48	54	54

MINIMUM COVER FOR CONSTRUCTION LOADS

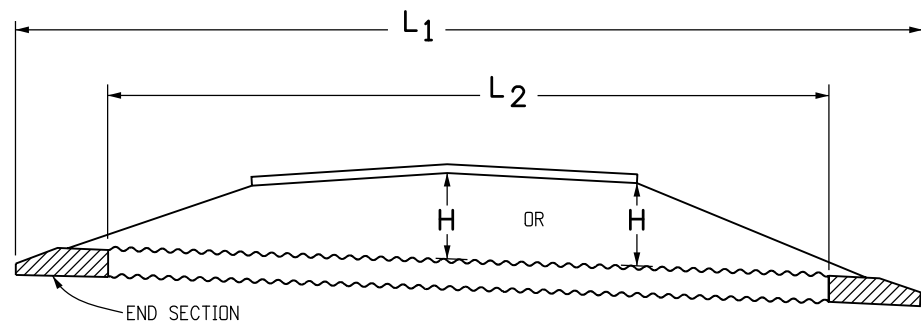


METAL PIPE WITH END SECTIONS

NOTE: USE THE **H** THAT IS GREATER FOR MAXIMUM ALLOWABLE FILL HEIGHT.

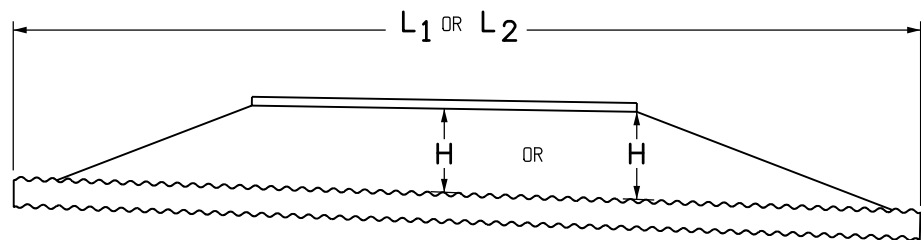

METAL PIPE WITHOUT END SECTIONS

NOTE: USE THE **H** THAT IS GREATER FOR MAXIMUM ALLOWABLE FILL HEIGHT.

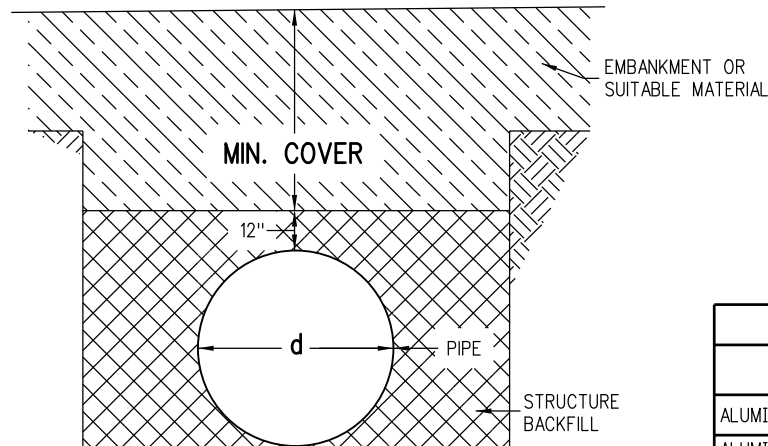

CONSTRUCTION MINIMUM COVER FOR PIPE

GENERAL NOTES

- STEEL PIPES SHALL CONFORM TO THE REQUIREMENTS OF AASHTO M36. ALUMINUM PIPES SHALL CONFORM TO THE REQUIREMENTS OF AASHTO M196. ALUMINIZED STEEL SHALL CONFORM TO THE REQUIREMENTS OF AASHTO M274.
- MINIMUM COVER SHALL BE PROVIDED DURING CONSTRUCTION TO PROTECT THE STRUCTURE FROM DAMAGE.
- PIPE SHALL BE PLACED WITH LONGITUDINAL SEAMS AT THE SIDES OR QUARTER POINTS BUT NOT ALONG TOP OF VERTICAL AXIS.
- STRUCTURAL PLATE PIPES OF EQUAL OR GREATER DIAMETER THAT CONFORM TO SECTION 510 MAY BE SUBSTITUTED FOR THE PIPES ON THESE SHEETS AT THE CONTRACTOR'S EXPENSE.
- WHEN A PIPE IS TO BE EXTENDED, THE SAME PIPE MATERIAL AND SIZE AS IN THE ORIGINAL INSTALLATION SHALL BE USED.
- EXTENSIONS FOR CMP ARCH PIPE SHALL MATCH THE CORRUGATIONS, AND THE SPAN AND RISE DIMENSIONS OF THE PIPE TO BE EXTENDED.
- WHEN INSTALLING A GUARDRAIL OR A SIGN POST DIRECTLY ABOVE A PIPE, THE BOTTOM OF THE POST MUST BE AT LEAST 1 FOOT ABOVE THE TOP OF THE PIPE. THE HOLE FOR THE POST SHALL BE DRILLED INTO THE SOIL.
- PIPE ARCH WITH EQUAL PERIPHERY AND WITH SPAN AND RISE DIMENSIONS APPROXIMATELY EQUAL TO THOSE SPECIFIED ON THE PLANS WILL BE PERMITTED.
- PIPE ARCH IS INTENDED FOR USE WHERE MINIMUM COVER REQUIREMENTS FOR ROUND PIPE CANNOT BE MET. WHEN COVER EXCEEDS 11 FT. USE ROUND PIPE.
- PIPE COVER GREATER THAN 90 FT. SHALL REQUIRE AN INVESTIGATION OF THE FOUNDATION MATERIAL.

LEGEND

H = THE MAXIMUM ALLOWABLE HEIGHTS OF FILL OVER THE TOP OF THE PIPE, EXCLUDING PAVEMENT THICKNESS, ARE SHOWN IN THE TABLES OF THIS STANDARD.

THE MINIMUM COVER SHALL BE AS SHOWN ON THESE TABLES OR CONFORM TO AASHTO REQUIREMENTS, WHICHEVER IS GREATER.

THE MINIMUM COVER FOR PIPE IS MEASURED FROM THE TOP OF THE PIPE TO THE BOTTOM OF THE PAVEMENT: HMA OR PCCP.

THE MINIMUM COVER IS MEASURED FROM THE TOP OF THE PIPE TO THE TOP OF THE SUBGRADE FOR CONSTRUCTION LOADS.

L1 = LENGTH OF PIPE TO BE MEASURED WHEN PLACED IN ACCORDANCE WITH SECTION 624.

L2 = LENGTH OF PIPE TO BE MEASURED WHEN PLACED IN ACCORDANCE WITH SECTION 603.

+ = THE MINIMUM SPACING BETWEEN THE OUTSIDE WALLS OF MULTIPLE PIPES OR END SECTIONS IS 18" OR $\frac{1}{2}$ **d**, WHICHEVER IS GREATER, BUT NOT TO EXCEED 36".

CONVERSION OF NOMINAL GAGE TO THICKNESS

GAGE NO.	16	14	12	10	8
ALUMINUM THICKNESS - IN.	0.060	0.075	0.105	0.135	0.164
ALUMINIZED OR GALVANIZED STEEL THICKNESS - IN.	0.064	0.079	0.109	0.138	0.168

ALLOWED WALL THICKNESS

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

(R-X)
(R-X)
(R-X)
(R-X)

Sheet Revisions

Date:	Comments

Colorado Department of Transportation

2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch

JBK

METAL PIPE

Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.

M-603-1

Standard Sheet No. 1 of 4

Project Sheet Number:

THESE TABLES ARE APPLICABLE FOR THE FOLLOWING LIST OF CORRUGATED STEEL PIPE:
1. GALVANIZED CORRUGATED STEEL PIPE (CSP)
2. ALUMINIZED CORRUGATED STEEL PIPE TYPE 2 (ALT2 CSP)
3. BITUMINOUS COATED CORRUGATED STEEL PIPE (BIT. CO. CSP)
4. ARAMID FIBER BONDED CORRUGATED STEEL PIPE (A.F. BD. CSP)
5. PRECOATED CORRUGATED STEEL PIPE (PCSP- BOTH SIDES)

DIAMETER (IN.)	H MINIMUM COVER (IN.)	PIPE GAGE				
		H MAXIMUM OF COVER (FT.)				
		16	14	12	10	8
12	24	207	259			
15	24	165	207			
18	24	138	172	242		
21	24	118	148	207		
24	24	103	129	181		
30	24	82	103	145		
36	24	68	86	120	155	
42	24	58	73	103	133	163
48	36	51	64	90	103	142
54	36		57	80	93	126
60	36			72	84	114
66	36				77	103
72	36					94
78	36					84
84	36					72

2-2⅓" X ½" CORRUGATIONS
CORRUGATED STEEL PIPE

DIAMETER (IN.)	H MINIMUM COVER (IN.)	PIPE GAGE	
		H MAXIMUM OF COVER (FT.)	
		16	14
6	24	408	509
8	24	306	382
10	24	244	305

1-½" X ¼" CORRUGATIONS
CORRUGATED STEEL PIPE

DIAMETER (IN.)	H MINIMUM COVER (IN.)	PIPE GAGE				
		H MAXIMUM OF COVER (FT.)				
		16	14	12	10	8
48	36	59	74	104	134	164
54	36	52	65	92	119	146
60	36	47	59	83	107	131
66	36	42	53	75	97	119
72	36	39	49	69	89	109
78	36		45	63	82	101
84	36		42	59	76	93
90	36			55	71	87
96	36			51	66	81
102	36			48	62	77
108	36				59	72
114	36				56	68
120	36				53	65
126	42					62

3" X 1" CORRUGATIONS
CORRUGATED STEEL PIPE

SPAN X RISE (IN. X IN.)	ROUND EQUIVALENT (IN.)	H MINIMUM COVER (IN.)	PIPE GAGE	H MAXIMUM COVER (FT.)
17 X 13	15	24	16	13
21 X 15	18	24	16	12
24 X 18	21	24	16	13
28 X 20	24	24	16	12
35 X 24	30	24	16	12
42 X 29	36	24	16	12
49 X 33	42	24	14	12
57 X 38	48	36	12	12
64 X 43	54	36	12	12
71 X 47	60	36	10	12
77 X 52	66	36	8	12
83 X 57	72	36	8	12

2-2⅓" X ½" CORRUGATIONS *
CORRUGATED STEEL PIPE ARCH

* CORNER BEARING PRESSURE OF 2 TONS PER SQ. FT.

SPAN X RISE (IN. X IN.)	ROUND EQUIVALENT (IN.)	H MINIMUM COVER (IN.)	PIPE GAGE	H MAXIMUM COVER (FT.)
53 X 41	48	36	14	12
60 X 46	54	36	14	20
66 X 51	60	36	14	20
73 X 55	66	36	14	20
81 X 59	72	36	14	17
87 X 63	78	36	14	16
95 X 67	84	36	14	16
103 X 71	90	36	12	16
112 X 75	96	36	12	16
117 X 79	102	36	12	16

3" X 1" CORRUGATIONS *
CORRUGATED STEEL PIPE ARCH

DIAMETER (IN.)	H MINIMUM COVER (IN.)	PIPE GAGE				
		H MAXIMUM OF COVER (FT.)				
		16	14	12	10	8
54	36	46	58	82	106	129
60	36		52	74	95	116
66	36		47	66	86	106
72	36			61	79	97
78	36			56	73	89
84	36			53	68	83
90	36				63	77
96	36				59	72
102	36				55	68
108	36					64

5" X 1" CORRUGATIONS
CORRUGATED STEEL PIPE

DIAMETER (IN.)	H MINIMUM COVER (IN.)	PIPE GAGE			
		H MAXIMUM OF COVER (FT.)			
		16	14	12	10
18	24	90	126		
21	24	77	108	181	
24	24	67	95	158	
30	24	54	75	126	
36	24	45	63	105	
42	24	38	54	90	
48	36	33	47	78	114
54	36	29	41	70	101
60	36		37	63	91
66	36		34	57	83
72	36			52	76
78	36			48	70
84	36			44	65
90	36				60
96	36				56
102	36				50

¾" X ¾ 7-½" CORRUGATIONS
CORRUGATED STEEL PIPE

THESE TABLES ARE APPLICABLE FOR THE FOLLOWING LIST
OF CORRUGATED STEEL PIPE:
1. GALVANIZED CORRUGATED STEEL PIPE (CSP)
2. ALUMINIZED CORRUGATED STEEL PIPE TYPE 2 (ALT2 CSP)
3. BITUMINOUS COATED CORRUGATED STEEL PIPE (BIT. CO. CSP)
4. ARAMID FIBER BONDED CORRUGATED STEEL PIPE (A.F. BO. CSP)
5. PRECOATED CORRUGATED STEEL PIPE (PCSP- BOTH SIDES)

SPAN X RISE (IN. X IN.)	ROUND EQUIVALENT (IN.)	H MINIMUM COVER (IN.)	PIPE GAGE	H MAXIMUM COVER (FT.)
81 X 59	72	36	12	17
87 X 63	78	36	12	16
95 X 67	84	36	12	16

5" X 1" CORRUGATIONS
CORRUGATED STEEL PIPE ARCH *

* CORNER BEARING PRESSURE OF 2 TONS PER SQ. FT.

SPAN X RISE (IN. X IN.)	ROUND EQUIVALENT (IN.)	H MINIMUM COVER (IN.)	PIPE GAGE	H MAXIMUM COVER (FT.)
20 X 16	18	24	16	16
23 X 19	21	24	16	15
27 X 21	24	24	16	13
33 X 26	30	24	16	13
40 X 31	36	24	16	14
46 X 36	42	24	12	13
53 X 41	48	36	12	13
60 X 46	54	36	12	20
66 X 51	60	36	12	20

¾" X ¾ 7-½" CORRUGATIONS
CORRUGATED STEEL PIPE ARCH *

Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	METAL PIPE	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)	Date:	Comments			M-603-1	
Designer Initials: JBK						Standard Sheet No. 3 of 4	
Last Modification Date: 07/31/19						Project Sheet Number:	
Detailer Initials: LTA					Issued by the Project Development Branch: July 31, 2019		
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English							

DIAMETER (IN.)	H MINIMUM COVER (IN.)	PIPE GAGE
		H MAXIMUM OF COVER (FT.)
		16
6	24	247
8	24	185
10	24	148

1-½" X ¼" CORRUGATIONS
CORRUGATED ALUMINUM PIPE

DIAMETER (IN.)	H MINIMUM COVER (IN.)	PIPE GAGE				
		H MAXIMUM OF COVER (FT.)				
		16	14	12	10	
18	24	43	61			
21	24	38	52	84		
24	24	33	45	73		
30	24	26	36	58		
36	24	21	30	49	69	
42	24		25	41	59	
48	36			36	51	
54	36			32	46	
60	36			29	41	
66	36				37	
72	36				34	

¾" X ¾" 7-½" CORRUGATIONS
CORRUGATED ALUMINUM PIPE

SPAN X RISE (IN. X IN.)	ROUND EQUIVALENT (IN.)	H MINIMUM COVER (IN.)	PIPE GAGE			
			H MAXIMUM OF COVER (FT.)			
			16	14	12	10
20 X 16	18	24	16			
23 X 19	21	24	15			
27 X 21	24	24	13	13		
33 X 26	30	24	13	13	13	
40 X 31	36	24		13	13	
46 X 36	42	24			13	13
53 X 41	48	36			13	13
60 X 46	54	36			20	20
66 X 51	60	36				20

¾" X ¾" 7-½" CORRUGATIONS
CORRUGATED ALUMINUM PIPE ARCH *

THESE TABLES ARE APPLICABLE FOR THE FOLLOWING LIST
OF CORRUGATED STEEL PIPE:
1. GALVANIZED CORRUGATED STEEL PIPE (CSP)
2. ALUMINIZED CORRUGATED STEEL PIPE TYPE 2 (ALT2 CSP)
3. BITUMINOUS COATED CORRUGATED STEEL PIPE (BIT. CO. CSP)
4. ARAMID FIBER BONDED CORRUGATED STEEL PIPE (A.F. BO. CSP)
5. PRECOATED CORRUGATED STEEL PIPE (PCSP- BOTH SIDES)

DIAMETER (IN.)	H MINIMUM COVER (IN.)	PIPE GAGE				
		H MAXIMUM OF COVER (FT.)				
		16	14	12	10	8
12	24	125	157			
15	24	100	125			
18	24	83	104			
21	24	71	89			
24	24	62	78	109		
27	24		69	97		
30	24		62	87		
36	24		51	73	94	
42	24			62	80	
48	36			54	70	85
54	36			48	62	76
60	36				52	64
66	36					52
72	36					43

2-⅔" X ½" CORRUGATIONS
CORRUGATED ALUMINUM PIPE

SPAN X RISE (IN. X IN.)	ROUND EQUIVALENT (IN.)	H MINIMUM COVER (IN.)	PIPE GAGE	H MAXIMUM COVER (FT.)
17 X 13	15	24	16	13
21 X 15	18	24	16	12
24 X 18	21	24	16	13
28 X 20	24	24	16	12
35 X 24	30	24	16	12
42 X 29	36	24	16	12
49 X 33	42	24	14	12
57 X 38	48	36	12	12
64 X 43	54	36	12	12
71 X 47	60	36	10	12

2-⅔" X ½" CORRUGATIONS
CORRUGATED ALUMINUM PIPE ARCH *

* CORNER BEARING PRESSURE OF 2 TONS PER SQ. FT.


DIAMETER (IN.)	H MINIMUM COVER (IN.)	PIPE GAGE				
		H MAXIMUM OF COVER (FT.)				
		16	14	12	10	8
30	24	57	72	101	135	159
36	24	47	60	84	112	132
42	24	40	51	72	96	113
48	36	35	44	62	84	99
54	36	31	39	55	74	88
60	36	28	35	50	67	79
66	36	25	32	45	61	72
72	36	23	29	41	56	66
78	36		27	38	51	61
84	36			35	48	56
90	36			33	44	52
96	36			31	41	49
102	36				39	46
108	36				37	43
114	36					39
120	36					36

3" X 1" CORRUGATIONS
CORRUGATED ALUMINUM PIPE

SPAN X RISE (IN. X IN.)	ROUND EQUIVALENT (IN.)	H MINIMUM COVER (IN.)	PIPE GAGE	H MAXIMUM COVER (FT.)
60 X 46	54	36	14	20
66 X 51	60	36	14	20
73 X 55	66	36	14	20
81 X 59	72	36	12	16
87 X 63	78	36	12	16
95 X 67	84	36	12	16
103 X 71	90	36	10	16
112 X 75	96	36	8	16

3" X 1" CORRUGATIONS
CORRUGATED ALUMINUM PIPE ARCH *

Computer File Information		Sheet Revisions			Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	METAL PIPE	STANDARD PLAN NO.	
Creation Date: 07/31/19		Date:	Comments				M-603-1	
Designer Initials: JBK		(R-X)					Standard Sheet No. 4 of 4	
Last Modification Date: 07/31/19		(R-X)					Project Sheet Number:	
Detailer Initials: LTA		(R-X)				Issued by the Project Development Branch: July 31, 2019		
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English		(R-X)						

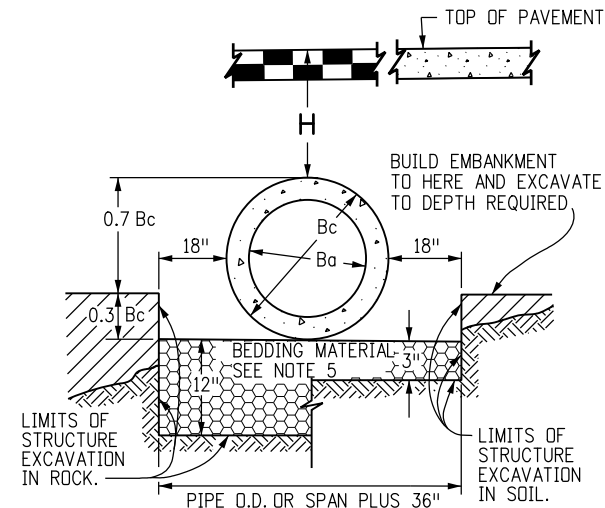


NOTE: Bc IS THE OUTSIDE DIMENSION FOR DIAMETER, SPAN OR RISE.

PIPE INSTALLATION
(WITH 0.7 PROJECTION RATIO)

CIRCULAR (CIR)			VERTICAL ELLIPTICAL (VE)				HORIZONTAL ELLIPTICAL (HE)			
PIPE SIZE= <i>Ba</i> (INSIDE DIA)	WALL THICKNESS	0.3 <i>Bc</i> (OUTSIDE DIA)	SPAN	RISE	WALL THICKNESS	0.3 OUTSIDE RISE	SPAN	RISE	WALL THICKNESS	0.3 OUTSIDE RISE
IN.		FT.	IN.			FT.	IN.			FT.
12 15 18	2 2-1/4 2-1/2	0.40 0.49 0.58					23	14	2-3/4	0.49
21 24 27	2-3/4 3 3-1/4	0.66 0.75 0.84					30 34	19 22	3-1/4 3-1/2	0.66 0.73
30 33 36	3-1/2 3-3/4 4	0.92 1.01 1.10	29	45	4-1/2	1.35	38	24	3-3/4	0.79
42 48	4-1/2 5	1.28 1.45	34 38	53 60	5 5-1/2	1.58 1.78	45	29	4-1/2	0.95
54 60 66	5-1/2 6 6-1/2	1.62 1.80 1.97	43 48 53	68 76 83	6 6-1/2 7	2.00 2.23 2.43	53 60	34 38	5 5-1/2	1.10 1.23
72 78 84	7 7-1/2 8	2.15 2.32 2.50	58 63 68	91 98 106	7-1/2 8 8-1/2	2.65 2.85 3.08	68 76 83	43 48 53	6 6-1/2 7	1.38 1.53 1.68
90 96	8-1/2 9	2.68 2.85	72 77	113 121	9 9-1/2	3.28 3.50	91 98 106	58 63 68	7-1/2 8 8-1/2	1.83 1.98 2.13
102 108	9-1/2 10	3.02 3.20	82 87	128 136	9-3/4 10	3.69 3.90	113 121 136	72 77 87	9 9-1/2 10	2.25 2.40 2.68

△ ALSO EQUIVALENT ROUND DIMENSION FOR ELLIPTICAL PIPE.


DIMENSIONS FOR REINFORCED CONCRETE PIPE
(FOR INFORMATION ONLY)

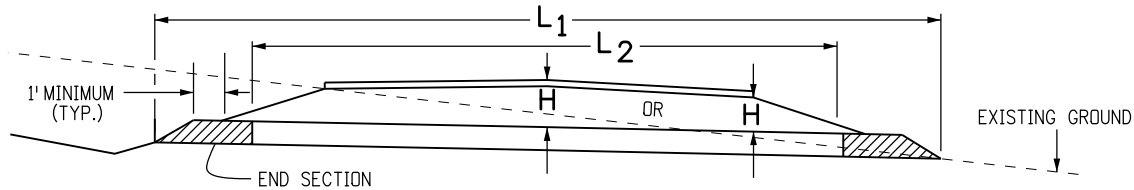

CONCRETE PIPE WITH END SECTIONS


NOTE: USE THE **H** THAT IS GREATER FOR MAXIMUM ALLOWABLE FILL HEIGHT.

- H** = HEIGHT OF FILL OVER TOP OF PIPE, INCLUDING PAVEMENT THICKNESS.
L₁ = LENGTH OF PIPE TO BE MEASURED WHEN PLACED IN ACCORDANCE WITH SECTION 624.
L₂ = LENGTH OF PIPE TO BE MEASURED WHEN PLACED IN ACCORDANCE WITH SECTION 603.

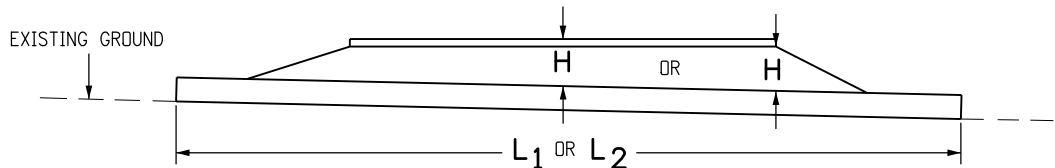

CONCRETE PIPE WITHOUT END SECTIONS

NOTE: USE THE **H** THAT IS GREATER FOR MAXIMUM ALLOWABLE FILL HEIGHT.

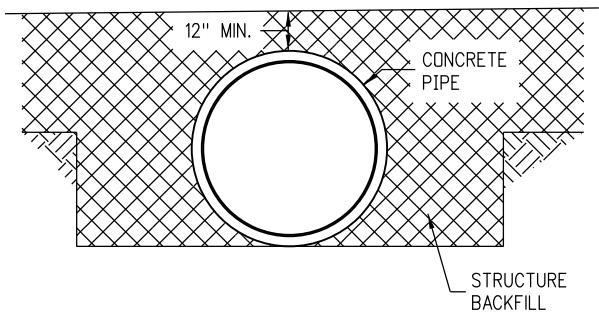

**CONSTRUCTION
MINIMUM COVER FOR RIGID PIPE**

TYPE OF PIPE	HEIGHT OF FILL OVER TOP OF PIPE, H (FEET)				
	CLASS OF PIPE (0.01 IN. CRACK D-LOAD)				
	CLASS CIR II CLASS VE II CLASS HE II	CLASS CIR III CLASS VE III CLASS HE III	CLASS CIR IV CLASS VE IV CLASS HE IV	CLASS CIR V CLASS VE V	CLASS VE VI
	1000 D	1350 D	2000 D	3000 D	4000 D
CIRCULAR (CIR)	1 TO 18	1 TO 25	± 25 TO 37	± 37 TO 45	
VERTICAL ELLIPTICAL (VE)	1 TO 18	1 TO 25	± 25 TO 37	± 37 TO 45	± 45 TO 62
HORIZONTAL ELLIPTICAL (HE)	1 TO 18	1 TO 25	± 25 TO 37		

**ALLOWABLE RANGE OF HEIGHTS FOR FILL
OVER REINFORCED CONCRETE PIPE**

(ALL SIZES)

GENERAL NOTES


REINFORCED CONCRETE PIPE

- FILL HEIGHTS GREATER THAN MAXIMUM ALLOWED IN THE HEIGHTS OF FILL TABLE ON THIS SHEET REQUIRE SPECIAL DESIGN OF STRUCTURE.
- PIPE DESIGN IS BASED ON SAFETY FACTOR OF 1.33 ON ULTIMATE STRENGTH.
- THE HEIGHTS OF FILL OVER TOP OF PIPE ARE BASED ON UNIT WEIGHT OF SOIL AT 135 LBS. PER CUBIC FT.
- PIPE CLASS IS DETERMINED FROM 0.01 IN. CRACK D-LOAD.
- BEDDING IS CLASS B (MODIFIED) (FROM CONCRETE PIPE DESIGN MANUAL-AMERICAN CONCRETE PIPE ASSOCIATION) WITH SETTLEMENT RATIO $R = 0.0 s_d$ (YIELDING BED). BEDDING MATERIAL FOR RIGID PIPE IN SOIL SHALL BE 3 IN. LOOSE THICKNESS STRUCTURE BACKFILL CLASS 2. BEDDING MATERIAL FOR RIGID PIPE IN ROCK SHALL BE 12 IN. LOOSE THICKNESS STRUCTURE BACKFILL CLASS 1.
- CHANGES IN DESIGN FACTORS REQUIRE COMPENSATING CHANGES IN PIPE DESIGN.
- MINIMUM WALL THICKNESS DIMENSIONS ARE BASED ON AASHTO M 170 (WALL B) FOR CIRCULAR PIPE, AND AASHTO M 207 FOR ELLIPTICAL PIPE.
- SPACING FOR MULTIPLE PIPE INSTALLATIONS SHALL CONFORM TO THE DETAILS SHOWN ON STANDARD PLAN M-206-1.
- WHEN A PIPE IS TO BE EXTENDED, THE SAME PIPE MATERIAL AND SIZE AS IN THE ORIGINAL PIPE INSTALLATION SHALL BE USED.

NONREINFORCED CONCRETE PIPE

- AT THE OPTION OF THE CONTRACTOR, NONREINFORCED CONCRETE PIPE CONFORMING TO AASHTO M 86 MAY BE USED IN LIEU OF REINFORCED CONCRETE PIPE FOR ALL SIZES 36 INCHES IN DIAMETER AND SMALLER. THE NONREINFORCED CONCRETE PIPE SHALL MEET THE SAME D-LOAD TO PRODUCE THE ULTIMATE LOAD UNDER THE THREE-EDGE BEARING METHOD AS SPECIFIED FOR REINFORCED CONCRETE PIPE IN CONFORMANCE WITH AASHTO M 170. THE CONTRACTOR SHALL PROVIDE WRITTEN CERTIFICATION OF CONFORMANCE. THE WALL THICKNESS OF THE NONREINFORCED PIPE MAY BE INCREASED AS REQUIRED TO MEET D-LOAD REQUIREMENT.
- ALL REQUIREMENTS FOR REINFORCED CONCRETE PIPE, EXCEPT THOSE REFERRING TO REINFORCEMENT, SHALL APPLY TO NONREINFORCED CONCRETE PIPE.

Computer File Information			Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	REINFORCED CONCRETE PIPE	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)		Date:	Comments			M-603-2	
Designer Initials: JBK	(R-X)						Standard Sheet No. 1 of 1	
Last Modification Date: 07/31/19	(R-X)					Issued by the Project Development Branch: July 31, 2019		
Detailer Initials: LTA	(R-X)							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						Project Sheet Number:	

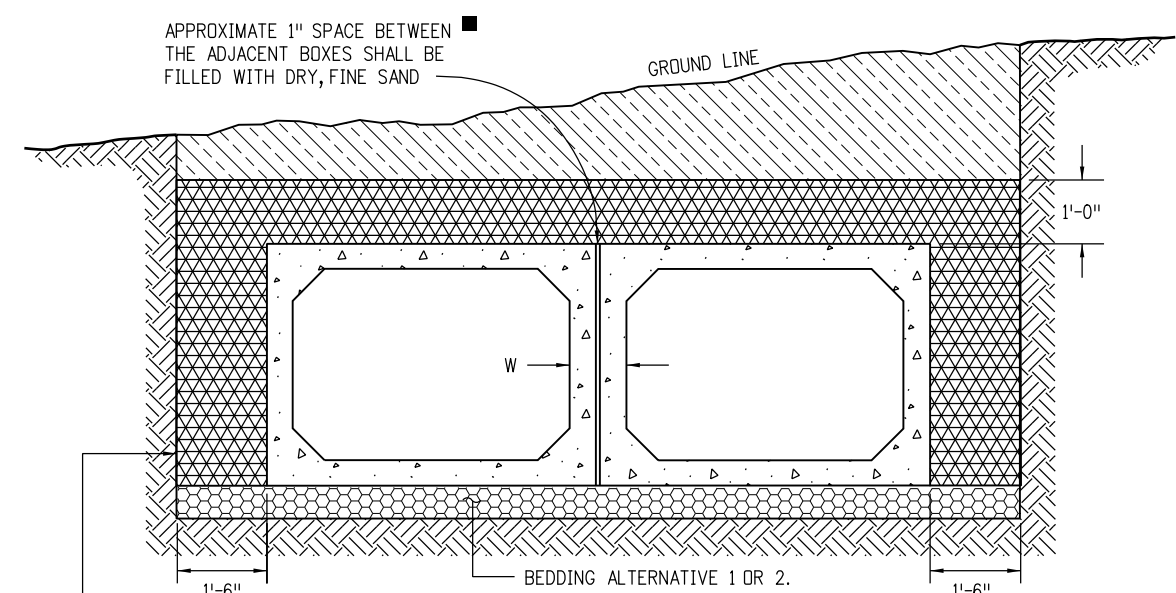

EXCAVATION & BACKFILL WILL BE MEASURED AND PAID FOR TO THIS LINE IN ACCORDANCE WITH SECTION 206.


■ GROUT OR FOAM SEALANT SHALL BE USED WHEN SPECIFIED ON THE PLANS.

EXCAVATION & BACKFILL


(DOUBLE PARALLEL PRECAST BOX CULVERT INSTALLATION SHOWN)

NOSE ANGLE DETAIL


SEE STANDARD PLANS M-601-2, AND 3 TYPICAL AT ADJACENT BOXES DRILL AND GROUT REINFORCING BARS (TYP.)

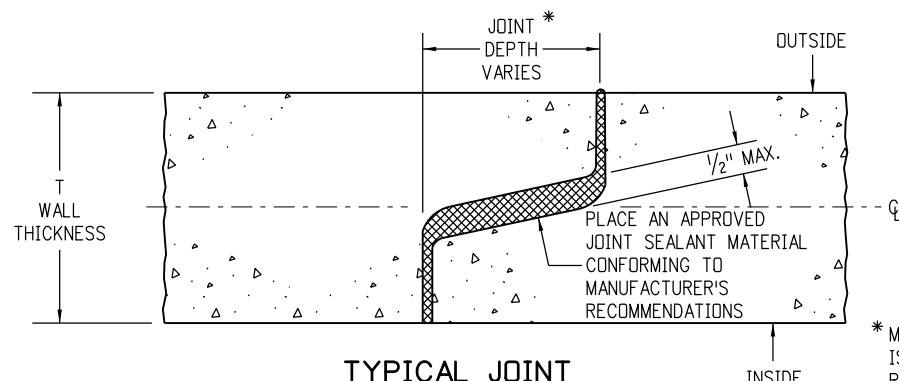


TYPICAL JOINT

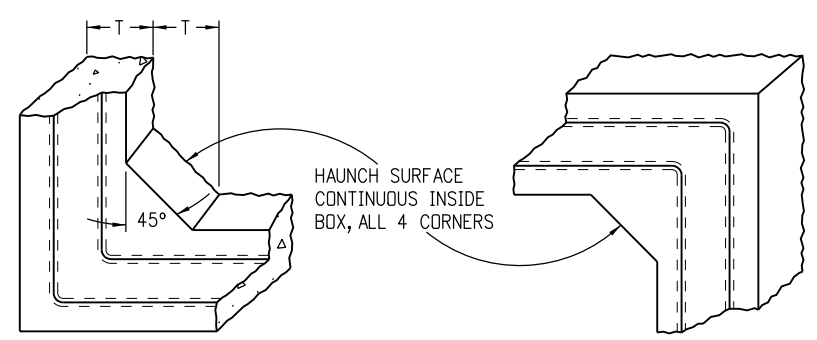


CORNERS

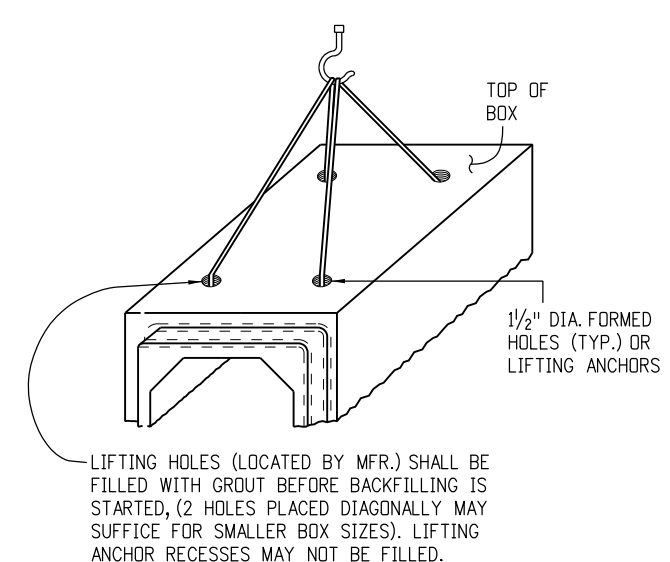

LIFTING

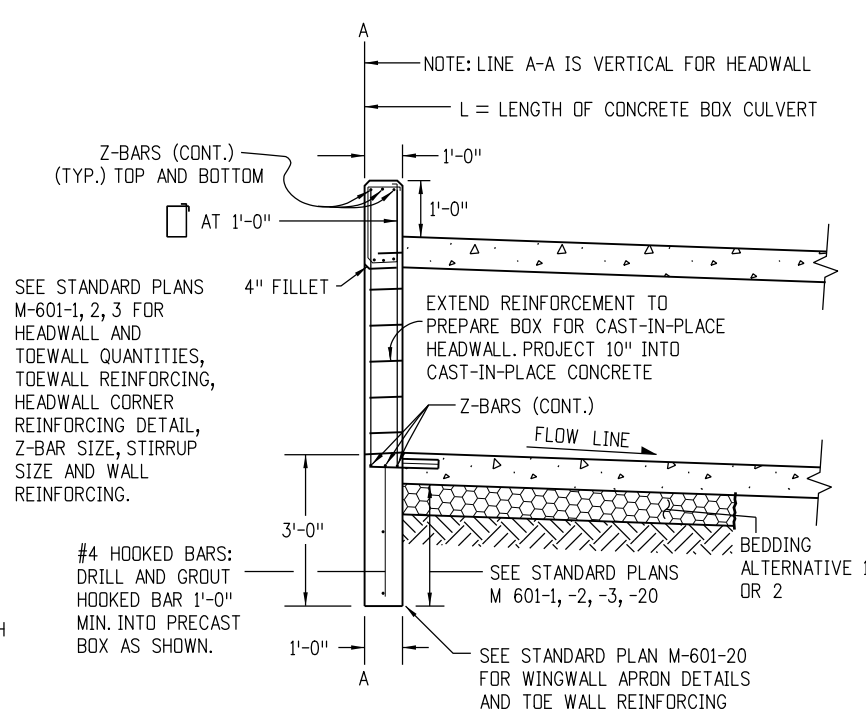

CULVERT END (WITH HEADWALL)

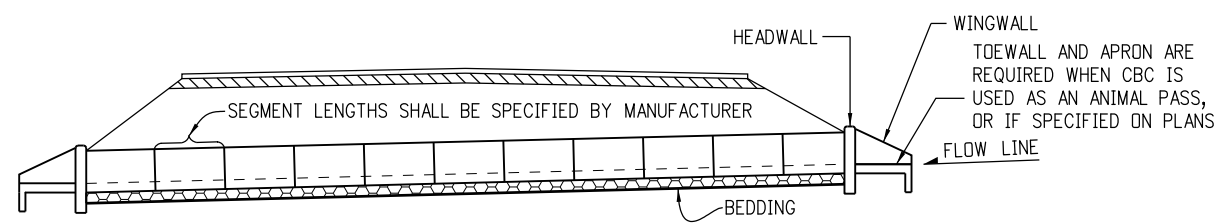

TYPICAL CULVERT INSTALLATION

GENERAL NOTES

1. PRECAST CONCRETE BOX CULVERT SHALL CONFORM TO THE REQUIREMENTS OF THE FOLLOWING SPECIFICATIONS:

ITEM OR CONDITION	MIN. COVER	AASHTO	EQUIV. ASTM
2 FT. OR MORE COVER	2 FT.	M 259, TABLE 2	C 1433, TABLE 2
LESS THAN 2 FT. COVER	0 FT.	M 273, TABLE 2	C 1433, TABLE 2
PREFORMED JOINT MATERIAL	—	M 198, 6.1 OR 6.2	C 990, 6.1 OR 6.2
SPAN 20 FT. OR MORE	0 FT.	—	C 1577

THE SPECIFICATIONS LISTED ABOVE SHOW REINFORCING PLACEMENT, EARTH COVER AND OTHER DETAILS NEEDED TO MANUFACTURE THE BOX CULVERTS.

THE DESIGN FOR A PRECAST CONCRETE BOX WITH A SPAN LARGER THEN 12 FT. SHALL BE PROVIDED BY THE MANUFACTURER.

2. THE CONTRACTOR SHALL SUBMIT TWO SETS OF WORKING DRAWINGS TO THE ENGINEER FOR INFORMATION ONLY, PRIOR TO FABRICATION.

3. BEDDING ALTERNATIVE 1 OR 2 IS REQUIRED:
BEDDING ALTERNATIVE IS AT THE CONTRACTOR'S OPTION. BEDDING AND EXCAVATION FOR BEDDING WILL NOT BE MEASURED AND PAID FOR SEPARATELY, BUT SHALL BE INCLUDED IN THE WORK.
BEDDING ALTERNATIVE 1 CONSISTS OF 6 IN. OF AGGREGATE BASE COURSE (CLASS 6) COMPACTED TO NOT LESS THAN 95% MAXIMUM DENSITY DETERMINED IN CONFORMANCE WITH AASHTO T 180.
BEDDING ALTERNATIVE 2 CONSISTS OF AN 3 IN. THICK, MINIMUM, LEAN CONCRETE BASE. CEMENT CONTENT = 250 LBS./CU. YD.

AGGREGATE GRADATION FOR ALTERNATIVE 2 BEDDING:

PASSING 2 IN. SIEVE	—	100%
PASSING NO. 4 SIEVE	—	20% TO 70%
PASSING NO. 200 SIEVE	—	5% TO 15%

4. CBC JOINTS USING RUBBER GASKETS SHALL MEET ASTM C1677.
5. CLASS 1 DRAINAGE GEOTEXTILE SHALL BE COMPLETELY WRAPPED AROUND ALL CBC JOINTS WHICH DO NOT HAVE RUBBER GASKETS. THE GEOTEXTILE SHALL EXTEND A MINIMUM OF 1 FT. ON EACH SIDE OF JOINTS AND SHALL OVERLAP AND BE SECURELY ATTACHED FOR AT LEAST 1 FT. AT ITS ENDS. THE WRAP SHALL BE A SMOOTH FIT (NOT LOOSE OR STRETCHED) JUST PRIOR TO BACKFILL. THE GEOTEXTILE MATERIAL SHALL MEET THE APPLICABLE REQUIREMENTS OF SECTION 420. COST FOR GEOTEXTILE WILL NOT BE MEASURED AND PAID FOR SEPARATELY, BUT SHALL BE INCLUDED IN THE WORK.
6. FOR ANY CULVERT SPAN 20 FT. OR GREATER, A FOUNDATION INVESTIGATION AND REPORT ARE REQUIRED. A LOAD-AND-RESISTANCE FACTOR DESIGN (LRFD) IS REQUIRED USING ASTM C 1577.
7. THE CONTRACTOR HAS THE OPTION OF PROVIDING A CBC WHICH MEETS ASTM C 1577 FOR SPANS LESS THAN 20 FT.
8. SEE M-601-1, 2, AND 3 FOR CAST-IN-PLACE CONCRETE BOX CULVERT DETAILS.

LEGEND

	STRUCTURE EXCAVATION LIMITS
	STRUCTURE BACKFILL, (CLASS 1)
	EMBANKMENT MATERIAL
	EARTH
	BEDDING
	CONCRETE

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

(R-X)
(R-X)
(R-X)
(R-X)

Sheet Revisions

Date:	Comments

Colorado Department of Transportation

2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch JBK

PRECAST CONCRETE BOX CULVERT

Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.

M-603-3

Standard Sheet No. 1 of 1

Project Sheet Number:

LEGEND

H = MAXIMUM ALLOWABLE HEIGHT OF COVER OVER THE TOP OF THE PIPE, EXCLUDING PAVEMENT THICKNESS.

FILL HEIGHTS AND DESIGN ASSUMPTIONS ARE BASED ON AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, 4TH EDITION, SECTION 12, FOR 900 PSI LONG TERM STRENGTH OF HDPE, AND AASHTO T180 MINIMUM RELATIVE COMPACTION OF 95% OR 90%.

FILL HEIGHTS ARE BASED ON AASHTO M294 FOR POYLETHELENE AND AASHTO M330 FOR POLYPROPYLENE, TYPE S PIPES WITH OUTER, CORRUGATED WALLS AND SMOOTH INNER LINEARS.

FILL HEIGHTS, FOR INSTALLATION WITH HIGH WATER TABLE, REQUIRE A SPECIAL DESIGN. THE MAXIMUM HEIGHT IN HIGHWATER LOCATIONS SHOULD BE 15 FEET OR BASED ON AASHTO LRFD DESIGN SPECIFICATIONS.


THE MINIMUM COVER SHALL BE AS SHOWN ON THESE TABLES OR CONFORM TO AASHTO REQUIREMENTS, WHICHEVER IS GREATER. THE MINIMUM COVER FOR PIPE IS MEASURED FROM THE TOP OF THE PIPE TO THE BOTTOM OF THE PAVEMENT: HMA OR PCCP.

THE MINIMUM COVER IS MEASURED FROM THE TOP OF THE PIPE TO THE TOP OF THE SUBGRADE DURING CONSTRUCTION. THE MINIMUM COVER IS BASED ON DUAL AXLE LOADS UP TO 50,000 POUNDS.

L₁ = LENGTH OF PIPE TO BE MEASURED WHEN PLACED IN ACCORDANCE WITH SECTION 624.


L₂ = LENGTH OF PIPE TO BE MEASURED WHEN PLACED IN ACCORDANCE WITH SECTION 603.

+ = THE MINIMUM SPACING BETWEEN THE OUTSIDE WALLS OF MULTIPLE PIPES OR END SECTIONS IS 18" OR 1/2(d), WHICHEVER IS GREATER.

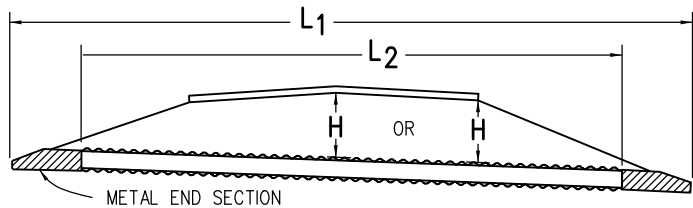


NOTE: USE THE H THAT IS GREATER FOR MAXIMUM ALLOWABLE FILL HEIGHT.

PIPE WITH END SECTIONS

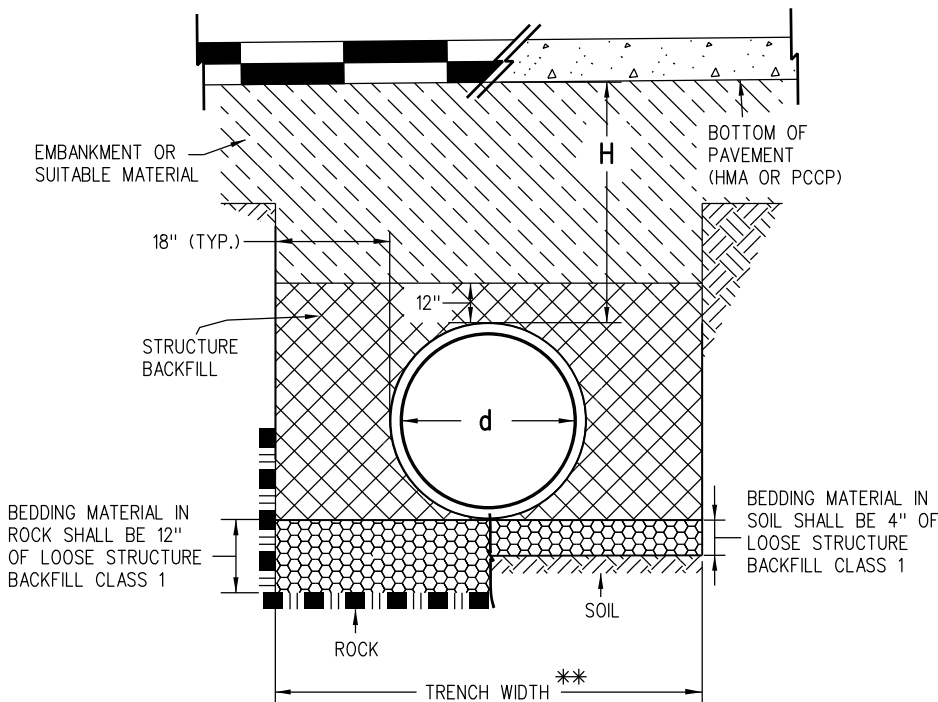


INSTALLATION OF PIPE

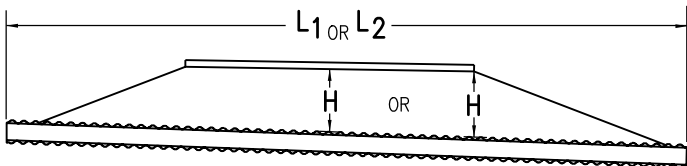

NOTE: USE THE H THAT IS GREATER FOR MAXIMUM ALLOWABLE FILL HEIGHT.


PIPE WITHOUT END SECTIONS

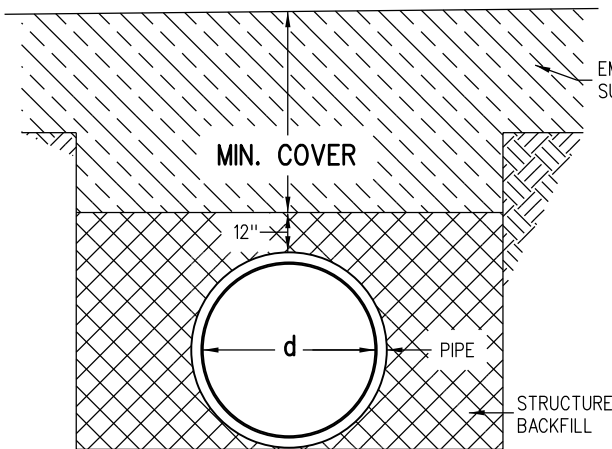

CONSTRUCTION MINIMUM COVER FOR PIPE

GENERAL NOTES

1. ALL PIPES SHALL MEET THE REQUIREMENTS OF AASHTO M294 FOR POLYETHELENE AND AASHTO M330 FOR POLYPROPYLENE, TYPE S FOR HIGH DENSITY CORRUGATED POLYETHYLENE PIPE (HDPE) AND POLYPROPYLENE PIPE (PP) RESPECTIVELY, WITH SMOOTH INNER SURFACE.
2. WHEN A PIPE IS TO BE EXTENDED, THE SAME PIPE MATERIAL AND SIZE AS IN THE ORIGINAL INSTALLATION SHALL BE USED.
3. MINIMUM COVER SHALL BE PROVIDED DURING CONSTRUCTION TO PROTECT THE PIPE FROM DAMAGE.
4. WHEN INSTALLING A GUARDRAIL OR A SIGN POST DIRECTLY ABOVE A PIPE, THE POST'S BOTTOM MUST BE AT LEAST 1 FOOT ABOVE THE TOP OF THE PIPE. THE HOLE FOR THE POST SHALL BE DRILLED INTO THE SOIL.
5. STRUCTURE BACKFILL MATERIAL SHALL BE CLASS 1.
6. FOR PIPES 24 INCHES OR LESS IN DIAMETER, H MIN. MAY BE REDUCED TO ONE FOOT FOR LOW VOLUME APPROACH ROADS NOT ON STATE HIGHWAYS.

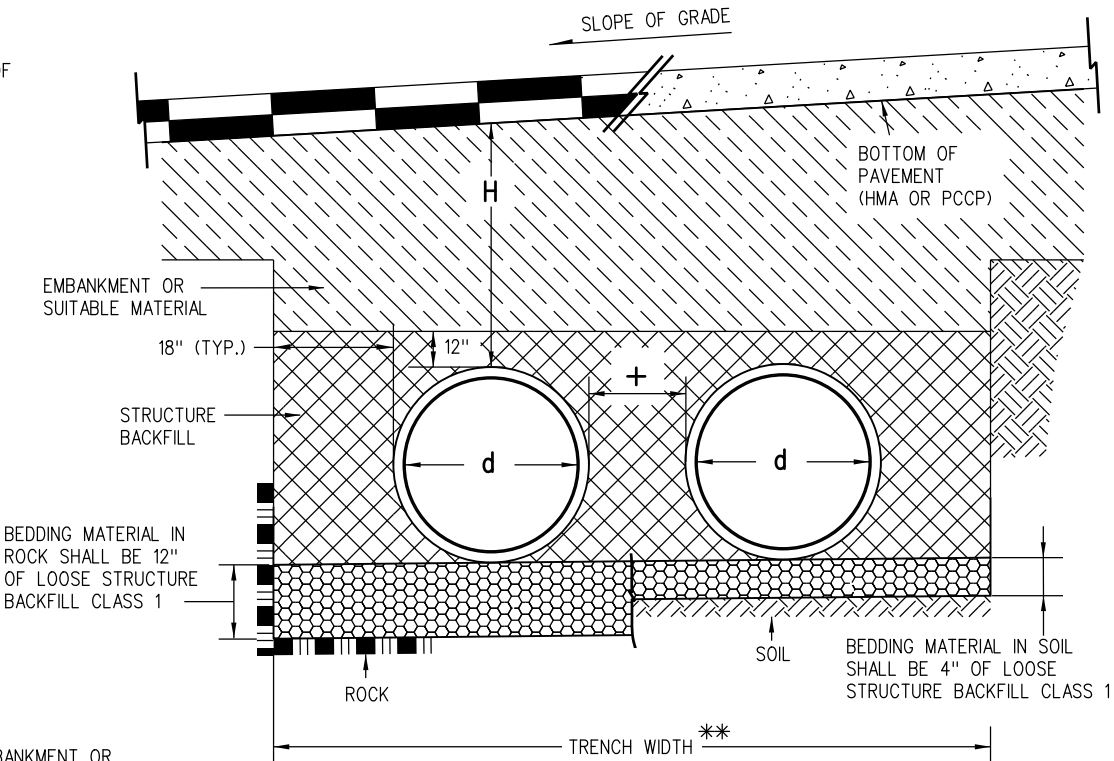

INSTALLATION OF MULTIPLE PIPES

** TRENCH WIDTH ASSUMES STABLE IN-SITU SIDE WALL

NOMINAL PIPE DIAMETER (IN.)	MINIMUM COVER (IN.) FOR INDICATED AXLE LOADS (KIPS)			
	18.0-50.0	50.0-75.0	75.0-110.0	110.0-150.0
24 - 36	24.0	30.0	36.0	36.0
42 - 48	36.0	36.0	42.0	48.0
54 - 60	36.0	36.0	42.0	48.0

AASHTO MINIMUM COVER FOR CONSTRUCTION LOADS

PIPE DIAMETER, d (IN.)	H MINIMUM HEIGHT OF COVER (FT.)		H MAXIMUM HEIGHT OF COVER (FT.)			
			95% COMPACTION		90% COMPACTION	
12	2	2	27	25	19	17
15	2	2	29	27	20	20
18	2	2	24	23	17	17
24	2	2	21	20	15	14
30	2	2	18	23	12	17
36	2	2	20	20	13	14
42	2	2	19	18	13	13
48	3	2	17	20	12	13
60	3	2.5	20	21	13	14

NOTE: THE VALUES FOR POLYPROPYLENE PIPES (AASHTO M330) ARE SHOWN IN ITALICS.

MINIMUM AND MAXIMUM COVER

Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	CORRUGATED POLYETHYLENE PIPE (AASHTO M294) AND POLYPROPYLENE PIPE (AASHTO M330) Issued by the Project Development Branch: July 31, 2019	STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-603-4
Designer Initials: JBK						Standard Sheet No. 1 of 1
Last Modification Date: 07/31/19						
Detailer Initials: LTA						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)					Project Sheet Number:

LEGEND

H = MAXIMUM ALLOWABLE HEIGHT OF COVER OVER THE TOP OF THE PIPE, EXCLUDING PAVEMENT THICKNESS.

FILL HEIGHTS ARE BASED ON AASHTO M304 POLYVINYL CHLORIDE (PVC) PIPE WITH OUTER, RIBBED WALL AND SMOOTH INNER WALL, AND ON AASHTO T180 MINIMUM RELATIVE COMPACTION OF 95% OR 90%.


FILL HEIGHTS, FOR INSTALLATION WITH HIGH WATER TABLE, REQUIRE A SPECIAL DESIGN. THE MAXIMUM HEIGHT IN HIGHWATER LOCATIONS SHOULD BE 15 FEET OR BASED ON AASHTO LRFD DESIGN SPECIFICATIONS.

THE MINIMUM COVER SHALL BE AS SHOWN ON THESE TABLES OR CONFORM TO AASHTO REQUIREMENTS, WHICHEVER IS GREATER. THE MINIMUM COVER FOR PIPE IS MEASURED FROM THE TOP OF THE PIPE TO THE BOTTOM OF THE PAVEMENT: HMA OR PCCP.

THE MINIMUM COVER IS MEASURED FROM THE TOP OF THE PIPE TO THE TOP OF THE SUBGRADE DURING CONSTRUCTION. THE MINIMUM COVER IS BASED ON DUAL AXLE LOADS UP TO 50,000 POUNDS.

L₁ = LENGTH OF PIPE TO BE MEASURED WHEN PLACED IN ACCORDANCE WITH SECTION 624.

L₂ = LENGTH OF PIPE TO BE MEASURED WHEN PLACED IN ACCORDANCE WITH SECTION 603.

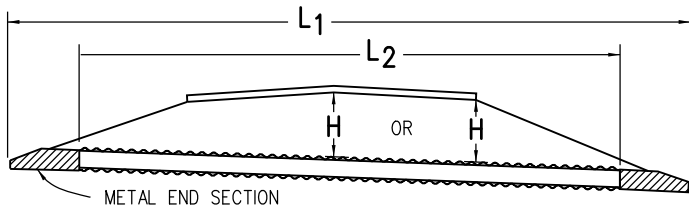


NOTE: USE THE H THAT IS GREATER FOR MAXIMUM ALLOWABLE FILL HEIGHT.


PIPE WITH END SECTIONS

PIPE DIAMETER, d (IN.)	H MINIMUM HEIGHT OF COVER (FT.)	H MAXIMUM HEIGHT OF COVER (FT.)	
		95% COMPACTION	90% COMPACTION
12	2	65	55
15	2	59	51
18	2	63	53
21	2	58	49
24	2	58	49
30	2	56	47
36	2	56	47

MINIMUM AND MAXIMUM COVER

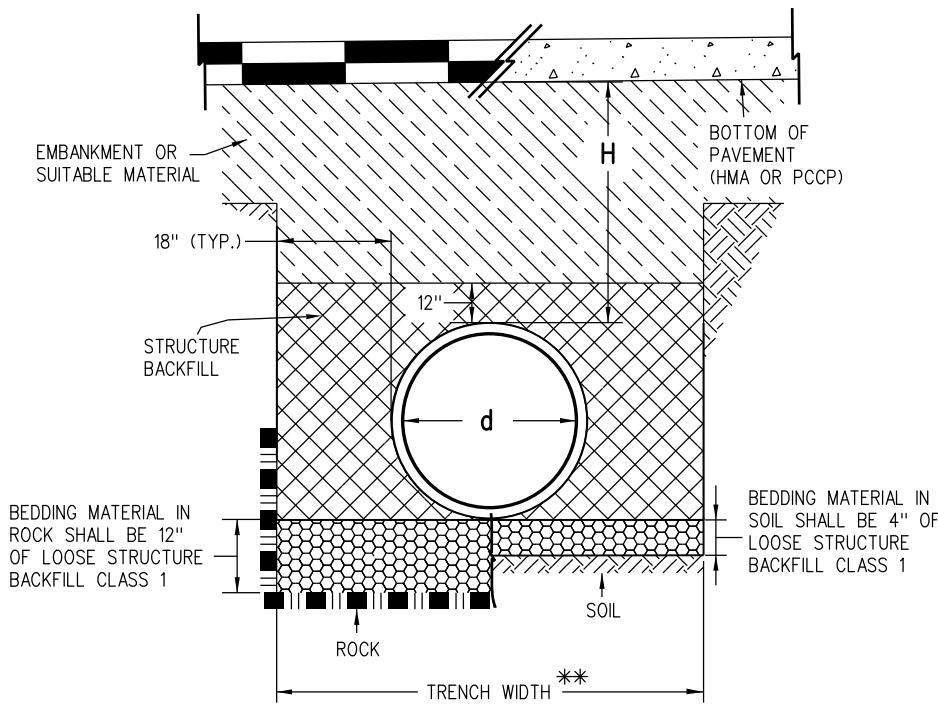


INSTALLATION OF PIPE

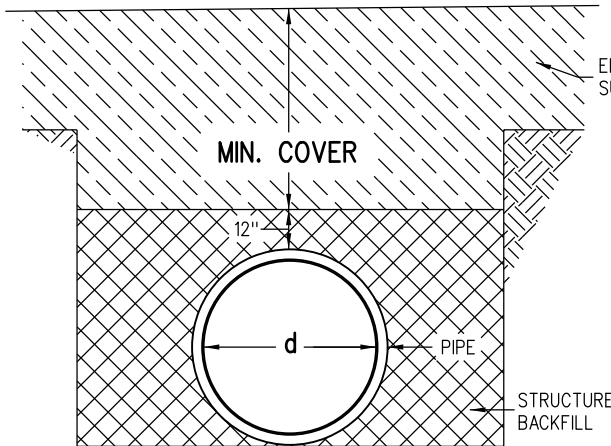

CONSTRUCTION MINIMUM COVER FOR PIPE

GENERAL NOTES

1. ALL PIPES SHALL MEET THE REQUIREMENTS OF AASHTO M304 FOR POLYVINYL CHLORIDE (PVC) PROFILE WALL DRAIN PIPE WITH 46 PSI WALL STIFFNESS PER ASTM F949.
2. FOR PIPES WITH DIAMETERS OF 15 INCHES OR LESS, SOLID WALL PVC PIPES MEETING AASHTO M278 MAY BE USED.
3. WHEN A PIPE IS TO BE EXTENDED, THE SAME PIPE MATERIAL AND SIZE AS IN THE ORIGINAL INSTALLATION SHALL BE USED.
4. MINIMUM COVER SHALL BE PROVIDED DURING CONSTRUCTION TO PROTECT THE PIPE FROM DAMAGE.
5. WHEN INSTALLING A GUARDRAIL OR A SIGN POST DIRECTLY ABOVE A PIPE, THE POST'S BOTTOM MUST BE AT LEAST 1 FOOT ABOVE THE TOP OF THE PIPE. THE HOLE FOR THE POST SHALL BE DRILLED INTO THE SOIL.
6. STRUCTURE BACKFILL MATERIAL SHALL BE CLASS 1.
7. FOR PIPES 24 INCHES OR LESS IN DIAMETER, H MIN. MAY BE REDUCED TO ONE FOOT FOR LOW VOLUME APPROACH ROADS NOT ON STATE HIGHWAYS.

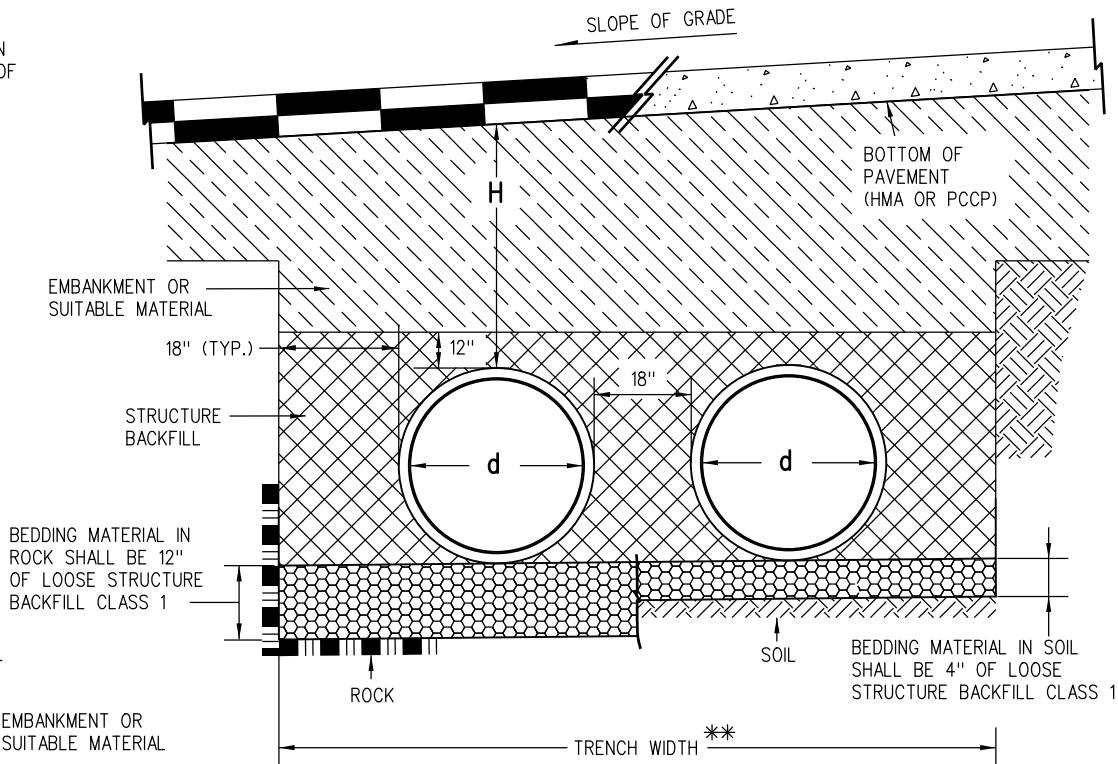

INSTALLATION OF MULTIPLE PIPES

** TRENCH WIDTH ASSUMES STABLE IN-SITU SIDE WALL

NOMINAL PIPE DIAMETER (IN.)	MINIMUM COVER (IN.) FOR INDICATED AXLE LOADS (KIPS)			
	18.0-50.0	50.0-75.0	75.0-110.0	110.0-150.0
24 - 36	24.0	30.0	36.0	36.0

AASHTO MINIMUM COVER FOR CONSTRUCTION LOADS

Computer File Information		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development BranchJBK	Sheet Revisions		POLYVINYL CHLORIDE (PVC) PIPE (AASHTO M304)		STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)		Date:	Comments			M-603-5	
Designer Initials: JBK							Standard Sheet No. 1 of 1	
Last Modification Date: 07/31/19								
Detailer Initials: LTA								
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English						Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:

LEGEND

H = MAXIMUM ALLOWABLE HEIGHT OF COVER OVER THE TOP OF THE PIPE, EXCLUDING PAVEMENT THICKNESS.

FILL HEIGHTS AND DESIGN ASSUMPTIONS ARE BASED ON AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, 7TH EDITION, SECTION 12.7.

FILL HEIGHTS ARE BASED ON AASHTO MP 20, TYPE S PIPES WITH RIBBED REINFORCED STEEL WALLS.

FILL HEIGHTS FOR INSTALLATION WITH HIGH WATER TABLE REQUIRE A SPECIAL DESIGN.


THE MINIMUM COVER SHALL BE AS SHOWN ON THESE TABLES OR CONFORM TO AASHTO REQUIREMENTS, WHICHEVER IS GREATER. THE MINIMUM COVER FOR PIPE IS MEASURED FROM THE TOP OF THE PIPE TO THE BOTTOM OF THE PAVEMENT: HMA OR PCCP.

THE MINIMUM COVER IS MEASURED FROM THE TOP OF THE PIPE TO THE TOP OF THE SUBGRADE DURING CONSTRUCTION. THE MINIMUM COVER IS BASED ON DUAL AXLE LOADS UP TO 50,000 POUNDS.

L₁ = LENGTH OF PIPE TO BE MEASURED WHEN PLACED IN ACCORDANCE WITH SECTION 624.

L₂ = LENGTH OF PIPE TO BE MEASURED WHEN PLACED IN ACCORDANCE WITH SECTION 603.

+ = THE MINIMUM SPACING BETWEEN THE OUTSIDE WALLS OF MULTIPLE PIPES OR END SECTIONS IS 18" OR $d/2$, WHICHEVER IS GREATER.

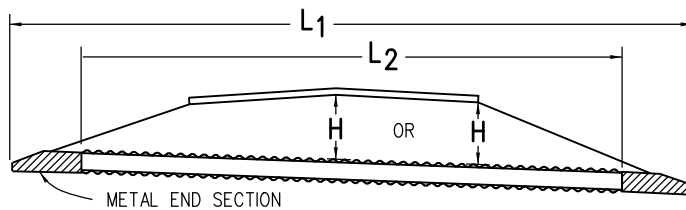


NOTE: USE THE **H** THAT IS GREATER FOR MAXIMUM ALLOWABLE FILL HEIGHT.

PIPE WITH END SECTIONS


PIPE DIAMETER, d (IN.)	H MINIMUM HEIGHT OF COVER (FT.)	H MAXIMUM HEIGHT* OF COVER (FT.)
30	2	50
36	2	50
42	2	50
48	2	30
54	2	30
60	2.5	30

* A MANUFACTURER'S CERTIFICATION OF MAXIMUM ALLOWABLE FILL HEIGHT IS REQUIRED PRIOR TO INSTALLATION.

MINIMUM AND MAXIMUM COVER

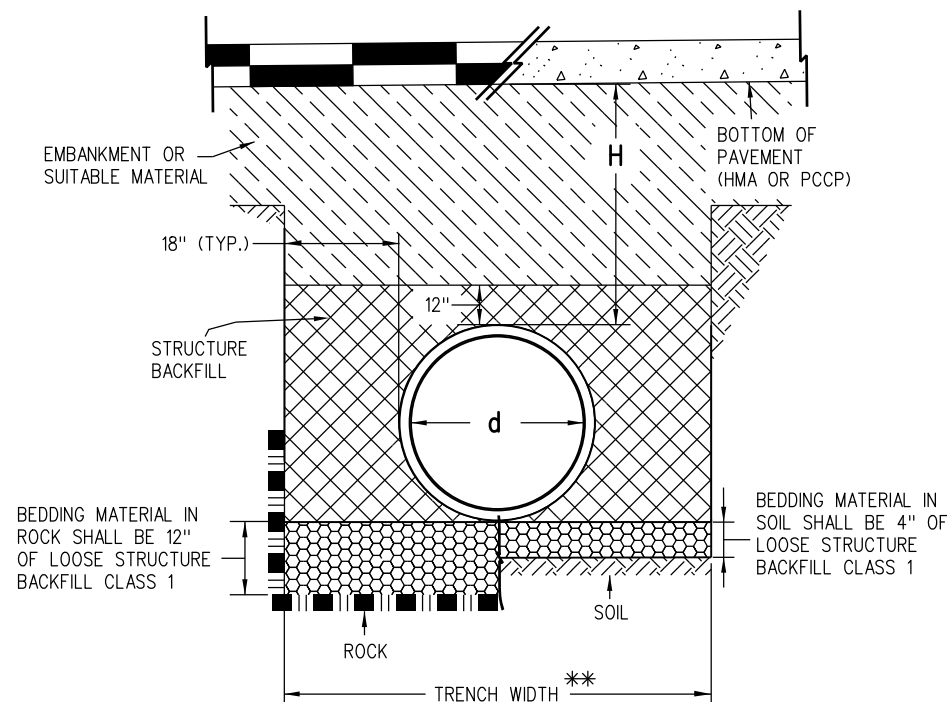


INSTALLATION OF PIPE

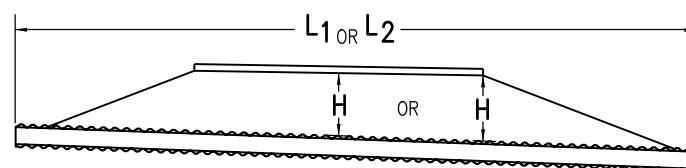

NOTE: USE THE **H** THAT IS GREATER FOR MAXIMUM ALLOWABLE FILL HEIGHT.


PIPE WITHOUT END SECTIONS

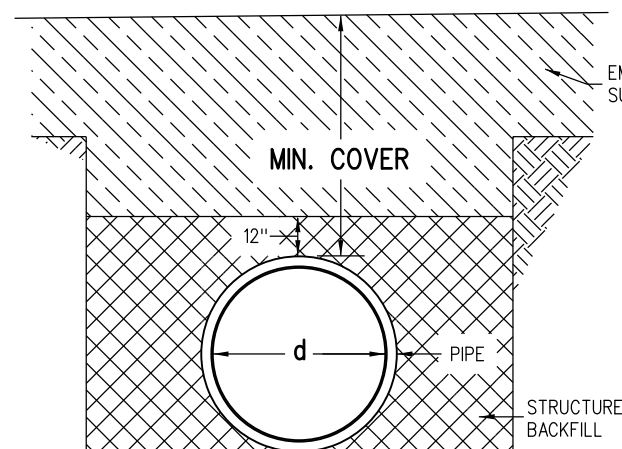

CONSTRUCTION MINIMUM COVER FOR PIPE

GENERAL NOTES

- ALL PIPES SHALL MEET THE REQUIREMENTS OF AASHTO MP 20 FOR STEEL REINFORCED, POLYETHYLENE, TYPE S RIBBED PIPE WITH SMOOTH INNER SURFACE. INSTALLATION SHALL CONFORM TO AASHTO LRFD BRIDGE CONSTRUCTION SPECIFICATIONS, 3RD EDITION, SECTION 26.
- WHEN A PIPE IS TO BE EXTENDED, THE SAME PIPE MATERIAL AND SIZE AS IN THE ORIGINAL INSTALLATION SHALL BE USED.
- MINIMUM COVER SHALL BE PROVIDED DURING CONSTRUCTION TO PROTECT THE PIPE FROM DAMAGE.
- WHEN INSTALLING A GUARDRAIL OR A SIGN POST DIRECTLY ABOVE A PIPE, THE POST'S BOTTOM MUST BE AT LEAST 1 FOOT ABOVE THE TOP OF THE PIPE. THE HOLE FOR THE POST SHALL BE DRILLED INTO THE SOIL.
- STRUCTURE BACKFILL MATERIAL SHALL BE CLASS 1.

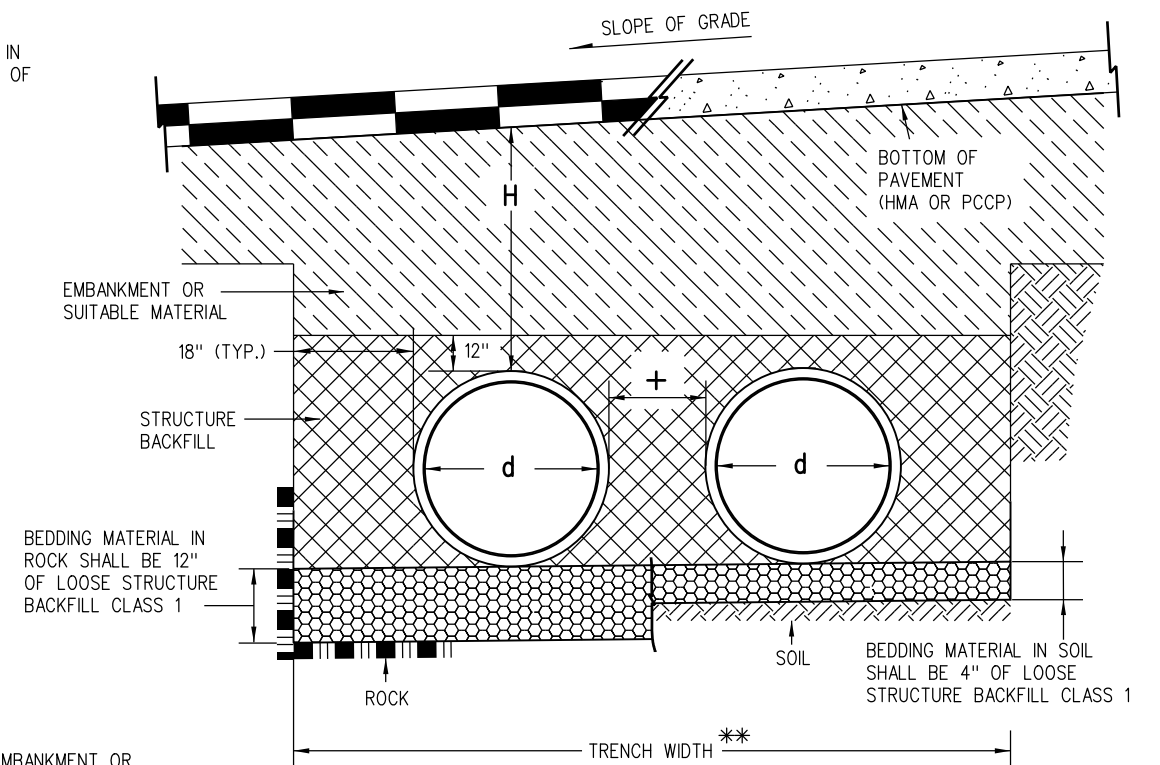

INSTALLATION OF MULTIPLE PIPES

** TRENCH WIDTH ASSUMES STABLE IN-SITU SIDE WALL


NOMINAL PIPE DIAMETER (IN.)	MINIMUM COVER (IN.) FOR INDICATED AXLE LOADS (KIPS)			
	18.0-50.0	50.0-75.0	75.0-110.0	110.0-150.0
30 - 36	24.0	30.0	36.0	36.0
42 - 48	36.0	36.0	42.0	48.0
54 - 60	36.0	36.0	42.0	48.0

AASHTO MINIMUM COVER FOR CONSTRUCTION LOADS

Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	STEEL REINFORCED POLYETHYLENE RIBBED PIPE (AASHTO MP 20)	STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-603-6
Designer Initials: JBK						Standard Sheet No. 1 of 1
Last Modification Date: 07/31/19						
Detailer Initials: LTA						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)				Issued by the Project Development Branch: July 31, 2019	Project Sheet Number:


PIPE DIA.	THICKNESS	DIMENSIONS					
		<i>A</i>	<i>B</i>	<i>H</i>	<i>L</i>	<i>W</i>	<i>T</i>
IN.							
12	0.064	6	6	6	21	24	34
18	0.064	8	10	6	31	36	46
21	0.064	9	12	6	36	42	52
24	0.064	10	13	6	41	48	58
30	0.079	12	16	8	51	60	70
36	0.079	14	19	9	60	72	94
42	0.109	16	22	11	69	84	106
48	0.109	18	27	12	78	90	112
54	0.109	18	30	12	84	102	124
60	0.109	18	33	12	87	114	136
66	0.109	18	36	12	87	120	142
72	0.109	18	39	12	87	126	148
78	0.109	18	42	12	87	132	154
84	0.109	18	45	12	87	138	160

FLEXIBLE ROUND PIPE

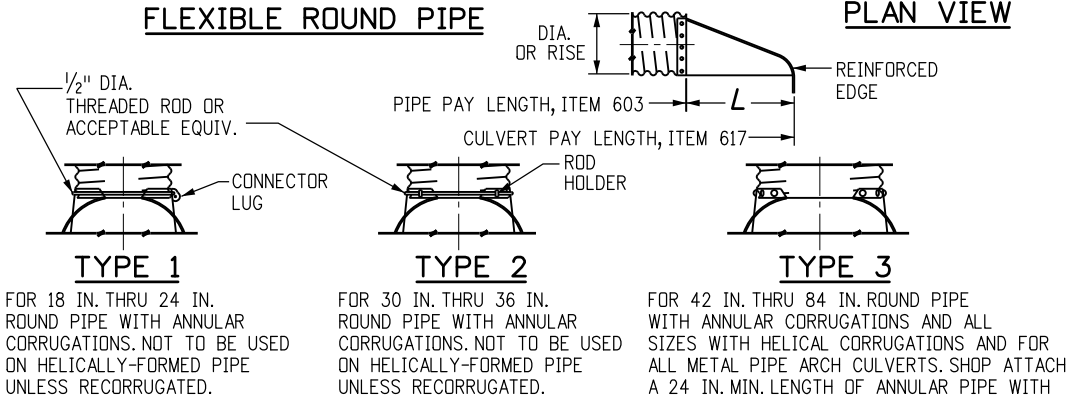


TYPICAL CONNECTIONS

END SECTION AND CONNECTION DETAILS FOR ROUND AND ARCH METAL PIPES

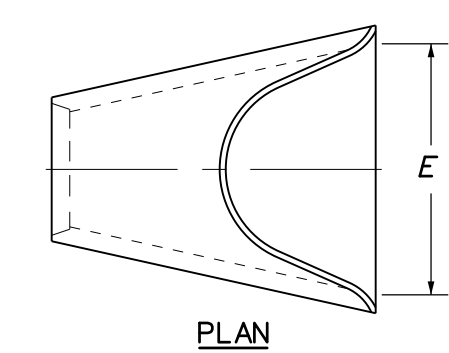


PLAN

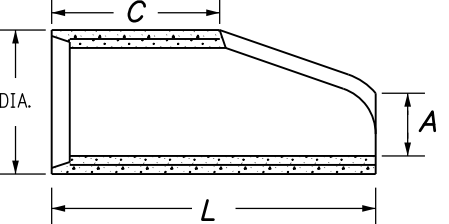

SECTION X-X


PIPE I.D.	DIMENSIONS			
	A	C	L	E
IN.				
18	10	48	78	36
24	10	48	78	48
30	14	36	96	60
36	18	36	96	72
42	24	36	96	78
48	28	24	96	84
54	30	36	96	90
60	36	36	96	96
72	34	20	96	108

REINFORCED CONCRETE CIRCULAR PIPE



END VIEW


END SECTION FOR REINFORCED CONCRETE CIRCULAR PIPE

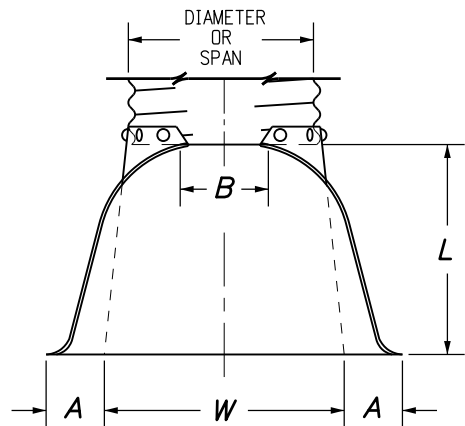


PLAN VIEW

PIPE ARCH	THICK- NESS	DIMENSIONS					
		<i>A</i>	<i>B</i>	<i>H</i>	<i>L</i>	<i>W</i>	<i>T</i>
SPAN x RISE		(±1")	(MAX.)	(±1")	(±1.5")	(±2")	
IN.							
21 x 15	0.064	7	10	6	23	36	46
24 x 18	0.064	8	12	6	28	42	52
28 x 20	0.064	9	14	6	32	48	58
35 x 24	0.079	10	16	6	39	60	70
42 x 29	0.079	12	18	8	46	75	85
49 x 33	0.109	13	21	9	53	85	103
57 x 38	0.109	18	26	12	63	90	108
64 x 43	0.109	18	30	12	70	102	120
71 x 47	0.109	18	33	12	77	114	132


FLEXIBLE PIPE ARCH

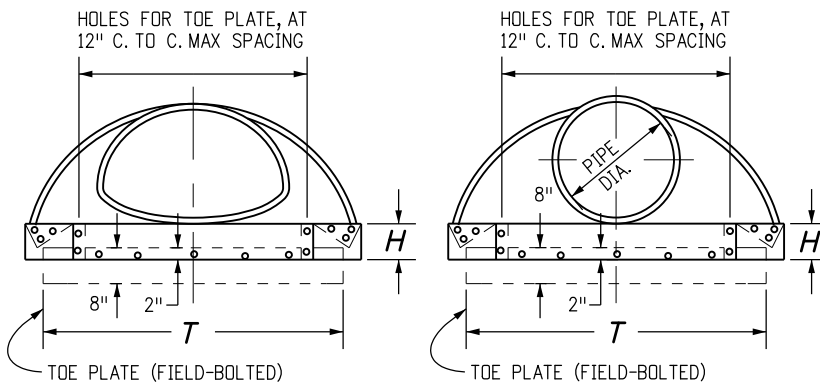


ELEVATIONS

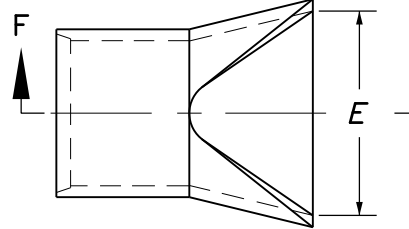

PLAN

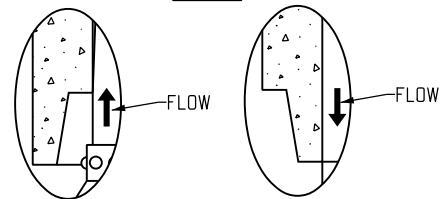

DETAIL A

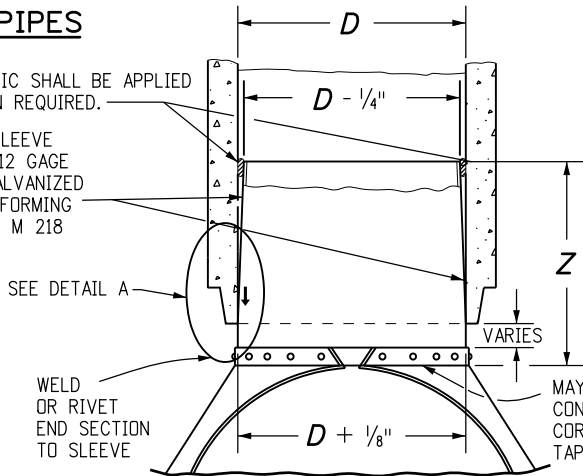


D	Z (MIN.)
IN.	
18 - 24	12
30 AND 36	16
42 AND LARGER	24

STEEL END SECTION FOR CONCRETE CIRCULAR PIPE

(ALTERNATIVE FOR CONCRETE END SECTION)

GENERAL NOTES

- DIMENSIONS OF END SECTIONS MAY VARY SLIGHTLY FROM THOSE SHOWN ON THE TABLES DUE TO DIFFERENT MANUFACTURERS' CONFIGURATIONS.
- CONCRETE END SECTIONS SHALL BE FURNISHED WITH TONGUE OR GROOVE AS REQUIRED.
- DESIGN LENGTH OF PIPE OR SIDE DRAIN IS BASED ON LENGTH OF END SECTION SHOWN IN TABLE. ANY ADDITIONAL PIPE REQUIRED TO PROVIDE THE DESIGN LENGTH SHALL BE FURNISHED BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE PROJECT.
- THE INSIDE CONFIGURATION AND THE JOINT OF CONCRETE END SECTION AND PIPE SHALL MATCH.
- END SECTIONS FOR CMP ARCH PIPE SHALL MATCH THE DIMENSIONS OF THE PIPE SHOWN ON THE PLANS.
- GALVANIZED TOE PLATE AS SHOWN IS REQUIRED ON END SECTIONS FOR CORRUGATED STEEL PIPE AND SHALL BE THE SAME THICKNESS AS END SECTIONS. TOE PLATE SHALL BE FIELD-BOLTED TO END SECTION WITH 3/8 IN. GALVANIZED BOLTS, NUTS AND WASHERS.
- GALVANIZED STEEL SHALL CONFORM TO AASHTO M 111, M 218 OR M 232.
- CONCRETE PIPE JOINT FASTENERS, WHERE SHOWN ON PLANS, SHALL BE INSTALLED SO THAT A MINIMUM OF 15 LINEAR FEET OF THE OUTLET END OF THE PIPE ARE MECHANICALLY LOCKED TOGETHER. END SECTION LENGTHS WHEN USED, SHALL BE INCLUDED IN THE 15 LF REQUIREMENT.
- CONNECTIONS OF METAL END SECTIONS TO PLASTIC PIPE SHALL BE APPROVED BY THE ENGINEER. PLASTIC END SECTIONS SHALL NOT BE USED.
- THE END SECTION STYLE, EITHER REGULAR OR SAFETY, SHALL BE AS SHOWN ON THE PLANS.
- AT THE OPTION OF THE CONTRACTOR AND APPROVAL OF THE CDOT PROJECT ENGINEER, REINFORCED CONCRETE END SECTIONS MAY BE MADE WITH SYNTHETIC FIBERS INSTEAD OF STEEL FOR PIPES 36 INCHES IN DIAMETER AND SMALLER, AND CONFORM TO AASHTO M 86 AND SUBSECTION 601.03.

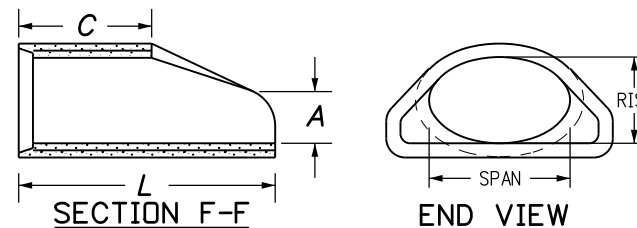


SECTION F-F

END VIEW


EQUIVALENT CIRCULAR DIA.	DIMENSIONS				
	NOMINAL SPAN x RISE	A	C	L	E
IN.					
24	30	19	9	33	72
30	38	24	10	18	72
36	45	29	12	24	84
42	53	34	16	36	96
48	60	38	21	36	96
54	68	43	26	36	96
60	76	48	30	36	96

END SECTION FOR REINFORCED CONCRETE ELLIPTICAL PIPE

3/4" GALVANIZED ANCHOR BOLTS, NUTS AND WASHERS, MILD STEEL, ASTM A 307. ROD LUG SHALL BE GALVANIZED OR COATED WITH EPOXY PAINT OR APPROVED EQUAL.



CONCRETE JOINT FASTENER (TWO PER JOINT)

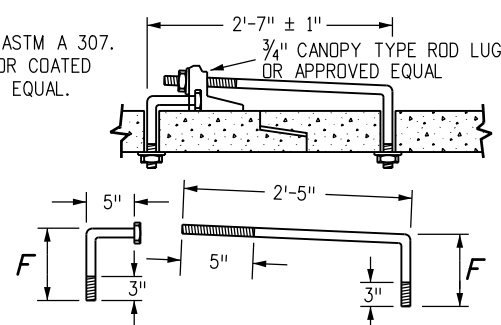

Computer File Information


Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

(R-X)
(R-X)
(R-X)
(R-X)

Sheet Revisions

Date:	Comments

Colorado Department of Transportation



Project Development Branch

JBK

CONCRETE AND METAL END SECTIONS


Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.


M-603-10

Standard Sheet No. 1 of 1


Project Sheet Number:

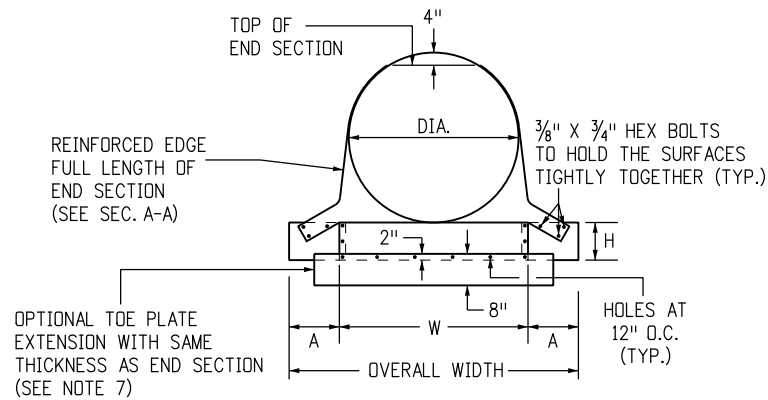

FRONT VIEW
ROUND PIPE CULVERT

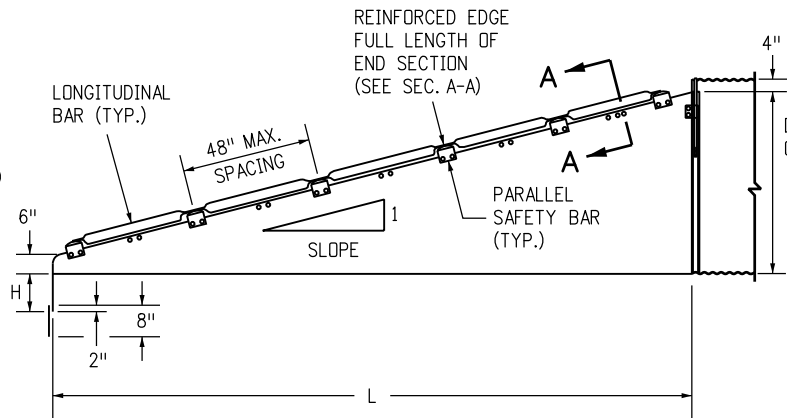


ELEVATION VIEW
CROSS DRAINAGE END SECTION

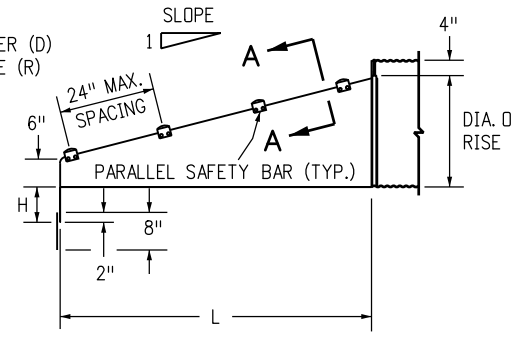



ELEVATION VIEW
PARALLEL DRAINAGE END SECTION

- GENERAL NOTES**
1. USE END SECTIONS ON 1V:4H TO 1V:6H SLOPES ONLY. USE TOE PLATE EXTENSION WHERE SHOWN ON THE PLANS.
 2. FABRICATE SAFETY AND LONGITUDINAL BARS FROM STEEL PIPE CONFORMING TO ASTM A53 SCHEDULE 40 SPECIFICATIONS. GALVANIZE BARS HOT DIPPED AFTER FABRICATION.
 3. A LONGITUDINAL BAR IS REQUIRED FOR CROSS DRAINAGE END SECTIONS WHEN THE SPAN IS GREATER THAN 30 INCHES. USE ADDITIONAL LONGITUDINAL BARS IF SPACING EXCEEDS 30 INCHES ON LARGER END SECTIONS.
 4. SAFETY AND LONGITUDINAL BARS ARE NOT REQUIRED ON 30 INCHES AND SMALLER CROSS DRAINAGE END SECTIONS.
 5. SAFETY BARS ARE NOT REQUIRED ON 18 INCHES AND SMALLER PARALLEL DRAINAGE END SECTIONS.
 6. WHEN REQUIRED, TOE PLATE EXTENSIONS SHALL BE THE SAME GAGE AS END SECTIONS. DIMENSIONS SHALL BE OVERALL WIDTH LESS 6 INCHES BY 8 INCHES HIGH.

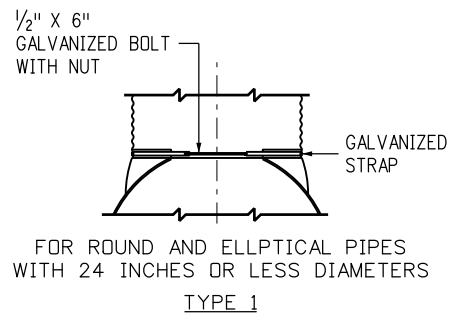

CONNECTOR DETAILS


NOTE: SIZES THRU 24" ATTACH TO PIPE WITH TYPE 1 STRAPS.
ALL OTHER SIZES ATTACH WITH TYPE 2 RODS AND LUGS.

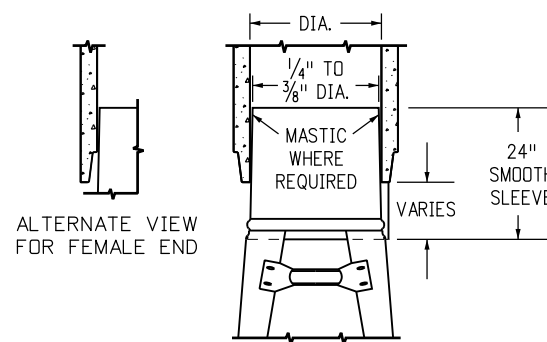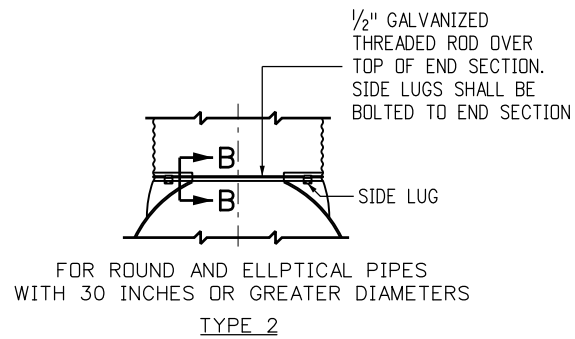


FOR ALL SIZES OF CONCRETE ROUND OR PIPE ARCHES

TAPER SLEEVE CONNECTION


METAL END SECTIONS FOR ROUND PIPE CULVERT							
PIPE DIA. SIZE (INCHES)	METAL THICK MIN. (INCH/GAGE)	DIMENSIONS IN INCHES					
		A	H	W	OVERALL WIDTH	L	
						Slope = 4	Slope = 6
18	0.064/16	8	6	24	40	32	47
24	0.064/16	8	6	30	46	55	83
30	0.109/12	12	9	36	60	79	118
36	0.109/12	12	9	42	66	102	154
42	0.109/12	16	12	48	80	126	189
48	0.109/12	16	12	54	86	150	224
54	0.109/12	16	12	60	92	173	260
60	0.109/12	16	12	66	98	197	295

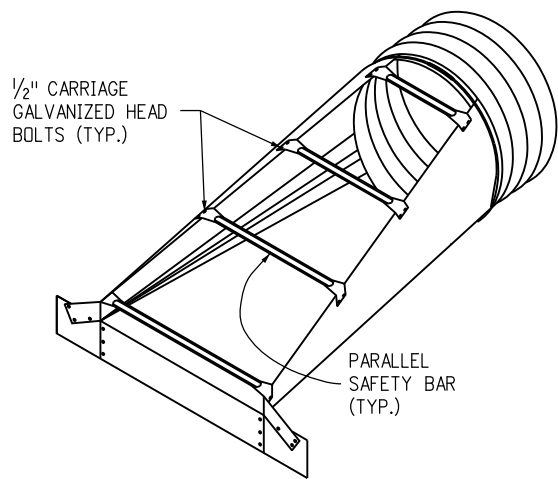


PARALLEL DRAINAGE END SECTION

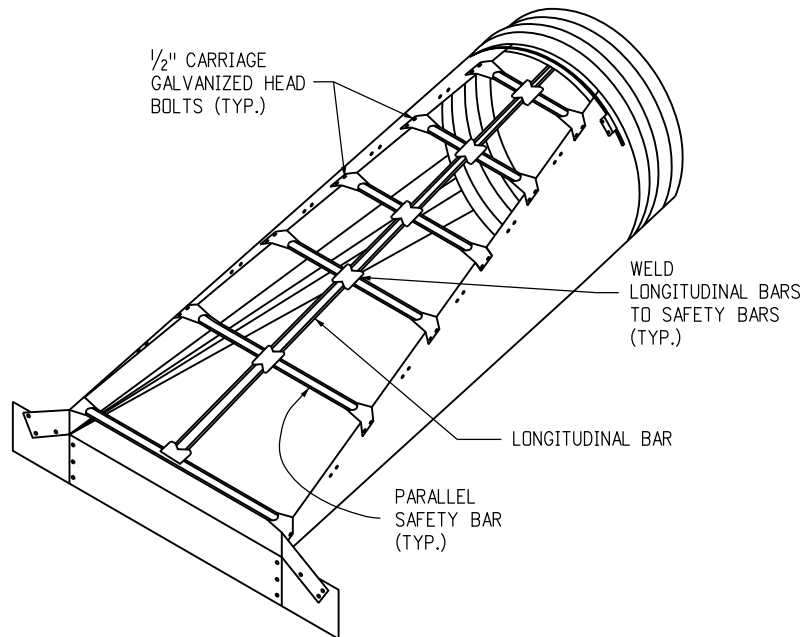

CROSS DRAINAGE END SECTION




SECTION A-A




SECTION B-B


METAL END SECTIONS FOR PIPE ARCH CULVERT									
PIPE SIZE (INCHES)			METAL THICK MIN. (INCH/GAGE)	DIMENSIONS (INCHES)					
EQUIV. DIA.	SPAN	RISE		A	H	W	OVERALL WIDTH	L	
								Slope = 4	Slope = 6
18	21	15	0.064/16	8	6	27	43	20	30
24	28	20	0.064/16	8	6	33	49	40	60
30	35	24	0.109/12	12	9	40	64	55	83
36	41	29	0.109/12	12	9	47	71	75	112
42	48	32	0.109/12	16	12	54	86	90	136
48	56	37	0.109/12	16	12	62	94	110	165
54	63	42	0.109/12	16	12	69	101	130	195
60	70	46	0.109/12	16	12	76	107	146	218
72	82	56	0.109/12	16	12	88	120	185	278



LONGITUDINAL DRAINAGE BAR




PARALLEL BARS

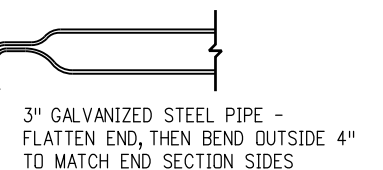


SAFETY BAR DETAILS

Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	TRAVERSABLE END SECTIONS AND SAFETY GRATES		STANDARD PLAN NO.	
Creation Date: 07/31/19			Date:	Comments				M-603-12	
Designer Initials: JJP								Standard Sheet No. 1 of 3	
Last Modification Date: 07/31/19									
Detailer Initials: LTA									
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English								Issued by the Project Development Branch: July 31, 2019	
						Project Sheet Number:			

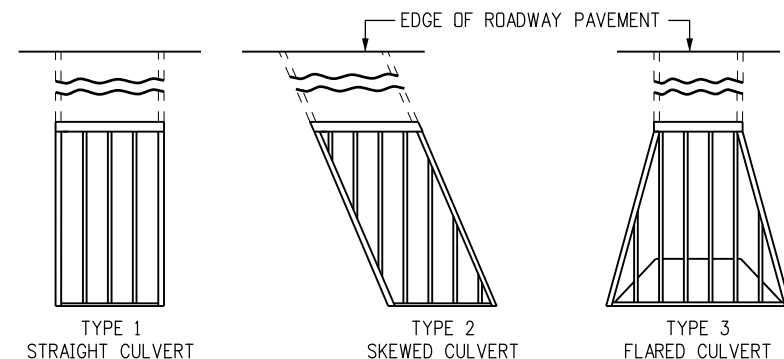


INSTALLATION TYPES

GRATE BARS SHALL BE PERPENDICULAR TO DIRECTION OF TRAFFIC FLOW.

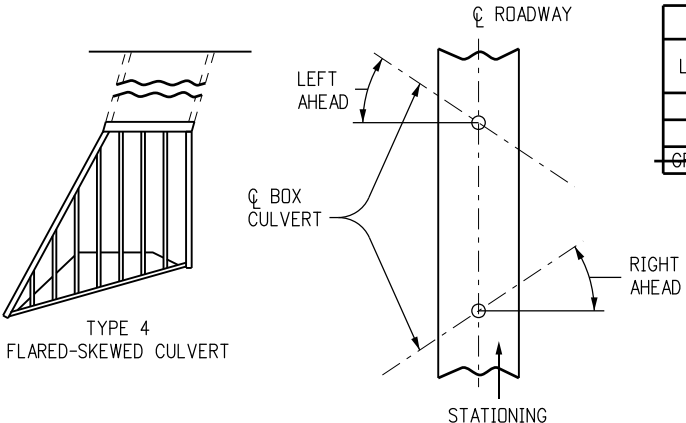


SKEW ANGLE DETERMINATION

GRATE & CROSS BAR SIZE REQUIREMENTS		
LENGTH OF SPAN	NOMINAL PIPE SIZE (SEE NOTE 7)	O.D. SIZE
LESS THAN 12'	3.0"	3.0"
12' - 16'	3.5"	3.5"
GREATER THAN 16'	4.0"	4.0"

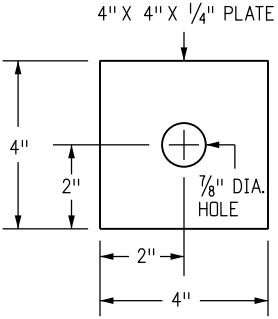


SHIM DETAIL

- ### NOTES
1. SHOP DRAWINGS SHALL BE SUBMITTED PER 105.02
 2. HARDWARE SUCH AS BOLTS, WASHERS, AND LOCK NUTS SHALL BE HOT-DIPPED GALVANIZED PER ASTM A123
 3. INTENDED FOR USE ON TERRAIN XX SLOPES WITH A CLEAR RUNOUT FOR ERRANT VEHICLES. GUARDRAIL IS THE PREFERRED OPTION ON STEEPER TERRAIN OR WITH HIGHER TRAFFIC VOLUMES
 4. MINIMUM SCHEDULE 40 PIPE SHALL BE UED. GALVANIZE ALL PIPES, FITTINGS AND HARDWARE AFTER ALL CUTTING, WELDING, DRILLING, AND FABRICATION.
 5. BOTH ENDS OF CULVERT SHALL BE TREATED TO PREVENT DEBRIS FROM ENTERING
 6. EQUALLY SPACED 24 INCHES MIN. TO 30 INCHES MAX. FROM EDGE OF SIDEWALL TO CENTER OF BRACKET, OR FROM CENTER TO CENTER OF BRACKET.
 7. THE CROSS BAR DIAMETER SHALL BE EQUAL TO OR GREATER THAN THE GRATE BAR DIAMETER.
 8. IF MORE THAN 20 FEET THAN A MIDSPAN SUPPORT SHALL BE REQUIRED. SEE SHEETS 3 AND 4.
 9. DRILL HOLES USING EQUIPMENT DESIGNED TO CUT THROUGH CONCRETE AND REINFORCING STEEL.
 10. A 3/4 INCH BOLT, LOCK NUT AND WASHERS. ALL HOLES ARE TO BE 7/8 INCH IN DIAMETER.
 11. BEND PLATES OR STRIPS WITHOUT CRACKING MATERIAL.
 12. SHIM THICKNESS EQUALS THE DIFFERENCE IN DIAMETERS OF THE GRATE BAR AND CROSS BAR.

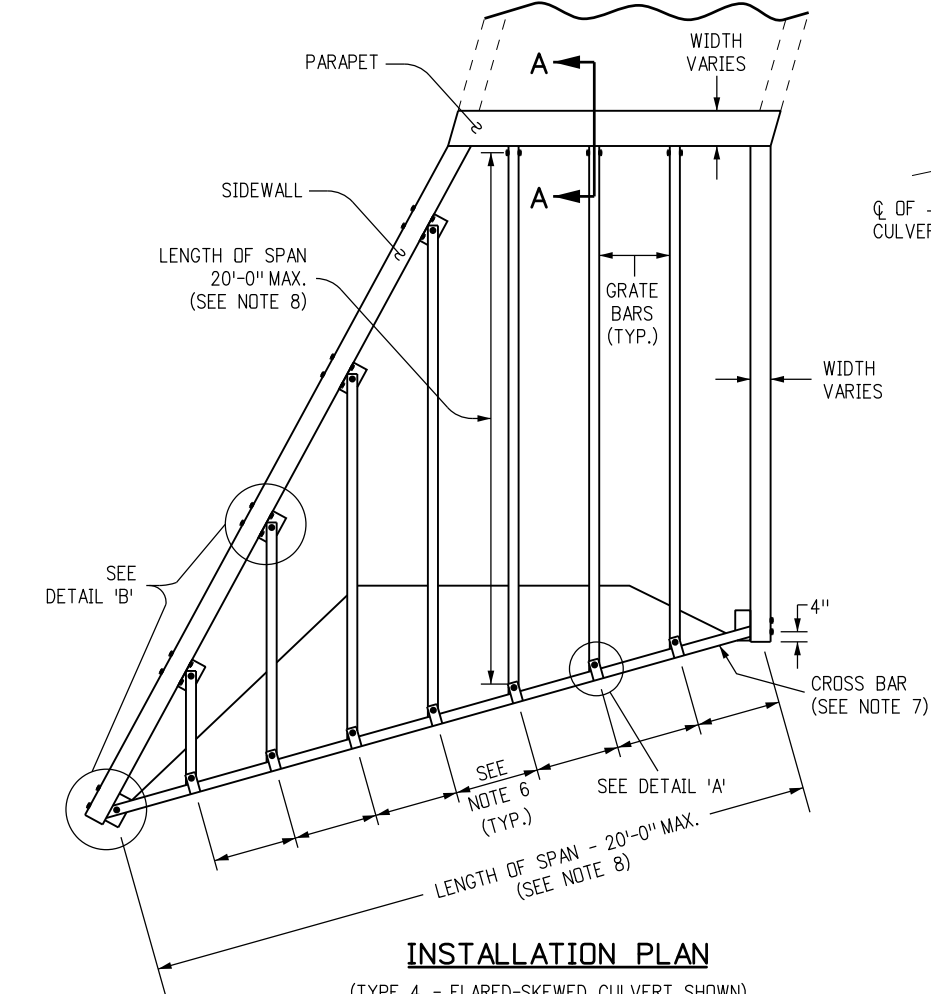


INSTALLATION PLAN


(TYPE 4 - FLARED-SKEWED CULVERT SHOWN)

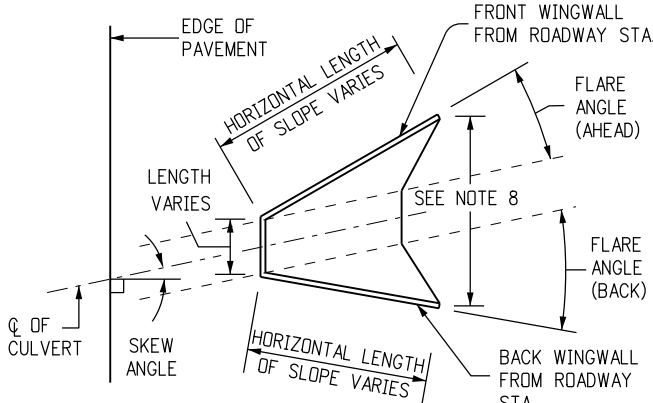

TOP VIEW

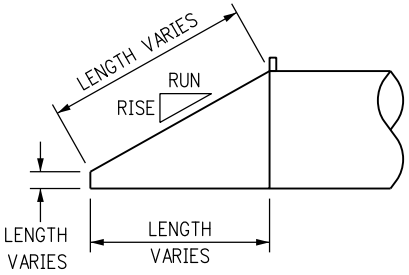


SIDE VIEW

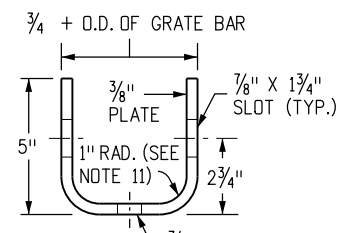


HEADWALL BRACKET

TOP VIEW




HEADWALL BRACKET

FRONT VIEW

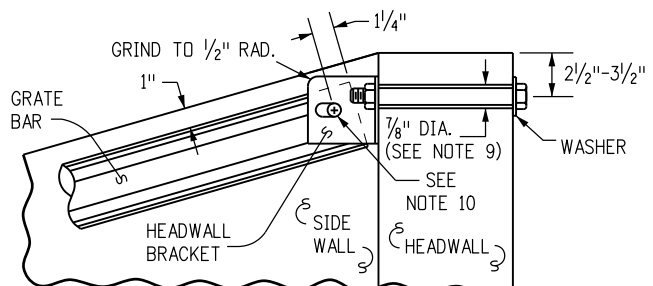


SECTION A-A

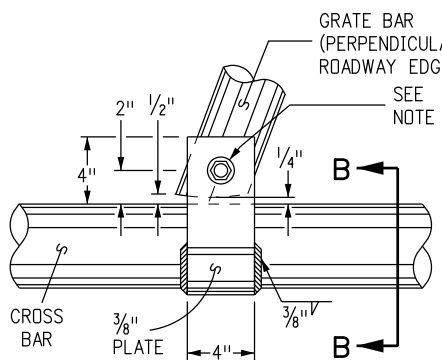


DETAIL "A"

TOP VIEW

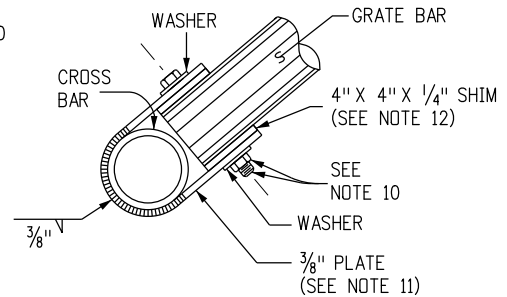


SECTION B-B

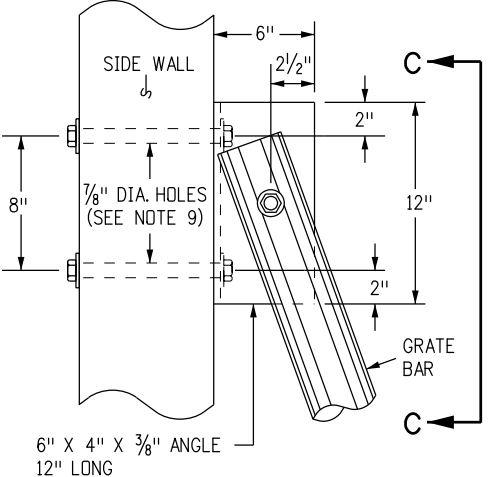


DETAIL "B"

TOP VIEW

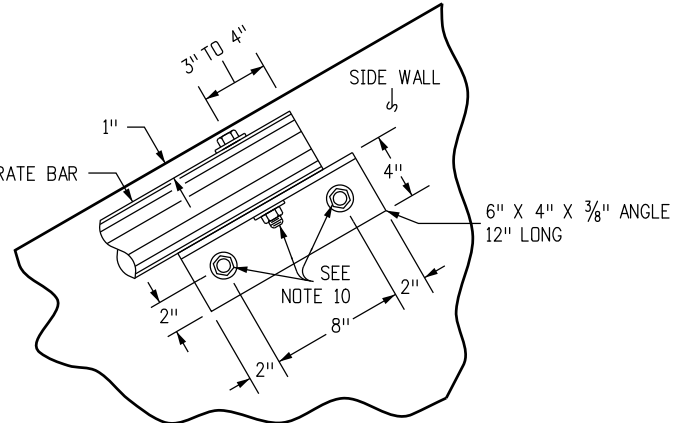


SECTION C-C

Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	TRAVERSABLE END SECTIONS AND SAFETY GRATES Issued by the Project Development Branch: July 31, 2019	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-603-12	
Designer Initials: JJP	(R-X)					Standard Sheet No. 2 of 3	
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:	
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English							

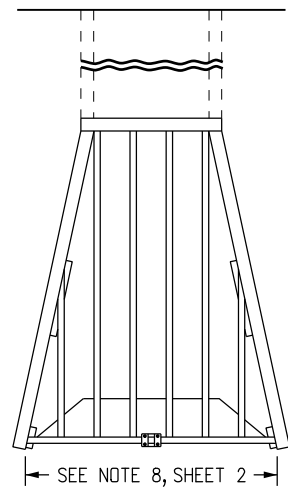


CASE 1

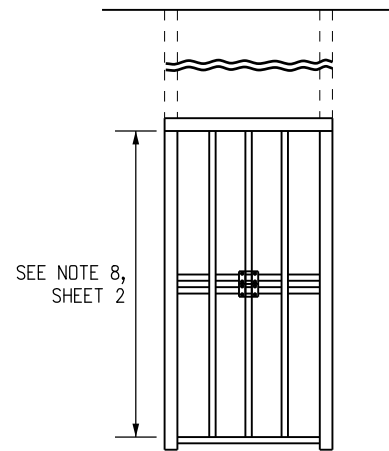


CASE 2

SEE NOTE 8,
SHEET 2


SEE NOTE 8, SHEET 2

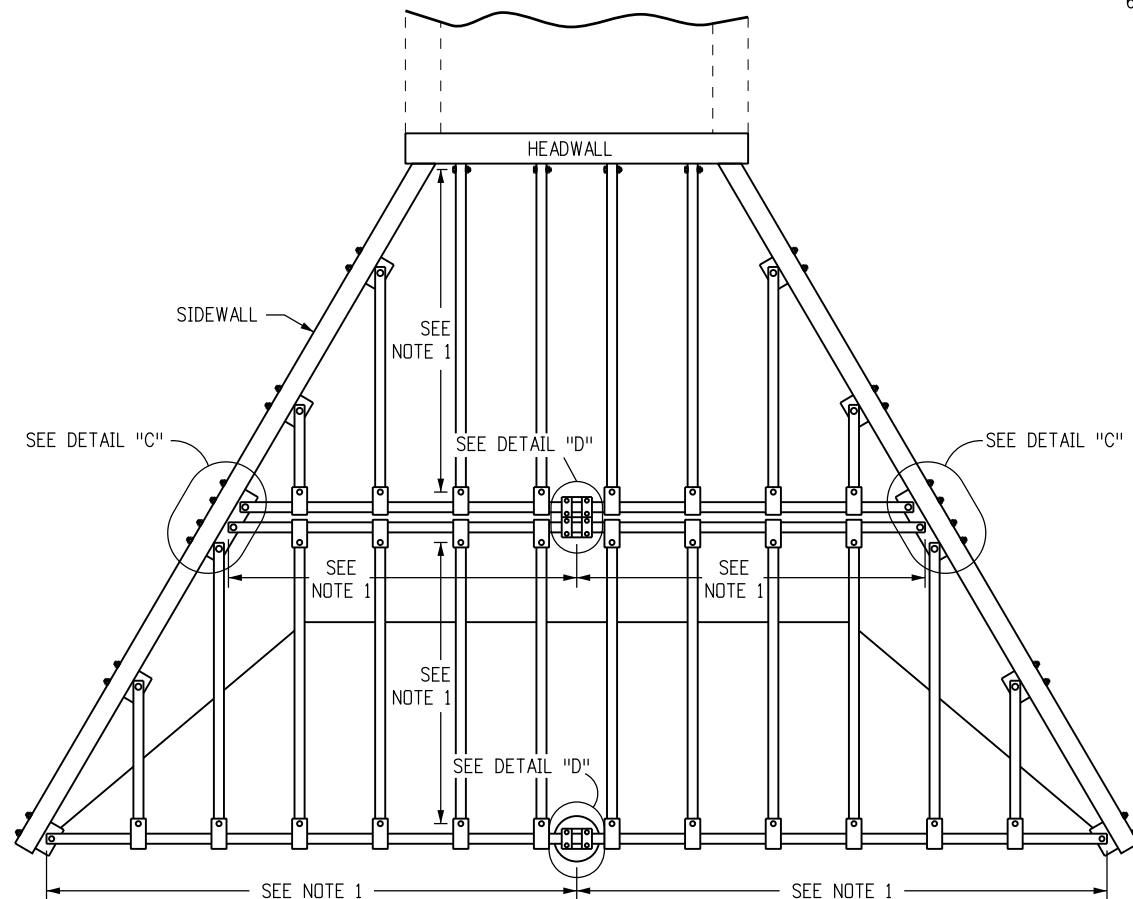


INSTALLATION PLAN WITH MIDSPAN SUPPORT

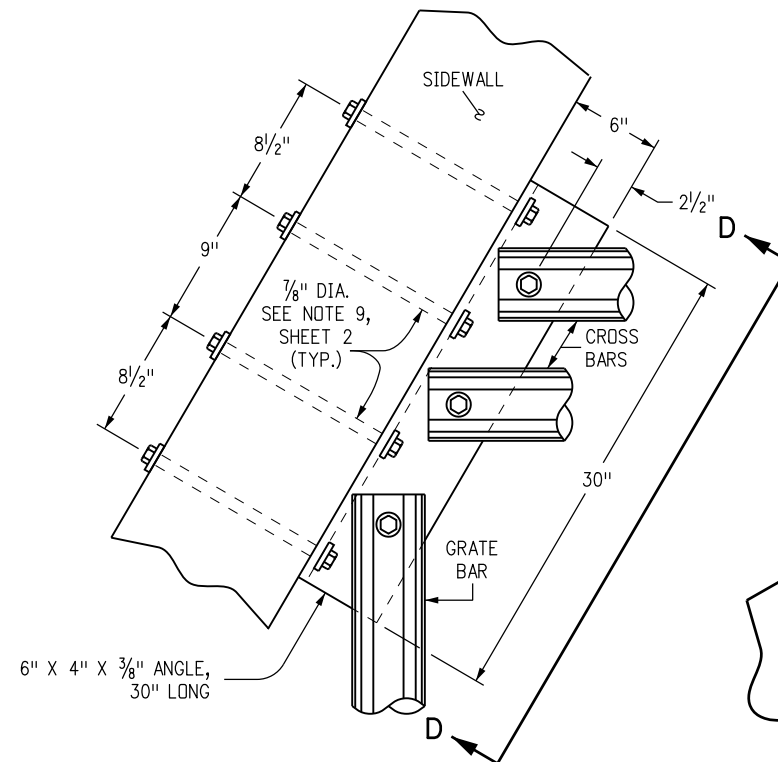


DETAIL "C"

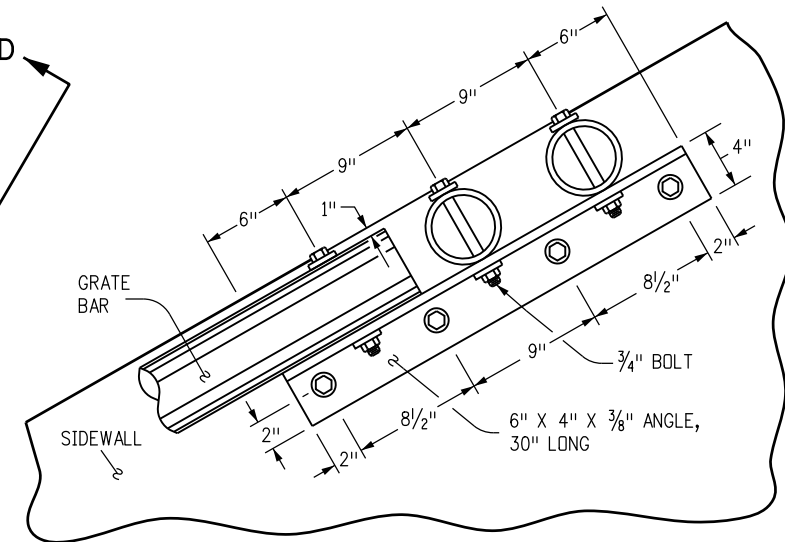


SECTION D-D

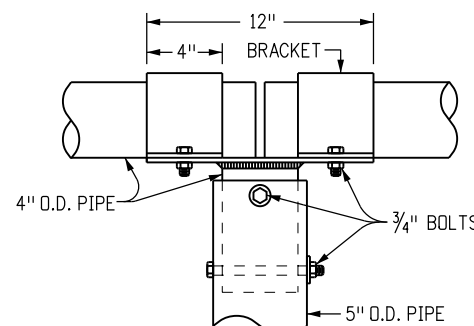


**CROSS BAR SUPPORT ASSEMBLY
SIDE VIEW**

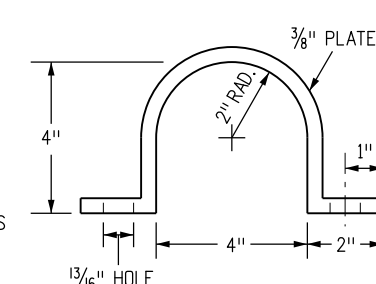


**BRACKET END VIEW
END VIEW**

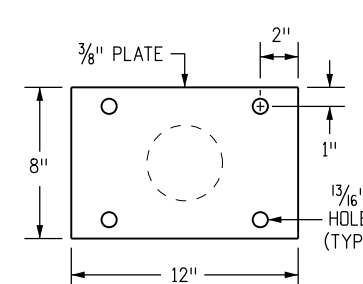


TOP VIEW

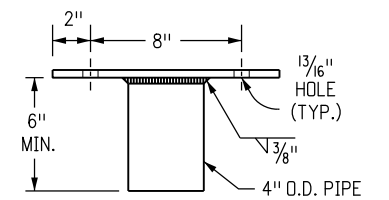


**SUPPORT PLATE
SIDE VIEW**

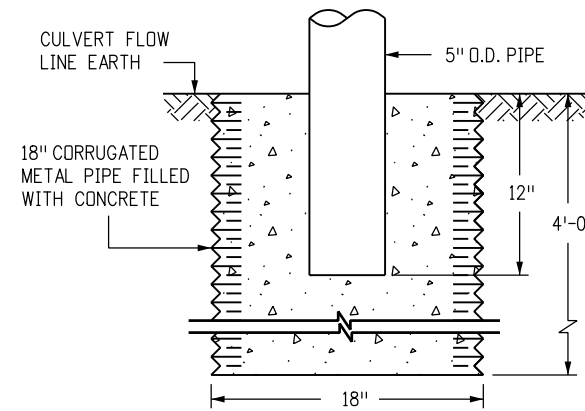

BOTTOM SUPPORT ON EARTH

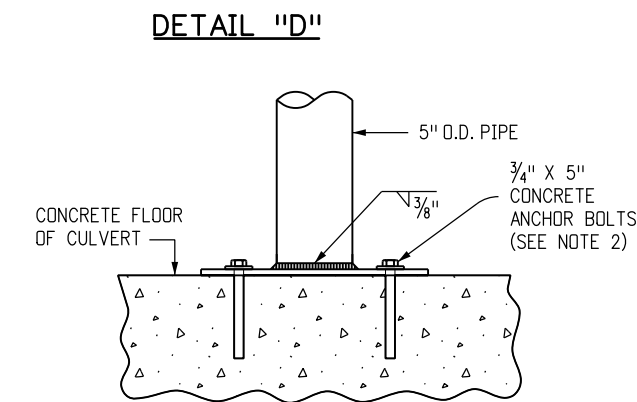

BOTTOM SUPPORT ON CULVERT FLOOR

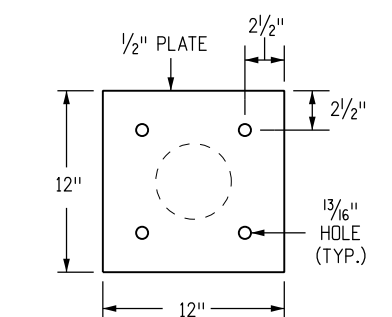

BOTTOM SUPPORT PLATE

NOTES

1. LENGTH OF SPAN (20 FEET MAXIMUM).
2. ALL ANCHOR BOLTS SHALL BE GROUTED IN PLACE WITH A NONSHRINK OR EPOXY GROUT WHICH SHALL COMPLETELY FILL THE HOLES.

Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments		M-603-12	
Designer Initials: JJP	(R-X)				Standard Sheet No. 3 of 3	
Last Modification Date: 07/31/19	(R-X)				Project Sheet Number:	
Detailer Initials: LTA	(R-X)					
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English				Issued by the Project Development Branch: July 31, 2019		


QUANTITIES FOR ONE INLET

H	CONCRETE (CU. YDS.)	STEEL (LBS.)	NO. STEPS REQ'D.
2'-6"	1.0	76	0
3'-0"	1.1	81	0
3'-6"	1.2	97	0
4'-0"	1.3	102	1
4'-6"	1.5	117	2
5'-0"	1.6	123	2
5'-6"	1.7	138	2
6'-0"	1.9	143	3
6'-6"	2.0	159	3
7'-0"	2.1	164	3
7'-6"	2.2	180	4
8'-0"	2.4	185	4
8'-6"	2.5	200	4
9'-0"	2.6	206	5
9'-6"	2.8	221	5
10'-0"	2.9	236	6
11'-6"	3.3	252	6


▼ PIPE INSIDE DIAMETER SHALL BE 30 IN. OR LESS. CONCRETE AND STEEL QUANTITIES ARE FOR ONE ENTIRE INLET BEFORE DEDUCTION FOR VOLUME OCCUPIED BY PIPE. WEIGHT OF STEEL INCLUDES A RING FOR THE MAXIMUM PIPE DIAMETER.

BAR LIST FOR H = 2 FT.-6 IN. AND BENDING DIAGRAM

MARK	NO. REQ'D.	HEIGHT	LENGTH
401	2	2'-2 1/2"	8'-0"
401	6	2'-7"	8'-8"
402	4	"U"	15'-4"




"U" INCREASE DIMENSION 6 IN. FOR EACH 6 IN. INCREASE OF "H" ABOVE 2 FT.-6 IN.




ADD ONE BAR FOR EACH FT. INCREASE OF "H" ABOVE 2 FT. - 6 IN.

402 BARS SHALL BE EQUALLY SPACED FROM EACH OTHER.

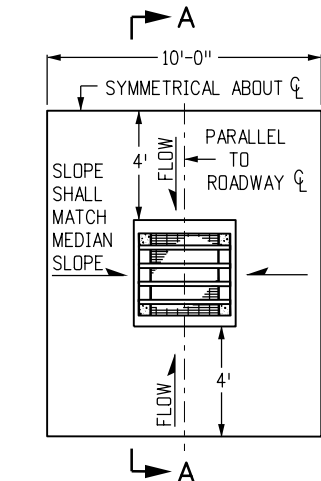


INLET WITH DITCH PAVING


STEEL GRATE QUANTITIES				
NO. PIECES	DESCRIPTION	LENGTH	LBS PER FT.	WEIGHT (LBS.)
4	S4 x 7.7 BEAM	41"	7.90	106
2	3 1/2" x 1/4" FLAT	26 5/8"	2.98	13
2	3" x 1/4" FLAT	26 5/8"	2.55	12
TOTAL LBS. = 131				

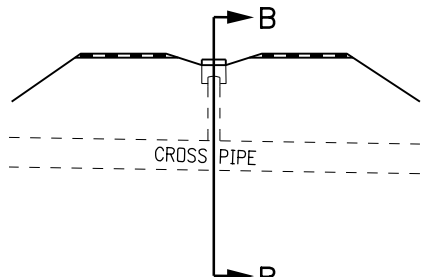


SECTION VIEW

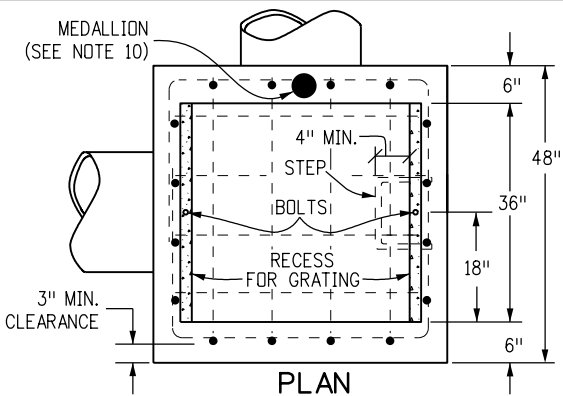


PLAN

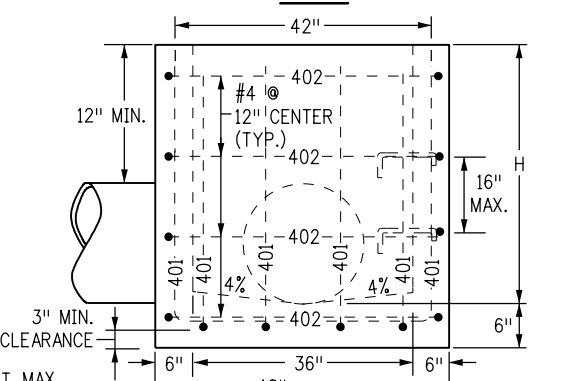

ELEVATION
CONCRETE INLET

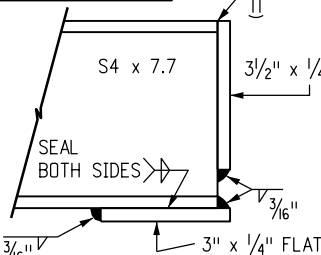


SECTION D-D

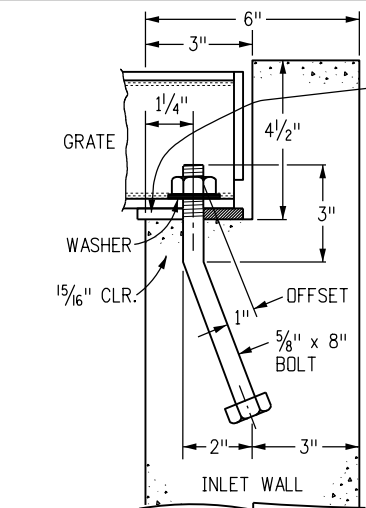

GRATE INSTALLATION
DETAIL

SLOT DETAIL

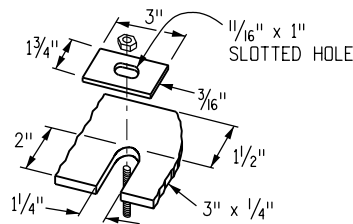


ALTERNATE SLOT
AND HOLD DOWN
PLATE DETAIL

GENERAL NOTES

1. INLET TYPE C IS NOT HS-20 RATED AND SHALL NOT BE PLACED IN PAVED ROADWAYS. THIS INLET SHALL BE USED ONLY OUTSIDE PAVED ROADWAYS.
2. CONCRETE SHALL BE CLASS B. INLET MAY BE CAST-IN-PLACE OR PRECAST.
3. REINFORCING BARS SHALL BE GRADE 60, EPOXY COATED, AND DEFORMED #4, AND SHALL HAVE A MIN. 2 INCH CLEARANCE. CUT OR BEND AROUND PIPES AS REQUIRED.
4. CONCRETE SLOPE AND DITCH PAVING SHALL BE IN ACCORDANCE WITH SECTION 507. REINFORCEMENT FOR CONCRETE SLOPE PAVING SHALL BE 6 X 6 - W1.4 X W1.4 OR 6 X 6 - W2.1 X W2.1.
5. STRUCTURAL STEEL FOR GRATES AND GRATE INSTALLATION HARDWARE SHALL BE GALVANIZED, AND SHALL BE IN ACCORDANCE WITH SUBSECTION 712.06.
6. THE STANDARD INLET GRATES SHALL BE USED ON ALL TYPE C INLETS UNLESS CLOSE MESH INLET GRATES ARE SPECIFIED ON THE PLANS.
7. CLOSE MESH GRATES ARE RECOMMENDED WHERE FOOT TRAFFIC OR BICYCLE ROUTES ARE IN CLOSE PROXIMITY TO GRATE. THIS GRATE IS NOT ADA COMPLIANT OR BICYCLE FRIENDLY AND SHALL NOT BE PLACED DIRECTLY IN SIDEWALKS, CROSSWALKS OR BIKE PATHS.
8. STEPS SHALL BE PROVIDED WHEN INLET DIMENSION "H" IS EQUAL TO OR GREATER THAN 3 FEET - 6 INCHES AND SHALL CONFORM TO AASHTO M 199.
9. SEE STANDARD PLAN M-604-11, FOR REINFORCEMENT AROUND THE PIPE OPENING.
10. ALL INLETS SHALL HAVE A 4 INCH DIA. METAL MEDALLION WITH A "NO DUMPING DRAINS TO STREAM" MESSAGE ON IT. THE MEDALLION SHALL HAVE A FISH SYMBOL WITH A BLUE BACKGROUND. IT SHALL BE FIRMLY ATTACHED TO THE TOP OF THE INLET WITH A PERMANENT FASTENER.
11. SEE PLANS FOR SIZE AND LOCATION OF PIPE.


3/8" TYPICAL HEX. ROUND OR TWISTED CROSS BARS AT 8 IN. CTRS. WELDED TO 4" x 3/8" BEARING BARS SPACED AT 2 3/8" CTRS.

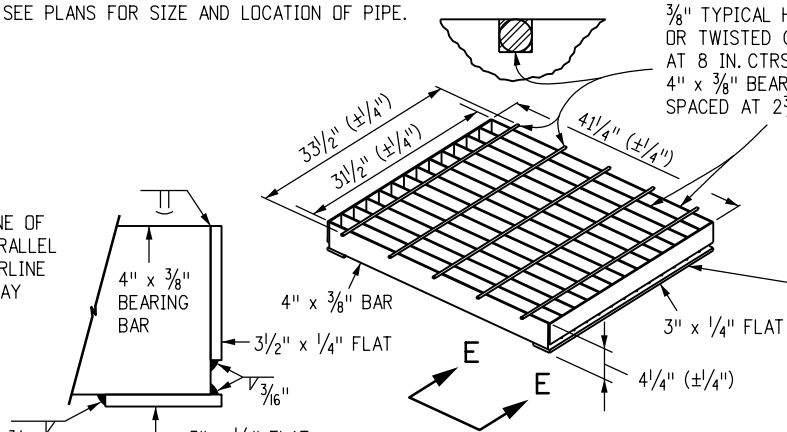

SECTION E-E


CLOSE MESH INLET GRATE

SLOT DETAIL IN 3 1/2" x 1/4" FLATS SAME AS IN STANDARD INLET GRATE

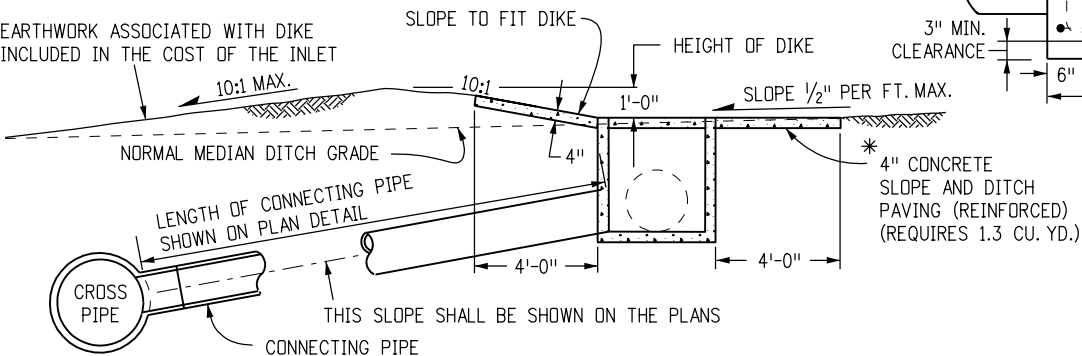


SECTION A-A
INLET ON GRADE
(FLOW FROM ONE DIRECTION)

SECTION B-B
INLET CONNECTED
TO A CROSS PIPE

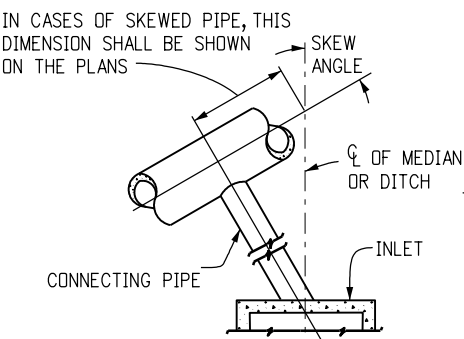


INLET CONNECTED TO A
SKEWED CROSS PIPE

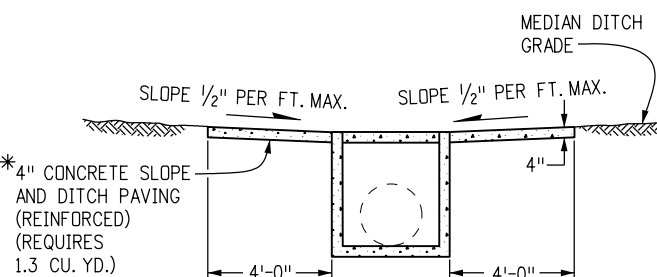

SECTION A-A

*CONCRETE SLOPE AND DITCH PAVING WILL BE REQUIRED WHEN SHOWN ON THE PLANS.

INLET AT BOTTOM OF VERTICAL CURVE
(FLOW FROM TWO DIRECTIONS)

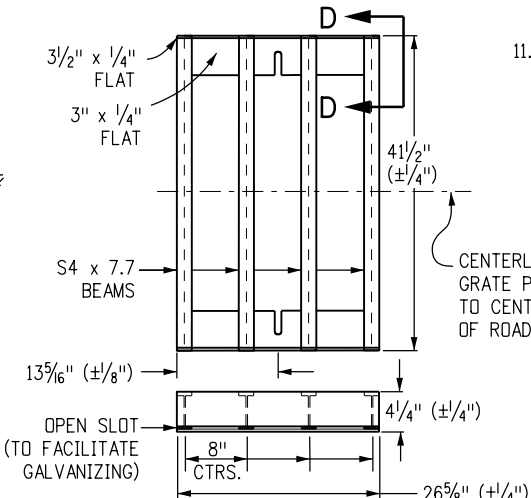

STANDARD INLET GRATE

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

Sheet Revisions

Date:	Comments
(R-X)	
(R-X)	
(R-X)	
(R-X)	

Colorado Department of Transportation



2829 West Howard Place
CDDT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch

JBK

INLET, TYPE C

Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.

M-604-10

Standard Sheet No. 1 of 1

Project Sheet Number:

Project Sheet Number:

Project Sheet Number:

MARK	BAR # OR SIZE	O.C. SPACING	TYPE	ALL INLETS		INLETS: H ≤ 5 FT.				INLETS: H > 5 FT.			
				L = 5 FT.		L = 10 FT.		L = 15 FT.		L = 10 FT.		L = 15 FT.	
				NO. REQ'D.	LENGTH	NO. REQ'D.	LENGTH	NO. REQ'D.	LENGTH	NO. REQ'D.	LENGTH	NO. REQ'D.	LENGTH
401	4	11"	II	15	*	21	*	26	*	11	*	11	*
402	4	11"	II	7	*	13	*	18	*	7	*	7	*
403	4	9"	II	*	4'-0"	*	4'-0"	*	4'-0"	*	4'-0"	*	4'-0"
405	4	6"	VI	11	6'-10"	21	6'-10"	31	6'-10"	11	6'-10"	11	6'-10"
406	4	6"	VIII	7	8'-10"	7	13'-10"	7	18'-10"	7	8'-10"	7	8'-10"
407	4	9"	II	*	5'-10"	*	10'-10"	*	15'-10"	*	5'-10"	*	5'-10"
408	4	12"	II	3	6'-10"	3	11'-10"	3	16'-0"	3	11'-10"	3	16'-0"
409	4	8"	II	6	5'-10"	6	10'-10"	6	15'-10"	6	10'-10"	6	15'-10"
410	4	11"	VII							3		3	*
411	4	11"	II							3	5'-2"	3	10'-2"
412	4	11"	II							3	2'-9"	3	2'-9"
413	4	9"	II							7	10'-10"	7	15'-10"
501	5	5½"	IV	11	3'-4"	22	3'-4"	33	3'-4"	22	3'-4"	33	3'-4"
502	5	5½"	III							11	11'-5"	17	11'-5"
503	5	5½"	II	5	3'-6"	16	3'-6"	27	3'-6"	6	3'-6"	6	3'-6"
504	5	5½"	IX									5	8'-4"
601	6	2½"	V	2	8'-10"	2	8'-10"	2	8'-10"	2	8'-10"	4	8'-10"
■ 8C8.5				1	5'-10"	1	10'-10"	1	15'-10"	1	10'-10"	1	15'-10"
				2 BARS, 1 RODS		4 BARS, 3 RODS		8 BARS, 5 RODS		4 BARS, 3 RODS		8 BARS, 5 RODS	

* VARIABLE REFER TO TABLE TWO.

■ INCLUDE #4, 18 IN. BARS (SEE CHANNEL LAYOUT).

REGULAR INLETS

DROP BOX INLETS

TABLE ONE ~ BAR LIST FOR CURB INLETS, TYPE "R"

"H"	LENGTH			NO. REQ'D.		NO. REQ'D.		L = 5 FT.		L = 10 FT.		L = 15 FT.	
	401	402	410	REGULAR		DROP BOX		CONC. CU. YDS.	STEEL LBS.	CONC. CU. YDS.	STEEL LBS.	CONC. CU. YDS.	STEEL LBS.
				403	407	403	407						
3'-0"	2'-8"	1'-8"		10	7			3.2	285	5.3	497	7.4	706
3'-6"	3'-2"	2'-2"		10	7			3.4	305	5.7	528	7.9	747
4'-0"	3'-8"	2'-8"		12	9			3.7	326	6.0	559	8.4	786
4'-6"	4'-2"	3'-2"		12	9			3.9	334	6.4	571	8.8	803
5'-0"	4'-8"	3'-8"		14	11			4.1	354	6.7	602	9.3	844
5'-6"	5'-2"	4'-2"	3'-5"	16	13	15	6	4.4	375	6.0	607	7.4	850
6'-0"	5'-8"	4'-8"	3'-11"	16	13	16	6	4.6	382	6.2	616	7.6	860
6'-6"	6'-2"	5'-2"	4'-5"	18	15	18	8	4.8	402	6.4	637	7.8	880
7'-0"	6'-8"	5'-8"	4'-11"	20	17	19	10	5.0	423	6.6	654	8.0	897
7'-6"	7'-2"	6'-2"	5'-5"	20	17	20	10	5.3	430	6.9	664	8.3	907
8'-0"	7'-8"	6'-8"	5'-11"	22	19	22	12	5.5	451	7.1	684	8.5	927
8'-6"	8'-2"	7'-2"	6'-5"	24	21	23	14	5.7	471	7.3	702	8.7	944
9'-0"	8'-8"	7'-8"	6'-11"	24	21	24	14	6.0	479	7.6	711	9.0	954
9'-6"	9'-2"	8'-2"	7'-5"	26	23	26	16	6.2	499	7.8	732	9.2	974
10'-0"	9'-8"	8'-8"	7'-11"	28	25	27	18	6.4	520	8.0	749	9.4	992
10'-6"	10'-2"	9'-2"	8'-5"	28	25	28	18	6.7	527	8.3	759	9.7	1001
11'-0"	10'-8"	9'-8"	8'-11"	30	27	30	20	6.9	547	8.5	779	9.9	1022


NOTES: FOR L=5 FT., L=10 FT., AND L=15 FT.

REGULAR INLETS: TOTAL QUANTITIES NEEDED ARE OUTSIDE THE HEAVY BLACK LINE.


DROP BOX INLETS: TOTAL QUANTITIES NEEDED ARE INSIDE THE HEAVY BLACK LINE.

STEEL WEIGHTS DO NOT INCLUDE STRUCTURAL STEEL CHANNEL.


TABLE TWO ~ BARS AND QUANTITIES VARIABLE WITH "H"

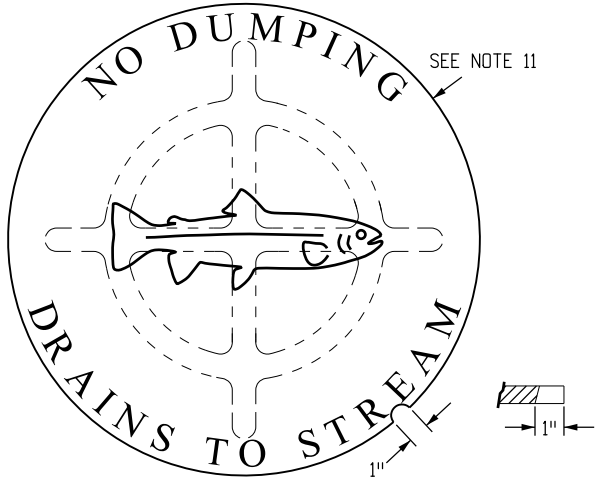


PLAN VIEW



ELEVATION VIEW
MANHOLE COVER (TYP.)

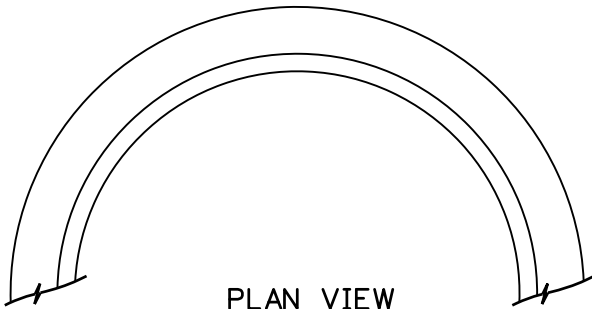


PLAN VIEW

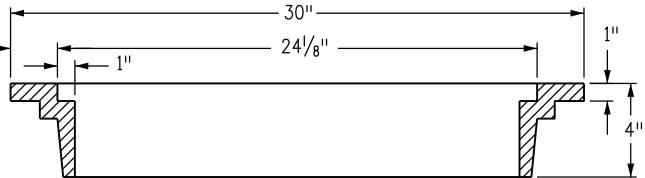

ELEVATION VIEW
MANHOLE RING (TYP.)




WEIGHTS: COVER = 125 LBS.
+ RING = 135 LBS.
TOTAL = 260 LBS.

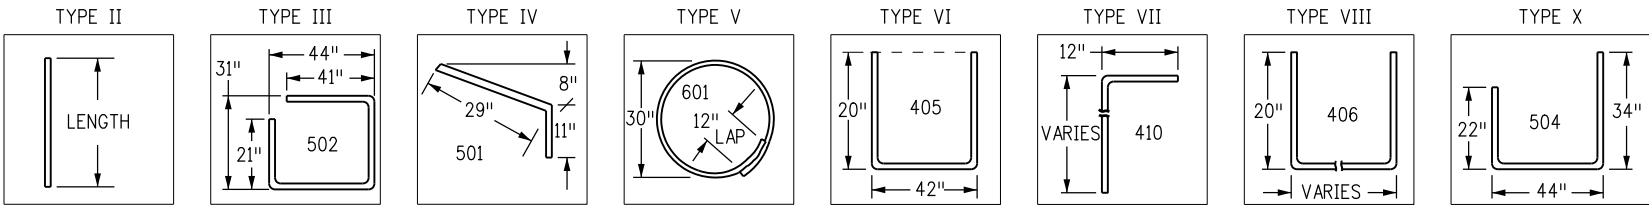


BAR BENDING DIAGRAMS ~ (DIMENSIONS ARE OUT-TO-OUT OF BAR)

GENERAL NOTES

- CONCRETE SHALL BE CLASS B. INLET MAY BE CAST-IN-PLACE OR PRECAST.
- CONCRETE WALLS SHALL BE FORMED ON BOTH SIDES AND SHALL BE 8 INCHES THICK.
- INLET STEPS SHALL BE IN CONFORMANCE WITH AASHTO M 199.
- CURB FACE ASSEMBLY SHALL BE GALVANIZED AFTER WELDING.
- EXPOSED CONCRETE CORNERS SHALL BE CHAMFERED ¾ OF A INCH. CURB AND GUTTER CORNERS SHALL BE FINISHED TO MATCH THE EXISTING CURB AND GUTTER BEYOND THE TRANSITION GUTTER.
- REINFORCING BARS SHALL BE DEFORMED AND SHALL HAVE A 2 INCH MINIMUM CLEARANCE. ALL REINFORCING BARS SHALL BE GRADE 60 AND EPOXY COATED.
- DIMENSIONS AND WEIGHTS OF TYPICAL MANHOLE RING AND COVER ARE NOMINAL.
- MATERIAL FOR MANHOLE RINGS AND COVERS SHALL BE GRAY OR DUCTILE CAST IRON IN ACCORDANCE WITH SUBSECTION 712.06.
- SINCE PIPE ENTRIES INTO THE INLET ARE VARIABLE, THE DIMENSIONS SHOWN ARE TYPICAL. ACTUAL DIMENSIONS AND QUANTITIES FOR CONCRETE AND REINFORCEMENT SHALL BE AS REQUIRED IN THE WORK. QUANTITIES INCLUDE VOLUMES OCCUPIED BY PIPES.
- STRUCTURAL STEEL SHALL BE GALVANIZED AND SHALL BE IN ACCORDANCE WITH SUBSECTION 712.06.
- ALL MANHOLE COVERS SHALL BE CAST WITH A "NO DUMPING DRAINS TO STREAM" MESSAGE AND A FISH SYMBOL. THE SURFACE OF THE MANHOLE COVER SHALL HAVE A NON-SLIP PATTERN.

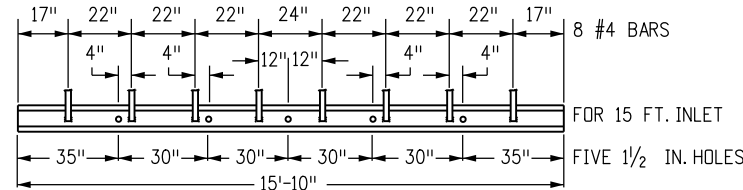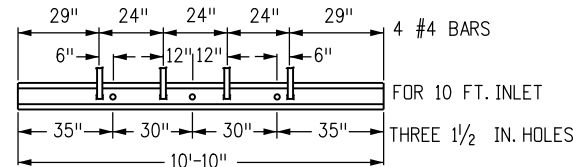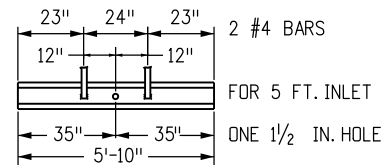


CHANNEL LAYOUT DETAILS
SEE CURB FACE ASSEMBLY ON SHEET 1.

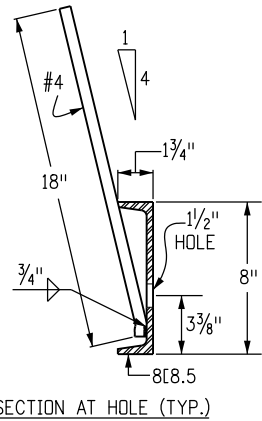


SECTION AT HOLE (TYP.)


Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	CURB INLET TYPE R	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)	Date:	Comments			M-604-12	
Designer Initials: JBK						Standard Sheet No. 2 of 2	
Last Modification Date: 07/31/19						Project Sheet Number:	
Detailer Initials: LTA							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English							

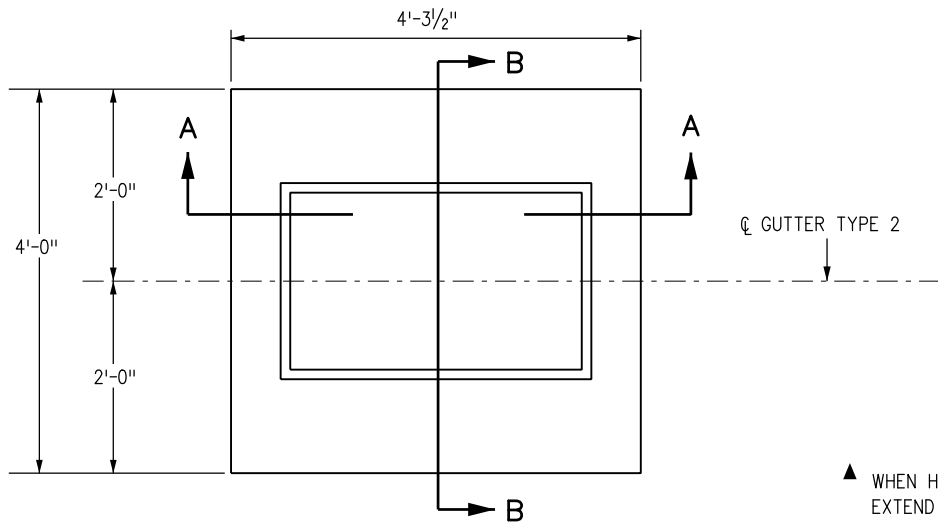


PLAN VIEW
TYPE 13 INLET FOR GUTTER TYPE 2

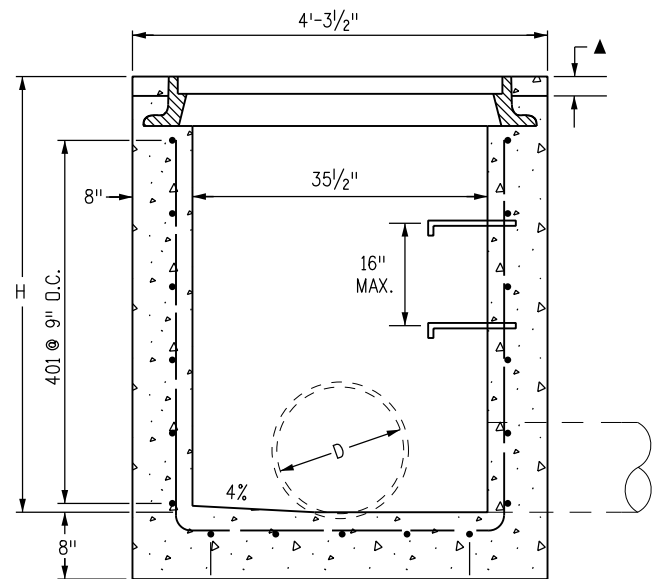

SECTION A-A
D MAX = 30 IN. FOR H > 4 FT.

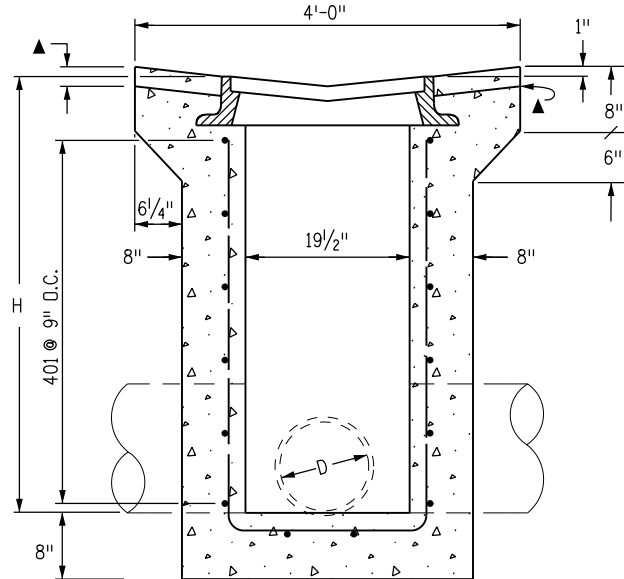


SECTION B-B
D MAX = 18 IN. FOR ALL H

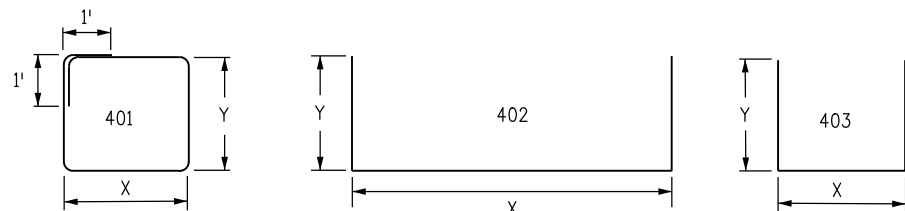


BENDING DIAGRAMS
ALL DIMENSIONS ARE OUT-TO-OUT OF BAR.

▲ WHEN HMA MATERIAL IS TO
EXTEND TO THE EDGE OF
THE GRATING FRAME,
CONCRETE MAY BE DEPRESSED.

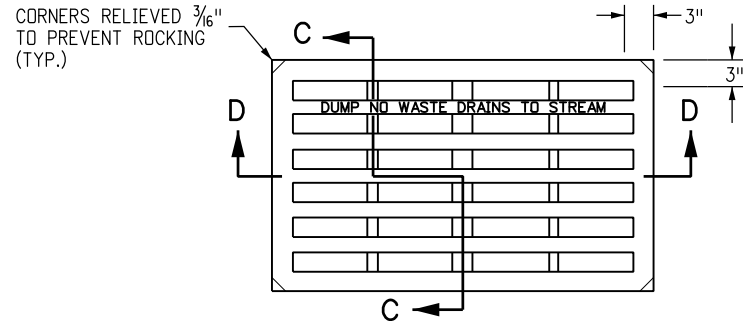


NO. 13 GRATE

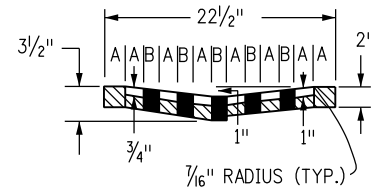


SECTION C-C


A = 1 3/4\"
B = 1 11/16\"
C = 7 15/16\"

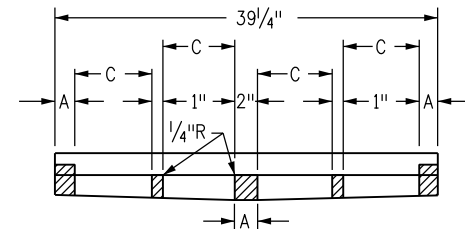

SECTION D-D

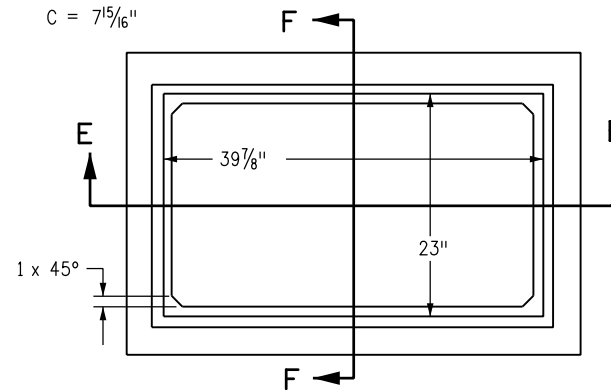


NO. 13 GRATING & FRAMES

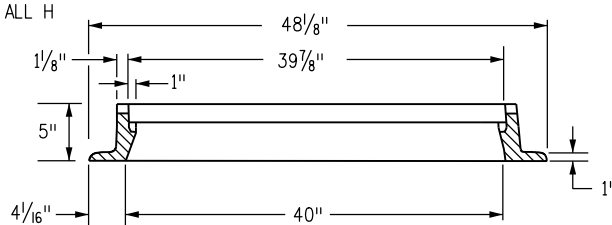

SECTION E-E

APPROXIMATE WEIGHT = 590 LBS.

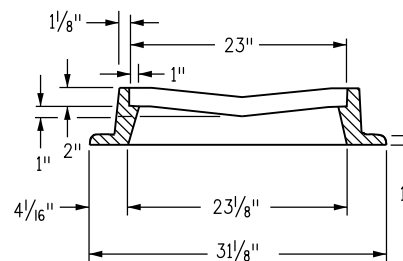

SECTION F-F

GENERAL NOTES

1. CONCRETE SHALL BE CLASS B. INLET MAY BE CAST-IN-PLACE OR PRECAST.
2. CAST-IN-PLACE CONCRETE WALLS SHALL BE FORMED ON BOTH SIDES.
3. EXPOSED CONCRETE CORNERS SHALL BE CHAMFERED 3/4 OF A INCH.
4. REINFORCING BARS SHALL BE DEFORMED #4 AND SHALL HAVE A 2 INCH MINIMUM CLEARANCE. ALL REINFORCING BARS SHALL BE GRADE 60 AND EPOXY COATED.
5. STEPS SHALL BE PROVIDED WHEN INLET DIMENSION "H" IS EQUAL TO OR GREATER THAN 3 FEET-6 INCHES AND SHALL CONFORM TO AASHTO M 199.
6. ALL GRATES AND FRAMES SHALL BE GRAY OR DUCTILE CAST IRON IN ACCORDANCE WITH SUBSECTION 712.06. GRATES AND FRAMES SHALL BE DESIGNED TO WITHSTAND HS 20 LOADING.
7. STATION POINT IS AT THE CENTER OF THE INLET.
8. GRATE SHALL HAVE "DUMP NO WASTE DRAINS TO STREAM" MESSAGE CAST ON SURFACE.

H	CONCRETE	REINFORCING STEEL	NO. OF 401 BARS REQ'D.	MAXIMUM PIPE I.D.	
	CU. YDS.	Ø LB.		SEC. A-A	SEC. B-B
				IN.	IN.
3'-0"	1.3	72	4	18	18
3'-6"	1.5	76	4	24	18
4'-0"	1.6	90	5	30	18
4'-6"	1.8	104	6	30	18
5'-0"	1.9	109	6	30	18
5'-6"	2.1	122	7	30	18
6'-0"	2.2	136	8	30	18
6'-6"	2.4	141	8	30	18
7'-0"	2.5	154	9	30	18
7'-6"	2.7	168	10	30	18
8'-0"	2.8	173	10	30	18
8'-6"	3.0	187	11	30	18
9'-0"	3.1	200	12	30	18
9'-6"	3.3	205	12	30	18
10'-0"	3.4	219	13	30	18

Ø INCLUDES 1% FOR OVERRUN.
NOTE: CONCRETE QUANTITIES INCLUDE VOLUME OCCUPIED BY PIPE.

QUANTITIES FOR ONE INLET

MARK	NO. REQ'D.	DIMENSIONS		LENGTH
		X	Y	
401	4	3'-6"	2'-2"	13'-4"
402	2	3'-4 1/2"	* 2'-6 1/2"	8'-5 1/2"
403	5	2'-1 1/2"	* 2'-7"	7'-2 1/2"

* ADD 6 IN. TO THIS DIMENSION FOR EACH 6 IN. INCREASE OF "H" OVER 3 FT.-0 IN.

BAR LIST FOR H = 3 FT.-0 IN.

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

Sheet Revisions

Date:	Comments
(R-X)	
(R-X)	
(R-X)	
(R-X)	

Colorado Department of Transportation

2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch

JBK

CONCRETE INLET TYPE 13


Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.

M-604-13


Standard Sheet No. 1 of 1

Project Sheet Number:

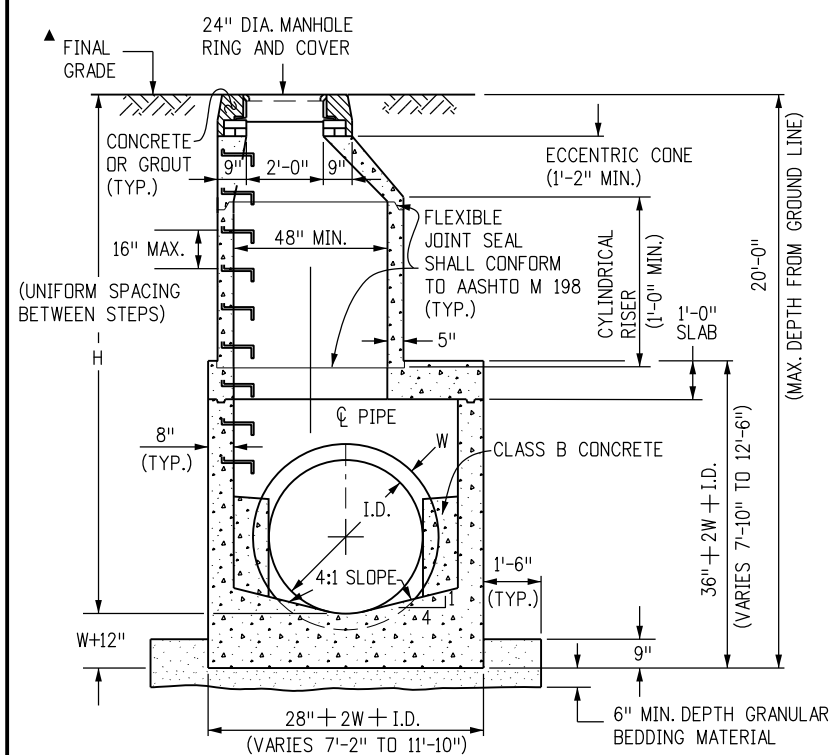


SECTION

MAH HOLE BOX BASE

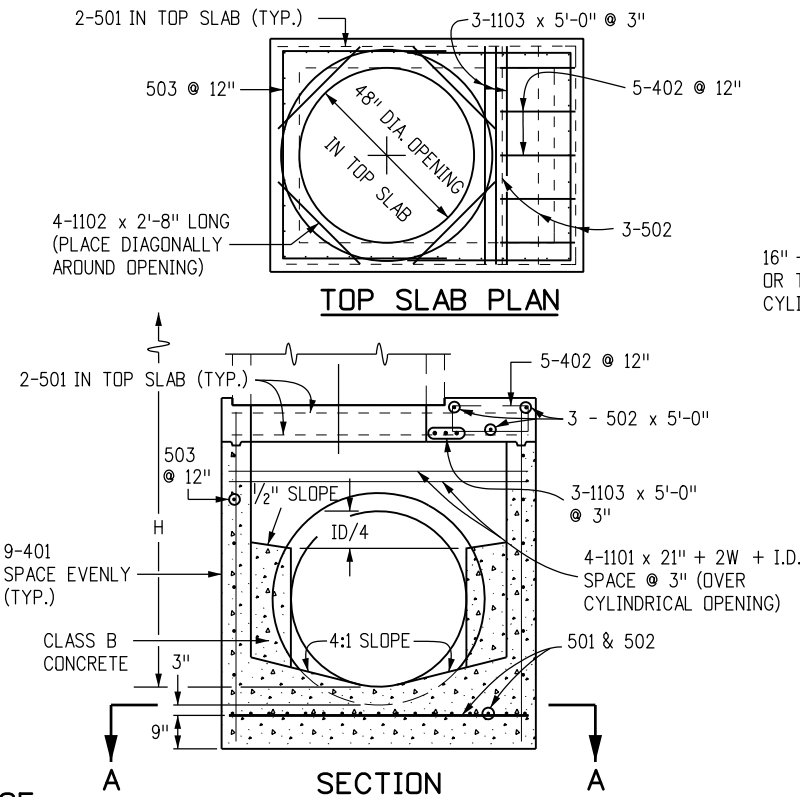


TOP SLAB PLAN

SECTION

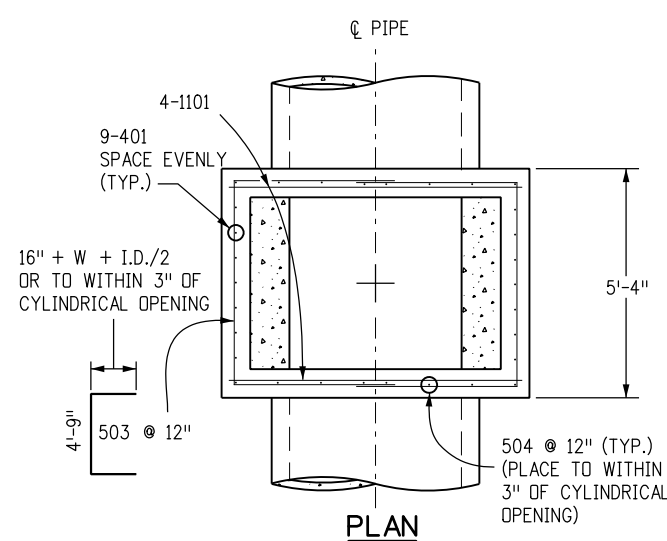

PLAN

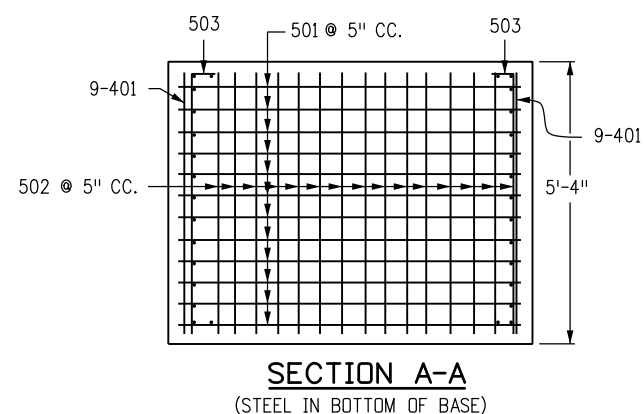


SECTION A-A
(STEEL IN BOTTOM OF BASE)

- GENERAL NOTES**
1. SINCE ALL PIPE ENTRIES INTO THE BASE ARE VARIABLE, THE DIMENSIONS SHOWN ARE TYPICAL. ACTUAL DIMENSIONS AND QUANTITIES FOR CONCRETE AND REINFORCEMENT SHALL BE AS REQUIRED IN THE WORK.
 2. THE PRECAST FLAT TOP MAY BE USED ON ANY MANHOLE. THE ECCENTRIC CONE MAY BE USED WHEN THE MANHOLE "H" HEIGHT IS AT LEAST 8 FT.
 3. THE MANHOLE RING FRAME SHALL BE SET IN A BED OF GROUT. THE FRAME SHALL BE SURROUNDED WITH A CEMENT GROUT IN UNPAVED AREA, OR A CONCRETE COLLAR IN PAVED AREA. SEE DETAILS ON SHEETS 2 AND 3.
 4. DESIGN OF BOX BASE IS BASED ON STRAIGHT RUNS OF PIPE OR CHANGE IN DIRECTION OF LESS THAN 45°. SPECIAL DESIGN IS REQUIRED FOR 45° OR GREATER.
 5. PRECAST MANHOLES AND REINFORCEMENT SHALL CONFORM TO AASHTO M 199 (ASTM C 478).
 6. CAST-IN-PLACE MANHOLES SHALL BE CLASS B CONCRETE.
 7. STEPS SHALL BE REQUIRED WHEN THE MANHOLE DEPTH EXCEEDS 3 FT.-6 IN. AND SHALL CONFORM TO AASHTO M 199.
 8. ALL REINFORCING STEEL SHALL BE GRADE 60 AND EPOXY COATED. VERTICAL STEEL SHALL BE PLACED AT CENTERLINE OF WALL. ALL BARS SHALL HAVE A 2 IN. MINIMUM CLEARANCE.
 9. ALL PIPE ENTRIES INTO THE BASE OF MANHOLE SHALL BE CONNECTED BY OPEN CHANNELIZATION ADJUSTED FOR PIPE SIZE, SHAPE, SLOPE, AND DIRECTION OF FLOW. DETAILS SHOWN ARE TYPICAL FOR INSTALLATIONS WITH ALL INVERTS OF SAME RELATIVE ELEVATION. FOR EXCESSIVE ELEVATION DIFFERENCE BETWEEN INVERTS, SPECIAL BASE/CHANNEL DETAILS WILL BE SHOWN ON THE PLANS.
 10. FLOW CHANNELS AND INVERTS SHALL BE FORMED BY SHAPING WITH CLASS B CONCRETE OR APPROVED GROUT.
 11. STUB-OUTS SHALL EXTEND 2 FT. MINIMUM BEYOND OUTSIDE WALL SURFACE OF MANHOLE AND BE SATISFACTORILY PLUGGED.
 12. THE SLOPE OF THE MANHOLE COVER SHALL MATCH THE ROADWAY PROFILE AND CROSS SLOPE.
- ▲ WHEN FINAL GRADE IS PAVEMENT SURFACE, RECESS MANHOLE RING AND COVER 1/4" MIN. TO 1/2" MAX.


MARK	SIZE	TYPE	WT. #/FT.	BARS	I.D.						FORMULAS
					54"	60"	66"	72"	84"	96"	
401	4	I	0.668	{NO. REQ'D. LENGTH WEIGHT *	18 8'-1" 97.2	18 8'-8" 104.2	18 9'-3" 111.2	18 9'-10" 118.2	18 11'-0" 132.3	18 12'-2" 146.3	401 BAR LENGTH = 32" + 2W + I.D.
402	4	III	0.668	{NO. REQ'D. LENGTH WEIGHT *	5 5'-5" 18.1	5 6'-0" 20.0	5 6'-7" 22.0	5 7'-2" 23.9	5 8'-4" 27.8	5 9'-6" 31.7	402 BAR LENGTH = I.D. + 2W
501	5	I	1.043	{NO. REQ'D. LENGTH WEIGHT *	17 7'-5" 131.5	17 8'-0" 141.8	17 8'-7" 152.2	17 9'-2" 162.5	17 10'-4" 183.2	17 11'-6" 203.9	501 BAR LENGTH = 24" + I.D. + 2W
502	5	I	1.043	{NO. REQ'D. LENGTH WEIGHT *	22 5'-0" 114.7	23 5'-0" 119.9	25 5'-0" 130.4	26 5'-0" 135.6	29 5'-0" 151.2	32 5'-0" 166.9	502 NUMBER BARS REQ'D. = 3 + (24+I.D.+2W / 5") + 1
503	5	II	1.043	{NO. REQ'D. LENGTH WEIGHT *	16 12'-10" 214.2	16 13'-5" 223.9	18 14'-0" 262.8	18 14'-7" 273.8	20 15'-9" 328.5	24 16'-11" 423.5	503 NUMBER BARS REQ'D. = 2 (13+I.D.+2W / 12") + 1 BAR LENGTH = 4'-9"+2(16+W+I.D./2)
504	5	I	1.043	{NO. REQ'D. LENGTH WEIGHT *	12 8'-1" 101.2	14 8'-8" 126.6	14 9'-3" 135.1	16 9'-10" 164.1	18 11'-0" 206.5	20 12'-2" 253.8	504 NUMBER BARS REQ'D. = 2 (2W+I.D.-4 / 12") + 1 BAR LENGTH = 32"+2W+I.D.
1101	11	I	5.313	{NO. REQ'D. LENGTH WEIGHT *	4 7'-2" 152.3	4 7'-9" 164.7	4 8'-4" 177.1	4 8'-11" 189.5	4 10'-1" 214.3	4 11'-3" 239.1	1101 BAR LENGTH = 21" + I.D. + 2W
1102	11	I	5.313	{NO. REQ'D. LENGTH WEIGHT *	4 2'-8" 56.7	4 2'-8" 56.7	4 2'-8" 56.7	4 2'-8" 56.7	4 2'-8" 56.7	4 56.7 2'-8"	
1103	11	I	5.313	{NO. REQ'D. LENGTH WEIGHT *	3 5'-0" 79.7	3 5'-0" 79.7	3 5'-0" 79.7	3 5'-0" 79.7	3 5'-0" 79.7	3 5'-0" 79.7	
* REINFORCING STEEL TOTAL					965.6	1,037.5	1,127.2	1,204.0	1,380.2	1,601.6	
CONCRETE - CUBIC YARDS - TOTAL					6.0	6.6	7.3	8.0	9.5	11.1	
NOTE: QUANTITIES ARE BASED ON SAME SIZE PIPE ENTRANCE TO AND EXIT FROM, BASE AND A 4 FT. MANHOLE ENTRANCE INTO TOP SLAB OF BASE.											

QUANTITIES FOR CONCRETE MANHOLE BOX BASE

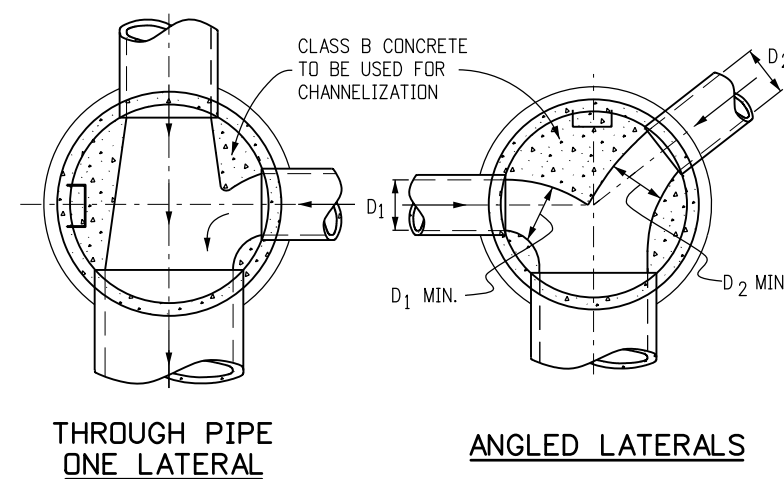

THROUGH PIPE
ONE LATERAL


ANGLED LATERALS

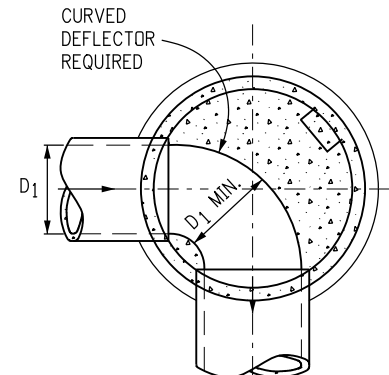


SHARP ANGLE

TYPICAL CHANNELIZATION DETAILS




Computer File Information			Sheet Revisions		Colorado Department of Transportation	MANHOLES	STANDARD PLAN NO.
Creation Date: 07/31/19			Date:	Comments			
Designer Initials: JBK	(R-X)				2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868	M-604-20	Standard Sheet No. 1 of 3
Last Modification Date: 07/31/19	(R-X)						
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						
Project Development Branch					JBK	Issued by the Project Development Branch: July 31, 2019	Project Sheet Number:

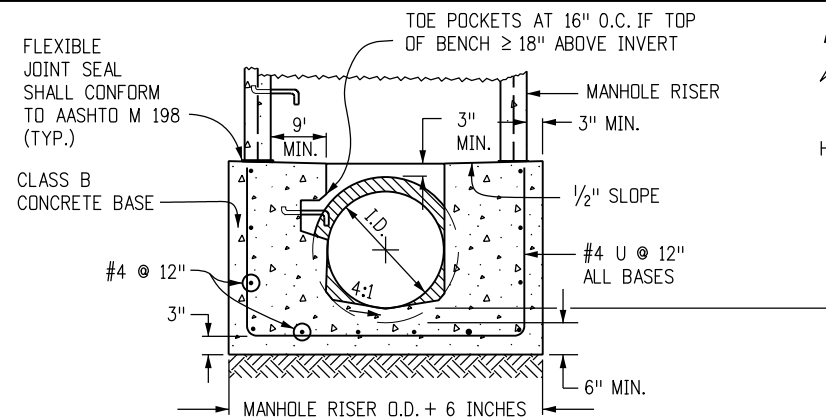

SECTION B-B

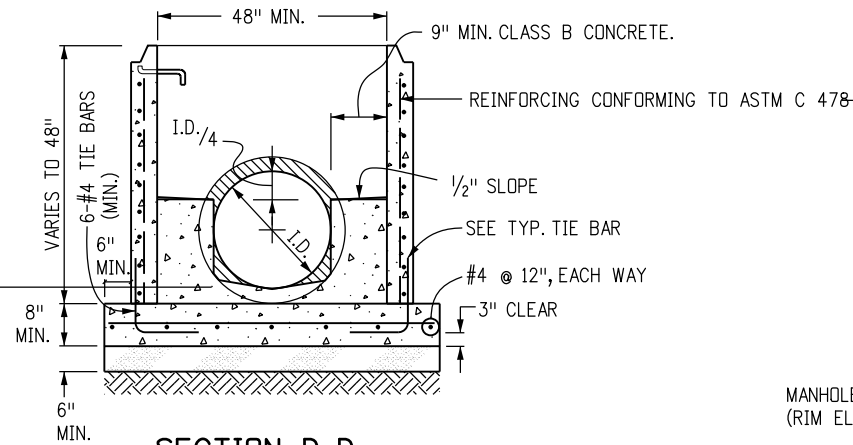


SECTION D-D

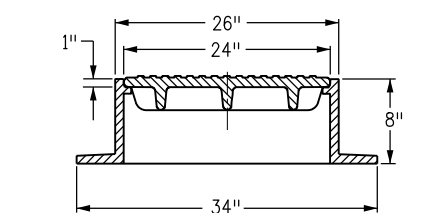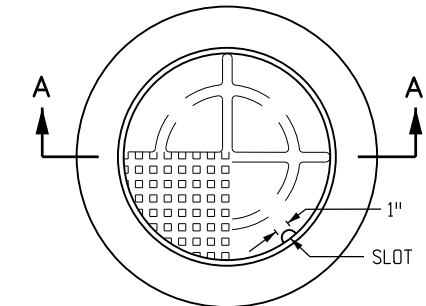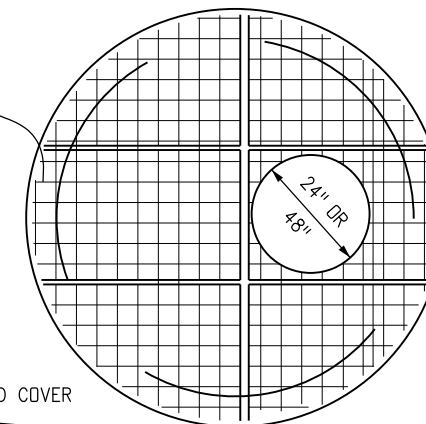


TOTAL WEIGHT: APPROXIMATELY 400 LBS.
SHALL BE GRAY OR DUCTILE CAST
IRON IN ACCORDANCE WITH
SUBSECTION 712.06.

SECTION A-A
MANHOLE RING AND COVER

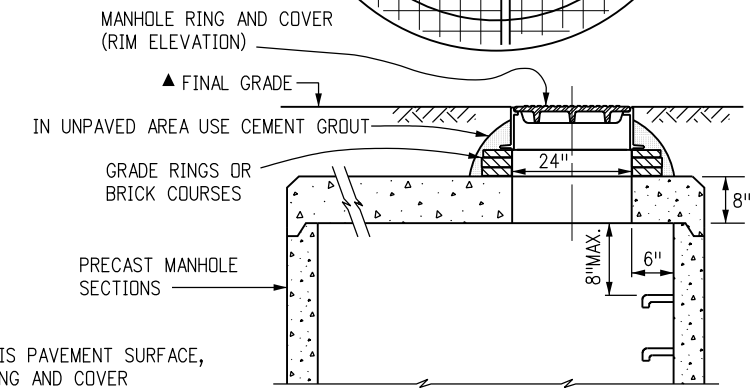


FLAT TOP SECTION DETAIL


▲ WHEN FINAL GRADE IS PAVEMENT SURFACE,
RECESS MANHOLE RING AND COVER
1/4" MIN. TO 1/2" MAX.

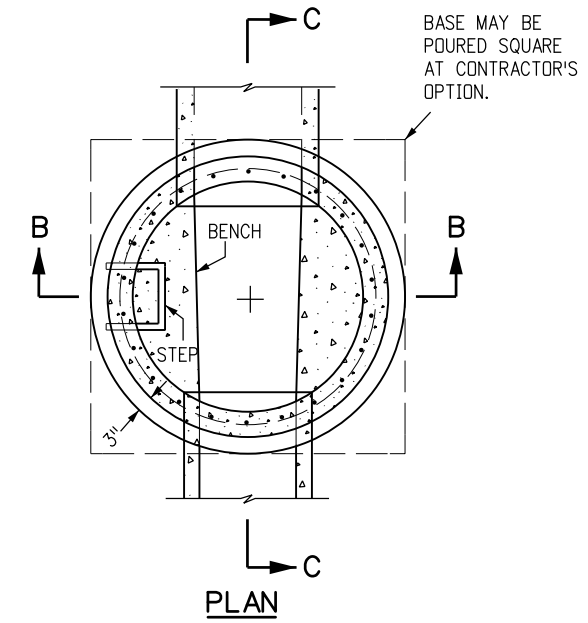


PLAN



TYPICAL
TIE BAR

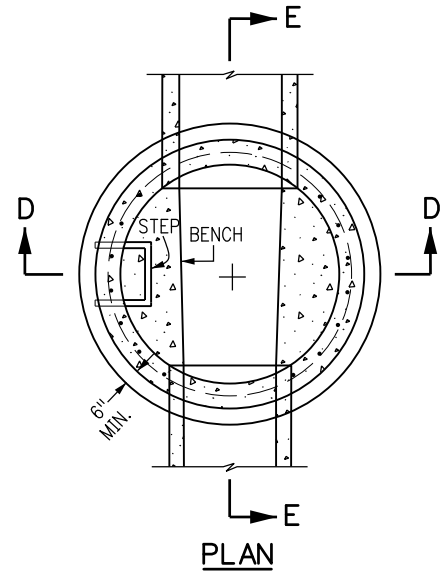


PLAN

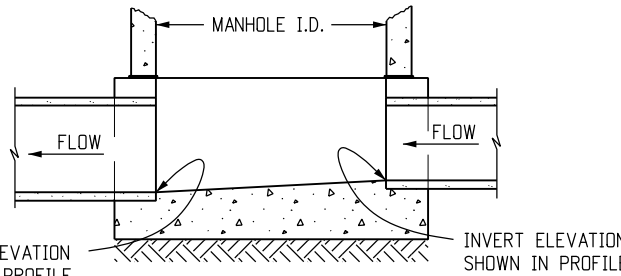


SECTION C-C

CAST-IN-PLACE SLAB BASE

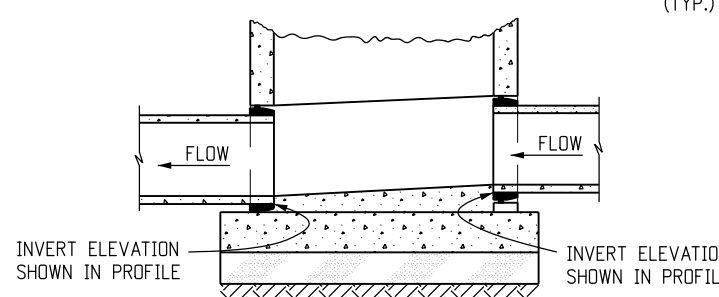


SECTION E-E

PRECAST SLAB BASE

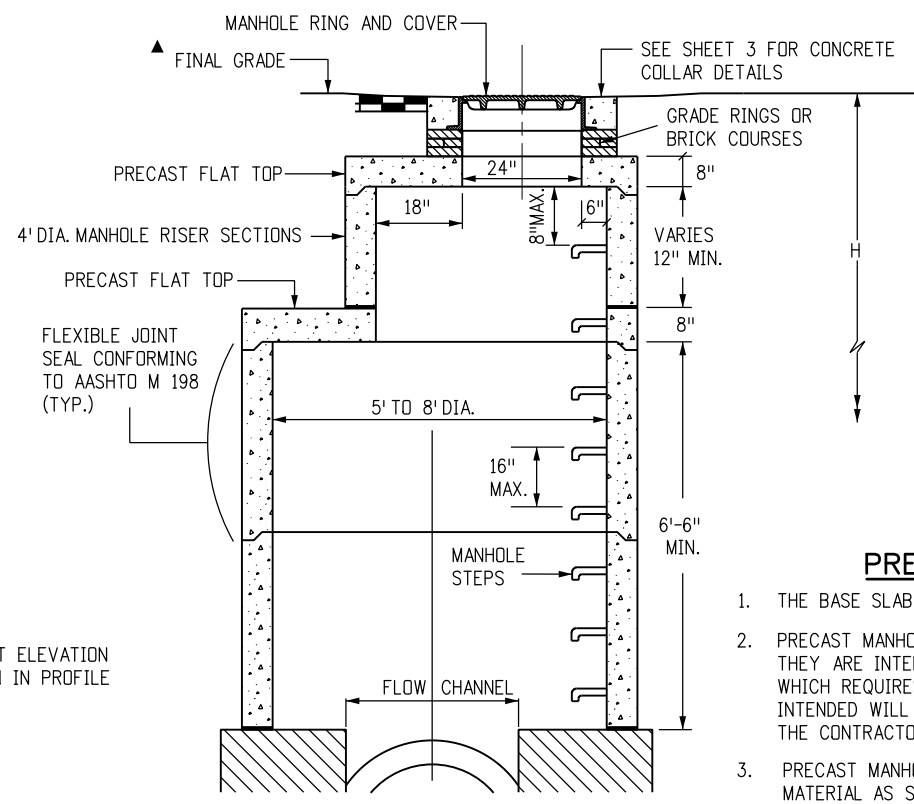

MANHOLE RISER DETAIL

LEGEND

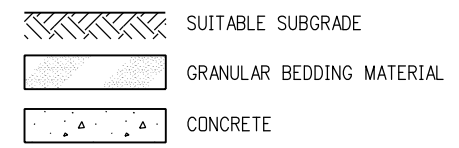

PRECAST MANHOLE BASES NOTES:

1. THE BASE SLAB SHALL BE POURED MONOLITHICALLY WITH BOTTOM RISER SECTION.
2. PRECAST MANHOLE BASES SHALL FIT THE CONDITIONS AND LOCATIONS FOR WHICH THEY ARE INTENDED WITHOUT ANY FIELD MODIFICATIONS. ANY MANHOLE BASE WHICH REQUIRES FIELD CUTTING OR MODIFICATION IN ORDER TO FIT THE LOCATIONS INTENDED WILL BE REJECTED BY THE ENGINEER AND REMOVED AND REPLACED BY THE CONTRACTOR AT NO COST TO THE DEPARTMENT.
3. PRECAST MANHOLE BASES SHALL BE BEDDED ON AN APPROVED GRANULAR BEDDING MATERIAL AS SHOWN ABOVE.

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

Sheet Revisions

Date:	Comments
(R-X)	
(R-X)	
(R-X)	
(R-X)	

Colorado Department of Transportation

2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868
Project Development Branch JBK

MANHOLES



Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.

M-604-20



Standard Sheet No. 2 of 3

Project Sheet Number:

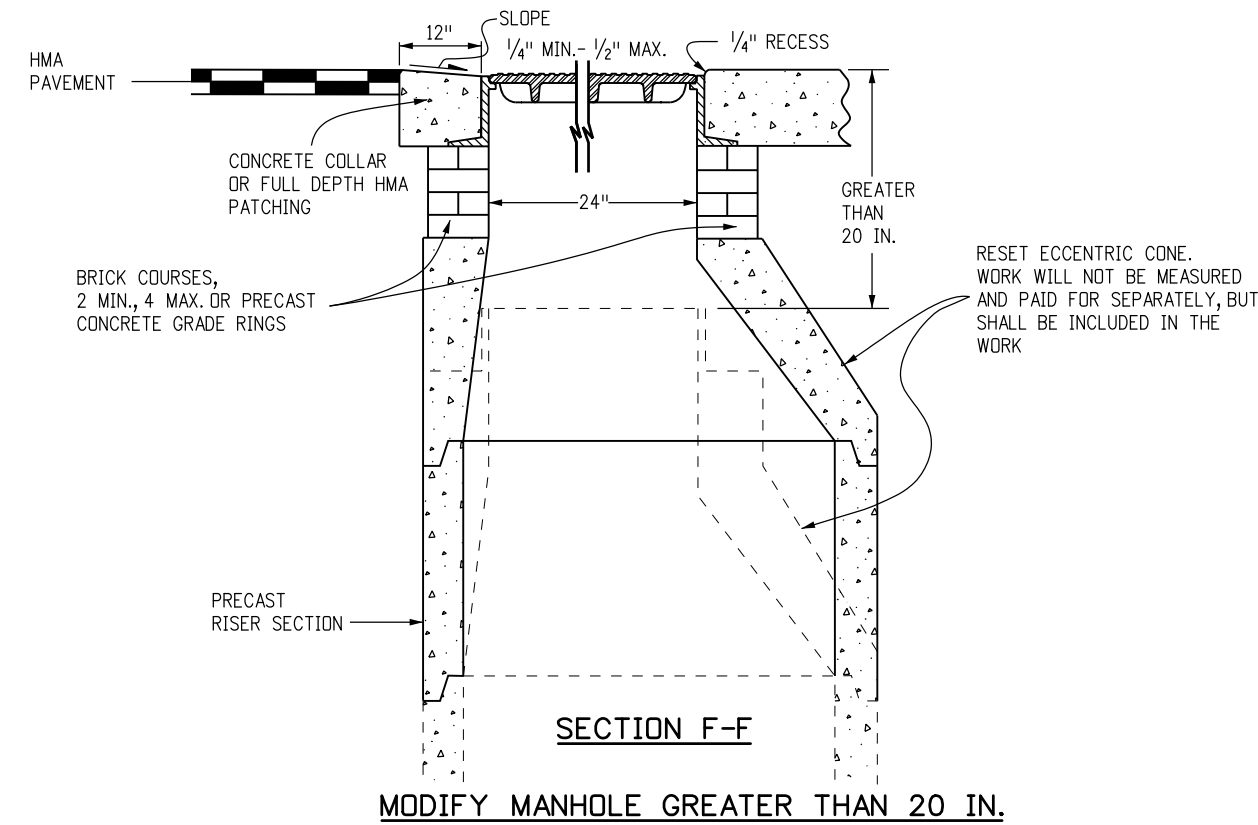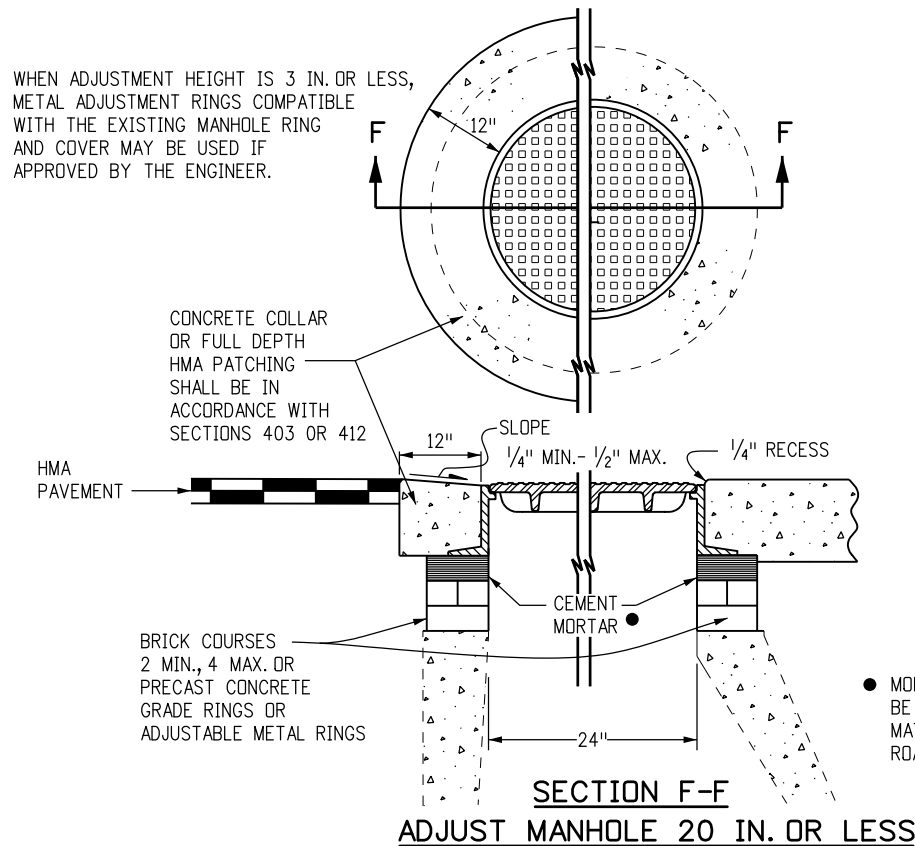




- ### T-BASE MANHOLES NOTES
1. THE T-BASE SECTION SHALL BE SHOP-FABRICATED FOR DELIVERY TO THE CONSTRUCTION SITE AS A COMPLETE UNIT.
 2. THESE DETAILS SHOW ONLY THE CONCEPTUAL AND STANDARD DIMENSIONAL REQUIREMENTS FOR TYPE T-BASE MANHOLES. THE CONTRACTOR SHALL FURNISH DETAILED SHOP DRAWINGS FOR APPROVAL PRIOR TO FABRICATION. THE DETAILS SHOWN HEREIN APPLY ONLY TO 48 IN. AND GREATER DIAMETER PIPES.
 3. EXCEPT FOR CLASS OF PIPE, SPECIFICATIONS FOR THE MANHOLE SHALL BE THE SAME AS THOSE REQUIRED FOR THE ADJOINING PIPE.
 4. THE T-BASE SECTION SHALL MAINTAIN ITS INTERNAL SHAPE AND FLOW AREA. GROUTING OR FILLING SHALL BE APPLIED SO AS TO NOT DISTURB THE NORMAL FLOW OR REDUCE THE AREA.

▲ WHEN FINAL GRADE IS PAVEMENT SURFACE, RECESS MANHOLE RING AND COVER 1/4" MIN. TO 1/2" MAX.

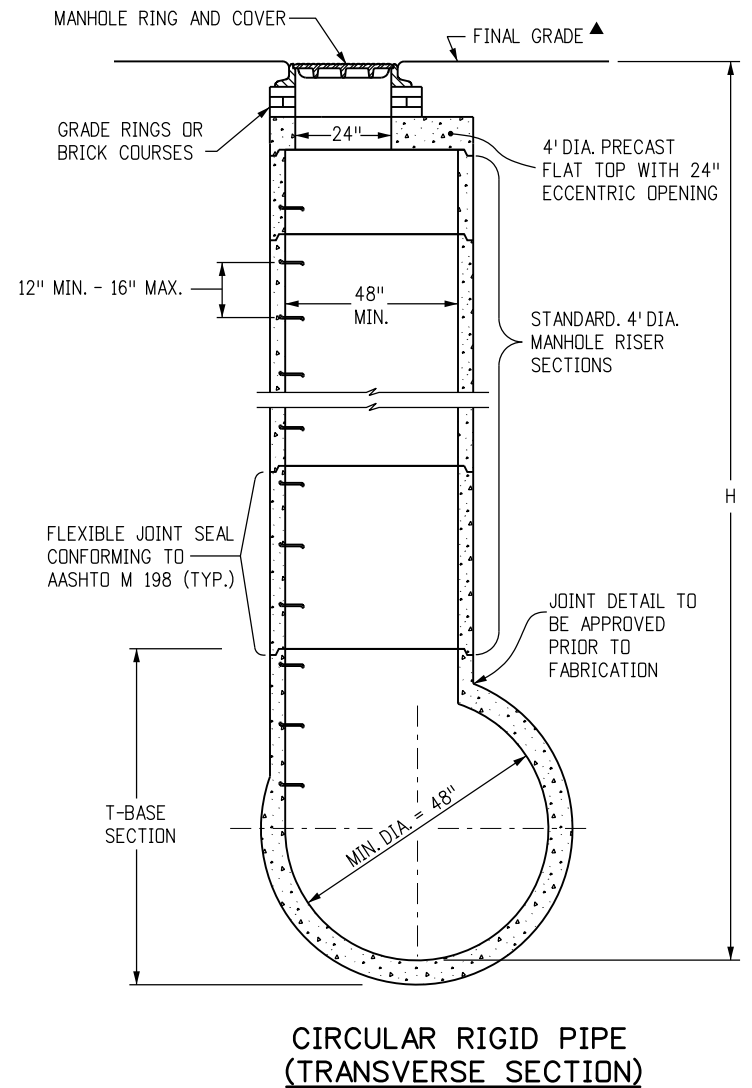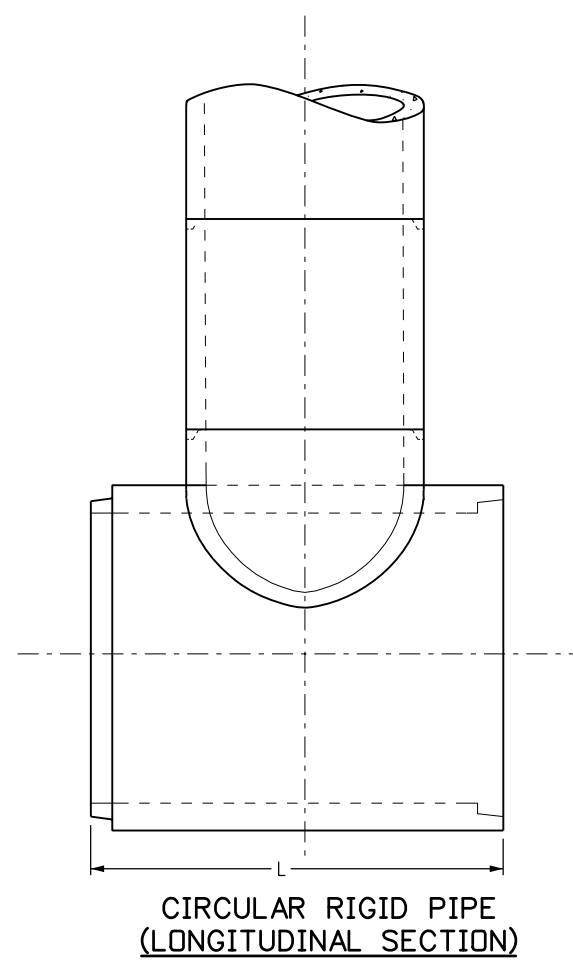

MANHOLE T-BASE

Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments		M-604-20	
Designer Initials: JBK	(R-X)				Standard Sheet No. 3 of 3	
Last Modification Date: 07/31/19	(R-X)				Project Sheet Number:	
Detailer Initials: LTA	(R-X)					
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English				Issued by the Project Development Branch: July 31, 2019		

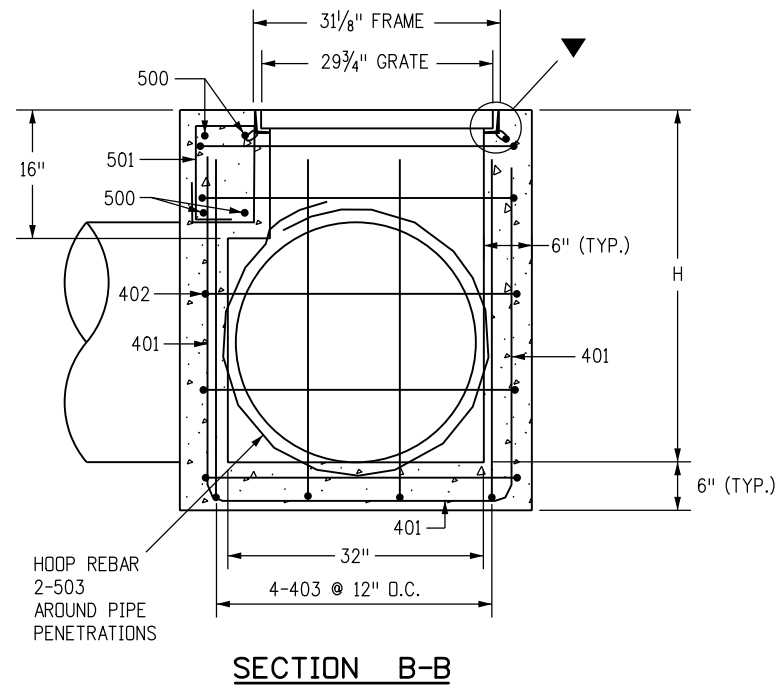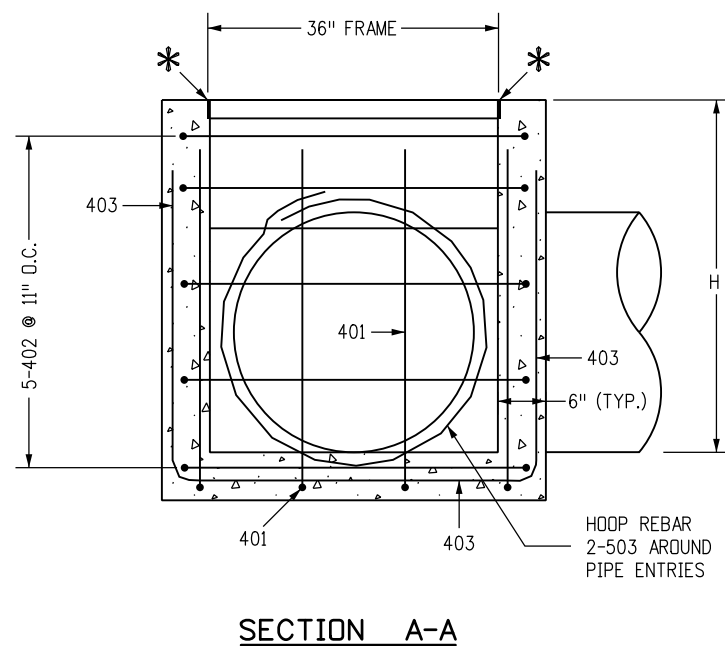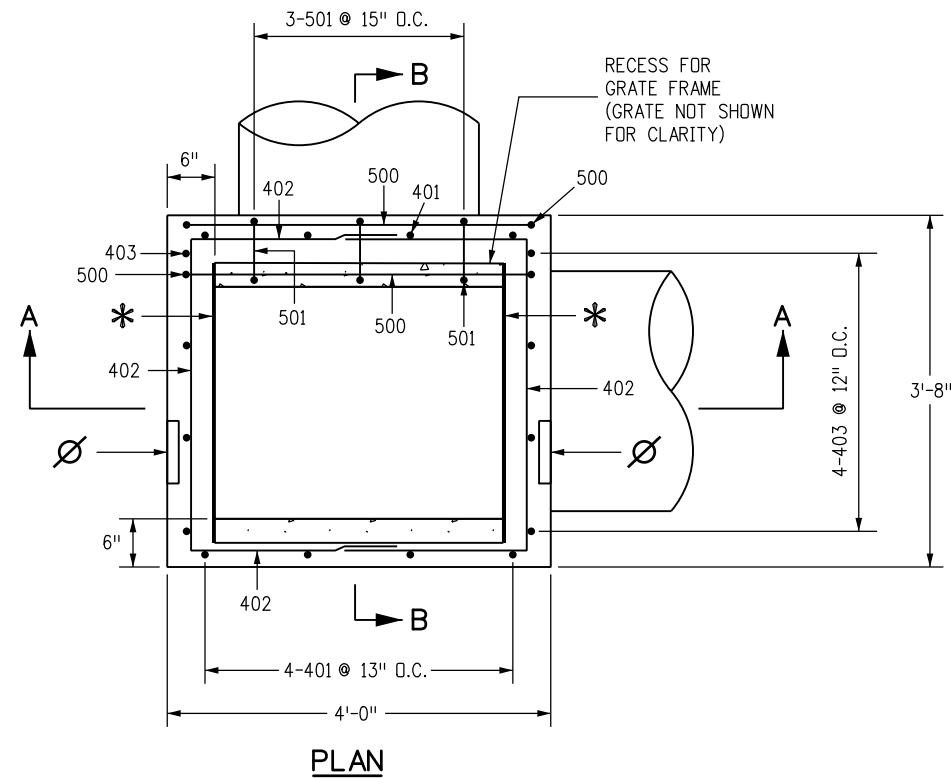

GENERAL NOTES

- FOR THE 32 INCH AND 36 INCH INSIDE INLET DIMENSIONS, THE ALLOWABLE PIPE I.D. IS 30 INCHES OR LESS. FOR THE 72 INCH INSIDE INLET DIMENSION, THE ALLOWABLE PIPE I.D. IS "H" MINUS 18 INCHES, OR LESS, UP TO A MAXIMUM OF 66 INCHES FOR "H" OF 7 FEET OR MORE.
- ALL CONCRETE SHALL BE CLASS B.
- INLET MAY BE CAST-IN-PLACE OR PRECAST.
- REINFORCING BARS SHALL BE #4 UNLESS SHOWN OTHERWISE.
- ALL REINFORCING BARS SHALL BE GRADE 60 AND EPOXY COATED. REINFORCING BARS SHALL HAVE A MINIMUM CLEARANCE OF 2 IN.
- ALL EDGE DISTANCES NOT MARKED "CLEAR" ARE TO THE CENTERLINE OF THE BAR.
- CUT OR BEND REINFORCING BARS AROUND PIPES AS REQUIRED.
- STEPS SHALL BE REQUIRED WHEN THE INLET DEPTH "H" IS EQUAL TO OR GREATER THAN 4 FT. AND SHALL CONFORM TO AASHTO M 199.
- THE INVERT OF THE BOX SHALL BE SLOPED TO DRAIN.
- THE CONTRACTOR SHALL STAMP FLOW ARROWS INTO THE TOP SURFACE OF THE INLET BOX SIDEWALLS TO INDICATE THE DIRECTION OF RUNOFF. THE STAMPED ARROWS SHALL BE 6 IN. LONG, 1 IN. HIGH, AND 3/8 IN. DEEP. FOR INLETS IN SUMP CONDITIONS, THE STAMPED FLOW ARROWS SHALL INDICATE THE PREDOMINATE DIRECTION OF RUNOFF FLOW.
- A 4 IN. DIA. STAINLESS STEEL MEDALLION WITH "NO DUMPING DRAINS TO STREAM" OR SIMILAR MESSAGE SHALL BE FIRMLY ATTACHED TO TOP OF THE INLET SURFACE WITH A PERMANENT FASTENER. THE MEDALLION WILL HAVE A FISH SYMBOL AND BLUE COLOR BACKGROUND. ALTERNATIVELY, THIS MESSAGE MAY BE CAST WITH 1 IN. HEIGHT LETTERS INTO THE TOP OF THE INLET'S CONCRETE SURFACE OR SURROUNDING CONCRETE APRON. THE NO DUMPING MESSAGE SHALL BE ELIMINATED FOR INLETS LOCATED WITHIN THE SHOULDER OF CONTROLLED ACCESS FREEWAYS WHEN SPECIFIED IN THE PLANS.

LEGEND

- ▼ GRATE TO BE INSTALLED DURING CONSTRUCTION OF THE BOX WITH THE VANE GRATE BOLTED IN PLACE TO THE FRAME.
- * TO FACILITATE REMOVAL OF THE GRATE, PLACE PLYWOOD 3 IN. x 1/4 IN. x 31-3/8 IN. ALONG EDGE OF THE GRATE AS SHOWN.
- Ø FLOW ARROW STAMP IN DIRECTION OF FLOW (TYP.). FLOW →

Computer File Information

Creation Date: 07/31/19
 Designer Initials: JBK
 Last Modification Date: 07/31/19
 Detailer Initials: LTA
 CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

Sheet Revisions

Date:	Comments
(R-X)	
(R-X)	
(R-X)	
(R-X)	

Colorado Department of Transportation
 2829 West Howard Place
 CDOT HQ, 3rd Floor
 Denver, CO 80204
 Phone: 303-757-9021 FAX: 303-757-9868
Project Development Branch JBK

VANE GRATE INLET


Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.


M-604-25

Standard Sheet No. 1 of 5


Project Sheet Number:

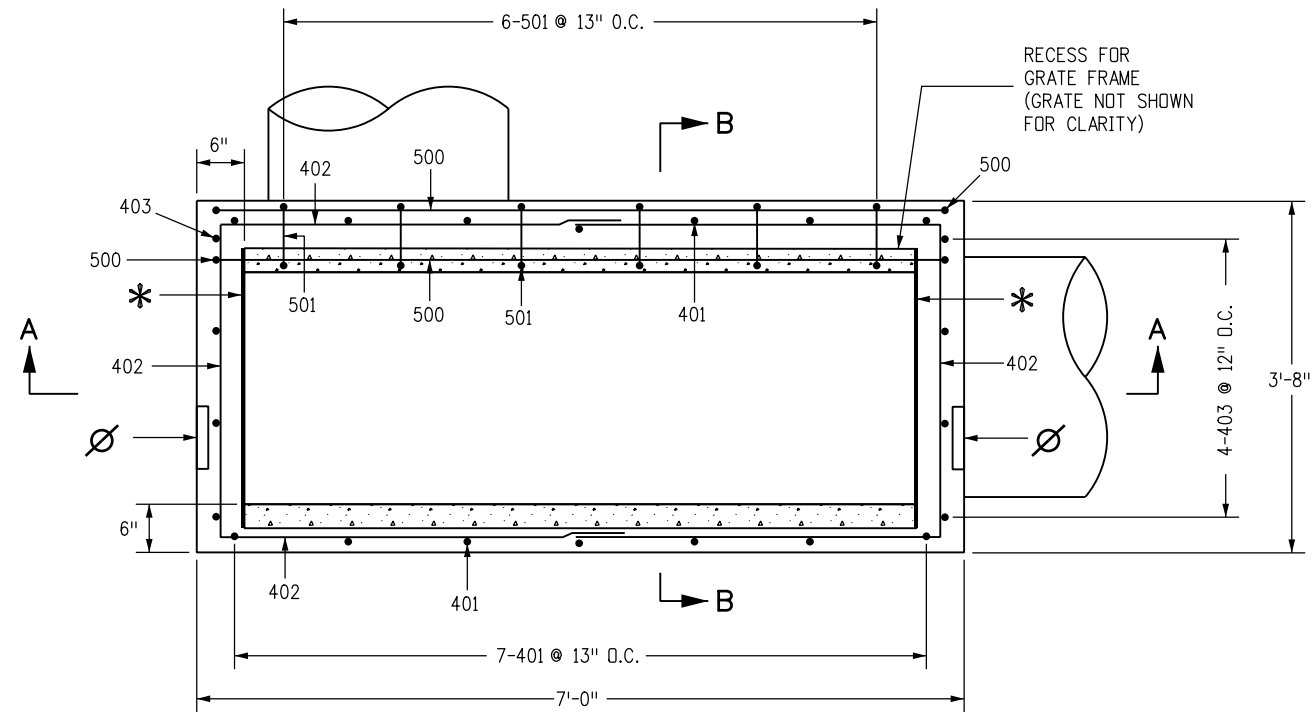

PLAN

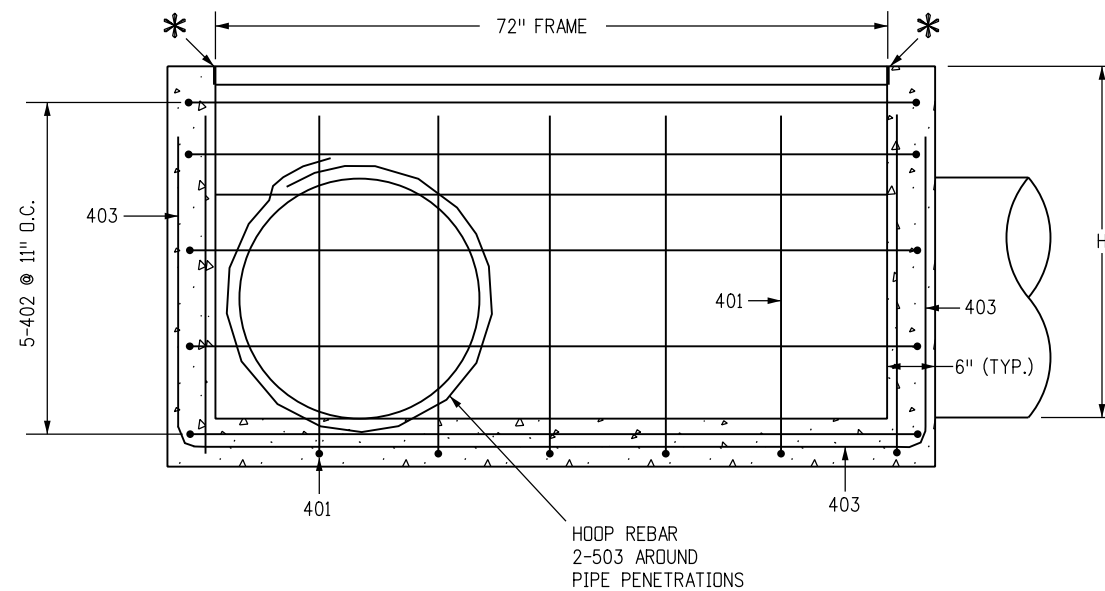

SECTION A-A

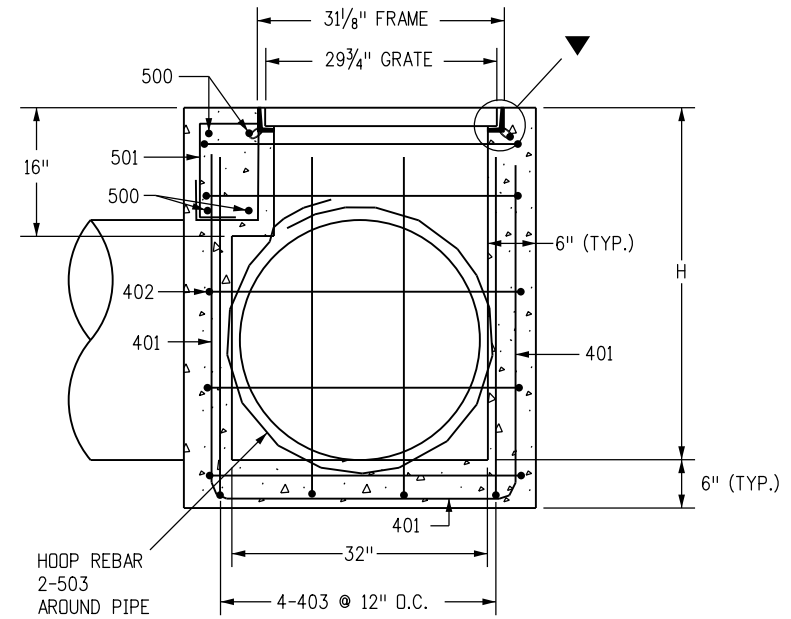

SECTION B-B

LEGEND

- ▼ GRATE TO BE INSTALLED DURING CONSTRUCTION OF THE BOX WITH THE VANE GRATE BOLTED IN PLACE TO THE FRAME.
- * TO FACILITATE REMOVAL OF THE GRATE, PLACE PLYWOOD 3 IN. x 1/4 IN. x 31-3/8 IN. ALONG EDGE OF THE GRATE AS SHOWN.
- Ø FLOW ARROW STAMP IN DIRECTION OF FLOW (TYP.). FLOW →

Computer File Information

Creation Date: 07/31/19
 Designer Initials: JBK
 Last Modification Date: 07/31/19
 Detailer Initials: LTA
 CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

Sheet Revisions

Date:	Comments
(R-X)	
(R-X)	
(R-X)	
(R-X)	

Colorado Department of Transportation
 2829 West Howard Place
 CDOT HQ, 3rd Floor
 Denver, CO 80204
 Phone: 303-757-9021 FAX: 303-757-9868
 Project Development Branch JBK

VANE GRATE INLET


Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.


M-604-25

Standard Sheet No. 2 of 5

Project Sheet Number:

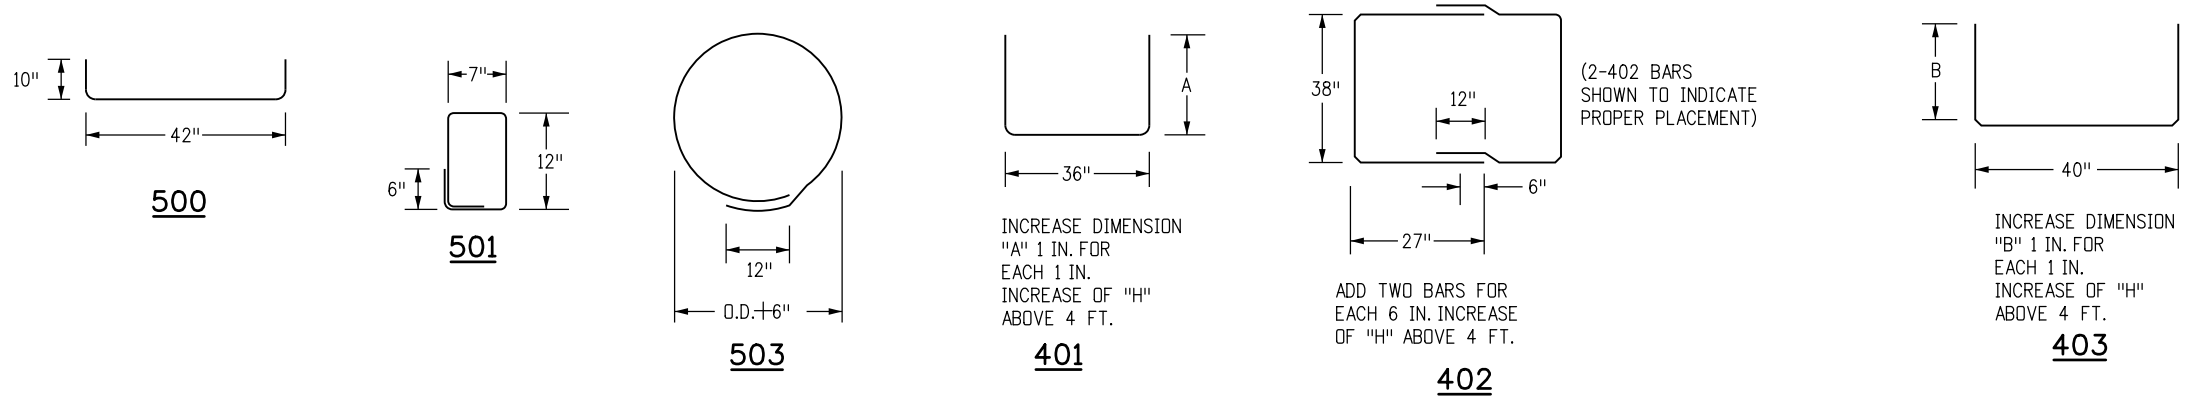

36 IN. INLET BOX BENDING DIAGRAM

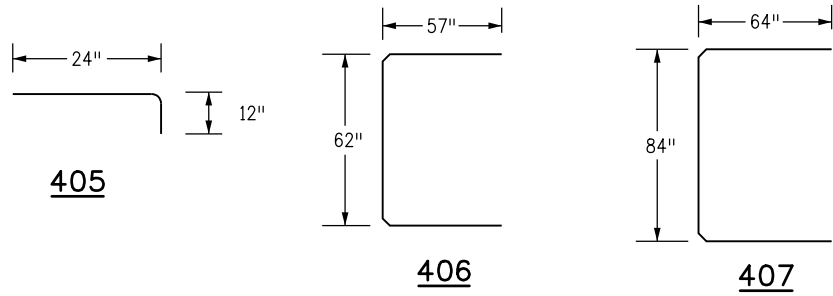

INLET APRON BENDING DIAGRAM FOR 36 IN. INLET

MARK	NO. REQ'D	LENGTH (EACH)
405	9	3'-0"
406	1	14'-8"
407	1	17'-8"

BAR LIST FOR CONCRETE APRON

(FOR INFORMATION ONLY)

MARK	NO. REQ'D	HEIGHT "A"	HEIGHT "B"	LENGTH (EACH)
500	4			5'-2"
501	3			4'-2"
503	4			10'-5"
401	4	3'-10"		10'-8"
402	10			7'-8"
403	4		4'-0"	11'-4"

BAR LIST FOR H = 4'-0" 36 IN. INLET

QUANTITIES FOR ONE 36 IN. INLET


H	NUMBER OF STEPS REQUIRED	CONC. CU. YD.	STEEL LBS.
4'-0"	1	1.3	180
4'-6"	2	1.5	186
5'-0"	2	1.6	201
5'-6"	2	1.7	207
6'-0"	3	1.8	222
6'-6"	3	1.9	227
7'-0"	3	2.1	243
7'-6"	4	2.2	248
8'-0"	4	2.3	263
8'-6"	4	2.4	269
9'-0"	5	2.5	285
9'-6"	5	2.7	289
10'-0"	5	2.8	306
10'-6"	6	2.9	310
11'-0"	6	3.0	326
11'-6"	6	3.1	331

NOTES


1. CONCRETE QUANTITY INCLUDES VOLUME OCCUPIED BY PIPES.
2. REINFORCING STEEL QUANTITY ASSUMES TWO 503 HOOPS FOR EACH 24 IN. PIPE.
3. BARS NUMBERED IN 400 SERIES INDICATES #4 SIZE BAR. BARS NUMBERED IN 500 SERIES INDICATES #5 SIZE BAR.
4. ALL REINFORCING BARS SHALL BE GRADE 40 AND EPOXY COATED.

QUANTITIES FOR ONE 72 IN. INLET

H	NUMBER OF STEPS REQUIRED	CONC. CU. YD.	STEEL LBS.
4'-0"	1	2.1	253
4'-6"	2	2.3	260
5'-0"	2	2.4	282
5'-6"	2	2.6	289
6'-0"	3	2.8	310
6'-6"	3	3.0	318
7'-0"	3	3.2	339
7'-6"	4	3.3	346
8'-0"	4	3.5	369
8'-6"	4	3.7	376
9'-0"	5	3.9	397
9'-6"	5	4.1	405
10'-0"	5	4.2	426
10'-6"	6	4.4	433
11'-0"	6	4.6	455
11'-6"	6	4.8	462

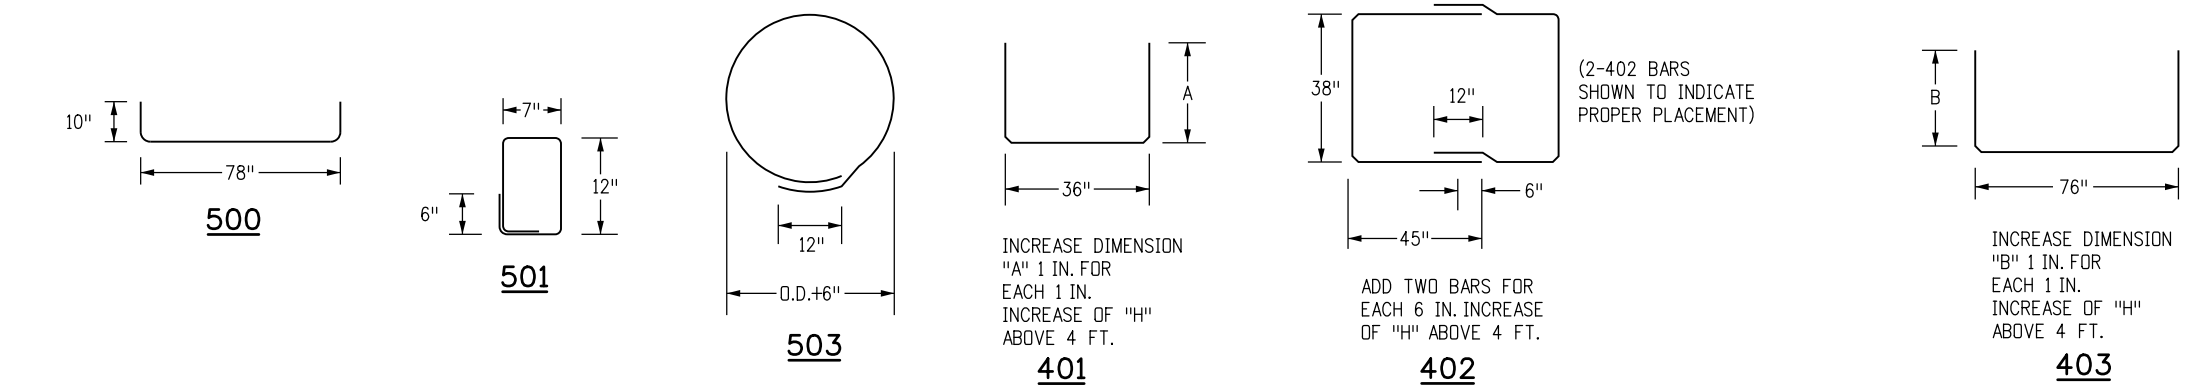

72 IN. INLET BOX BENDING DIAGRAM

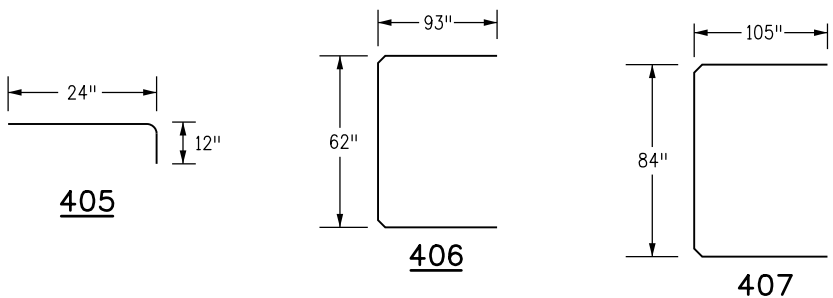

INLET APRON BENDING DIAGRAM FOR 72 IN. INLET

MARK	NO. REQ'D	LENGTH (EACH)
405	13	3'-0"
406	1	20'-8"
407	1	24'-6"


BAR LIST FOR CONCRETE APRON

(FOR INFORMATION ONLY)


MARK	NO. REQ'D	HEIGHT "A"	HEIGHT "B"	LENGTH (EACH)
500	4			8'-2"
501	6			4'-2"
503	4			10'-5"
401	7	3'-10"		10'-8"
402	10			10'-8"
403	4		4'-0"	14'-4"

BAR LIST FOR H = 4'-0" 72 IN. INLET


Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch	VANE GRATE INLET	STANDARD PLAN NO.
Creation Date: 07/31/19		Date:	Comments			M-604-25
Designer Initials: JBK						Standard Sheet No. 3 of 5
Last Modification Date: 07/31/19						Project Sheet Number:
Detailer Initials: LTA				JBK	Issued by the Project Development Branch: July 31, 2019	
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English						

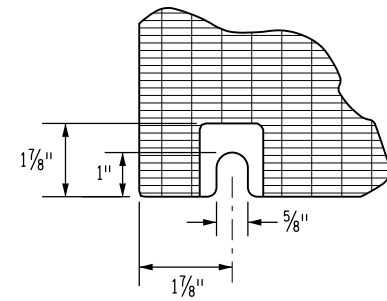


DETAIL A
BOLT SLOT AT CORNER (TYP.)

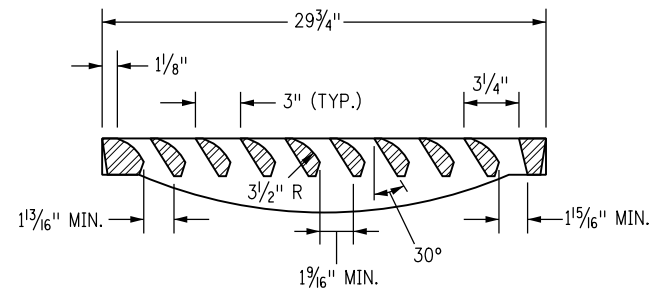

SECTION A-A

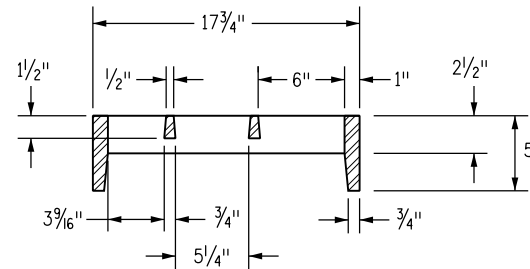


SECTION B-B

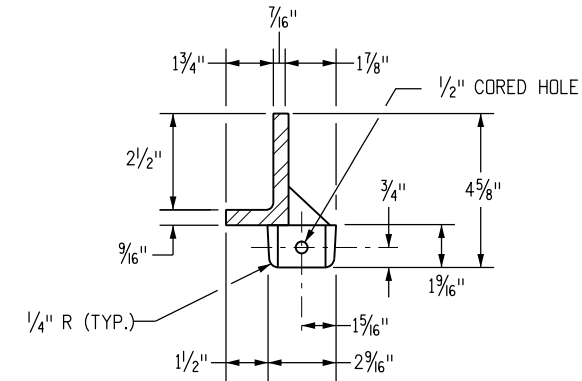


DETAIL B

NOTES


1. FREE OPEN AREA: 190 SQ. IN./GRATE.
2. MATERIAL: CAST GRAY IRON ASTM A-48 CLASS 35B.
3. FINISH: NO PAINT.
4. WEIGHT: GRATE 170 LBS. EACH; FRAME 29 LBS. EACH.
5. ALL REINFORCING BARS SHALL BE EPOXY COATED.

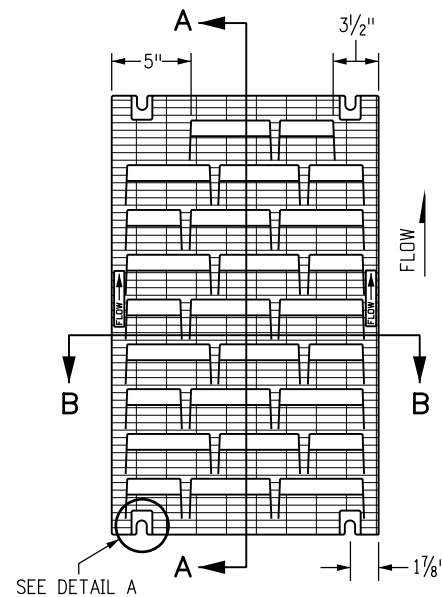


GRATE PLAN

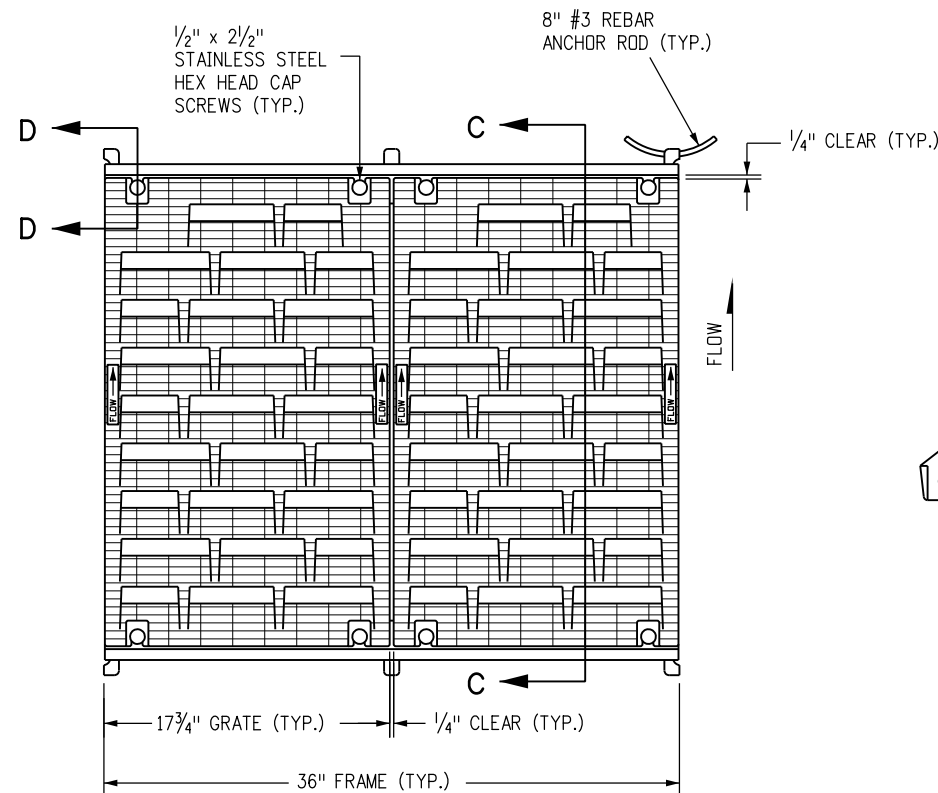

MULTIPLE GRATE WITH FRAME PLAN

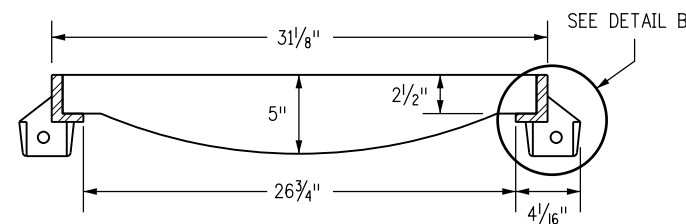


SECTION C-C

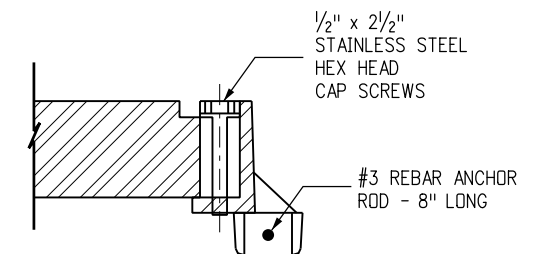


SECTION D-D


Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	VANE GRATE INLET		STANDARD PLAN NO.	
Creation Date: 07/31/19	Date:		Comments	M-604-25					
Designer Initials: JBK				Standard Sheet No. 4 of 5					
Last Modification Date: 07/31/19				Project Sheet Number:					
Detailer Initials: LTA									
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English									

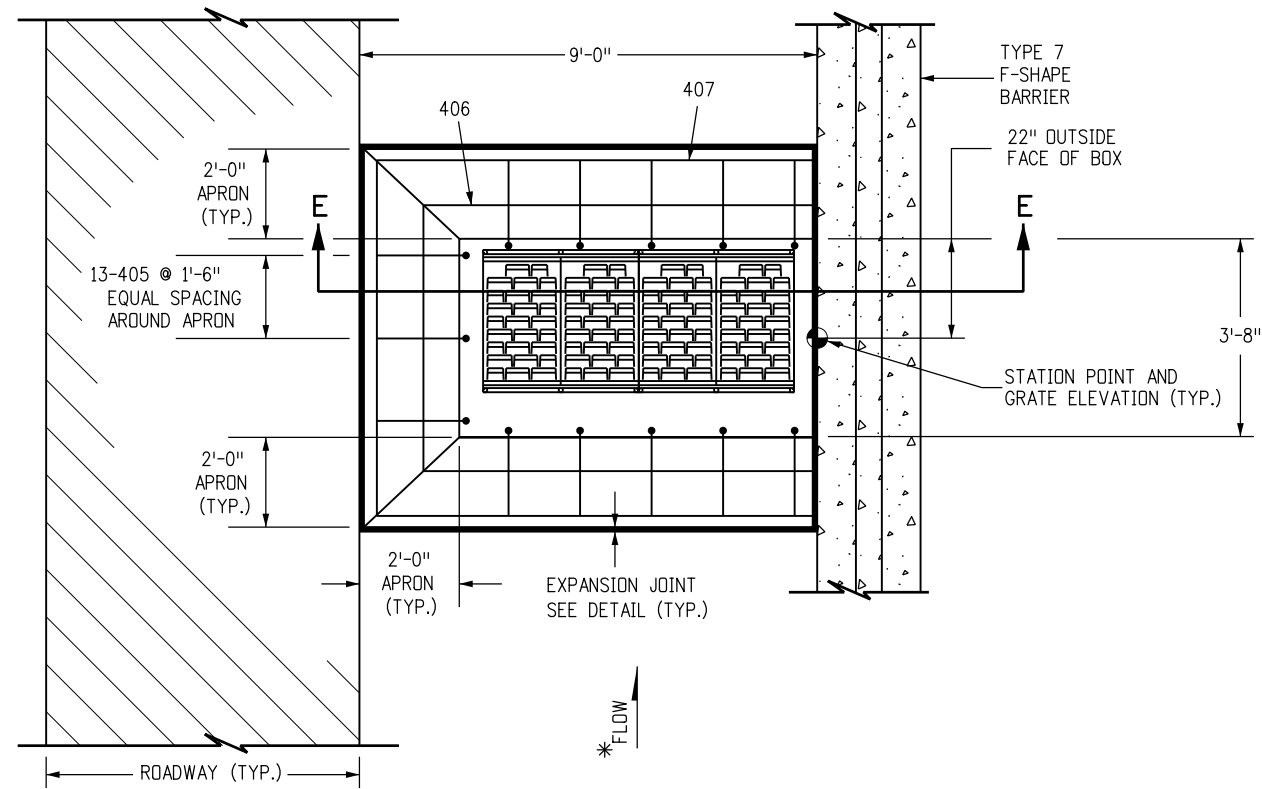

CONCRETE APRON FOR 72 IN. INLET

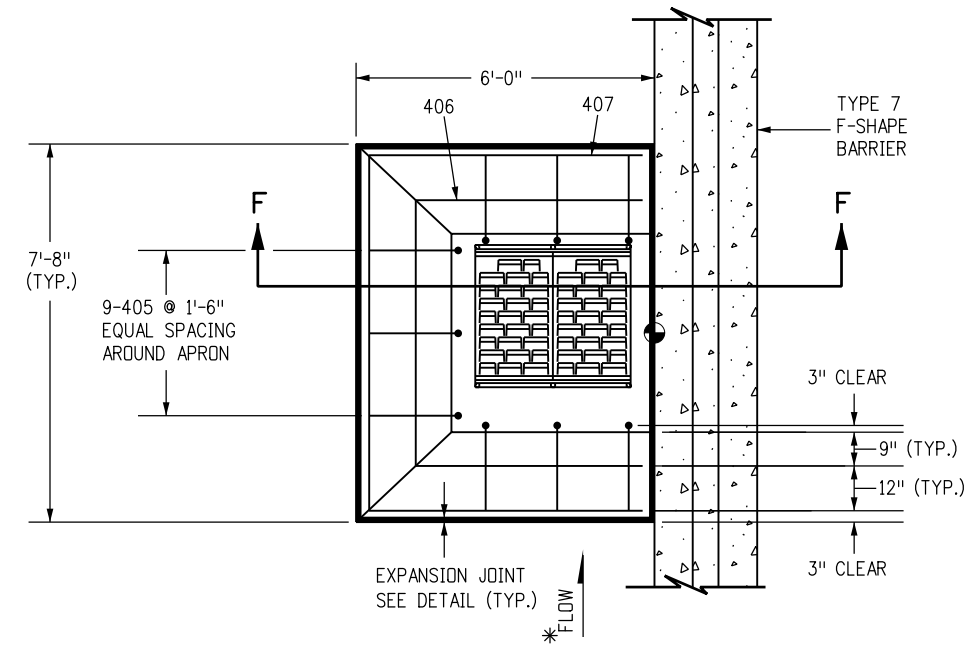


CONCRETE APRON FOR 36 IN. INLET

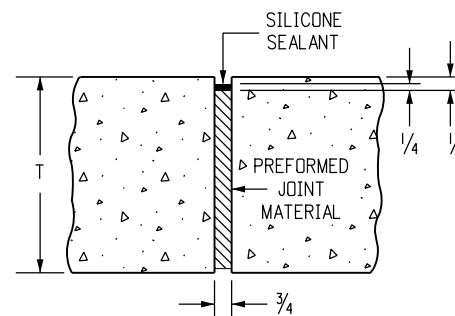


EXPANSION JOINT (TYP.)

NOTES

1. A 2 FT. CONCRETE TRANSITION APRON SHALL BE CONSTRUCTED AS SHOWN AND SHALL BE KEYED INTO THE INLET.
 2. CONCRETE APRON SHALL BE THE SAME THICKNESS AND TYPE AS THE SURROUNDING CONCRETE.
 3. THE COST OF THE CONCRETE APRON SHALL BE INCLUDED THE COST OF THE INLET.
- * IF THE INLET IS OFFSET FROM THE BARRIER, SLOPE THE APRON ADJACENT TO THE BARRIER TO DIRECT FLOW TOWARD THE GRATE.

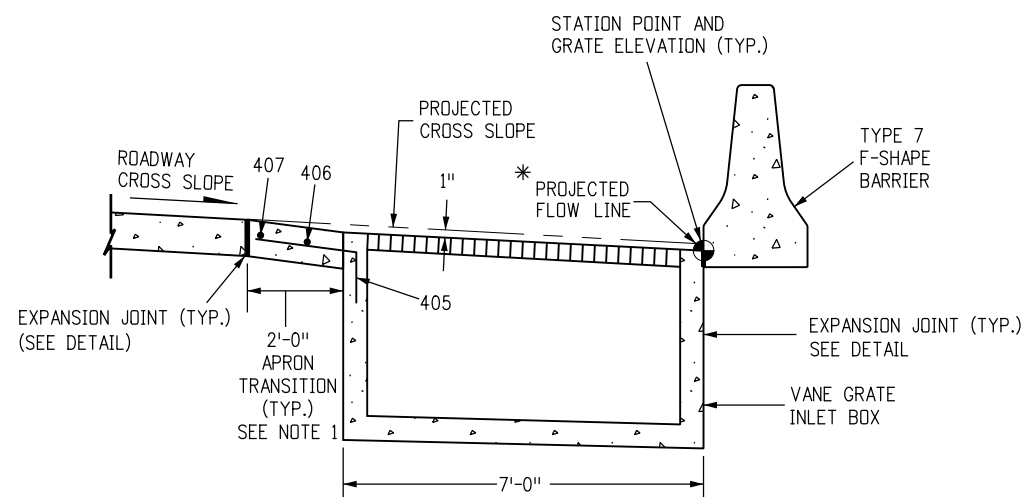


SECTION E-E

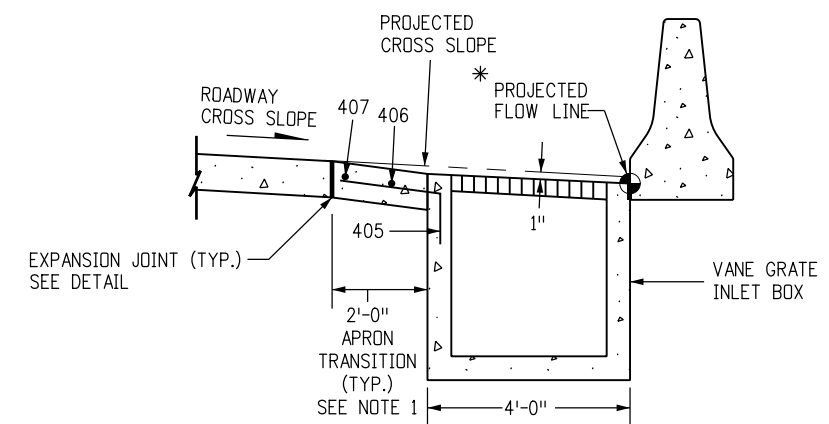


SECTION F-F

Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation CDOT 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	VANE GRATE INLET		STANDARD PLAN NO.	
Creation Date: 07/31/19			Date:	Comments		M-604-25		Standard Sheet No. 5 of 5	
Designer Initials: JBK									
Last Modification Date: 07/31/19									
Detailer Initials: LTA									
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English								Issued by the Project Development Branch: July 31, 2019	

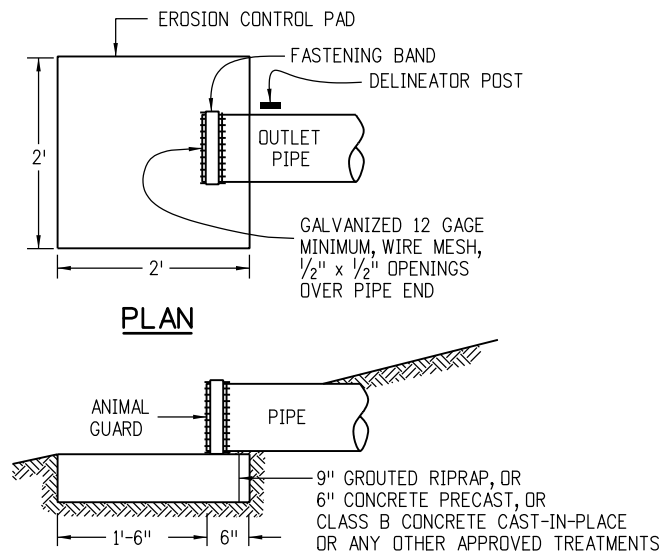


PLAN


PROFILE
OUTLET PIPE
END TREATMENT

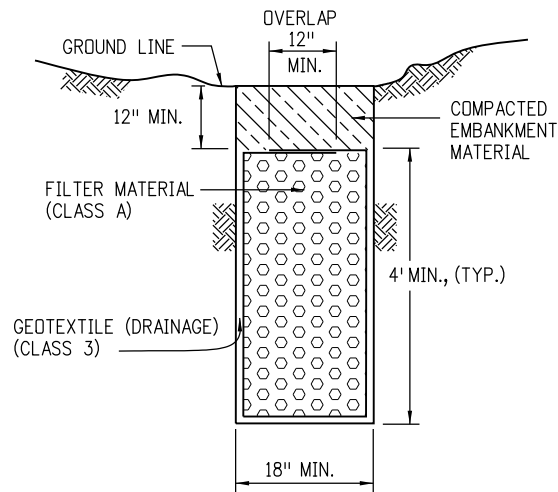


FRENCH DRAIN

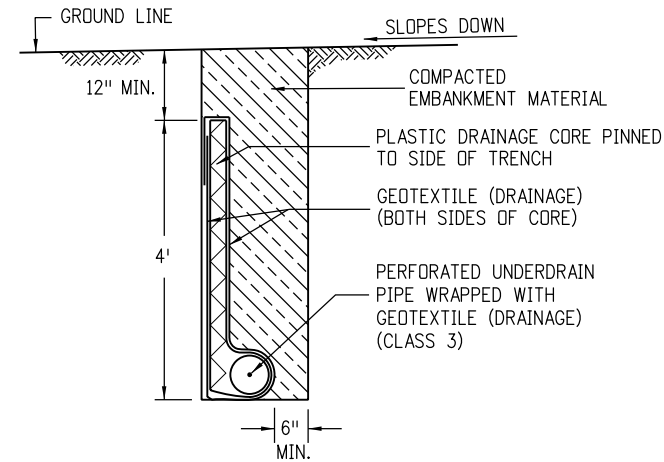


GEOCOMPOSITE
UNDERDRAIN

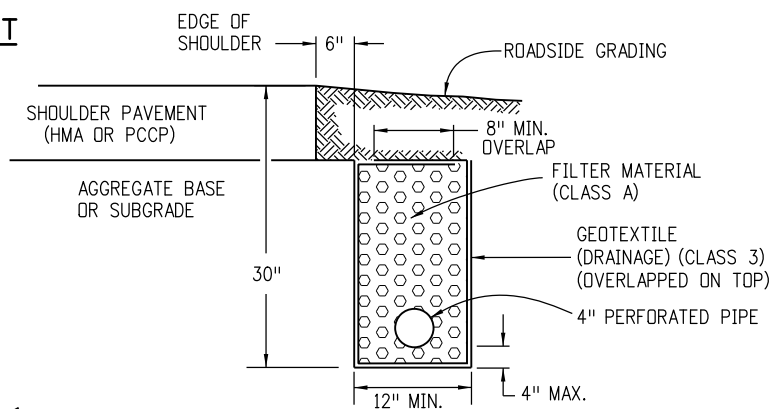


PIPE EDGE DRAIN

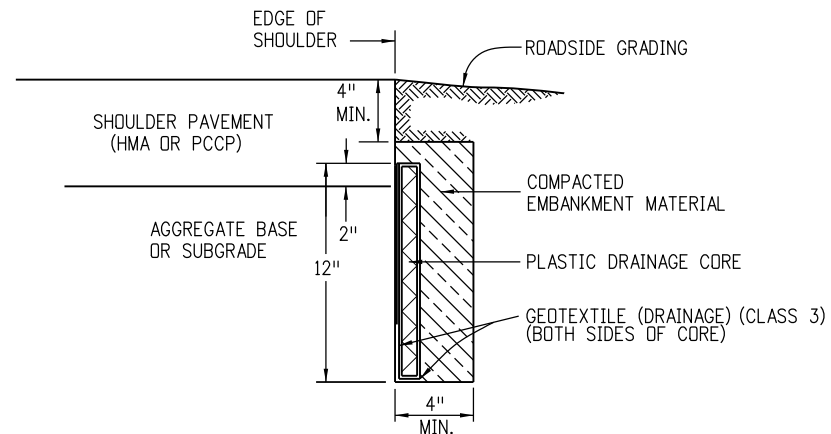


GEOCOMPOSITE EDGE DRAIN

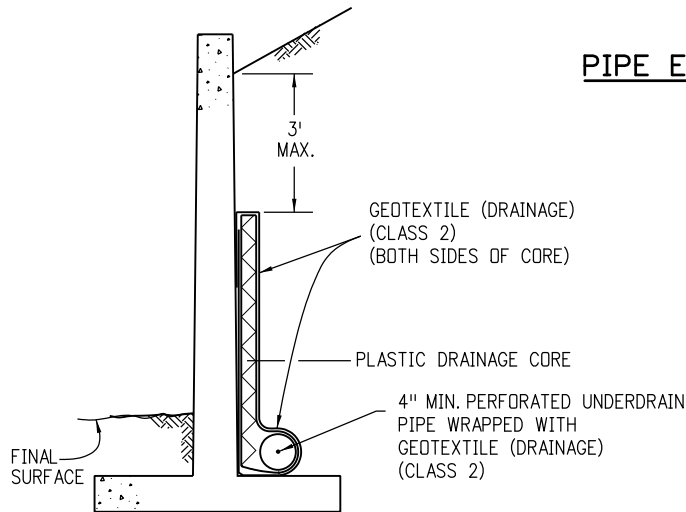


GEOCOMPOSITE
DRAIN WITH PIPE

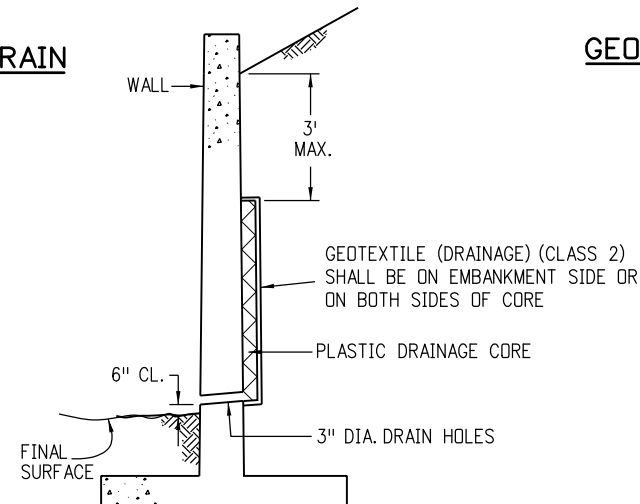

GEOCOMPOSITE
DRAIN WITHOUT PIPE

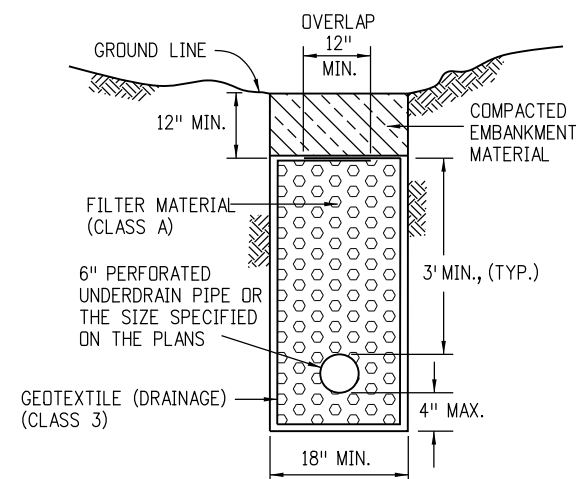

PIPE UNDERDRAIN

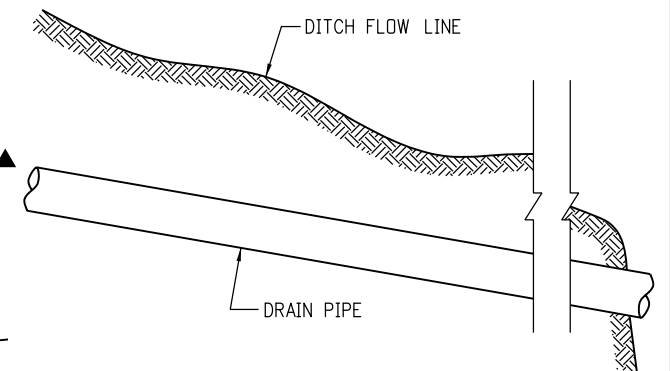

UNDERDRAIN PIPE

FLOWLINE OF PIPE SHALL FOLLOW ESTABLISHED GRADE AND NOT NATURAL SLOPE OF GROUND LINE.

THE SLOPE OF PERFORATED UNDERDRAIN PIPES AND NON-PERFORATED UNDERDRAIN PIPES SHALL BE UNIFORM.

GENERAL NOTES

1. THE LOCATION AND GRADE OF SUBSURFACE DRAINS AND OUTLET PIPES WILL BE AS SHOWN ON THE PLANS OR AS DIRECTED BY THE ENGINEER.
2. OUTLETS FOR THE EDGE DRAINS ARE TO BE SPACED AT MAXIMUM 600 FT. INTERVALS OR AS SHOWN ON THE PLANS. GEOCOMPOSITE OUTLET CONNECTIONS SHALL CONFORM TO MANUFACTURER'S RECOMMENDATIONS.
3. WHERE THE UNDERDRAIN PIPE OUTLETS ONTO A SLOPE OR DITCH, THE OUTLET PIPE END SHALL BE MARKED WITH A DELINEATOR POST, AND HAVE AN ANIMAL GUARD AND AN EROSION CONTROL PAD.
4. THE GEOCOMPOSITE SHALL BE SECURED TO THE WALL OR TO THE TRENCH SIDE TO PREVENT MOVEMENT DURING BACKFILLING.
5. DRAIN HOLES IN RETAINING WALL SHALL BE SPACED AT 10 FT. INTERVALS OR AS SHOWN ON THE PLANS.
6. STRUCTURE EXCAVATION AND BACKFILL LIMITS FOR RETAINING WALLS ARE SHOWN ON STANDARD PLAN M-206-1. ALL EXTRA EXCAVATION AND BACKFILL WORK NECESSARY TO COMPLETE RETAINING WALL, AGGREGATE, AND GEOCOMPOSITE DRAINS IS INCLUDED IN THE DRAIN WORK.
7. FILTER MATERIAL SHALL BE TAMPED WITH A LIGHT VIBRATORY TAMPER PRIOR TO OVERLAPPING THE GEOTEXTILE FABRIC.
8. THE EDGE DRAIN TRENCH SHALL BE CONSTRUCTED AFTER PLACEMENT OF THE AGGREGATE BASE AND SUBBASE.

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

Sheet Revisions

Date:	Comments
(R-X)	
(R-X)	
(R-X)	
(R-X)	

Colorado Department of Transportation



2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch

JBK

SUBSURFACE DRAINS

Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.

M-605-1

Standard Sheet No. 1 of 1

Project Sheet Number:

GENERAL NOTES (CONTINUE ON SHEET 2)

1. TOLERANCE FOR TOP OF GUARDRAIL BEAM IS ± 1 IN.
2. RATE OF SLOPE DEPENDS ON GUARDRAIL LOCATION:
 - A. FOR GUARDRAIL FACE 2 FT. OR LESS FROM THE NORMAL EDGE OF PAVED SHOULDER, CONTINUE THE RATE OF SLOPE OF THE NORMAL PAVED SHOULDER TO THE BREAKPOINT.
 - B. FOR GUARDRAIL FACE MORE THAN 2 FT. FROM THE NORMAL EDGE OF THE PAVED SHOULDER, THE SLOPE SHALL BE 10:1 OR FLATTER.
3. WHEN SPECIFIED ON THE PLANS, EXTEND A 2 IN. MINIMUM THICKNESS PAVED SURFACE TO 1 FT. BEHIND THE GUARDRAIL POSTS OR TO THE EROSION CONTROL CURB AS SHOWN ON PLANS. ASPHALT CUTTING & PATCHING OR OTHER APPROVED METHOD SHALL BE USED TO MINIMIZE DAMAGE TO ALL PAVED SURFACES UNDER GUARDRAIL INSTALLATIONS. ALL REPAIRS TO THE PAVED AREA WILL NOT BE MEASURED AND PAID FOR SEPARATELY BUT SHALL BE INCLUDED IN THE COST OF THE WORK. A MINIMUM 3 IN. THICK FIBER REINFORCED CONCRETE PAVEMENT MAY ALSO BE USED FOR PAVING BENEATH THE GUARDRAIL. INSTALL THE POST IN A $\frac{1}{2}$ IN. OVERSIZED FORMED HOLE FOR GUARDRAIL RUNS AND TERMINALS AS DIRECTED. PAYMENT FOR THIS PAVED SURFACE WILL BE MADE UNDER A PAVEMENT OR CONCRETE PAY ITEM WITH QUANTITIES SHOWN ON THE PLANS.

4. THE MINIMUM GUARDRAIL OFFSET FROM PAVED SHOULDER EDGE SHALL BE:
 - 0 FT. FOR SHOULDERS 8 FT. OR WIDER
 - 2 FT. FOR SHOULDERS 6 FT. OR LESS

THE GUARDRAIL OFFSET FROM PAVED INSIDE SHOULDER EDGE OF A DIVIDED HIGHWAY SHALL BE:


- 0 FT. MINIMUM FOR SHOULDERS 6 FT. OR WIDER
- 2 FT. DESIRABLE FOR 4 FT. SHOULDERS

THE ABOVE 2 FT. GUARDRAIL TO SHOULDER OFFSET IS DESIRABLE BUT NOT REQUIRED FOR:

- A. FOR AN EXISTING HIGHWAY WITH A DESIGN SPEED LESS THAN 50 MPH, THE MINIMUM OFFSET IS 4 FT. FROM THE TRAVELED WAY.
- B. FOR A ONE-WAY ONE-LANE RAMP, AND WHERE ONE OR MORE OF THE FOLLOWING ARE TRUE:
 - (1) THE NON-OFFSET GUARDRAIL BEGINS AT LEAST 100 FT. BEYOND RAMP NOSE.
 - (2) THE NON-OFFSET GUARDRAIL IS NOT LOCATED ON THE RAMP EXIT OR ENTRANCE CURVE CONNECTION TO THE MAJOR HIGHWAY.
 - (3) THE RAMP SHOULDERS ARE 4 FT. OR WIDER.


USE OF GREATER THAN MINIMUM OFFSET DIMENSIONS IS ENCOURAGED TO MEET THE DESIRABLE GOAL OF PLACING THE GUARDRAIL AS FAR AS POSSIBLE FROM THE TRAVEL WAY, EVEN FOR SHORT DISTANCES, WHILE PROVIDING A SMOOTH CHANGE IN GUARDRAIL ALIGNMENT.

5. IF 2 FT. CANNOT BE PROVIDED BETWEEN THE BACK OF THE GUARDRAIL POST AND THE BREAKPOINT, USE 7 FT. GUARDRAIL POSTS. REFER TO THE "RESTRICTIVE ROADSIDE INSTALLATION" DETAIL.
6. WHEN SPECIFIED ON THE PLANS, INSTALL 4 IN. HIGH TYPE 6 CURB WITH ITS FACE AT OR BEHIND THE RAIL FACE. AS AN ALTERNATIVE WHEN SPECIFIED ON THE PLANS, INSTALL A 2 IN. x 6 IN. TREATED (AASHTO M 133) WOOD CURB. FASTEN WITH A 4 IN. LAG BOLT AND WASHER AT EACH WOOD POST, OR WITH A $\frac{1}{4}$ IN. DIA. BOLT WITH WASHER AND NUT AT EACH STEEL POST. IF THE 2 IN. x 6 IN. WOOD CURB IS SPECIFIED, IT WILL BE INCLUDED IN THE COST OF THE GUARDRAIL. IF APPROVED BY THE ENGINEER, A 2 IN. x 4 IN. TREATED WOOD CURB MAY BE SUBSTITUTED FOR THE 2 IN. x 6 IN. CURB AND SET ON TOP OF PAVEMENT SURFACE AND ATTACHED AS DESCRIBED ABOVE. NO SPLICING SHALL BE ALLOWED IN WOOD CURBS. ADJACENT BOARDS SHALL BE BUTTED TOGETHER AND BOLTED AT A POST LOCATION. JOINTS SHALL BE LOCATED AT THE POSTS.

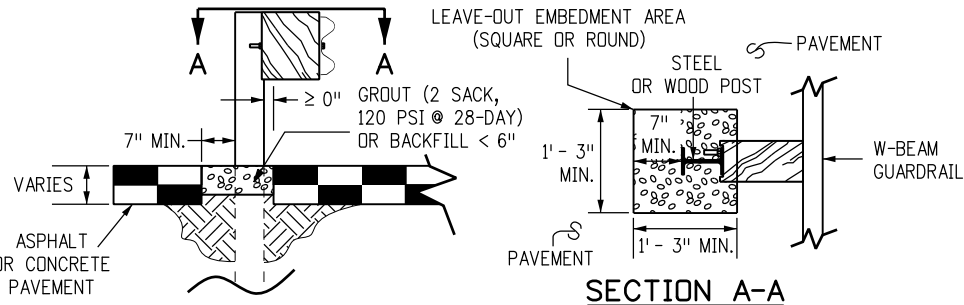



LEAVE-OUT AREA FOR GUARDRAIL POSTS LOCATED IN PAVEMENT

NOTE: LEAVE-OUT AREAS SHALL BE PROVIDED FOR ALL GUARDRAIL POSTS LOCATED IN PAVEMENT TO ALLOW THE POSTS TO ROTATE IN THEIR EMBEDMENT SUCH THAT VEHICLE IMPACT LOADS ARE DISTRIBUTED THROUGH THE POST INTO THE EMBEDMENT MATERIAL PRIOR TO THE POSTS BREAKING PREMATURELY.

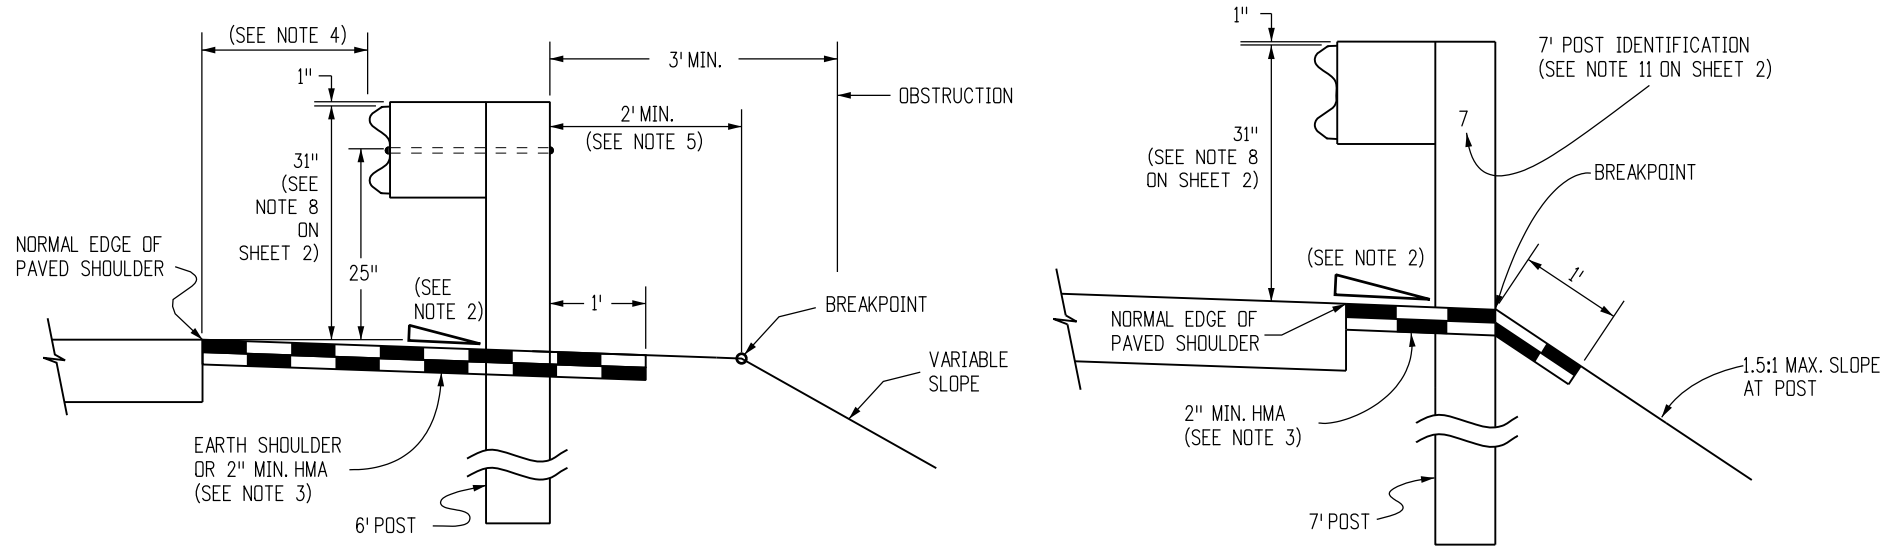

NORMAL ROADSIDE INSTALLATION WHEN FILL REQUIRES GUARDRAIL


RESTRICTIVE ROADSIDE INSTALLATION WITH 7 FOOT GUARDRAIL POSTS

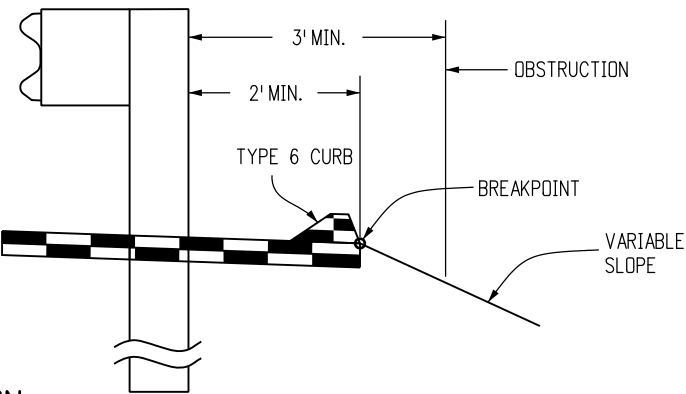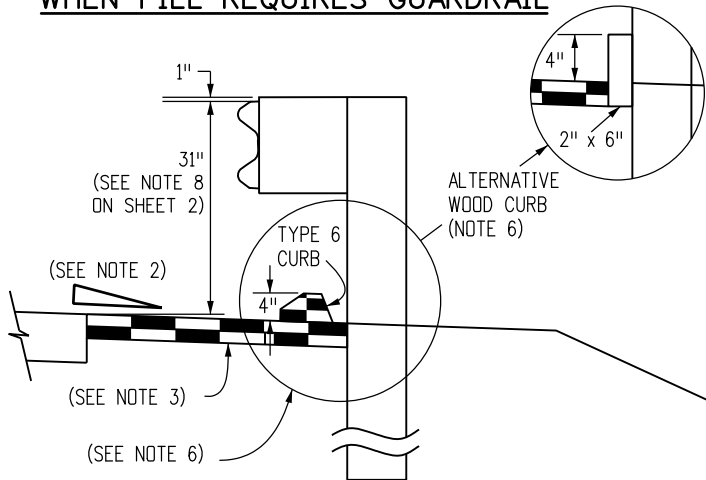


OPTION A

ROADSIDE INSTALLATION WITH EROSION CONTROL CURB

OPTION B (PREFERRED)

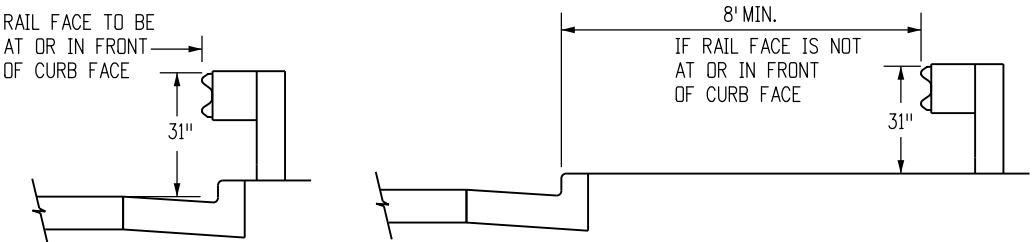

URBAN ROADSIDE INSTALLATION WITH CURB AND GUTTER

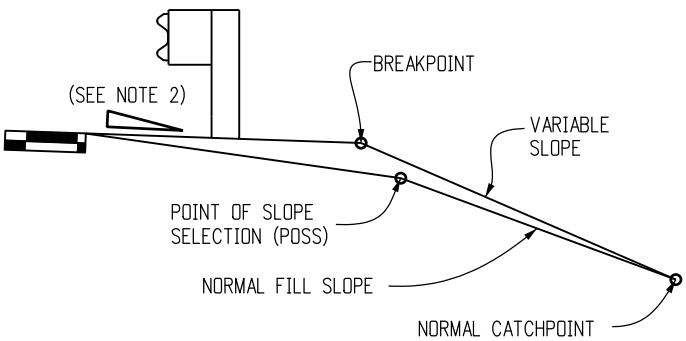

EMBANKMENT WITH GUARDRAIL

(NOTE: THE CATCHPOINT REMAINS THE SAME AS THAT FOR "NORMAL" FILL SLOPE. FOR THE WIDER "Z" DISTANCES, THE VARIABLE SLOPE MAY "CATCH" AT THE POSS.)

LOCATION	SPACING
ALL LOCATIONS EXCEPT BRIDGE RAIL LOCATIONS	6'-3"
BRIDGE OR STRUCTURE APPROACH	SEE SHEETS 11 & 19

NORMAL CENTER-TO-CENTER POST SPACING

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

(R-X)
(R-X)
(R-X)
(R-X)

Sheet Revisions

Date:	Comments

Colorado Department of Transportation

2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch

JBK

**MIDWEST
GUARDRAIL SYSTEM (MGS)
TYPE 3 W-BEAM 31 INCHES**

Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.





M-606-1

Standard Sheet No. 1 of 19

Project Sheet Number:


GENERAL NOTES (CONTINUED FROM SHEET 1)

7. SEE SHEETS 7 AND 9 FOR CURB TREATMENTS AT GUARDRAIL TERMINALS.
8. IF THIS DIMENSION WILL BE LESS THAN 28 INCHES, RESET GUARDRAIL HEIGHT TO 28 INCHES OR ABOVE.
9. ALL W-BEAM SPLICES, AND SPLICES OF TERMINAL CONNECTORS TO W-BEAM SHALL BE LAPPED IN THE DIRECTION OF TRAFFIC UNLESS OTHERWISE NOTED IN THE PLANS OR BY THE MANUFACTURER.
10. MATERIAL TYPE AND SHAPE OF POSTS AND BLOCKS SHALL BE THE SAME THROUGHOUT THE PROJECT EXCEPT WHEN SPECIFIC POSTS AND BLOCKS ARE SPECIFIED, i.e. AT END ANCHORAGES AND BOX CULVERTS.
11. WHEN SPECIFIED IN THE CONTRACT, 7 FT. POSTS SHALL BE INSTALLED INSTEAD OF THE STANDARD 6 FT. POSTS. THE 7 FT. POSTS SHALL BE MARKED WITH THE NUMBER 7 TO ENSURE PERMANENT IDENTIFICATION. STEEL POSTS SHALL BE STAMPED PRIOR TO GALVANIZING. THE NUMBER 7 SHALL BE A MINIMUM 2 IN. TALL AND LOCATED AS SHOWN ON THE ELEVATION VIEW ON SHEET 1.
12. THE STANDARD 3 IN. X 1 3/4 IN. X 3/16 IN. RECTANGULAR WASHER USED UNDER POST BOLT HEADS IN THE PAST MAY REMAIN IN EXISTING INSTALLATIONS BUT SHALL NOT BE USED IN NEW CONSTRUCTION, REPAIRS, OR RESETTING OF RAIL, EXCEPT WHEN SPECIFICALLY IDENTIFIED ON THE STANDARD PLAN.
13. STANDARD GALVANIZED ROUND STEEL WASHERS SHALL BE USED UNDER ALL NUTS IN CONTACT WITH WOOD POSTS.
14. AN ADDITIONAL HOLE SHALL BE PROVIDED IN THE POSTS TO FACILITATE FUTURE RAISING OF THE RAIL ELEMENTS AND BLOCKS FOR OVERLAYS. POSTS PROVIDED MAY ALSO HAVE ADDITIONAL HOLES (UP TO 4 PER FLANGE) FOR MEDIAN GUARDRAIL APPLICATION.
15. RETROREFLECTOR TABS SHALL BE INSTALLED AT 25 FT. INTERVALS (SEE SHEETS 6 AND 8 FOR EXCEPTIONS). RETROREFLECTOR TABS WILL NOT BE PAID FOR SEPARATELY BUT SHALL BE INCLUDED IN THE WORK. THE TABS SHALL BE INSTALLED ON SPLICE BOLTS, NOT ON POST BOLTS AND SHALL BE MOUNTED SO THE BOLT SLOT FACES AWAY FROM TRAFFIC, AND THE RETROREFLECTOR SURFACE FACES THE APPROACHING TRAFFIC FOR ONE-WAY ROADS. FOR TWO-WAY ROADS, BOTH SIDES OF THE TABS SHALL BE RETROREFLECTIVE, SO THAT DELINEATION IS PROVIDED FOR BOTH DIRECTIONS OF TRAVEL. THE RETROREFLECTIVE SHEETING COLOR SHALL MATCH THE COLOR OF THE ADJACENT TRAVEL WAY EDGE LINE. SEE THE RETROREFLECTOR TAB DETAIL ON SHEET 3.
16. AT THE TIME OF INSTALLATION, WOOD POSTS OR BLOCKS WITH SEASONING CHECKS GREATER THAN 1/4 IN. SHALL NOT BE USED WHEN THE CHECK EXTENDS THE FULL LENGTH OF THE PIECE.
17. WOOD BLOCKS SHALL BE CUT FROM THE SAME CROSS-SECTION, SPECIES, AND GRADE, AND SHALL RECEIVE THE SAME PRESERVATIVE TREATMENT AS THE POSTS WHEN WOOD POSTS ARE USED.
18. REFERENCES SUCH AS 00PDB01", 00PDE01", AND 00PWE01" IN THIS STANDARD PLAN SPECIFY HARDWARE DETAILS FROM 00A GUIDE TO STANDARDIZED HIGHWAY BARRIER HARDWARE" PREPARED BY THE AASHTO-AGC-ARTBA JOINT COOPERATIVE COMMITTEE.
19. RAIL BLOCKS MANUFACTURED FROM SYNTHETIC MATERIAL WILL BE ACCEPTED AS ALTERNATIVES TO WOOD BLOCKS FOR USE WITH STEEL POSTS PROVIDED THAT THE BLOCKS HAVE RECEIVED FHWA APPROVAL.
20. WOOD POSTS SHALL BE MADE OF TIMBER WITH AN EXTREME FIBER STRESS IN BENDING OF 1200 PSI STRESS GRADING AND POST DIMENSIONS SHALL CONFORM WITH THE RULES OF THE WEST COAST INSPECTION BUREAU, OR THE SOUTHERN PINE BUREAU, OR THE WESTERN WOOD PRODUCTS ASSOCIATION. TIMBER FOR POSTS SHALL BE EITHER ROUGH SAWN (UNPLANED) OR S4S (SURFACED FOUR SIDES) WITH NOMINAL DIMENSIONS INDICATED. ONLY ONE TYPE OF SURFACE FINISH SHALL BE USED FOR POSTS AND BLOCKS IN ANY ONE CONTINUOUS LENGTH OF GUARDRAIL.
21. GLULAM POSTS AND BLOCKS WILL BE ACCEPTED AS ALTERNATIVES PROVIDED THAT THE SUPPLIED MATERIALS HAVE RECEIVED FHWA APPROVAL AND ARE CERTIFIED AS IDENTICAL TO THE SPECIMENS USED FOR TESTING AND APPROVAL.
22. PRESSURE TREATMENT OF POSTS AND BLOCKS SHALL CONFORM TO AASHTO M 133 EXCEPT THAT BLOCKS NEED NOT BE INCISED. PRESERVATION ASSAY RETENTION REPORTS SHALL BE SUBMITTED TO THE ENGINEER. THE CONTRACTOR SHALL CERTIFY THAT THE SPECIES AND GRADE MEET THE REQUIREMENTS OF THE CONTRACT.
23. W-BEAM AND THRIE-BEAM GUARDRAIL POSTS SHALL BE MANUFACTURED USING AASHTO M 270 (ASTM A 709) GRADE 36 STEEL UNLESS CORROSION RESISTANT STEEL IS REQUIRED, IN WHICH CASE THE POST SHALL BE MANUFACTURED FROM AASHTO M 270 (ASTM A 709) GRADE 50W STEEL. THE DIMENSIONS OF THE CROSS-SECTION SHALL CONFORM TO A W6 X 9 SECTION AS DEFINED IN AASHTO M 160 (ASTM A 6). W6 X 8.5 WIDE FLANGE STEEL POSTS ARE AN ACCEPTABLE ALTERNATIVE TO THE W6 X 9.
24. AFTER THE SECTION IS CUT AND ALL HOLES ARE DRILLED OR PUNCHED THE COMPONENT SHALL BE ZINC-COATED CONFORMING TO AASHTO M 111 (ASTM A 123) UNLESS CORROSION-RESISTANT STEEL IS USED. WHEN CORROSION-RESISTANT STEEL IS USED THE PORTION OF THE POST TO BE EMBEDDED IN SOIL SHALL BE ZINC-COATED CONFORMING TO AASHTO M 111 (ASTM A 123) AND THE PORTION ABOVE THE SOIL SHALL NOT BE ZINC-COATED, PAINTED OR OTHERWISE TREATED.
25. FIELD MODIFICATION TO RAIL ELEMENTS IS ALLOWED PER MANUFACTURER'S RECOMMENDATIONS, OR WITH THE APPROVAL OF THE STANDARDS AND SPECIFICATIONS UNIT. POSTS SHALL NOT BE MODIFIED. COMPONENTS ON WHICH THE SPELTER COATING HAS BEEN DAMAGED SHALL BE EITHER REGALVANIZED OR RECOATED IN CONFORMANCE WITH AASHTO M 36, OR PAINTED WITH ONE FULL BRUSH COAT OF ZINC RICH PAINT CONFORMING TO MILITARY SPECIFICATION DOD-P-21035A.

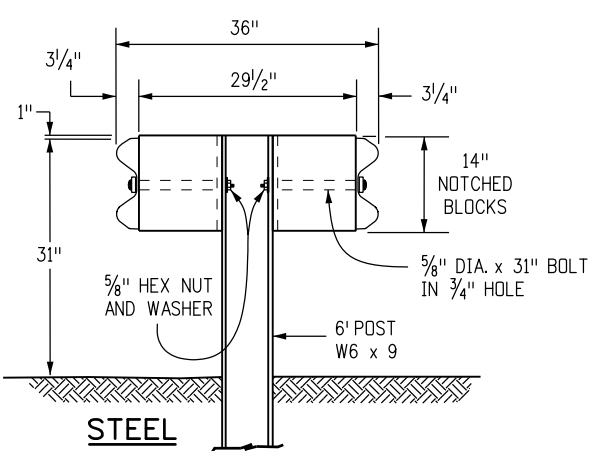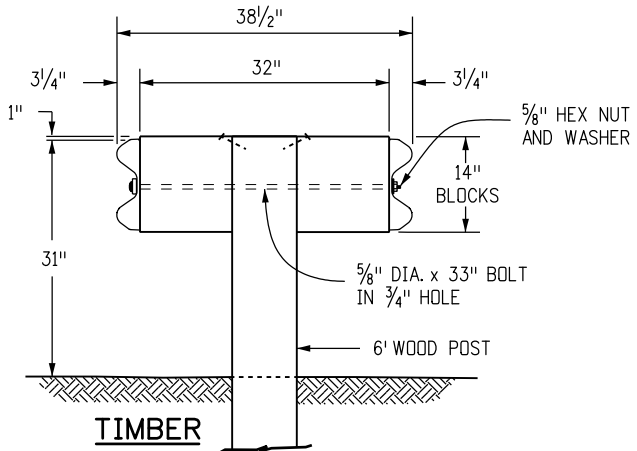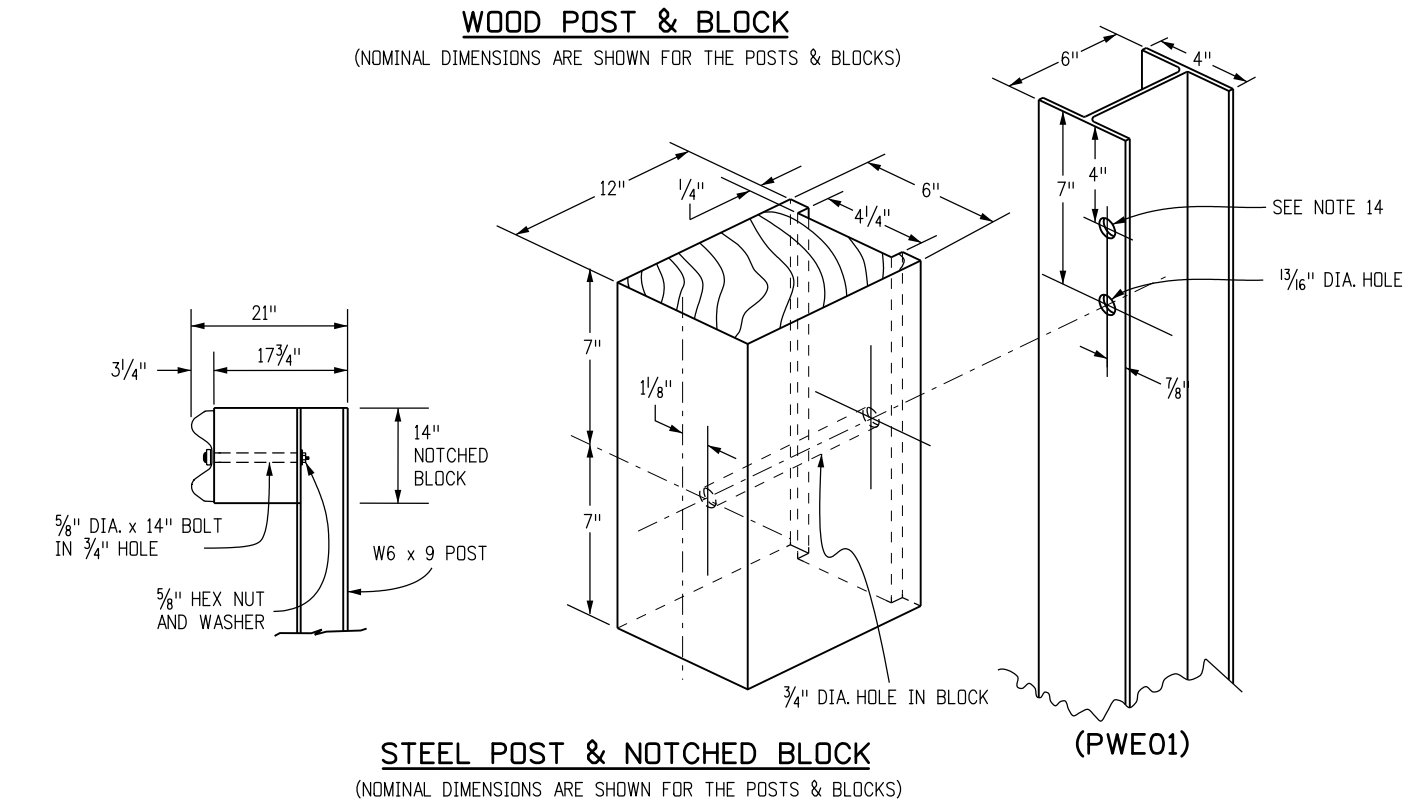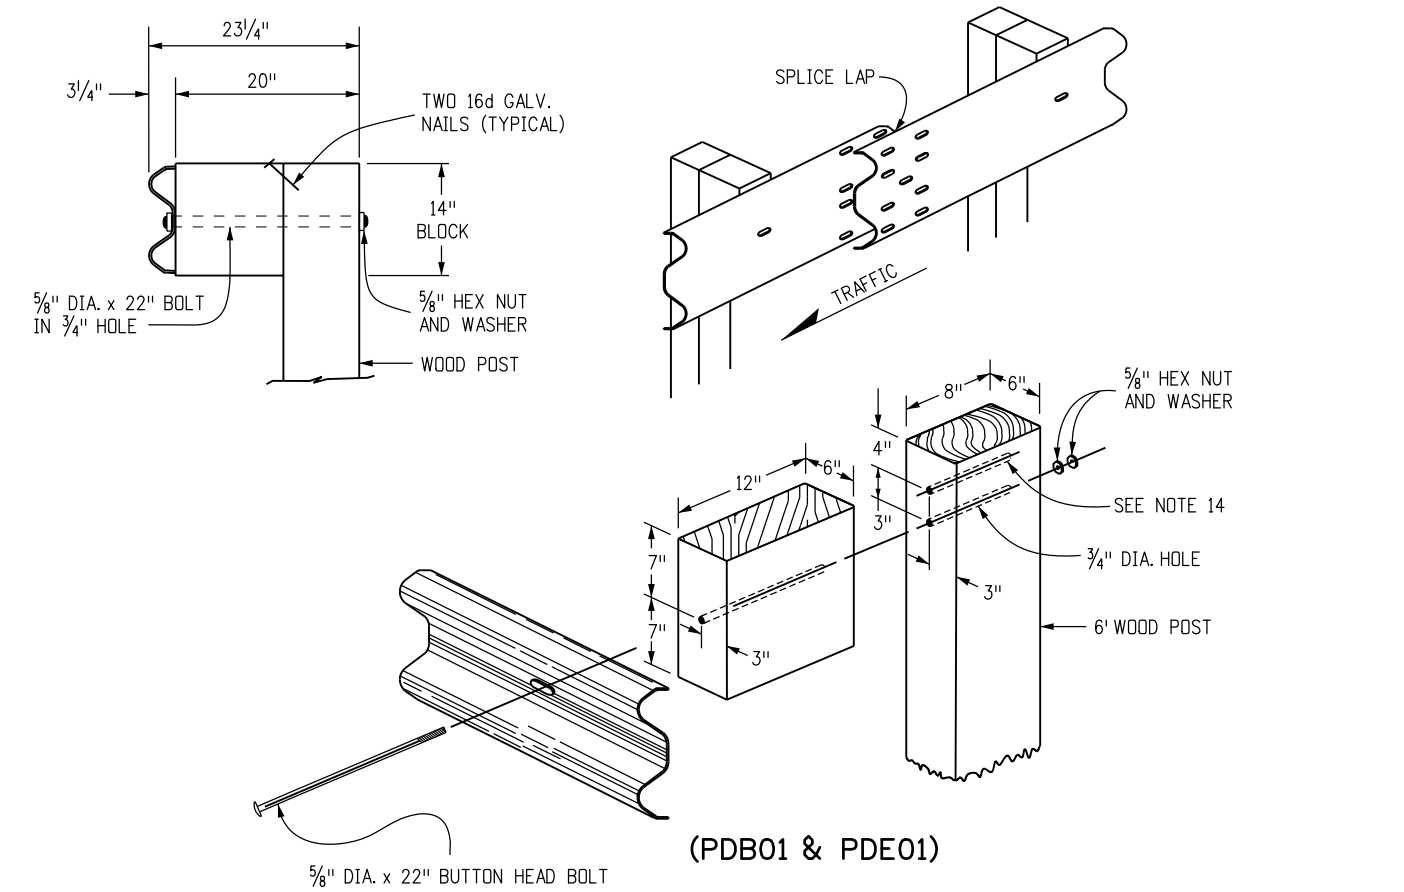


DOUBLE BLOCK AND GUARDRAIL TYPE 3 (DOUBLE) FOR MEDIAN BARRIER


Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	MIDWEST GUARDRAIL SYSTEM (MGS) TYPE 3 W-BEAM 31 INCHES	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-606-1	
Designer Initials: JBK	(R-X)					Standard Sheet No. 2 of 19	
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:	
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English					Issued by the Project Development Branch: July 31, 2019		

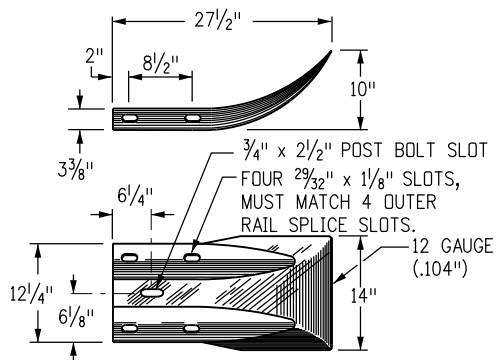

TERMINAL SECTION (FLARED)

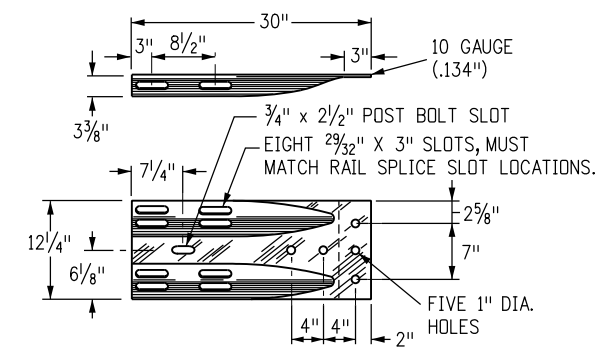


TERMINAL SECTION (CONNECTOR)

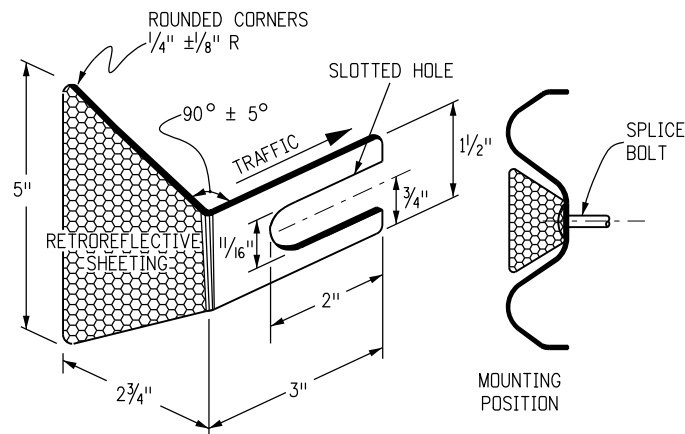


RETROREFLECTOR TAB


NOTE: RETROREFLECTOR TABS SHALL BE MANUFACTURED FROM 12 TO 14 GAUGE STEEL AND SHALL CONFORM TO THE REQUIREMENTS OF S STANDARD S-612-1.

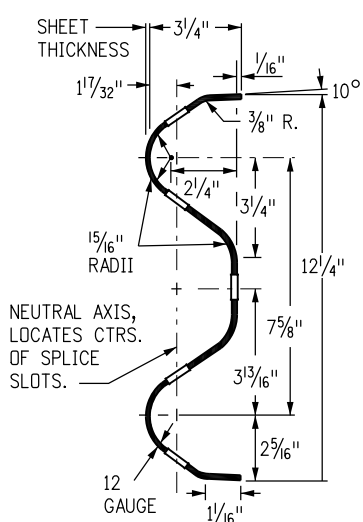


W-BEAM RAIL SECTION

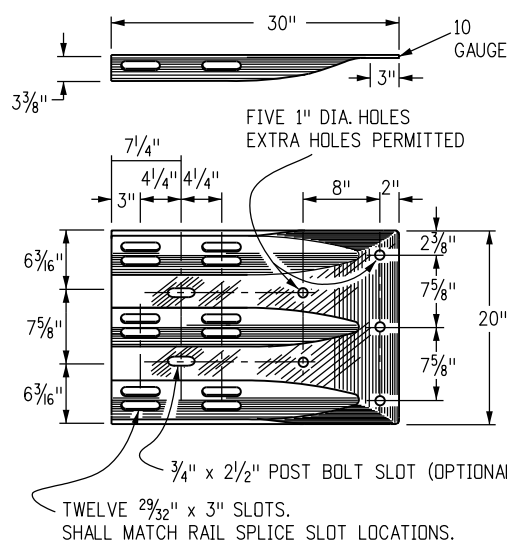


THRIE BEAM TERMINAL SECTION (CONNECTOR)

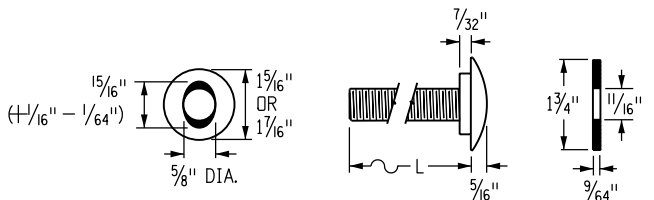


BUTTON HEAD BOLT WITH OVAL SHOULDER WASHER

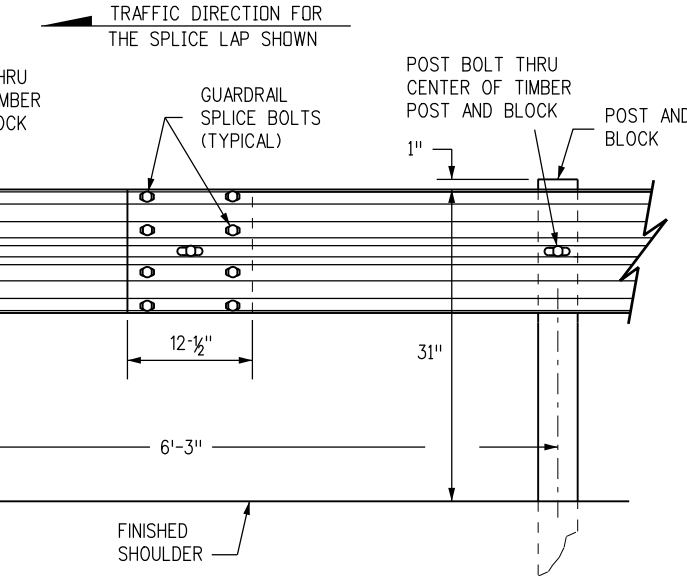

W-BEAM RAIL SPLICE

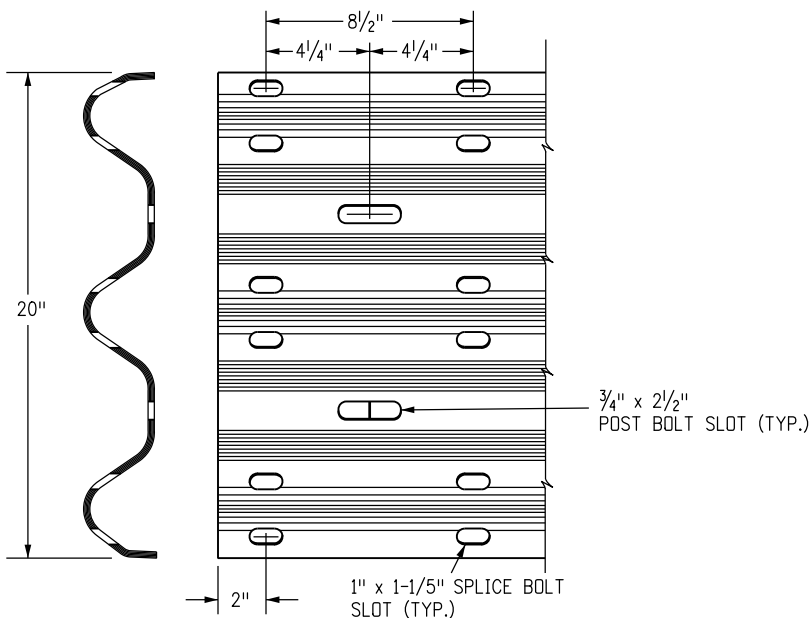


THRIE BEAM DETAIL



HEX NUT

PART	MATERIAL SPEC.	GALVANIZING SPEC.	CORROSION-RESISTANT SPEC.
W-BEAM RAIL & TERMINAL SECTIONS	AASHTO M 180, CLASS A OR B	AASHTO M 180, TYPE 1 OR 2	AASHTO M 180, TYPE 4
BASE PLATE	ASTM A 36	AASHTO M 111	N.A.
NUTS, BOLTS & STUDS FOR GENERAL USE	ASTM A 307	AASHTO M 232, CLASS C OR ASTM B 695 CLASS 50 TYPE 1	
HIGH STRENGTH BOLTS & NUTS	ASTM A 325		
HIGH STRENGTH STUDS & NUTS	ASTM A 449		
ROUND STEEL WASHERS	ASTM F 436		
RECTANGULAR WASHERS	AASHTO M 180		
OTHER FITTINGS	ASTM A 36	AASHTO M 111	

THE TABULATION OF GUARDRAIL WILL SPECIFY THE TYPE OF CORROSION PROTECTION: GALVANIZED OR CORROSION - RESISTANT STEEL.
STEEL POSTS SHALL HAVE THE SAME CORROSION PROTECTION AS SPECIFIED FOR THE METAL BEAM RAIL. PUNCHING, DRILLING, CUTTING, OR WELDING OF POSTS WILL NOT BE PERMITTED AFTER GALVANIZING.

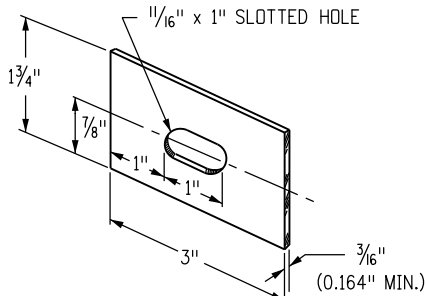


RECTANGULAR WASHER (TO BE USED ONLY WHERE SPECIFIED.)

DIAMETER & TYPE (INCHES)	12" BLOCKS L = LENGTH (INCHES)	THREAD LENGTH (INCHES)	INTENDED USE	AASHTO-AGC-ARTBA STANDARD NUMBER	NO. BOLTS, NUTS & WASHERS
5/8	1/4	FULL (1 1/32)	ALL RAIL SPLICES	FBB01	8 PER SPLICE*
BUTTONHEAD OVAL SHLDR.	22	MIN. 2 1/2	SINGLE BLOCK & POST (TIMBER)	FBB04	1 PER POST
	33	MIN. 2	DOUBLE BLOCK & POST (TIMBER)	FBB05	1 PER POST
	14	MIN. 2	FASTEN NOTCHED BLOCK TO STEEL POST	FBB03	1 PER BLOCK
WASHERS NOT USED AT RAIL SPLICES					


Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	MIDWEST GUARDRAIL SYSTEM (MGS) TYPE 3 W-BEAM 31 INCHES Issued by the Project Development Branch: July 31, 2019	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-606-1	
Designer Initials: JBK	(R-X)					Standard Sheet No. 3 of 19	
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:	
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						

NOTES

1. THE MGS TRANSITION FROM A TYPE 3 GUARDRAIL SHALL BE COMPLETED OUTSIDE THE MGS END ANCHORAGE LIMITS

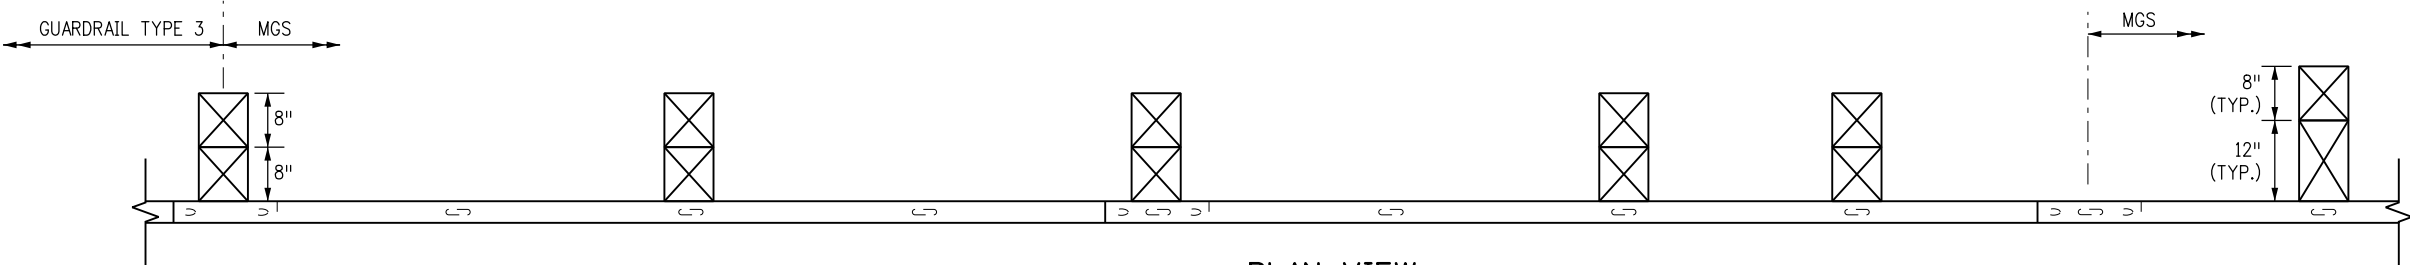


PLAN VIEW

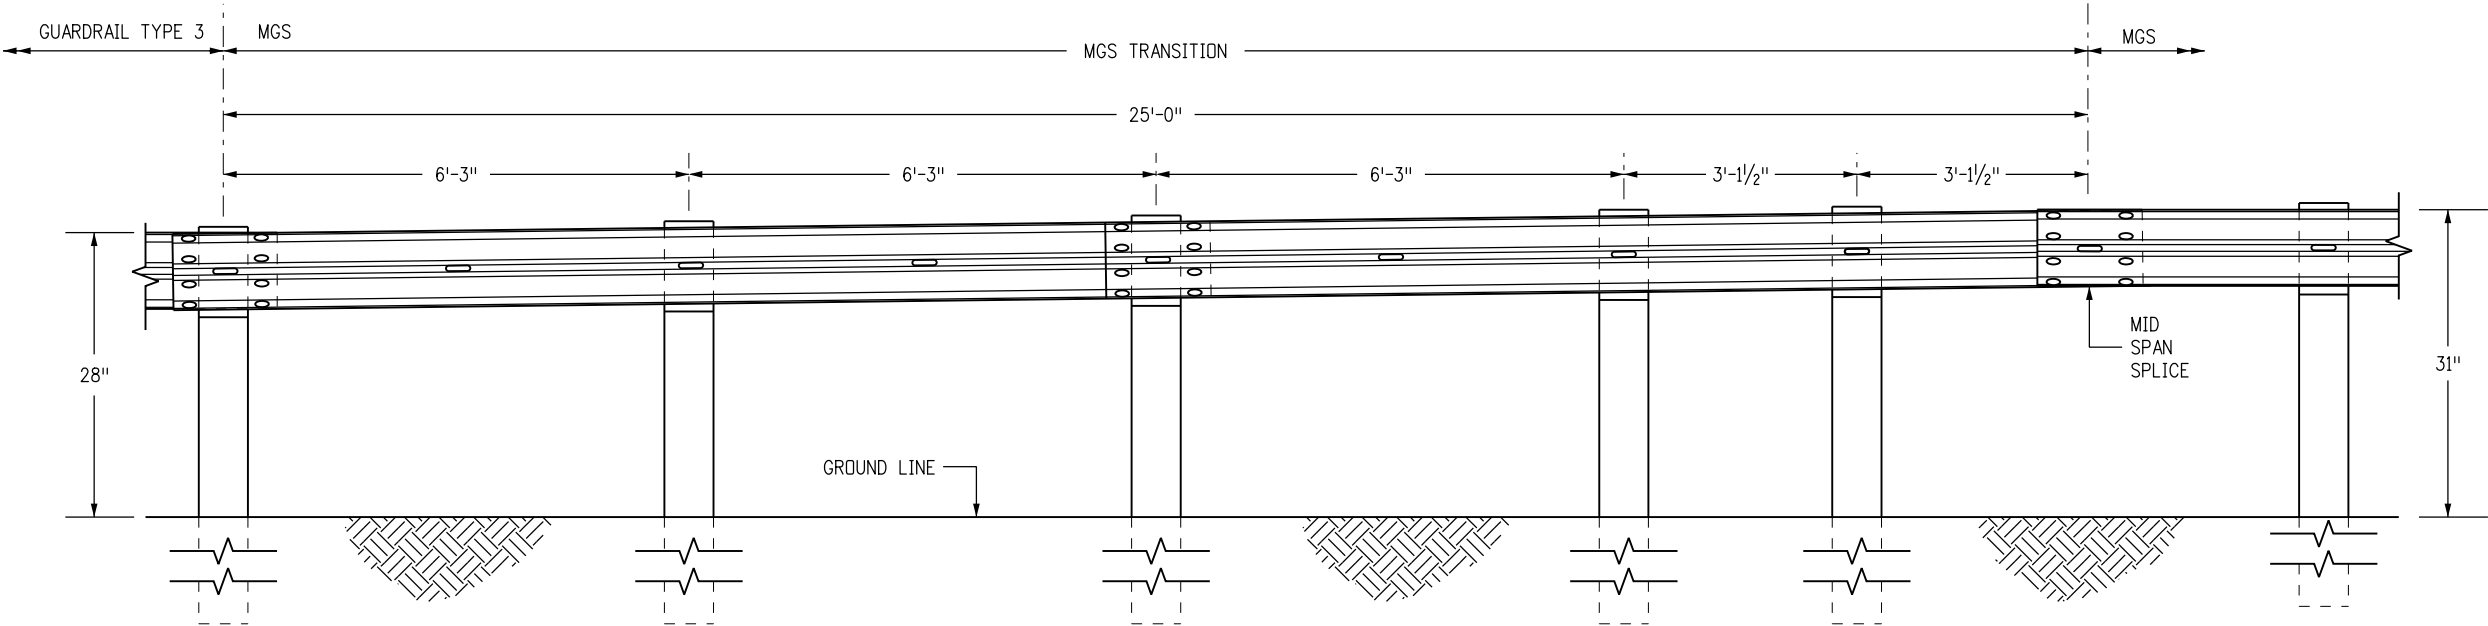


ELEVATION VIEW

TRANSITION FROM 28 INCH GUARDRAIL TO 31 INCH MGS

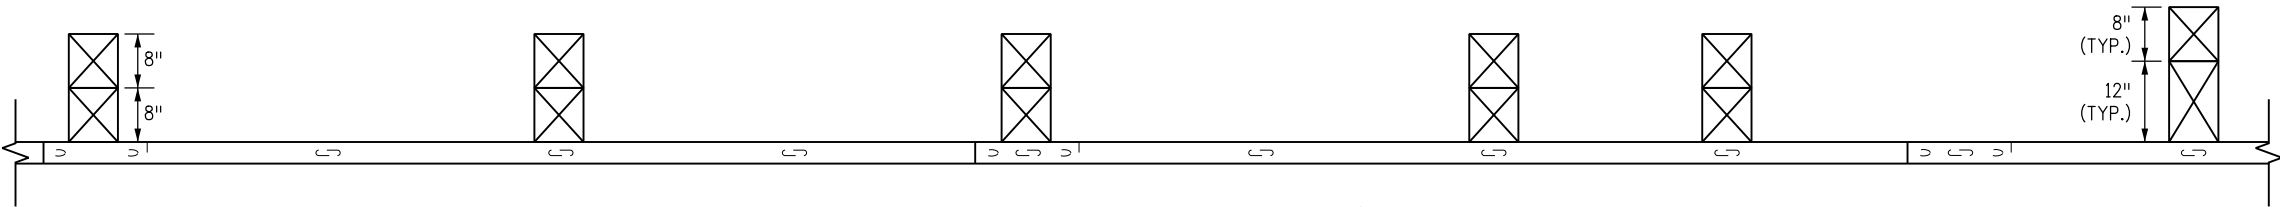


ALTERNATE PLAN VIEW - ALIGNMENT TAPER

Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development BranchJBK	MIDWEST GUARDRAIL SYSTEM (MGS) TYPE 3 W-BEAM 31 INCHES		STANDARD PLAN NO.			
Creation Date: 07/31/19			Date:	Comments				M-606-1			
Designer Initials: JBK											
Last Modification Date: 07/31/19											
Detailer Initials: LTA											
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English								Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:	

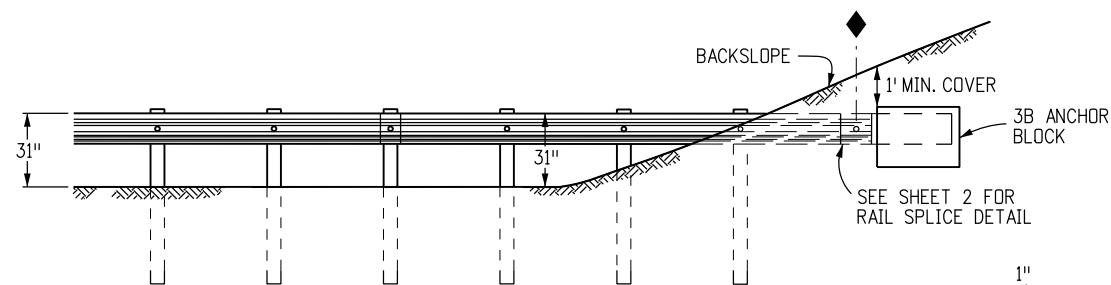


SEE TYPE 3B (RUB RAIL) PLAN VIEW FOR ALIGNMENT. THE 100 FT. FLARE LENGTH MAY BE SHORTENED IF THE SLOPE IS LESS THAN 8 FT. WIDE.

END ANCHORAGE TYPE 3B
(WITHOUT ROADSIDE DITCH AT GUARDRAIL)

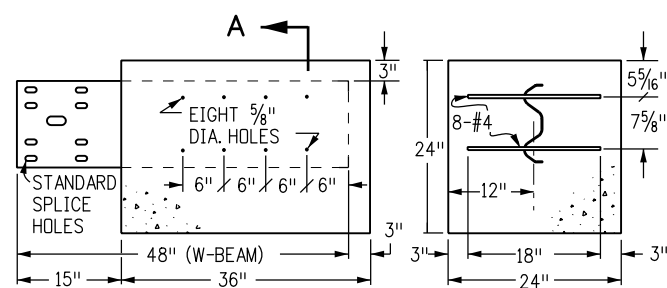


SECTION A-A

TYPE 3B ANCHOR BLOCK DETAIL

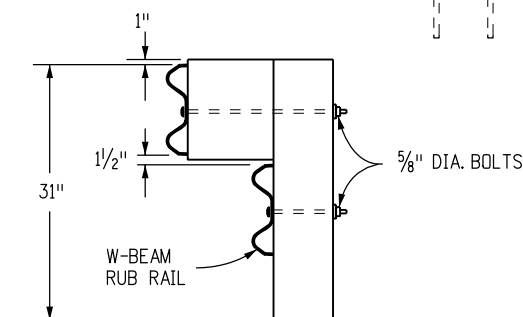


SECTION B-B

MOUNT A W-BEAM RUB RAIL 1-1/2 IN. BELOW THE TOP RAIL WHEN THE TOP RAIL HEIGHT EXCEEDS 33 IN. ABOVE THE GROUND

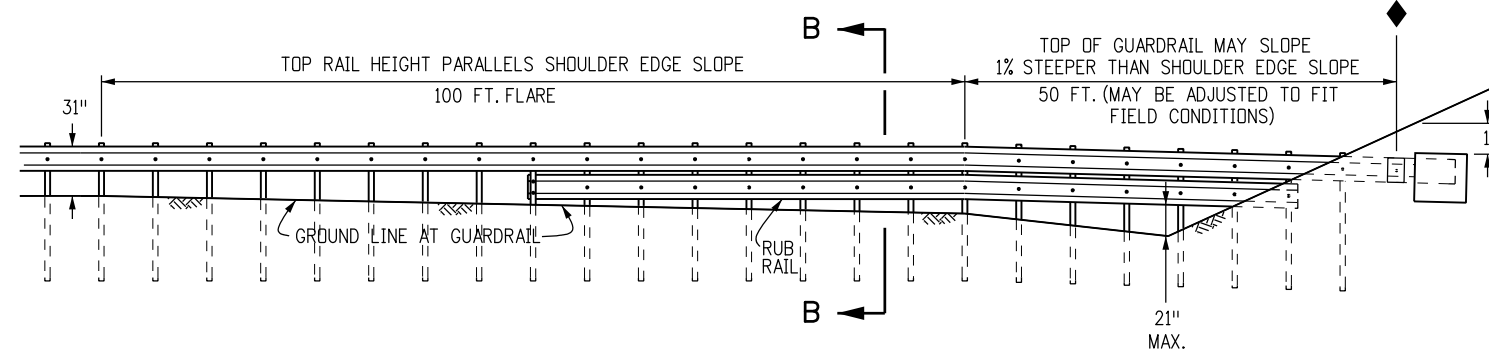


ELEVATION VIEW

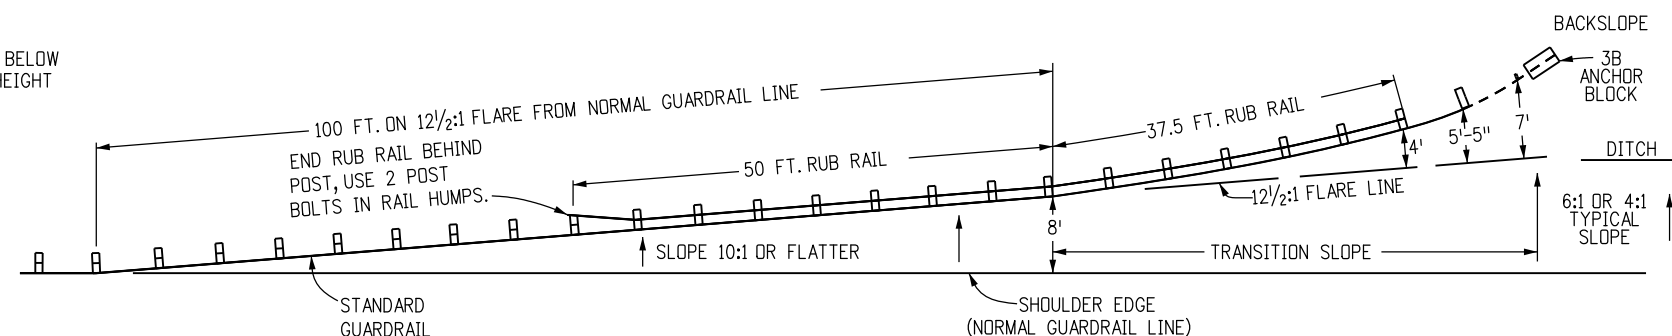

PLAN VIEW


END ANCHORAGE TYPE 3B (RUB RAIL)

(WITH ROADSIDE DITCH AT GUARDRAIL)

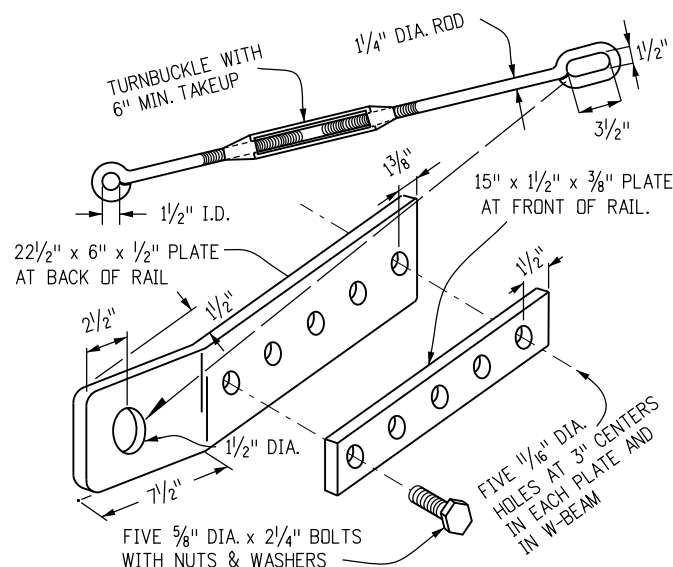


TYPE 3D HARDWARE DETAILS

NOTE: ALL PARTS SHALL BE GALVANIZED

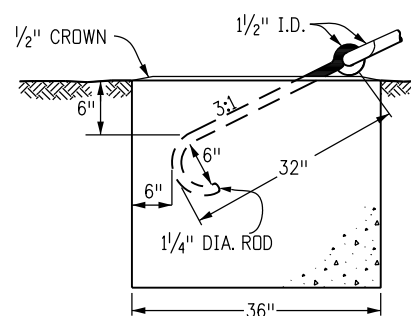


FRONT

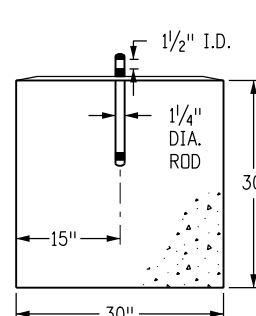


END

TYPE 3D ANCHOR BLOCK DETAIL

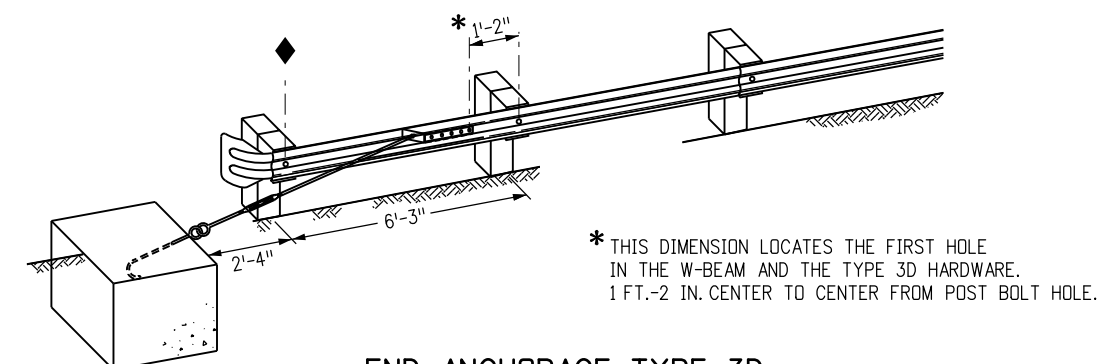

END ANCHORAGE TYPE 3D DEPARTURE TERMINAL



Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	MIDWEST GUARDRAIL SYSTEM (MGS) TYPE 3 W-BEAM 31 INCHES		STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)	Date:	Comments		M-606-1		Standard Sheet No. 5 of 19	
Designer Initials: JBK								
Last Modification Date: 07/31/19								
Detailer Initials: LTA								
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English					Issued by the Project Development Branch: July 31, 2019	Project Sheet Number:		

OFFSET NOTES

1. POST OFFSET DIMENSIONS ARE GIVEN TO THE CENTER OF THE TRAFFIC FACE OF POSTS.
2. THE GUARDRAIL BETWEEN POST ① THRU ⑦ IS ON A STRAIGHT LINE FLARE.




NOTES

1. THE END ANCHORAGES (FLARED) SHALL EITHER BE THE SLOTTED RAIL TERMINAL SRT-31 AS MANUFACTURED BY TRINITY HIGHWAY PRODUCTS LLC (TELEPHONE #: 1-888-356-2363), OR THE FLEAT-350, AS MANUFACTURED BY ROAD SYSTEMS INC. (TELEPHONE #: 432-263-2435). ONE END ANCHORAGE (FLARED) SHALL INCLUDE ALL POST, RAIL, AND ALL HARDWARE ITEMS REQUIRED FOR A COMPLETE UNIT. THE END ANCHORAGE (FLARES) SHALL BE INSTALLED CONFORMING TO THE MANUFACTURER'S RECOMMENDATIONS. THE CONTRACTOR SHALL PROVIDE A COPY OF THE MANUFACTURER'S INSTALLATION INSTRUCTIONS AND PARTS LIST TO THE ENGINEER PRIOR TO INSTALLATION OF THE DEVICE.
2. AFTER INSTALLATION AND IN HEAVY SNOW LOCATIONS, TRIM POSTS ① AND ② (IF THEY ARE WOODEN) FLUSH WITH RAIL TOP AND TREAT END WITH SEALANT, IN CONFORMANCE WITH AASHTO M 133.
3. POSTS SHALL BE DRILLED FOR BREAKAWAY ACCORDING TO THE MANUFACTURER'S INSTRUCTIONS.
4. SEE SHEETS 1, 3 AND 5 FOR STANDARD GUARDRAIL TYPE 3 AND INSTALLATION DETAILS.
5. RETROREFLECTOR TABS SHALL NOT BE USED ON END ANCHORAGE POSTS.
6. DELINEATION SHALL BE APPLIED TO THE END PIECE, AND SHALL NOT BE PAID FOR SEPARATELY BUT SHALL BE INCLUDED IN THE WORK.

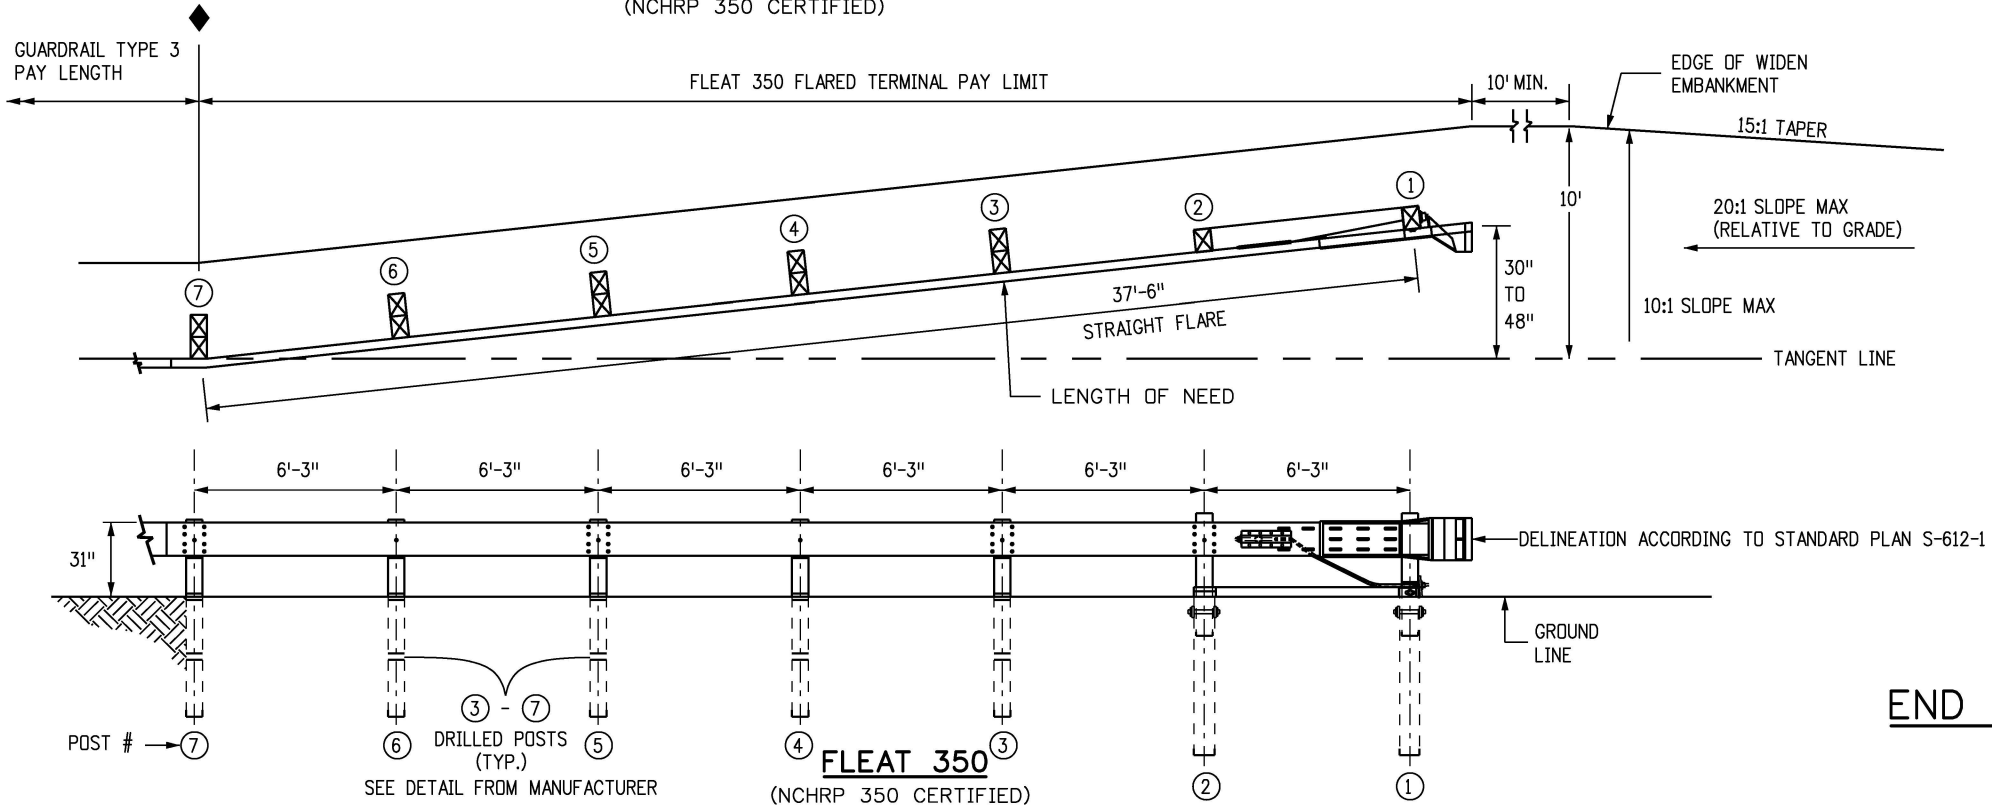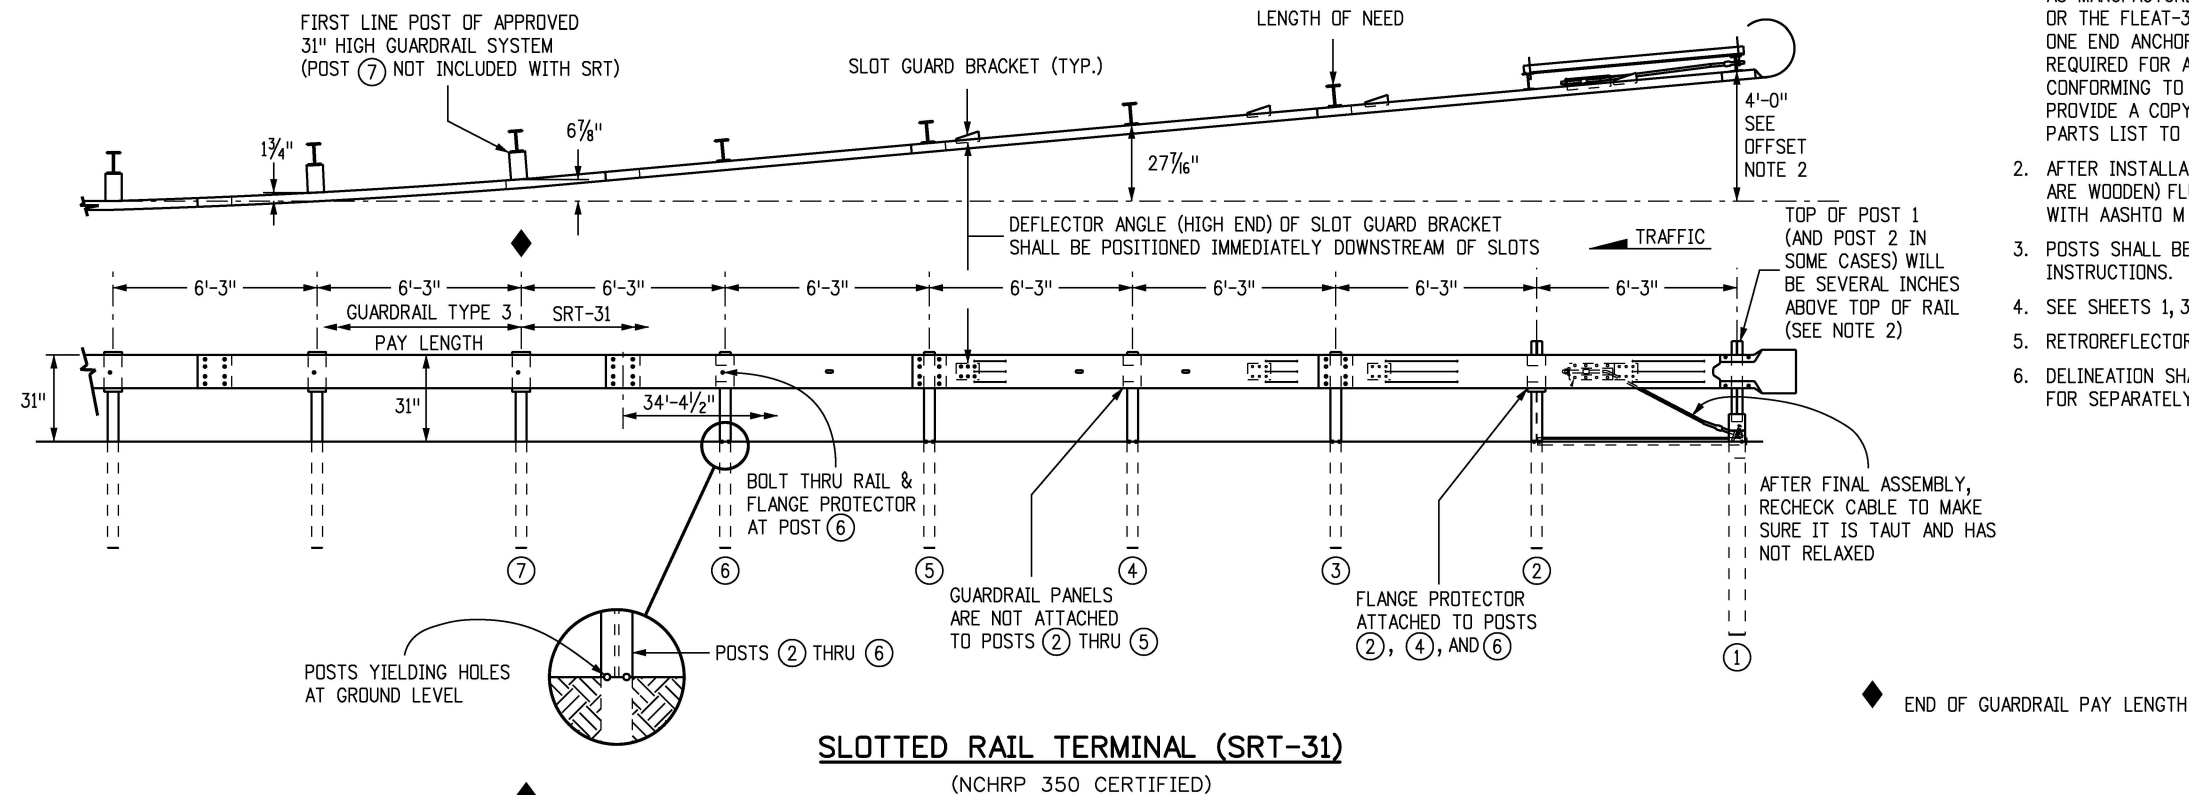




END ANCHORAGES (FLARED)

Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	MIDWEST GUARDRAIL SYSTEM (MGS) TYPE 3 W-BEAM 31 INCHES Issued by the Project Development Branch: July 31, 2019	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-606-1	
Designer Initials: JBK						Standard Sheet No. 6 of 19	
Last Modification Date: 07/31/19						Project Sheet Number:	
Detailer Initials: LTA							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						

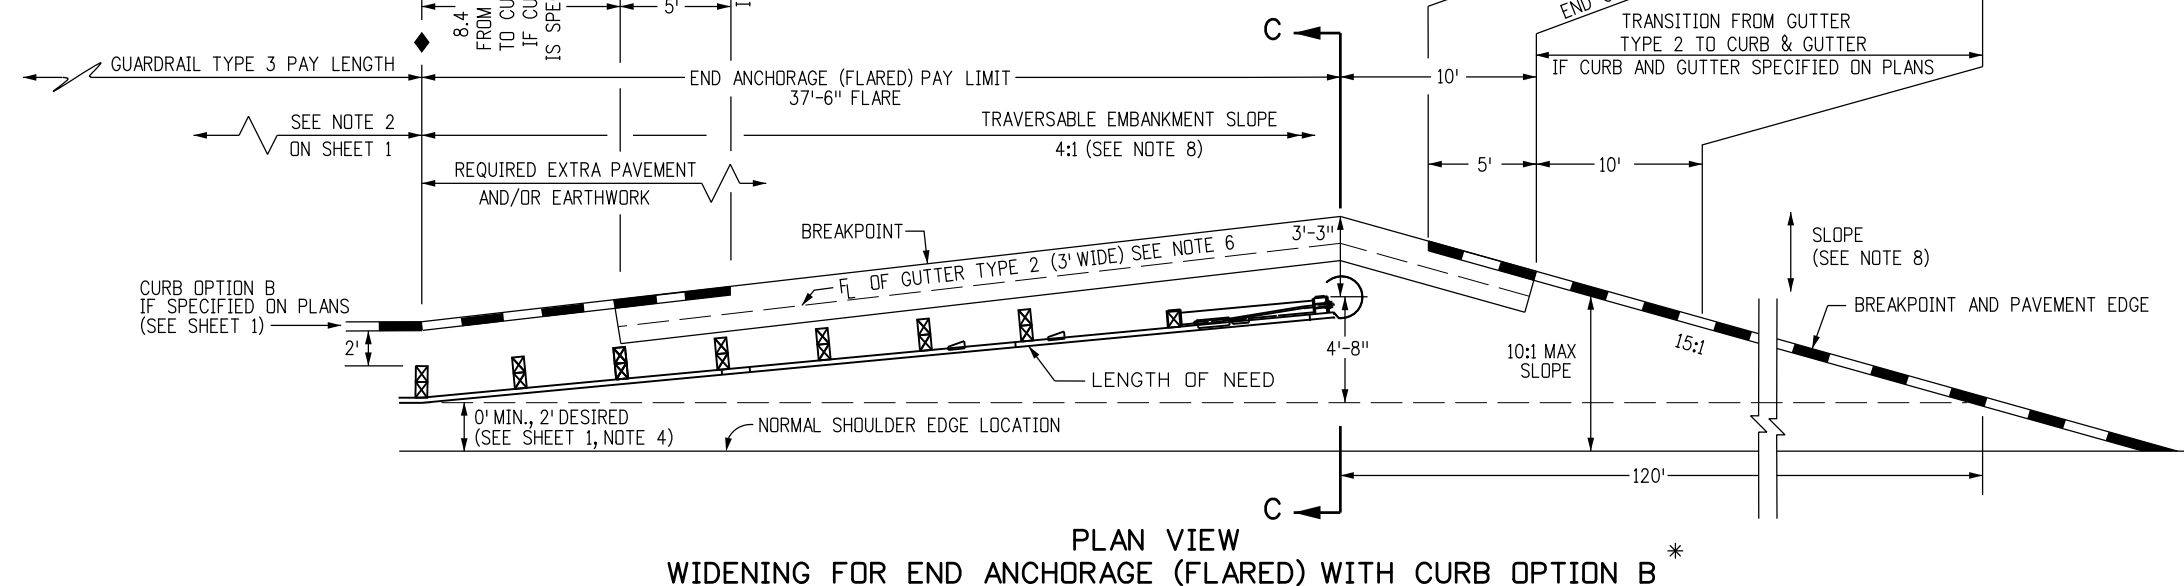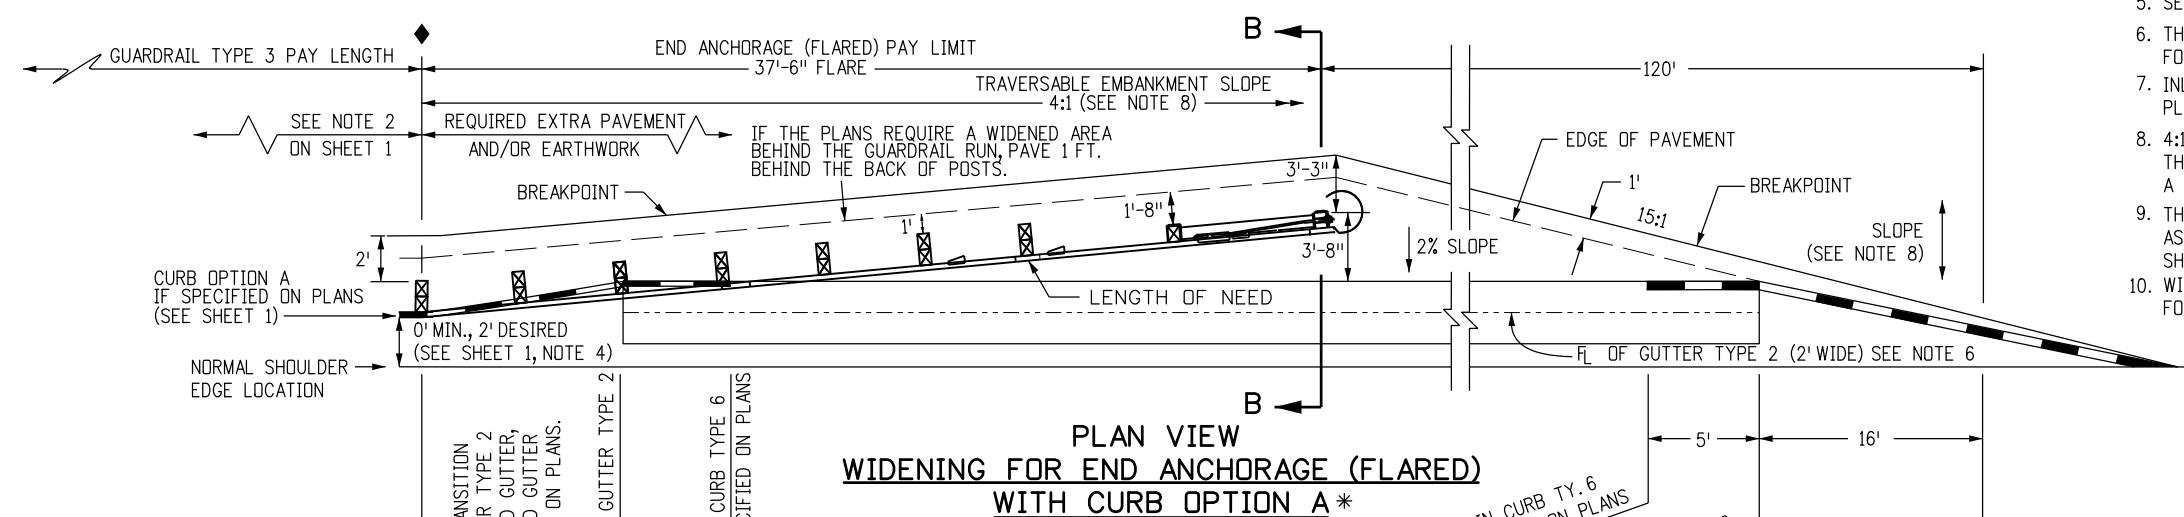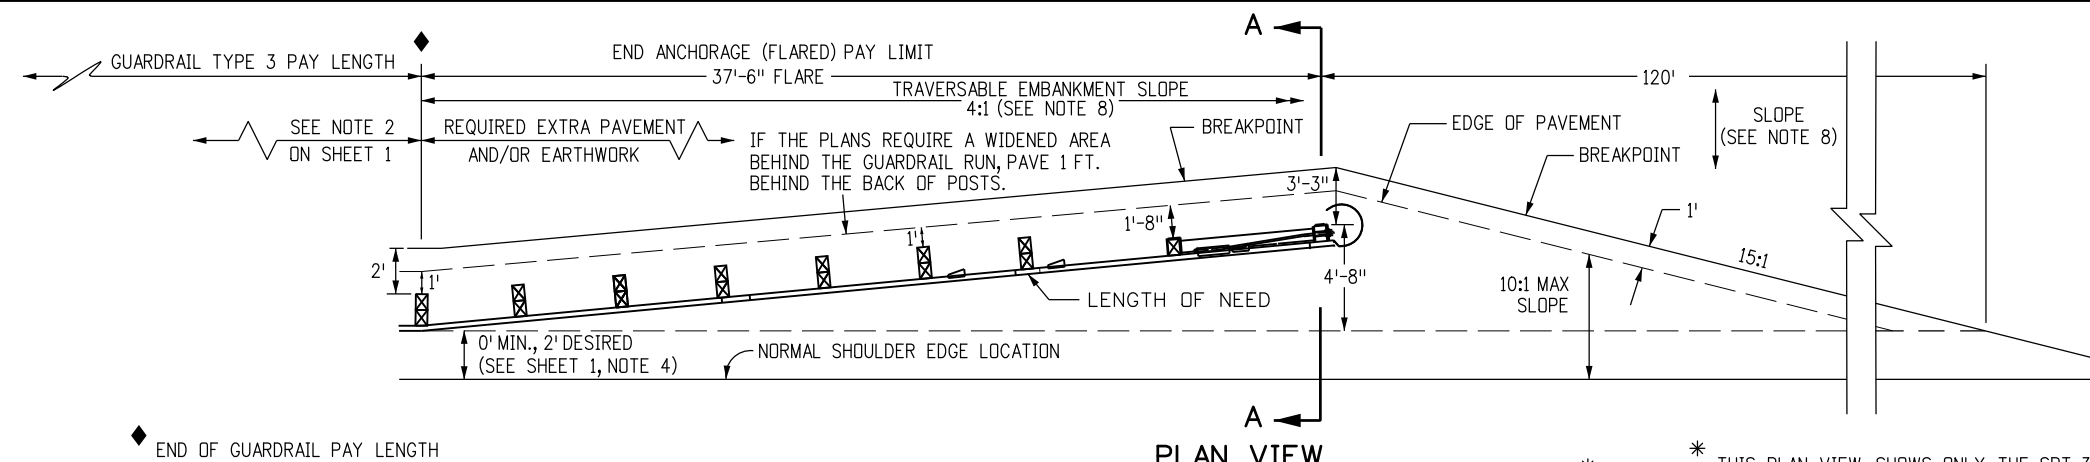

NOTES


- PAYMENT FOR THE ADDED EMBANKMENT (APPROXIMATELY 45 CU. YDS.) FOR THE FLARE SHALL BE AS FOLLOWS:
A. UNDER PAY ITEM 203 WHEN THE CONTRACT PLAN INCLUDES PAY ITEM 203
B. INCLUDED IN THE COST OF THE END ANCHORAGE (FLARED) WHEN THE CONTRACT PLANS DO NOT INCLUDE PAY ITEM 203. THE ADDED EMBANKMENT SHALL BE CONSTRUCTED IN ACCORDANCE WITH SUBSECTION 203.07, AASHTO T 99.
- WHEN THE WIDENED AREA IS PAVED, PAYMENT FOR THE PAVEMENT (APPROX. 70 SQ. YDS.) SHALL BE AS FOLLOWS:
A. UNDER PAY ITEM 403 OR 412 WHEN THE CONTRACT PLAN INCLUDES PAY ITEM 403 OR 412
B. INCLUDED IN THE COST OF THE END ANCHORAGE (FLARED) WHEN THE CONTRACT PLAN DOES NOT INCLUDE PAY ITEM 403 OR 412 (SEE SHEET 1, NOTE 2 FOR PAVEMENT TYPES)
- CONCRETE PAVED AREAS SHALL HAVE THEIR TAPERED ENDS SQUARED OFF AS DIRECTED BY THE ENGINEER.
- WHEN OVERLAY PAVING, THE FINISHED SURFACE AT EACH POST SHALL NOT BE ABOVE THE TOP BREAKAWAY HOLE OR STRUT ASSEMBLY. THE WIDENED AREA AT THE FLARED END ANCHORAGE SHOULD NOT BE OVERLAYED UNLESS PAVEMENT CONDITIONS WARRANT IT BEING OVERLAYED. ANY OVERLAY PAVEMENT ABUTTING THE FLARED END ANCHORAGE SHALL BE TAPERED TO PREVENT A DROP IN THE PAVED SURFACE BELOW THE RAIL.
- SEE SHEETS 1, 2, 3, AND 5 FOR STANDARD TYPE 3 GUARDRAIL INSTALLATION DETAILS.
- THE COST OF THE GUTTER WILL BE PAID FOR AS "GUTTER TYPE 2 (2 FT.)" FOR A LENGTH OF 134 FT. OR "GUTTER TY. 2 (3 FT.)" FOR A LENGTH OF 40 FT.
- INLETS OR RUNDOWNS MAY BE USED INSTEAD OF THE GUTTER IF SPECIFIED ON THE PLANS. NO ADDITIONAL CURB SHALL BE ADDED IN THE VICINITY OF THE END ANCHORAGE.
- 4:1 OR FLATTER SLOPES IN THE TRAVERSABLE AREA SHALL BE USED BEHIND THE END ANCHORAGE, AND IN ADVANCE OF POST ①. IF THIS IS NOT POSSIBLE, A MINIMUM 3:1 SLOPE MAY BE USED IF APPROVED BY THE ENGINEER.
- THE WIDENED AREA, EXCEPT FOR CURB OPTION A, SHALL HAVE THE SAME GRADING AS THE ADJACENT GUARDRAIL: 10:1 OR FLATTER IF MORE THAN 2 FT. FROM SHOULDER OR SLOPE EQUAL TO ROADWAY SLOPE IF 2 FT. OR LESS FROM SHOULDER.
- WIDENING FOR END ANCHORAGES SHALL BE PAVED ON INTERSTATES AND FREEWAYS. FOR OTHER HIGHWAYS, PAVING SHALL BE AS SHOWN ON THE PLANS.

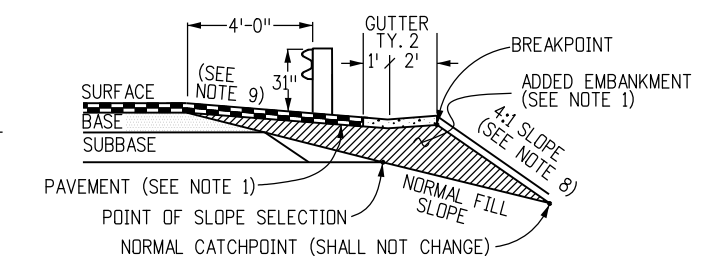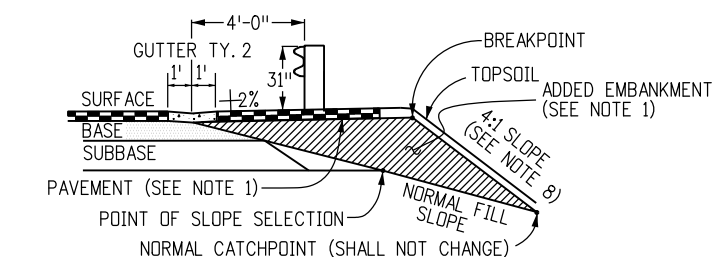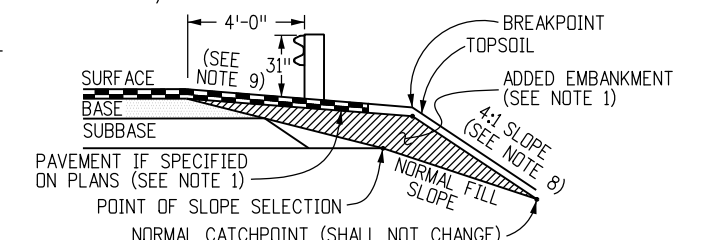

Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	MIDWEST GUARDRAIL SYSTEM (MGS) TYPE 3 W-BEAM 31 INCHES Issued by the Project Development Branch: July 31, 2019	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-606-1	
Designer Initials: JBK	(R-X)					Standard Sheet No. 7 of 19	
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:	
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						


NOTES FOR NONFLARED

1. THE END ANCHORAGE (NONFLARED) SHALL EITHER BE THE SOFTSTOP AS MANUFACTURED BY TRINITY INDUSTRIES, INC. (TEL. #: 1-888-356-2363), OR THE MAX-TENSION AS MANUFACTURED BY LINDSAY TRANSPORTATION SOLUTIONS (TEL. #: 402-829-6800), OR THE MSKT AS MANUFACTURED BY ROAD SYSTEMS, INC. (TEL. #: 432-263-2435). THE END ANCHORAGE (NONFLARED) SHALL INCLUDE ALL POST, RAIL, AND HARDWARE ITEMS REQUIRED FOR A COMPLETE UNIT. THE END ANCHORAGE (NONFLARED) SHALL BE INSTALLED CONFORMING TO THE MANUFACTURER'S RECOMMENDATIONS. THE CONTRACTOR SHALL PROVIDE A COPY OF THE MANUFACTURER'S INSTALLATION INSTRUCTIONS AND PARTS LIST TO THE ENGINEER PRIOR TO THE INSTALLATION OF THE DEVICE.
2. DO NOT ATTACH THESE END ANCHORAGES DIRECTLY TO A RIGID BARRIER (EX. CONCRETE BARRIER, STEEL BARRIER, CONCRETE STRUCTURE) WITHOUT A PROPER TRANSITION.
3. CONNECTIONS TO W-BEAMS WHERE THE SPLICE IS NOT AT MID-SPAN BUT AT A POST CAN BE MADE USING A 3'-1 1/2", 9'-4 1/2", OR 15'-7 1/2" W-BEAM PANEL DOWNSTREAM OF TRAFFIC.
4. FOR MSKT END ANCHORAGES (NONFLARED), USE THE MANUFACTURER'S SPECIFIED STEEL FOUNDATION TUBES FOR POSTS ① AND ②.
5. RETROREFLECTOR TABS SHALL NOT BE USED ON END ANCHORAGE POSTS.
6. DELINEATION SHALL BE APPLIED TO THE END PIECE AND SHALL NOT BE PAID FOR SEPARATELY BUT BE INCLUDED IN THE COST OF THE WORK. SEE STANDARD PLAN S-612-1.

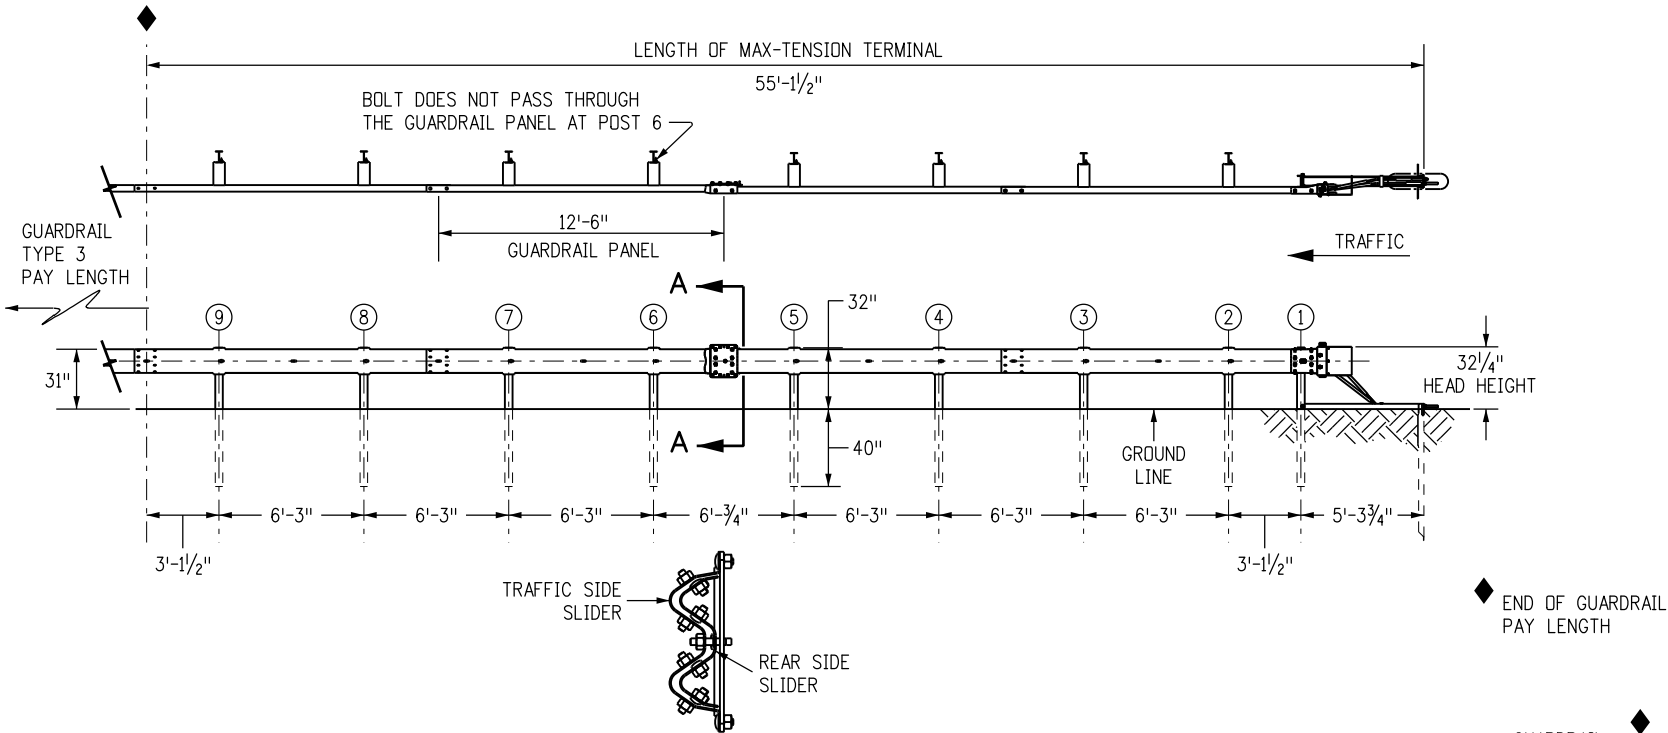




SECTION A-A

MAX-TENSION TERMINAL END ANCHORAGE (NONFLARED)
(MASH CERTIFIED)

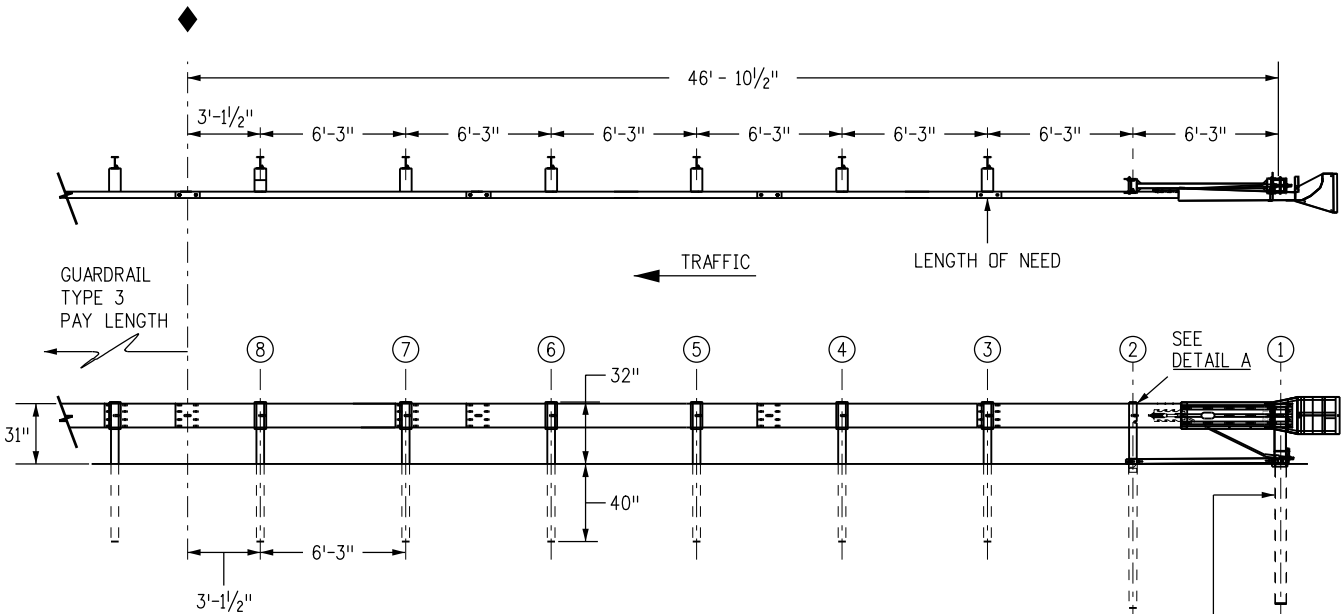




MSKT TERMINAL END ANCHORAGE (NONFLARED)
(MASH CERTIFIED)

END ANCHORAGES (NONFLARED)

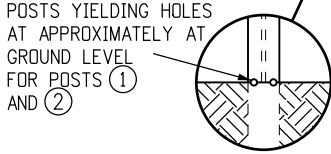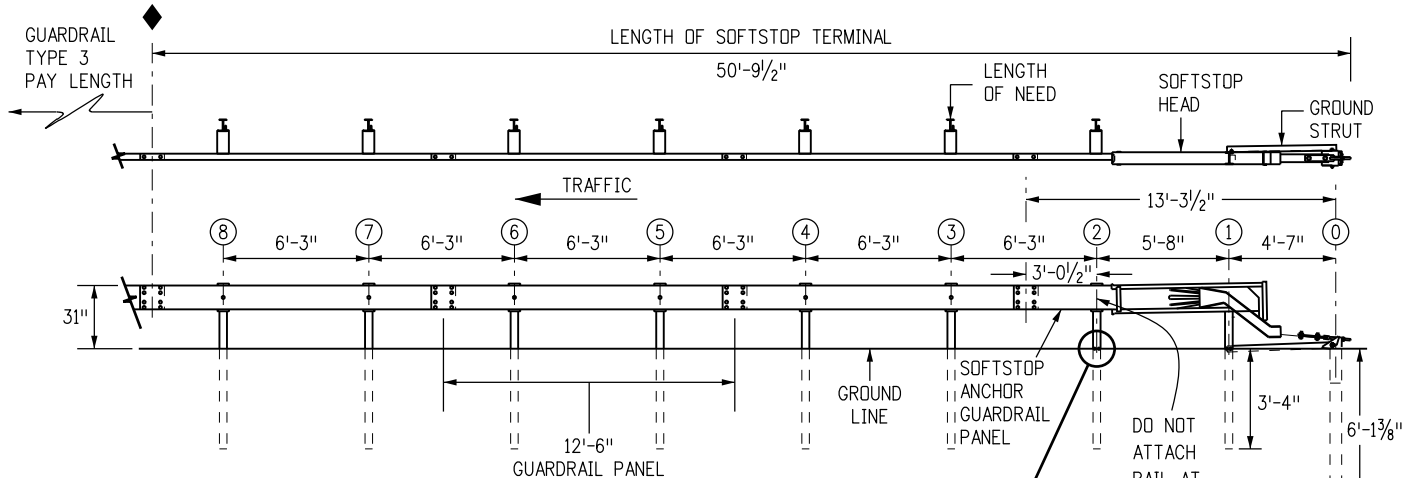


SOFTSTOP TERMINAL END ANCHORAGE (NONFLARED)
(MASH CERTIFIED)

Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	MIDWEST GUARDRAIL SYSTEM (MGS) TYPE 3 W-BEAM 31 INCHES Issued by the Project Development Branch: July 31, 2019	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-606-1	
Designer Initials: JBK	(R-X)					Standard Sheet No. 8 of 19	
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:	
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English							

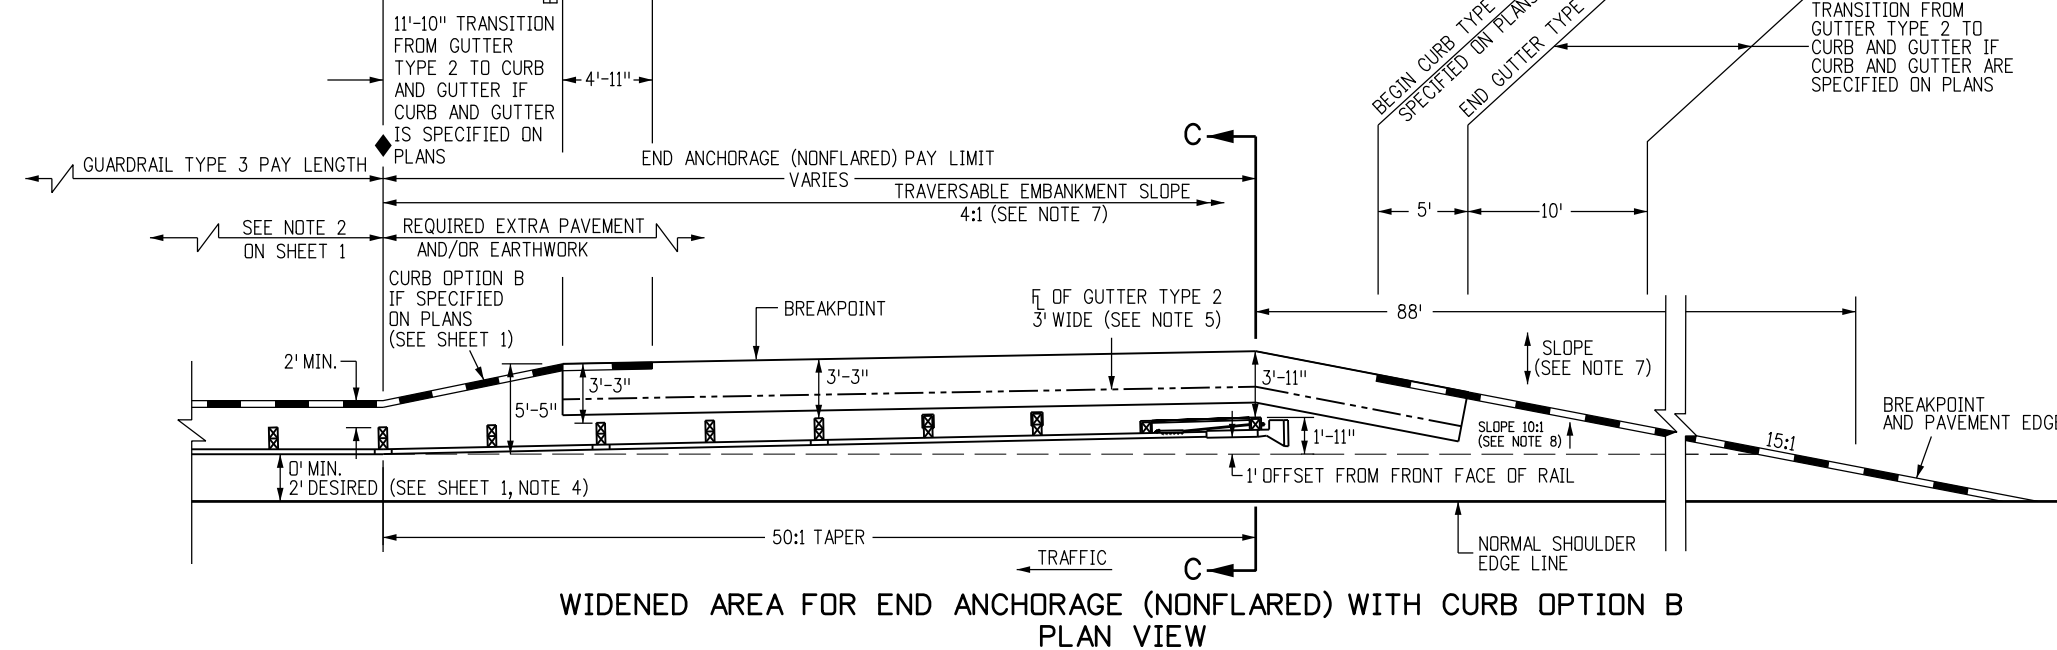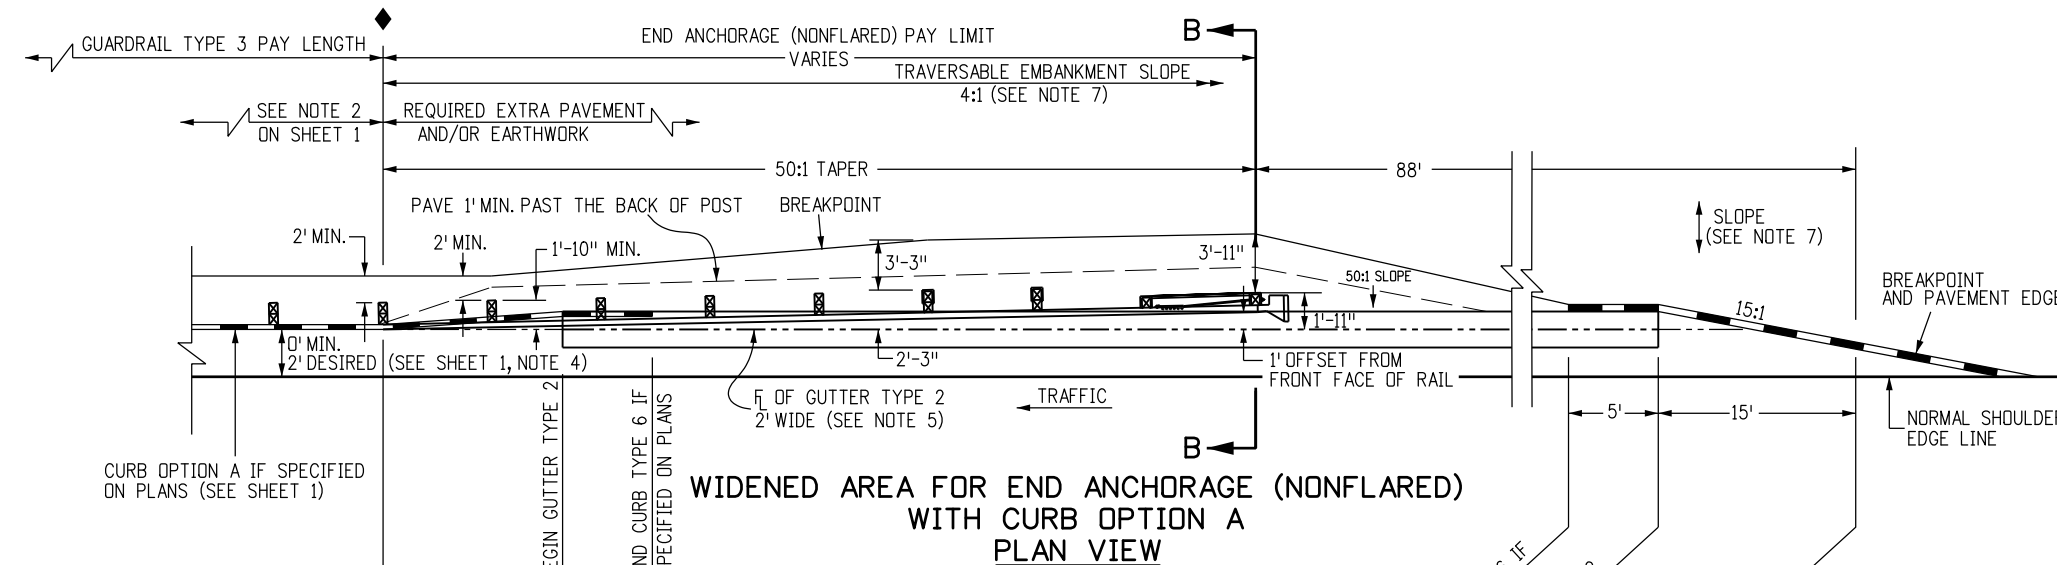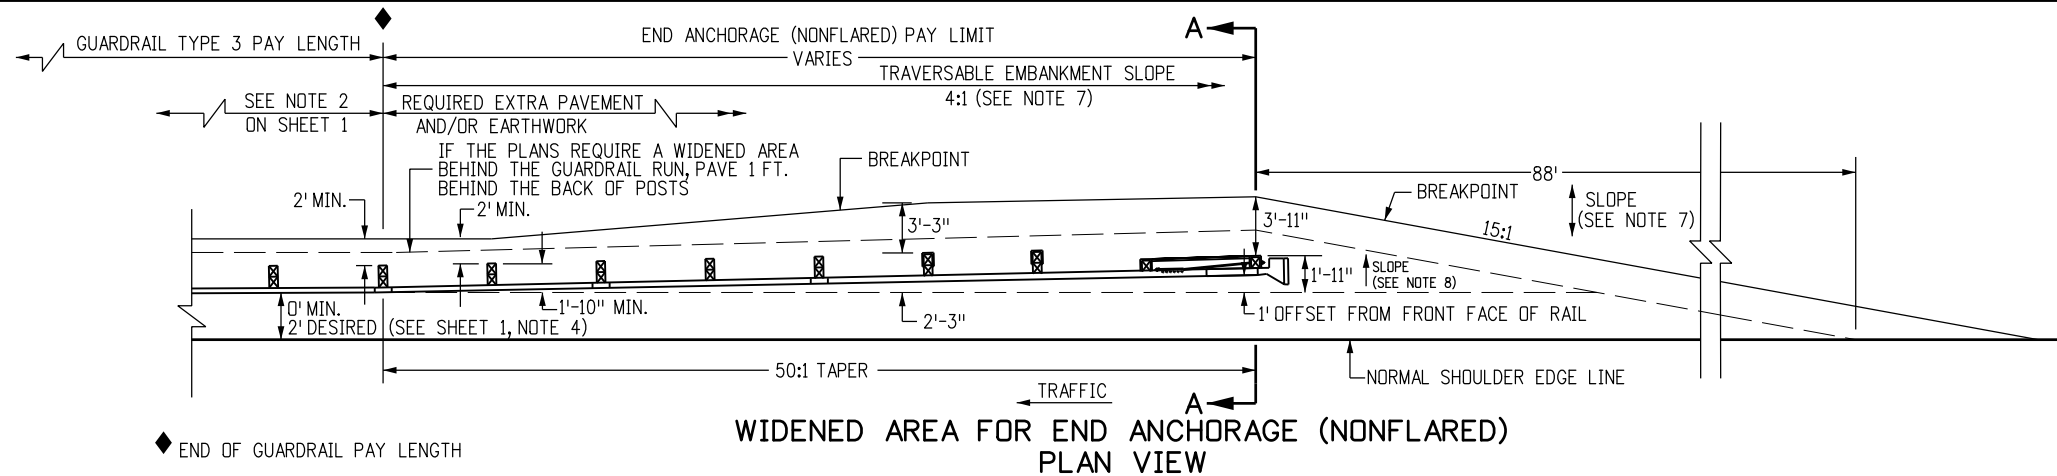

- ### NOTES
- PAYMENT FOR THE ADDED EMBANKMENT (APPROXIMATELY 25 CU. YDS.) FOR THE FLARE SHALL BE AS FOLLOWS:
A. UNDER PAY ITEM 203 WHEN THE CONTRACT PLAN INCLUDES PAY ITEM 203.
B. INCLUDED IN THE COST OF THE END ANCHORAGE (NONFLARED) WHEN THE CONTRACT PLANS DOES NOT INCLUDE PAY ITEM 203. THE ADDED EMBANKMENT SHALL BE BE CONSTRUCTED IN ACCORDANCE WITH SUBSECTION 203.07, AASHTO T 99.
 - WHEN THE WIDENED AREA IS PAVED, PAYMENT FOR THE PAVEMENT (APPROX. 39 SQ. YDS.) SHALL BE AS FOLLOWS:
A. UNDER PAY ITEM 403 OR 412 WHEN THE CONTRACT PLAN INCLUDES PAY ITEM 403 OR 412.
B. INCLUDED IN THE COST OF THE END ANCHORAGE (NONFLARED) WHEN THE CONTRACT PLAN DOES NOT INCLUDE PAY ITEM 403 OR 412, (SEE SHEET 1, NOTE 2 FOR PAYMENT TYPES).
 - WHEN OVERLAY PAVING, THE FINISHED SURFACE AT EACH POST SHALL NOT BE ABOVE THE TOP BREAKWAY HOLE OR STRUT ASSEMBLY. THE WIDENED AREA AT THE END ANCHORAGE (NONFLARED) SHALL NOT BE OVERLAYED UNLESS PAVEMENT CONDITIONS WARRANT IT BEING OVERLAYED. ANY OVERLAY PAVEMENT ABUTTING THE END ANCHORAGE (NONFLARED) SHALL BE TAPERED TO PREVENT A DROP IN THE PAVED SURFACE BELOW THE RAIL.
 - SEE SHEETS 1, 2, 3, AND 5 FOR STANDARD TYPE 3 GUARDRAIL INSTALLATION DETAILS.
 - THE COST OF THE GUTTER WILL BE PAID FOR AS "GUTTER TYPE 2 (2 FT.)" FOR A LENGTH OF 111 FT., OR "GUTTER TY. 2 (3 FT.)" FOR A LENGTH OF 50 FT.
 - INLETS OR RUNDOWNS MAY BE USED INSTEAD OF THE GUTTER IF SPECIFIED ON THE PLANS. NO ADDITIONAL CURB SHALL BE ADDED IN THE VICINITY OF THE END TREATMENT.
 - 4:1 OR FLATTER SLOPES IN THE TRAVERSABLE AREA SHALL BE USED BEHIND THE END ANCHORAGE AREA, AND IN ADVANCE OF POST ①. IF THIS IS NOT POSSIBLE A MINIMUM 3:1 SLOPE MAY BE USED IF APPROVED BY THE ENGINEER.
 - THE WIDENED AREA, EXCEPT FOR CURB OPTION A, SHALL HAVE THE SAME GRADING AS BENEATH THE ADJACENT GUARDRAIL: 10:1 OR FLATTER IF MORE THAN 2 FT. FROM SHOULDER, OR SLOPE EQUAL TO ROADWAY SLOPE IF 2 FT. OR LESS FROM SHOULDER.
 - WIDENING FOR END ANCHORAGES SHALL BE PAVED ON INTERSTATES AND FREEWAYS. FOR OTHER HIGHWAYS, PAVING SHALL BE AS SHOWN ON THE PLANS.

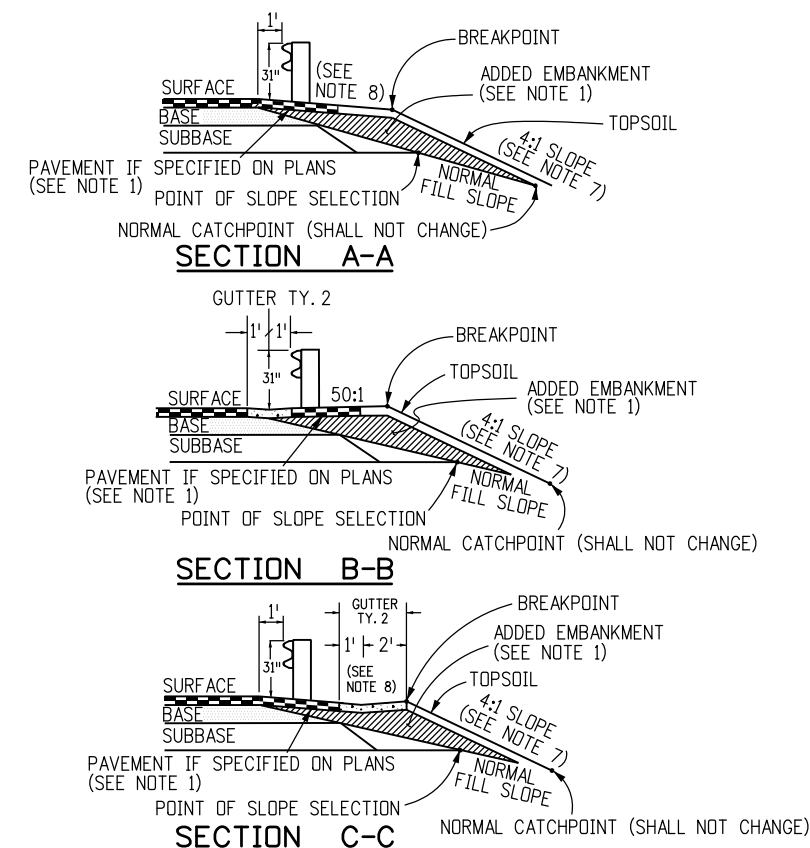

Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	MIDWEST GUARDRAIL SYSTEM (MGS) TYPE 3 W-BEAM 31 INCHES		STANDARD PLAN NO. M-606-1 Standard Sheet No. 9 of 19
Creation Date: 07/31/19	(R-X)	Date:	Comments				Project Sheet Number:
Designer Initials: JBK	(R-X)						
Last Modification Date: 07/31/19	(R-X)						
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						

MEDIAN TERMINAL NOTES

1. THE MEDIAN TERMINAL SHALL BE THE MAX-TENSION MEDIAN AS MANUFACTURED BY BY BARRIER SYSTEM BY LINDSAY (LINDSAY TRANSPORTATION SOLUTIONS) (TEL #: 888 800-3691).

2. THE MAX-TENSION SHALL BE APPLIED DIRECTLY TO W-BEAM GUARDRAIL SYSTEMS AT, OR TRANSITIONED TO, 31 INCH WITH PANELS AND POST SPACING CONFIGURED AT MID-SPAN SPLICE. TRANSITIONS TO STRONG POST W-BEAM GUARDRAIL SYSTEMS OR OTHER BARRIERS WHERE THE SPLICE IS NOT MID-SPAN SHALL BE ACCOMPLISHED USING A 3 FT. 1-1/2 INCH, 9 FT. 4-1/2 INCH OR 15 FT. 7-1/2 INCH PANELS AFTER THE MAX-TENSION SYSTEM (MIN. OF 50 FT. DOWNSTREAM OF THE FIRST POST). TRANSITIONS TO OTHER BARRIER SYSTEMS SHALL ALSO BE AT A MIN. OF 50 FT. DOWNSTREAM FROM THE FIRST POST. SEE SHEET 4.

3. THE MAX-TENSION SHALL NOT BE ATTACHED DIRECTLY TO RIGID BARRIERS SUCH AS CONCRETE BARRIERS, STEEL BARRIERS OR CONCRETE STRUCTURES WITHOUT PROPER TRANSITION. IF ROCK OR STIFF SOIL IS ENCOUNTERED, THE POSTS AND SOIL ANCHOR MAY BE INSTALLED BY AUGURING AND BACKFILLING THE HOLE.

4. EITHER 8 INCH OR 12 INCH COMPOSITE OR TIMBER BLOCKOUTS SHALL BE USED PER MANUFACTURE'S RECOMMENDATIONS.

5. EITHER 12 FT.-6 INCH OR 25 FOOT PANELS SHALL BE USED DEPENDING ON SITE CONDITIONS OR CONNECTED BARRIER SYSTEMS.



6. RAIL PANELS SHALL BE LAPPED PER MANUFACTURER'S INSTALLATION MANUAL, REGARDLESS OF AN UPSTREAM OR DOWNSTREAM END SYSTEM POSITION.
7. ALL STEEL COMPONENTS SHALL BE GALVANIZED PER ASTM A123 OR EQUIVALENT UNLESS OTHERWISE STATED.

8. ONE MEDIAN TERMINAL SHALL INCLUDE ALL POSTS, RAIL, AND HARDWARE ITEMS REQUIRED FOR A COMPLETE UNIT. THE DEVICE SHALL BE INSTALLED IN CONFORMANCE WITH THE MANUFACTURER'S INSTRUCTIONS. THE CONTRACTOR SHALL PROVIDE A COPY OF THE MANUFACTURER'S INSTALLATION INSTRUCTIONS AND PARTS LISTS TO THE ENGINEER PRIOR TO THE INSTALLATION OF THE DEVICE.



9. UNLESS OTHERWISE SPECIFIED ON THE PLANS, THE MEDIAN TERMINAL SHALL BE INSTALLED FOR BIDIRECTIONAL TRAFFIC APPLICATION.

10. EACH INSTALLATION SHALL BE SUPERVISED AND CERTIFIED AS CORRECT UPON COMPLETION BY A REPRESENTATIVE OF THE DEVICE MANUFACTURER OR BY AN EMPLOYEE OF THE CONTRACTOR WHO IS A CERTIFIED INSTALLER. THE CERTIFIED INSTALLER SHALL HAVE COMPLETED DEVICE TRAINING AND SHALL BE REGISTERED WITH THE MANUFACTURER AS A CERTIFIED INSTALLER.

11. DELINEATION, IF REQUIRED, SHALL BE APPLIED TO THE END PIECE AND WILL NOT BE PAID FOR SEPARATELY BUT SHALL BE INCLUDED IN THE COST OF THE WORK. SEE STANDARD PLAN S-612-1.


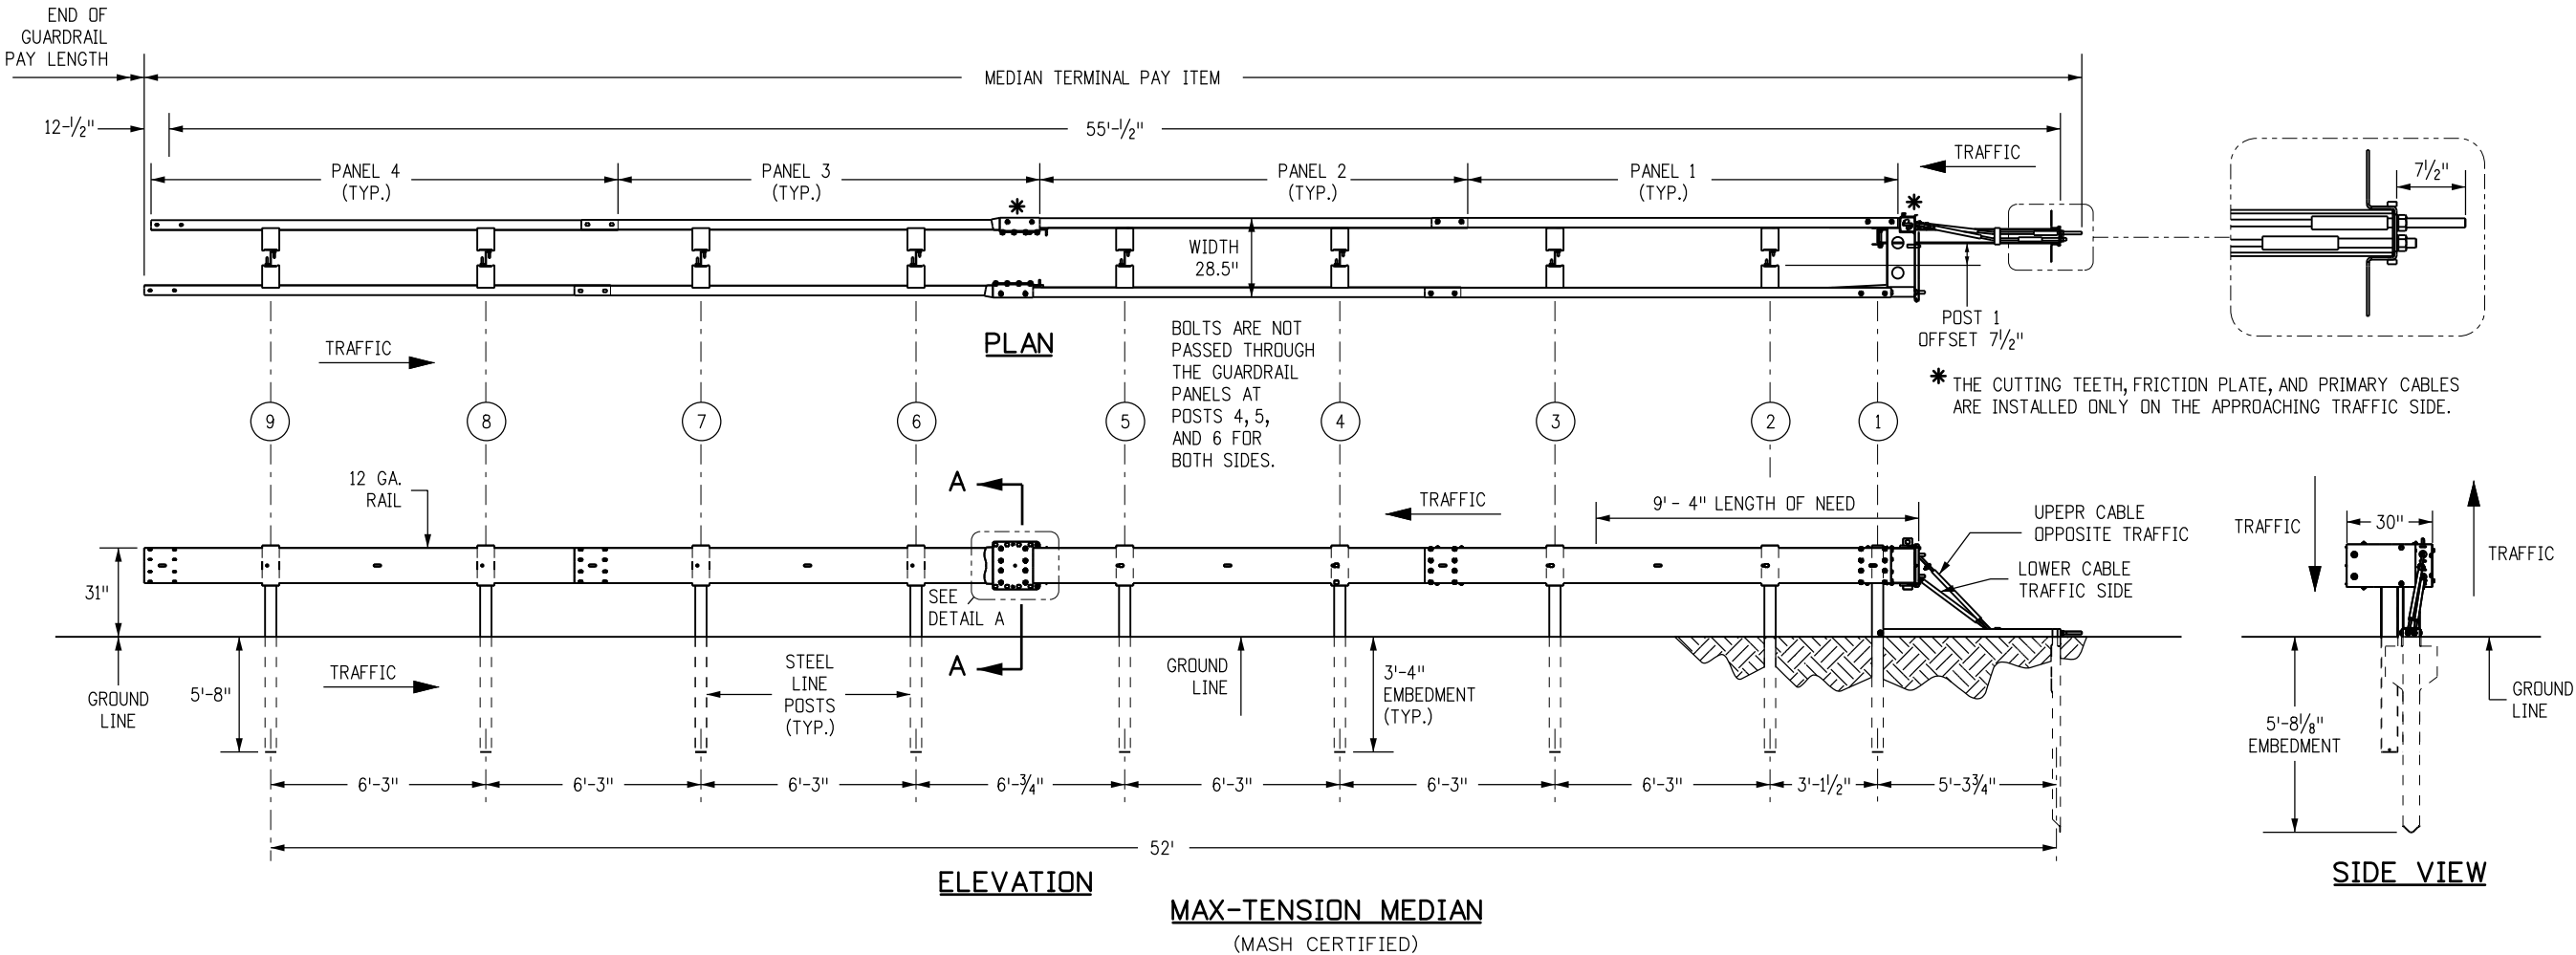
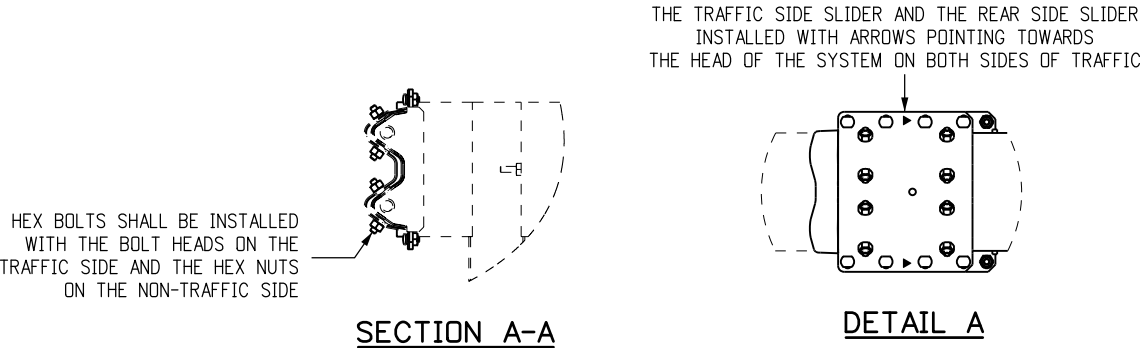


Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	MIDWEST		STANDARD PLAN NO.	
Creation Date: 07/31/19			Date:	Comments		GUARDRAIL SYSTEM (MGS)		M-606-1	
Designer Initials: JBK						TYPE 3 W-BEAM 31 INCHES		Standard Sheet No. 10 of 19	
Last Modification Date: 07/31/19									
Detailer Initials: LTA									
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English								Issued by the Project Development Branch: July 31, 2019	
						Project Sheet Number:			

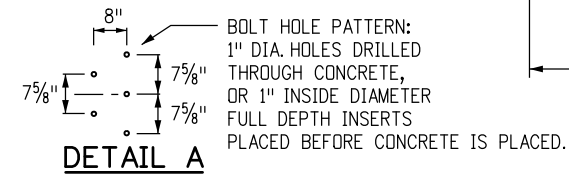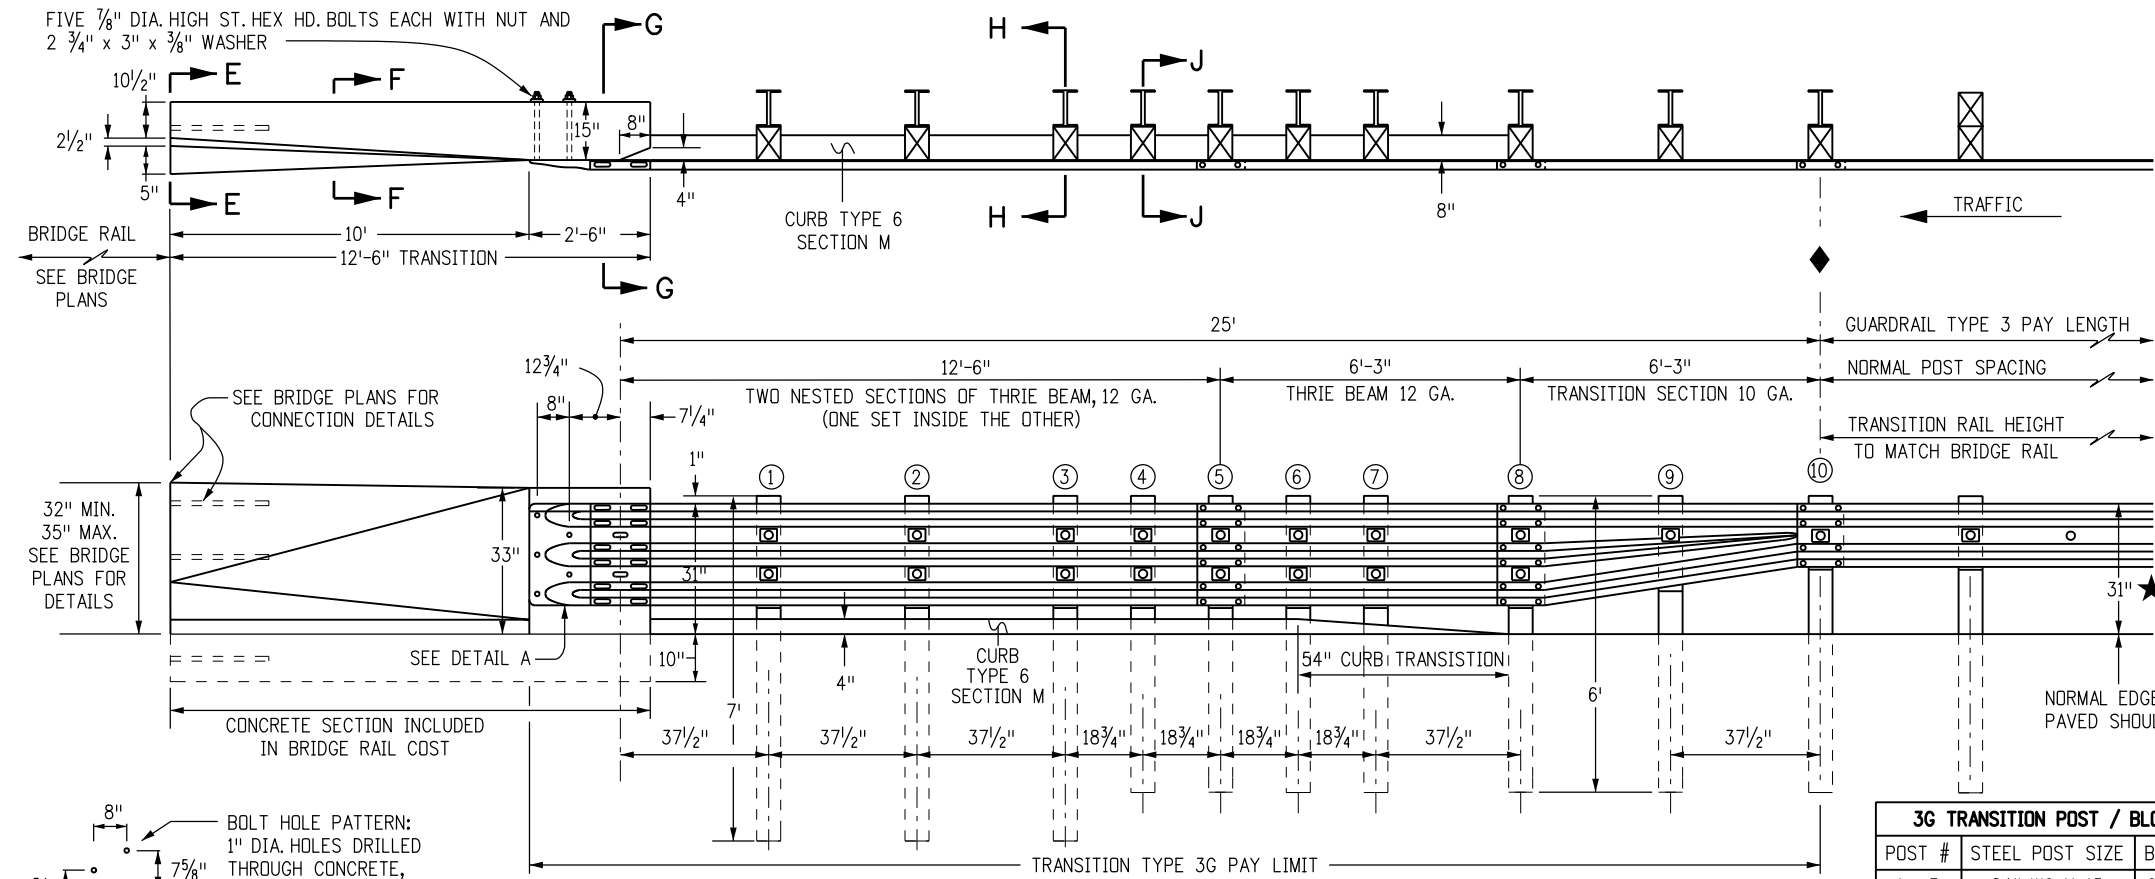


3G TRANSITION POST / BLOCK SIZING		
POST #	STEEL POST SIZE	BLOCKOUT SIZE
1 - 3	84" W6 X 15	6" X 12" X 19"
4 - 9	72" W6 X 9	6" X 12" X 19"
10	72" W6 X 9	6" X 12" X 14"


- ### NOTES
- TRANSITION TYPE 3G IS FOR USE AT BOTH ENDS OF BRIDGES ON TWO-WAY HIGHWAYS AND AT THE APPROACH END OF BRIDGES ON ONE-WAY HIGHWAYS.
 - TRANSITION TYPE 3H IS FOR USE AT THE TRAILING END OF BRIDGES ON ONE-WAY HIGHWAYS.
 - THE THRIE BEAM SECTION IN TRANSITIONS TYPES 3G AND 3H MAY BE SHOP BENT TO FIT CURVES THAT ARE GREATER THAN OR EQUAL TO A 10 FT. RADIUS. HOWEVER, THE 6 FT.-3 IN. TRANSITION SECTION SHALL NOT BE BENT.
 - A 12 FT.-6 IN. CONCRETE TRANSITION IS REQUIRED BETWEEN THE TYPE 3G OR 3H AND TYPE 7 BRIDGE RAIL. SEE STANDARD PLAN M-606-15 FOR THE TRANSITION BETWEEN TYPE 3 GUARDRAIL AND TYPE 9 GUARDRAIL.
 - TRANSITIONS TYPE 3G AND TYPE 3H ARE ALSO USED TO CONNECT TO TYPE 8 AND TYPE 10 BRIDGE RAIL. SEE BRIDGE PLANS FOR CONNECTION DETAILS.
 - BACKUP PLATE IS NOT REQUIRED AT POSTS ON TYPE 3G AND 3H.
 - THIS SYMBOL IN THE ELEVATION DRAWINGS SHOWS THE LOCATIONS WHERE A RECTANGULAR WASHER IS REQUIRED UNDER THE POST BOLT HEAD.
 - CURB TYPE 6 SECTION M, MAY BE ASPHALT OR CONCRETE. THE COST OF CURB IS INCLUDED IN THE WORK, UNLESS A SEPARATE PAY ITEM IS INCLUDED IN THE BID SCHEDULE.
 - FOR TYPE 3G, POSTS ① THRU ③ ARE 7 FT. LONG. ALL OTHER POSTS SHALL BE A STANDARD 6 FT. LONG UNLESS OTHERWISE SPECIFIED IN THE CONTRACT.
 - NOTCHED RAIL BLOCKS MANUFACTURED FROM SYNTHETIC MATERIAL WILL BE ACCEPTED AS ALTERNATIVES TO WOOD NOTCHED BLOCKS FOR USE WITH STEEL POSTS PROVIDED THAT THE BLOCKS HAVE RECEIVED FHWA APPROVAL AND ARE CERTIFIED AS IDENTICAL TO THE SPECIMENS USED FOR TESTING AND APPROVAL. STEEL BLOCKS ARE NOT ALLOWED.

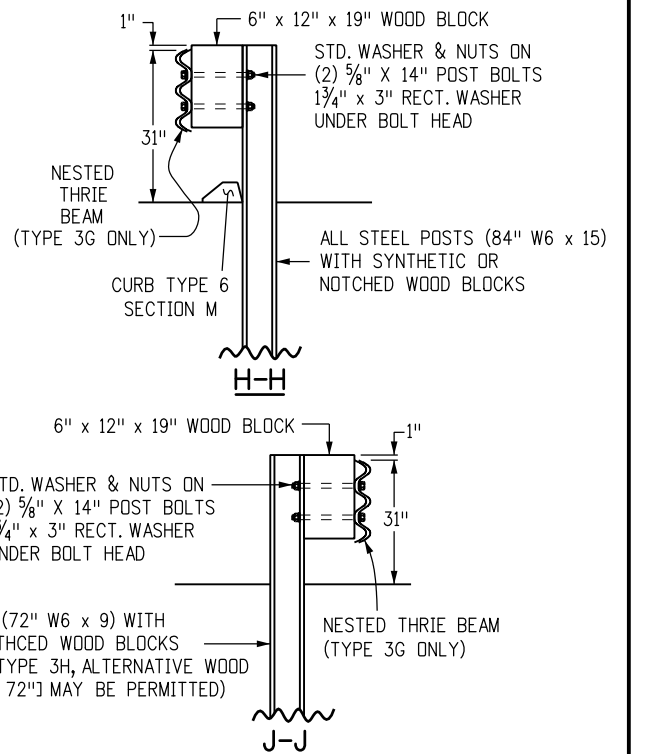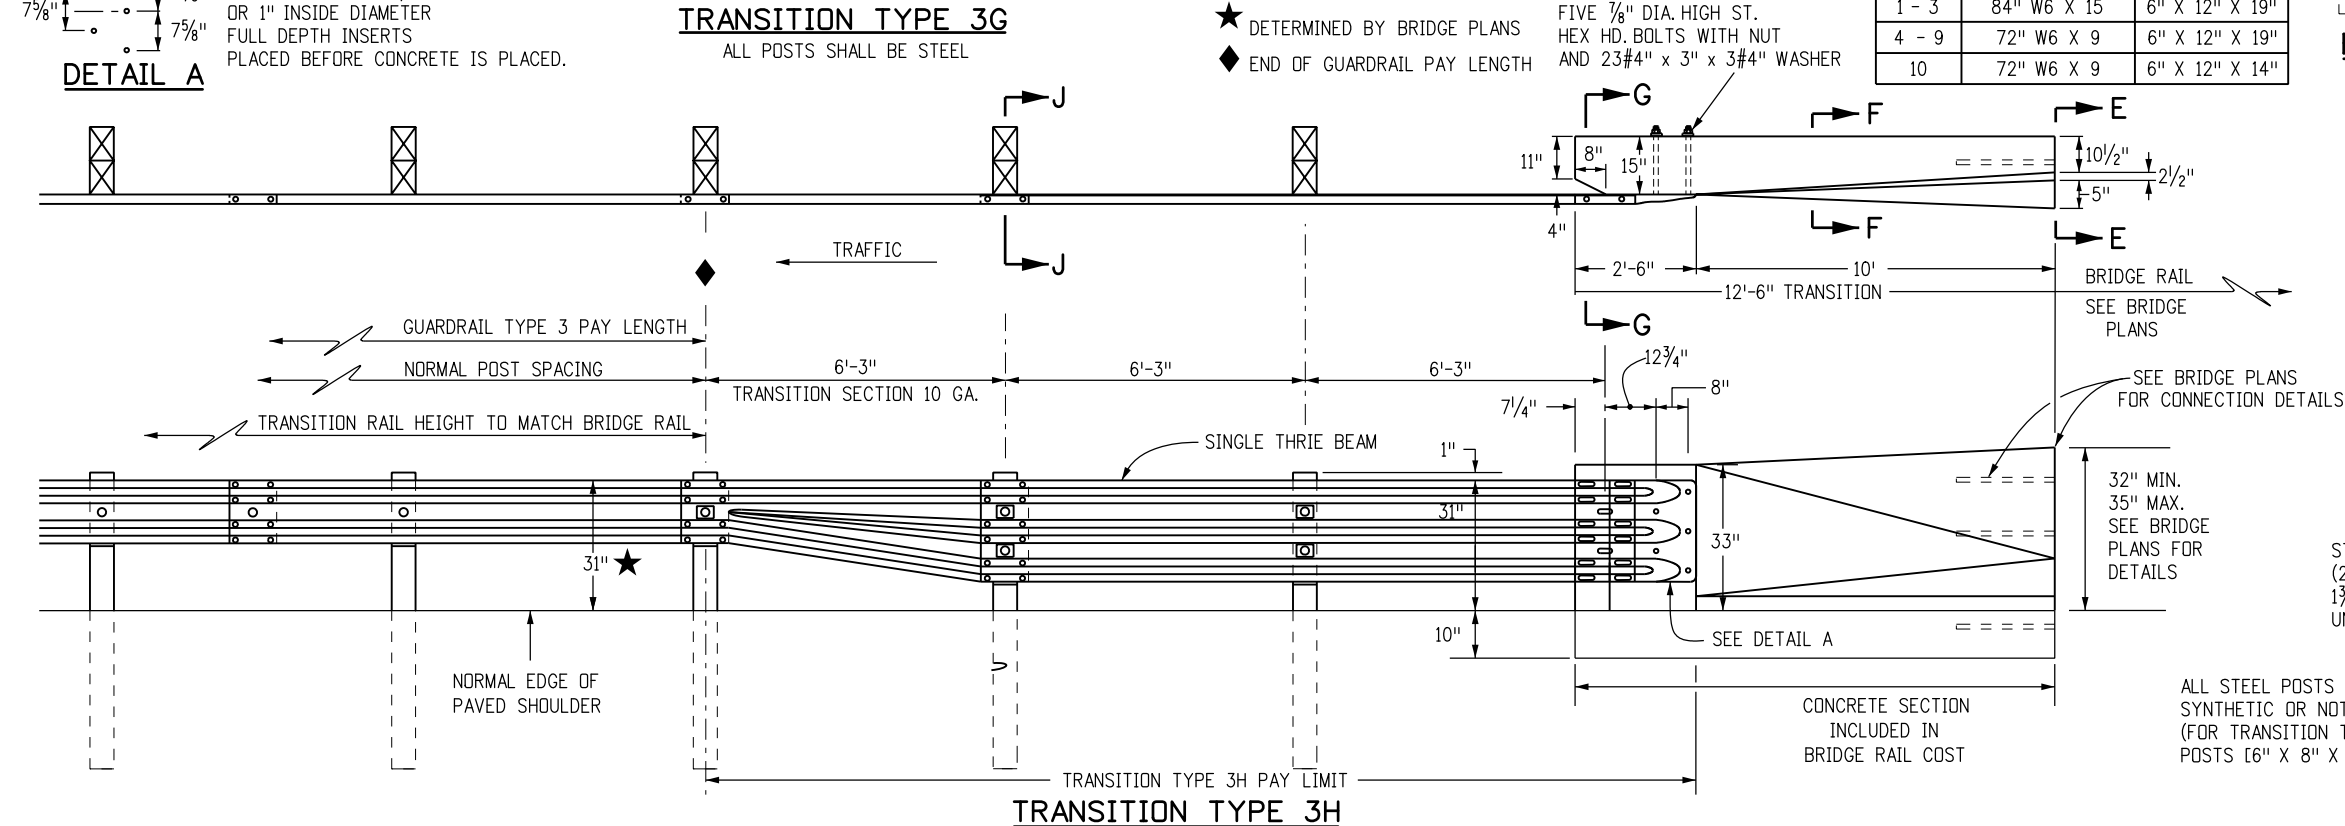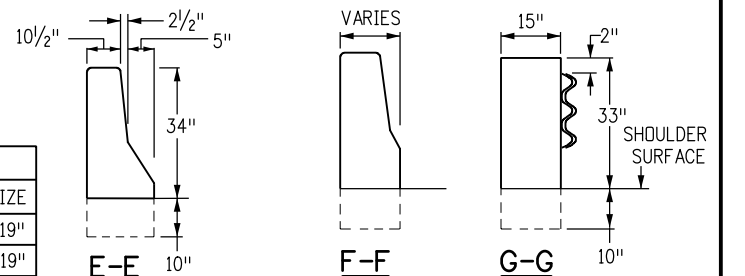



Computer File Information		Sheet Revisions		Colorado Department of Transportation	MIDWEST GUARDRAIL SYSTEM (MGS) TYPE 3 W-BEAM 31 INCHES	STANDARD PLAN NO. M-606-1 Standard Sheet No. 11 of 19
Creation Date: 07/31/19	(R-X)	Date:	Comments			
Designer Initials: JBK	(R-X)			2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868	Issued by the Project Development Branch: July 31, 2019	Project Sheet Number:
Last Modification Date: 07/31/19	(R-X)					
Detailer Initials: LTA	(R-X)					
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)			Project Development Branch	JBK	

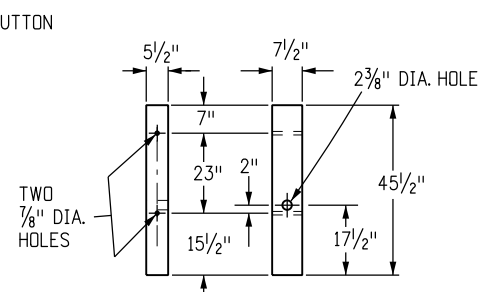


WOOD BREAKAWAY POST ②

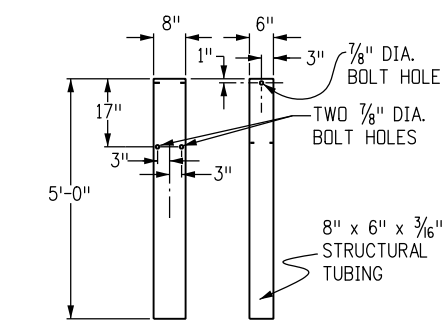


STEEL TUBE

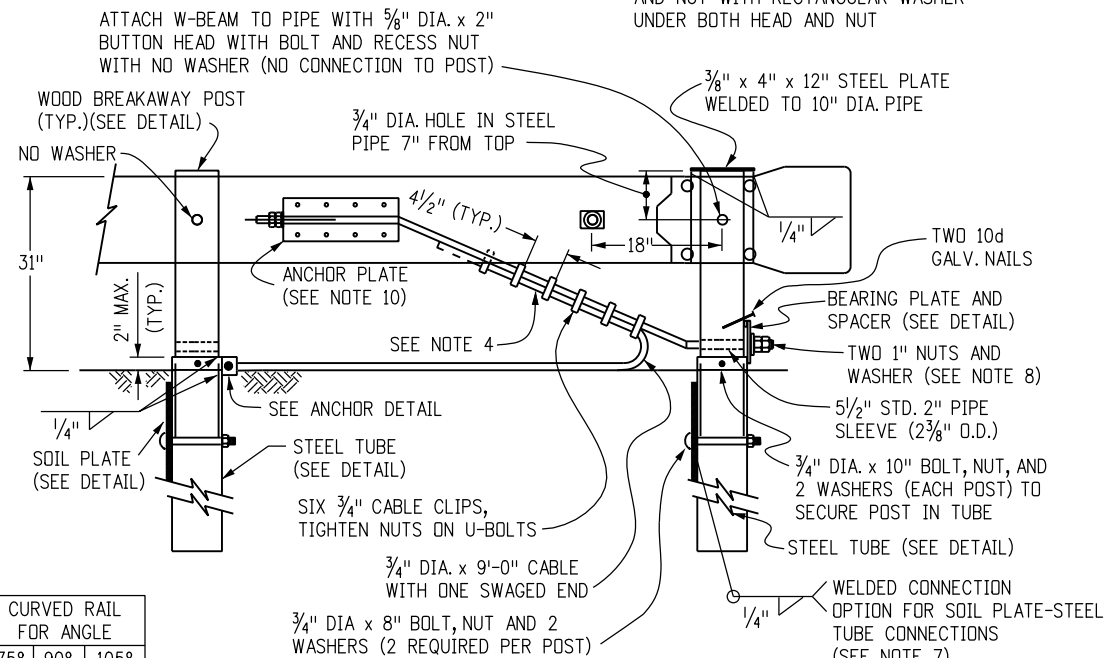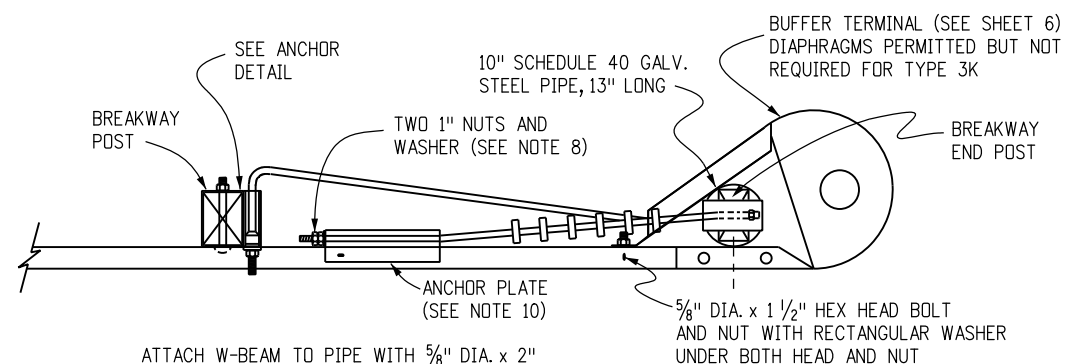


LOW SPEED END ANCHORAGE - TYPE 3K

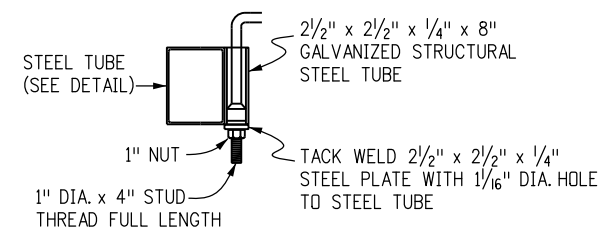

ANCHOR DETAIL

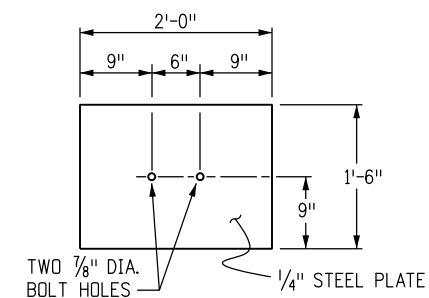

SOIL PLATE

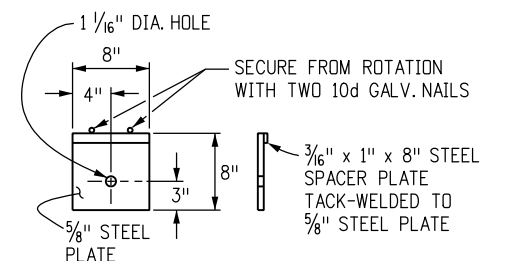


BEARING PLATE
FOR STEEL TUBE

NOTES

1. APPLICATION: THE TRANSITION TYPE 3J MAY BE USED TO SHIELD HAZARDS AT THE INTERSECTION OF TWO ROADWAYS. TYPICAL APPLICATIONS INCLUDE, BUT ARE NOT LIMITED TO, THE FOLLOWING:
 - A. CANAL SERVICE ROADS AT BRIDGE ENDS.
 - B. INTERRUPTIONS IN GUARDRAIL RUNS BY INTERSECTING ROADWAYS, ETC..


THE LOW SPEED (<45 MPH) END ANCHORAGE TYPE 3K SHALL BE USED ONLY ON DRIVEWAYS AND LOW SPEED SERVICE ROADS. WHEN AN APPROVED CRASH-TESTED END TREATMENT IS REQUIRED USE THE END ANCHORAGE (FLARED) OR (NONFLARED) WITH 37 FT.-6 IN. LENGTH.
2. GRADING AND PAVING FOR THE 3J & 3K SHALL MATCH THE GRADING AND PAVING OF THE GUARDRAIL TO WHICH THEY ARE ATTACHED, AND SHALL BE IN ACCORDANCE WITH SHEET ONE OF THIS STANDARD. MAXIMUM FILL SLOPE SHALL BE 2:1.
3. THE RAIL IS NOT BOLTED TO THE CRT POST AT THE CENTER OF THE CURVE FOR THE 8 FT.-6 IN., 17 FT., AND 25 FT.-6 IN. RADII. PLATES SHALL CONFORM TO ASTM A 36, AND THE STRUCTURAL TUBING TO ASTM A 500.
4. THE $\frac{3}{4}$ IN. GALVANIZED WIRE ROPE (CABLE) SHALL CONFORM TO AASHTO M 30 TYPE II.
5. PLATES SHALL CONFORM TO ASTM A 36, AND STRUCTURAL TUBING TO ASTM A 500. WELDING SHALL MEET ALL REQUIREMENTS OF THE AMERICAN WELDING SOCIETY.
6. ALL STRUCTURAL STEEL SHALL BE GALVANIZED IN CONFORMANCE WITH ASTM A 123. POSTS SHALL NOT BE PUNCHED, DRILLED, CUT, OR WELDED AFTER GALVANIZING.
7. WHEN THE SOIL PLATE WELDED OPTION IS SELECTED, SOIL PLATE CONNECTION BOLT HOLES ARE NOT REQUIRED.
8. OUTSIDE NUT SHALL BE TORQUED AGAINST INSIDE NUT WITH THE CABLE INSTALLED TAUT BETWEEN THE ANCHOR PLATE AND FIRST POST.
9. ALL CURVED GUARDRAIL SHALL BE SHOP BENT.
10. SEE SHEET 5 FOR ANCHOR PLATE AND OTHER DETAILS.
11. THE STEEL TUBE MAY BE DRIVEN WITH WOOD POST INSERTED IF NO DAMAGE OCCURS TO THE POST OR BOLTS.

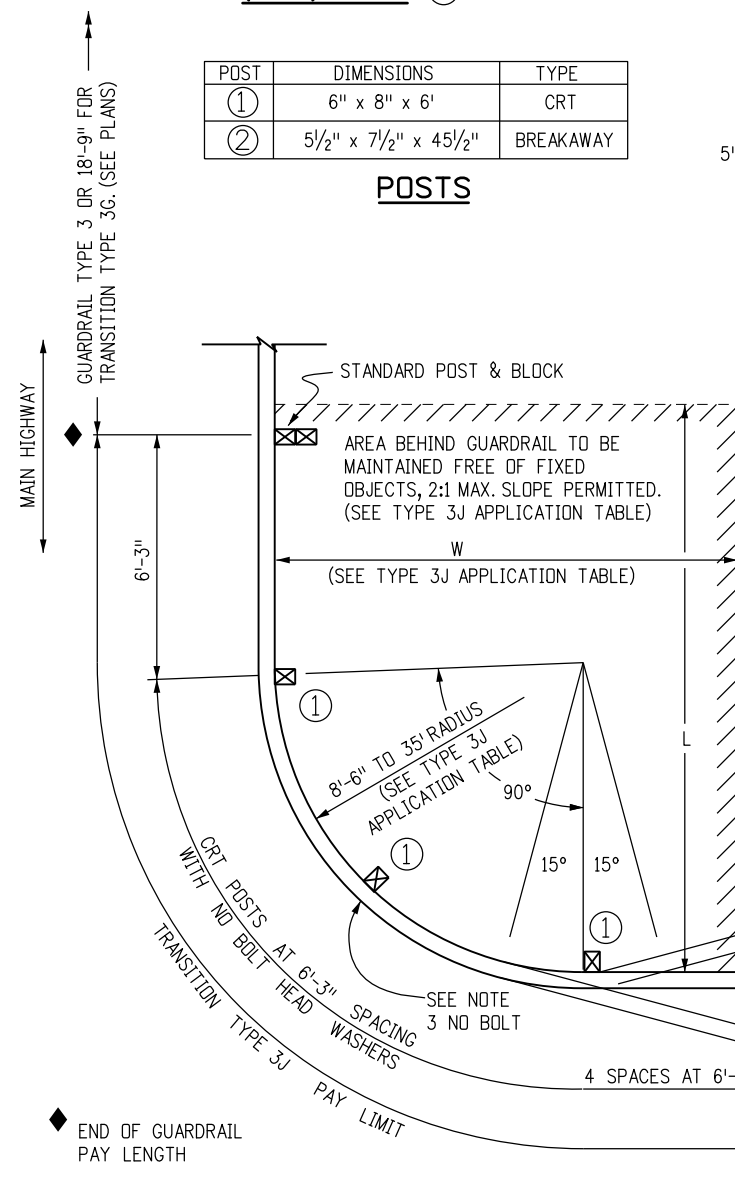





INTERSECTING ROADWAYS TRANSITION - TYPE 3J TRANSITION

RADIUS	ANGLE	NO. CRT POSTS	AREA FREE OF FIXED OBJECTS		CURVED RAIL FOR ANGLE		
			L	W	75°	90°	105°
8'-6"	75°-105°	5	25'	15'	11'	13'	15'
17'	75°-90°	6	30'	15'	22"	27'	31'
	91°-105°	7					
25'-6"	75°-85°	7	40'	20'	33'	40'	47'
	86°-95°	8					
	96°-105°	9					
35'	75°-85°	9	50'	20'	46'	55'	64'
	86°-95°	10					
	96°-105°	11					

TRANSITION TYPE 3J APPLICATION

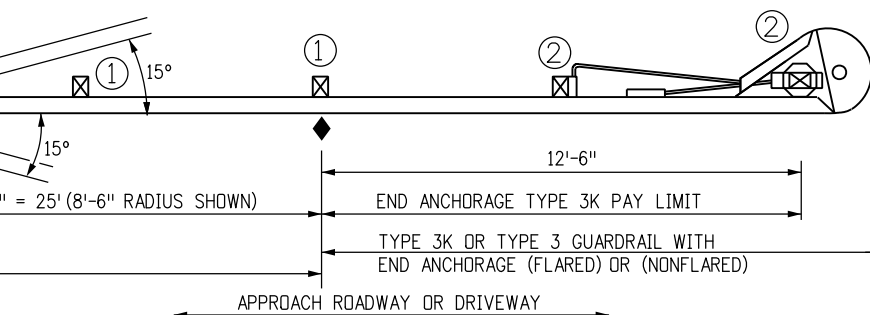


Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	MIDWEST		STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)	Date:	Comments		GUARDRAIL SYSTEM (MGS)		M-606-1	
Designer Initials: JBK					TYPE 3 W-BEAM 31 INCHES		Standard Sheet No. 12 of 19	
Last Modification Date: 07/31/19					Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:	
Detailer Initials: LTA								
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English								

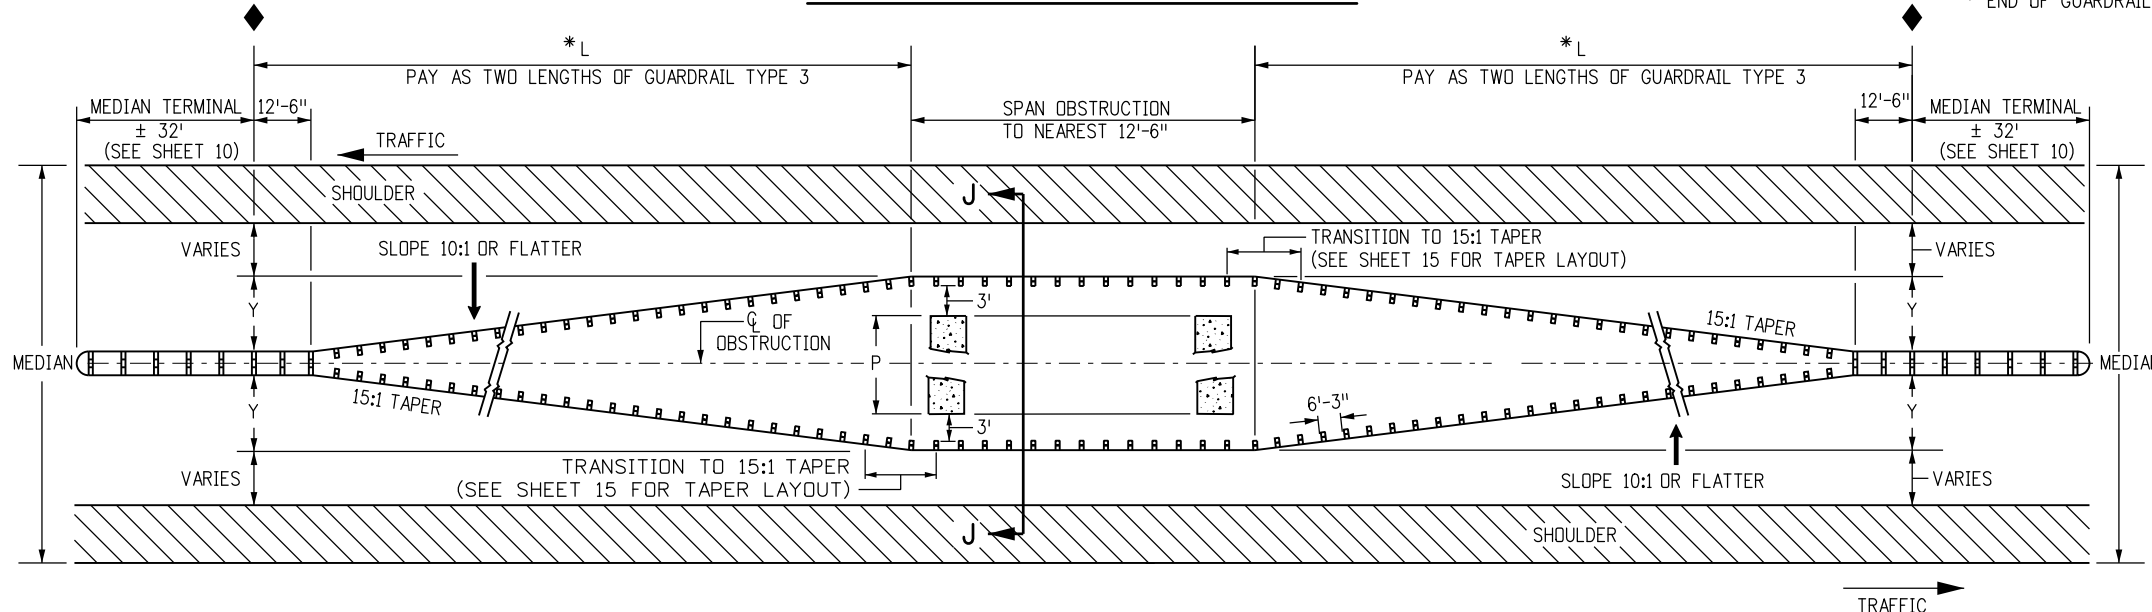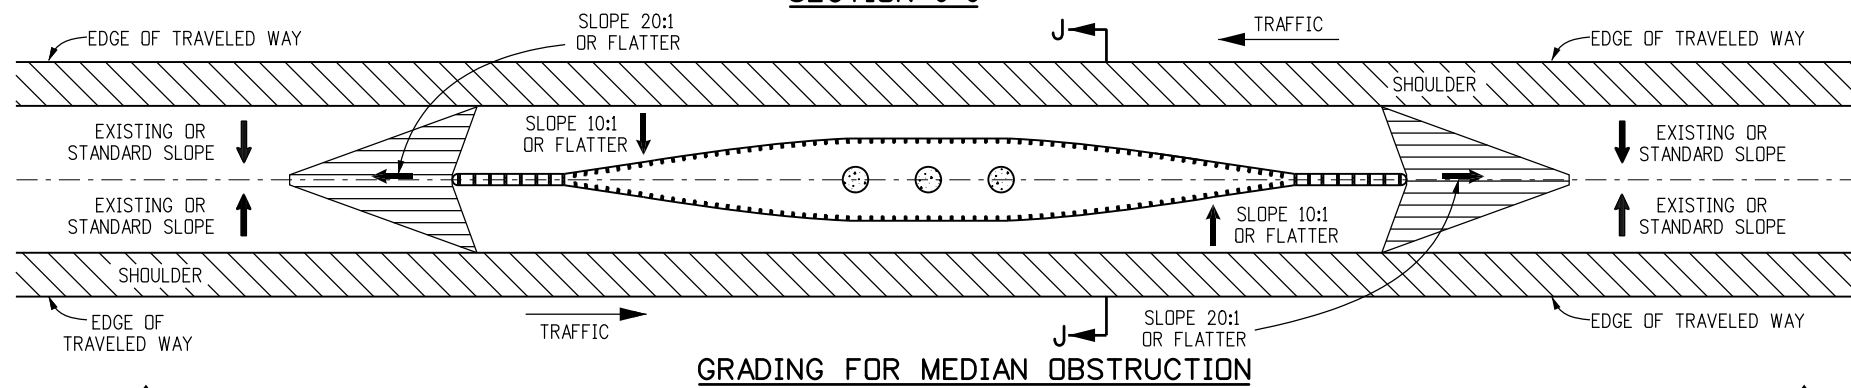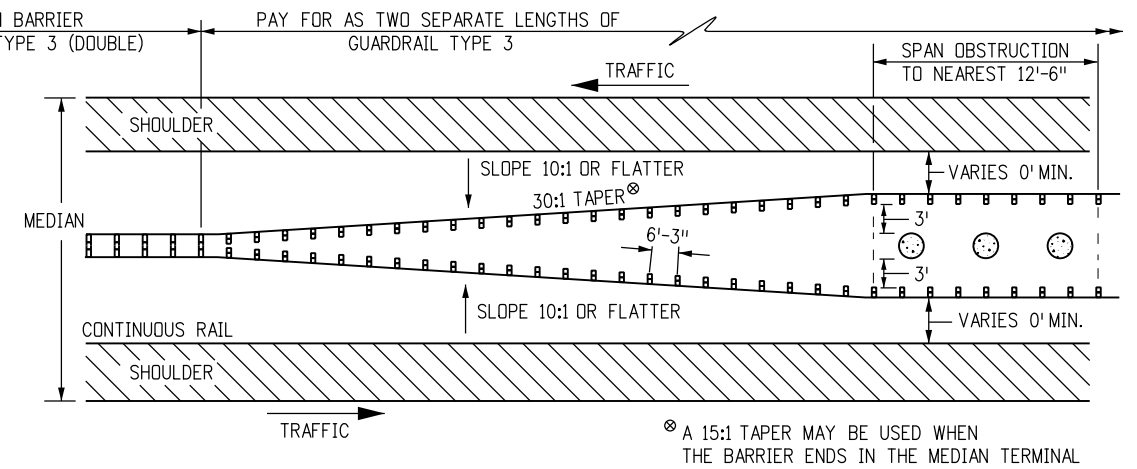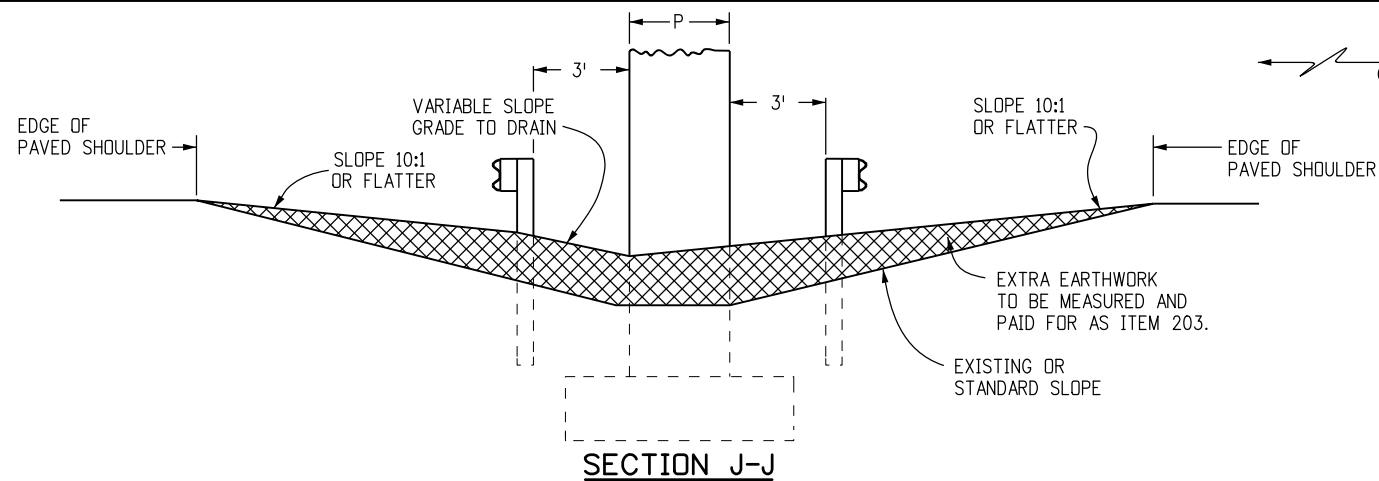

P	1'	2'	3'	4'	5'	6'	7'	8'	9'	10'	11'	12'	13'	14'	15'	16'	17'	18'	19'	20'
Y	4'-1"	4'-7"	5'-1"	5'-7"	6'-1"	6'-7"	7'-1"	7'-7"	8'-1"	8'-7"	9'-1"	9'-7"	10'-1"	10'-7"	11'-1"	11'-7"	12'-1"	12'-7"	13'-1"	13'-7"
L	75'	87'-6"	100'	112'-6"	125'	137'-6"	150'	162'-6"	175'	187'-6"	200'	212'-6"	225'							

GUARDRAIL FOR OBSTRUCTION IN MEDIANS WIDER THAN 30 FT.

NOTE: FOR OBSTRUCTIONS (P) THAT ARE WIDER THAN 20 FT. IN MEDIANS USE SHEET 16.

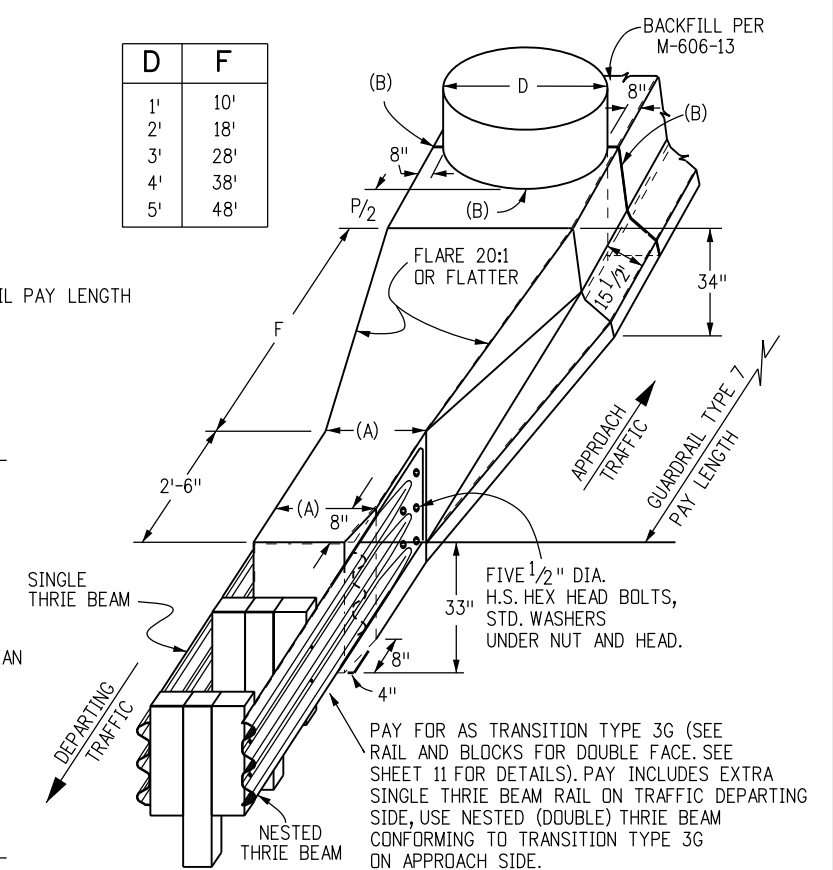


- (A). TIMBER POSTS 2 FT., STEEL POSTS 1 FT.-9 1/2 IN.
(B). 1/2 IN. PREFORMED JOINT MATERIAL

* L IS MEASURED ALONG FACE OF GUARDRAIL

OBSTRUCTIONS IN MEDIANS

Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	MIDWEST		STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)	Date:	Comments		GUARDRAIL SYSTEM (MGS)		M-606-1	
Designer Initials: JBK					TYPE 3 W-BEAM 31 INCHES		Standard Sheet No. 13 of 19	
Last Modification Date: 07/31/19					Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:	
Detailer Initials: LTA								
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English								

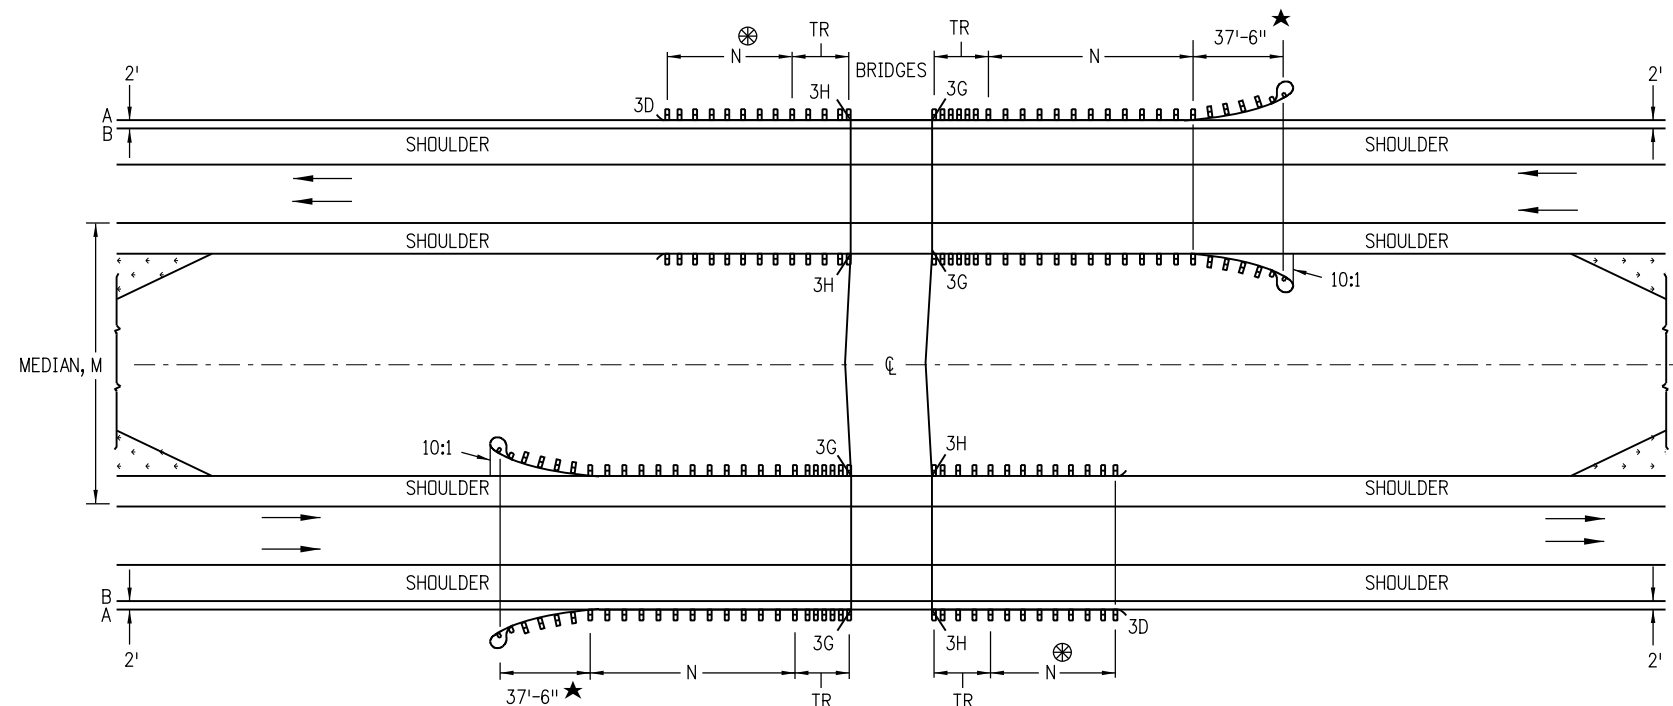


MULTILANE DIVIDED HIGHWAYS FOR STEEP EMBANKMENTS IN MEDIAN

NOTES

- 1. MEDIAN BARRIERS TANGENT TO THE ROADWAY MAY BE USED WHERE THE SHOULDER SLOPES IN THE MEDIAN ARE STEEP.
- 2. BARRIER LENGTHS SHALL BE INCREASED TO ACCOUNT FOR STEEP EMBANKMENTS OR OTHER HAZARDS WITHIN CLOSE PROXIMITY OF BRIDGES.

- ⊗ — DO NOT CONSTRUCT THE TR AND GUARDRAIL ON THE TRAILING BRIDGE ENDS IF SITE CONDITIONS DO NOT WARRANT THE USE OF GUARDRAIL.
- N — SHOWN ON PLANS. LENGTH TO SHIELD ALL HAZARDS IS BASED ON GUARDRAIL'S LENGTH OF NEED COMPUTATION. SEE AASHTO ROADWAY DESIGN GUIDE. THE MINIMUM SHALL BE 12 FT. - 6 IN., WHERE SITE CONDITIONS ALLOW. THE TOTAL LENGTH OF NEED WILL INCLUDE THE LENGTH OF TRANSITION, THE LENGTH OF RAIL (N), AND ANY REDIRECTIVE LENGTH IN THE RAIL END TREATMENT.
- TR — 25 FEET FOR TRANSITION TYPES 3G AND 3H.
- A — EDGE OF 8 FT. OR 10 FT. SHOULDER.
- B — EDGE OF 6 FT. OR LESS SHOULDER.
- ★ — END ANCHORAGE CAN BE FLARED OR NONFLARED.


Computer File Information		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	Sheet Revisions		MIDWEST GUARDRAIL SYSTEM (MGS) TYPE 3 W-BEAM 31 INCHES		STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)		Date:	Comments			M-606-1	
Designer Initials: JBK							Standard Sheet No. 14 of 19	
Last Modification Date: 07/31/19								
Detailer Initials: LTA								
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English							Issued by the Project Development Branch: July 31, 2019	
						Project Sheet Number:		

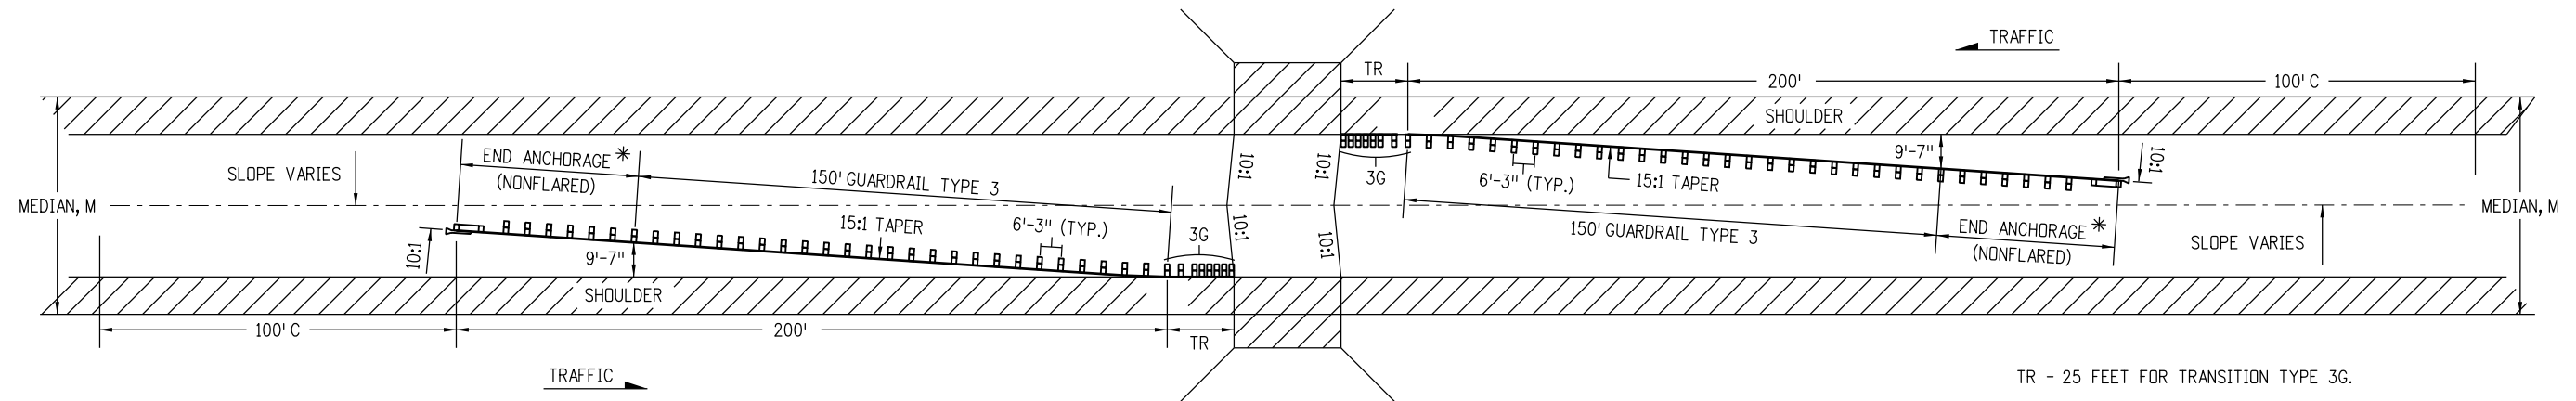


MEDIANS 60 FT. AND OVER WITH 10 FT. OR WIDER SHOULDERS.

* END ANCHORAGE LENGTH AND FLARE RATES VARY BY DEVICE.
SEE MANUFACTURER/SUPPLIER FOR INSTALLATION REQUIREMENTS.

TR - 25 FEET FOR TRANSITION TYPE 3G.
C - CHANGE: 100 FT. TRANSITION TO NORMAL SLOPE.
M - WIDTH OF MEDIAN.

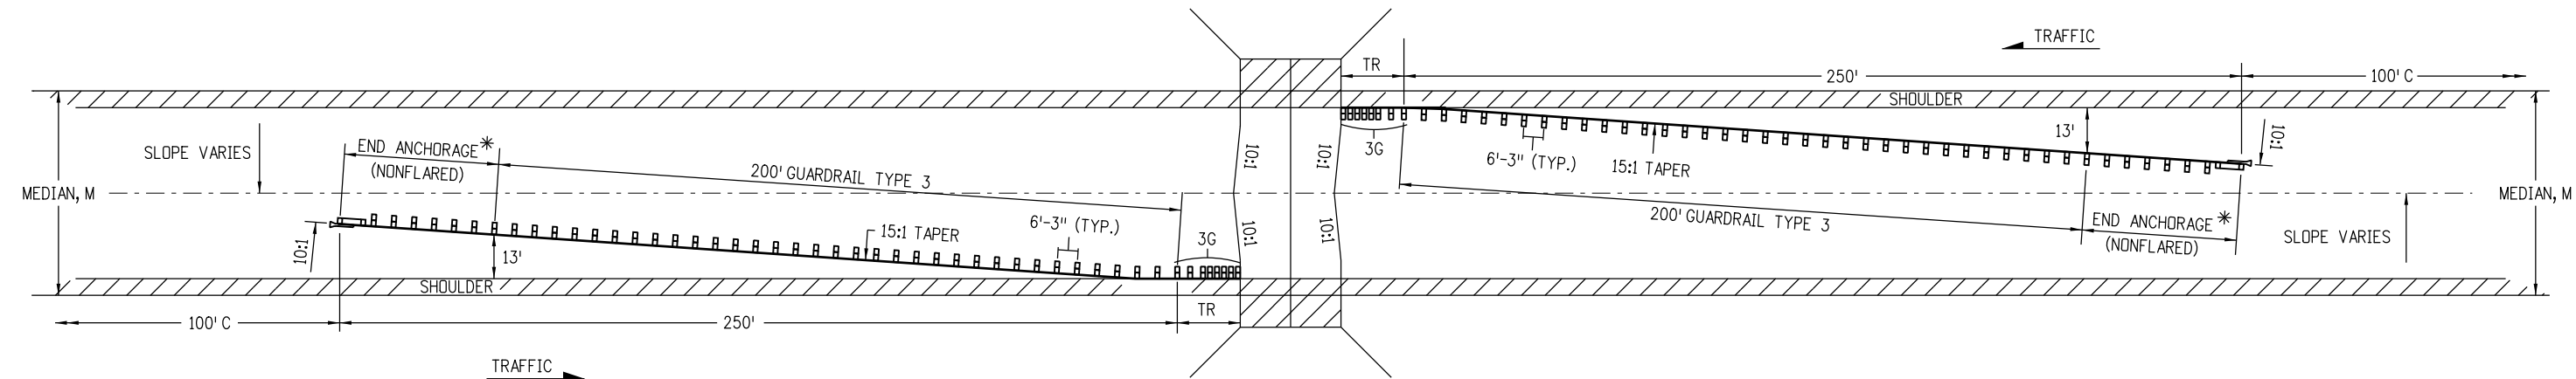

MEDIANS 60 FT. AND OVER WITH 4 to 8 FT. SHOULDERS.

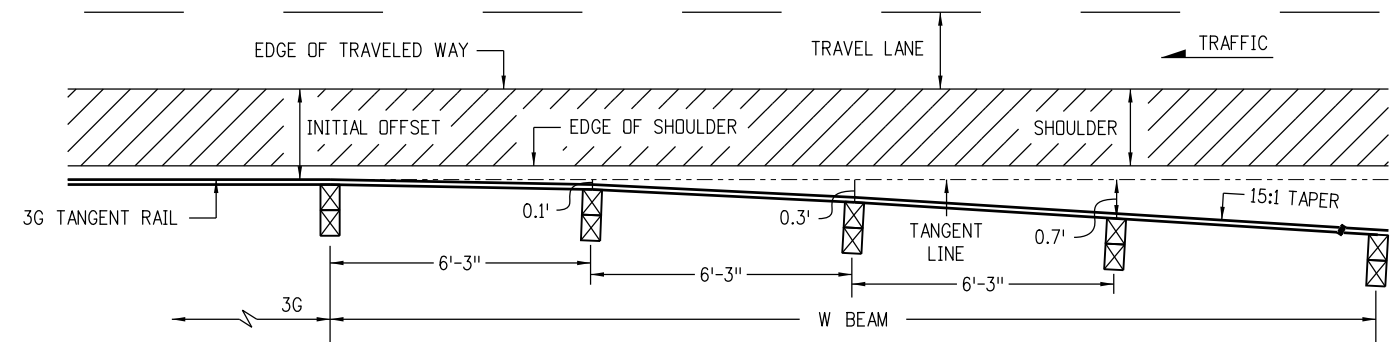

TRANSITION TO TYPICAL 15:1 TAPER

NOTES

- GUARDRAIL TRANSITIONS FROM PARALLEL TO ROADWAY SHOULDER AT 3G SEGMENT TO 15:1 TAPER WITHIN 25 FEET BASED ON POST OFFSET DIMENSIONS SHOWN.
- SEE SHEET 14 FOR THE RIGHT SHOULDER GUARDRAIL LAYOUT.

MULTILANE DIVIDED HIGHWAYS - (DEPRESSED MEDIANS, 60 FT. AND OVER WITH OPEN HAZARDS OR OBSTRUCTIONS)



Computer File Information		CDOT Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	Sheet Revisions		MIDWEST GUARDRAIL SYSTEM (MGS) TYPE 3 W-BEAM 31 INCHES		STANDARD PLAN NO.	
Creation Date: 07/31/19			Date:	Comments			M-606-1	
Designer Initials: JBK	(R-X)							
Last Modification Date: 07/31/19	(R-X)							
Detailer Initials: LTA	(R-X)							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)				Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:	

NOTES


1. GUARDRAIL TRANSITIONS FROM PARALLEL TO ROADWAY SHOULDER AT 3G SEGMENT TO 15:1 TAPER WITHIN 25 FEET BASED ON POST OFFSET DIMENSIONS SHOWN.

2. THE OPTION 1 LAYOUT SHALL BE USED WHEN "Y" EXCEEDS 16 FEET OR WHEN MEDIAN BARRIER IS CONTINUOUS.
3. THE OPTION 2 LAYOUT SHALL BE USED WHEN "Y" IS 16 FEET OR LESS.

4. SEE SHEET 14 FOR RIGHT SHOULDER GUARDRAIL LAYOUT.

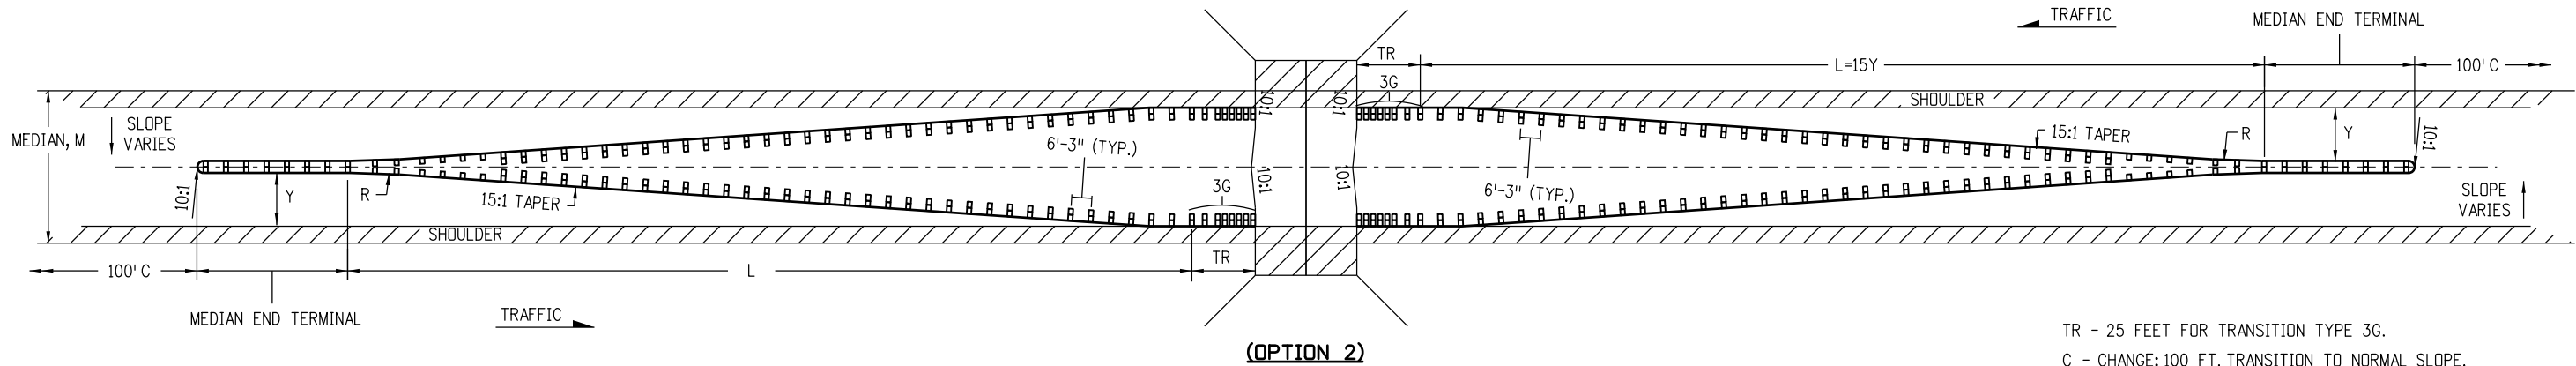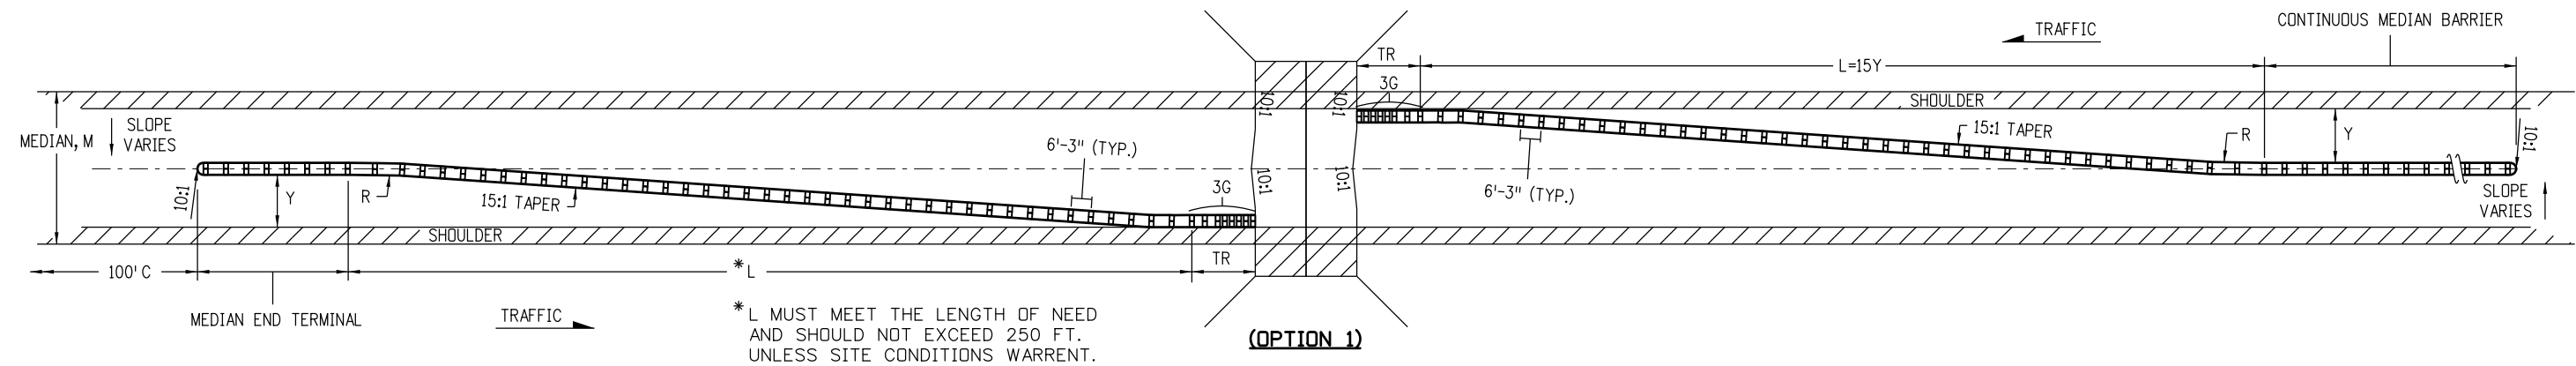


TR - 25 FEET FOR TRANSITION TYPE 3G.
C - CHANGE: 100 FT. TRANSITION TO NORMAL SLOPE.
M - WIDTH OF MEDIAN.
L - TOTAL LENGTH PAID AS GUARDRAIL TYPE 3.
Y - FINAL OFFSET AT END.

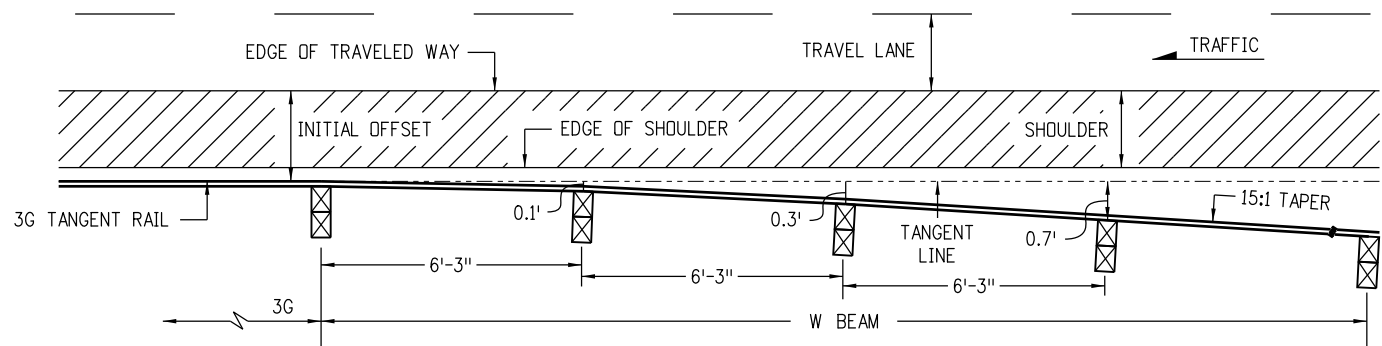


TRANSITION TO TYPICAL 15:1 TAPER

MULTILANE DIVIDED HIGHWAYS - (DEPRESSED MEDIANS, 21 - 59 FT. WITH OPEN HAZARDS OR OBSTRUCTIONS)


Computer File Information		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	Sheet Revisions		MIDWEST GUARDRAIL SYSTEM (MGS) TYPE 3 W-BEAM 31 INCHES		STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)		Date:	Comments			M-606-1	
Designer Initials: JBK							Standard Sheet No. 16 of 19	
Last Modification Date: 07/31/19							Project Sheet Number:	
Detailer Initials: LTA							Issued by the Project Development Branch: July 31, 2019	
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English								

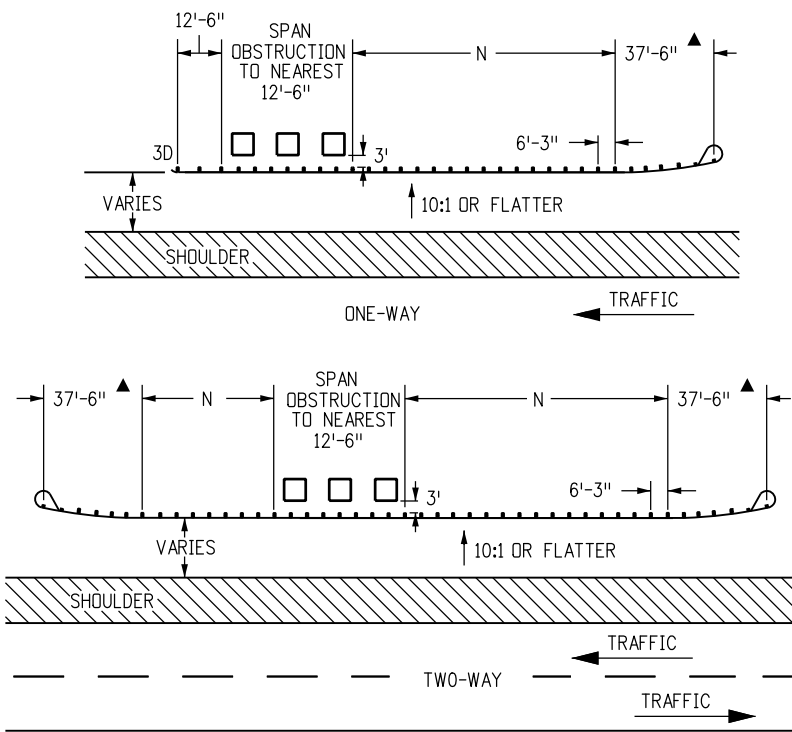

GUARDRAIL FOR ROADSIDE OBSTRUCTIONS

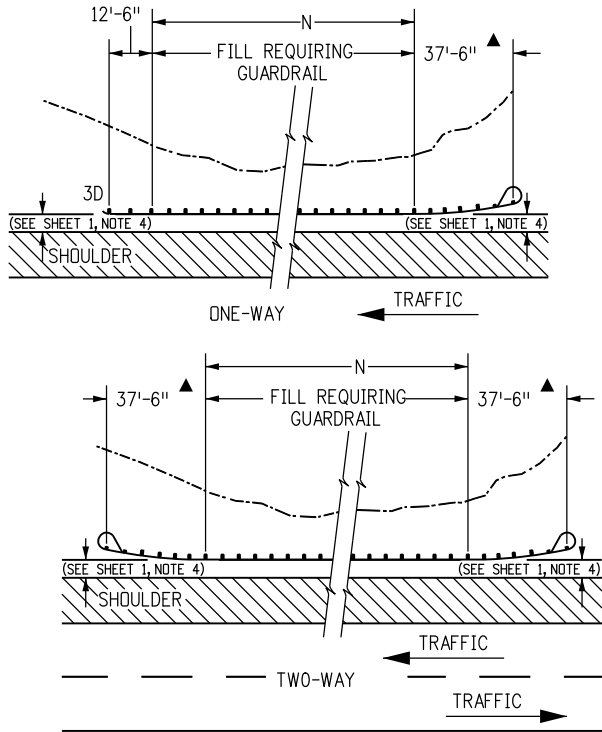


GUARDRAIL FOR ROADSIDE FILL CONSTRUCTION

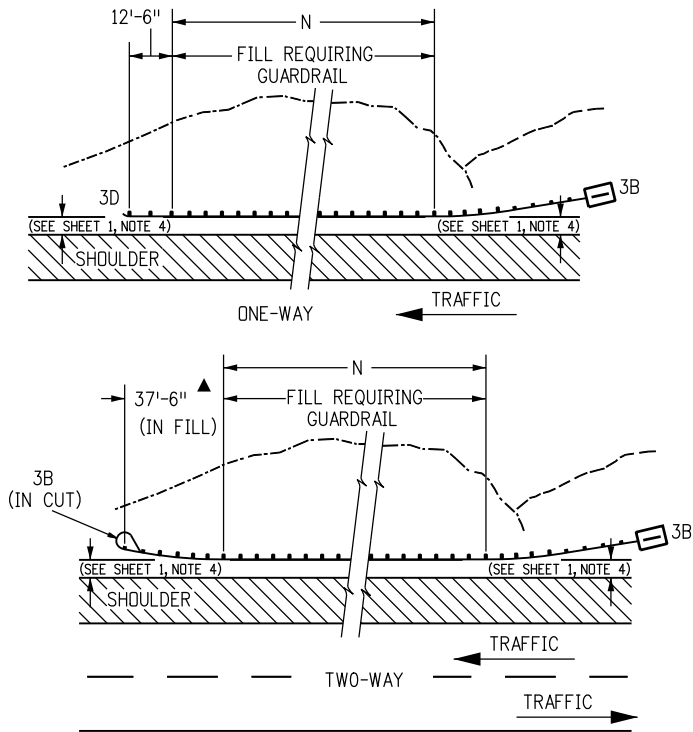


GUARDRAIL FOR ROADSIDE CUT-TO-FILL CONDITION

- NOTES**
1. A TYPE 3G OR 3H TRANSITION (SEE SHEET 11) SHALL BE USED TO CONNECT THE TYPE 3 W-BEAM TO A TYPE 9 CONCRETE BARRIER (SEE M-606-15) OR TO A TYPE 8 OR 10 BRIDGE RAIL.
 2. "TR" SHALL BE 25 FEET FOR THE TRANSITION TYPES 3G AND 3H.
 3. THE GUARDRAIL LENGTH DIMENSION "N" IS THE LENGTH AS DETERMINED BY THE LENGTH OF NEED COMPUTATION AND IS SHOWN ON THE PLANS. THE MINIMUM IS 12 FT.-6 IN. WHERE SITE CONDITIONS ALLOW. THE OVERALL REQUIRED LENGTH OF NEED CAN INCLUDE THE LENGTH OF TRANSITION, THE LENGTH OF RAIL (N), AND ANY REDIRECTIVE LENGTH IN THE RAIL END TREATMENT. A TRAVERSABLE SLOPE SHALL BE PROVIDED BEHIND THE TERMINAL TO DIMENSION "N" PRIOR TO THE OBSTRUCTION UNLESS OTHERWISE APPROVED BY THE ENGINEER.

▲ END ANCHORAGE CAN BE FLARED OR NONFLARED

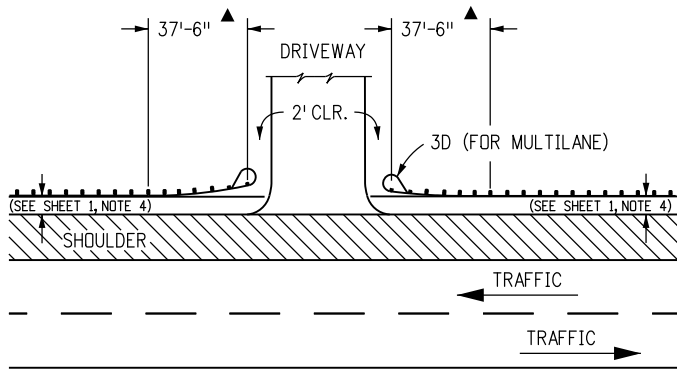


LAYOUT FOR DRIVEWAY APPROACH

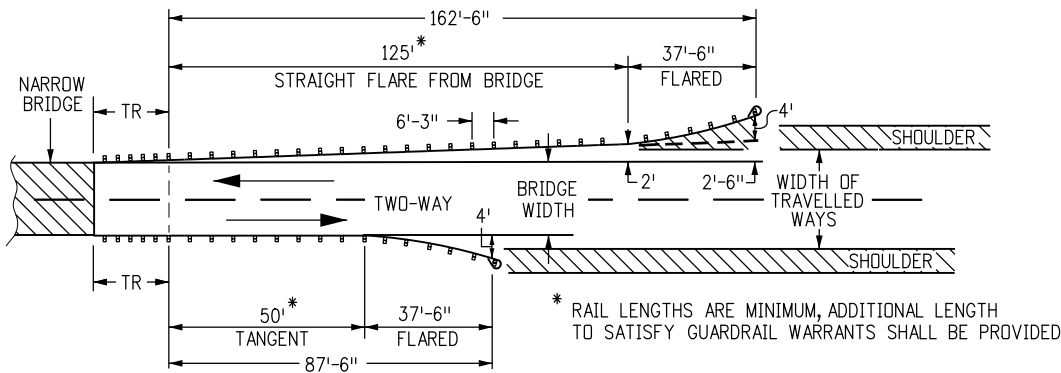


2-WAY NARROW APPLICATION

* RAIL LENGTHS ARE MINIMUM, ADDITIONAL LENGTH TO SATISFY GUARDRAIL WARRANTS SHALL BE PROVIDED

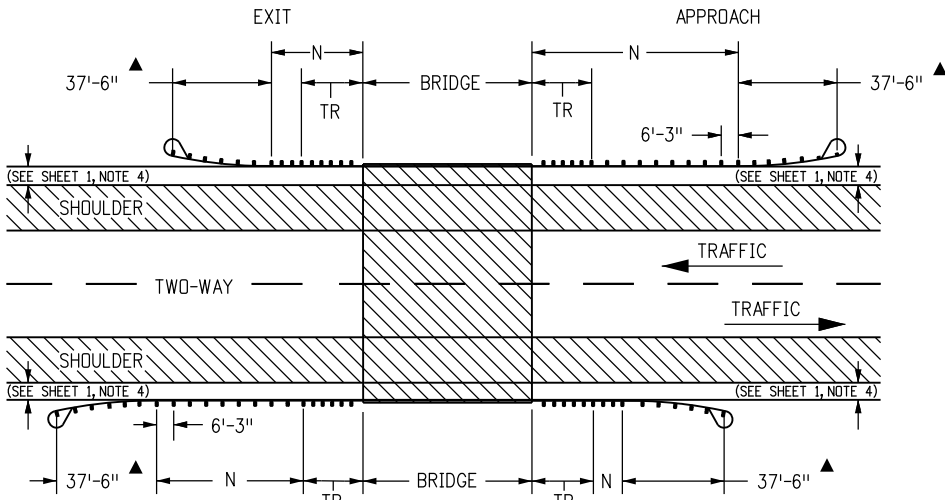

2-WAY NORMAL BRIDGE APPLICATION


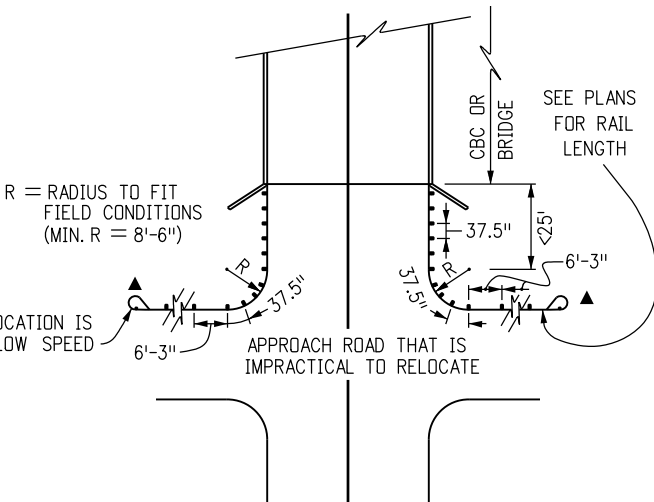


GUARDRAIL TYPE 3 WITH BLOCKED OUT POSTS SPACED AT 3'-1½" FROM STRUCTURE AROUND CURVE.


INTERRUPTED STRUCTURE APPROACH

(USE TYPE 3J ON SHEET 12 WHEN PRACTICAL)


Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	MIDWEST GUARDRAIL SYSTEM (MGS) TYPE 3 W-BEAM 31 INCHES		STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments		GUARDRAIL SYSTEM (MGS) TYPE 3 W-BEAM 31 INCHES		M-606-1
Designer Initials: JBK	(R-X)				Issued by the Project Development Branch: July 31, 2019		Standard Sheet No. 17 of 19
Last Modification Date: 07/31/19	(R-X)						Project Sheet Number:
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						

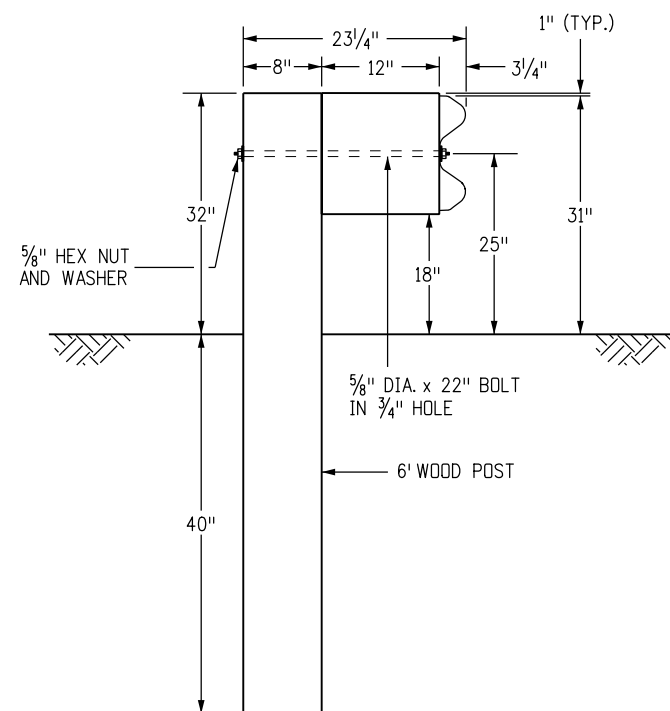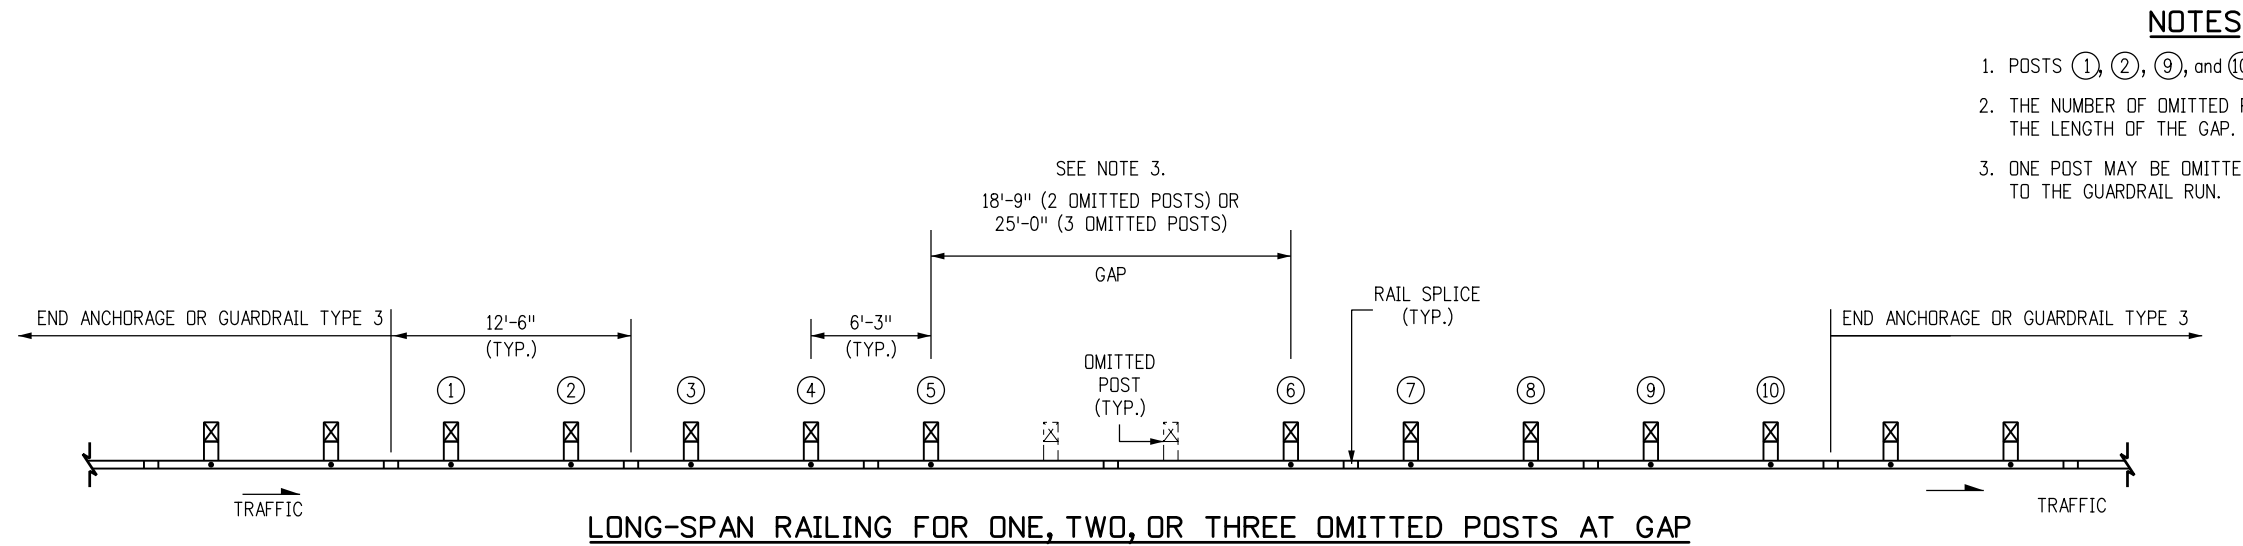

TIMBER POST
POSTS ①-② AND ⑨-⑩
(SEE NOTE 1)

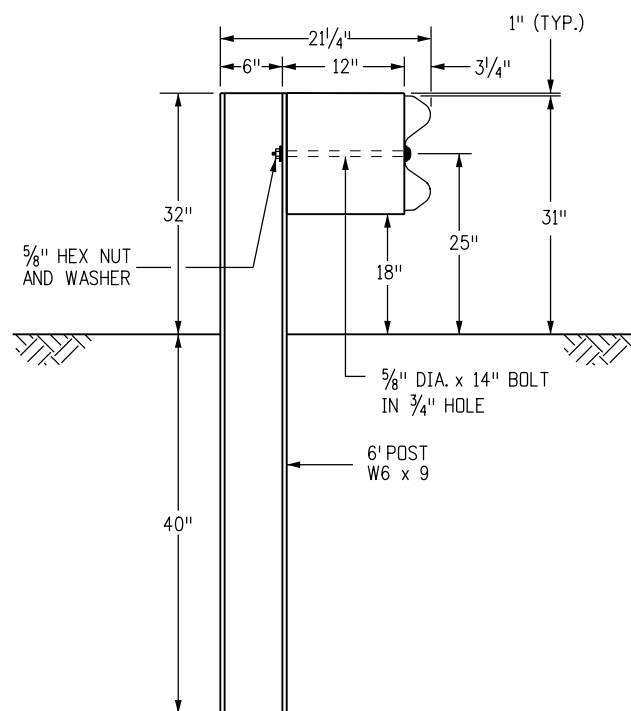

STEEL POST
POSTS ①-② AND ⑨-⑩
(SEE NOTE 1)

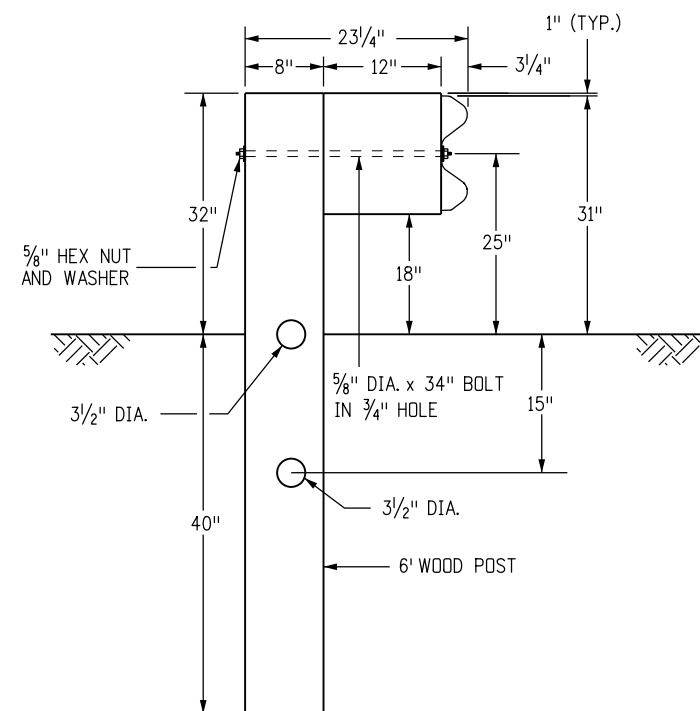


BREAKWAY TIMBER POST
POSTS ③ - ⑧


Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	MIDWEST		STANDARD PLAN NO.	
Creation Date: 07/31/19			Date:	Comments		GUARDRAIL SYSTEM (MGS)		M-606-1	
Designer Initials: JBK						TYPE 3 W-BEAM 31 INCHES		Standard Sheet No. 18 of 19	
Last Modification Date: 07/31/19						Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:	
Detailer Initials: LTA									
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English									

NOTES


1. LOCATION AND LENGTH OF MEDIAN GUARDRAIL APPROACHES TO CULVERTS WITH FULL HEADWALL AND WINGWALLS SHALL BE AS SHOWN FOR BRIDGES ON SHEET 15. THE GUARDRAIL TYPE 3 SHALL CONTINUE ACROSS THE CULVERT AS SHOWN ON THIS SHEET.
2. RIGHT SHOULDER BOX CULVERT TREATMENT IS SHOWN ON THIS SHEET FOR CULVERTS 20 FT. OR LESS IN LENGTH.
3. CONSTRUCTION AND PAYMENT FOR FILL HEIGHTS SHALL BE INCLUDED IN THE COST OF THE GUARDRAIL TYPE 3.
4. ANCHORAGE D: SIX BOLTS FOR BASE PLATE "B" WITH INSIDE MOUNT. THE BOLTS SHALL BE 7/8 IN. DIA X 10 IN. HIGH STRENGTH RODS THREADED FULL LENGTH AND ALL GALVANIZED. RODS SHALL BE CAST-IN-PLACE FOR NEW STRUCTURES. FOR EXISTING STRUCTURES, THE RODS SHALL BE INSTALLED IN 1-1/4 IN. DIA HOLES WITH NON-SHRINK GROUT OR EPOXY CONFORMING TO ASTM C 881. IF THE THICKNESS OF A CULVERT'S TOP PANEL REQUIRES BOLTS TO BE LESS THAN 10 IN. HIGH, THE BOLTS SHALL BE APPROVED BY THE ENGINEER.
5. THE GUARDRAIL LENGTH DIMENSION "N" IS THE LENGTH AS DETERMINED BY THE LENGTH OF NEED COMPUTATION AND IS SHOWN ON THE PLANS. THE MINIMUM IS 12 FT.-6 IN. WHERE SITE CONDITIONS ALLOW. THE OVERALL REQUIRED LENGTH OF NEED CAN INCLUDE THE LENGTH OF TRANSITION, THE LENGTH OF RAIL (N), AND ANY REDIRECTIVE LENGTH IN THE RAIL END TREATMENT.
6. ALL POSTS, BASE PLATES, AND ANCHOR BOLTS SHALL BE FABRICATED FROM ASTM A 36 STEEL. THE ABOVE MATERIAL, W-BEAM, AND ALL ANCHOR BOLTS AND MISCELLANEOUS BOLTS, NUTS, AND WASHERS SHALL BE GALVANIZED AFTER FABRICATION IN ACCORDANCE WITH SECTION 509. CONCRETE, REINFORCING STEEL, AND STRUCTURAL STEEL ELEMENTS SHALL BE IN ACCORDANCE WITH SECTIONS 601, 602, AND 509, RESPECTIVELY.
7. POST ANCHORS, ENCASED IN CONCRETE, SHALL BE ASTM A 36 STEEL, AND NEED NOT BE GALVANIZED.
8. PRIOR TO INSTALLATION OF GUARDRAIL ON CULVERTS, THREE SETS OF WORKING DRAWINGS WHICH COMPLY WITH THE REQUIREMENTS OF SECTION 105 SHALL BE SUBMITTED TO THE ENGINEER FOR INFORMATION ONLY.

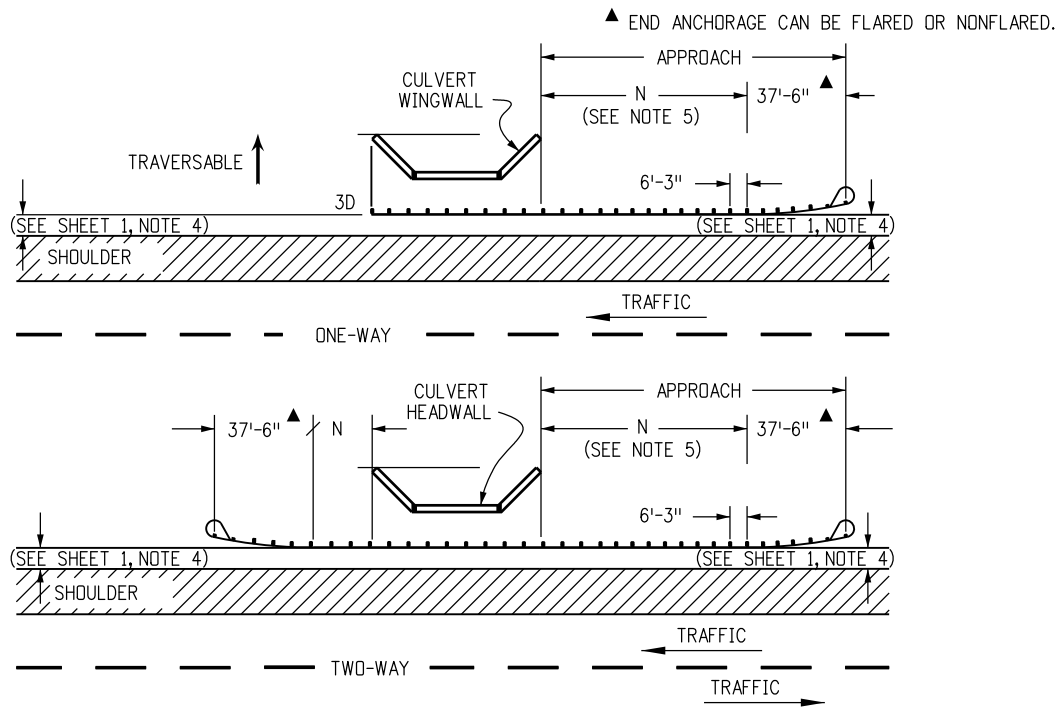


GUARDRAIL FOR CULVERTS

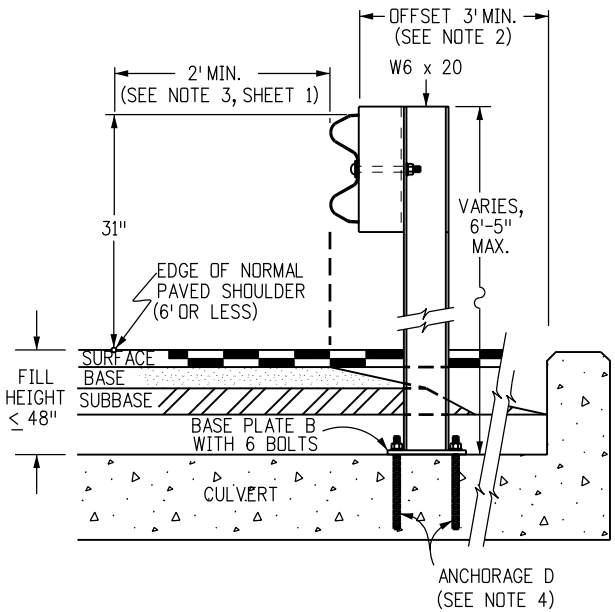


INSIDE MOUNT ON CBC

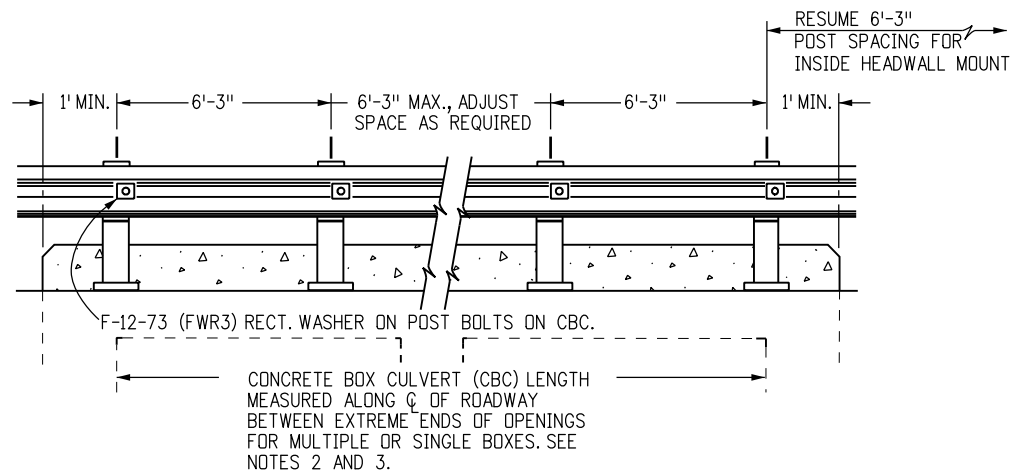

RAIL PLACEMENT FOR INSIDE MOUNT

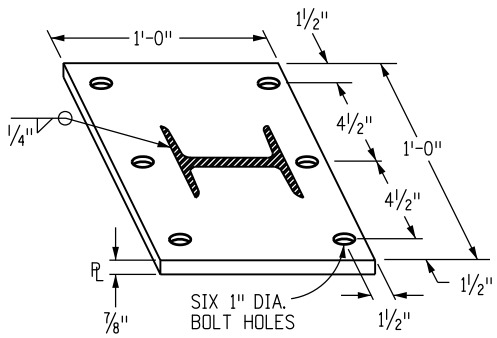


BASE PLATE B
(FOR INSIDE MOUNT)

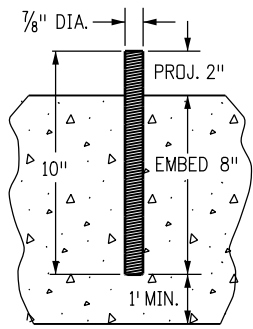


ANCHORAGE D
(FOR INSIDE MOUNT)

Computer File Information			Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development BranchJBK	MIDWEST GUARDRAIL SYSTEM (MGS) TYPE 3 W-BEAM 31 INCHES		STANDARD PLAN NO.
Creation Date: 07/31/19			Date:	Comments			M-606-1	
Designer Initials: JBK	(R-X)							
Last Modification Date: 07/31/19	(R-X)							
Detailer Initials: LTA	(R-X)							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						Issued by the Project Development Branch: July 31, 2019	Project Sheet Number:

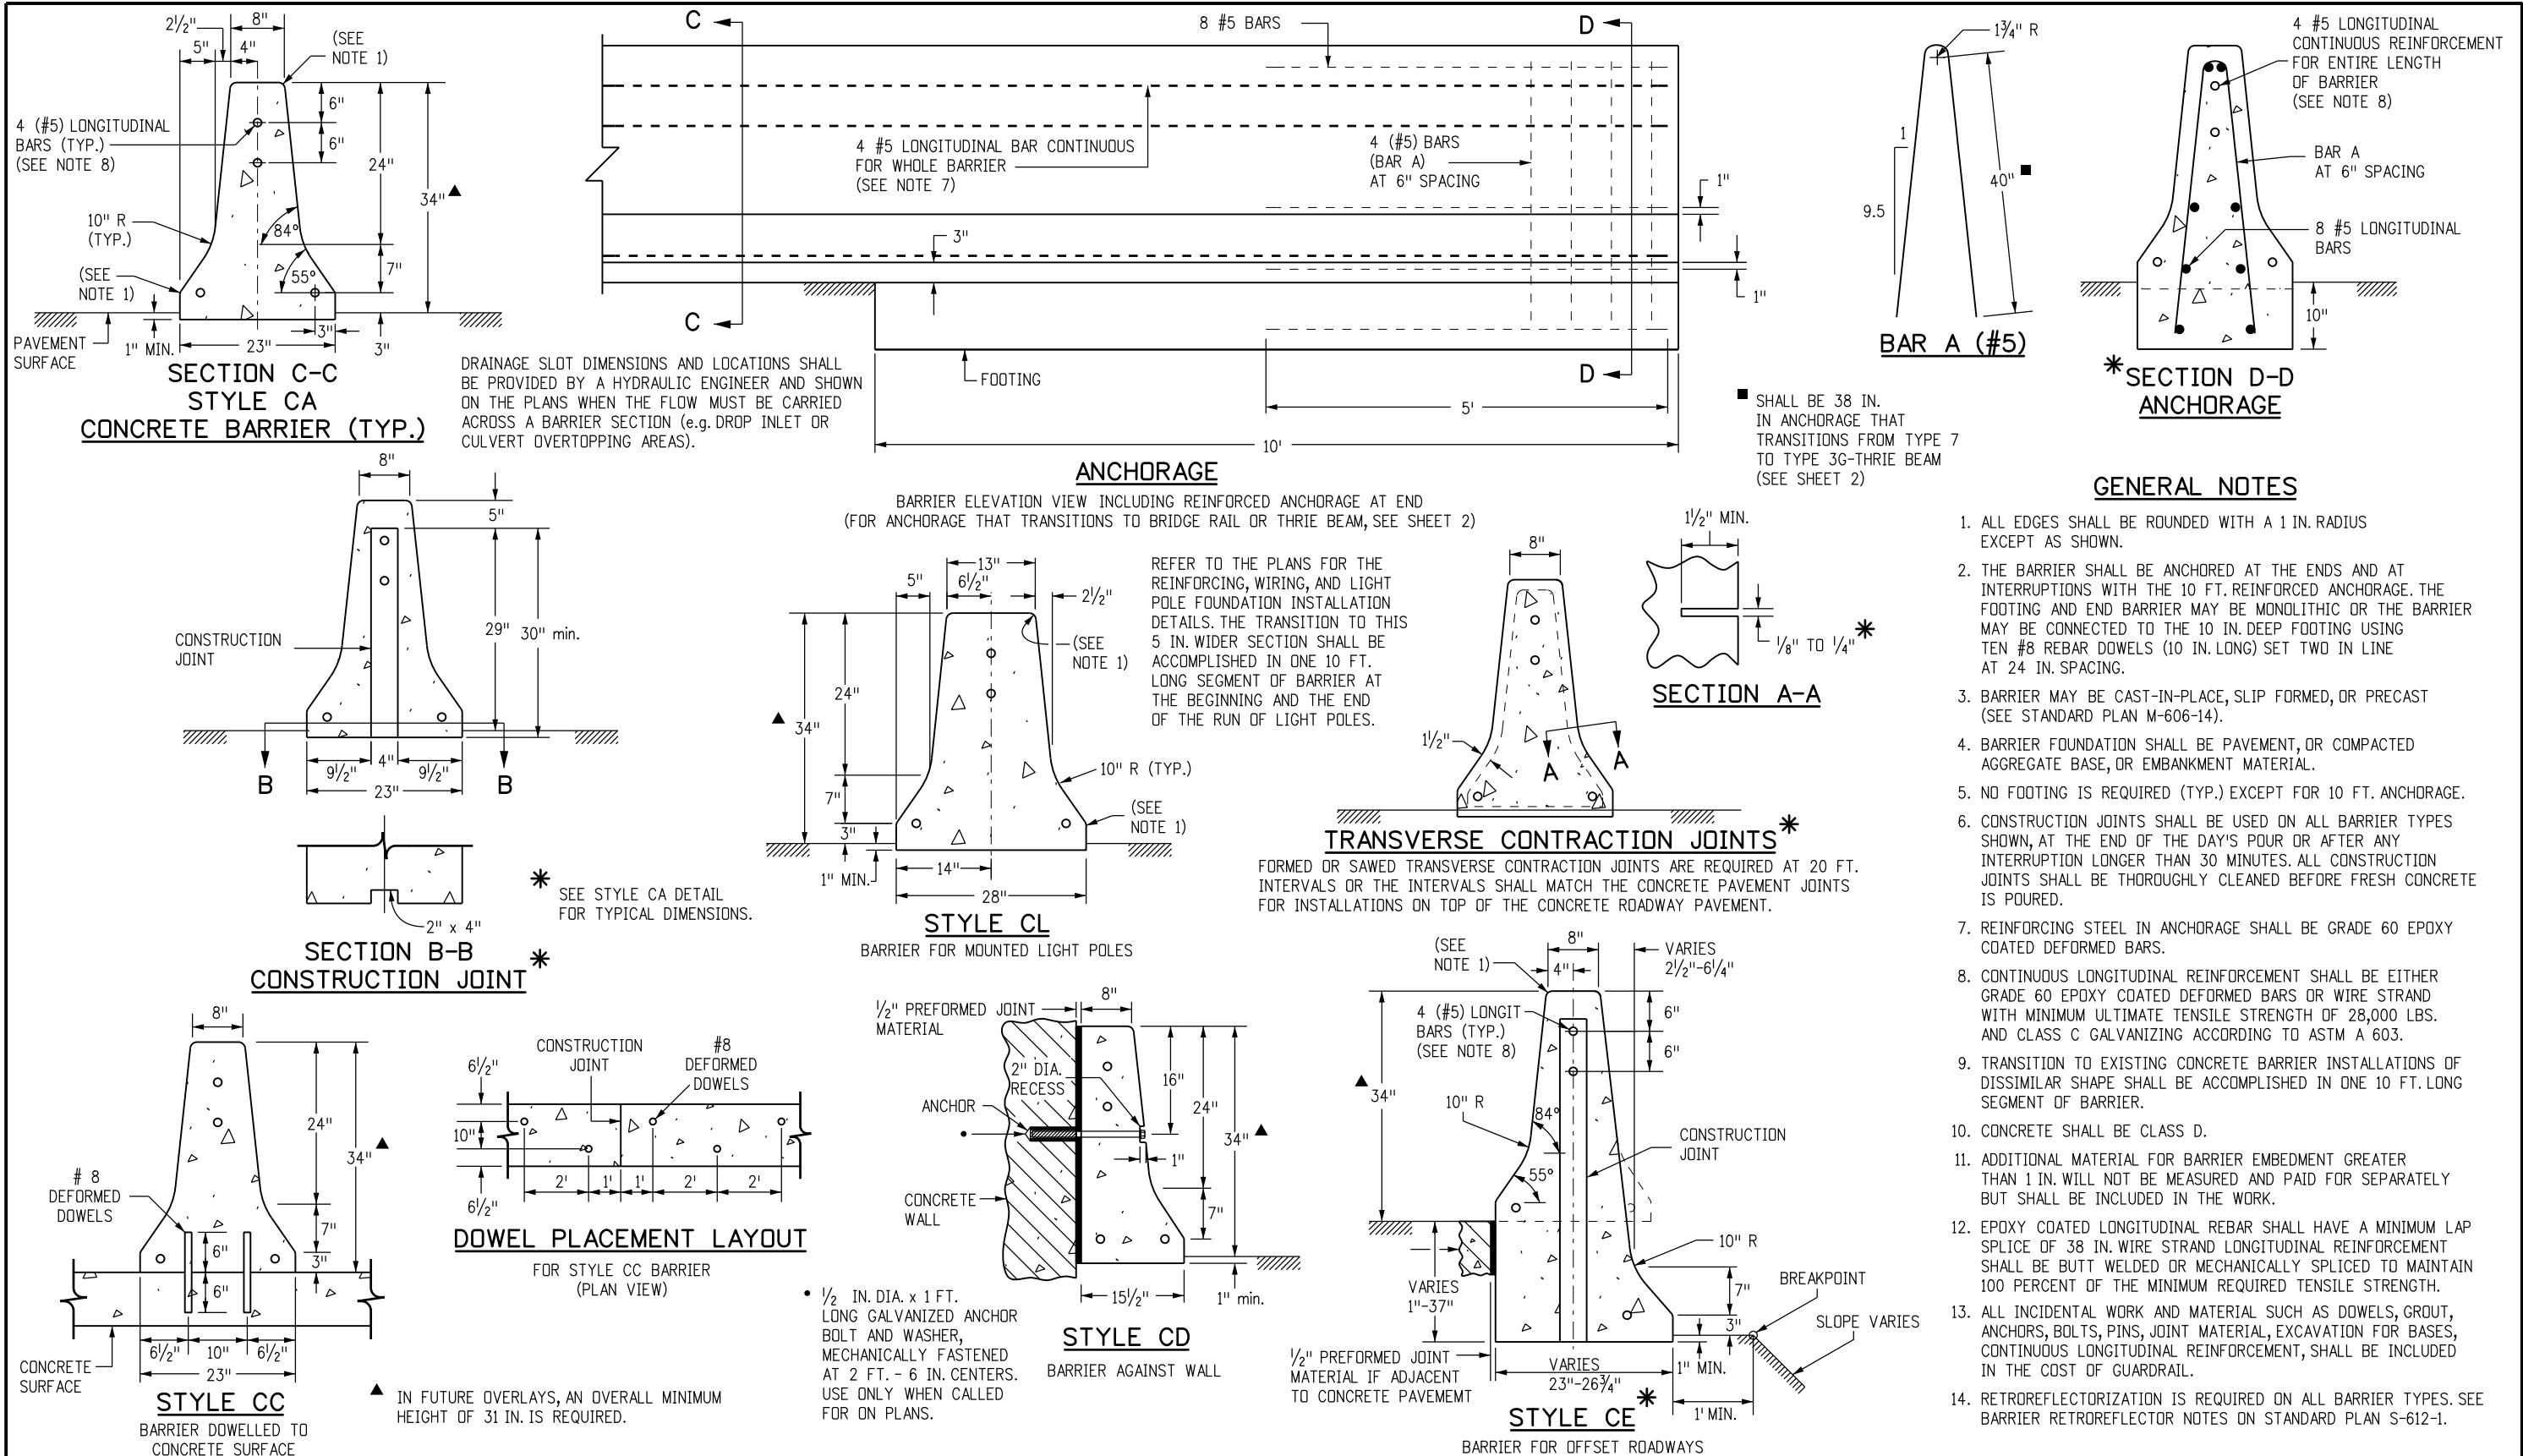


Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	GUARDRAIL TYPE 7 F-SHAPE BARRIER Issued by the Project Development Branch: July 31, 2019	STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)	Date:	Comments			M-606-13
Designer Initials: JBK						Standard Sheet No. 1 of 4
Last Modification Date: 07/31/19						
Detailer Initials: LTA						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English						Project Sheet Number:

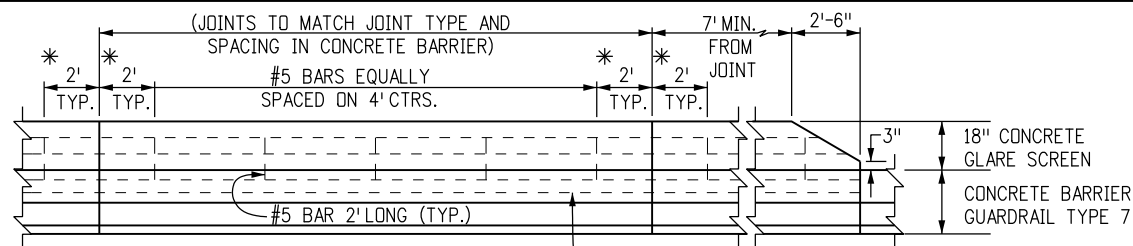


ELEVATION

#5 REINFORCEMENT CONTINUOUS BARS


* 2 FT. IS TYPICAL FOR CAST-IN-PLACE BARRIERS.
1 FT. IS TYPICAL FOR PRECAST BARRIERS.
THE MINIMUM ACCEPTABLE DIMENSION IS 6 IN.

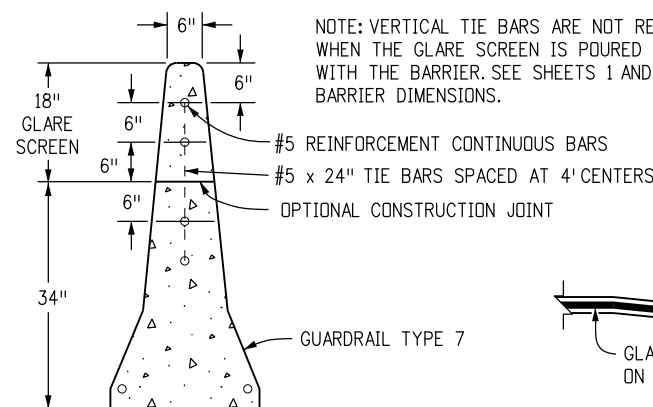


CONCRETE GLARE SCREEN

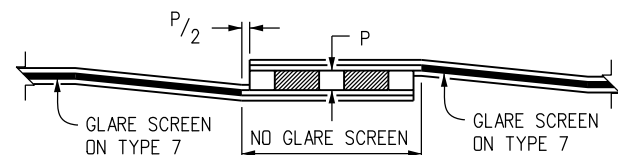


**GLARE SCREEN
AT MEDIAN OBSTRUCTIONS**

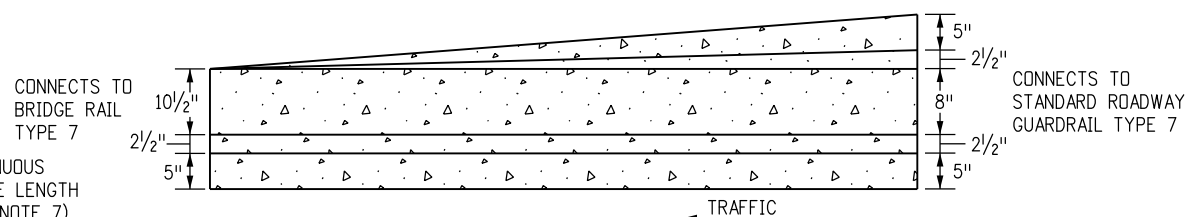


PLAN

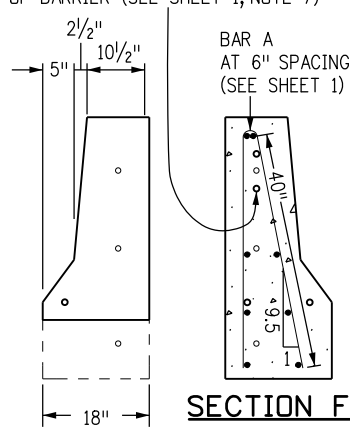

SECTION E-E

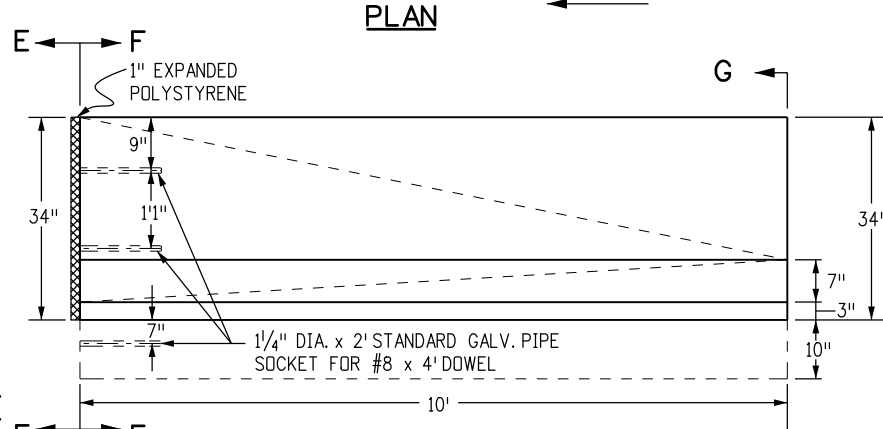


ELEVATION

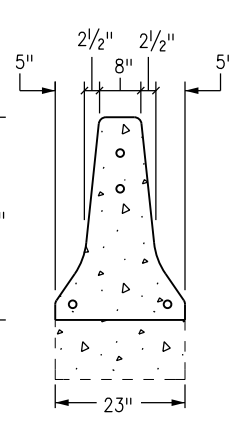

SECTION G-G

THIS SECTION PROVIDES A TRANSITION FOR THE SHAPE OF THE BRIDGE RAIL TYPE 7 TO THE ROADWAY GUARDRAIL TYPE 7. MEASURED AND PAID FOR AS GUARDRAIL TYPE 7.
(SEE ANCHORAGE DETAIL ON SHEET 1 FOR REINFORCEMENT INFORMATION)


BRIDGE RAIL TYPE 7 TO ROADWAY SHOULDER TYPE 7 TRANSITION AND ANCHORAGE

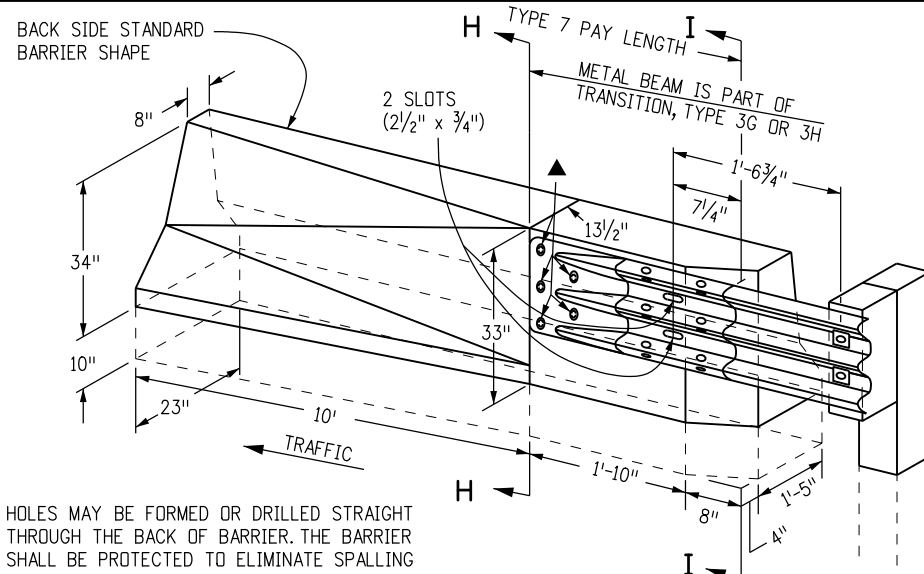

▲ HOLES MAY BE FORMED OR DRILLED STRAIGHT THROUGH THE BACK OF BARRIER. THE BARRIER SHALL BE PROTECTED TO ELIMINATE SPALLING WHEN DRILLED.



TYPE 7 TO SINGLE TYPE 3G TRANSITION AND ANCHORAGE

(SEE ANCHORAGE DETAIL ON SHEET 1 FOR REINFORCEMENT INFORMATION)


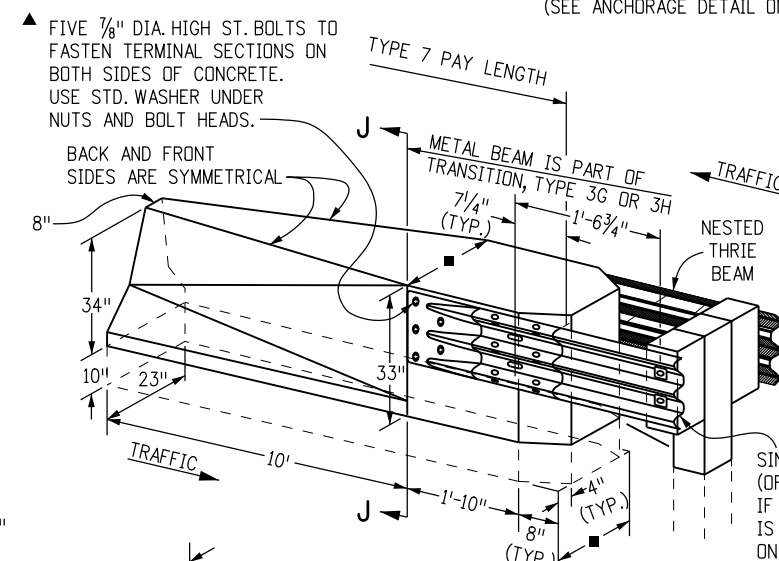


TYPE 7 TO DOUBLE TYPE 3G TRANSITION AND ANCHORAGE


(SEE ANCHORAGE DETAIL ON SHEET 1 FOR REINFORCEMENT INFORMATION)

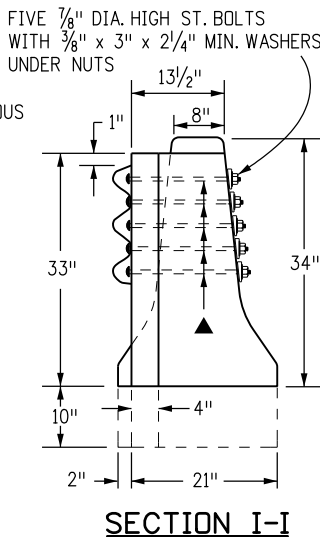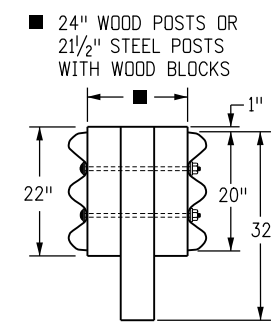


SECTION I-I

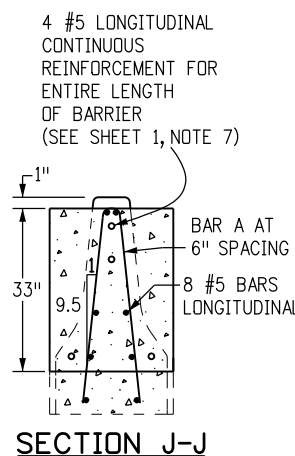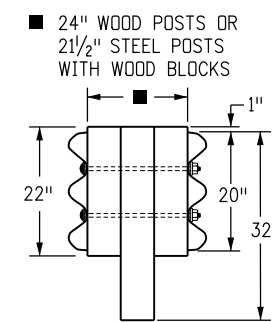


SECTION J-J

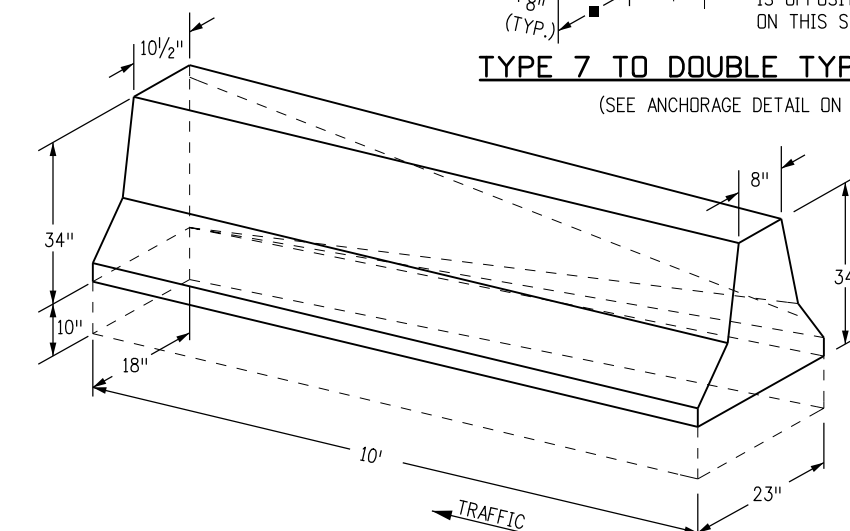

Computer File Information		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	GUARDRAIL TYPE 7 F-SHAPE BARRIER		STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)		Date:	Comments	M-606-13	
Designer Initials: JBK	(R-X)				Standard Sheet No. 2 of 4	
Last Modification Date: 07/31/19	(R-X)				Issued by the Project Development Branch: July 31, 2019	
Detailer Initials: LTA	(R-X)					
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)					




- * 1/2" PREFORMED JOINT MATERIAL
- ▲ PIER COLUMN, SIGN SUPPORT FOOTING,
CONCRETE WALL, OR SIMILAR
OBSTRUCTIONS.

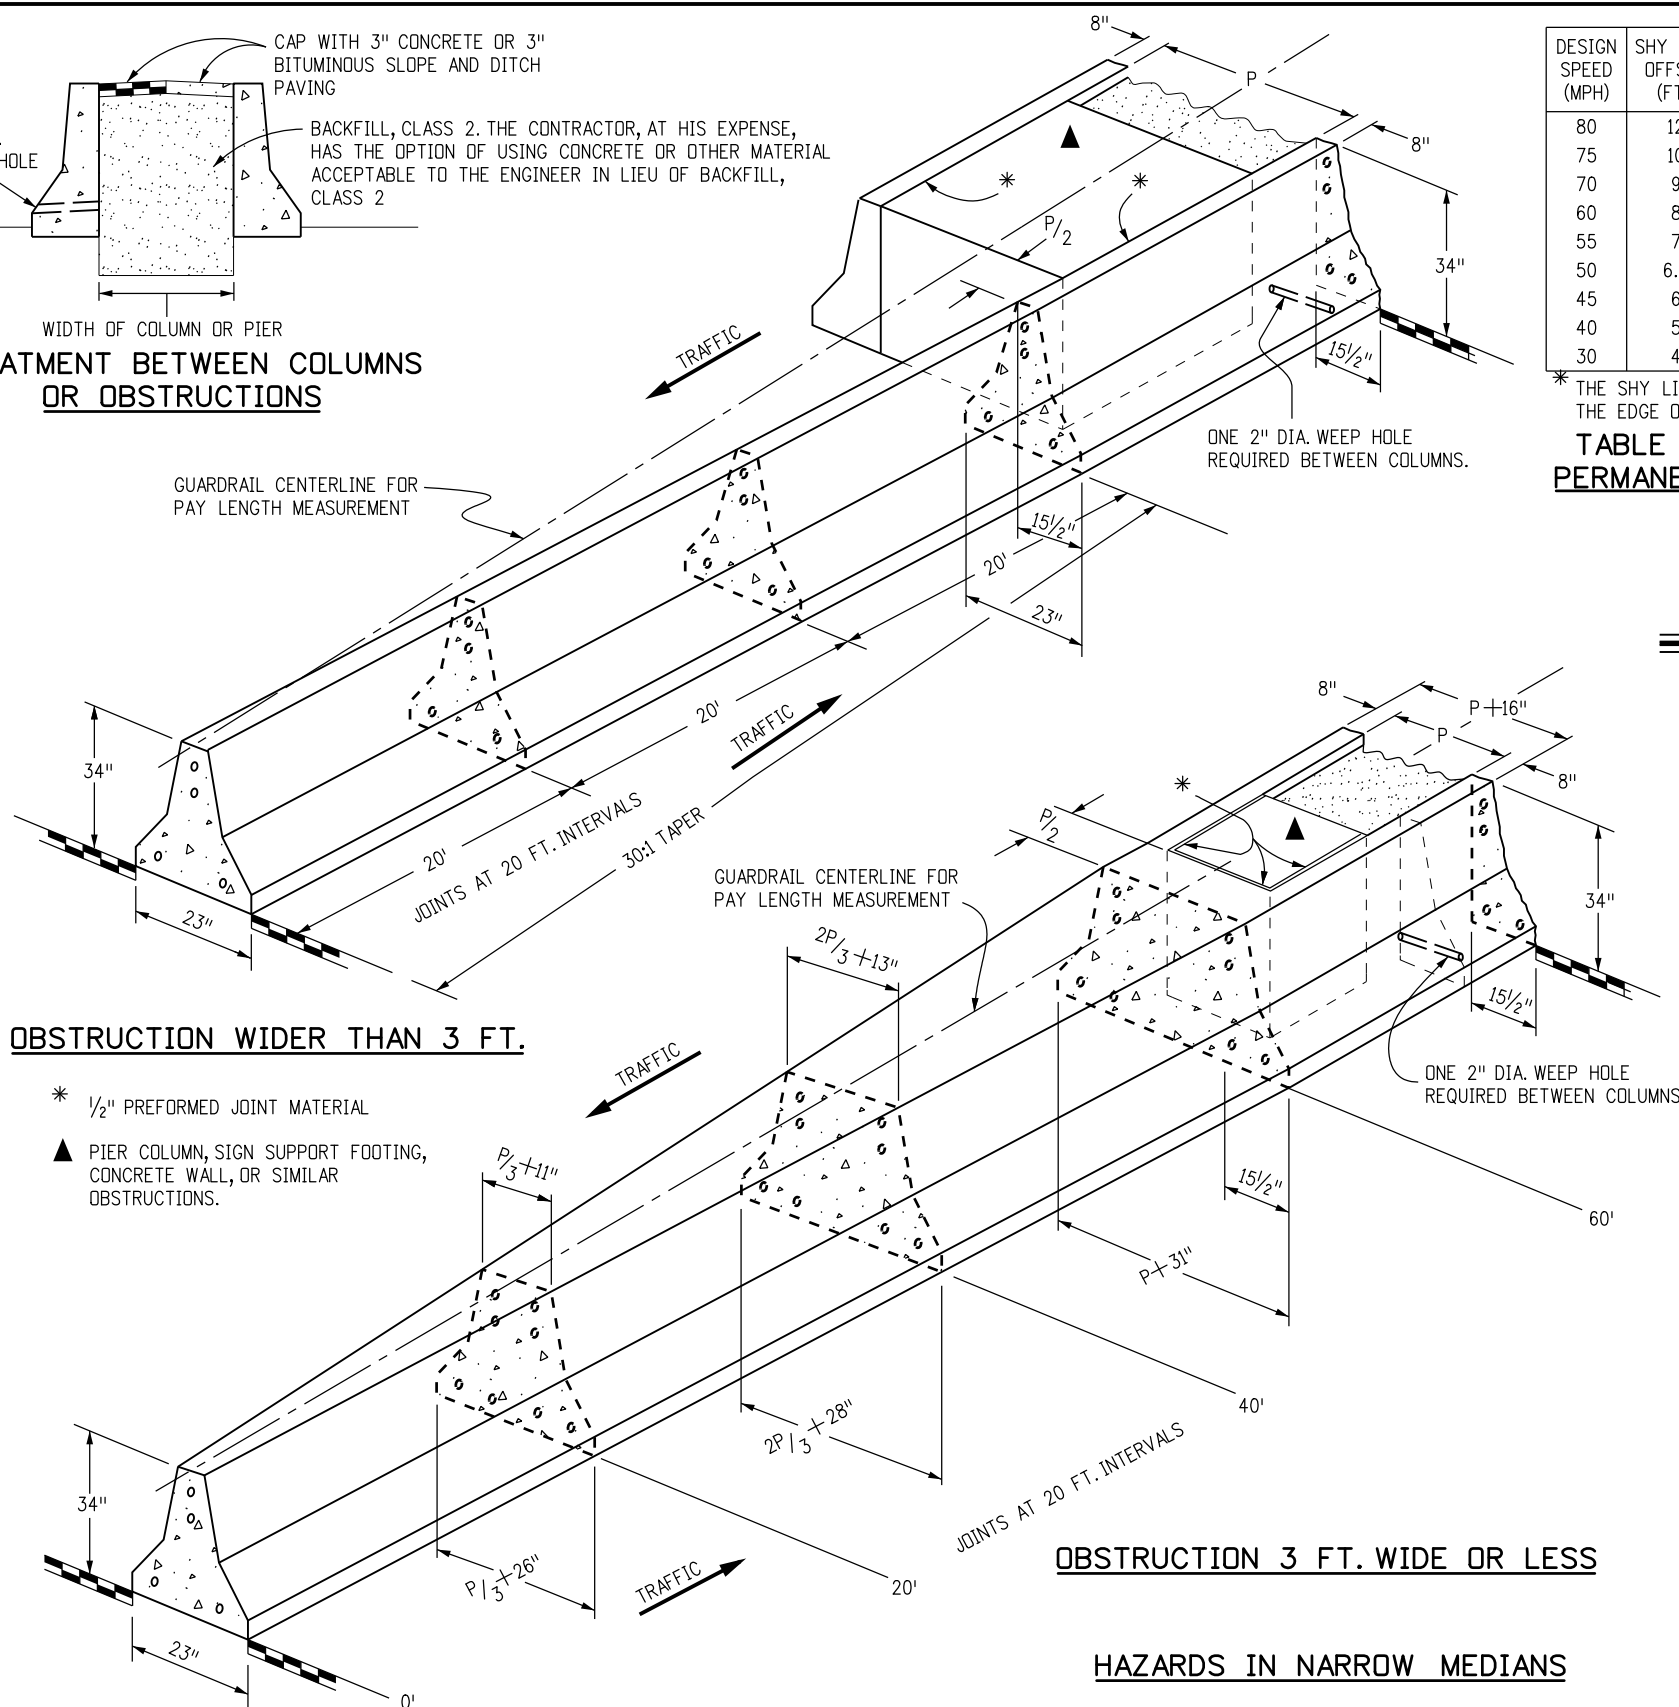


DESIGN SPEED (MPH)	SHY LINE OFFSET (FT.)*	FLARE RATE FOR BARRIER INSIDE SHY LINE	FLARE RATE FOR BARRIER OUTSIDE SHY LINE
80	12	30:1	20:1
75	10	30:1	20:1
70	9	30:1	20:1
60	8	26:1	18:1
55	7	24:1	16:1
50	6.5	21:1	14:1
45	6	18:1	12:1
40	5	16:1	10:1
30	4	13:1	8:1

* THE SHY LINE OFFSET IS MEASURED FROM THE EDGE OF THE TRAVELED WAY.

TABLE OF FLARE RATES FOR PERMANENT CONCRETE BARRIER

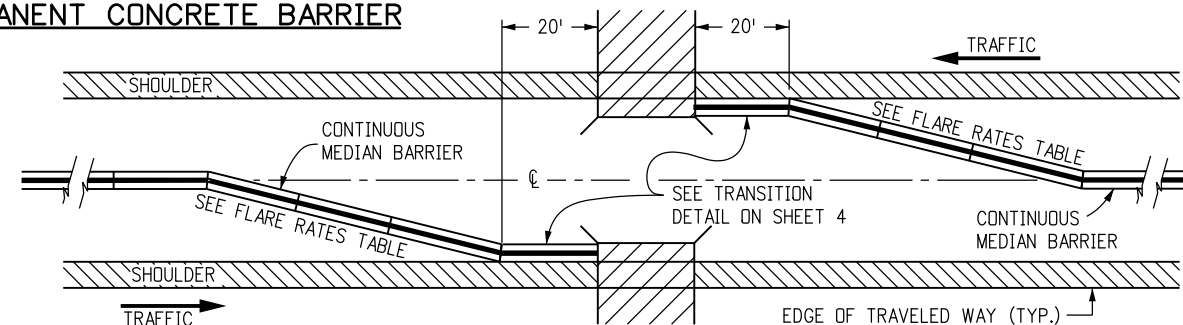


BRIDGE APPROACH

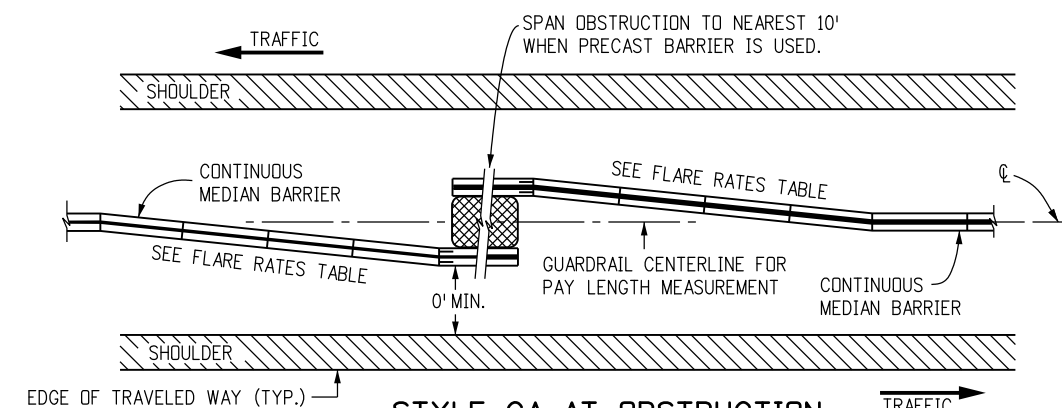

STYLE CA AT OBSTRUCTION

(OBSTRUCTION NOT SUITABLE FOR TYPE CD)

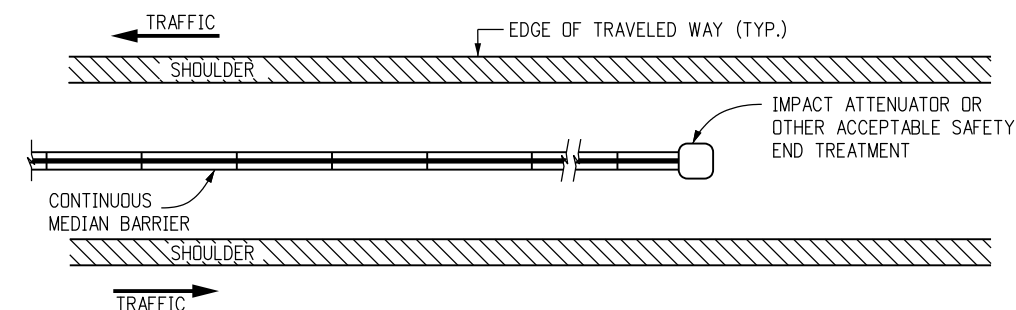


MEDIAN BARRIER END TREATMENT


NOTES

1. THE MEDIAN IN THESE APPLICATIONS SHALL BE PAVED ON A SLOPE CONTINUED FROM THE ADJACENT PAVED SHOULDER OR A 10:1 OR FLATTER SLOPE.
2. THE PAY LENGTH FOR BARRIER ON BOTH SIDES OF AN OBSTRUCTION WILL BE DETERMINED BY ONE LINEAR MEASUREMENT ALONG THE GUARDRAIL CENTERLINE. THE BACKFILL AND CAP BETWEEN COLUMNS OR OBSTRUCTIONS WILL NOT BE MEASURED AND PAID FOR SEPARATELY BUT SHALL BE INCLUDED IN THE WORK.
3. GUARDRAIL BETWEEN COLUMNS OR OBSTRUCTIONS MAY BE STYLES CD OR CA AS SHOWN ON THE PLANS.


Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	GUARDRAIL TYPE 7 F-SHAPE BARRIER	STANDARD PLAN NO.
Creation Date: 07/31/19	Date:	Comments	M-606-13			
Designer Initials: JBK	(R-X)		Standard Sheet No. 3 of 4			
Last Modification Date: 07/31/19	(R-X)		Issued by the Project Development Branch: July 31, 2019 Project Sheet Number:			
Detailer Initials: LTA	(R-X)					
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)					

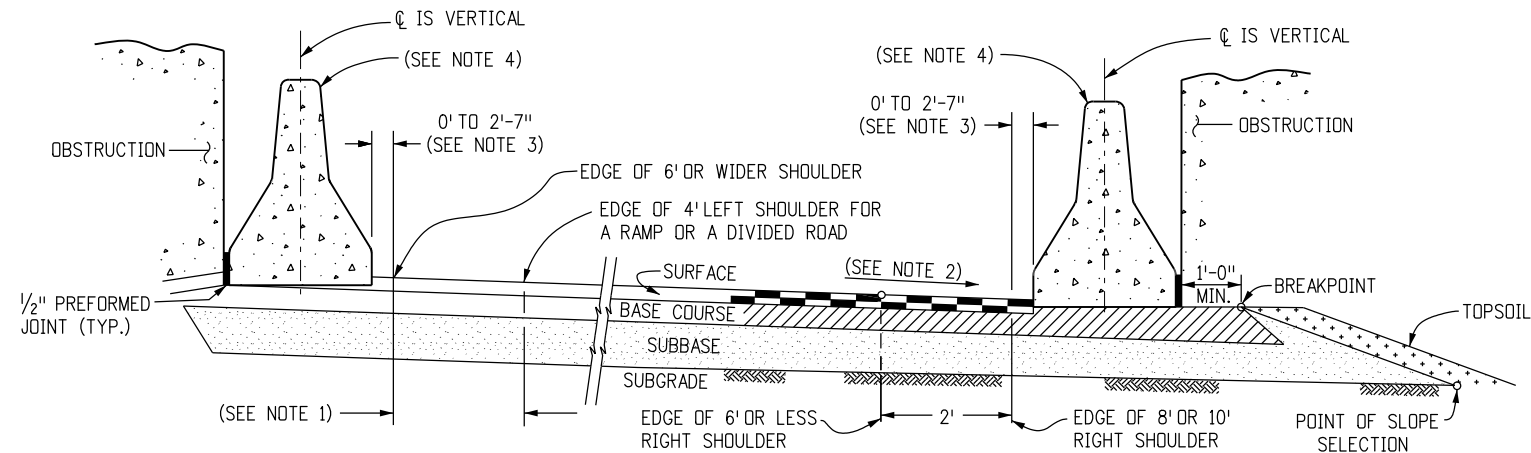

TYPE 7 ON LEFT AND RIGHT SHOULDERS AT OBSTRUCTIONS

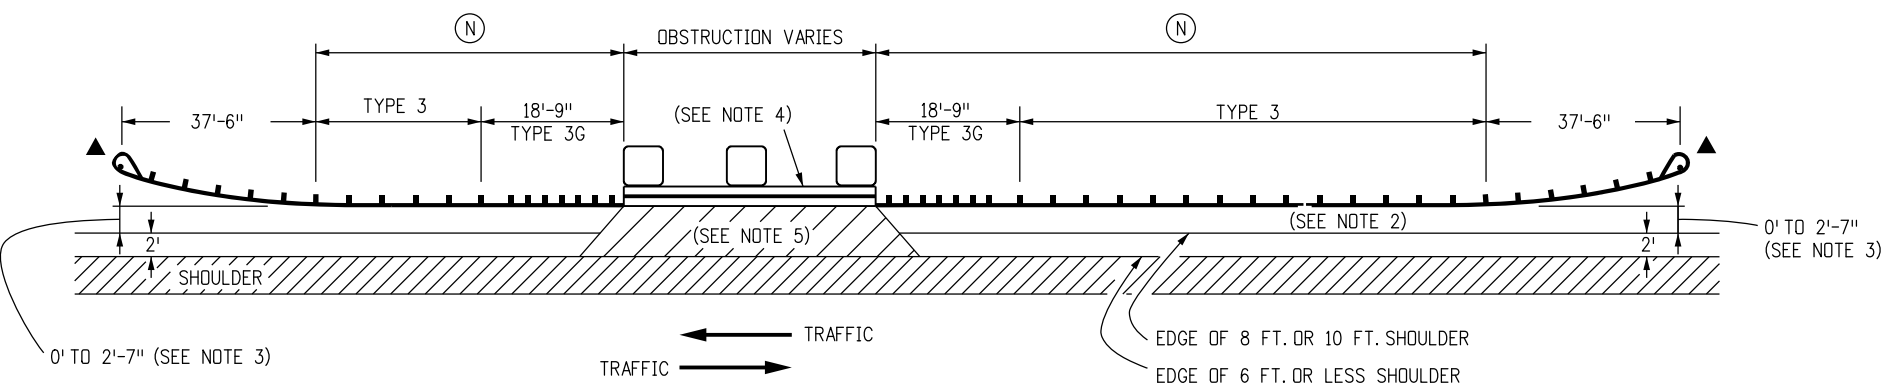

2-LANE 2-WAY ROADS

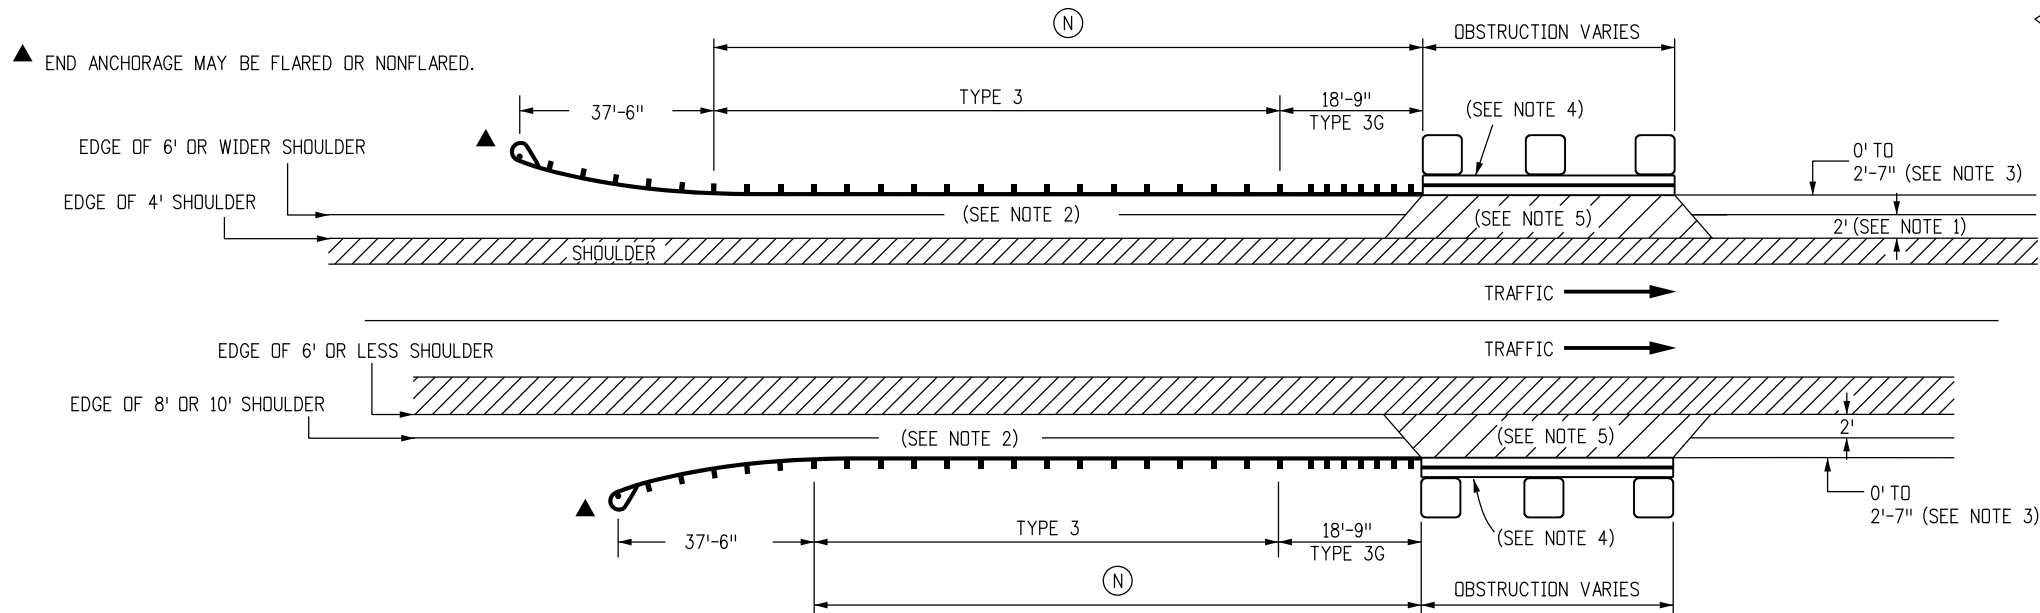


DIRECTIONAL ROADWAYS AND RAMP

HAZARDS ON ROADSIDES

NOTES

1. TWO FT. IS DESIRABLE FOR THIS DIMENSION WITH A 4 FT. LEFT SHOULDER. THE MINIMUM IS 0 FT., WHICH IS ACCEPTABLE FOR 6 FT. OR WIDER SHOULDERS.
2. RATE OF SLOPE DEPENDS ON GUARDRAIL LOCATION:
 - A. FOR GUARDRAIL FACE 2 FT. OR LESS FROM THE NORMAL EDGE OF PAVED SHOULDER, CONTINUE THE RATE OF SLOPE OF THE NORMAL PAVED SHOULDER TO THE BREAKPOINT.
 - B. FOR GUARDRAIL FACE MORE THAN 2 FT. FROM THE NORMAL EDGE OF THE PAVED SHOULDER, THE SLOPE SHALL BE 10:1 OR FLATTER.
3. IF THE DISTANCE FROM THE EDGE OF SHOULDER TO THE OBSTRUCTION EXCEEDS 4 FT.-7 IN., TYPE 3-W BEAM GUARDRAIL MAY BE SPECIFIED ON THE PLANS INSTEAD OF TYPE 7 (SEE PLANS, AND DETAIL BELOW).
4. STYLE CA BARRIERS ARE SHOWN. STYLE CD MAY BE USED AS APPROPRIATE. SEE SHEET 2 FOR TYPE 7 TO SINGLE TYPE 3G TRANSITION.
5. THE AREA BETWEEN SHOULDER AND THE TYPE 7 SHALL BE PAVED. PAYMENT FOR THE PAVED SURFACE WILL BE MADE UNDER A PAVEMENT PAY ITEM, HMA OR CONCRETE, WITH QUANTITIES SHOWN ON THE PLANS.


(N) THE GUARDRAIL LENGTH DIMENSION "N" IS THE LENGTH AS DETERMINED BY THE LENGTH OF NEED COMPUTATION AND AS SHOWN ON THE PLANS. MINIMUM SHALL BE 12 FT.-6 IN. WHERE SITE CONDITIONS ALLOW.

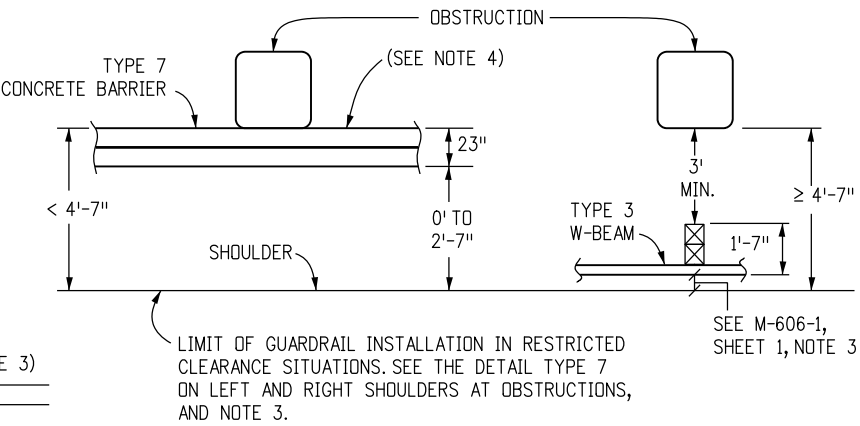


Computer File Information		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development BranchJBK	Sheet Revisions		GUARDRAIL TYPE 7 F-SHAPE BARRIER Issued by the Project Development Branch: July 31, 2019	STANDARD PLAN NO.	
Creation Date: 07/31/19			Date:	Comments		M-606-13	
Designer Initials: JBK	(R-X)					Standard Sheet No. 4 of 4	
Last Modification Date: 07/31/19	(R-X)						
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						

GENERAL NOTES


1. ALL STEEL REINFORCING SHALL BE 2 IN. CLEAR OF THE NEAREST SURFACE OF CONCRETE UNLESS OTHERWISE SHOWN. REINFORCING STEEL SHALL BE GRADE 40 MINIMUM.
2. CONCRETE SHALL BE CLASS D.
3. ALL PERMANENT PRECAST BARRIERS USED TO REPLACE OTHER CONCRETE BARRIERS, SHALL BE IN NEW CONDITION, UNDAMAGED, AND WITH NO REPAIRS.
4. FOR TEMPORARY INSTALLATIONS, INSTALL WITH A MINIMUM 4 FT. DISTANCE FROM THE CENTERLINE OF THE CONCRETE BARRIER TO ANY OBSTRUCTIONS BEHIND IT. FOR TEMPORARY INSTALLATIONS WITH LESS THAN A 4 FT. MINIMUM DISTANCE, STABILIZATION PINS SHALL BE USED ON EACH BARRIER UNIT ADJACENT TO, AND WITHIN 10 FT. OF BOTH SIDES OF THE OBSTRUCTION. SEE SHEET 3 FOR STABILIZATION PINNING DETAILS.
5. THE FLARE RATE FOR TEMPORARY INSTALLATIONS SHALL BE 10:1 OR FLATTER UNLESS OTHERWISE APPROVED BY THE ENGINEER FOR PERMANENT INSTALLATIONS. SEE THE FLARE RATES TABLE ON STANDARD M-606-13, SHEET 3.
6. STABILIZATION PINS SHALL BE USED TO ANCHOR EACH 10 FT. UNIT IN ALL PERMANENT INSTALLATIONS. SEE SHEET 3 FOR STABILIZATION PINNING DETAILS.
7. FOR ALL PERMANENT INSTALLATIONS THAT REQUIRE END ANCHORAGES. SEE STANDARD PLAN M-606-13, SHEET 1, FOR ANCHORAGE DETAILS.
8. THE MONTH AND YEAR THE PRECAST TYPE 7 CONCRETE BARRIER WAS MANUFACTURED SHALL BE MOLDED INTO ONE END OF EACH 10 FT. BARRIER UNIT.
9. APPROVED NON-SHRINK GROUT SHALL BE USED FOR GROUTING OVER ALL PINS AND GROUTING OF SCUPPERS.
10. WHEN HYDRAULIC ANALYSIS ALLOWS, SCUPPERS MAY NOT BE NEEDED ON:
 - A. MEDIAN INSTALLATION WITH INLET DRAINAGE.
 - B. SHOULDER BARRIER ON HIGH EDGE OF A SUPERELEVATED SHOULDER.
 - C. MEDIAN BARRIER ON A CREST VERTICAL CURVE.
 - D. PERMANENT BARRIER, IF SPECIFIED ON PLANS.
11. ALL INCIDENTAL WORK AND MATERIALS SUCH AS CONNECTING PINS, ANCHORS BOLTS, GROUT, AND EXCAVATION FOR END ANCHORAGE, WILL NOT BE PAID FOR SEPARATELY, BUT SHALL BE INCLUDED IN THE COST OF THE WORK.
12. ONE IN. DIAMETER THREADED INSERTS MAY BE CAST-IN-PLACE TO FACILITATE LIFTING FOR TEMPORARY BARRIER APPLICATIONS ONLY.
13. RETROREFLECTORIZATION IS REQUIRED ON BARRIERS. SEE BARRIER RETROREFLECTOR NOTES ON STANDARD PLAN S-612-1.

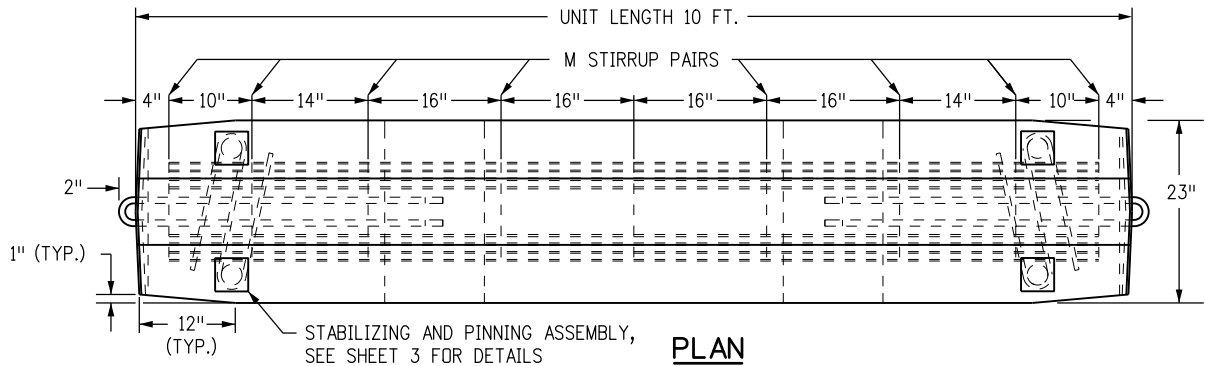


PLAN

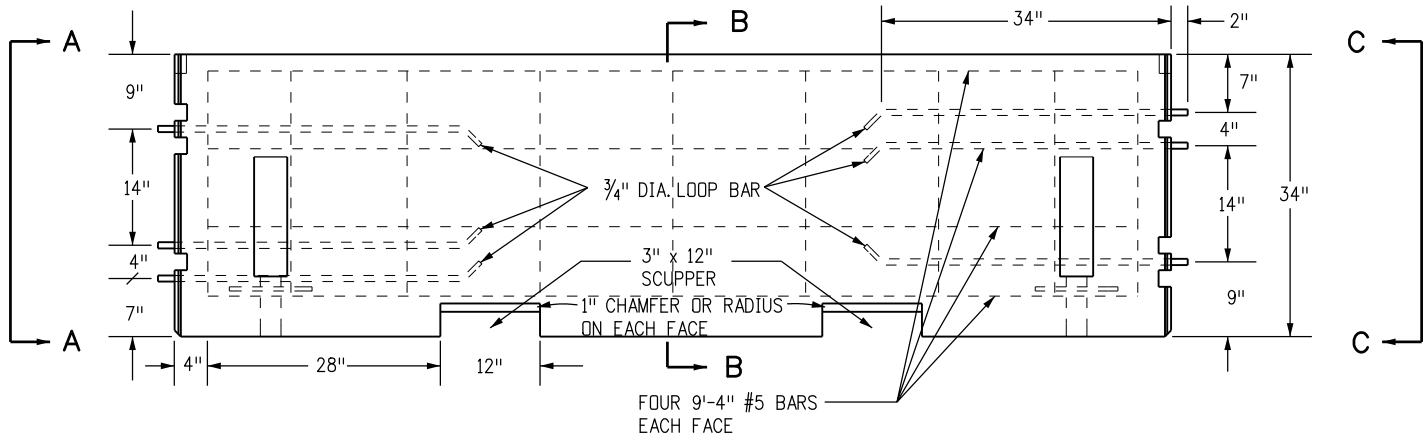

ELEVATION BARRIER




STIRRUP "M" #5 REBAR PAIR

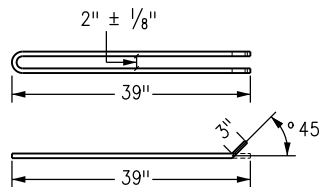


LOOP BAR BENDING DETAIL
(ASTM A36)


(HOT-DIP GALVANIZED
AFTER FABRICATION)

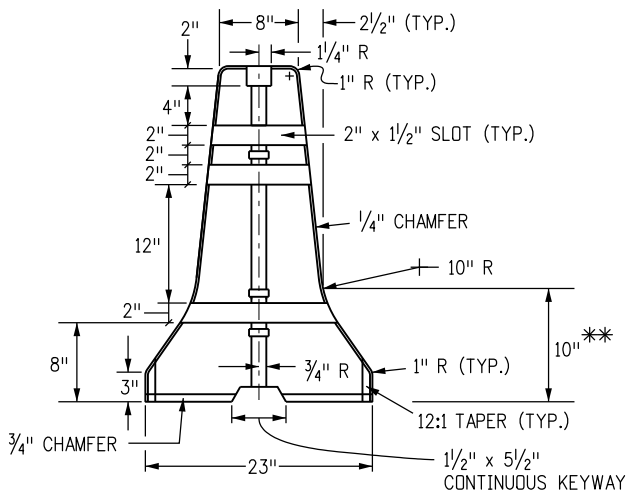

SECTION A-A

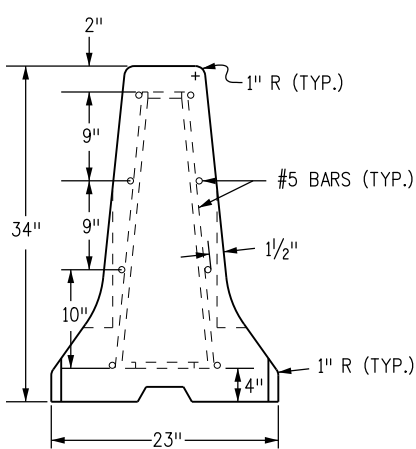


SECTION B-B

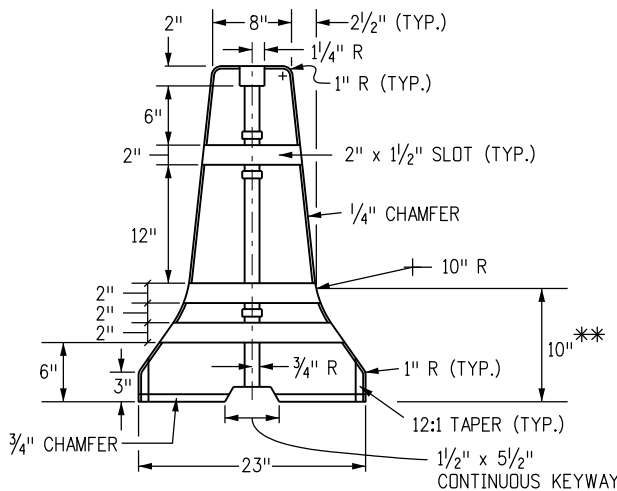


SECTION C-C

** DIMENSIONS MARKED ARE TO THE INTERSECTION POINT
OF THE BARRIER SLOPES. CONSTRUCT THE 10 IN. RADIUS
TO PROVIDE A SMOOTH TRANSITION BETWEEN THE SLOPES.

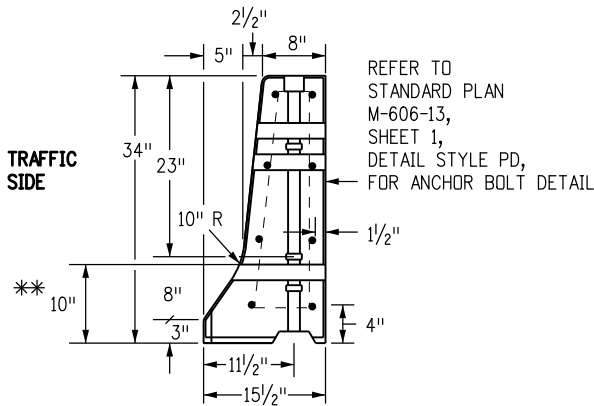

NARROW BASE
SHOULDER BARRIER

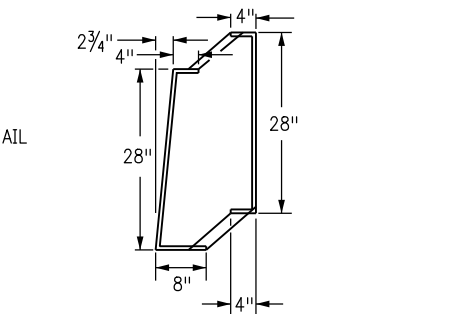

NARROW BASE
STIRRUP "M" #5 REBAR PAIR

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

Sheet Revisions

Date:	Comments
(R-X)	
(R-X)	
(R-X)	
(R-X)	

Colorado Department of Transportation

2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch

JBK

PRECAST TYPE 7
CONCRETE BARRIER



Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.




M-606-14

Standard Sheet No. 1 of 3

Project Sheet Number:

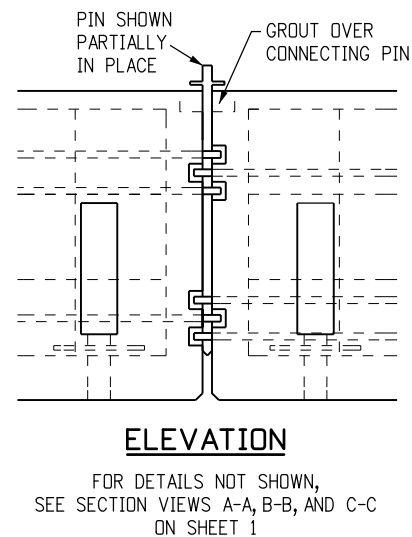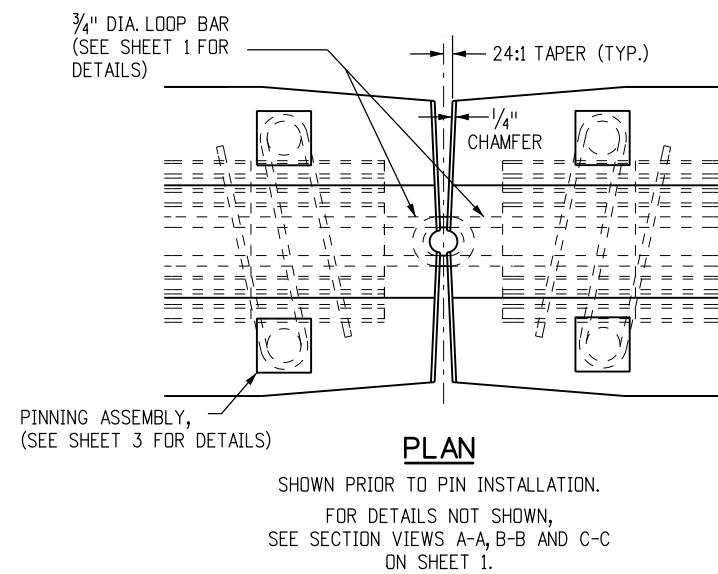


- ## NOTES
1. WASHERS SHALL BE FORGED AS AN INTEGRAL PART OF THE PIN, OR SHALL BE WELDED AS SHOWN.
 2. PINS SHALL BE HOT-DIPPED GALVANIZED AFTER FABRICATION.
 3. IF AN ALTERNATIVE TOP CONFIGURATION IS USED FOR LIFTING, THE LIFTING PIN SHALL BE PROVIDED. PINS SHALL CONFORM TO CRITICAL DIMENSIONS (PIN LENGTH DIAMETER).
 4. PINS SHALL CONFORM TO ASTM A449.
 5. APPROVED NON-SHRINK GROUT SHALL BE USED FOR GROUTING OVER ALL PINS, AND GROUTING OF SCUPPERS.
 6. BOTH ENDS OF THE BARRIER SHALL HAVE A 24:1 TAPER IN EACH DIRECTION FROM THE CENTER PIN RECESS TO ITS OUTER EDGE TO FACILITATE PLACEMENT ON CURVES.
 7. JOINTS BETWEEN CAST-IN-PLACE GUARDRAIL TYPE 7 AND PERMANENT INSTALLATION PRECAST TYPE 7 CONCRETE BARRIER SHALL INCLUDE ALL REGRESSES AND LOOPS IN THE CAST-IN-PLACE END, ALONG WITH THE PIN TO COMPLETE THE TYPICAL PRECAST TYPE 7 CONCRETE BARRIER JOINT.

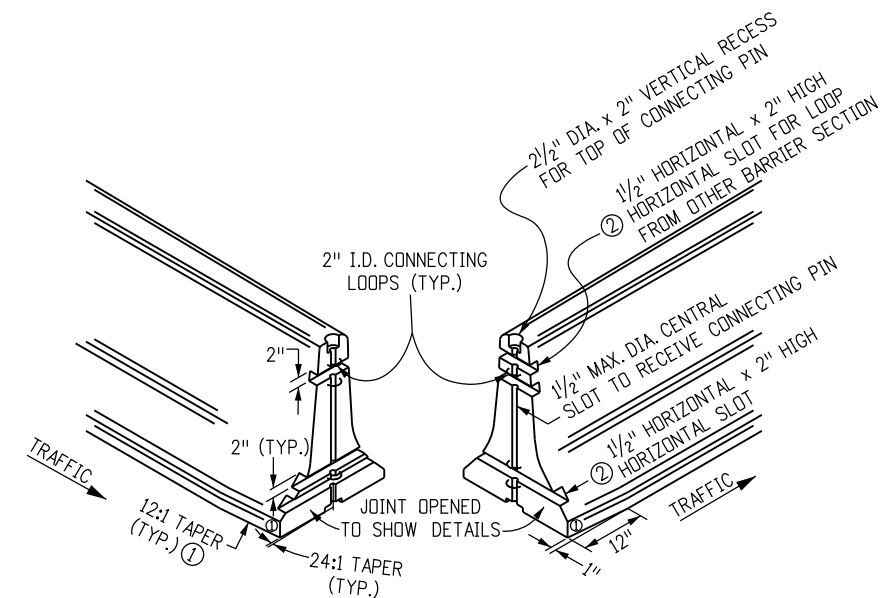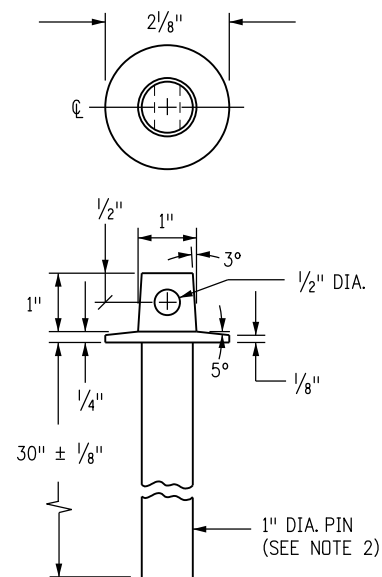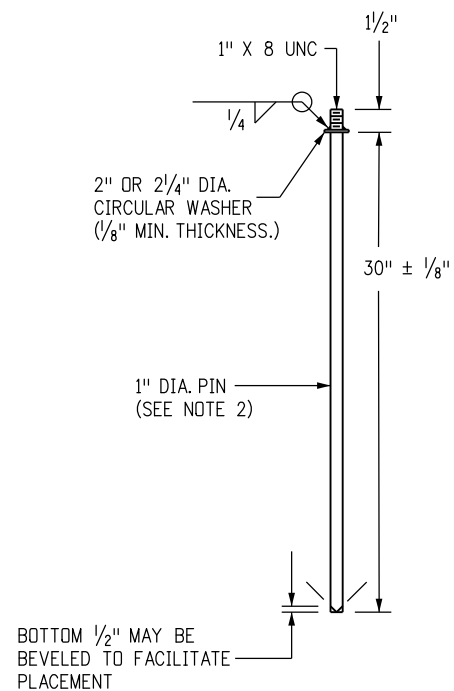


- ① A 1 IN. BY 12 IN. TAPER IS REQUIRED AT THE BOTTOM OF ALL FOUR CORNERS OF THE BARRIER SECTIONS TO ELIMINATE SNAGGING OF SNOW PLOW BLADES. THE TAPER IS OPTIONAL ON PERMANENT INSTALLATIONS.
- ② THE HORIZONTAL SLOTS SHALL BE $1\frac{1}{2}$ IN. IN DEPTH AT THE CENTER OF THE BARRIER AND MAY DECREASE IN DEPTH AT THE EDGE OF THE BARRIER DUE TO THE (24:1) TAPER.

DETAILS FOR PIN AND LOOP CONNECTION


Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		 Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	PRECAST TYPE 7 CONCRETE BARRIER		STANDARD PLAN NO.			
Creation Date: 07/31/19			Date:	Comments				M-606-14			
Designer Initials: JBK											
Last Modification Date: 07/31/19											
Detailer Initials: LTA										Standard Sheet No. 2 of 3	
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English								Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:	

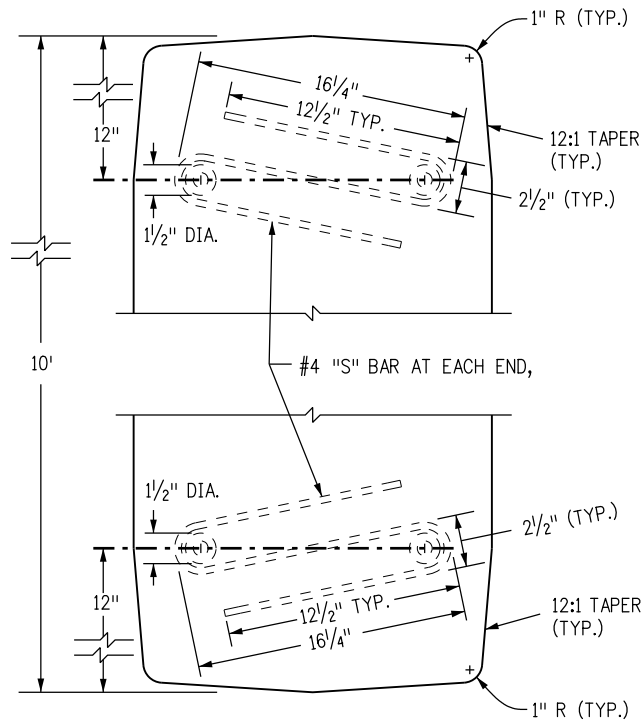

PLAN VIEW OF S BAR ENDS

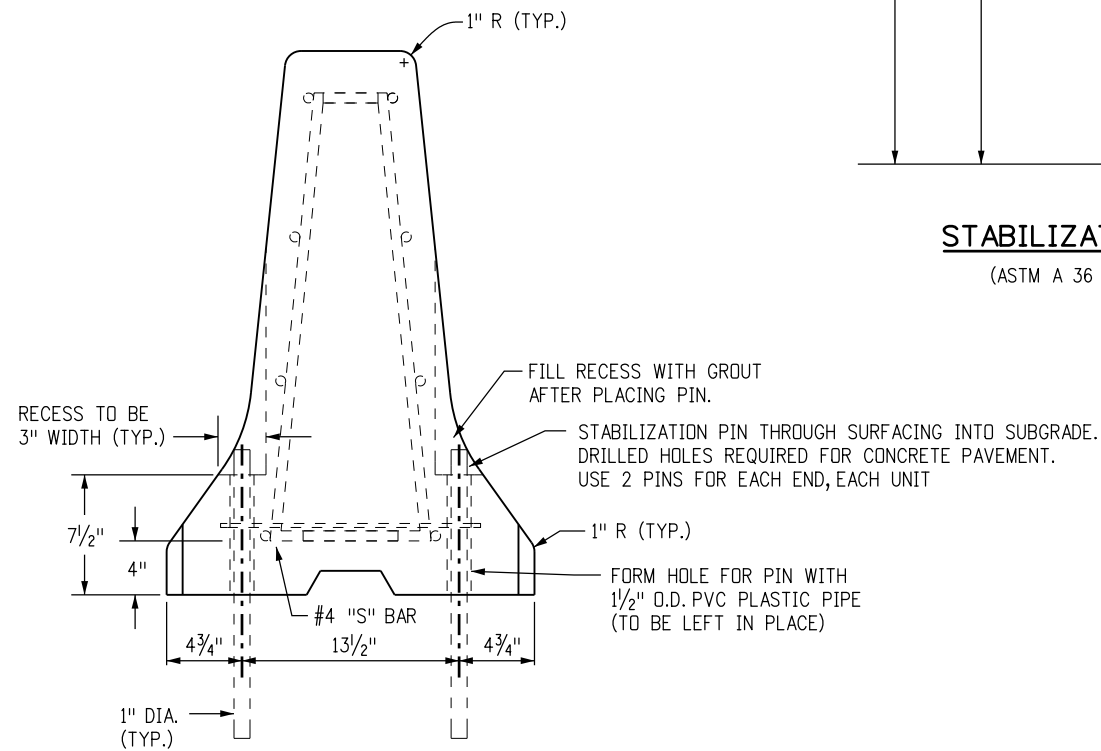


ELEVATION VIEW WITH PINS

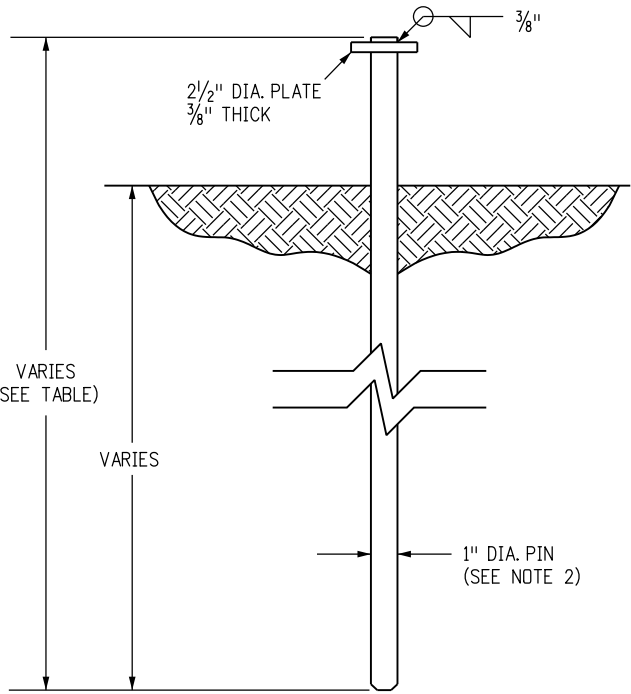

STABILIZATION PIN

(ASTM A 36 STEEL)

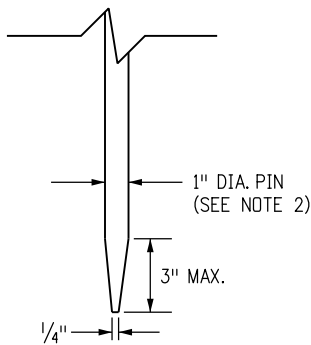

OPTIONAL TAPERED END PIN

(SEE NOTE 4)

NOTES


- SEE SHEET 1 FOR REINFORCEMENT AND OTHER DETAILS NOT SHOWN HERE.
- PINS SHALL BE HOT-DIPPED GALVANIZED AFTER FABRICATION
- FOR TERMINAL ANCHORING OF THE PERMANENT INSTALLATION OF PRECAST TYPE 7 CONCRETE BARRIER, SEE THE END ANCHORAGE DETAIL ON STANDARD PLAN M-606-13, SHEET 1.
- AN OPTIONAL 3 IN. MAXIMUM TAPERED END POINT MAY BE PROVIDED ON THE STABILIZATION PIN TO FACILITATE DRIVING.

ROAD SURFACE	PIN LENGTH
CONCRETE	2 FT.-6 IN.
HMA	3 FT.
SOIL	3 FT.-6 IN.


TABLE OF STABILIZATION PIN LENGTHS

DETAILS FOR STABILIZATION OF PERMANENT OR TEMPORARY PINNED PRECAST TYPE 7 CONCRETE BARRIER

Computer File Information		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development BranchJBK	Sheet Revisions		PRECAST TYPE 7 CONCRETE BARRIER		STANDARD PLAN NO.	
Creation Date: 07/31/19			Date:	Comments			M-606-14	
Designer Initials: JBK	(R-X)						Standard Sheet No. 3 of 3	
Last Modification Date: 07/31/19	(R-X)							
Detailer Initials: LTA	(R-X)							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)				Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:	

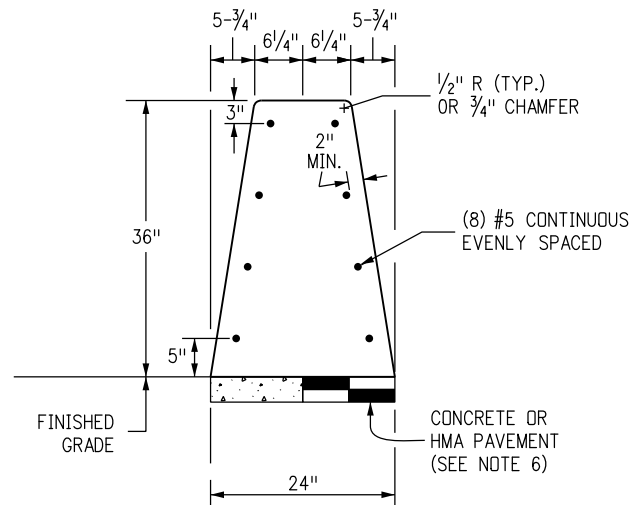


CONCRETE BARRIER STYLE CA

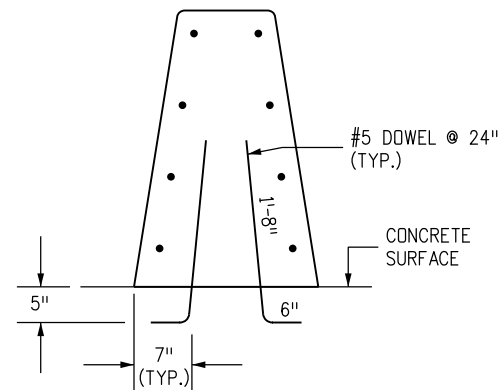


CONCRETE BARRIER STYLE CC

DETAILS SIMILAR TO STYLE CA EXCEPT AS NOTED.
BARRIER DOWELLED TO CONCRETE SURFACES.

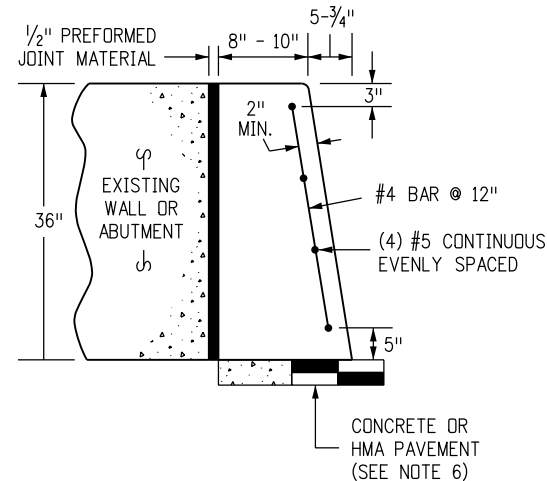


CONCRETE BARRIER STYLE CD

BARRIER AGAINST WALLS.

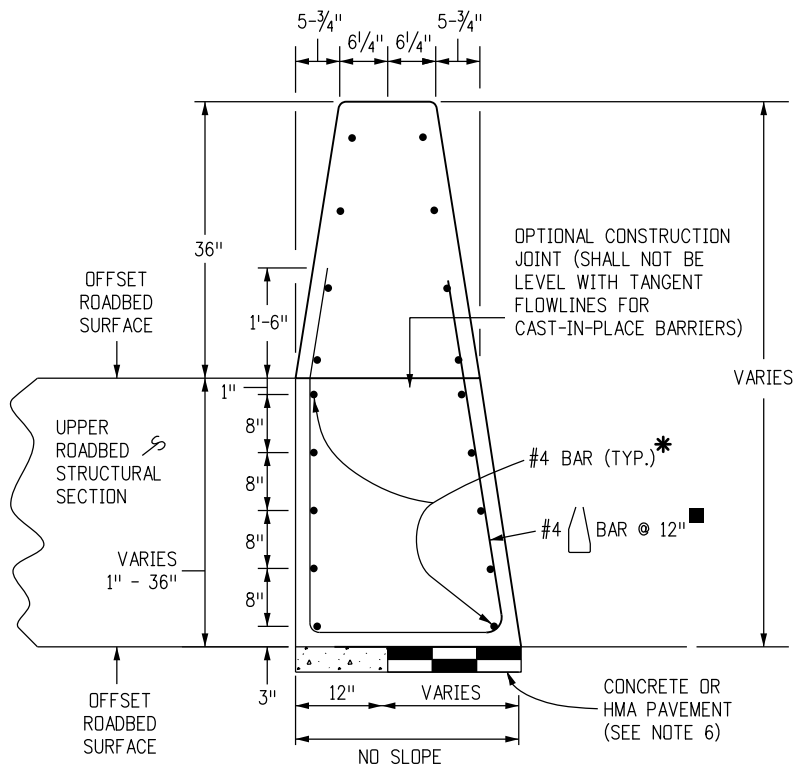

CONCRETE BARRIER STYLE CE

DETAILS SIMILAR TO STYLE CA EXCEPT AS NOTED.
USE CONCRETE BARRIER END ANCHOR WHEN NECESSARY.
SHOWN 36 INCH ROADBED SURFACES OFFSET.

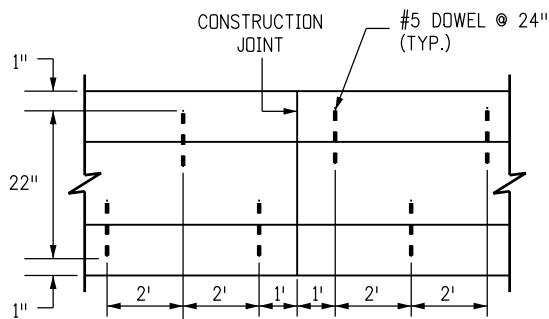

DOWEL PLACEMENT LAYOUT


* FOR SURFACES OFFSETS LESS THAN OR EQUAL TO 3 INCHES, NO ADDITIONAL REINFORCEMENT IS REQUIRED.

SURFACE OFFSETS GREATER THAN 3 INCHES WILL REQUIRE ADDITIONAL REINFORCEMENT AS SHOWN.

THE LOWEST LAYER OF TWO #4 SHALL BE 3 INCHES ABOVE THE BOTTOM OF THE BARRIER. EACH VERTICAL INCREMENT OF 8 INCHES MEASURED FROM THE LOWEST LAYER OF REINFORCEMENT SHALL INCLUDE AN ADDITIONAL TWO #4.


FOR BARRIER TRANSITIONING IN HEIGHT MAINTAIN THE BOTTOM REINFORCEMENT LAYER COVER AND DISCONTINUE/ADD INCREMENTAL REINFORCING PARALLEL TO THE BARRIER AS HEIGHT REQUIRES.

■ REINFORCING STIRRUP NOT REQUIRED FOR ROADBED OFFSETS LESS THAN 1 FOOT.

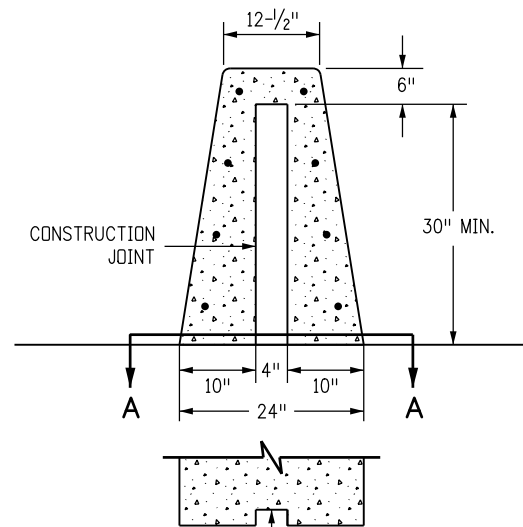

**SECTION A-A
CONSTRUCTION JOINT**

SEE NOTE 15.

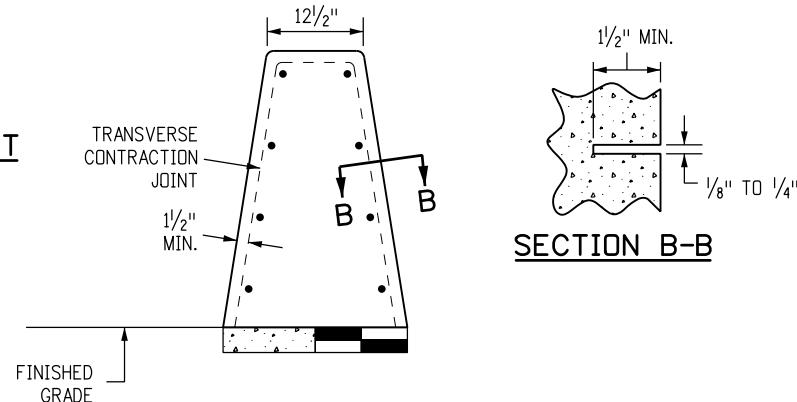

TRANSVERSE CONTRACTION JOINTS

FORMED OR SAWED TRANSVERSE CONTRACTION JOINTS ARE REQUIRED AT 20 FT. INTERVALS OR THE INTERVALS SHALL MATCH THE CONCRETE PAVEMENT JOINTS FOR INSTALLATIONS THAT ARE ON TOP OF THE CONCRETE ROADWAY PAVEMENT. SEE CONCRETE BARRIER STYLE CA FOR TYPICAL DIMENSIONS.


GENERAL NOTES

1. SEE SHEET 2 FOR DETAILS OF CONCRETE BARRIER STYLE CA END ANCHOR CONNECTIONS TO STRUCTURES OR TRANSITION TO GUARDRAIL TYPE 7.
2. SEE SHEET 6 FOR CONCRETE BARRIER STYLE CA TRANSITIONS AT BRIDGE COLUMNS AND SIGN PEDESTALS IN MEDIANS.
3. WHERE GLARE SCREENS ARE REQUIRED, USE CONCRETE BARRIER STYLE CG ON SHEET 4.
4. WHERE ROADBED OFFSET IS GREATER THAN 1 1/2 INCH, SEE CONCRETE BARRIER STYLE CE
5. BARRIER MAY BE CAST-IN-PLACE OR SLIP FORMED.
6. BARRIER FOUNDATION SHALL BE PAVEMENT, OR COMPACTED AGGREGATE BASE, OR COMPACTED EMBANKMENT MATERIAL.
7. NO ANCHORAGE IS REQUIRED (TYP.) EXCEPT FOR THE 10 FOOT ANCHORAGE. SEE SHEETS 2 AND 3 FOR DETAILS.
8. CONSTRUCTION JOINTS SHALL BE USED ON ALL BARRIER TYPES SHOWN, AT THE END OF THE DAY'S POUR OR AFTER ANY INTERRUPTION LONGER THAN 30 MINUTES. ALL CONSTRUCTION JOINTS SHALL BE THOROUGHLY CLEANED BEFORE FRESH CONCRETE IS POURED.
9. ALL REINFORCING STEEL SHALL BE GRADE 60 EPOXY COATED DEFORMED BARS AND SHALL BE A MINIMUM OF 2 INCHES IN FROM THE NEAREST CONCRETE SURFACE, UNLESS OTHERWISE NOTED.
10. CONTINUOUS LONGITUDINAL REINFORCEMENT SHALL BE EITHER GRADE 60 EPOXY COATED DEFORMED BARS OR WIRE STRAND WITH MINIMUM ULTIMATE TENSILE STRENGTH OF 28,000 LBS. AND CLASS C GALVANIZING ACCORDING TO ASTM A 603.
11. TRANSITION TO EXISTING CONCRETE BARRIER INSTALLATIONS OF DISSIMILAR SHAPE SHALL BE ACCOMPLISHED IN ONE 15 FOOT LONG SEGMENT OF BARRIER.
12. CONCRETE SHALL BE CLASS D.
13. ADDITIONAL MATERIAL FOR BARRIER EMBEDMENT GREATER THAN 1 INCH WILL NOT BE MEASURED AND PAID FOR SEPARATELY BUT SHALL BE INCLUDED IN THE WORK.
14. EPOXY COATED LONGITUDINAL REBAR SHALL HAVE A MINIMUM LAP SPLICE OF 38 INCHES. WIRE STRAND LONGITUDINAL REINFORCEMENT SHALL BE BUTT WELDED OR MECHANICALLY SPLICED TO MAINTAIN 100 PERCENT OF THE MINIMUM REQUIRED TENSILE STRENGTH.
15. ALL INCIDENTAL WORK AND MATERIAL SUCH AS DOWELS, GROUT, ANCHORS, BOLTS, PINS, JOINT MATERIAL, EXCAVATION FOR BASES, CONTINUOUS LONGITUDINAL REINFORCEMENT, SHALL BE INCLUDED IN THE COST OF GUARDRAIL.
16. RETROREFLECTORIZATION IS REQUIRED ON ALL BARRIER TYPES. SEE BARRIER RETROREFLECTOR NOTES ON STANDARD PLAN S-612-1.


Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	GUARDRAIL TYPE 9 SINGLE SLOPE BARRIER		STANDARD PLAN NO.	
Creation Date: 07/31/19	Date:		Comments	M-606-15					
Designer Initials: JBK				Standard Sheet No. 1 of 11					
Last Modification Date: 07/31/19									
Detailer Initials: LTA									
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English				Issued by the Project Development Branch: July 31, 2019					
			Project Sheet Number:						

NOTES

- 1. SEE SHEET 3 FOR END ANCHORAGE REQUIREMENTS. AT A MINIMUM, THE BARRIER SHALL BE ANCHORED AT THE ENDS AND AT INTERRUPTIONS WITH THE A 10 FOOT ANCHORAGE. THE ANCHORAGE. SHALL BE MONOLITHIC OR DOWELED WITH 2-#8 X 8" @ 2'-0 BARS.
- 2. SEE SHEET 1 FOR CONCRETE BARRIER STYLE CA AND STYLE CC.
- 3. TRANSITION TO EXISTING CONCRETE BARRIER INSTALLATIONS OF DISSIMILAR SHAPE SHALL BE ACCOMPLISHED IN ONE 15 FOOT LONG SEGMENT OF BARRIER.
- 4. SEE SHEET 6 FOR CONCRETE BARRIER STYLE CA TRANSITIONS AT BRIDGE COLUMNS AND SIGN PEDESTALS IN MEDIANS.
- 5. FOR STYLE CA CONNECTIONS TO STRUCTURES, SEE THE BRIDGE PLANS.

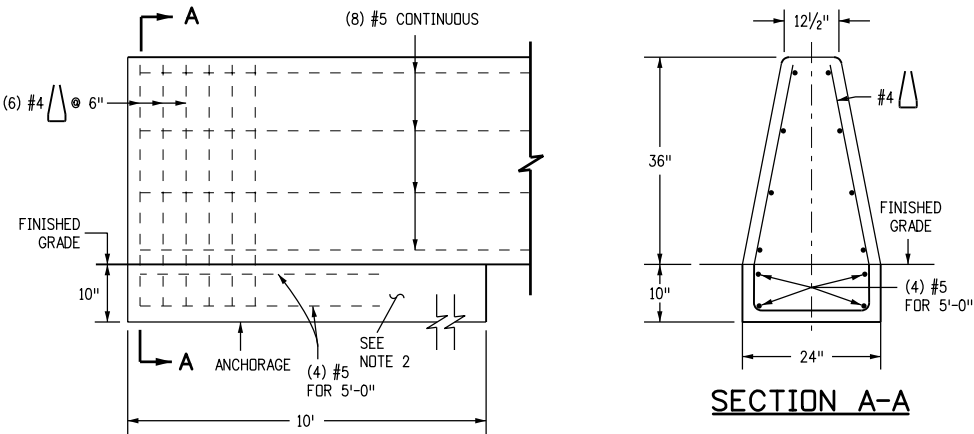

END ANCHORAGE

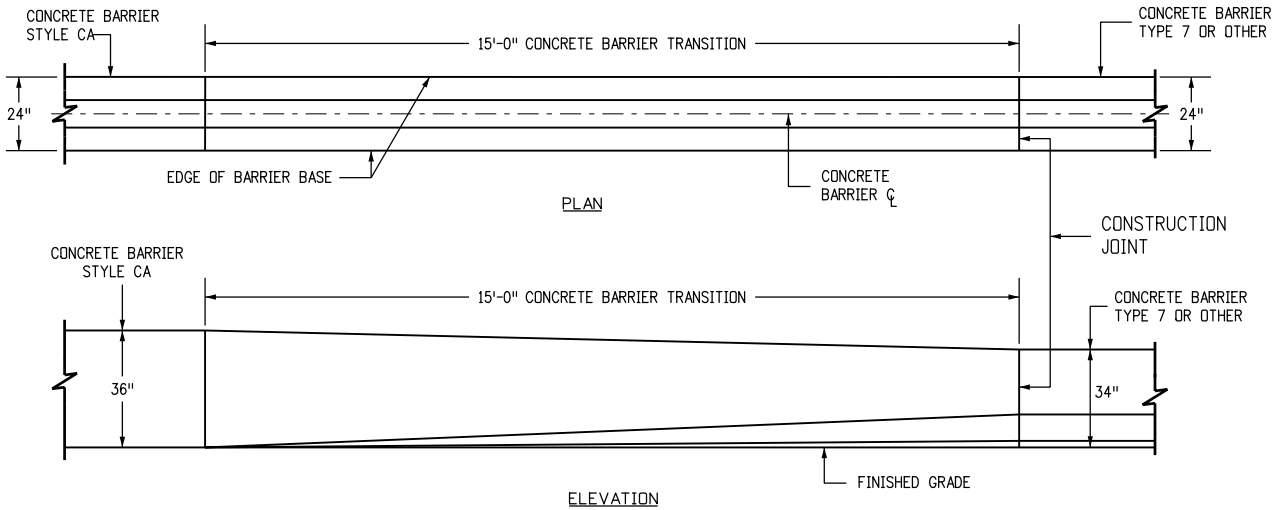


TRANSITION CONCRETE BARRIER TYPE 9 TO CONCRETE BARRIER TYPE 7 OR EXISTING

Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		 Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	GUARDRAIL TYPE 9 SINGLE SLOPE BARRIER	STANDARD PLAN NO.	
Creation Date: 07/31/19	Date:		Comments	M-606-15				
Designer Initials: JBK				Standard Sheet No. 2 of 11				
Last Modification Date: 07/31/19				Project Sheet Number:				
Detailer Initials: LTA								
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English				Issued by the Project Development Branch: July 31, 2019				

NOTES


1. SEE PLANS FOR CONCRETE BARRIER LENGTHS LESS THAN 150 FEET AND/OR HINGE WIDTHS EQUAL TO OR LESS THAN 1 FOOT BEHIND THE CONCRETE BARRIER.
2. SEE SHEET 2 FOR REINFORCING BAR DETAILS.
3. NEW CONCRETE BARRIERS UNDER 150 FEET SHALL BE DOWELED INTO EXISTING CONCRETE BRIDGE BARRIERS OR WINGWALLS TO MINIMIZE ROTATIONS TO ANY OF THEM. SEE SHEET 1 FOR DOWEL PLACEMENT LAYOUT.
4. FOR END ANCHORAGES UNDER 150 FEET, CONSTRUCT THE ANCHORAGE FOR THE ENTIRE LENGTH OF THE CONCRETE BARRIER.
5. FOR CONCRETE BARRIER RUNS GREATER THAN 150 FEET BUT LESS THAN 500 FEET, THE RUN SHALL BE ANCHORED AT THE ENDS AND AT GAPS, SUCH AS AN EMERGENCY ACCESS.
6. FOR END ANCHORAGES OVER 500 FEET, CONSTRUCT ANCHORAGES EVERY 250 FEET.
7. REINFORCING STEEL IN ANCHORAGE SHALL BE GRADE 60 EPOXY COATED DEFORMED BARS.
8. CONCRETE SHALL BE CLASS D.
9. ALL INCIDENTAL WORK AND ADDITIONAL MATERIALS SHALL BE INCLUDED IN THE COST OF THE CONCRETE BARRIER.

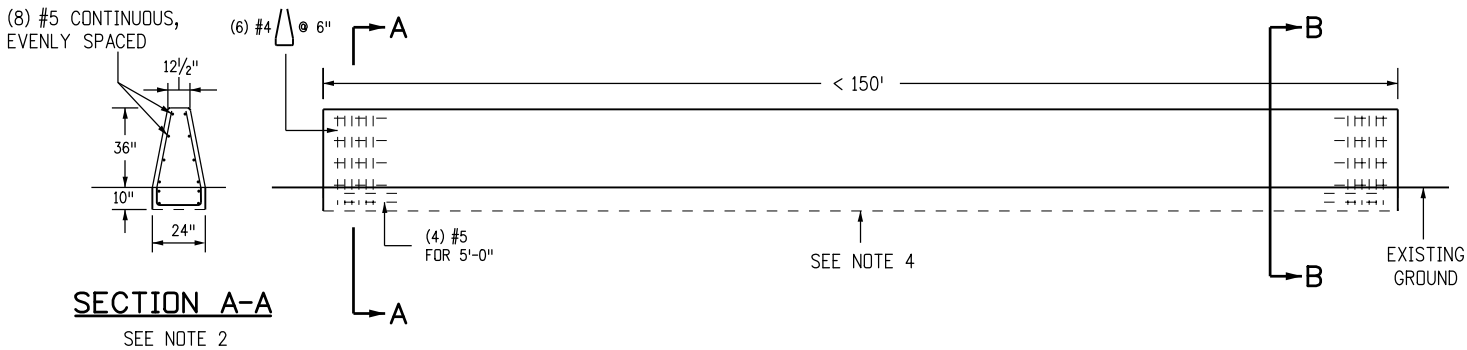


SECTION A-A

SEE NOTE 2


CONCRETE BARRIER END ANCHORAGE UNDER 150 FEET

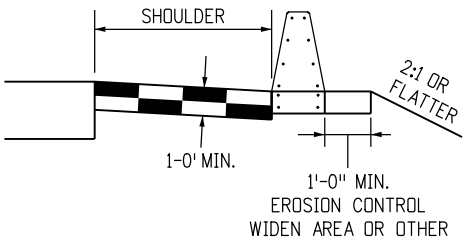


SECTION B-B

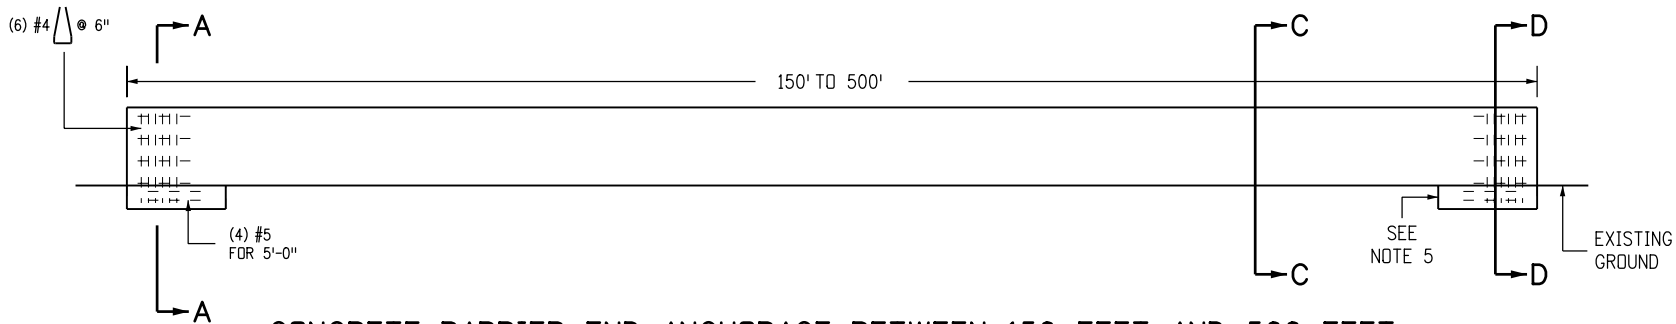


CONCRETE BARRIER END ANCHORAGE BETWEEN 150 FEET AND 500 FEET

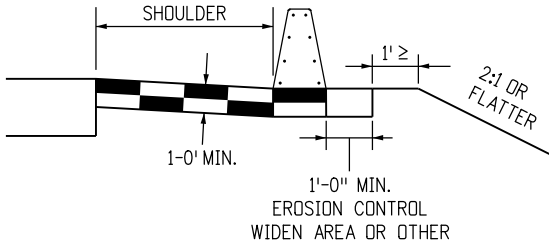

SECTION C-C

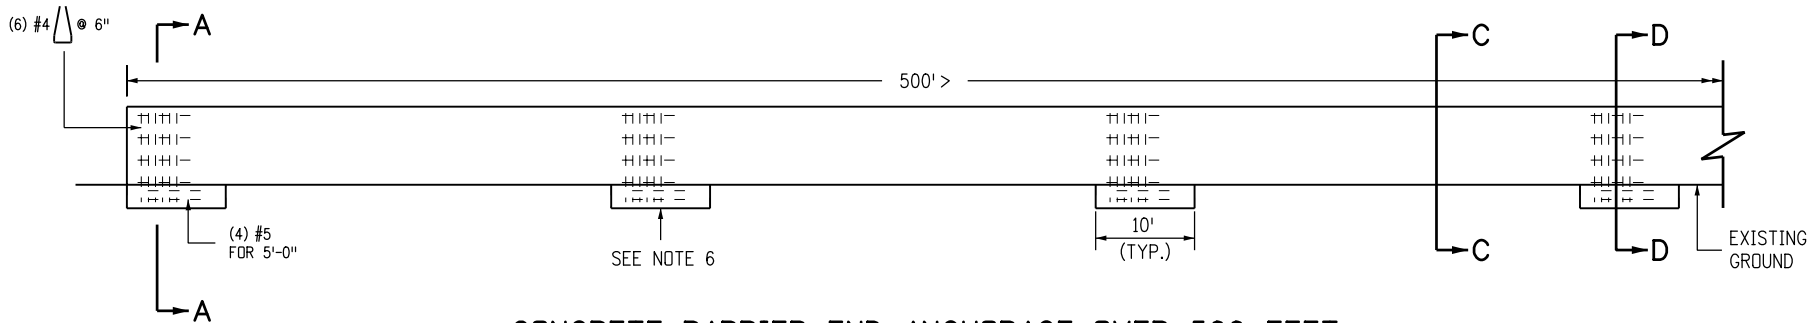

CONCRETE BARRIER END ANCHORAGE OVER 500 FEET

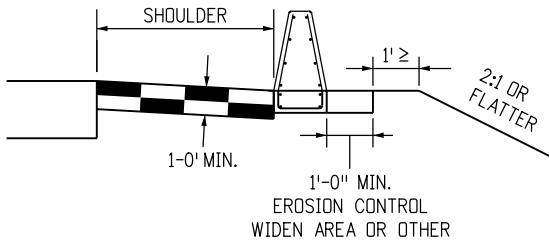


SECTION D-D


Computer File Information		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	Sheet Revisions		GUARDRAIL TYPE 9 SINGLE SLOPE BARRIER		STANDARD PLAN NO.	
Creation Date: 07/31/19			Date:	Comments			M-606-15	
Designer Initials: JBK	(R-X)						Standard Sheet No. 3 of 11	
Last Modification Date: 07/31/19	(R-X)							
Detailer Initials: LTA	(R-X)							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)				Issued by the Project Development Branch: July 31, 2019			
						Project Sheet Number:		

NOTES


1. SEE SHEET 5 FOR DETAILS OF CONCRETE BARRIER STYLE CGE/CG END ANCHORS CONNECTIONS TO STRUCTURES AND TRANSITIONS TO GUARDRAIL TYPE 7.
2. WHERE ROADBED OFFSET IS GREATER THAN 1½ INCH, SEE CONCRETE BARRIER TYPE CGE.
3. BARRIER FOUNDATION SHALL BE PAVEMENT, OR COMPACTED AGGREGATE BASE, OR COMPACTED EMBANKMENT MATERIAL.
4. RETROREFLECTORIZATION IS REQUIRED ON ALL BARRIER TYPES. SEE THE BARRIER RETROREFLECTOR NOTES ON STANDARD PLAN S-612-1.

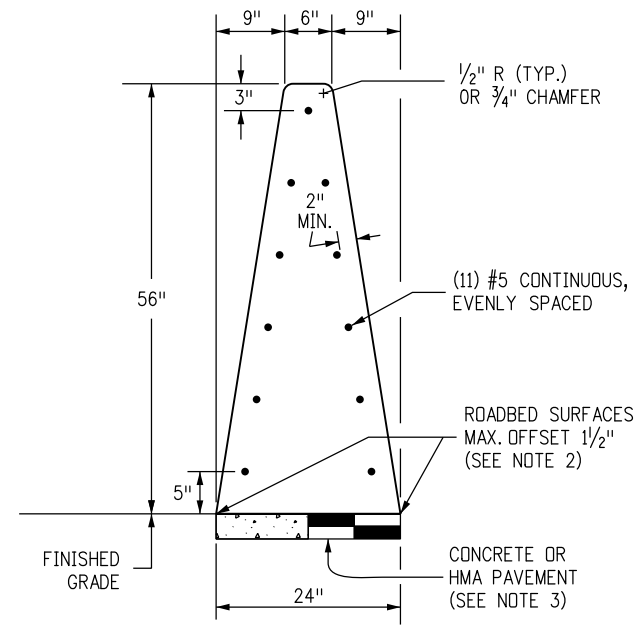

CONCRETE BARRIER STYLE CG (56")
MONOLITHIC CONCRETE GLARE SCREEN/BARRIER

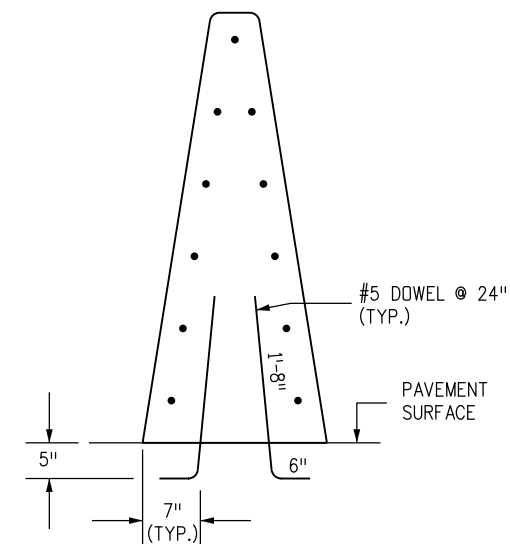

CONCRETE BARRIER STYLE CGC
 DETAILS SIMILAR TO STYLE CG EXCEPT AS NOTED.
 BARRIER DOWELLED TO CONCRETE SURFACES.

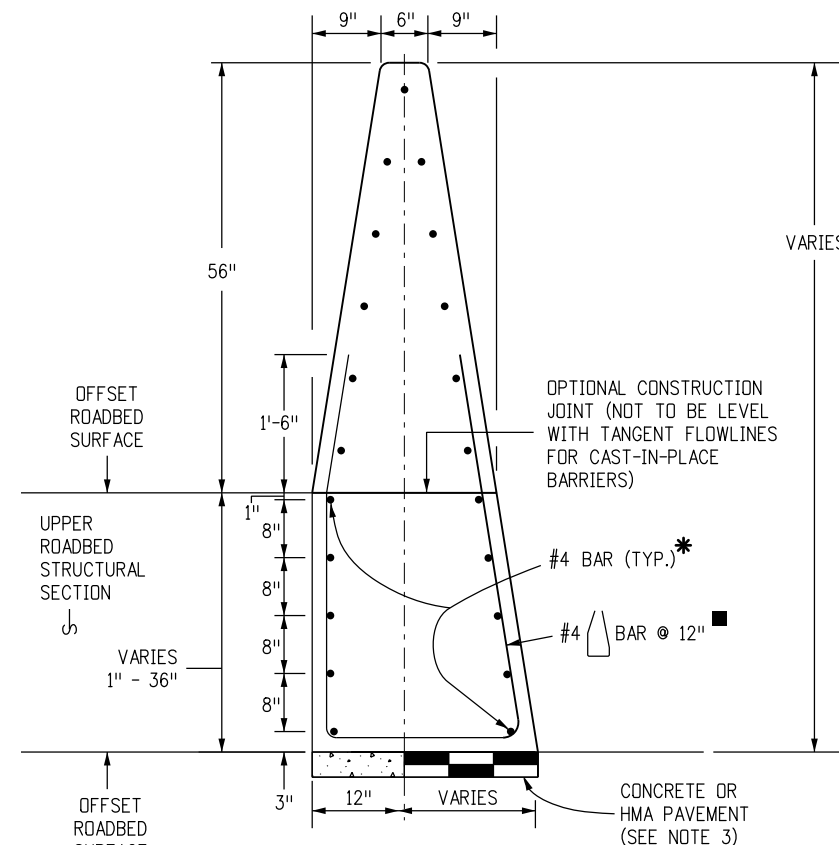


CONCRETE BARRIER STYLE CGE
 DETAILS SIMILAR TO STYLE CE EXCEPT AS NOTED.
 USE CONCRETE BARRIER END ANCHOR WHEN NECESSARY.
 SHOWN WITH A 36 INCH ROADBED SURFACES OFFSET.
 BARRIER FOR OFFSET ROADWAYS.

* FOR SURFACES OFFSETS LESS THAN OR EQUAL TO 3 INCHES, NO ADDITIONAL REINFORCEMENT IS REQUIRED.

S SURFACE OFFSETS GREATER THAN 3 INCHES WILL REQUIRE ADDITIONAL REINFORCEMENT AS SHOWN.

THE LOWEST LAYER OF TWO #4 SHALL BE 3 INCHES ABOVE THE BOTTOM OF THE BARRIER. EACH VERTICAL INCREMENT OF 8 INCHES MEASURED FROM THE LOWEST LAYER OF REINFORCEMENT SHALL INCLUDE AN ADDITIONAL TWO #4.

■ REINFORCING STIRRUP NOT REQUIRED FOR ROADBED OFFSETS LESS THAN 1 FOOT.

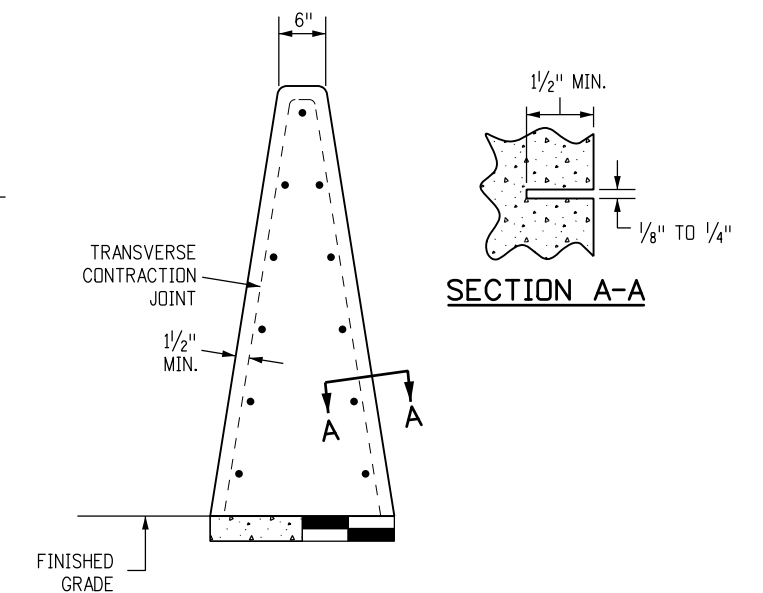


TRANSVERSE CONTRACTION JOINTS

FORMED OR SAWED TRANSVERSE CONTRACTION JOINTS ARE REQUIRED AT 20 FT. INTERVALS OR THE INTERVALS SHALL MATCH THE CONCRETE PAVEMENT JOINTS FOR INSTALLATIONS THAT ARE ON TOP OF THE CONCRETE ROADWAY PAVEMENT. SEE CONCRETE BARRIER STYLE CG FOR TYPICAL DIMENSIONS.

Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDDT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	GUARDRAIL TYPE 9 SINGLE SLOPE BARRIER		STANDARD PLAN NO.	
Creation Date: 07/31/19			Date:	Comments		M-606-15		Standard Sheet No. 4 of 11	
Designer Initials: JBK									
Last Modification Date: 07/31/19									
Detailer Initials: LTA									
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English								Issued by the Project Development Branch: July 31, 2019	
						Project Sheet Number:			


NOTES

1. SEE SHEET 3 FOR END ANCHORAGE REQUIREMENTS. AT A MINIMUM, THE BARRIER SHALL BE ANCHORED AT THE ENDS AND AT INTERRUPTIONS WITH THE 10 FOOT ANCHORAGE. ANCHORAGE SHALL BE MONOLITHIC OR DOWELED WITH 2-#8 X 8" @ 2'-0 BARS.
2. SEE SHEET 4 FOR CONCRETE BARRIER STYLE CG AND STYLE CGC.
3. SEE SHEET 9 FOR TRANSITION TO THRIE BEAMS.
4. TRANSITION TO EXISTING CONCRETE BARRIER INSTALLATIONS OF DISSIMILAR SHAPE SHALL BE ACCOMPLISHED IN ONE 15 FOOT LONG SEGMENT OF BARRIER.
5. SEE SHEET 6 FOR CONCRETE BARRIER STYLE CA TRANSITIONS AT BRIDGE COLUMNS AND SIGN PEDESTALS IN MEDIANS.
6. FOR STYLE CG CONNECTIONS TO STRUCTURES, SEE THE BRIDGE PLANS.

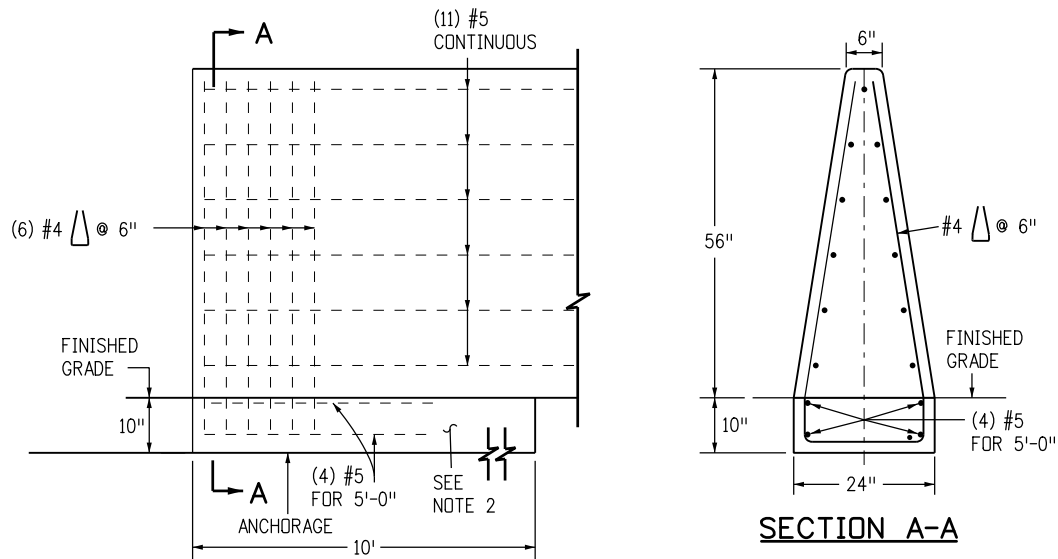


ANCHORAGE

BARRIER ELEVATION VIEW INCLUDING REINFORCED ANCHORAGE AT END.

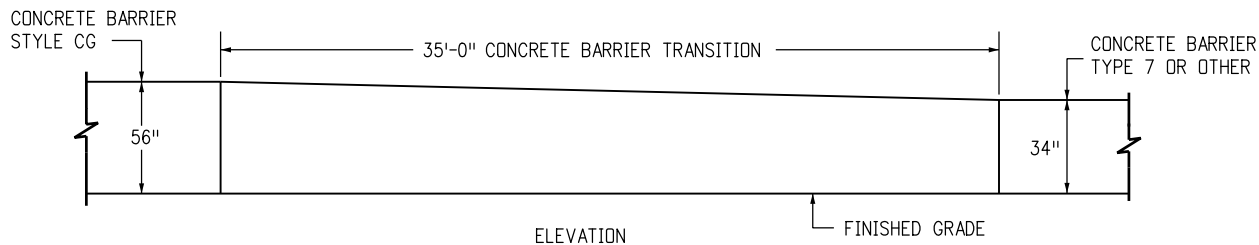


TRANSITION CONCRETE BARRIER STYLE CGE/CG TO CONCRETE BARRIER TYPE 7 OR EXISTING


Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	GUARDRAIL TYPE 9 SINGLE SLOPE BARRIER Issued by the Project Development Branch: July 31, 2019	STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-606-15
Designer Initials: JBK						Standard Sheet No. 5 of 11
Last Modification Date: 07/31/19						
Detailer Initials: LTA						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)					Project Sheet Number:

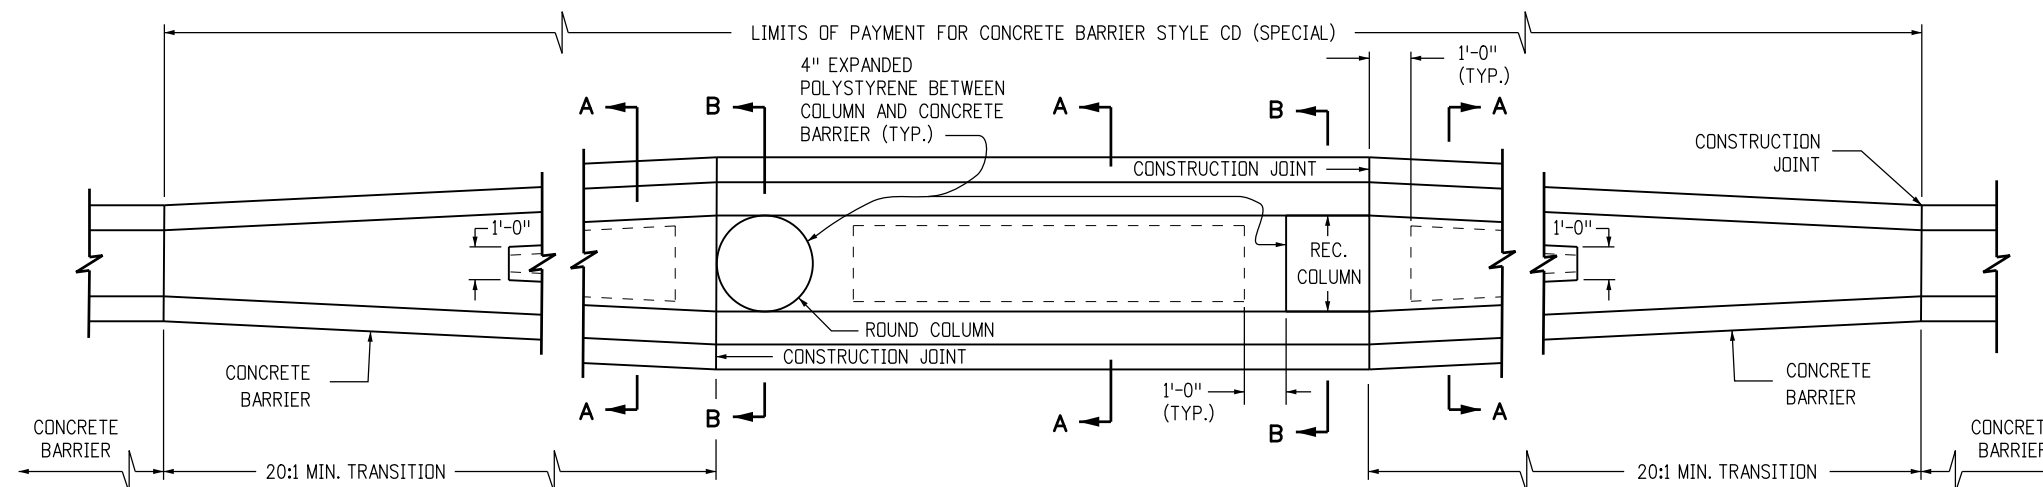


CONCRETE BARRIER TRANSITION AT BRIDGE COLUMNS

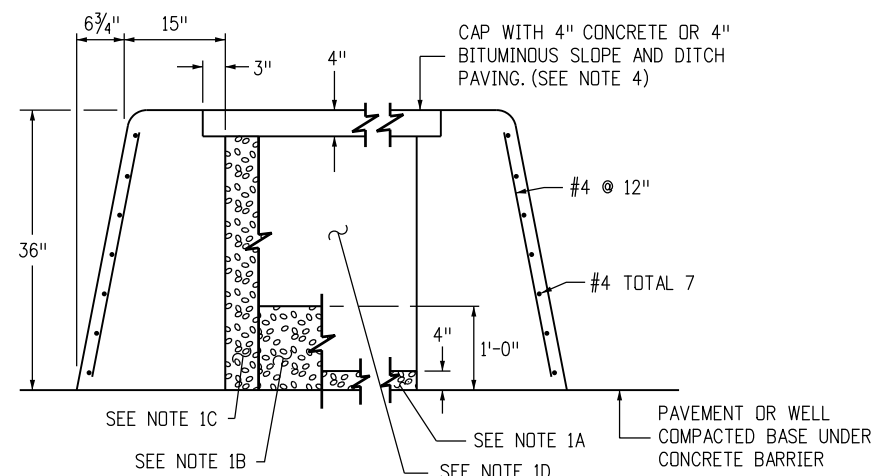


SECTION A-A

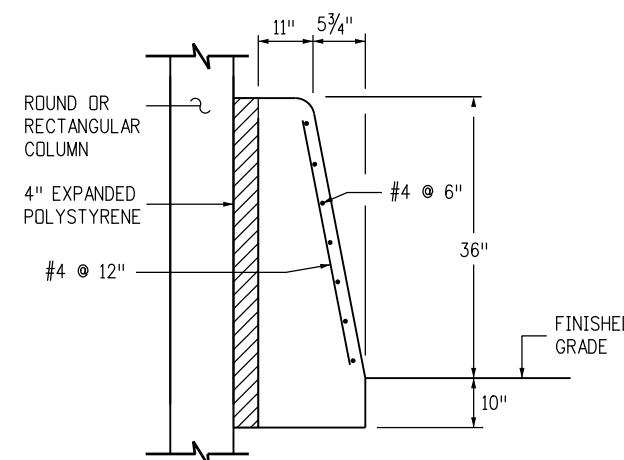

SECTION B-B

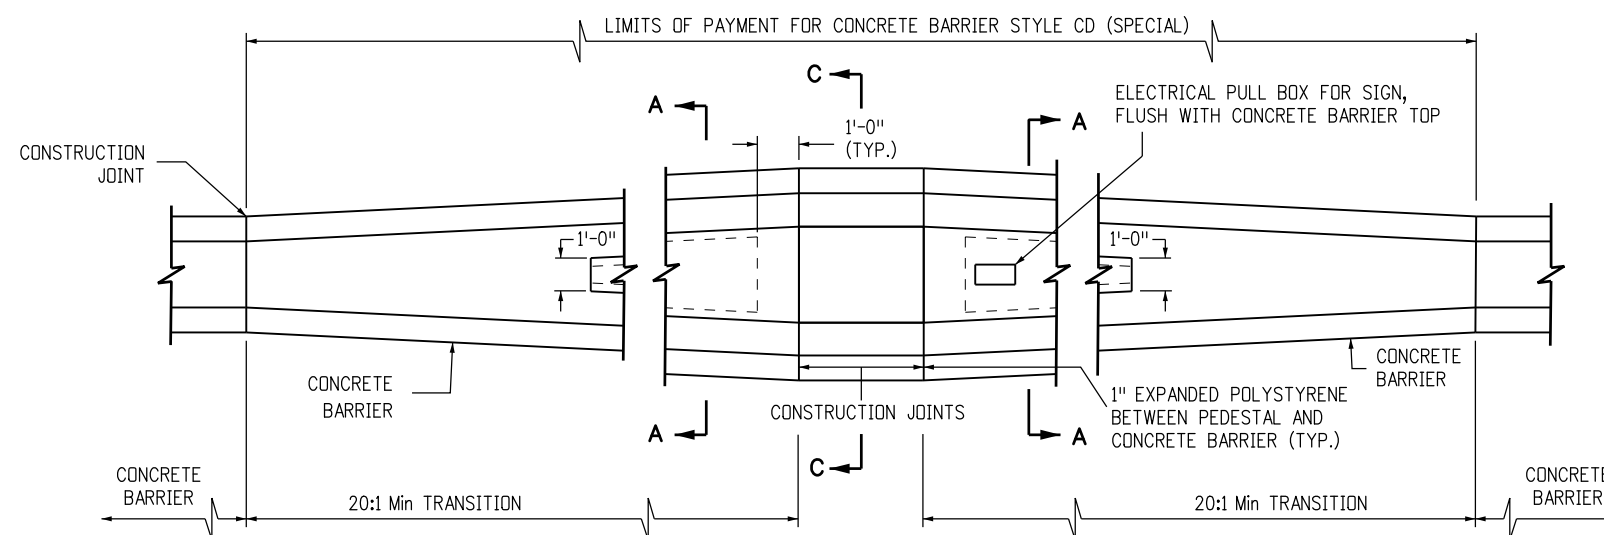

CONCRETE BARRIER TRANSITION AT SIGN PEDESTAL

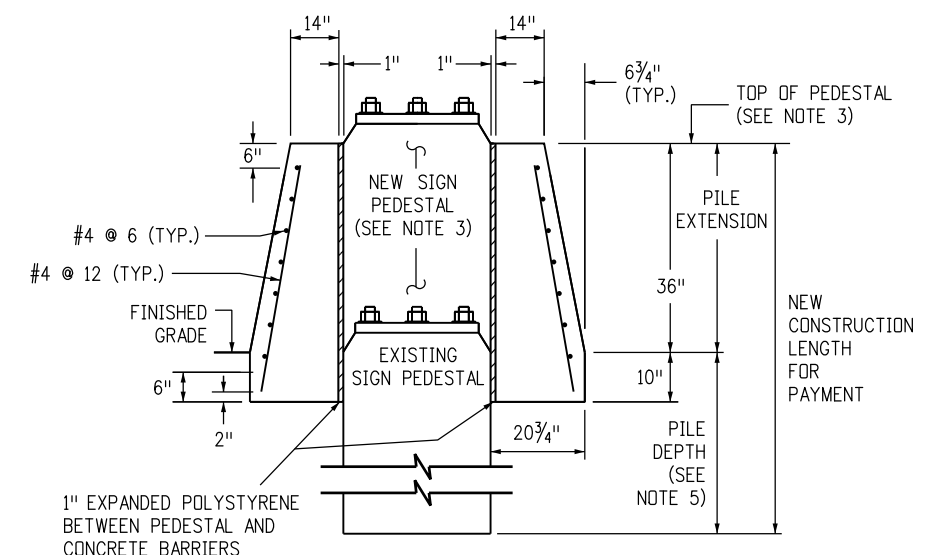


SECTION C-C


NOTES

1. THE CONTRACTOR'S OPTIONS FOR FILL BETWEEN CONCRETE BARRIER WALLS:
A. PLACE 4 INCHES OF POLYSTYRENE AT BASE BETWEEN CONCRETE BARRIER WALLS.
B. PLACE 1 FOOT OF GRANULAR MATERIAL AT BASE BETWEEN WALLS.
C. PLACE GRANULAR MATERIAL FROM BASE TO BOTTOM OF 4 INCH CAP.
D. MONOLITHIC CONCRETE WITH FOAM BLOCKOUTS IS NOT PERMITTED.
2. REINFORCING STEEL SHALL EXTEND CONTINUOUS THROUGH CONSTRUCTION JOINTS.
3. SEE OVERHEAD SIGN PLANS FOR SIGN PEDESTAL ELEVATIONS FOR NEW CONSTRUCTION.
4. ADJUST HEIGHT OF CONCRETE BARRIER WALL ON LOW SIDE OF OFFSET OR SUPERELEVATED ROADWAYS TO PROVIDE LEVEL GRADE ACROSS TOP OF CONCRETE BARRIER CAP.
5. FOR OVERHEAD SIGNS, SEE STANDARD PLAN S-614-60.


Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	GUARDRAIL TYPE 9 SINGLE SLOPE BARRIER	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-606-15	
Designer Initials: JBK	(R-X)					Standard Sheet No. 6 of 11	
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:	
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						

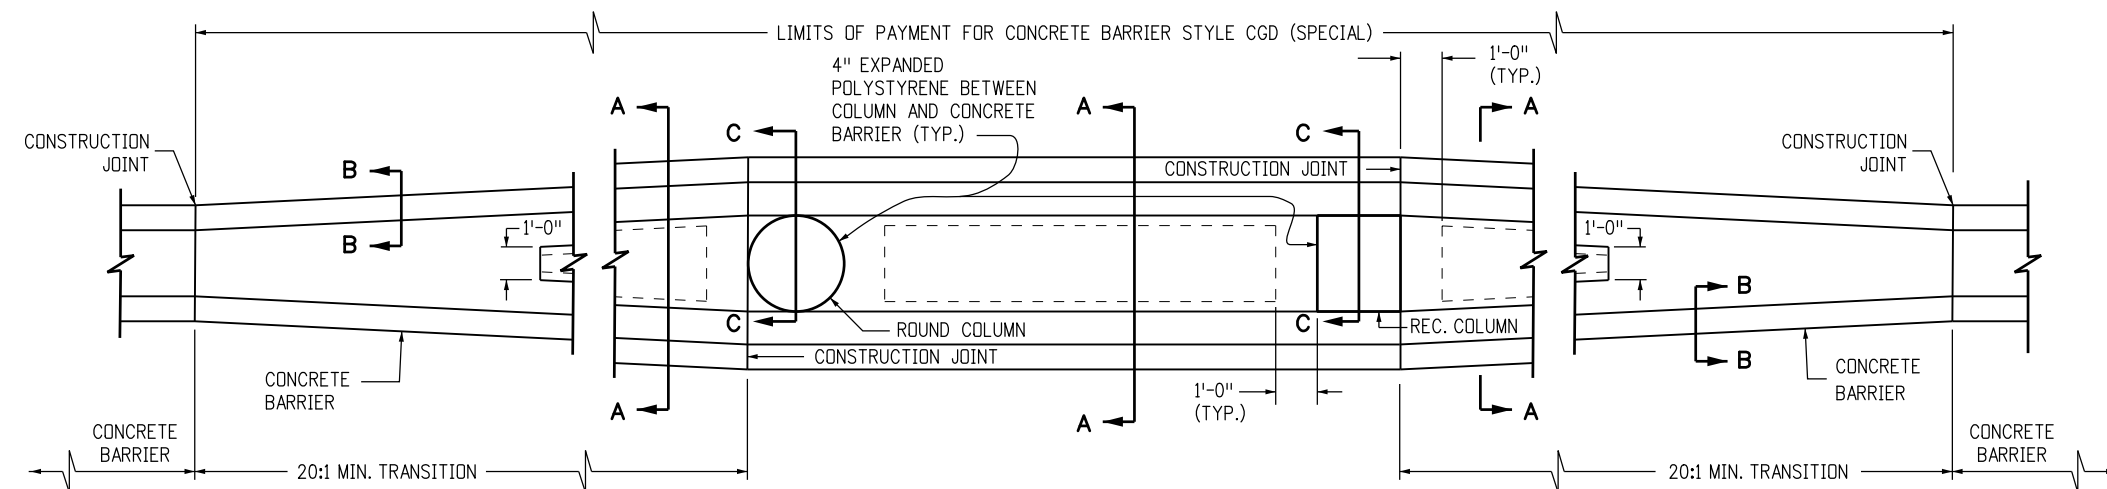


CONCRETE BARRIER TRANSITION AT BRIDGE COLUMNS

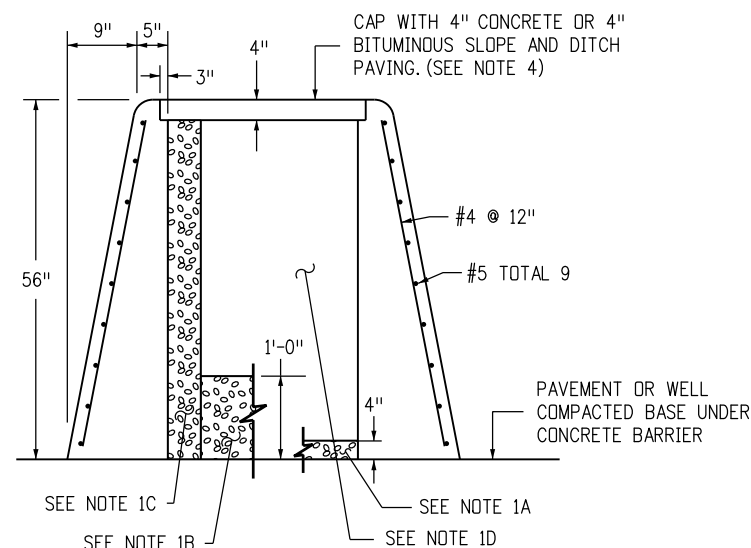


SECTION A-A

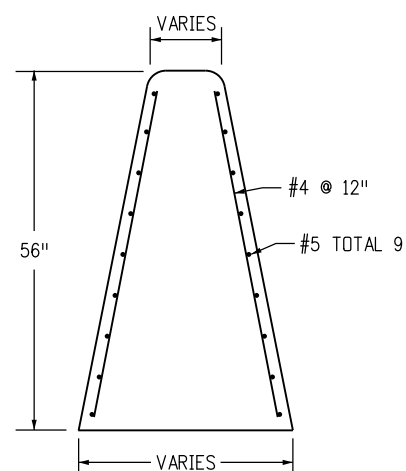

SECTION B-B

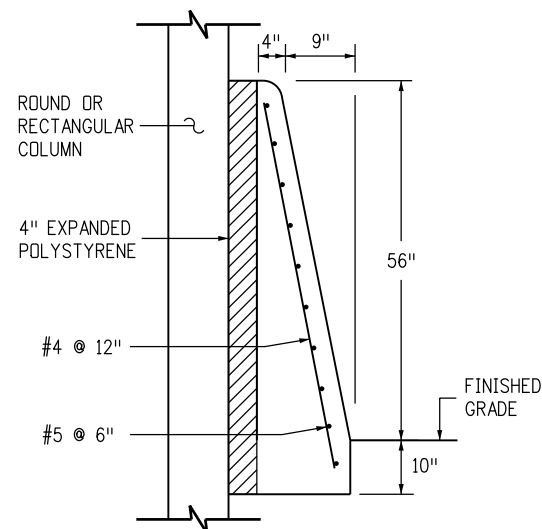


SECTION C-C

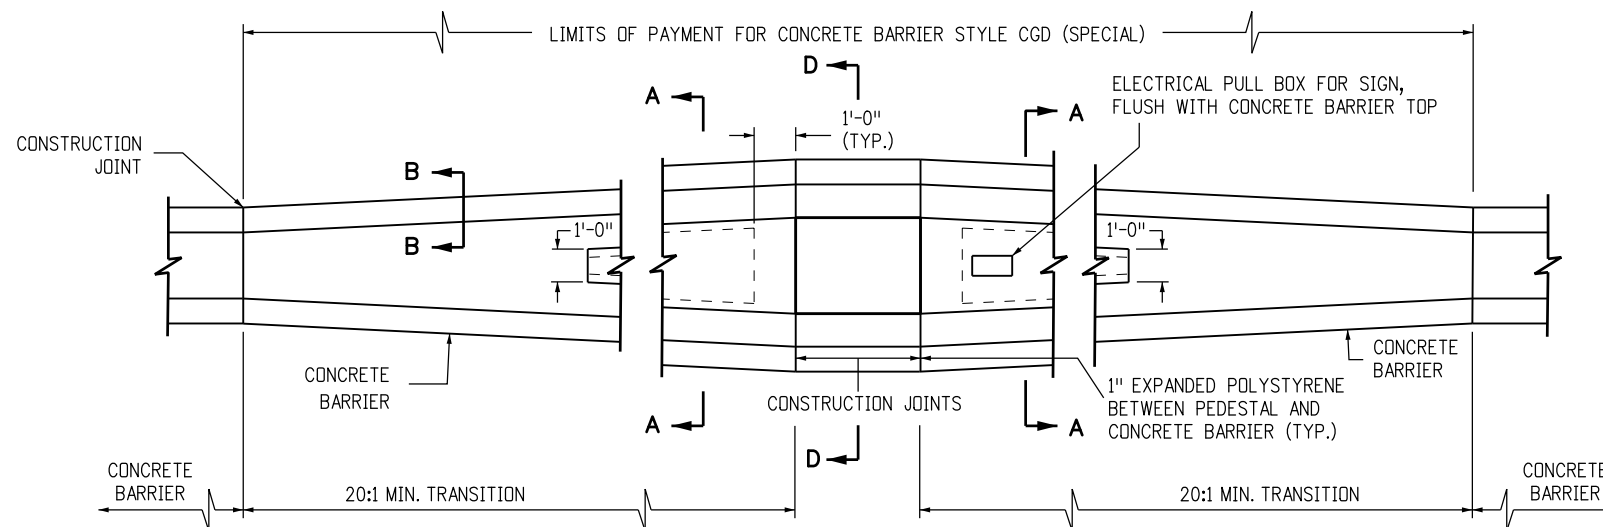

CONCRETE BARRIER TRANSITION AT SIGN PEDESTAL

NOTES

- THE CONTRACTOR'S OPTIONS FOR FILL BETWEEN CONCRETE BARRIER WALLS:
 - PLACE 4 INCHES OF POLYSTYRENE AT BASE BETWEEN CONCRETE BARRIER WALLS.
 - PLACE 1 FOOT OF GRANULAR MATERIAL AT BASE BETWEEN WALLS.
 - PLACE GRANULAR MATERIAL FROM BASE TO BOTTOM OF 4 INCH CAP.
 - MONOLITHIC CONCRETE WITH FOAM BLOCKOUTS IS NOT PERMITTED.
- REINFORCING STEEL SHALL EXTEND CONTINUOUS THROUGH CONSTRUCTION JOINTS.
- SEE OVERHEAD SIGN PLANS FOR SIGN PEDESTAL ELEVATIONS FOR NEW CONSTRUCTION.
- ADJUST HEIGHT OF CONCRETE BARRIER WALL ON LOW SIDE OF OFFSET OR SUPERELEVATED ROADWAYS TO PROVIDE LEVEL GRADE ACROSS TOP OF CONCRETE BARRIER CAP.
- FOR OVERHEAD SIGNS, SEE STANDARD PLAN S-614-60.

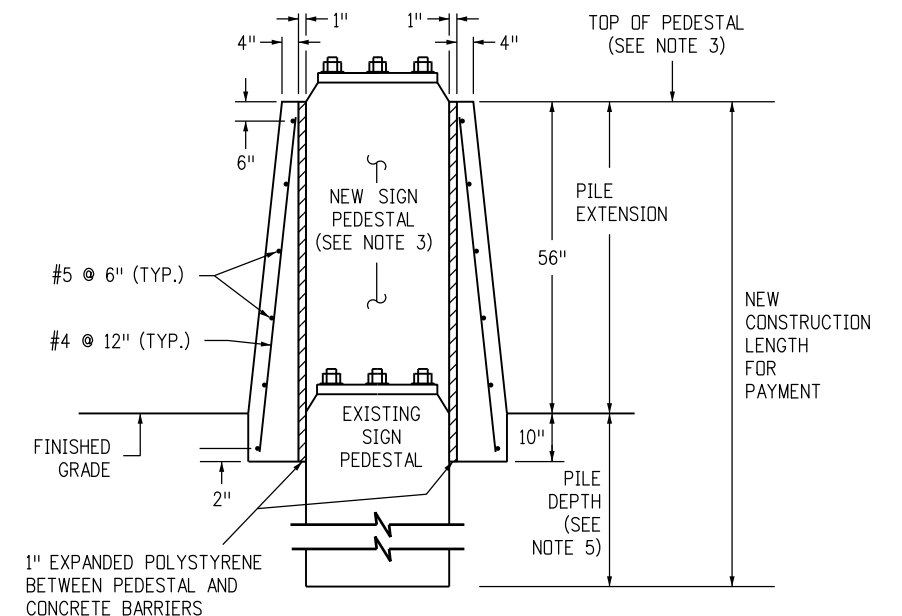

SECTION D-D

Computer File Information

Creation Date: 07/31/19
 Designer Initials: JBK
 Last Modification Date: 07/31/19
 Detailer Initials: LTA
 CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

Sheet Revisions

Date:	Comments
(R-X)	
(R-X)	
(R-X)	
(R-X)	

Colorado Department of Transportation



2829 West Howard Place
 CDOT HQ, 3rd Floor
 Denver, CO 80204
 Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch

JBK

GUARDRAIL TYPE 9 SINGLE SLOPE BARRIER




Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.

M-606-15


Standard Sheet No. 7 of 11

Project Sheet Number:

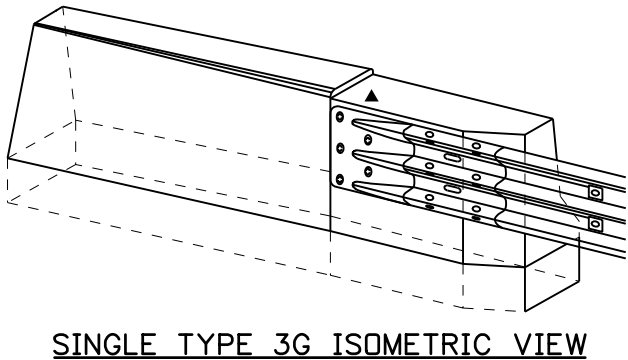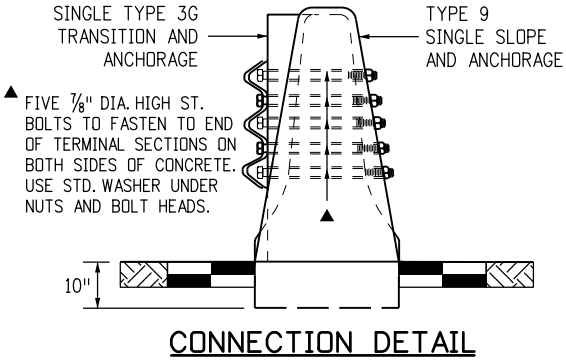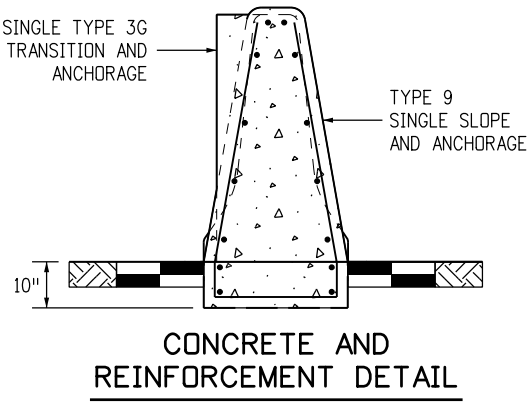


TYPE 9 TO SINGLE TYPE 3G TRANSITION AND ANCHORAGE OPTION
SEE SHEET 1 FOR REINFORCEMENT INFORMATION AND SHEET 3 FOR ANCHORAGE DETAILS

Computer File Information		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development BranchJBK	Sheet Revisions		GUARDRAIL TYPE 9 SINGLE SLOPE BARRIER Issued by the Project Development Branch: July 31, 2019	STANDARD PLAN NO.	
Creation Date: 07/31/19			Date:	Comments		M-606-15	
Designer Initials: JBK	(R-X)					Standard Sheet No. 8 of 11	
Last Modification Date: 07/31/19	(R-X)						
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						

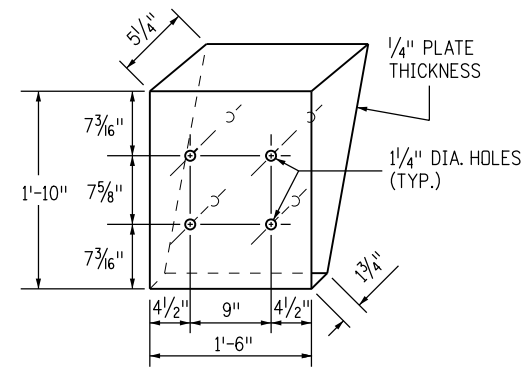

DETAIL A
BEVELED METAL BOX SPACE
(SEE NOTE 1)

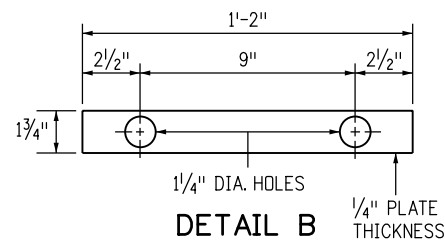


DETAIL B
PLATE A

LEGEND


- (A) NESTED THRIE BEAM ELEMENTS
(ONE 12 GAUGE ELEMENT NESTED
OVER ONE 10 GAUGE ELEMENT).
- (B) ONE 10 GAUGE THRIE BEAM
ELEMENT.
- (C) ONE 12 GAUGE THRIE BEAM
ELEMENT.
- 10 GAUGE = 0.135" THICK
- 12 GAUGE = 0.108" THICK

NOTES


- WHERE BEVELED METAL BOX SPACERS ARE INSTALLED,
PLACE A 1 1/4 INCH X 3/4 INCH AND A 1/4 INCH X 2 INCH
PIPE SPACERS ON 1 INCH HS BOLTS PASSING THROUGH
THE INTERIOR OF BOX.
- ALL METAL BOXES SHALL BE GALVANIZED.

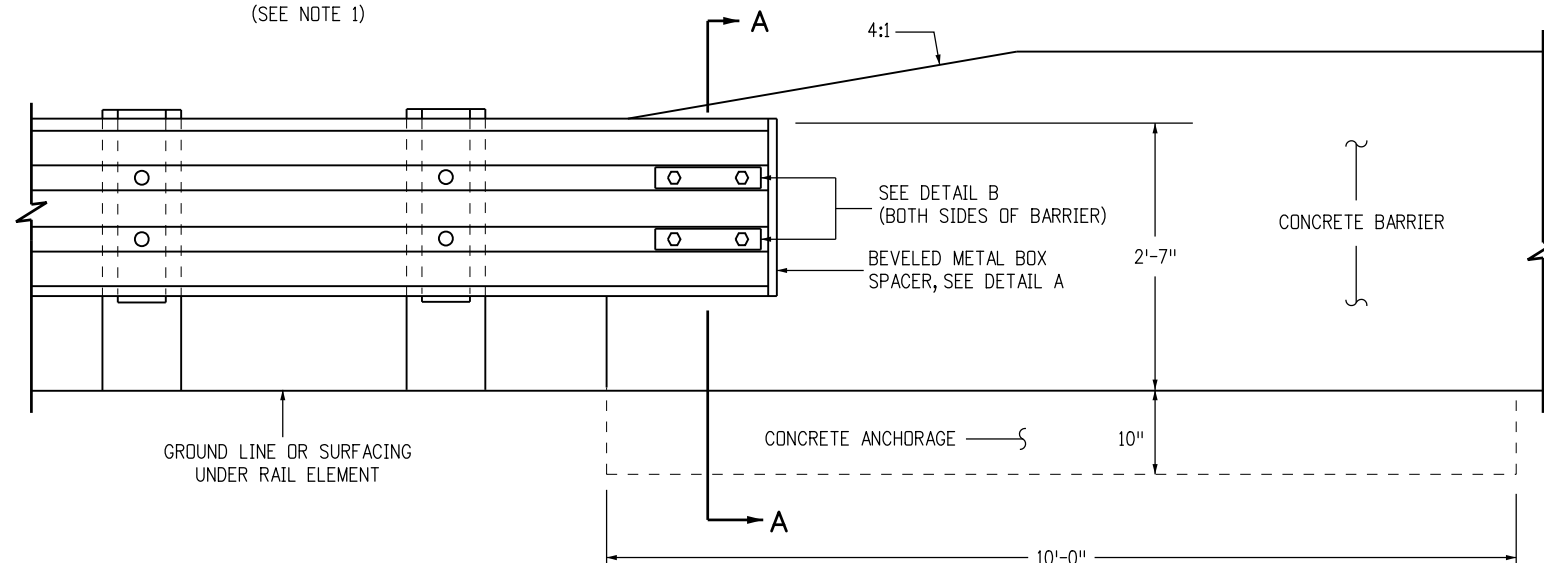

ELEVATION

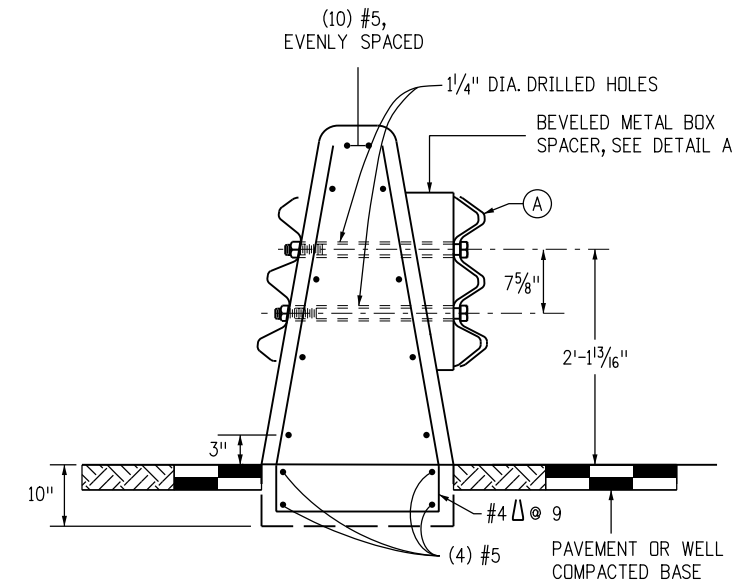


SECTION A-A

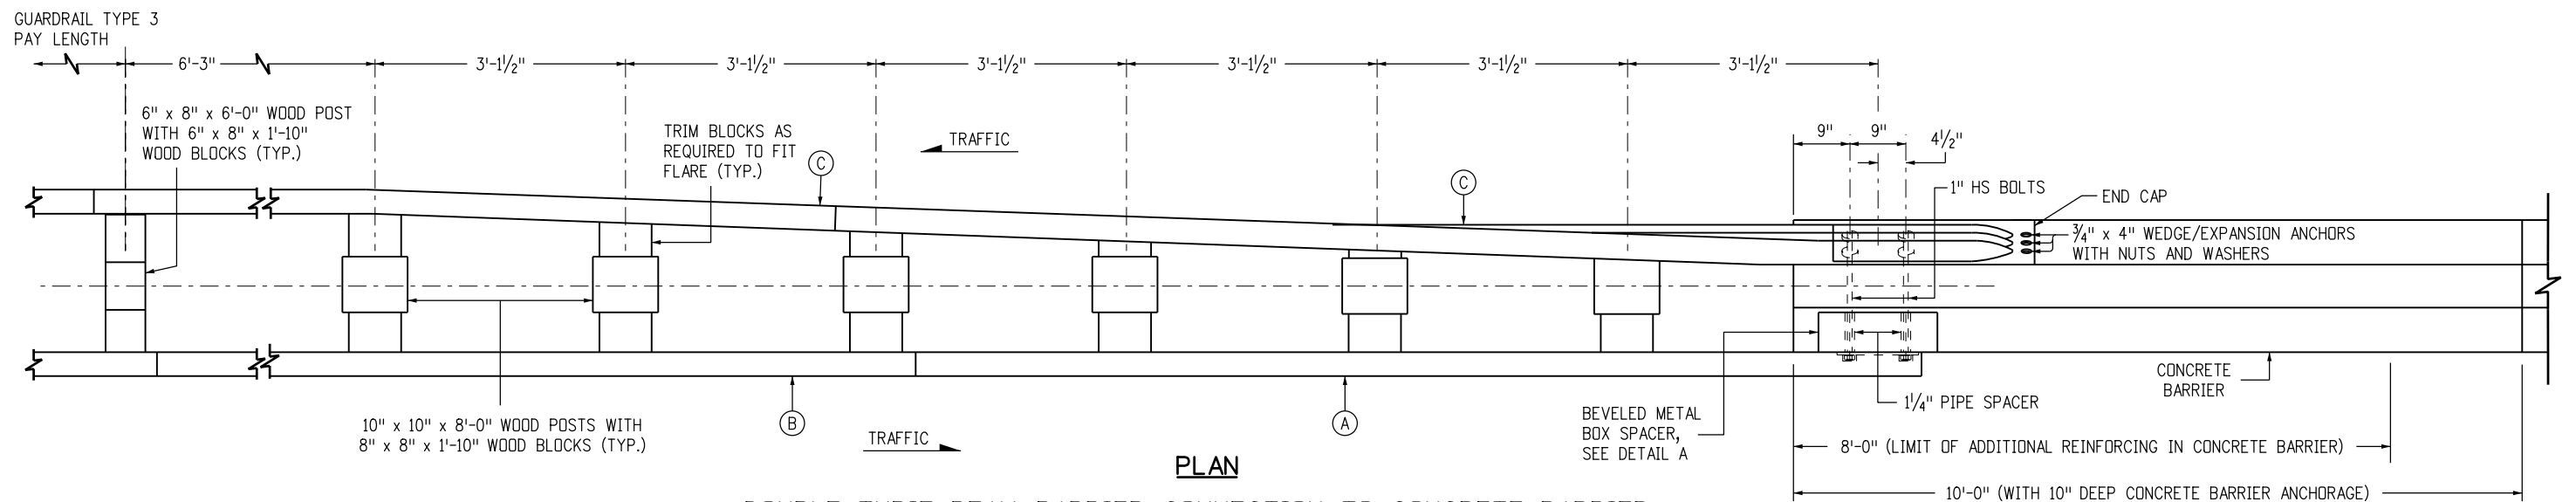


DOUBLE THRIE BEAM BARRIER CONNECTION TO CONCRETE BARRIER


Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	GUARDRAIL TYPE 9 SINGLE SLOPE BARRIER		STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)	Date:	Comments		M-606-15		Standard Sheet No. 9 of 11	
Designer Initials: JBK								
Last Modification Date: 07/31/19								
Detailer Initials: LTA								
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English				Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:		

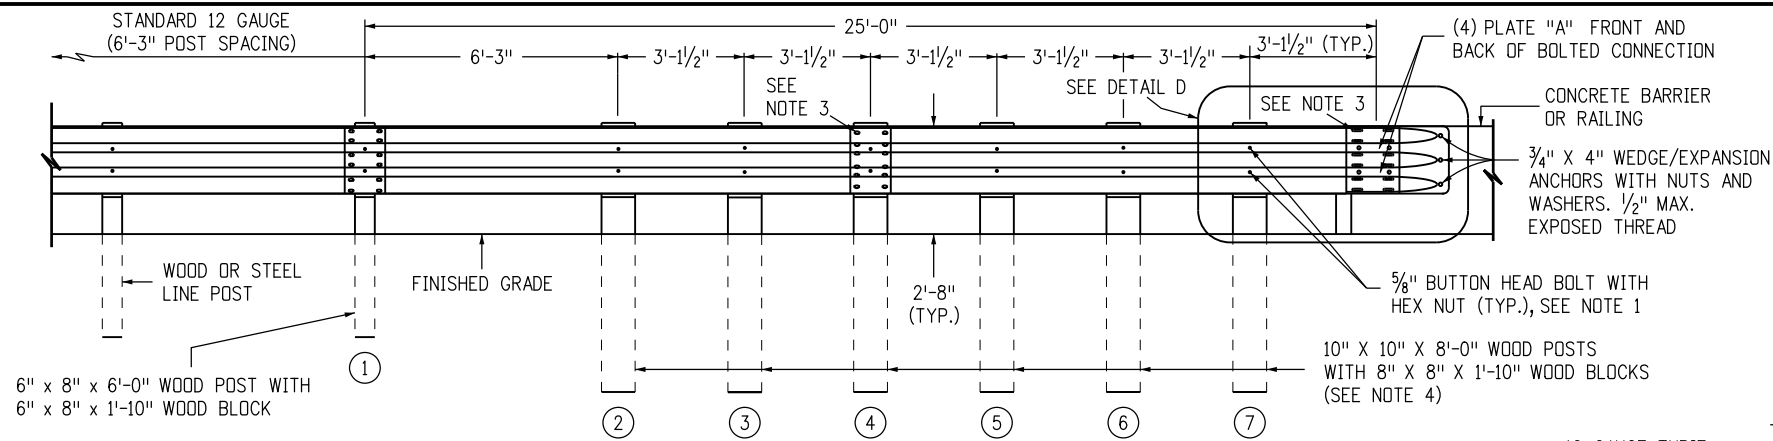


ELEVATION

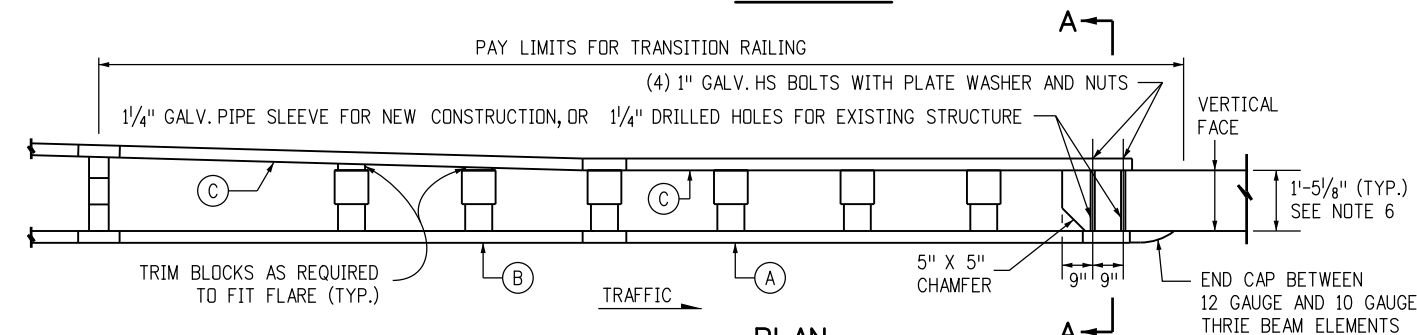

**PLAN
TRANSITION RAILING
WITHOUT BLOCKOUT ATTACHMENT**

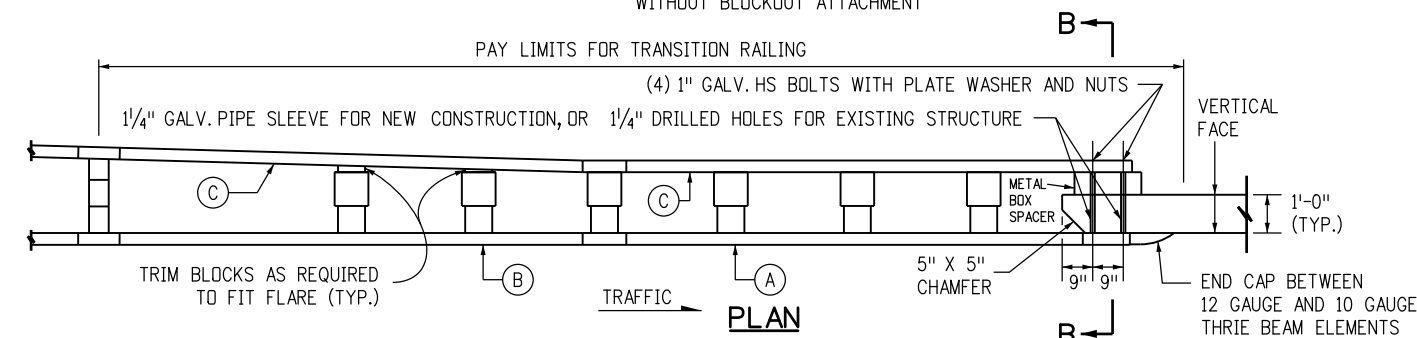


**PLAN
TRANSITION RAILING
WITH BLOCKOUT ATTACHMENT**

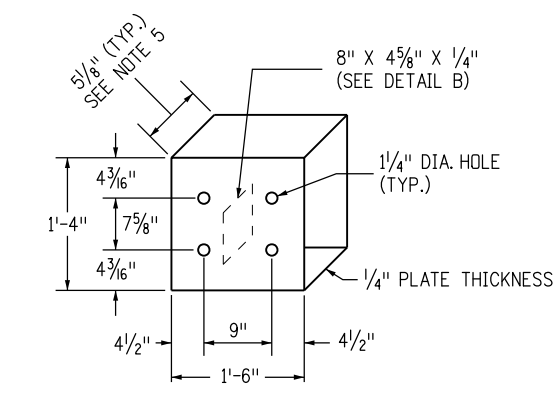


DETAIL A

PLACEMENT OF HOLES FOR FRONT AND BACK PANELS

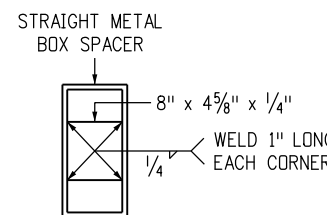


DETAIL B

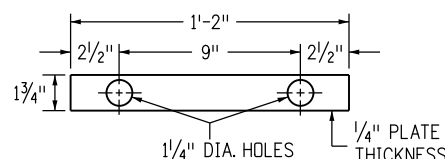


**PLATE "A"
DETAIL C**


STRAIGHT METAL BOX SPACER

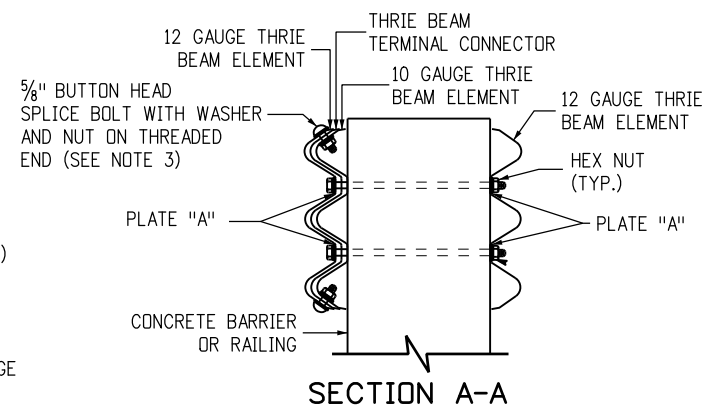

SECTION A-A

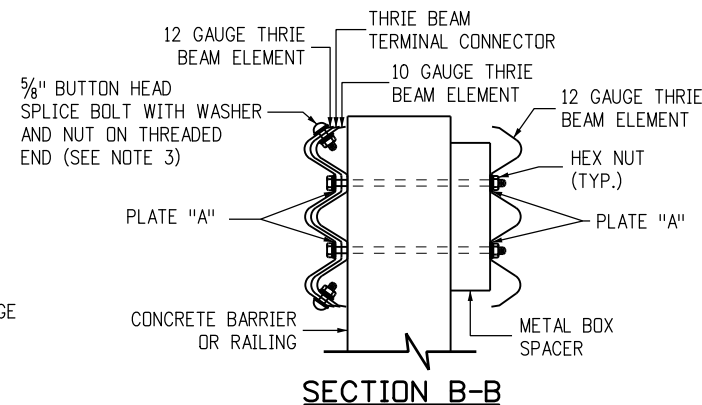

SECTION B-B

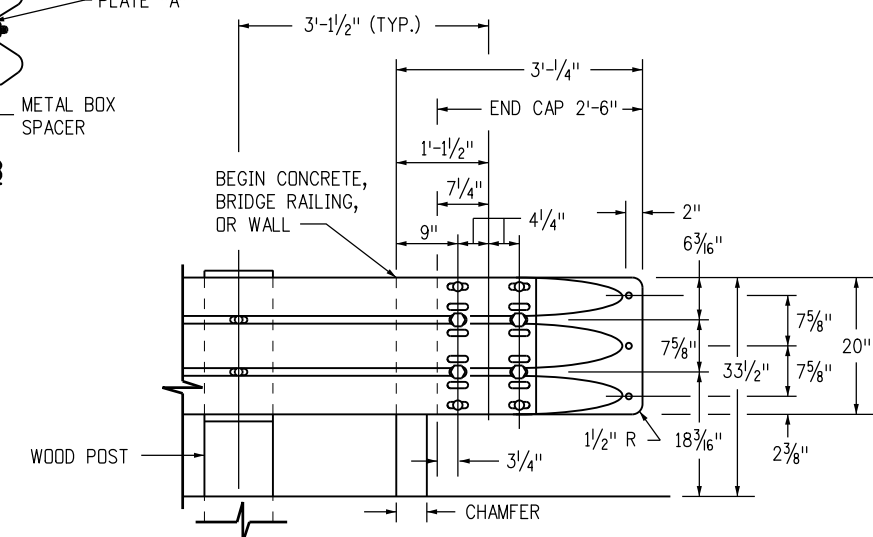

DETAIL D

SEE MANUFACTURER'S DETAILS FOR EXACT DIMENSIONS

LEGEND

- (A) NESTED THRIE BEAM ELEMENTS (ONE 12 GAUGE ELEMENT NESTED OVER ONE 10 GAUGE ELEMENT)
 - (B) ONE 10 GAUGE THRIE BEAM ELEMENT
 - (C) ONE 12 GAUGE THRIE BEAM ELEMENT
- 10 GAUGE = 0.135" THICK
12 GAUGE = 0.108" THICK

NOTES

1. USE 5/8" BUTTON HEAD BOLTS AND HEX NUTS FOR CONNECTIONS TO POSTS. NO WASHER ON RAIL FACE FOR BOLTED CONNECTIONS TO POST.
2. THE NESTED RAIL ELEMENTS, END CAP AND SINGLE 10 GAUGE THRIE BEAM ELEMENT, MAY BE SPLICED TOGETHER PRIOR TO BOLTING THE ELEMENTS TO THE WOOD POST AND CONCRETE BARRIER OR RAILING.
3. EXTERIOR SPLICE BOLT HOLES FOR RAIL ELEMENT SPLICES AT POST (4) AND THE CONNECTION TO THE CONCRETE BARRIER OR RAILING SHALL BE THE STANDARD 2 9/32" X 1 1/8" SLOT SIZE. INTERIOR SPLICE BOLT HOLES AT THESE LOCATIONS MAY BE INCREASED UP TO 1 1/4". ONLY THE TOP TWO AND THE BOTTOM TWO SPLICE BOLTS WITH WASHERS AND NUTS ARE REQUIRED FOR RAIL SPLICES AT POST (4) AND THE CONNECTION TO THE CONCRETE BARRIER OR RAILING.
4. THE TOP ELEVATION OF POSTS (1) THROUGH (7) SHALL NOT PROJECT MORE THAN 1 INCH ABOVE THE TOP ELEVATION OF THE RAIL ELEMENT.
5. THE DEPTH OF THE METAL BOX SPACER VARIES FROM THE 5/8" TO 1 1/2" AND IS DEPENDENT ON THE WIDTH OF THE CONCRETE RAILING OR WALL. THE COMBINED DIMENSION FOR THE DEPTH OF THE METAL BOX SPACER PLUS THE WIDTH OF RAILING OR WALL IS TYPICALLY 17 1/8". WHERE THE SPACE BETWEEN THE BACKSIDE OF THE CONCRETE RAILING OR WALL AND THE REAR THRIE BEAM ELEMENT IS LESS THAN 1 1/2", METAL PLATES SIMILAR TO PLATE "A" ARE BE USED AS SPACERS.
6. WHERE THE WIDTH OF THE CONCRETE RAILING OR WALL IS GREATER THAN 17 1/8", WOOD BLOCKS ARE TO BE USED TO FILL THE SPACE CREATED BETWEEN THE BACKSIDE OF POST (4) THROUGH NO. (7) AND THE REAR THRIE BEAM ELEMENT. THESE WOOD BLOCKS SHALL BE 8 INCHES IN WIDTH AND ONE FOOT-TWO INCHES IN LENGTH. THE DIMENSION BETWEEN THE FRONT THRIE BEAM ELEMENT AND THE REAR THRIE BEAM ELEMENT IS TO MATCH THE WIDTH OF THE CONCRETE RAILING OR WALL.

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

Sheet Revisions

Date:	Comments
(R-X)	
(R-X)	
(R-X)	
(R-X)	

Colorado Department of Transportation

2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch

JBK

**GUARDRAIL TYPE 9
SINGLE SLOPE BARRIER**


Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.


M-606-15

Standard Sheet No. 10 of 11

Project Sheet Number:

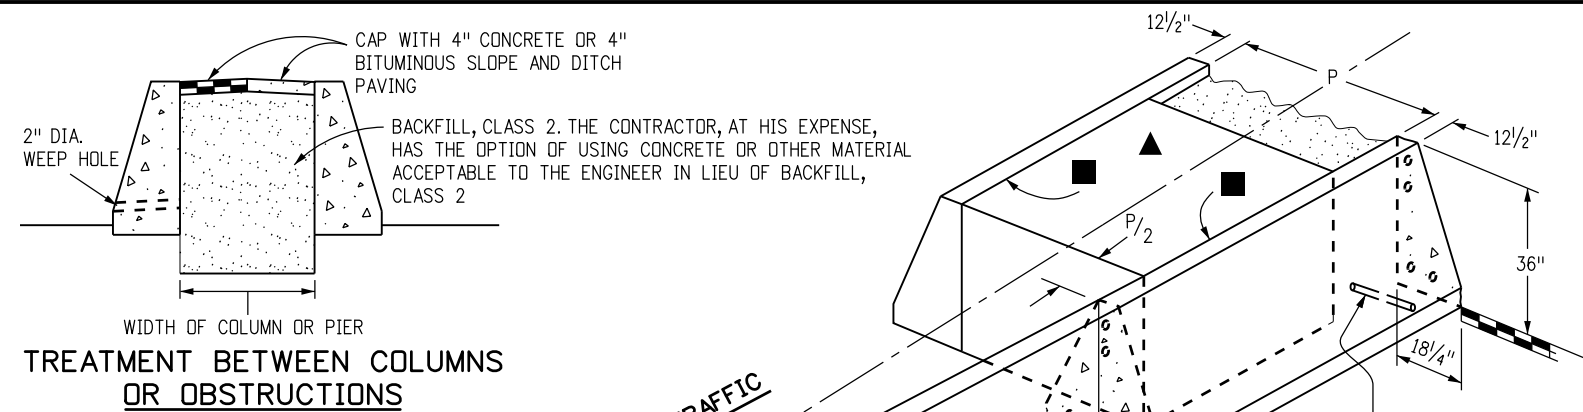


TREATMENT BETWEEN COLUMNS OR OBSTRUCTIONS

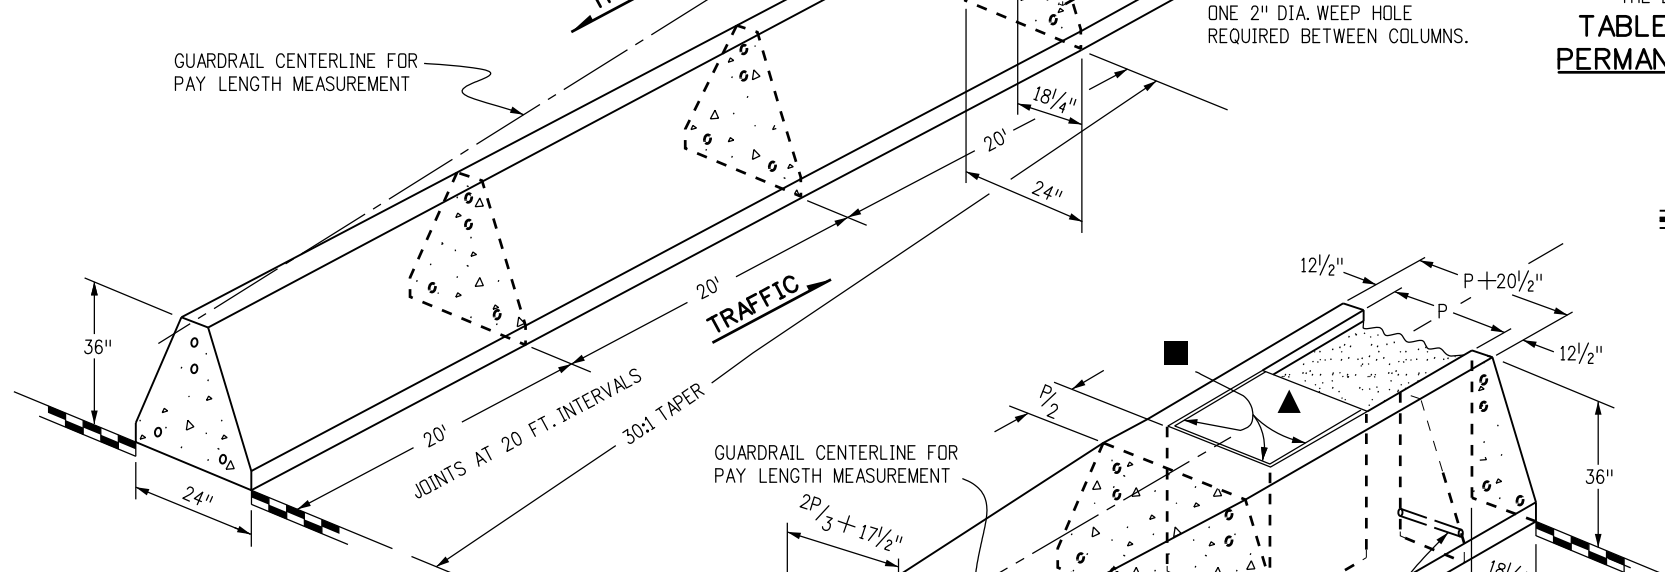

OBSTRUCTION WIDER THAN 3 FT.

- 1/2" PREFORMED JOINT MATERIAL
- PIER COLUMN, SIGN SUPPORT FOOTING, CONCRETE WALL, OR SIMILAR OBSTRUCTIONS.

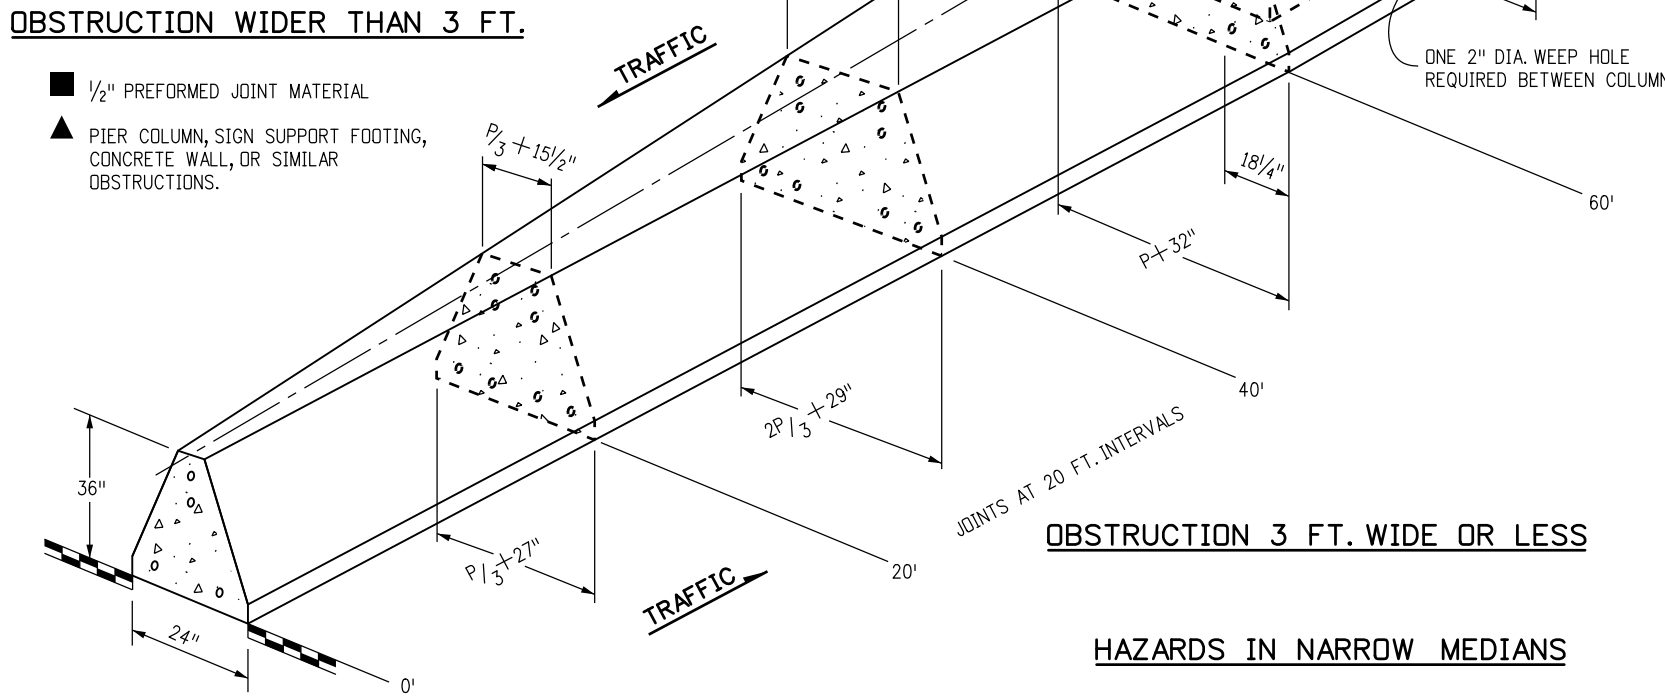

OBSTRUCTION 3 FT. WIDE OR LESS

HAZARDS IN NARROW MEDIANS


DESIGN SPEED (MPH)	SHY LINE OFFSET (FT.) *	FLARE RATE FOR BARRIER INSIDE SHY LINE	FLARE RATE FOR BARRIER OUTSIDE SHY LINE
80	12	30:1	20:1
75	10	30:1	20:1
70	9	30:1	20:1
60	8	26:1	18:1
55	7	24:1	16:1
50	6.5	21:1	14:1
45	6	18:1	12:1
40	5	16:1	10:1
30	4	13:1	8:1

* THE SHY LINE OFFSET IS MEASURED FROM THE EDGE OF THE TRAVELED WAY.


TABLE OF FLARE RATES FOR PERMANENT CONCRETE BARRIER

NOTES

- THE MEDIAN IN THESE APPLICATIONS SHALL BE PAVED ON A SLOPE CONTINUED FROM THE ADJACENT PAVED SHOULDER OR A 10:1 OR FLATTER SLOPE.
- THE PAY LENGTH FOR BARRIER ON BOTH SIDES OF AN OBSTRUCTION WILL BE DETERMINED BY ONE LINEAR MEASUREMENT ALONG THE GUARDRAIL CENTERLINE. THE BACKFILL AND CAP BETWEEN COLUMNS OR OBSTRUCTIONS WILL NOT BE MEASURED AND PAID FOR SEPARATELY BUT SHALL BE INCLUDED IN THE WORK.
- GUARDRAIL BETWEEN COLUMNS OR OBSTRUCTIONS MAY BE STYLES CA OR CD AS SHOWN ON THE PLANS.

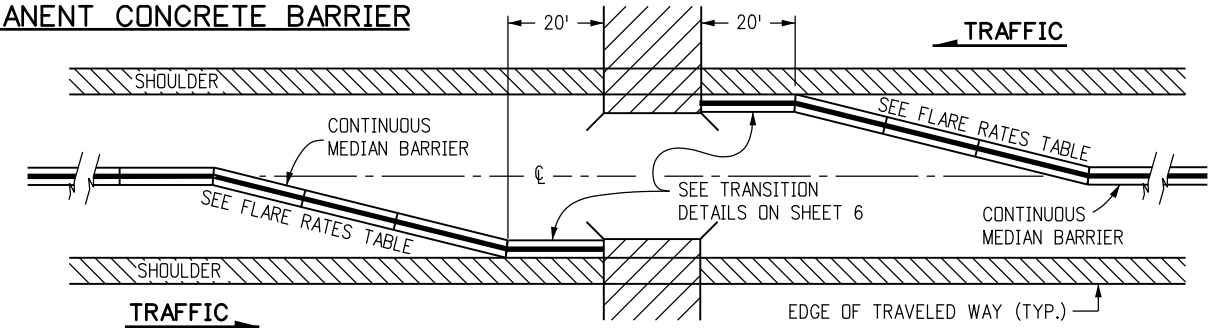


BRIDGE APPROACH

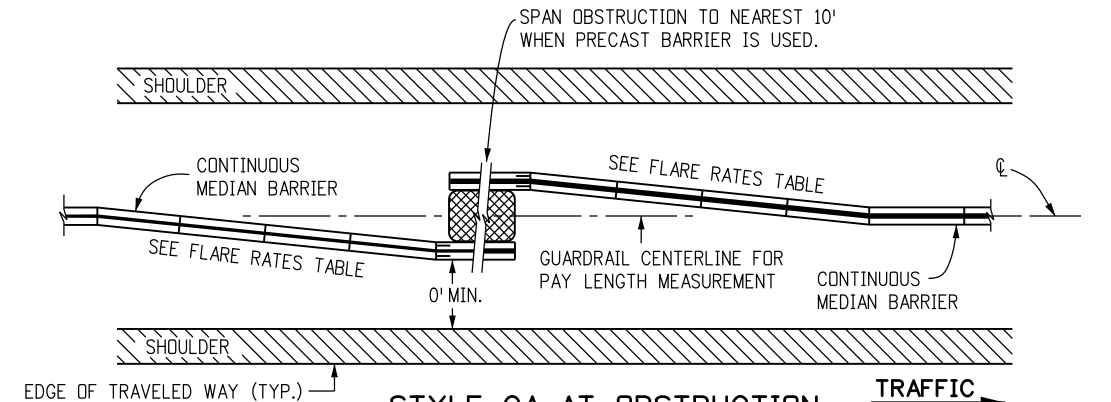

STYLE CA AT OBSTRUCTION

(OBSTRUCTION NOT SUITABLE FOR STYLE CD)

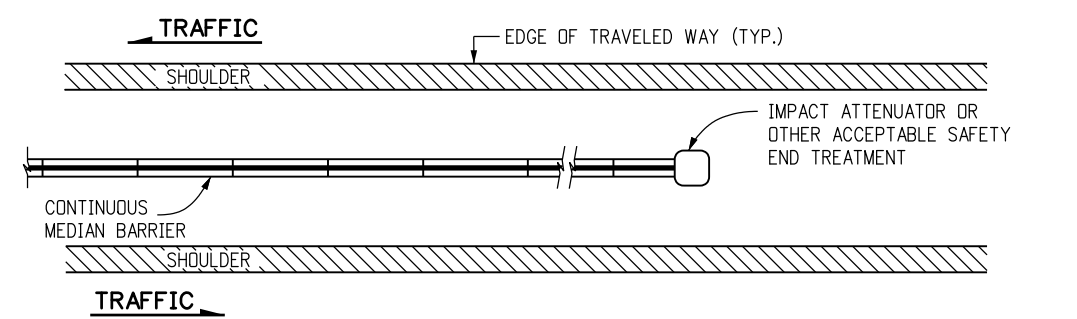

MEDIAN BARRIER END TREATMENT

Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch	GUARDRAIL TYPE 9 SINGLE SLOPE BARRIER Issued by the Project Development Branch: July 31, 2019	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-606-15	
Designer Initials: JBK	(R-X)					Standard Sheet No. 11 of 11	
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:	
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)			JBK			

GENERAL NOTES

1. ALL MATERIAL DIMENSIONS AND WEIGHTS ON THIS STANDARD ARE NOMINAL UNLESS OTHERWISE INDICATED.
2. AT EACH LOCATION WHERE AN ELECTRIC TRANSMISSION, DISTRIBUTION OR SECONDARY LINE CROSSES A WOOD POST FENCE, THE CONTRACTOR SHALL FURNISH AND INSTALL A GROUND CONFORMING TO ARTICLE 250 OF THE NATIONAL ELECTRICAL CODE. THE GROUND ROD SHALL BE A MINIMUM DIAMETER OF 1/2 IN. AND 8 FT. IN LENGTH, AND DRIVEN AT LEAST 7 1/2 FT. INTO THE GROUND. THE ROD SHALL BE CONNECTED TO EACH WIRE WITH A MINIMUM AWG NO. 8 STRANDED COPPER WIRE. GROUNDING WILL NOT BE PAID FOR SEPARATELY BUT SHALL BE INCLUDED IN THE WORK.

A METAL LINE POST SHALL BE INSTALLED A MAXIMUM OF EVERY 500 FT. ALONG A WOOD POST FENCE. THE METAL POST SHALL BE WITHIN 1 FT. OF THE NEAREST WOOD POST, AND SHALL BE TIED TO EACH STRAND WITH A WIRE CLAMP.
3. DIMENSIONS SHOWN FOR "STANDARD" AND "ALTERNATIVE" APPLY FOR BOTH WOOD AND METAL POST FENCE.
4. FENCE WIRE SHALL BE ENDED, DOUBLE WRAPPED AND TIED OFF AT END POSTS, ANGLE POSTS AND LINE BRACE POSTS. FENCE TO BE CONTINUED SHALL THEN BE RESTARTED IN THE SAME MANNER.
5. FENCE WIRE SHALL BE PLACED ON EITHER ROAD OR FIELD SIDE OF POSTS, DEPENDING ON LOCAL CONDITIONS, i.e. ON CURVES, THE WIRE SHALL BE PLACED ON THE SIDE OF THE POST WHICH WILL RESULT IN THE LEAST TENSION ON FENCE TIES. THIS WILL ALSO APPLY WHERE WIND DRIFT, TUMBLE WEEDS OR OTHER CONDITIONS WOULD EXERT UNUSUAL PRESSURE AGAINST THE WIRE. WHERE POSSIBLE, WIRE SHOULD BE PLACED ON THE LIVESTOCK SIDE OF THE POSTS.
6. WHERE STEEL POSTS ARE SPECIFIED, EVERY FIFTH POST SHALL BE WOOD, WHEN SPECIFIED ON THE PLANS.
7. RIGHT OF WAY FENCES SHALL BE CONSTRUCTED APPROXIMATELY 6 IN. INSIDE THE BOUNDARY OF THE RIGHT OF WAY AS SHOWN ON THE PLANS, OR AS STAKED.
8. THE CONTRACTOR SHALL BE RESPONSIBLE FOR RE-ESTABLISHING DISTURBED OR DESTROYED SURVEY MONUMENTS TO THE APPROPRIATE ACCURACY IN ACCORDANCE WITH SUBSECTION 625.08 OF THE STANDARD SPECIFICATIONS.

WOOD POSTS:

ALL LINE POSTS SHALL HAVE A MINIMUM DIAMETER OF 4 IN. AND BE A MINIMUM OF 6 FT.-0 IN. LONG.

ALL END, CORNER, INTERSECTION AND BRACE POSTS SHALL HAVE A MINIMUM DIAMETER OF 5 IN. AND BE 7 FT. IN LENGTH.

WOOD POSTS HAVING NONUNIFORM CROSS SECTION SHALL BE SET WITH THE LARGER DIAMETER END IN THE GROUND.

FENCE WIRE SHALL BE STAPLED TO WOOD POSTS OR TIED TO METAL POSTS AS SHOWN MARKED **✚** ON BARBED WIRE OR COMBINATION WIRE FENCE DETAILS. STAPLES SHALL BE NO. 9 WIRE MINIMUM, AND AT LEAST 1 1/2 IN. LONG.

METAL POSTS:

ALL POSTS AND BRACES SHALL BE THE TYPES AND WEIGHTS SHOWN OR ACCEPTABLE EQUIVALENTS, AND SHALL BE IN ACCORDANCE WITH AASHTO M 281. HOLES SHALL BE PROVIDED IN END, CORNER, AND GATE POSTS AS DETAILED.

CORNER AND LINE BRACE POSTS:

TYPE: 2 1/2 IN. x 2 1/2 IN. x 1/4 IN. STRUCTURAL STEEL ANGLES
WEIGHT: 4.10 LBS./LIN. FT.
LENGTH: 6 FT.-6 IN. MIN.
NUMBER OF BRACES: TWO

LINE POSTS:

TYPE: "STUDDED TEE" OR "U"
WEIGHT: 1.33 LBS./LIN. FT. (WITHOUT ANCHOR)
LENGTH: 6 FT.-0 IN. MINIMUM
ANCHOR: SECURELY FASTENED, WITH BEARING SURFACE SUFFICIENT TO RESIST MOVEMENT OF POST. WEIGHT: 0.67 LB.

METAL END POSTS AND GATE POSTS:

TYPE: 2 1/2 IN. x 2 1/2 IN. x 1/4 IN. STRUCTURAL STEEL ANGLES
WEIGHT: 4.10 LBS./LIN. FT.
NUMBER OF BRACES: ONE
LENGTH: END, 6 FT.-6 IN. MINIMUM. PANEL GATE, 7 FT.-0 IN. MINIMUM.

BRACES: (FOR CORNER, END OR LINE BRACE POSTS)

TYPE: 2 IN. x 2 IN. x 1/4 IN. STRUCTURAL STEEL ANGLES
WEIGHT: 3.19 LBS./LIN. FT.
LENGTH: SAME AS CORNER AND END POSTS USED.

FOOTINGS OR BASES:

CONCRETE SHALL BE CLASS B.
CONCRETE WITH LIGHTWEIGHT AGGREGATES CONFORMING TO AASHTO M 195 (ASTM C 330) WILL BE PERMITTED.

ALTERNATIVES: (CONTRACTOR'S OPTION)

TYPE	I.D.	O.D.	WEIGHT	WALL THICKNESS
	INCHES	INCHES	LB/FT.	INCHES
1. STD. GALV. PIPE	2 1/2	2 7/8	5.79 ± 5%	0.203
2. H.S. COLD ROLLED PIPE	2 1/2	2 7/8 ± 0.16	4.64 ± 5%	0.160 ± 5%

LENGTHS SHALL BE 6 FT.-6 IN. MINIMUM

BRACES:

TYPE: 1 3/8 IN. O.D. TUBULAR STEEL WITH 2 1/2 IN. BRACE BAND, HINGE BOLT AND 1 3/8 IN. I.D. RAIL END; ALL GALVANIZED.
WEIGHT: 16 LBS/LIN. FT. ± 5%
LENGTH: 6 FT.-6 IN. MINIMUM.

BARBED WIRE:

ZINC-COATED STEEL BARBED WIRE SHALL CONFORM TO AASHTO M 280, (ASTM A 121), 12-1/2 GAGE WITH CLASS 1 COATING, OR ALUMINUM-COATED STEEL BARBED WIRE CONFORMING TO ASTM A 585 TYPE 1.

WOVEN WIRE MESH:

WOVEN WIRE USED IN COMBINATION WIRE FENCE SHALL BE GALVANIZED AND CONFORM TO AASHTO M 279, (ASTM A 116) COATING CLASS 1, AND THE FOLLOWING:

STANDARD	WOVEN WIRE FIELD FENCE, STYLE OR DESIGN NO.	ALTERNATIVE 4 IN. X 4 IN. WIRE "V" MESH
832-6-11*	32 IN. WIDTH 0.65 LBS/LIN.FT.	34 IN. WIDTH - 0.75 LBS/LIN.FT.
726-6-11*	26 IN. WIDTH 0.55 LBS/LIN.FT.	26 IN. WIDTH - 0.54 LBS/LIN.FT.
		CROSS WIRES-1 STRAND-14-1/2 GAGE MIN. HORIZONTAL-2 STRAND-12-1/2 GAGE

* 12-1/2 GAGE WOVEN WIRE FENCE FABRIC (832-6-12-1/2 OR 726-6-12-1/2) MAY BE USED WHEN SPECIFIED IN THE CONTRACT.

ALL FENCE WIRE TIES, CLIPS, CLAMPS, STAPLES AND OTHER WIRE APPURTENANCES SHALL BE GALVANIZED IN ACCORDANCE WITH AASHTO M 232.

DRIVEWAY GATES (SINGLE):

HEIGHT: 42 IN.
WEIGHT: NOT LESS THAN 90 LBS. COMPLETE WITH LATCH AND HINGES.
WIDTH OF GATE OPENING: 16 FT.-0 IN. MINIMUM TO 20 FT.-0 IN. MAXIMUM.
GATE FRAME: 1 IN. I.D. STANDARD GALVANIZED PIPE OR ACCEPTABLE EQUIVALENT AND SHALL BE OF ALL WELDED CONSTRUCTION.

WOVEN WIRE SHALL ENCLOSE THE GATE FRAME AS SHOWN AND SHALL BE THE SAME WOVEN WIRE DESIGN AS THE FENCE, OR AS APPROVED BY THE ENGINEER.

ALTERNATIVE DRIVEWAY GATES (SINGLE PANEL):

WEIGHT: GALVANIZED STEEL, 75 LBS.
HEIGHT: APPROXIMATELY 42 IN. (5 PANELS),
WIDTH OF GATE OPENING: 16 FT.-0 IN. MINIMUM TO 20 FT.-0 IN. MAXIMUM.

GATES SHALL BE OF RIVETED CONSTRUCTION AS FOLLOWS:
MINIMUM FOUR NO. 10 RIVETS AT EACH RIGHT ANGLE CONNECTION AND WHERE DIAGONAL BRACES CONNECT TO HORIZONTAL PANELS.

MINIMUM THREE NO. 10 RIVETS WHERE DIAGONAL BRACES CONNECT TO TOP AND BOTTOM PANELS.

WALK GATES:

HEIGHT: APPROXIMATELY 42 IN. (5 PANELS)
WEIGHT: GALVANIZED STEEL, 16 LBS.; TEMPERED ALUMINUM, 10 LBS.
WIDTH OF GATE OPENING: 3 FT.-0 IN. MINIMUM.

ALTERNATIVE WALK GATES:

HEIGHT: 42 IN.
WEIGHT: NOT LESS THAN 18 LBS. COMPLETE WITH LATCH AND HINGES.

WIDTH OF GATE OPENING: 3 FT.-0 IN. MINIMUM.
GATE FRAME: 3/4 IN. I.D. STANDARD GALVANIZED PIPE OR ACCEPTABLE EQUIVALENT AND SHALL BE OF ALL-WELDED CONSTRUCTION.

WOVEN WIRE SHALL BE OF THE SAME CONSTRUCTION DESIGNATED FOR DRIVEWAY GATE.

ALTERNATIVE EQUIVALENT STANDARD METAL GATES OTHER THAN SHOWN WILL BE ACCEPTABLE SUBJECT TO THE ENGINEER'S APPROVAL.

IN LIEU OF GALVANIZED FINISH ON GATE FRAMES, CADMIUM-PLATED PIPE OR ALUMINUM PAINTING WILL BE ACCEPTED.

LATCHES AND HINGES:

GALVANIZED STEEL OR ALUMINUM OF STANDARD MANUFACTURE. HINGES SHALL BE PLACED AS SHOWN TO PREVENT THEFT.










IN LIEU OF STANDARD MAKE LATCHES, THE CONTRACTOR MAY USE AN ELECTRO-GALVANIZED CHAIN, EYEBOLT AND SNAPHOOK TYPE LATCH.

EYEBOLT, CHAIN AND SNAPHOOK ASSEMBLY SHALL BE SECURED TO LATCH SIDE OF GATE. GATE CLOSURE MAY BE ACCOMPLISHED BY WRAPPING CHAIN AROUND END POST AND SNAPPING HOOK INTO CHAIN.

WOOD STAYS:

WOOD STAYS SHALL BE UNTREATED NATIVE TIMBER. STAY DIMENSIONS SHALL BE 2 IN. x 2 IN. NOMINAL MINIMUM (1 1/2 IN. x 1 1/2 IN.). WOOD STAYS MAY BE STAPLED, OR DRILLED AND TIED WITH WIRE. METAL STAYS MAY BE TIED TO THE BOTTOM WIRE.

Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development BranchJBK	WIRE FENCES AND GATES	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)	Date:	Comments			M-607-1	
Designer Initials: JBK						Standard Sheet No. 1 of 3	
Last Modification Date: 07/31/19							
Detailer Initials: LTA							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English					Issued by the Project Development Branch: July 31, 2019	Project Sheet Number:	

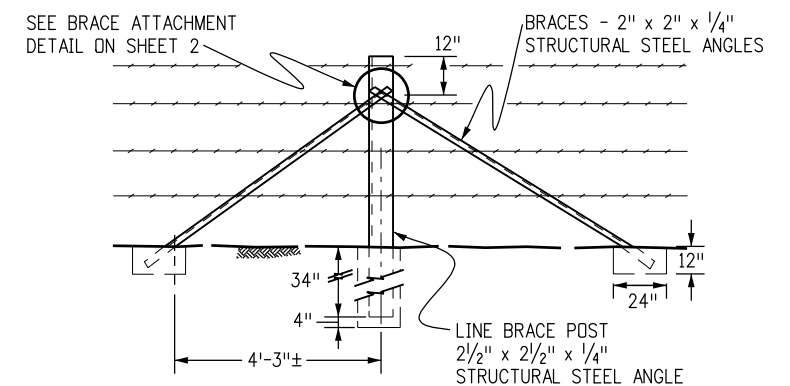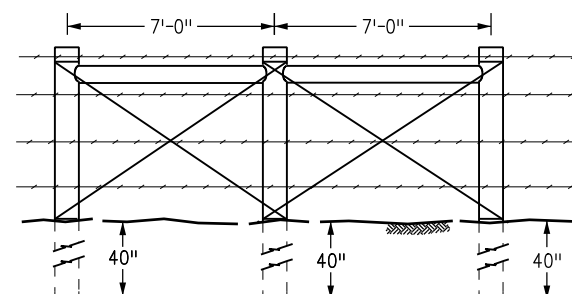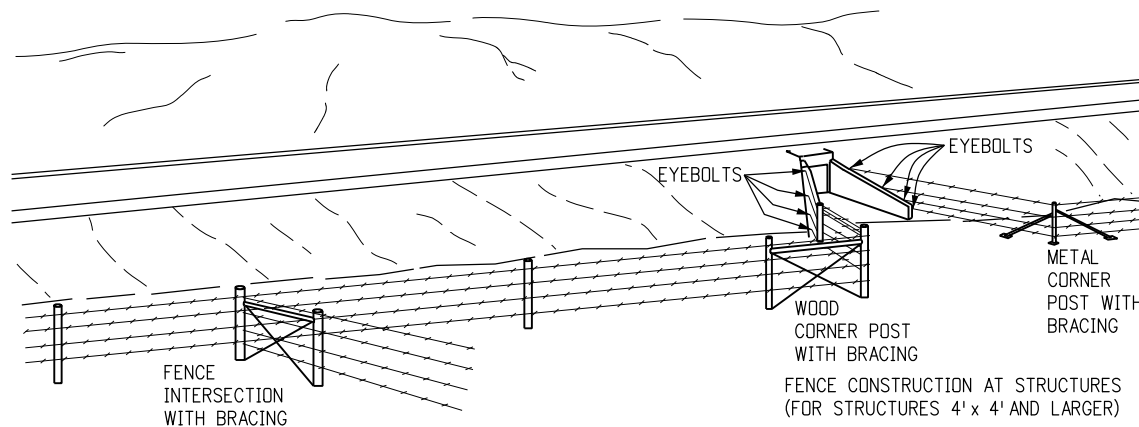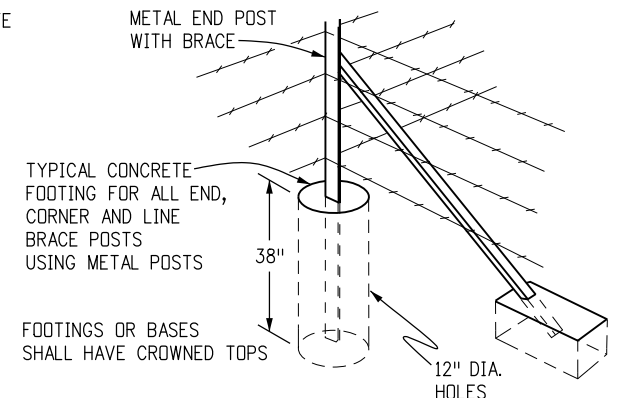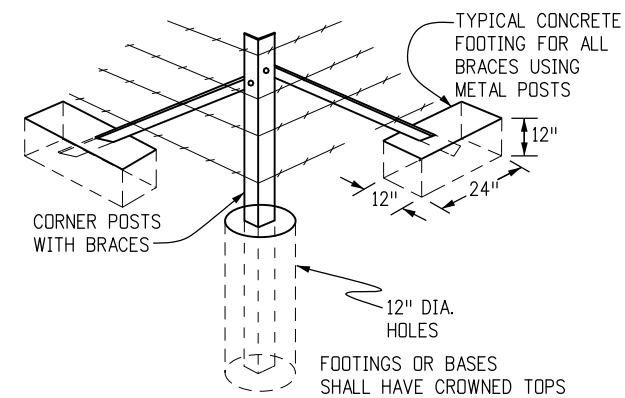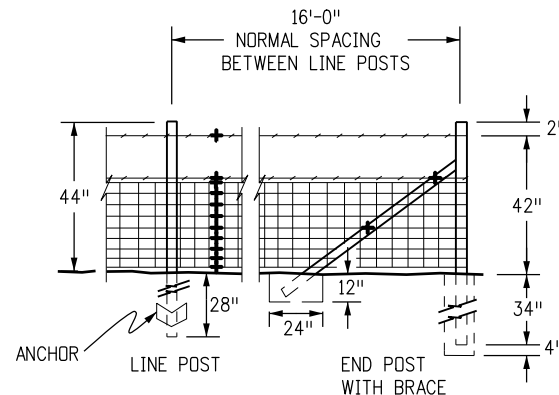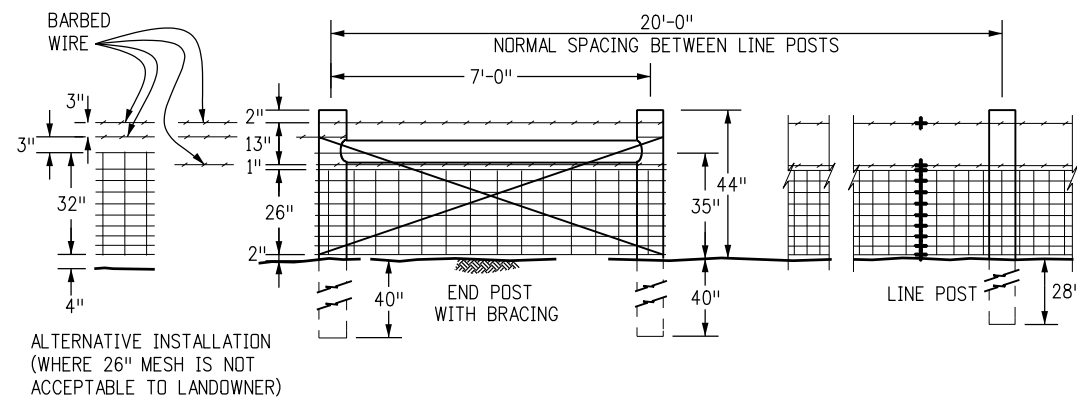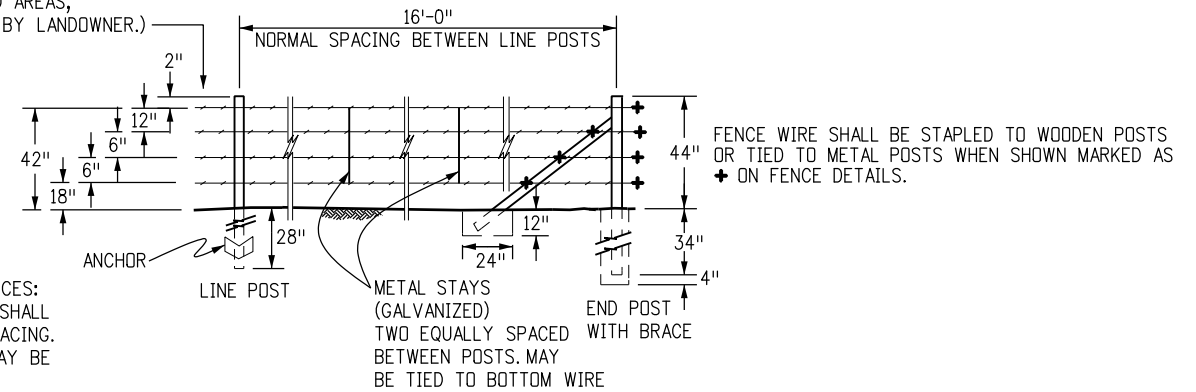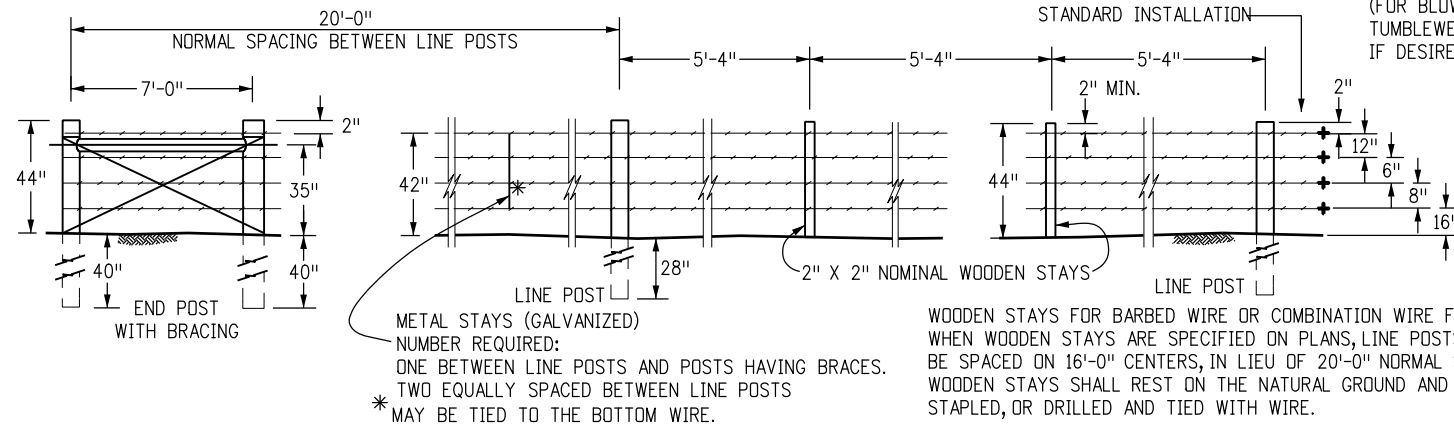


1. AT ALL STRUCTURES OF 4 FT. x 4 FT. AND LARGER, THE FENCE SHALL END AT THE EYEBOLTS IN THE WINGS OF THE STRUCTURE. WHERE THE TYPE OF STRUCTURE PROHIBITS THE USE OF EYEBOLTS, AN END POST WITH BRACE SHALL BE USED.
2. EYEBOLTS SHALL BE MADE OF 1/2 IN. ROUND BARS WITH A MINIMUM OF 6 IN. OF BODY LENGTH EMBEDDED (HOOKED OR BENT) IN FRESH CONCRETE.

3. FOR EYEBOLTS IN EXISTING CONCRETE, THE 1/2 IN. ROUND BARS SHALL BE DEFORMED AND GROUTED INTO DRILLED HOLES.
4. EYEBOLTS SHALL HAVE A MINIMUM OF 1 IN. INSIDE EYE DIAMETER.
5. EYEBOLTS SHALL BE FURNISHED AND INSTALLED BY THE CONTRACTOR. EYEBOLTS WILL NOT BE PAID FOR SEPARATELY BUT SHALL BE INCLUDED IN THE WORK.

WHEN GATES, ANGLES, CORNERS OR INTERSECTING FENCES ARE NOT REQUIRED, LINE BRACES SHALL BE SPACED AS FOLLOWS:
METAL POSTS - 800 FT. INTERVALS
WOOD POSTS - 1,400 FT. INTERVALS

Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	WIRE FENCES AND GATES Issued by the Project Development Branch: July 31, 2019	STANDARD PLAN NO.	
Creation Date: 07/31/19		Date:	Comments			M-607-1	
Designer Initials: JBK	(R-X)					Standard Sheet No. 2 of 3	
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:	
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						

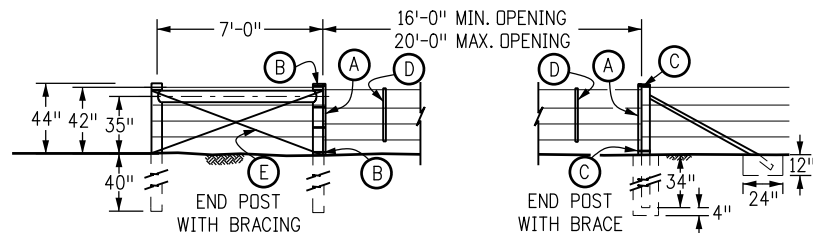

▼ FOR COMBINATION WIRE GATE, USE 3/4" MESH AND ONE STRAND OF BARBED WIRE. EXTEND WOODEN STAYS TO GROUND.


- (A) 2 IN. x 4 IN. x 4 FT. WOODEN STAYS
(B) FOUR NO. 12-1/2 GA. WIRE LOOPS TO ACT AS HINGES
(C) NO. 12-1/2 GA. WIRE LOOPS

- (D) TWO 2 IN. x 2 IN. NOMINAL WOODEN STAYS EQUALLY SPACED
(E) NO. 12-1/2 GA. BRACE WIRE, DOUBLE STRAND

WOODEN POSTS

METAL END POSTS

▼ BARBED WIRE GATE

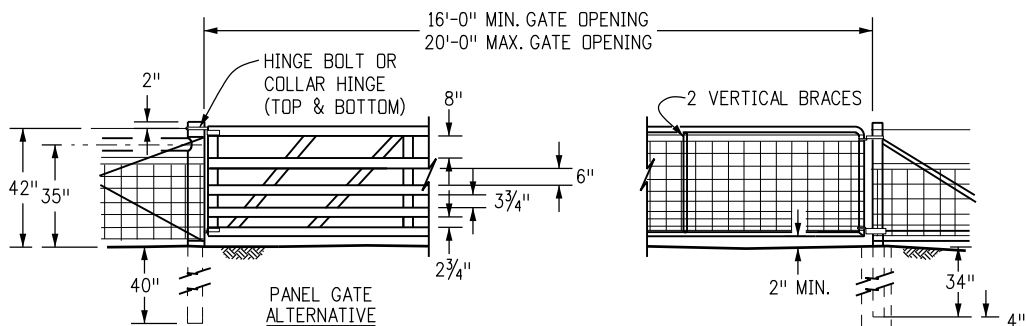

WOODEN POSTS


(16'-0" MAX.)

DRIVEWAY GATES

(METAL AND WOOD END POSTS SHALL BE BRACED SAME AS FOR BARBED WIRE GATES)

METAL END POSTS

(20'-0" MAX.)

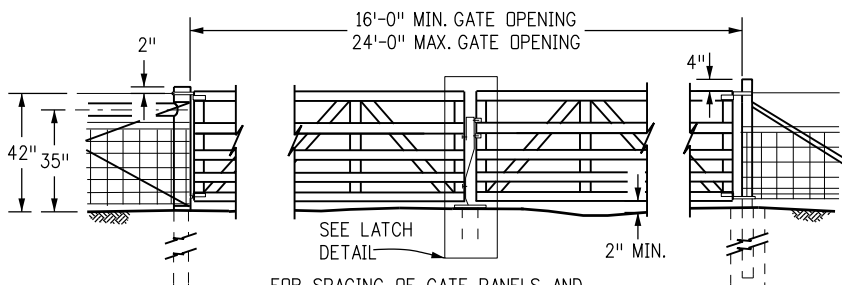


WOODEN POSTS

FOR SPACING OF GATE PANELS AND LENGTH OF POSTS, SEE DETAIL ABOVE.


TWIN DRIVEWAY GATES

(METAL AND WOOD END POSTS SHALL BE BRACED SAME AS FOR BARBED WIRE GATES)

PANEL GATE POSTS

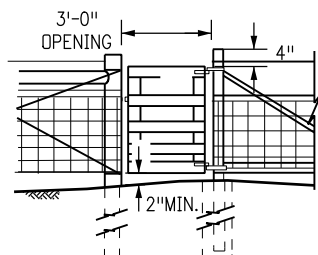

FOR LENGTH OF POSTS AND SPACING OF WIRE AND GATE PANELS, SEE DRIVEWAY GATE DETAIL ABOVE.

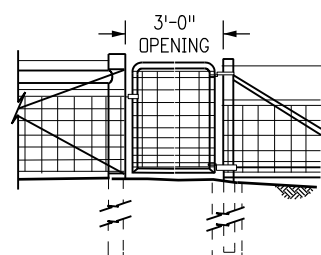


WOODEN POSTS PANEL GATE POSTS

WALK GATE


(METAL AND WOOD END POSTS SHALL BE BRACED SAME AS FOR BARBED WIRE GATES)

WOODEN POSTS METAL END POSTS


ALTERNATIVE WALK GATE

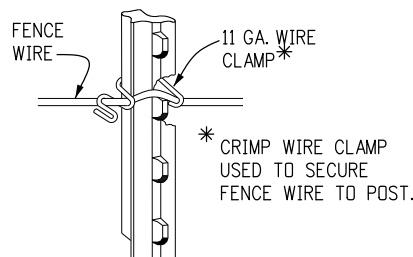

TIES FOR "STUDED TEE" OR "U" POSTS

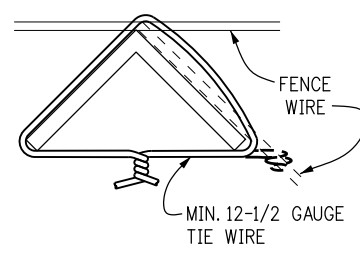


TIES FOR ANGLE POSTS FENCE WIRE TIES




BORE A 3/8" x 2" HOLE IN EACH POST AND BRACE TO RECEIVE THE PINS. WRAP THE ENDS OF THE BRACES TIGHTLY WITH SEVERAL TURNS OF 12-1/2 GA. SMOOTH GALV. WIRE TO PREVENT SPLITTING OR NOTCH POST AND NAIL WITH 40d COMMON NAILS.

CROSS BRACE DOWELING DETAIL

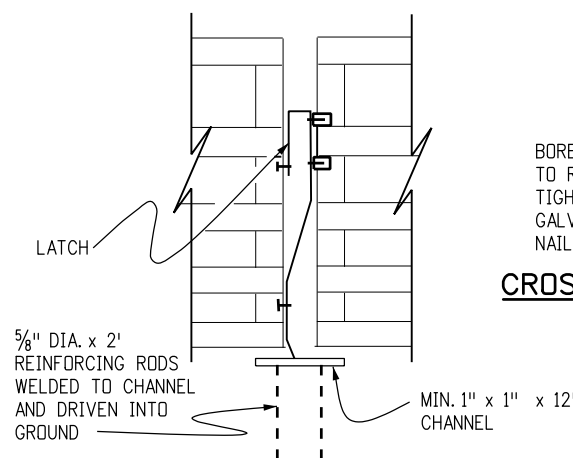


LATCH DETAIL

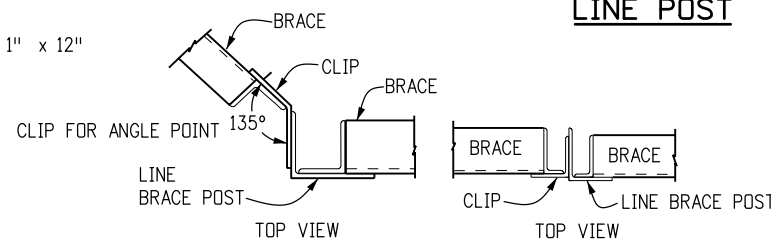


STUDED "TEE" LINE POST

"U" LINE POST TYPICAL METAL POSTS

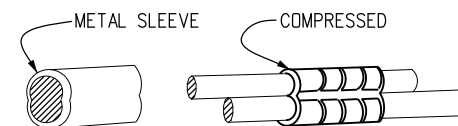


WIRE SPLICE

WOODEN POSTS MAY BE DRIVEN IN LIEU OF SETTING AND TAMPING, AT THE OPTION OF THE CONTRACTOR. DRIVING METHODS SHALL NOT DAMAGE POST.

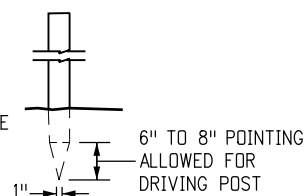


POST POINTING

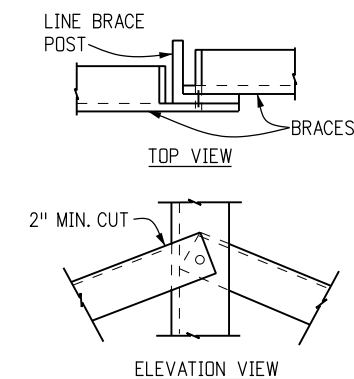


BRACE ATTACHMENT DETAIL

HOLES IN POSTS, BRACES AND CLIPS SHALL ACCOMMODATE 1/2" DIA. GALVANIZED MACHINE BOLTS.

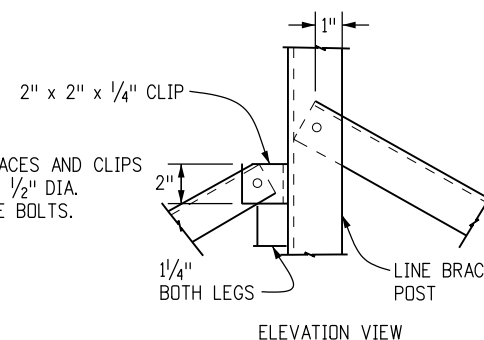

ALTERNATIVE BRACE ATTACHMENT DETAIL

Ø ALTERNATIVE ATTACHMENT METHODS, ACCEPTABLE TO THE ENGINEER, MAY BE USED.

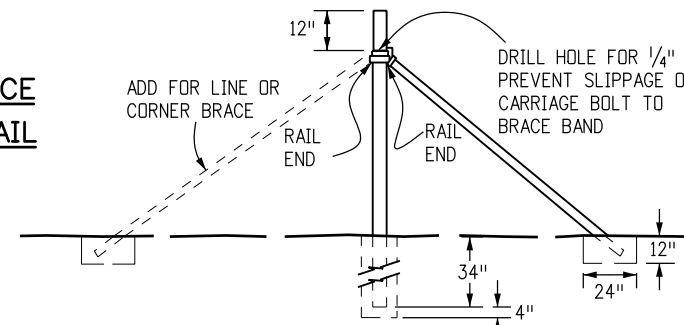

ALTERNATIVE POST

(FOR END, CORNER OR LINE BRACE POSTS)

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

(R-X)
(R-X)
(R-X)
(R-X)

Sheet Revisions

Date:	Comments

Colorado Department of Transportation

2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch

JBK

WIRE FENCES AND GATES

Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.


M-607-1

Standard Sheet No. 3 of 3

Project Sheet Number:


GENERAL NOTES

- AT EACH LOCATION WHERE AN ELECTRIC TRANSMISSION, DISTRIBUTION, OR SECONDARY LINE CROSSES A FENCE, THE CONTRACTOR SHALL FURNISH AND INSTALL A GROUND CONFORMING TO ARTICLE 250 OF THE NATIONAL ELECTRIC CODE. A GROUND SHALL ALSO BE INSTALLED A MAXIMUM OF EVERY 500 FT. ALONG THE FENCE. THE GROUND ROD SHALL BE A MINIMUM DIAMETER OF 1/2 IN. AND 8 FT. IN LENGTH, AND DRIVEN AT LEAST 7 1/2 FT. INTO THE GROUND. THE ROD SHALL BE CONNECTED TO EACH WIRE WITH A MINIMUM AWG NO. 8 STRANDED COPPER WIRE. GROUNDING WILL NOT BE PAID FOR SEPARATELY BUT SHALL BE INCLUDED IN THE COST OF THE FENCE.
- H (HEIGHT OF FABRIC) SHALL BE AS SHOWN ON THE PLANS. FABRIC IS AVAILABLE IN THE FOLLOWING HEIGHTS: 36 IN., 42 IN., 48 IN., 60 IN., 72 IN., 84 IN., 96 IN., 108 IN., 120 IN., AND 144 IN.
- CHAIN LINK FENCE SHALL CONFORM TO AASHTO M 181.
- CHAIN LINK FABRIC SHALL BE 2 IN. MESH NO. 9 GAGE GALVANIZED OR ALUMINUM COATED WIRE SECURELY FASTENED TO TENSION WIRE, LINE POSTS, RAILS, BRACES AND STRETCHER BARS SPACED AS SHOWN HEREON. WIRE FASTENERS AND TIE CLIPS SHALL BE NO. 11 GAGE (W&M) GALVANIZED STEEL WIRE OR NO. 7 GAGE (B&S) ALUMINUM WIRE, AND HOG RINGS SHALL BE NO. 9 GAGE, ALL IN CONFORMANCE WITH ASTM F 626.
- STEEL POSTS, RAILS AND GATE FRAMES SHALL CONFORM TO AASHTO M 181 TYPE 1, GRADE 2.
- AT THE CONTRACTOR'S OPTION, PIPE USED FOR FENCE CONSTRUCTION SHALL CONFORM TO THE DIMENSIONS AND WEIGHTS FOR EITHER "ORDINARY PIPE" OR "ALTERNATIVE PIPE" AS SHOWN ON SHEET 2. "ALTERNATIVE PIPE" SHALL BE HIGH STRENGTH STEEL PIPE CONFORMING TO FEDERAL SPECIFICATION RR-F-191/3C.
- TENSION WIRE SHALL BE CONTINUOUS BETWEEN END OR CORNER POST AND LINE BRACE POST. A TURNBUCKLE OR OTHER APPROVED TIGHTENING DEVICE SHALL BE USED FOR EACH CONTINUOUS SPAN OF TENSION WIRE.
- TENSION WIRE SHALL CONFORM TO AASHTO M 181.
- CONCRETE FOOTINGS SHALL HAVE TOPS CROWNED AT GROUND LEVEL AND SHALL BE CLASS B. CONCRETE WITH LIGHTWEIGHT AGGREGATE CONFORMING TO AASHTO M 195, MAY BE SUBSTITUTED.
- TERMINATION OF FENCE AT BRIDGES OR OTHER STRUCTURES SHALL BE AS SHOWN ON THE PLANS.
- CHAIN LINK FABRIC UP TO 5 FT. HIGH SHALL BE KNUCKLED AT THE TOP AND BOTTOM SELVAGES. FABRIC OVER 5 FT. HIGH SHALL BE TWISTED AND BARBED ON THE TOP SELVAGE AND KNUCKLED ON THE BOTTOM SELVAGE.
- FENCE MAY BE CONSTRUCTED WITH EITHER ROUND PIPE OR ROLL-FORMED STEEL COMPONENTS. THE CONTRACTOR SHALL STATE AT THE PRECONSTRUCTION CONFERENCE, THE TYPE OF CONSTRUCTION AND TYPE OF LINE POST TO BE USED THROUGHOUT THE PROJECT.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR RE-ESTABLISHING DISTURBED OR DESTROYED SURVEY MONUMENTS TO THE APPROPRIATE ACCURACY IN ACCORDANCE WITH SUBSECTION 625.08 OF THE STANDARD SPECIFICATIONS.

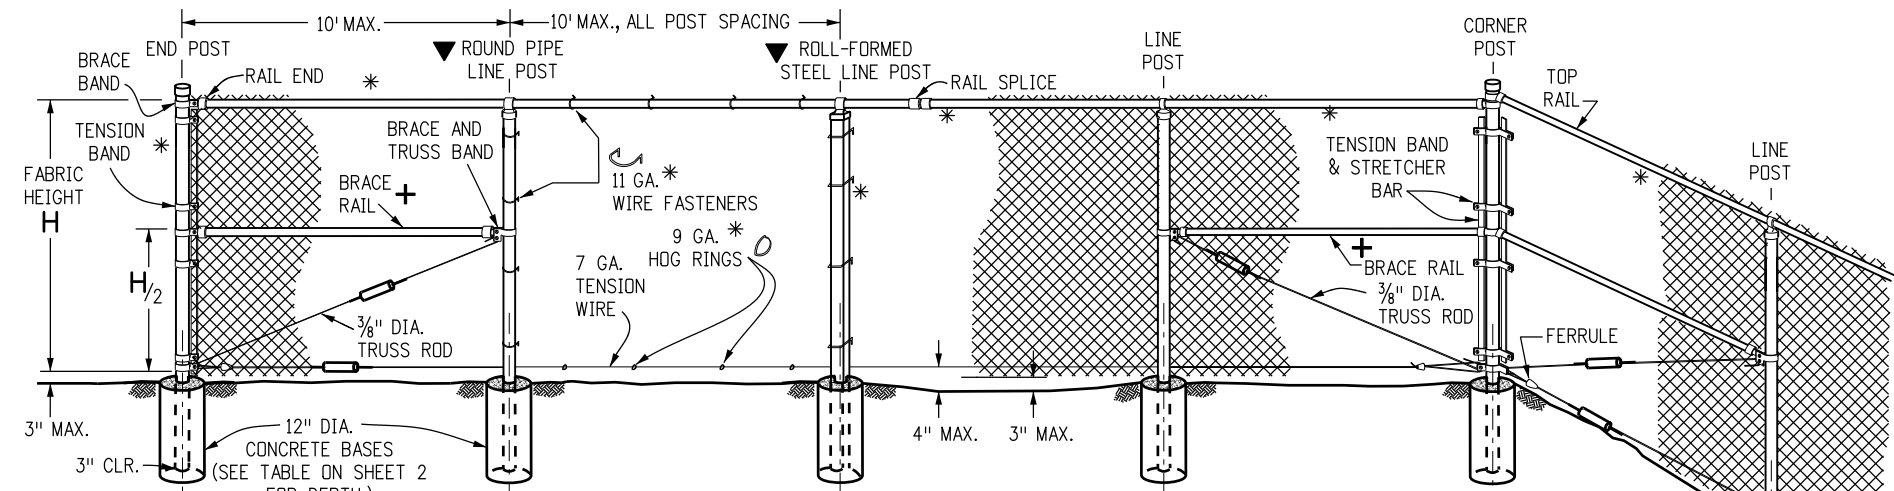

FENCE WITH TOP RAIL (USE ONLY AT SPECIAL LOCATIONS BEYOND CLEAR ZONE WHEN THE TOP RAIL IS SPECIFIED ON PLANS)


LEGEND

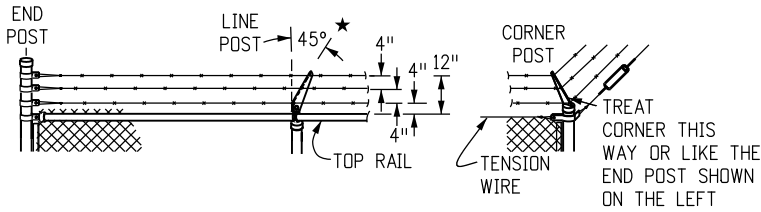


BARBED WIRE TOP (USE ONLY WHEN SPECIFIED ON PLANS)

- CASE 1. TO KEEP INSIDERS IN, SLOPE TOP IN 45°
- CASE 2. TO KEEP OUTSIDERS OUT, SLOPE TOP OUT 45° BARBED WIRE OVER GATES SHALL NOT BE SLOPED


- * ATTACH FABRIC TO ALL FENCE & GATE STRUCTURES AT 12 IN. INTERVALS VERTICALLY AND AT 20 IN. HORIZONTALLY.
- TIGHTENER OR TURNBUCKLE SYMBOL, (SEE DETAILS ON SHEETS 2 AND 3).
- ▼ TYPE OF LINE POST (ROUND PIPE OR ROLL-FORMED STEEL) SHALL BE AT THE OPTION OF THE CONTRACTOR UNLESS OTHERWISE SHOWN ON THE PLANS.
- + BRACE RAIL IS NOT REQUIRED FOR 36 IN., 42 IN., OR 48 IN. FABRIC HEIGHTS. BRACE RAIL FOR FENCE WITH ROLL-FORMED STEEL ELEMENTS IS 12 IN. BELOW THE TOP RAIL, (SEE SHEET 3).

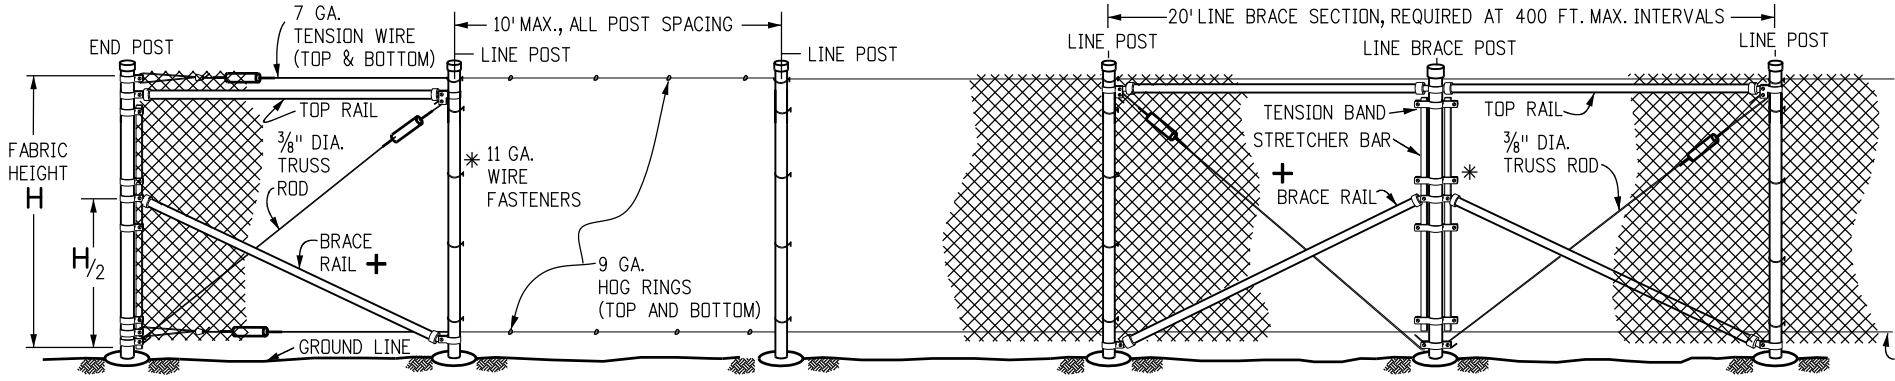


FENCE WITH TOP TENSION WIRE (USE FOR STANDARD CHAIN LINK FENCE)

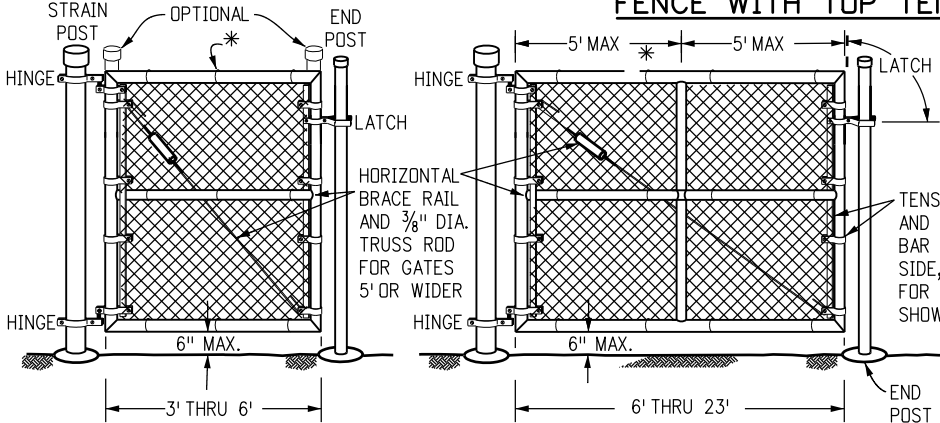


WALK GATE

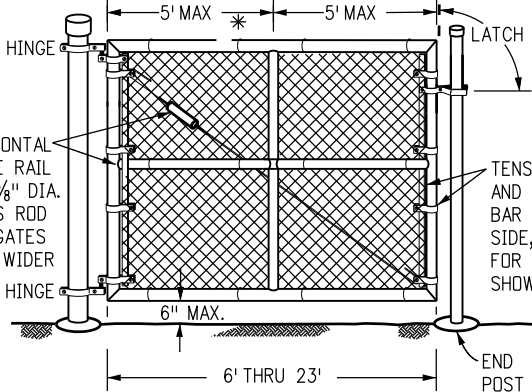

SINGLE GATE

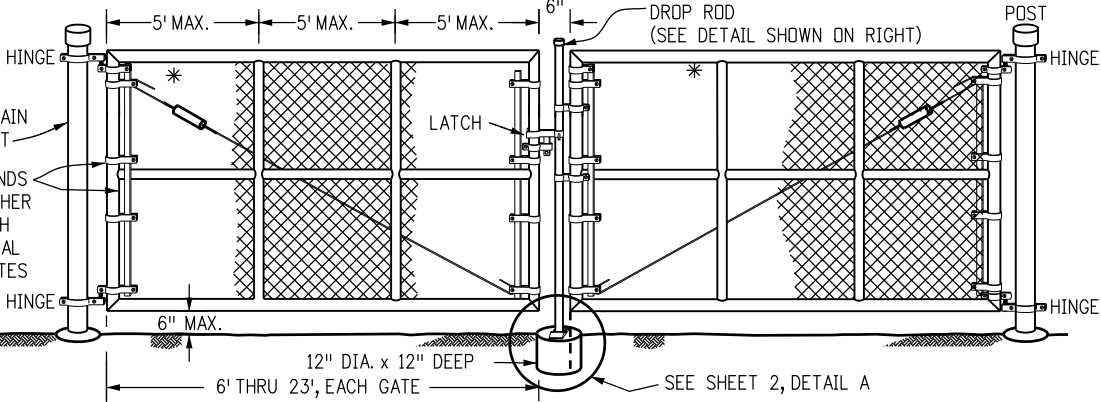

DOUBLE GATE

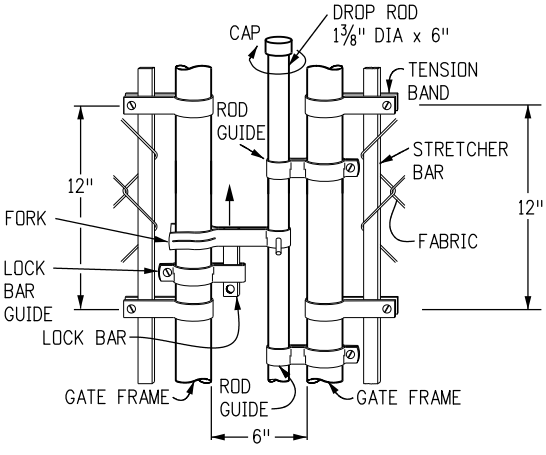

TYPICAL DROP ROD ASSEMBLY

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

Sheet Revisions

Date:	Comments
(R-X)	
(R-X)	
(R-X)	
(R-X)	

Colorado Department of Transportation

2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch

JBK

CHAIN LINK FENCE

Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.

M-607-2

Standard Sheet No. 1 of 3

Project Sheet Number:

FENCE MATERIAL

FABRIC HEIGHT	END, CORNER AND LINE BRACE POSTS		LINE POSTS		TOP & BRACE RAILS	
<i>H</i>	ROUND PIPE I.D.	ROLL-FORMED STEEL	ROUND PIPE I.D.	ROLL-FORMED STEEL	ROUND PIPE I.D.	ROLL-FORMED STEEL
FEET	INCHES		INCHES		INCHES	
3 THRU 6	2.5	3.5 x 3.5	1.5	1.875 x 1.625	1.25	1.25 x 1.625
> 6 THRU 8	2.5	3.5 x 3.5	2.0	1.875 x 1.625	1.25	1.25 x 1.625
> 8 THRU 12	2.5	3.5 x 3.5	2.0	2.250 x 1.625	1.25	1.25 x 1.625

FABRIC HEIGHT <i>H</i>	△ CONCRETE BASE			
	DEPTH	DIA.	DEPTH	DIA.
FEET	INCHES		INCHES	
3 THRU 4	34	12	28	12
> 4 THRU 12	40	12	40	12

△ ALL POSTS 3 IN CLEAR FROM BOTTOM OF CONCRETE BASE

GATE MATERIAL

GATE FRAME WIDTH	STRAIN POST		△ CONCRETE BASE	
	ROUND I.D.	ROLL-FORMED	DEPTH	DIA.
FEET	INCHES		INCHES	
3 THRU 6	2.5	3.5 x 3.5	36	12
> 6 THRU 13	3.5	_____	42	12
> 13 THRU 18	6.0	_____	48	18
> 18 THRU 23	8.0	_____	48	24

GATE FRAME		FRAME PIPE	BRACING PIPE
WIDTH	HEIGHT	I.D.	I.D.
FEET		INCHES	
3 THRU 8	3 THRU 6	1.25	1.25
> 8 THRU 23	6	1.50	1.25
> 8 THRU 23	> 6 THRU 12	1.50	1.50

ROLL-FORMED STEEL

PART	SIZE	THICK.	WEIGHT
	INCHES	GAGE	LB/FT
TOP & BRACE RAILS	1.250 x 1.625	14	2.08
LINE POST (H: 3FT - 6FT)	1.875 x 1.625	12	2.75
LINE POST (H: > 6FT - 8FT)	1.875 x 1.625	11	3.36
LINE POST (H: > 8FT - 12FT)	2.250 x 1.625	11	4.02
END, CORNER & LINE BRACE POSTS	3.50 x 3.50	10	7.59


ORDINARY PIPE

NOMINAL I.D.	O.D.	WALL THICK.	WEIGHT
INCHES			LB/FT
1.25	1.660	0.140	2.27
1.50	1.900	0.145	2.72
2.00	2.375	0.154	3.65
2.50	2.875	0.203	5.79
3.00	3.500	0.216	7.58
3.50	4.000	0.226	9.11
4.00	4.500	0.237	10.79
5.00	5.563	0.258	14.62
6.00	6.625	0.280	18.97
8.00	8.625	0.322	28.55


ALTERNATIVE PIPE

NOMINAL I.D.	O.D.	WALL THICK.	WEIGHT
INCHES			LB/FT
1.25	1.660	0.111	1.836
1.50	1.900	0.120	2.281
2.00	2.375	0.130	3.117
2.50	2.875	0.160	4.640

USE AT EACH MILL CUT (APPROX. 21 FT.) OF TOP RAIL
ROLL-FORMED TOP RAIL REQUIRES A SPLICE INSERT (SEE SHEET 3)

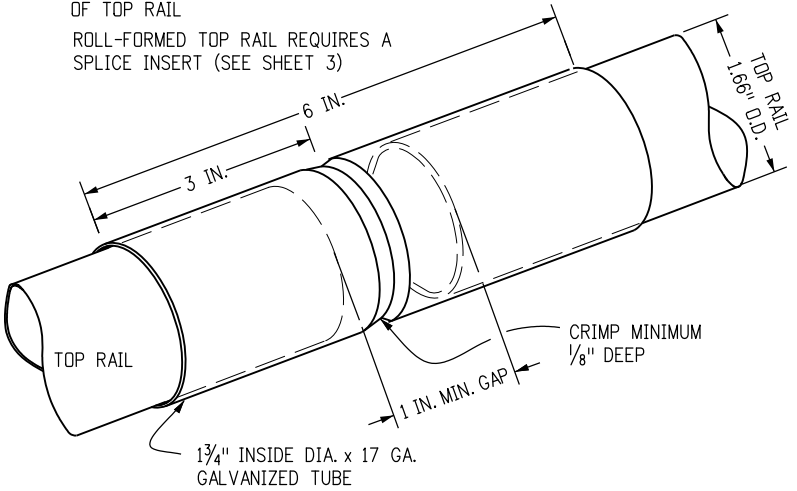


RAIL SPLICE




DROP ROD IS OPTIONAL IF GATE FRAMES EXTEND DOWN TO CENTER REST. USE LATCH SHOWN FOR WALK OR SINGLE GATE.


DETAIL A
TYPICAL CENTER REST

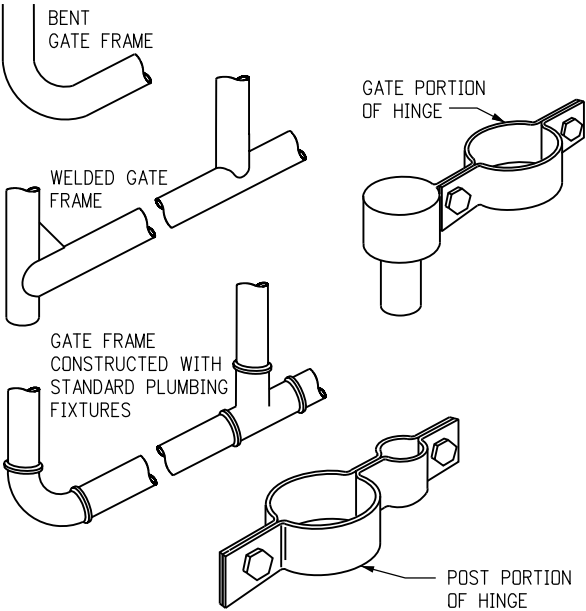

GATE FRAMES & HINGE

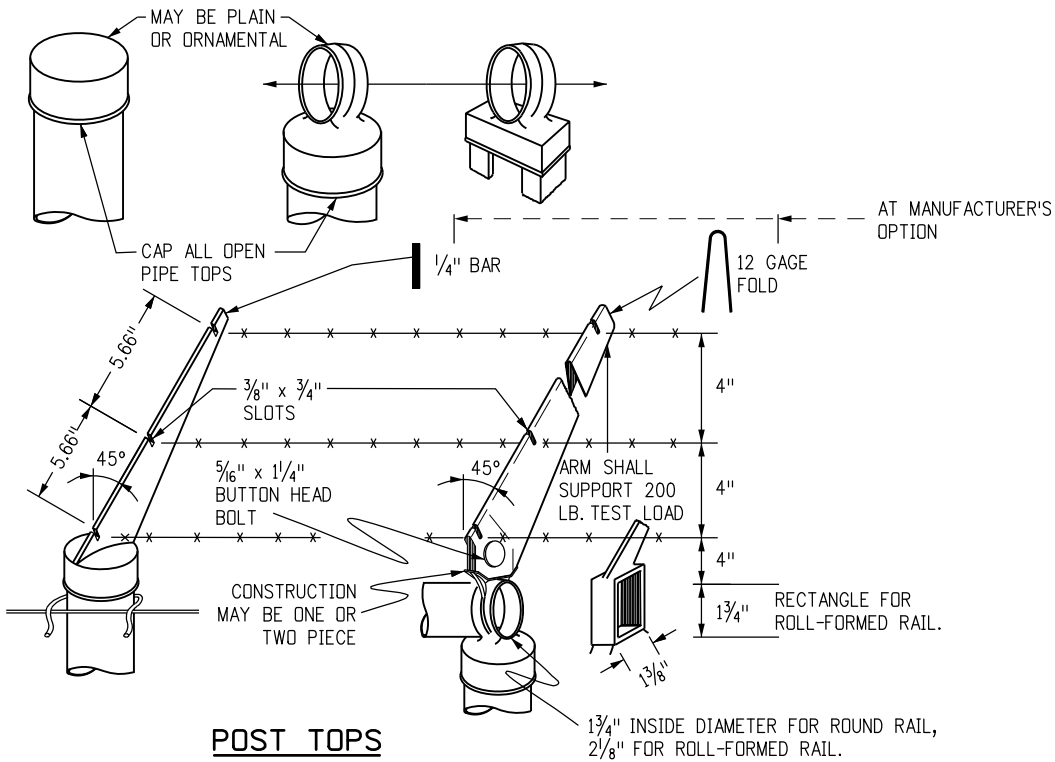


POST TOPS

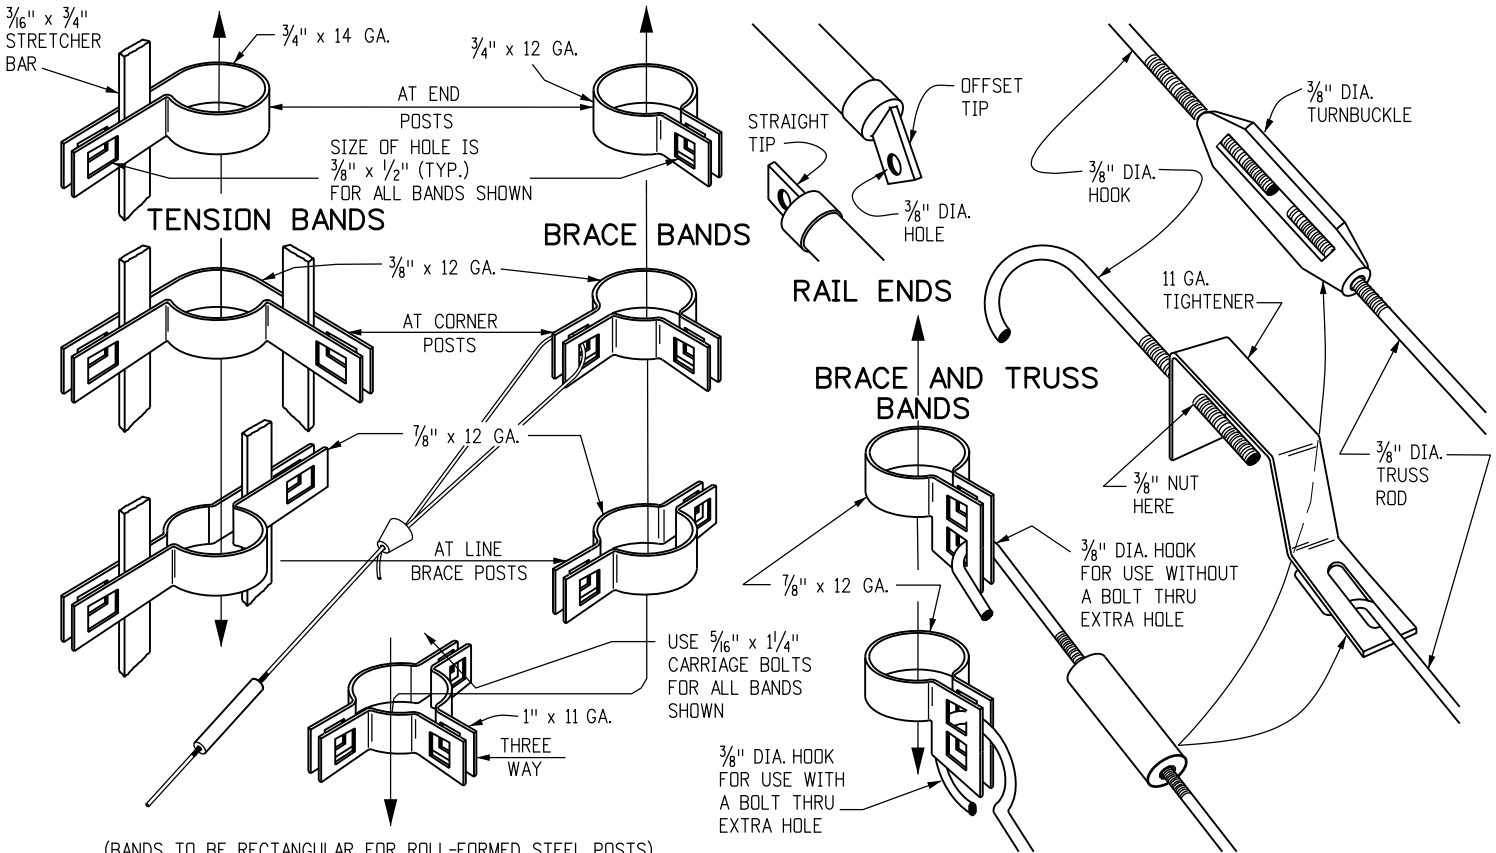

BANDS, RAIL ENDS & TIGHTENERS (DIMENSIONS SHOWN ARE MINIMUMS)


Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	CHAIN LINK FENCE	Issued by the Project Development Branch: July 31, 2019	STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments				M-607-2
Designer Initials: JBK	(R-X)						Standard Sheet No. 2 of 3
Last Modification Date: 07/31/19	(R-X)						Project Sheet Number:
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						

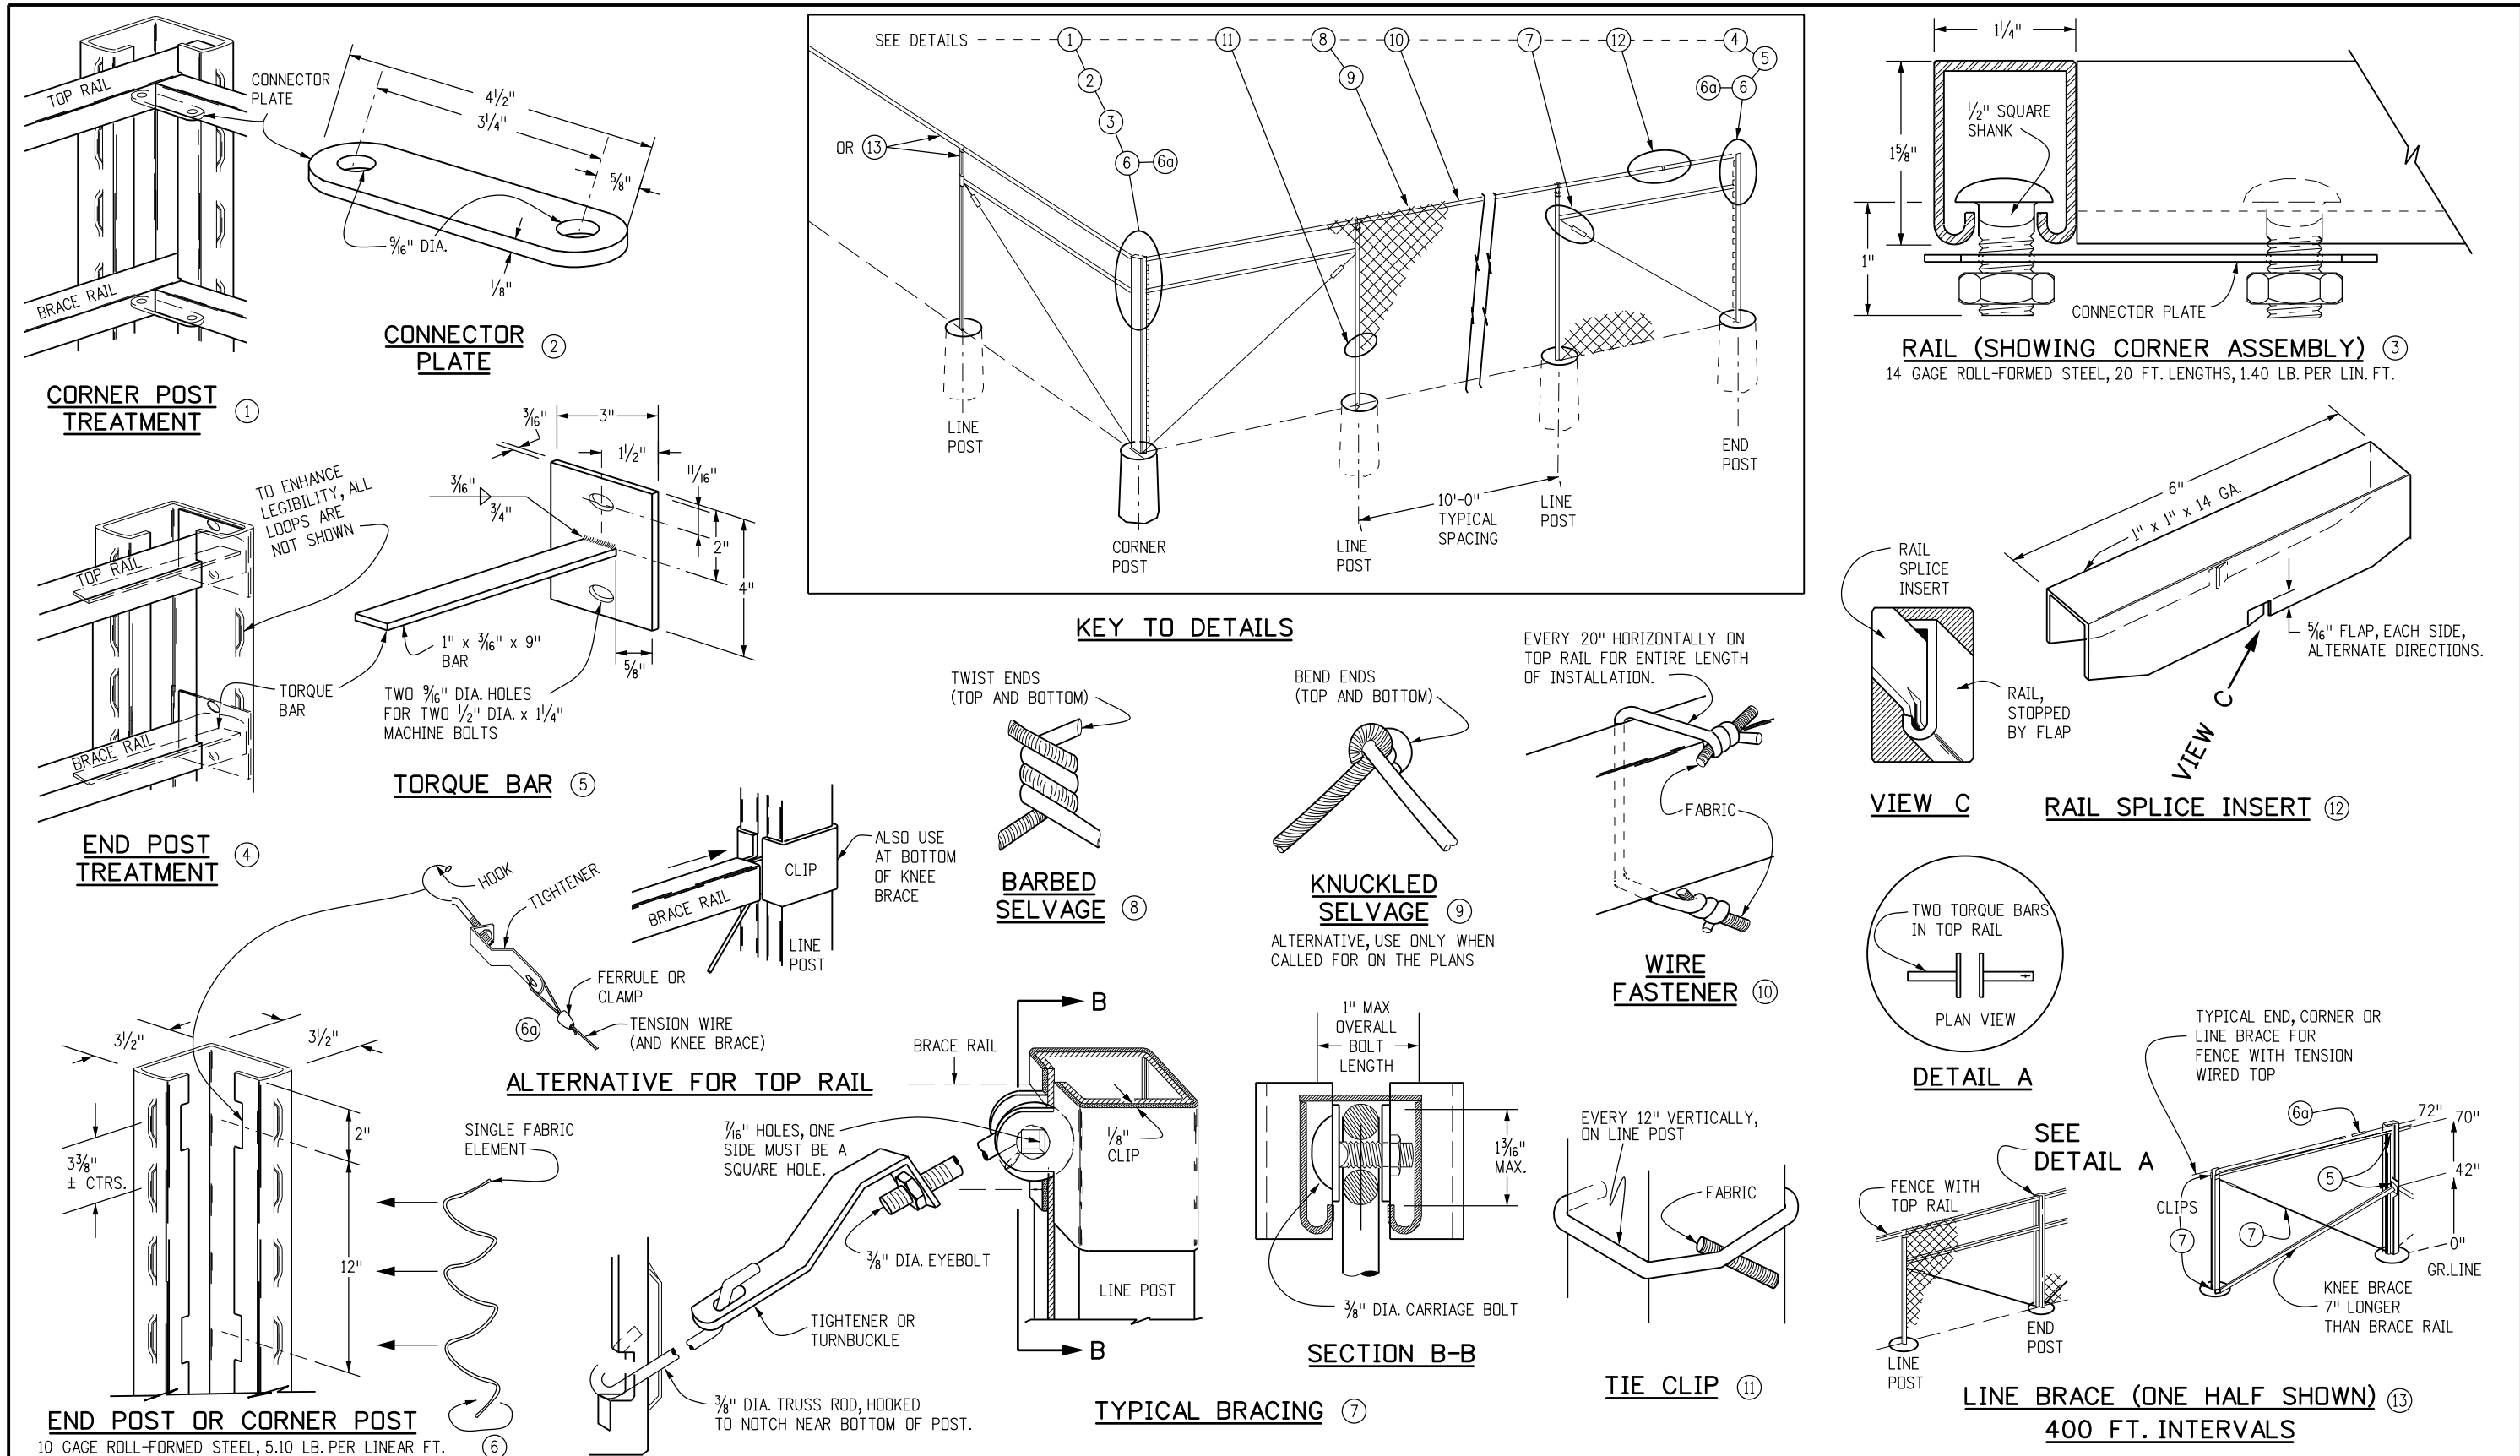


Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	CHAIN LINK FENCE	STANDARD PLAN NO.	
Creation Date: 07/31/19		Date:	Comments			M-607-2	
Designer Initials: JBK	(R-X)					Standard Sheet No. 3 of 3	
Last Modification Date: 07/31/19	(R-X)				Project Sheet Number:		
Detailer Initials: LTA	(R-X)				Issued by the Project Development Branch: July 31, 2019		
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English		(R-X)					

GENERAL NOTES

1. ALL POSTS AND BRACES SHALL BE OF THE TYPES AND WEIGHTS SHOWN ON THIS SHEET OR ACCEPTABLE EQUIVALENTS, ALL IN CONFORMANCE WITH AASHTO M 281. HOLES TO BE PROVIDED IN END POSTS AS DETAILED. ADDITIONAL END POSTS SHALL BE SUPPLIED FOR PULL BRACE POSTS WHEN REQUIRED BY THE ENGINEER.
2. LINE BRACE POSTS SHALL BE INSTALLED EVERY 800 FT. OR LESS WHERE THE FENCING IS CONTINUOUS. THE COST SHALL BE INCLUDED IN THE WORK. SEE STANDARD PLAN M-607-1.
3. WOVEN WIRE FENCE FABRIC, USED AS SHOWN, SHALL BE GALVANIZED (ZINC-COATED) CLASS 1 AND CONFORM TO AASHTO M 279 (ASTM A 116).
4. CONCRETE FOOTINGS SHALL HAVE TOPS CROWNED AT GROUND LEVEL AND SHALL BE CLASS B. CONCRETE WITH LIGHT WEIGHT AGGREGATE, CONFORMING TO AASHTO M 195 (ASTM C 330) WILL BE PERMITTED. THE COST OF THE CONCRETE SHALL BE INCLUDED IN THE WORK.
5. ON CURVES, FENCE WIRE SHALL BE PLACED ON SIDE OF POST WHICH WILL RESULT IN THE LEAST AMOUNT OF TENSION ON FENCE TIES.
6. AT EACH LOCATION WHERE AN ELECTRIC TRANSMISSION, DISTRIBUTION OR SECONDARY LINE CROSSES A BARRIER FENCE, THE CONTRACTOR SHALL FURNISH AND INSTALL A GROUND CONFORMING TO ARTICLE 250 OF THE NATIONAL ELECTRICAL CODE. THE GROUND ROD SHALL BE A MINIMUM DIAMETER OF 1/2 IN. AND 8 FT. IN LENGTH, AND DRIVEN AT LEAST 7 1/2 FT. INTO THE GROUND. THE ROD SHALL BE CONNECTED TO EACH WIRE WITH A MINIMUM AWG NO. 8 STRANDED COPPER WIRE. GROUNDING WILL NOT BE PAID FOR SEPARATELY BUT SHALL BE INCLUDED IN THE WORK.

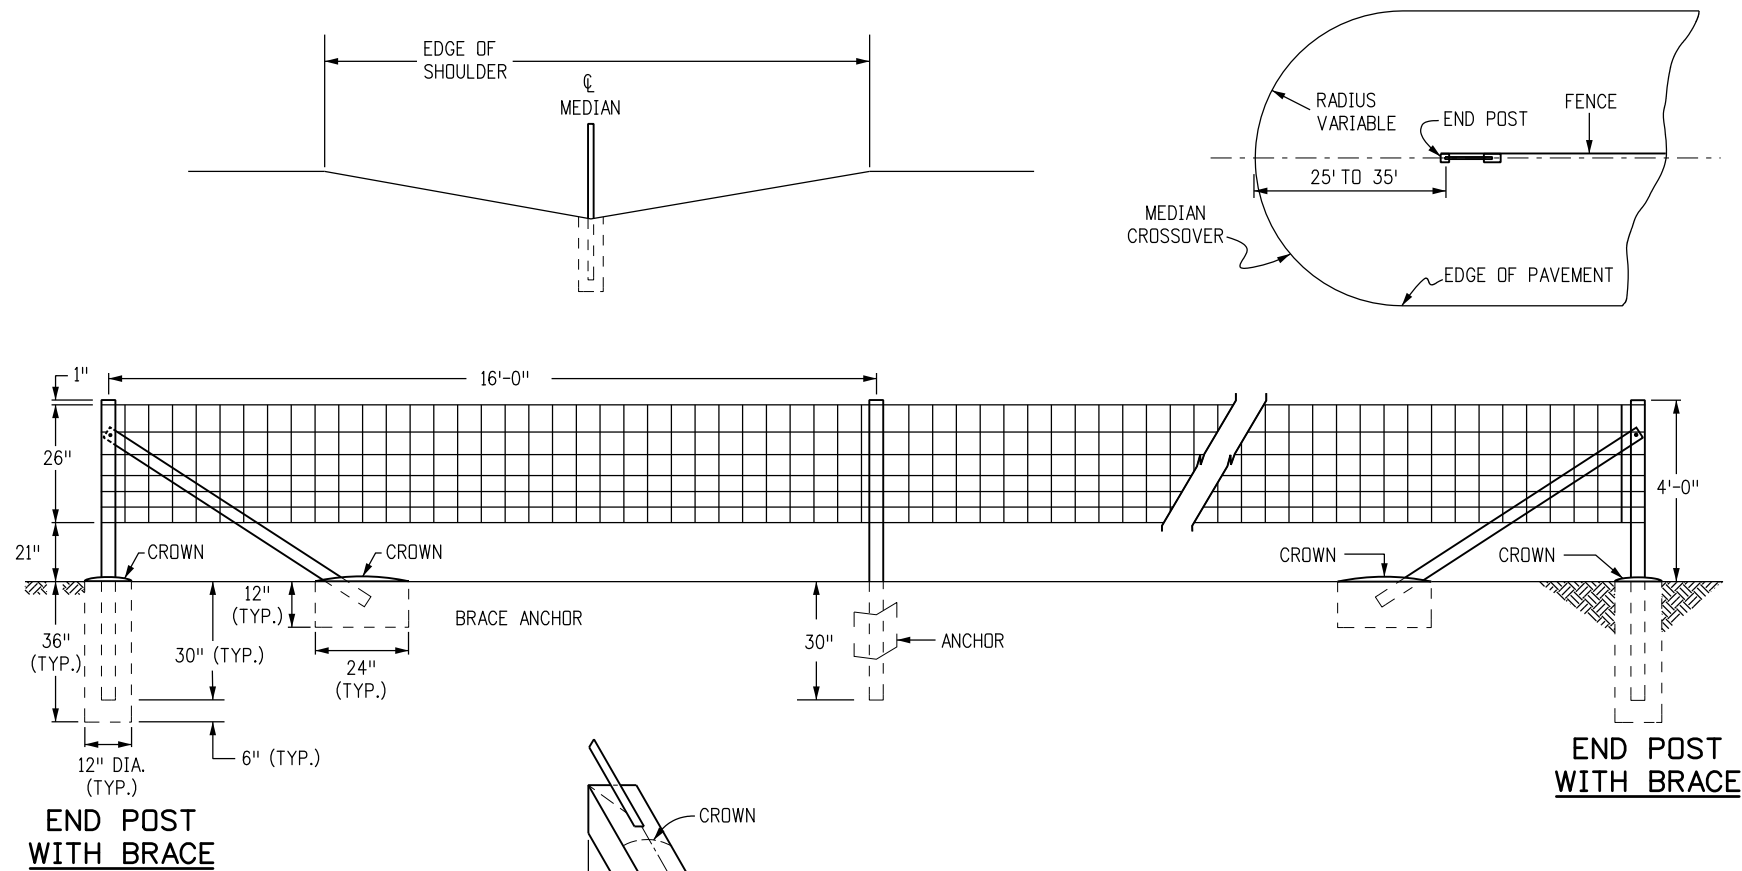


SKETCH OF BRACE ANCHOR

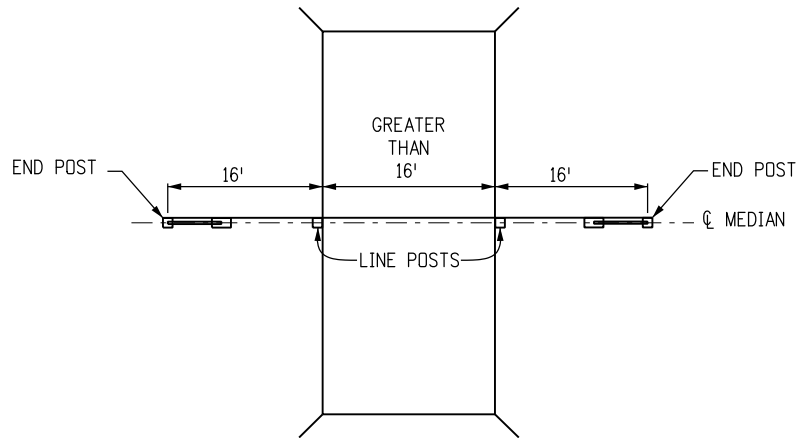


LOCATION OF BARRIER FENCE AT BOX CULVERTS WITH NO FILL

SPECIFICATIONS


- END POSTS:
TYPE: 2 1/2" x 2 1/2" x 1/4" STRUCTURAL STEEL ANGLES
WEIGHT: 4.10 LBS. PER LIN. FT. NOMINAL (RAW)
LENGTH: 6'-6" MINIMUM
NO. OF BRACES: ONE
- LINE POSTS:
TYPE: "STUDDED TEE" OR "U" POST
WEIGHT: 1.33 LBS. PER. LIN. FT. NOMINAL WITHOUT ANCHOR. (RAW)
LENGTH: 6'-6" MINIMUM
ANCHOR: SECURELY FASTENED, WITH BEARING SURFACE SUFFICIENT TO RESIST MOVEMENT OF POST. WGT. 0.67 LBS. MINIMUM
- BRACES:
TYPE: 2" x 2" x 1/4" STRUCTURAL STEEL ANGLES
WEIGHT: 3.19 LBS. PER LIN. FT. NOMINAL (RAW)
LENGTH: 6'-6" MINIMUM
- WOVEN WIRE FENCE FABRIC:
STYLE OR DESIGN NUMBER: 726 - 6 - 12 1/2
- TIES:
END POSTS: EACH HORIZONTAL WIRE OF WOVEN WIRE FABRIC TO BE WRAPPED AROUND POST AND FASTENED IN ADDITION TO TWO TIE WIRES.
LINE POSTS: MINIMUM THREE TIES PER POST FOR WOVEN WIRE FABRIC

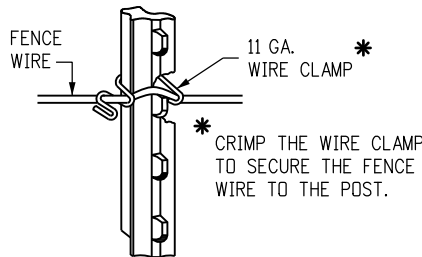


TIES FOR "STUDDED TEE" OR "U" POSTS

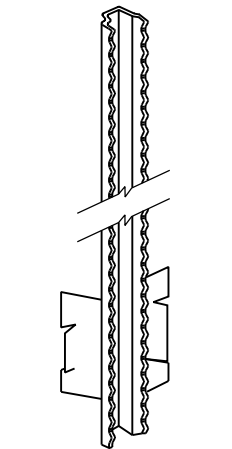


"U" LINE POST

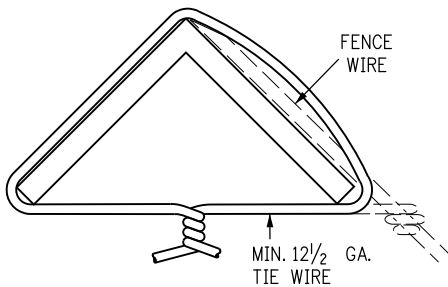

END POST TIE

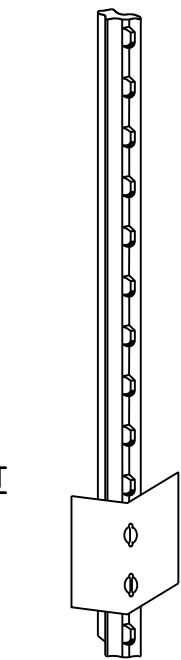



"STUDDED TEE" LINE POST

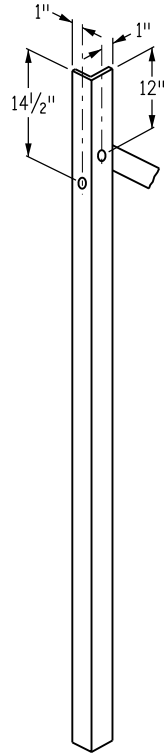

END POST WITH BRACING




NOTE: HOLES IN END POSTS AND BRACES SHALL ACCOMMODATE 1/2" DIA. GALVANIZED MACHINE BOLTS.

Computer File Information		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	Sheet Revisions		BARRIER FENCE	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)		Date:	Comments		M-607-3	
Designer Initials: JBK						Standard Sheet No. 1 of 1	
Last Modification Date: 07/31/19						Project Sheet Number:	
Detailer Initials: LTA						Issued by the Project Development Branch: July 31, 2019	
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English							

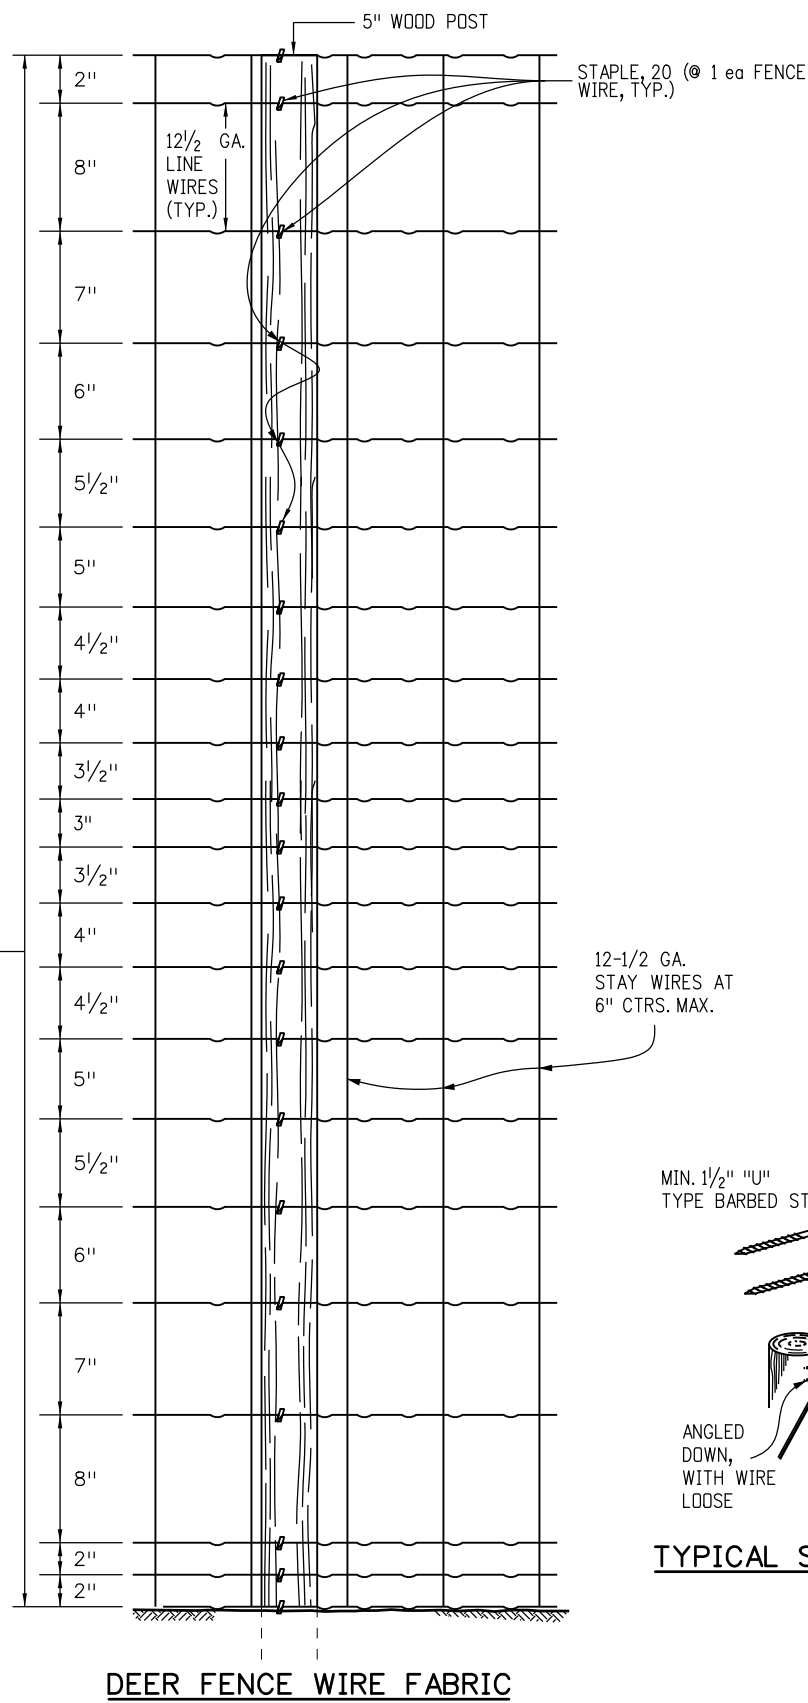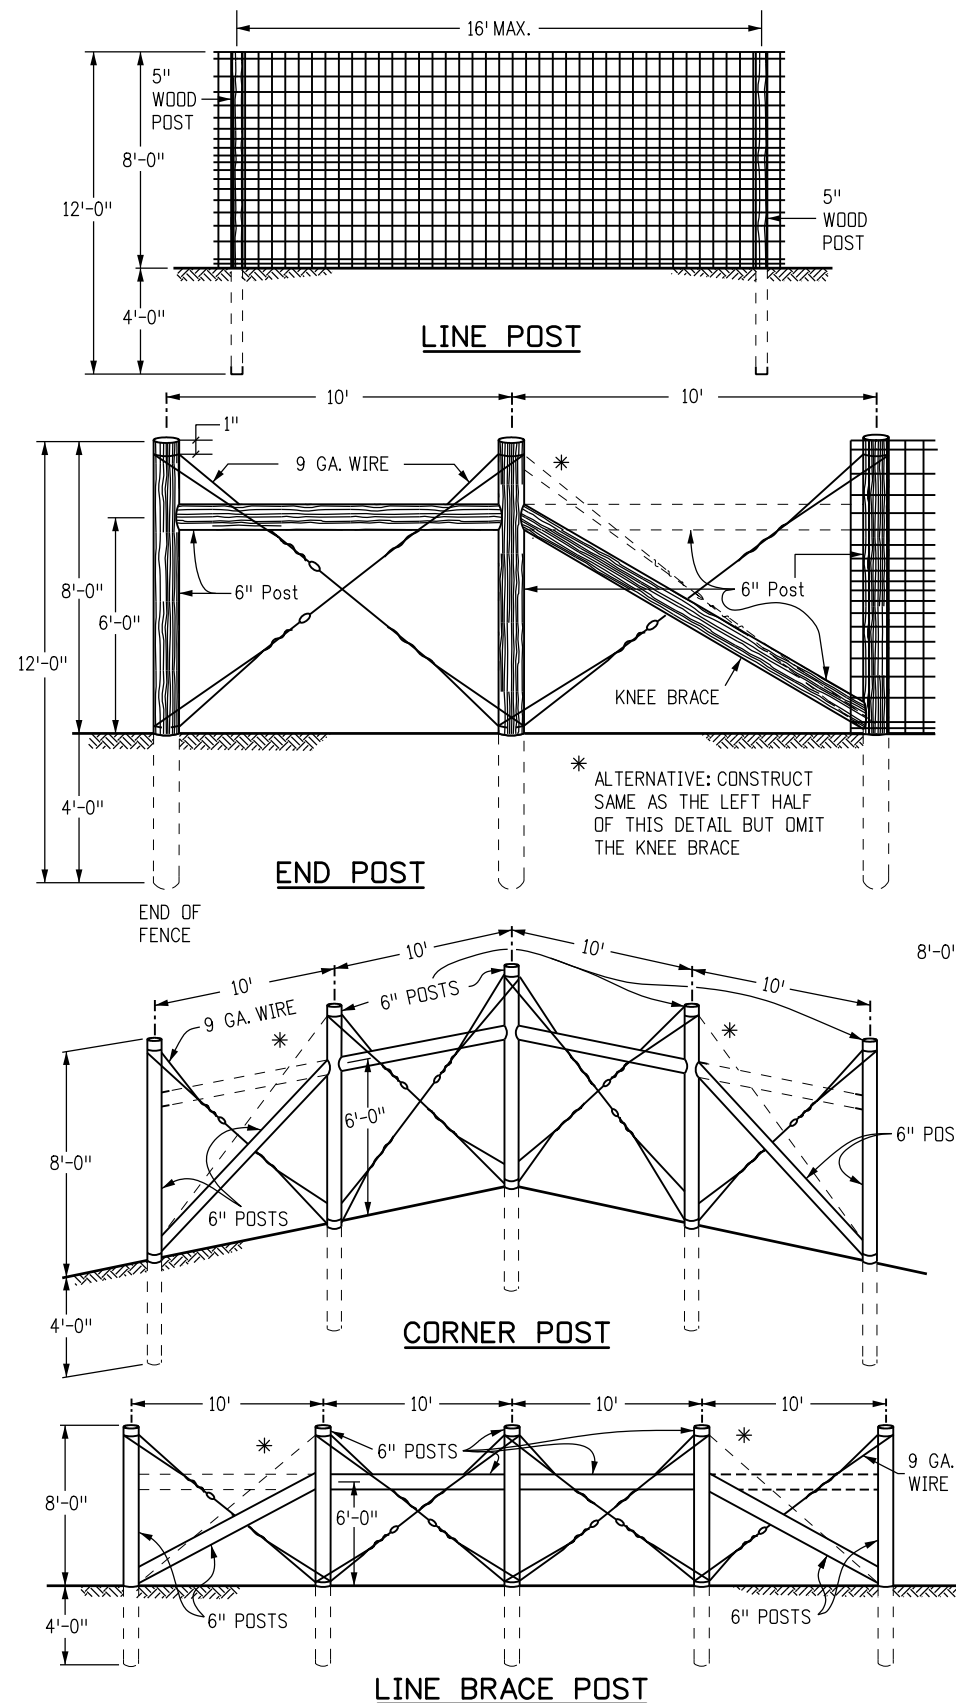


GENERAL NOTES


1. AT EACH LOCATION WHERE AN ELECTRIC TRANSMISSION, DISTRIBUTION OR SECONDARY LINE CROSSES A BARRIER FENCE, THE CONTRACTOR SHALL FURNISH AND INSTALL A GROUND CONFORMING TO ARTICLE 250 OF THE NATIONAL ELECTRICAL CODE. THE GROUND ROD SHALL BE A MINIMUM DIAMETER OF 1/2 IN. AND 8 FT. IN LENGTH, AND DRIVEN AT LEAST 7 1/2 FT. INTO THE GROUND. THE ROD SHALL BE CONNECTED TO EACH WIRE WITH A MINIMUM AWG NO. 8 STRANDED COPPER WIRE. GROUNDING WILL NOT BE PAID FOR SEPARATELY BUT SHALL BE INCLUDED IN THE WORK.
2. END POST, CORNER POST, AND LINE BRACE POST SHALL BE ASSEMBLED BY THE UNIT AND PAID FOR AS SUCH. ALL WORK AND MATERIAL ASSOCIATED WITH EACH ASSEMBLY, SHALL BE INCLUDED IN THE UNIT PRICE FOR THAT ASSEMBLY.
3. LINE BRACE POSTS SHALL BE SPACED AT 400 FT. INTERVALS, WHERE FENCING IS CONTINUOUS AND WHERE END, CORNER & LINE BRACE POSTS ARE NOT SPECIFIED.
4. ALL LINE POSTS SHALL BE 5 IN. MIN. DIAMETER AND 12 FT. LONG. ALL END, CORNER AND LINE BRACE POSTS SHALL BE 6 IN. MIN. DIAMETER AND 12 FT. LONG. ALL POSTS AND BRACES SHALL BE TREATED IN ACCORDANCE WITH SUBSECTION 710.07.
5. FENCE WIRE MAY BE PLACED ON EITHER THE ROAD SIDE OR THE FIELD SIDE OF POSTS, DEPENDING ON LOCAL CONDITIONS; i.e., ON CURVES, THE WIRE SHOULD BE PLACED ON THE SIDE WHICH WOULD RESULT IN THE LEAST AMOUNT OF TENSION ON THE STAPLES. THIS ALSO APPLIES WHERE WIND DRIFT OR OTHER CONDITIONS WOULD EXERT UNUSUAL PRESSURE AGAINST THE WIRE.
6. WHERE CONCRETE STRUCTURES ARE USED AS A DEER PASS, THE FENCE SHALL END AT EYEBOLTS IN WINGS OF THE STRUCTURE. EYEBOLTS IN FRESH CONCRETE SHALL BE MADE OF 1/2 IN. ROUND BARS AND EMBEDDED A MINIMUM OF 6 IN. WITH A HOOKED OR BENT END. IN EXISTING CONCRETE, THE 1/2 IN. ROUND BARS SHALL BE DEFORMED AND GROUTED INTO DRILLED HOLES. EYEBOLTS SHALL HAVE A MINIMUM OF 1 IN. INSIDE EYE DIAMETER AND SHALL BE FURNISHED AND INSTALLED BY THE CONTRACTOR. COST OF EYEBOLTS SHALL BE INCLUDED IN THE CONTRACT PRICE FOR FENCING.
7. WOVEN WIRE FENCE FABRIC SHALL CONFORM TO AASHTO M 279 (ASTM A 116). DESIGN NO. 2096-6-12 1/2, GRADE 60, COATING TYPE ZA, COATING CLASS 80.
8. ALL FENCE WIRE TIES, BRACE WIRES, STAPLES AND OTHER WIRE APPURTENANCES SHALL BE GALVANIZED IN CONFORMANCE WITH AASHTO M 232.
9. THE CONTRACTOR SHALL RE-ESTABLISH DISTURBED OR DESTROYED SURVEY MONUMENTS TO THE APPROPRIATE ACCURACY IN ACCORDANCE WITH SUBSECTION 625.08 OF THE STANDARD SPECIFICATIONS.
10. CONTINUOUS LINE WIRE SHALL BE HIGH TENSILE (175 K MIN.). CONTINUOUS STAY WIRE SHALL BE MID-TENSILE (125 K MIN.). FIXED KNOT 13 GAUGE WIRE (60K MIN.) SHALL CONNECT LINE WIRE WITH THE VERTICAL STAY WIRE.
11. DEER GATE AND TOP BRACES SHALL BE PAINTED WITH GREEN PAINT ACCORDING TO SUBSECTION 708.03 AND COLOR NO. 14109 OF FEDERAL STANDARD 595B.

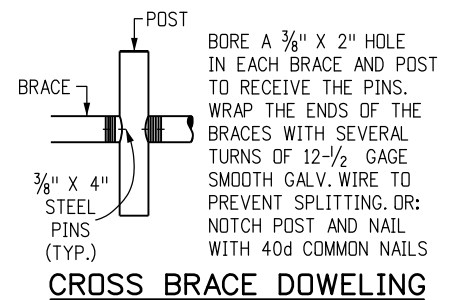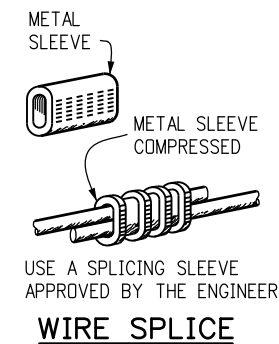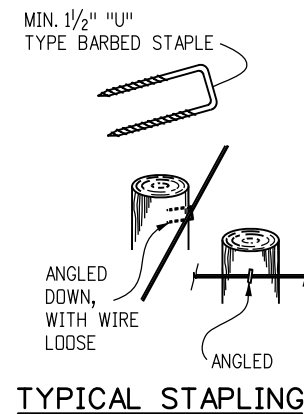

Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	DEER FENCE, GATES, AND GAME RAMPS	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-607-4	
Designer Initials: JBK	(R-X)					Standard Sheet No. 1 of 5	
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:	
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						

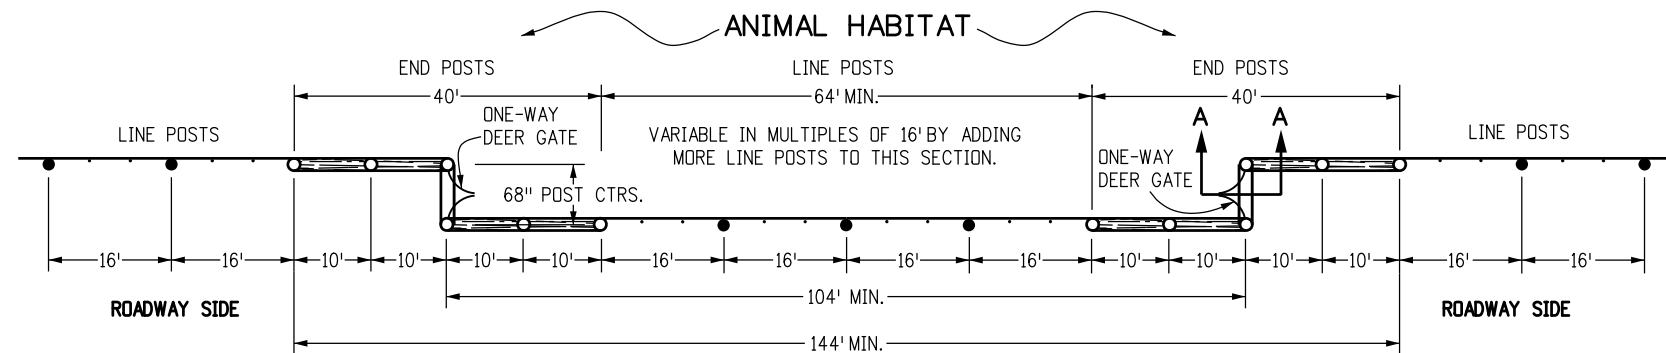


PLAN VIEW - TYPICAL DEER GATE INSTALLATION




NOTES

1. SIX IN. DOUBLE ACTING SPRING DOOR HINGE WITH FLAT BUTTON TIPS CUT IN TWO SHALL BE USED AS A SINGLE SWING HINGE AND BE PROVIDED WITH A GREASING NIPPLE AND WELDED TO SUPPORT PLATE.
2. TINES SHALL BE MOLDED IN ONE PIECE OF STEEL (AASHTO M 169, GRADE 1050), WITH NO WELDS ALLOWED.

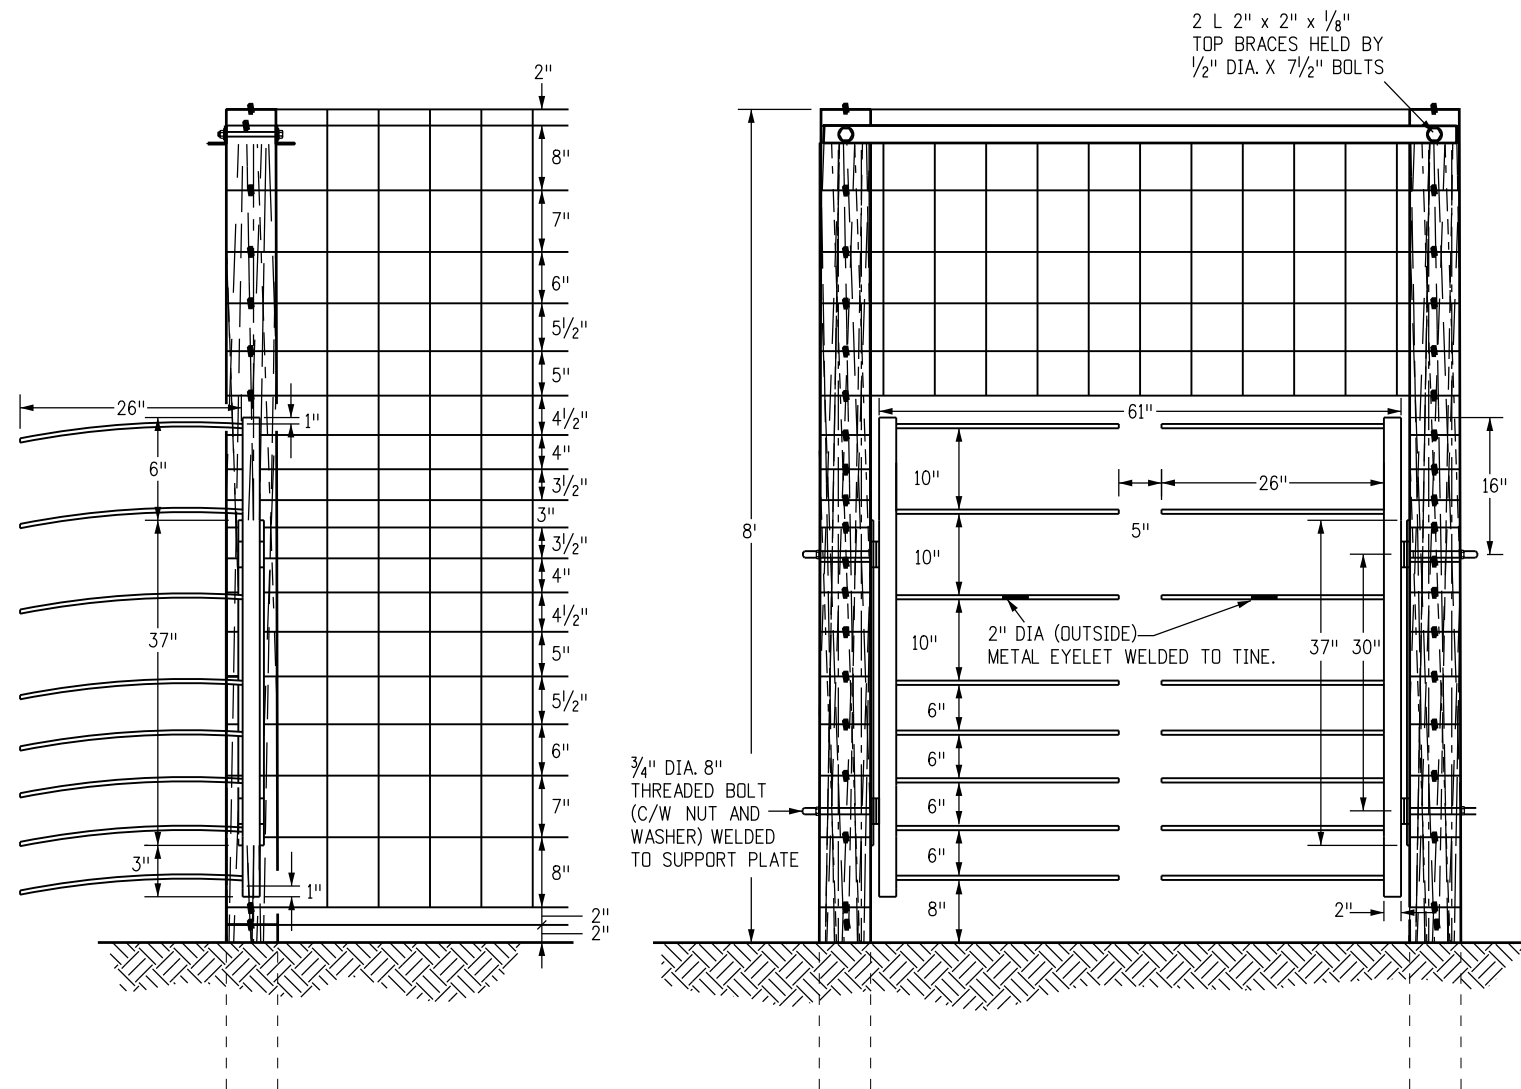


SECTION A-A

FRONT VIEW - DEER GATE

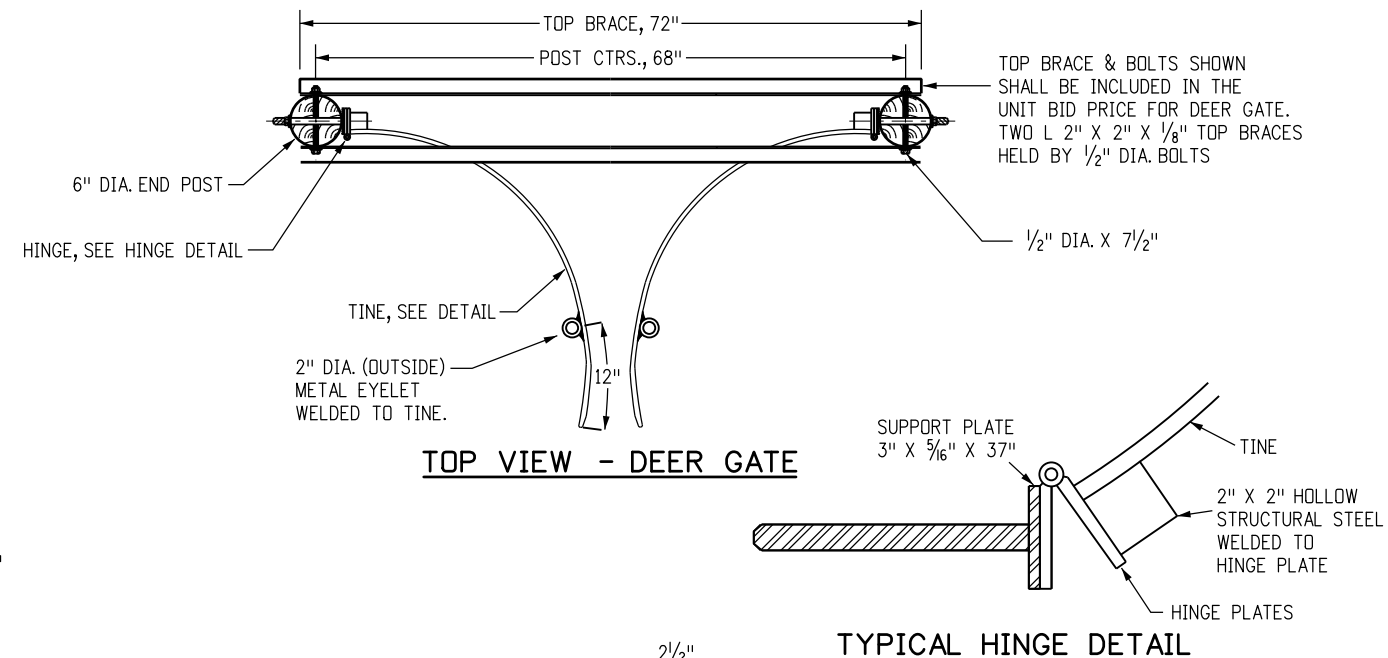

TOP VIEW - DEER GATE

TYPICAL HINGE DETAIL

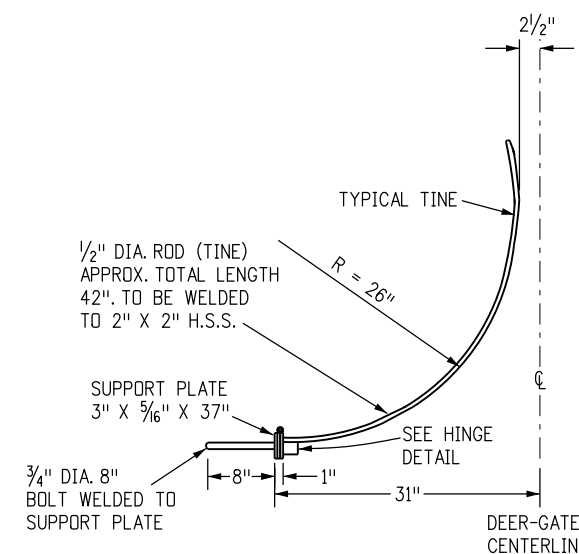


TYPICAL TINE DETAIL

Computer File Information		Sheet Revisions		 Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	DEER FENCE, GATES, AND GAME RAMPS	STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)	Date:	Comments		M-607-4	Standard Sheet No. 2 of 5
Designer Initials: JBK						
Last Modification Date: 07/31/19						
Detailer Initials: LTA						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English				Issued by the Project Development Branch: July 31, 2019	Project Sheet Number:	


NOTES

1. LOCATIONS OF DEER FENCE IN THE CLEAR ZONE SHALL BE SHOWN IN THE PLANS.
2. POSTS WITHIN THE CLEAR ZONE SHALL BE DRILLED.
3. DRILL HOLES PERPENDICULAR TO THE ROADWAY.
4. KNEE BRACE SHALL BE OMITTED FROM ANY END POST OR CORNER POST WITHIN THE CLEAR ZONE.


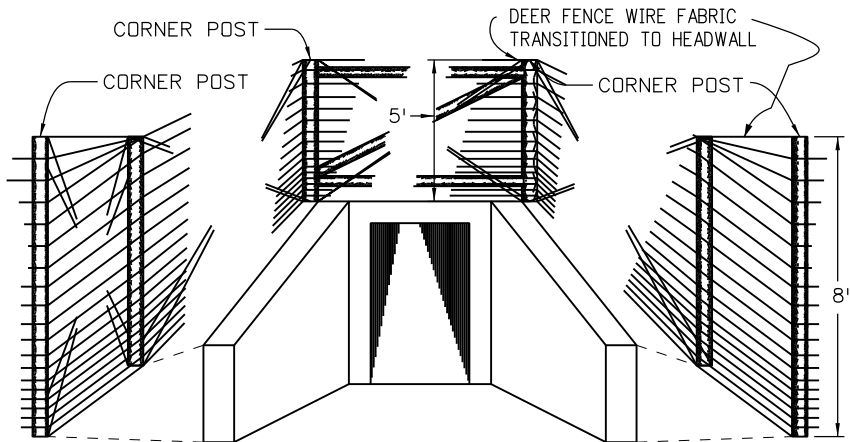


FENCE DEER OVER CONCRETE BOX CULVERT

FIVE FOOT POSTS AND WIRE FABRIC SHALL BE INSTALLED WHERE THE FENCE PASSES OVER A CBC AT LOCATIONS SHOWN IN THE PLANS. THIS WORK WILL BE PAID FOR AS FENCE DEER (SPECIAL).

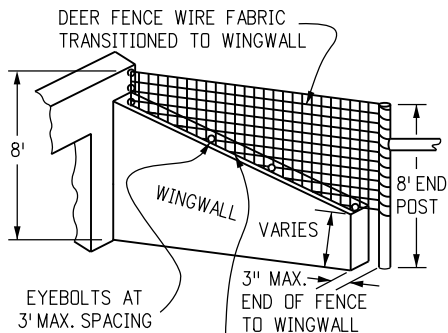


INSTALL 9 GA. WIRE THROUGH EYEBOLTS AND ATTACH FENCE FABRIC TO WIRE AT 1 FT. INTERVALS

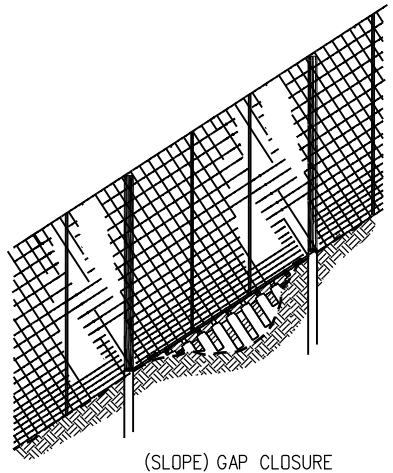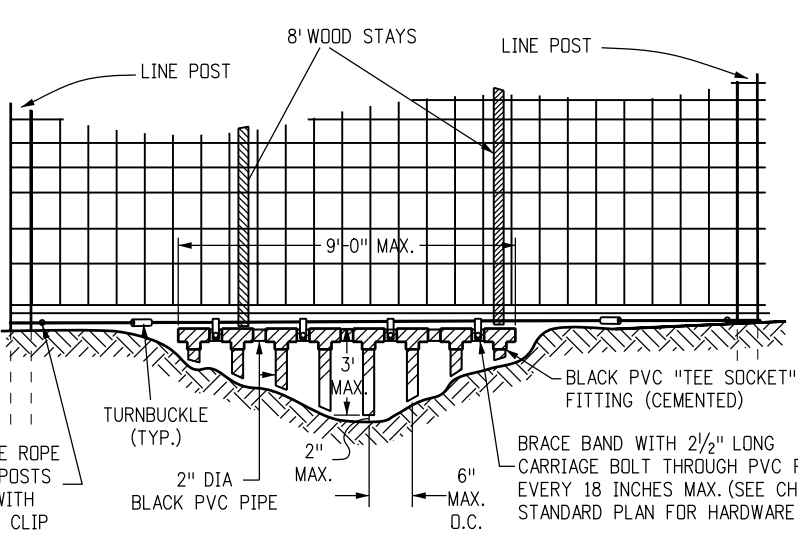


GAP CLOSURE

USE THIS DETAIL TO CLOSE ALL GAPS BETWEEN 6 INCHES AND 3 FEET. GAP CLOSURES SHALL BE INCLUDED IN THE PRICE OF THE FENCE AND NOT BE PAID FOR SEPARATELY.

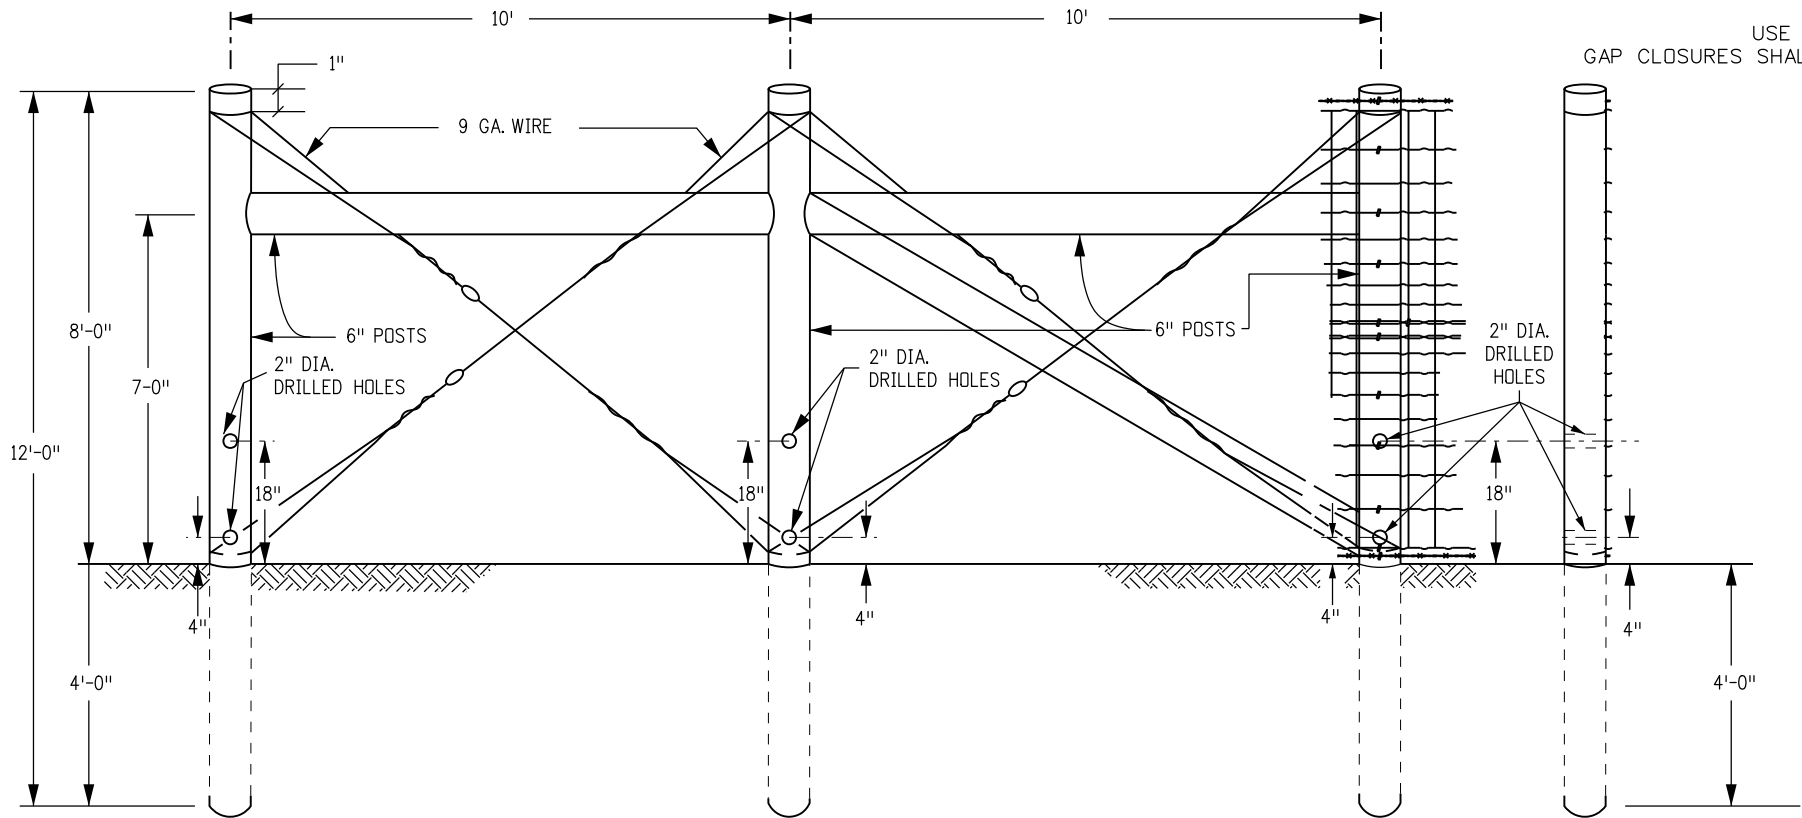

END POST AND CORNER POST

SIDE VIEW

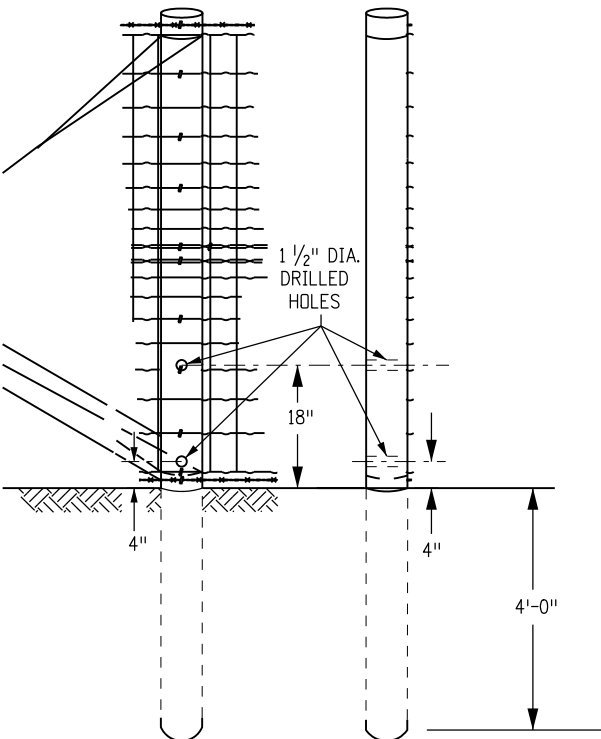

FRONT VIEW SIDE VIEW

5 IN. LINE POST

MODIFIED FOR PLACEMENT WITHIN ROADWAY CLEAR ZONE

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

Sheet Revisions

Date:	Comments

Colorado Department of Transportation



2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch

JBK

DEER FENCE, GATES,
AND GAME RAMPS


Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.


M-607-4

Standard Sheet No. 3 of 5


Project Sheet Number:

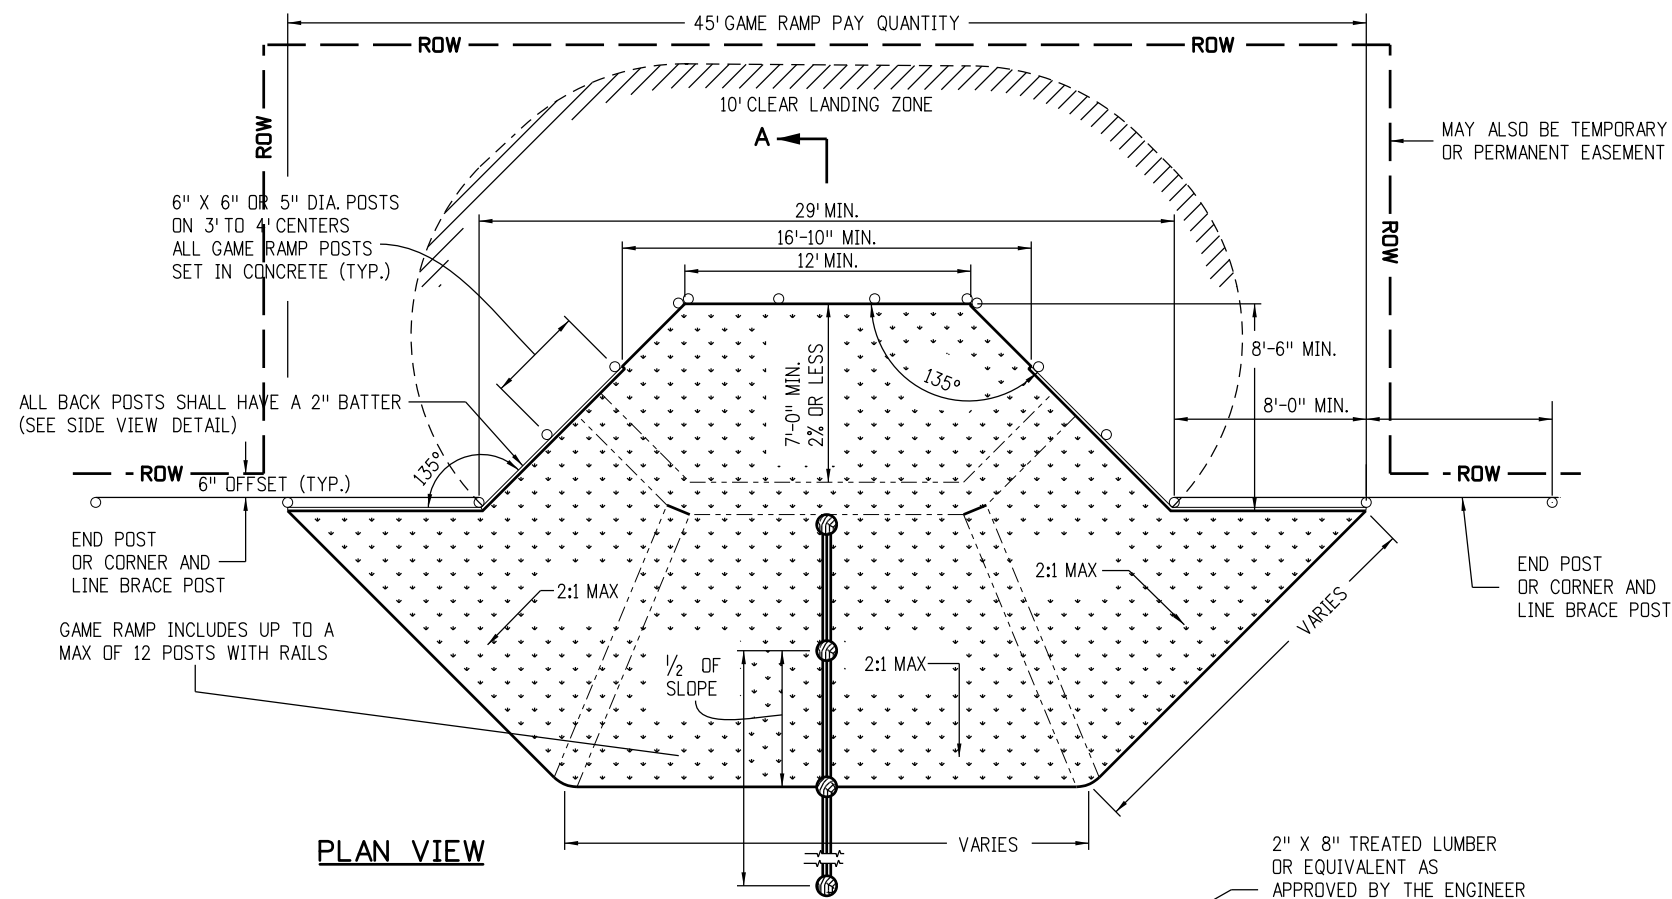

PLAN VIEW

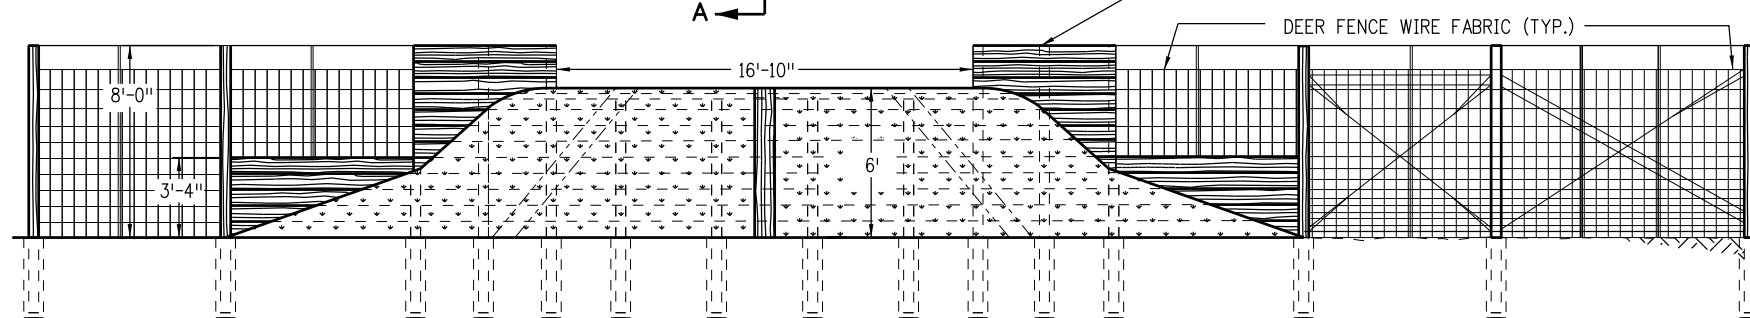


FRONT ELEVATION VIEW

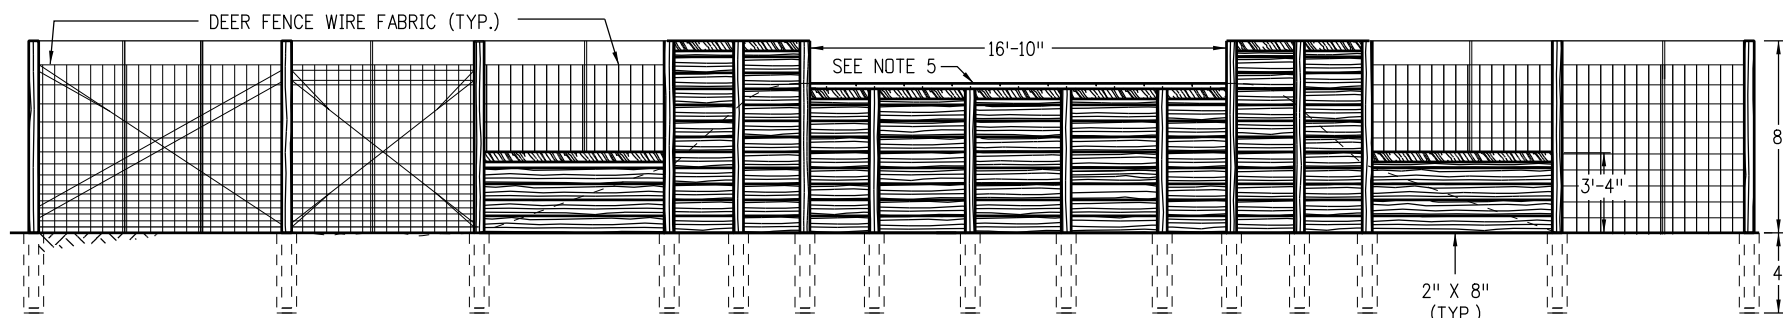


REAR ELEVATION VIEW

- NOTES**
1. THE LANDING ZONE SHALL BE FLAT, STABLE, AND EARTHEN. THE AREA SHALL BE VOID OF OBJECTS THAT MAY HINDER OR ENDANGER WILDLIFE. THE ENGINEER MAY ADJUST THE GAME RAMP LOCATION AS NEEDED.
 2. THERE SHALL BE NO DISTURBANCE BEYOND THE ROW OR TEMPORARY/PERMANANT EASEMENTS.
 3. FILL MATERIAL SHALL BE STRUCTURE BACKFILL (CLASS 2) AND MEET THE REQUIREMENTS OF SECTION 206 WITH A MINIMUM COMPACTION OF 90%.
 4. FOUR INCHES OF TOPSOIL SHALL BE PLACED IN ACCORDANCE WITH SECTION 207.
 5. FINISHED HEIGHT OF BACKFILL/TOPSOIL SHALL BE 2" ABOVE LUMBER.
 6. SEEDING SHALL BE COMPLETED AFTER THE ENGINEER APPROVES GRADING.
 7. SEE THE STORMWATER MANAGEMENT PLAN FOR THE SEEDING PLAN.
 8. GAME RAMP IS PAID PER REVISION OF SECTION 607, FENCES.

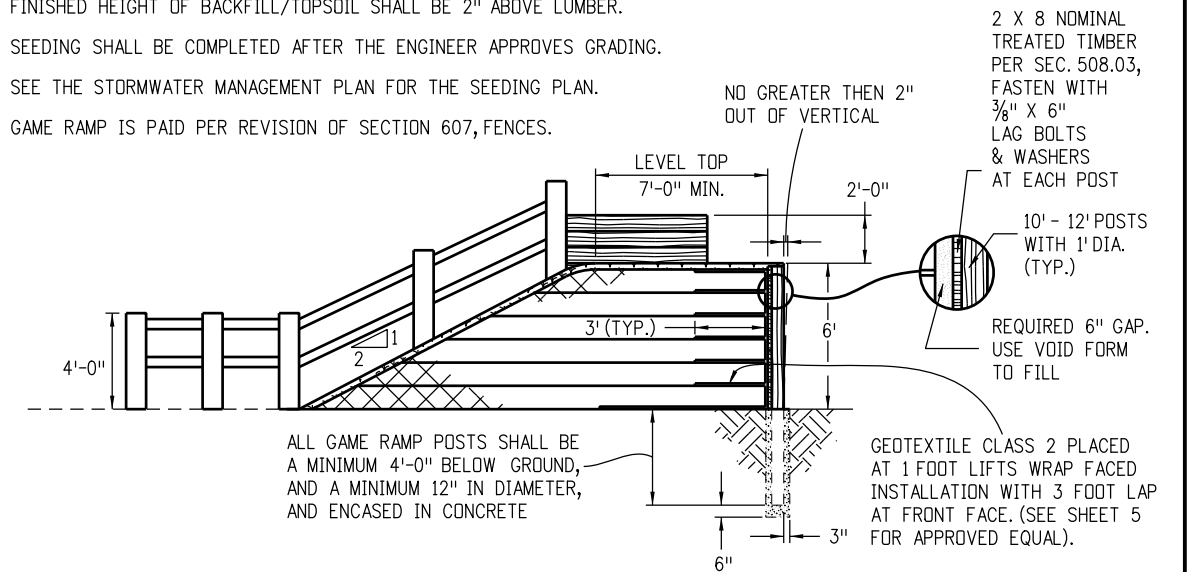


SECTION A-A

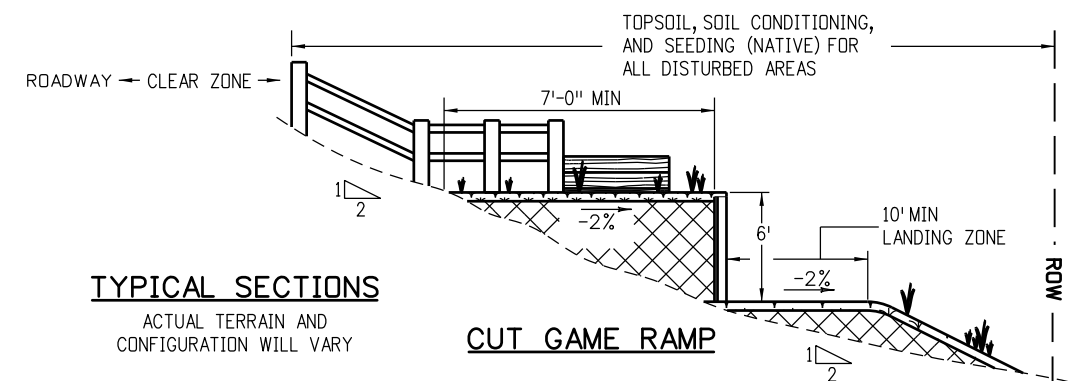

TYPICAL SECTIONS

CUT GAME RAMP

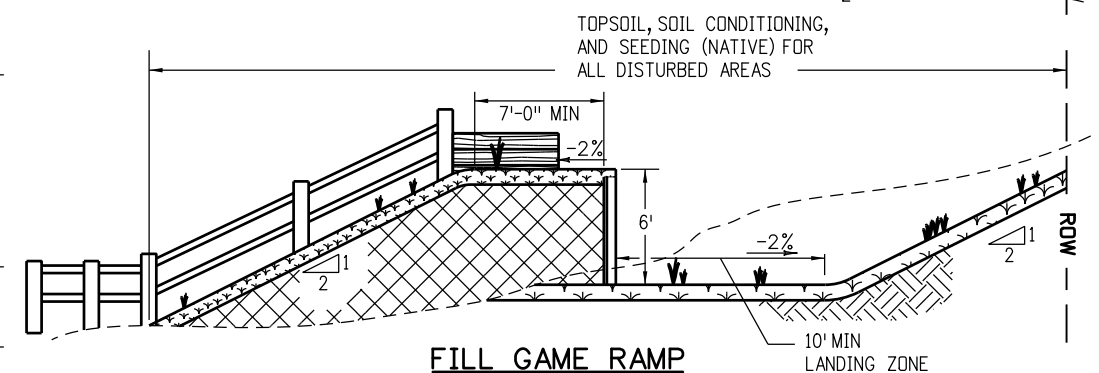

FILL GAME RAMP


Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments		M-607-4
Designer Initials: JBK	(R-X)				Standard Sheet No. 4 of 5
Last Modification Date: 07/31/19	(R-X)				
Detailer Initials: LTA	(R-X)				
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)			Issued by the Project Development Branch: July 31, 2019	Project Sheet Number:



NOTES



- | | | |
|---|---------------------------------|--|
| <p>1. GEOTEXTILE REINFORCEMENT SHALL BE WOVEN FABRIC WITH A MINIMUM AVERAGE ROLL VALUE OF 4800 LB/FT FOR INSTALLATIONS WITH A GAP AND 2400 LB/FT FOR INSTALLATIONS WITHOUT A GAP BASED ON ASTM D4595.</p> <p>2. GEOTEXTILE REINFORCEMENT SHALL BE PLACED BY ALTERNATING MACHINE DIRECTION (MD) WITH CROSS MACHINE DIRECTION (XD) FROM LAYER TO LAYER.</p> <p>3. THE GEOTEXTILE REINFORCEMENT WRAP AT BACK FACE OF GAME RAMP SHALL BE PULLED BACK SLACK FREE WITH ITS END ANCHORED TO SOIL UNDERNEATH WITH STAPLES OR PINS.</p> <p>4. MINIMUM SPLICE OF ALL GEOTEXTILE SHALL CONSIST OF 1 FOOT OF OVERLAP.</p> | <p><u>GAP DETAIL STEP 1</u></p> | <p><u>GAP DETAIL STEP 2</u></p> |
| | | <p>5. GEOTEXTILE REINFORCEMENT WRAP AT BACK FACE OF GAME RAMP WALL SHALL BE TEMPORARILY HUNG WITH A SPACER BOARD AND TACK STRIP. AFTER REACHING A TOTAL OF 2'-0" COMPACTED LIFT, THE TACK STRIP SHALL BE REMOVED AND GEOTEXTILE REINFORCEMENT SHALL BE PULLED BACK SLACK FREE WITH ITS END ANCHORED TO SOIL UNDERNEATH WITH STAPLE OR PINS BEFORE THE SPACER BOARD IS PULLED.</p> <p>6. DO NOT USE SPACER FOR THE TOP LIFT (FINAL LIFT). TOP LIFT SHALL ABUT THE GAME RAMP WALL.</p> |

Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	DEER FENCE, GATES, AND GAME RAMPS	STANDARD PLAN NO.	
Creation Date: 07/31/19			Date:	Comments			M-607-4	
Designer Initials: JBK							Standard Sheet No. 5 of 5	
Last Modification Date: 07/31/19								
Detailer Initials: LTA								
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English								Issued by the Project Development Branch: July 31, 2019

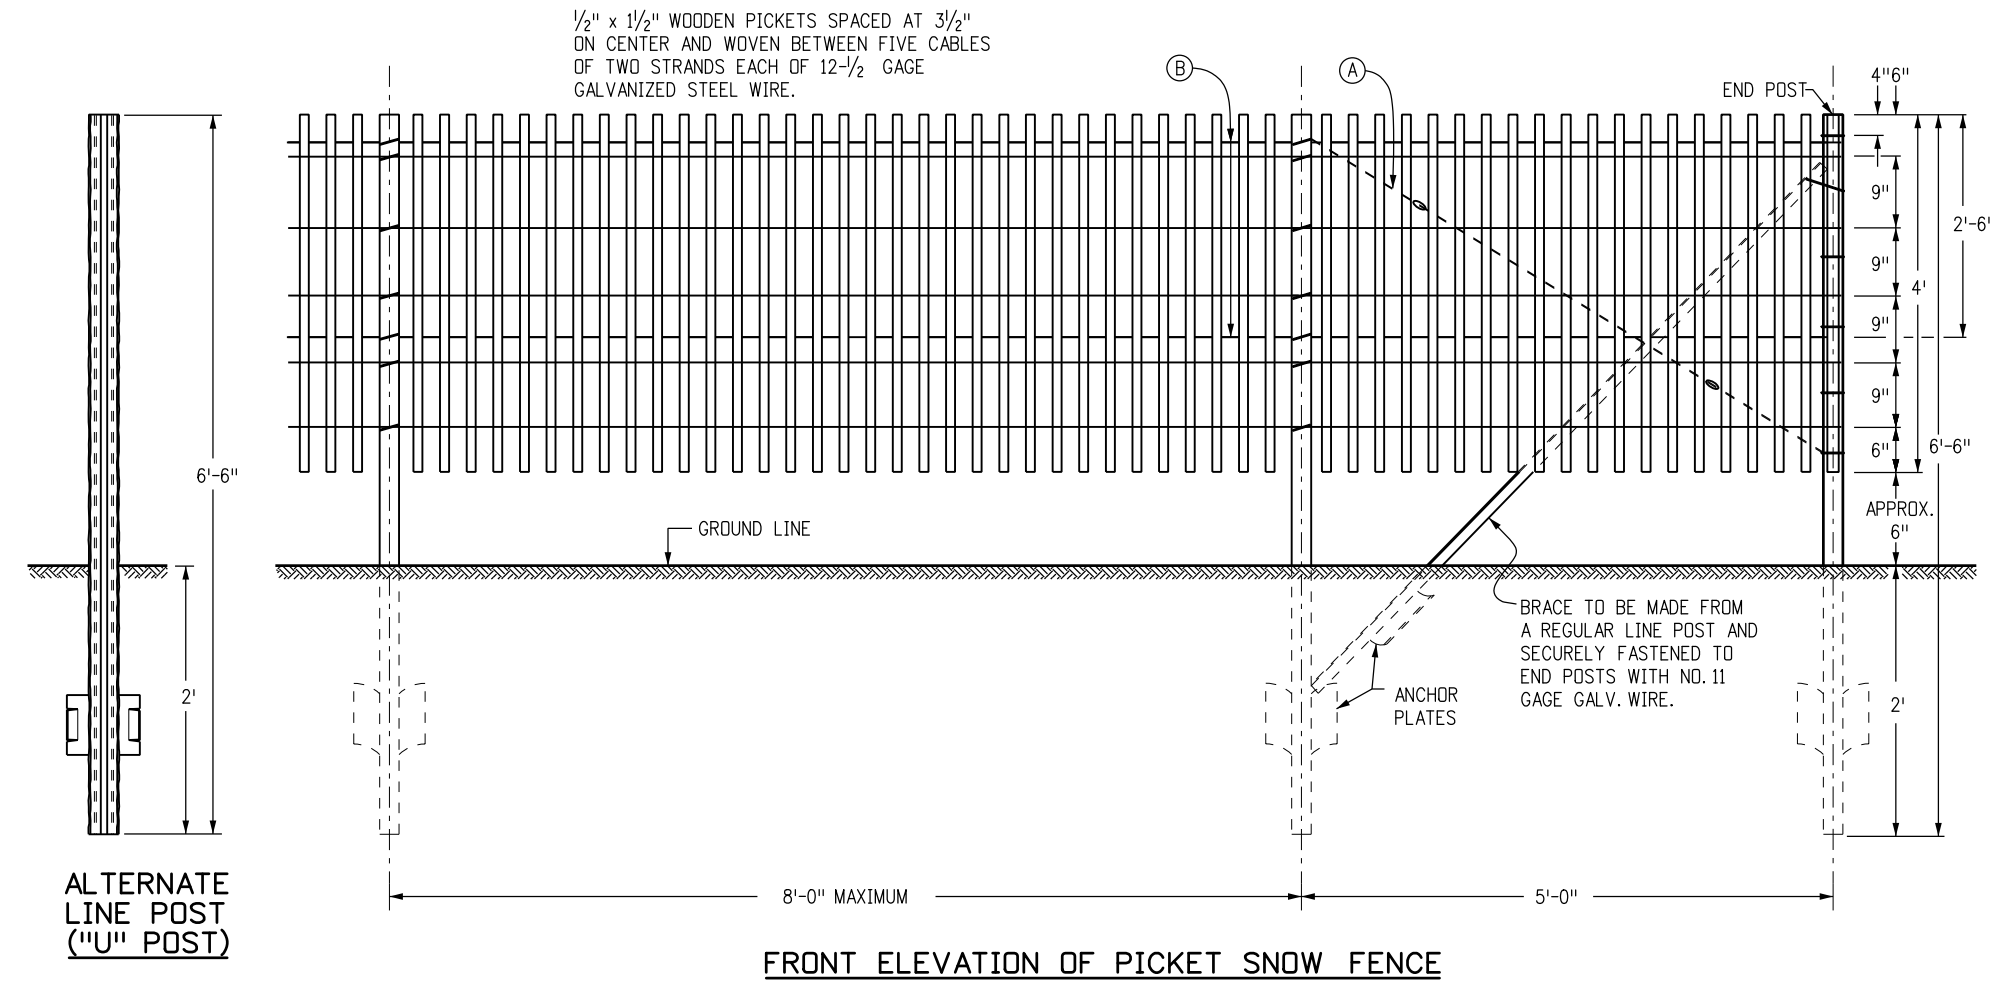

GENERAL NOTES

1. WIRE-BOUND PICKET FENCE, CONFORMING TO ASTM F 537, SHALL BE STRETCHED TIGHT AND SECURELY FASTENED TO ALL POSTS WITH 11 GAGE GALVANIZED STEEL WIRE CLAMPS OR 12-1/2 GAGE GALVANIZED STEEL WIRE TIES.
2. ALL FENCE POSTS COMPLETE WITH ANCHOR PLATE, SHALL BE HOT-DIPPED GALVANIZED CONFORMING TO AASHTO M 281. LINE POSTS (WITHOUT ANCHOR) SHALL WEIGH AT LEAST 1.33 LBS. PER LIN. FT. (RAW). SUITABLE ANCHOR PLATES SHALL BE SECURELY FASTENED TO EACH LINE POST AND SHALL WEIGH 0.67 LB. NOMINAL.
3. IN GENERAL, SNOW FENCE SHALL BE PLACED 100 TO 150 FT. FROM THE CENTERLINE OF ROADWAY. HOWEVER, THE SPECIFIC LOCATION ON EACH PROJECT WILL BE SHOWN ON THE PLANS, OR AS DETERMINED BY THE ENGINEER.
4. SNOW FENCE MAY BE PLACED IMMEDIATELY IN FRONT OF THE RIGHT OF WAY FENCE ON THE HIGHWAY SIDE WHEN SUCH LOCATION IS SUITABLE. THIS WILL AVOID TRAPPING OF WEEDS AND DEBRIS BETWEEN THE FENCES. IN SUCH INSTALLATIONS THE SNOW FENCE SHALL NOT BE TIED OR FASTENED TO THE RIGHT OF WAY FENCE.
5. FENCE SHALL BE SECURELY BRACED AT EACH END PANEL WITH A REGULAR LINE POST AND 1 DIAGONAL CABLE CONSISTING OF 2 STRANDS OF TWISTED WIRE. EACH STRAND TO CONSIST OF TWO 12-1/2 GAGE GALVANIZED WIRES (A).
6. LINE BRACE POSTS SHALL BE INSTALLED EVERY 400 FT. OR LESS WHERE THE FENCING IS CONTINUOUS AND SHALL NOT BE PAID FOR SEPARATELY BUT BE INCLUDED IN THE WORK.
7. TWO HORIZONTAL WIRES (B) SHALL BE STRUNG BEHIND THE PICKETS FOR THE FULL LENGTH OF THE FENCE. EACH HORIZONTAL WIRE SHALL CONSIST OF TWO 12 GAGE TWISTED GALVANIZED WIRES. EACH HORIZONTAL WIRE SHALL BE FASTENED SECURELY TO EACH FENCE POST BY MEANS OF 11 GAGE WIRE CLAMPS OR 12-1/2 GAGE WIRE TIES.

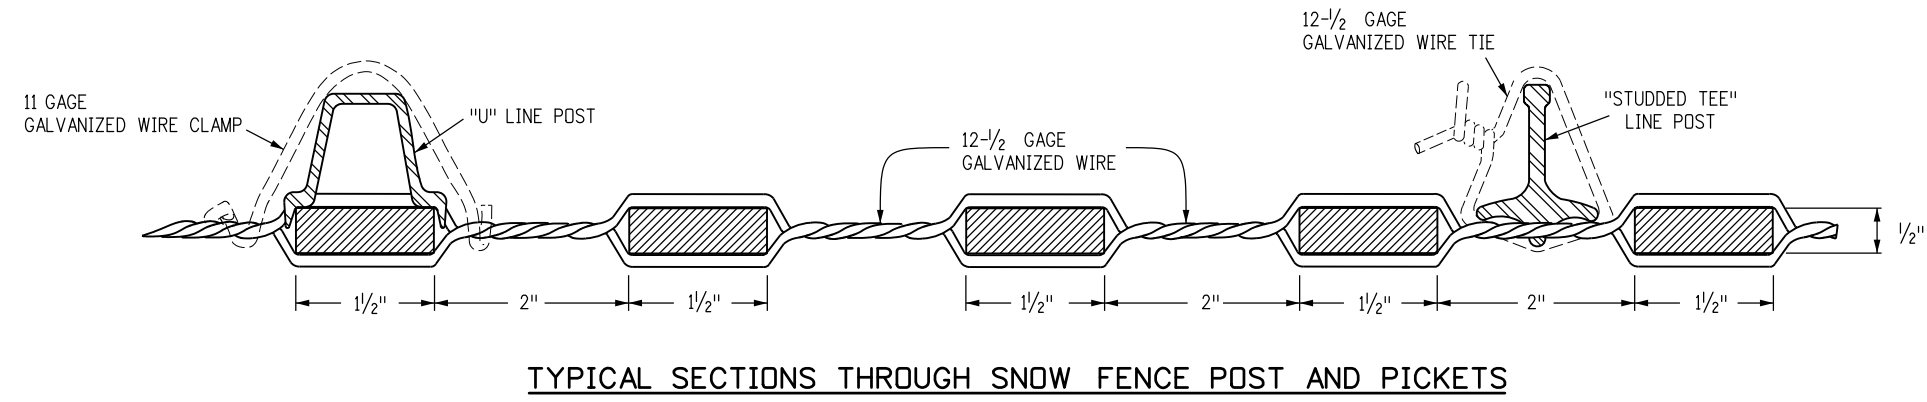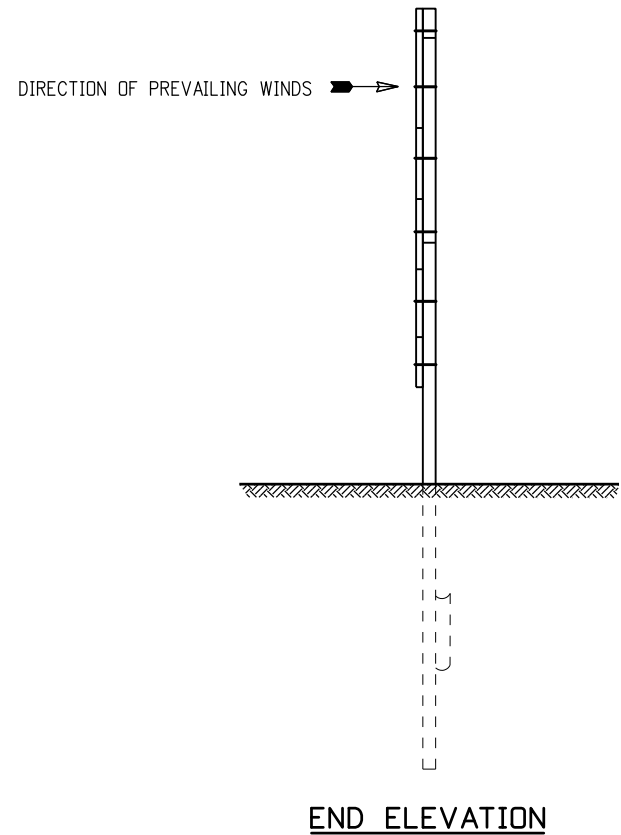

NOTE: OTHER SECTIONS OF STEEL POSTS HAVING EQUAL WEIGHT AND EQUIVALENT STRENGTH MAY BE USED IN LIEU OF EITHER OF THESE SECTIONS SHOWN.

Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	PICKET SNOW FENCE	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-607-10	
Designer Initials: JBK						Standard Sheet No. 1 of 1	
Last Modification Date: 07/31/19						Project Sheet Number:	
Detailer Initials: LTA							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)				Issued by the Project Development Branch: July 31, 2019		

GENERAL NOTES

1. STEEL LIGHT STANDARDS SHALL HAVE AN 8 IN. OUTSIDE DIAMETER AT THE BASE WITH A 3/16 IN. MINIMUM WALL THICKNESS, AND A UNIFORM TAPER THROUGHOUT. LIGHT STANDARDS SHALL BE ROUND OR TWELVE OR MORE SIDED, AND FABRICATED IN ACCORDANCE WITH SECTIONS 613 AND 715.

2. A CERTIFICATE OF COMPLIANCE (C.O.C) SHALL BE SUBMITTED TO THE ENGINEER AFTER FABRICATION OF THE LIGHT STANDARDS. THE C.O.C. SHALL BE SUBMITTED IN ACCORDANCE WITH SUBSECTION 106.12.

3. THE GATE ARM SHALL BE FABRICATED FROM HIGH STRENGTH RECTANGULAR FIBERGLASS AND 6061-T6 RECTANGULAR ALUMINUM TUBING. THE MAXIMUM ARM LENGTH SHALL BE 40 FT. THE FIBERGLASS/ALUMINUM GATE SHALL BE SUPPLIED BY SAFETRAN, B&B ELECTRONIC, OR AN APPROVED EQUIVALENT.

4. THE CONTRACTOR SHALL SURVEY THE CROSS SECTION OF THE ROADWAY, DETERMINE EACH GATE ARM LENGTH, AND SUBMIT THIS INFORMATION TO THE ENGINEER BEFORE ORDERING MATERIAL. THE LOCATION OF THE ROAD CLOSURE GATES AND THE REQUIRED MOUNTING HEIGHT OF THE GATE ARM PIVOT SHALL BE VERIFIED BY THE CONTRACTOR AND SUBMITTED TO THE ENGINEER.

5. A BREAKAWAY SHEAR PIN BASE IS REQUIRED FOR THE LIGHTWEIGHT ALUMINUM/FIBERGLASS ARMS. WHEN EXCESSIVE FORCE IS APPLIED TO THE GATE ARMS EQUIPPED WITH THE SHEAR PIN BASE, THE PIN SHALL SHEAR, AND THE ARM SHALL THEN SWING 45 DEGREES HORIZONTALLY AND DROP FREE OF THE GATE OPERATOR, MINIMIZING DAMAGE TO THE VEHICLE AND THE GATE.

6. THE HEIGHTS OF THE GATE ARM GUIDES WERE DETERMINED FOR A 29 FT. TALL TAPERED LIGHT STANDARD WITH A BASE DIAMETER OF 8 IN. AND A TOP DIAMETER OF 4 IN. GUIDE LOCATIONS MAY BE ADJUSTED FOR VARIOUS GATE ARM LENGTHS AND WARNING LIGHT SPACINGS. THE HEIGHT OF THE GATE ARM OVER THE ROADWAY SHALL BE 3 FT. - 7 IN. TO 4 FT. - 7 IN. FROM THE BOTTOM OF THE ARM TO THE ROADWAY.

7. THE WORM GEAR WINCH AND CABLE SHALL BE MANUFACTURED BY DUTTON-LAINSON, MFR. MODEL NO. WG2000, WITH A 7/32" THICK CABLE, AND A PULL CAPACITY OF 2000 LBS.
8. WHEN THE GATE IS FULLY RAISED, THE NUT AND WASHER SHALL FIT SNUGLY AGAINST THE OUTSIDE OF THE REAR CHANNEL AND BE PADLOCKED IN PLACE. THE CONTRACTOR SHALL SUPPLY ONE HEAVY, WEATHERPROOF PADLOCK WITH TWO KEYS FOR EACH GATE ARM PIVOT. INFORMATION ON THE KEY TYPE REQUIREMENTS WILL BE PROVIDE BY THE ENGINEER. PAIRED PIVOTS FOR DIVIDED HIGHWAYS SHALL BE KEYED ALIKE.

9. ELECTRICAL CONNECTION TO THE POWER SOURCE SHOWN ON THE PLANS WILL BE PAID FOR BY FORCE ACCOUNT. IF NO POWER SOURCE IS AVAILABLE, OMIT THE LUMINAIRE AND USE BATTERY OR SOLAR PANEL POWER FOR THE LED LIGHTS AS APPROVED BY THE ENGINEER.


10. GATE WARNING LIGHTS SHALL BE RED LED (TYPE B) HIGH INTENSITY. THE LIGHT AT THE END OF THE ARM NEAR THE CENTERLINE OF THE ROADWAY SHALL BE STEADY BURN. THE OTHER TWO LIGHTS SHALL FLASH AT THE RATE REQUIRED BY THE "MUTCD". SPACING OF THE LIGHTS SHALL VARY BASED ON ROADWAY WIDTH AND GATE ARM LENGTH. THE CONTRACTOR SHALL DETERMINE THE SPACING AND SUBMIT THE LED LAYOUT TO THE ENGINEER FOR VERIFICATION PRIOR TO PLACEMENT.

11. GALVANIZING: THE STEEL LIGHT STANDARDS, MAST ARMS, DROP GATE PIVOTS, SUPPORTS, GUIDES, AND ALL ASSOCIATED HARDWARE SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 715. ALL ROUGH EDGES AND BURRS SHALL BE GROUNDED SMOOTH PRIOR TO GALVANIZING.


12. BOLTED CONNECTIONS: ALL BOLTS SHALL CONFORM TO ASTM A 307, GRADE A, UNLESS DESIGNATED AS HS (HIGH STRENGTH). HS BOLTS SHALL CONFORM TO ASTM A 325. AFTER THE ROAD CLOSURE GATE IS ASSEMBLED, ALL EXPOSED BOLT THREADS SHALL BE PAINTED WITH TWO COATS OF ALUMINUM PAINT. THE ALUMINUM PAINT SHALL MEET THE REQUIREMENTS OF SUBSECTION 708.04.

13. FIELD ASSEMBLY: IN SOME INSTALLATIONS, THE CONNECTION PLATES FOR THE LUMINAIRE ARMS MAY REQUIRE MODIFICATION TO ALLOW THE PIVOT SLEEVE TO SLIP OVER. ALL DAMAGE TO THE GALVANIZING SHALL BE REPAIRED WITH TWO COATS OF ALUMINUM PAINT.


Computer File Information		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development BranchJBK	ROAD CLOSURE GATE		STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)		Date:	Comments	M-607-15	
Designer Initials: JBK					Standard Sheet No. 1 of 9	
Last Modification Date: 07/31/19					Project Sheet Number:	
Detailer Initials: LTA						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English						

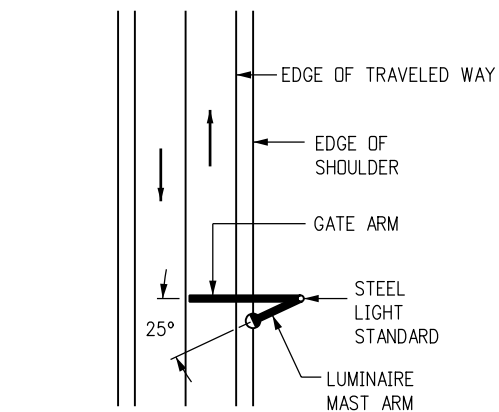


**TWO-WAY HIGHWAY
(ONE GATE REQUIRED)**

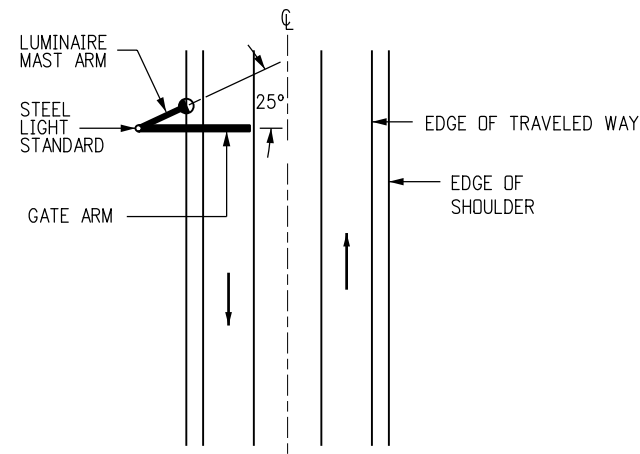

**TWO-LANE DIVIDED
HIGHWAY WITH MEDIAN
(ONE GATE REQUIRED)**

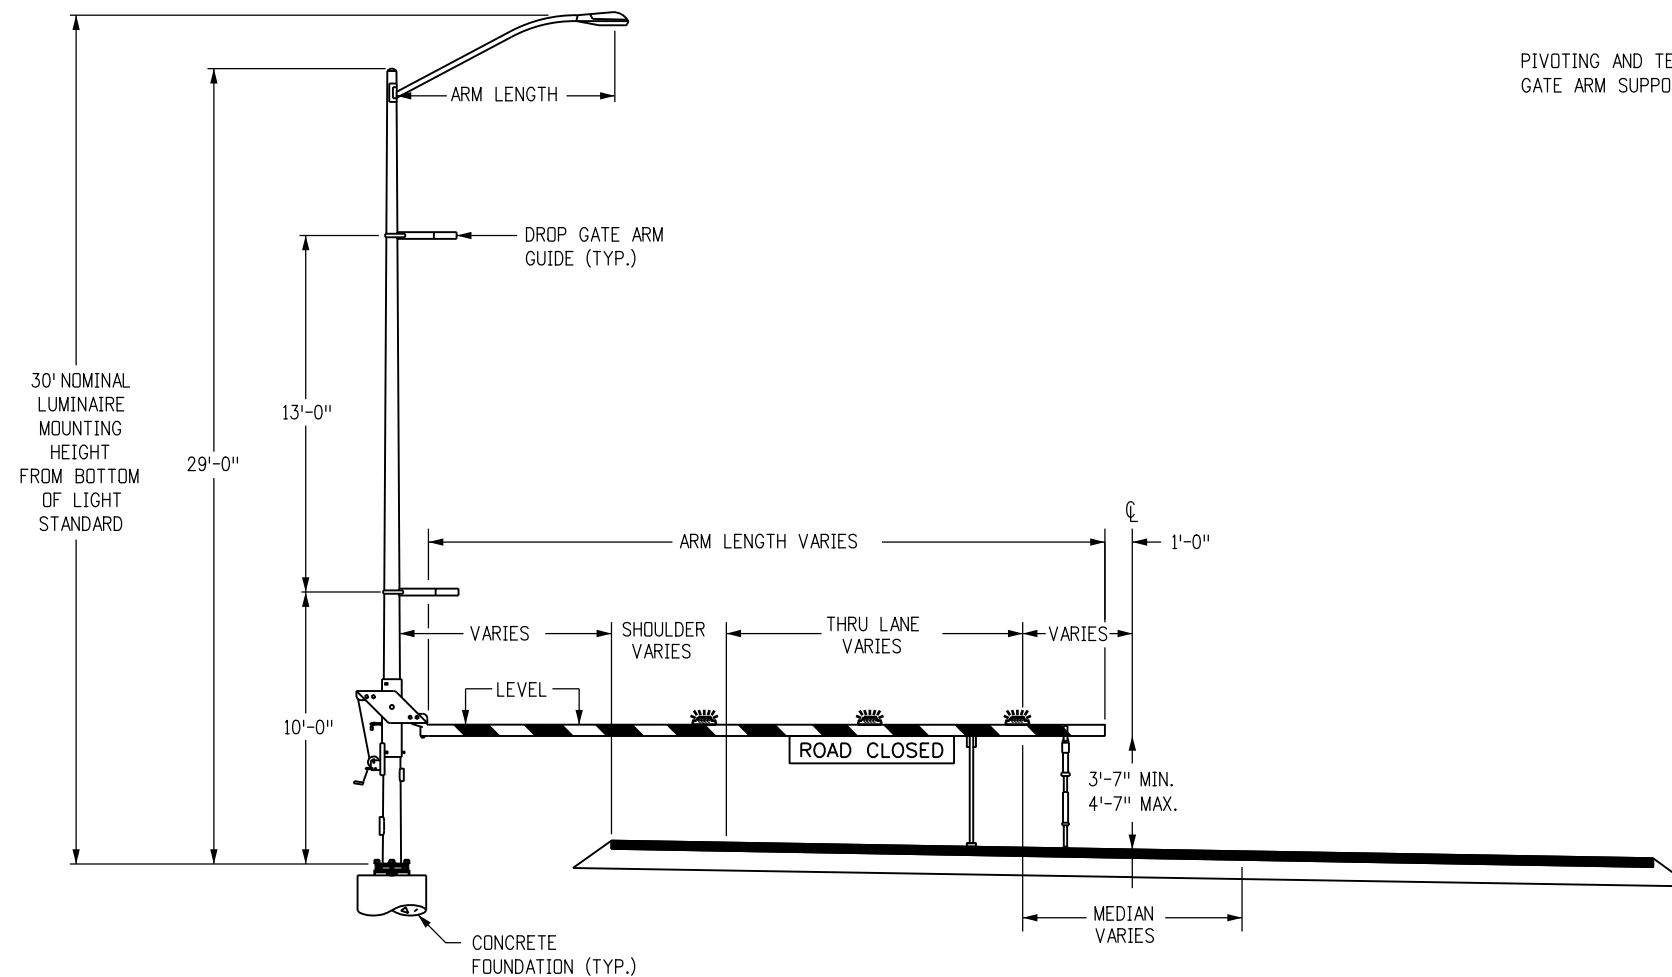


TYPICAL LOWERED POSITION

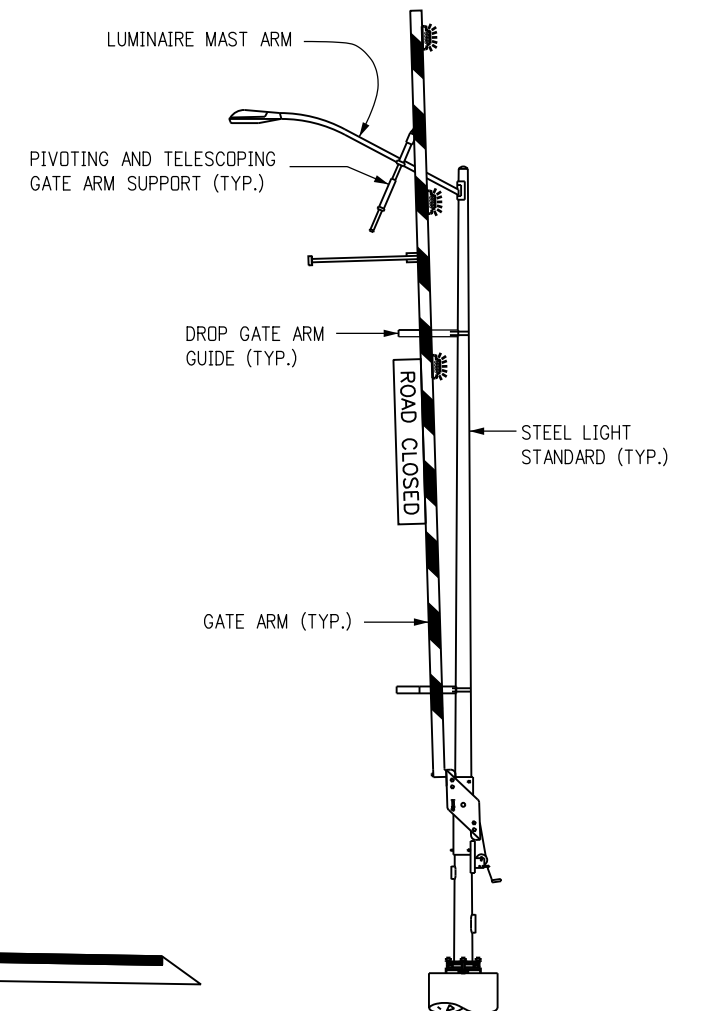


TYPICAL RAISED POSITION


Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	ROAD CLOSURE GATE Issued by the Project Development Branch: July 31, 2019		STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments				M-607-15
Designer Initials: JBK	(R-X)						Standard Sheet No. 2 of 9
Last Modification Date: 07/31/19	(R-X)						Project Sheet Number:
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English							

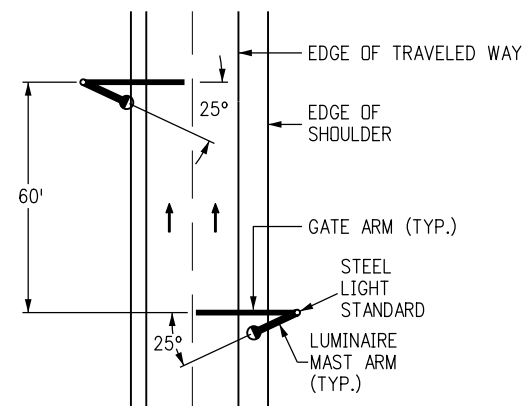

DIVIDED HIGHWAY INSTALLATION
(TWO GATES REQUIRED)


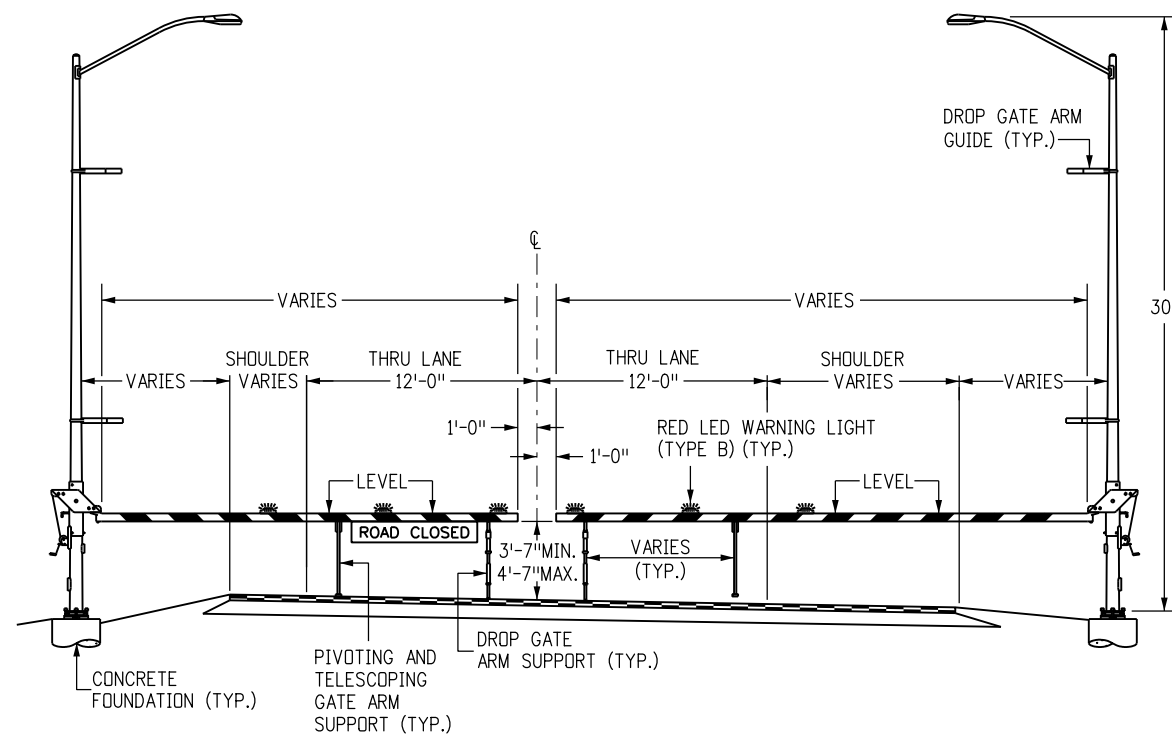


INTERSTATE MAINLINE


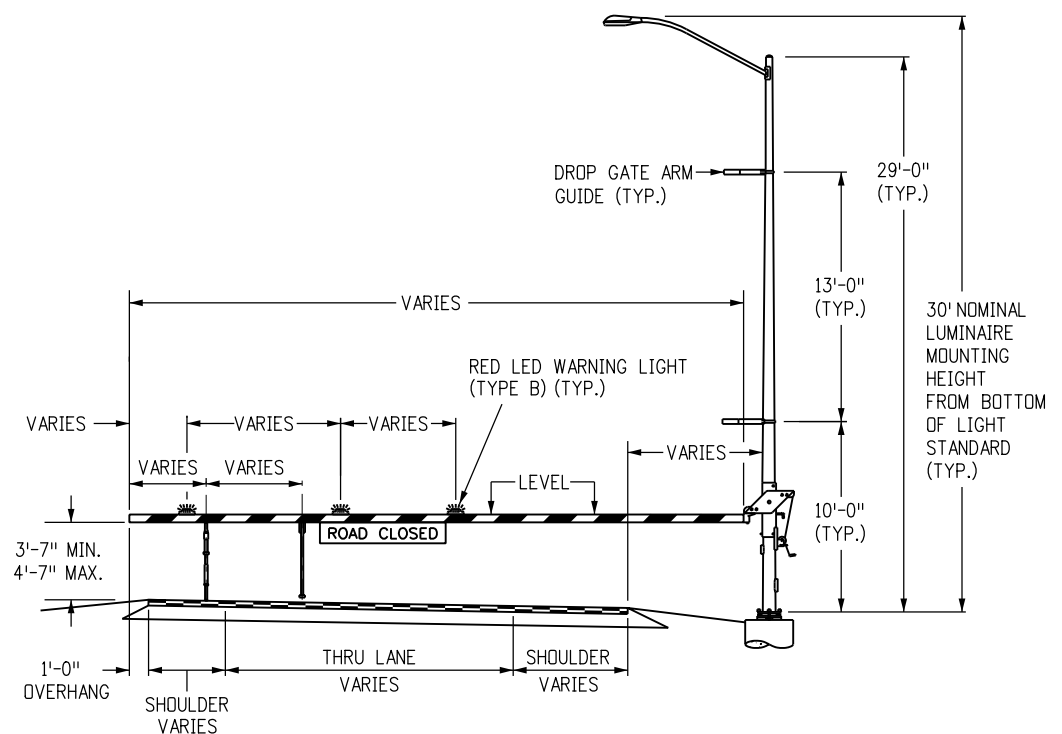


LUMINAIRE AND GATE
(RAMP LOCATIONS)



Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDDT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development BranchJBK	ROAD CLOSURE GATE		STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)	Date:	Comments		M-607-15		Standard Sheet No. 3 of 9	
Designer Initials: JBK								
Last Modification Date: 07/31/19								
Detailer Initials: LTA								
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English					Issued by the Project Development Branch: July 31, 2019	Project Sheet Number:		

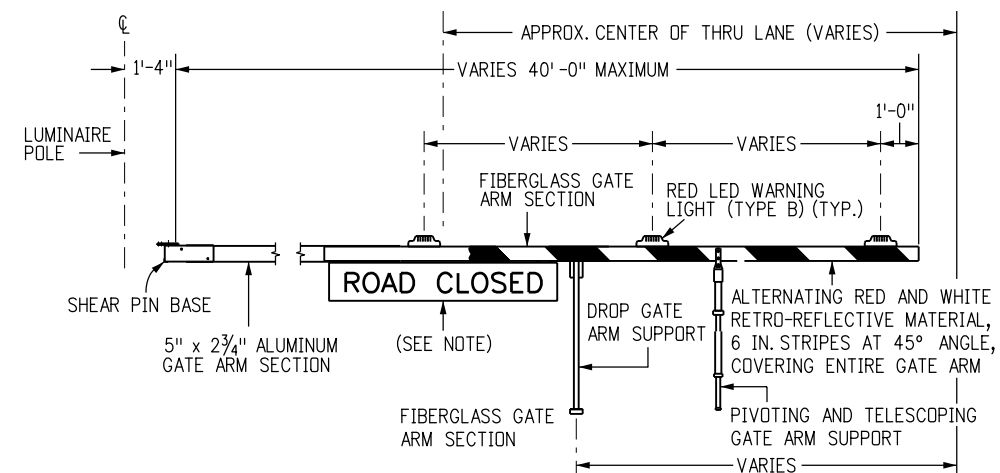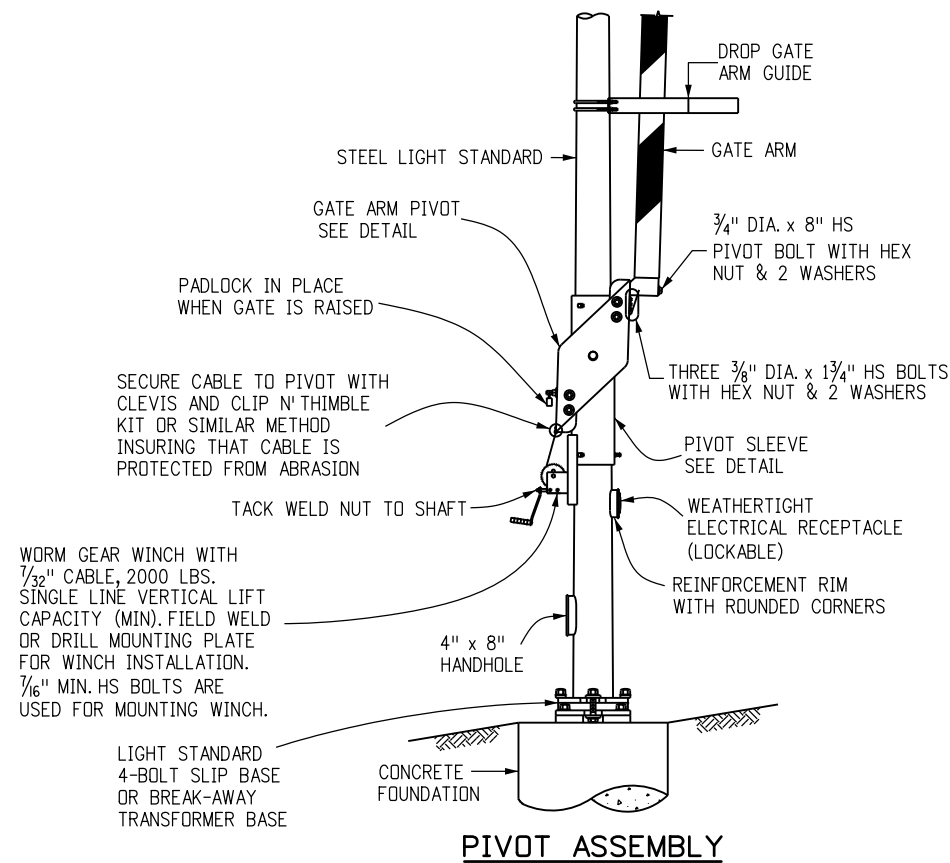




NOTE: PLACE THE BLACK AND WHITE "ROAD CLOSED" SIGN IN THE CENTER OF THE THROUGH LANE. THE SIGN LETTERS WILL BE 6" IN HEIGHT.

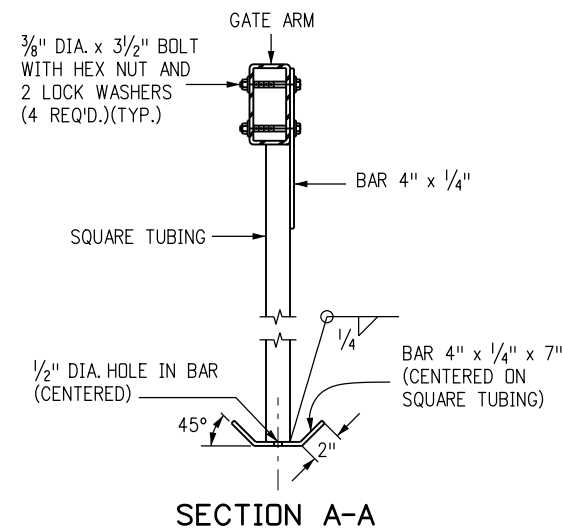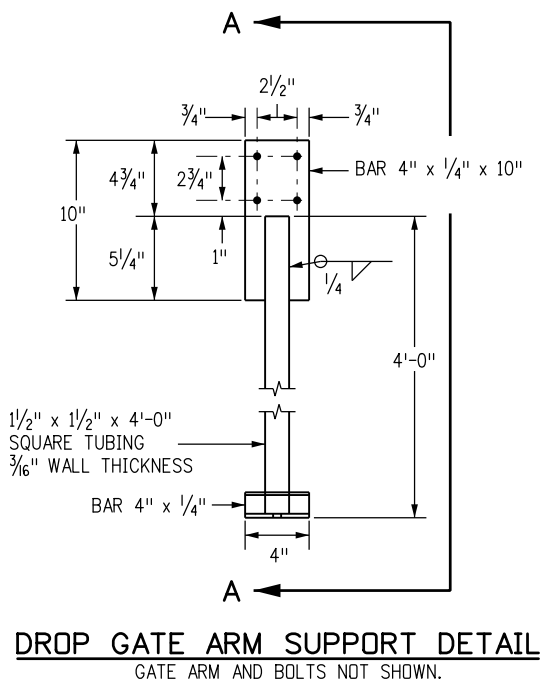

Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	ROAD CLOSURE GATE Issued by the Project Development Branch: July 31, 2019		STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments				M-607-15
Designer Initials: JBK	(R-X)						Standard Sheet No. 4 of 9
Last Modification Date: 07/31/19	(R-X)						Project Sheet Number:
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English							

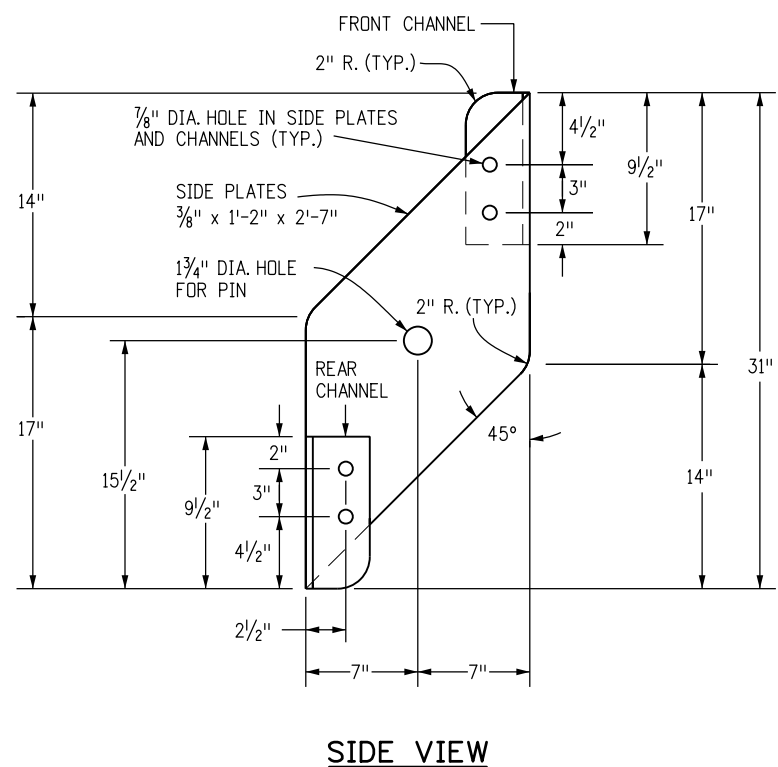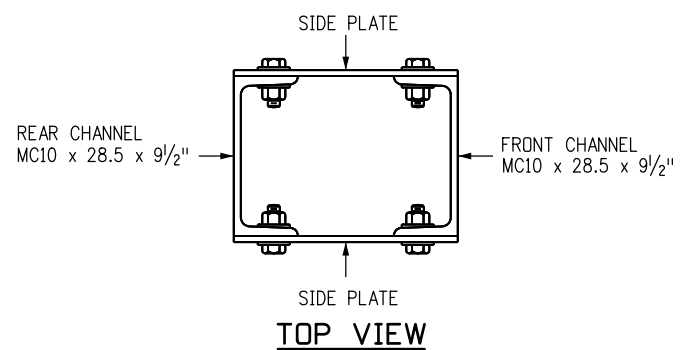


GATE ARM PIVOT SIDE PLATE DETAIL

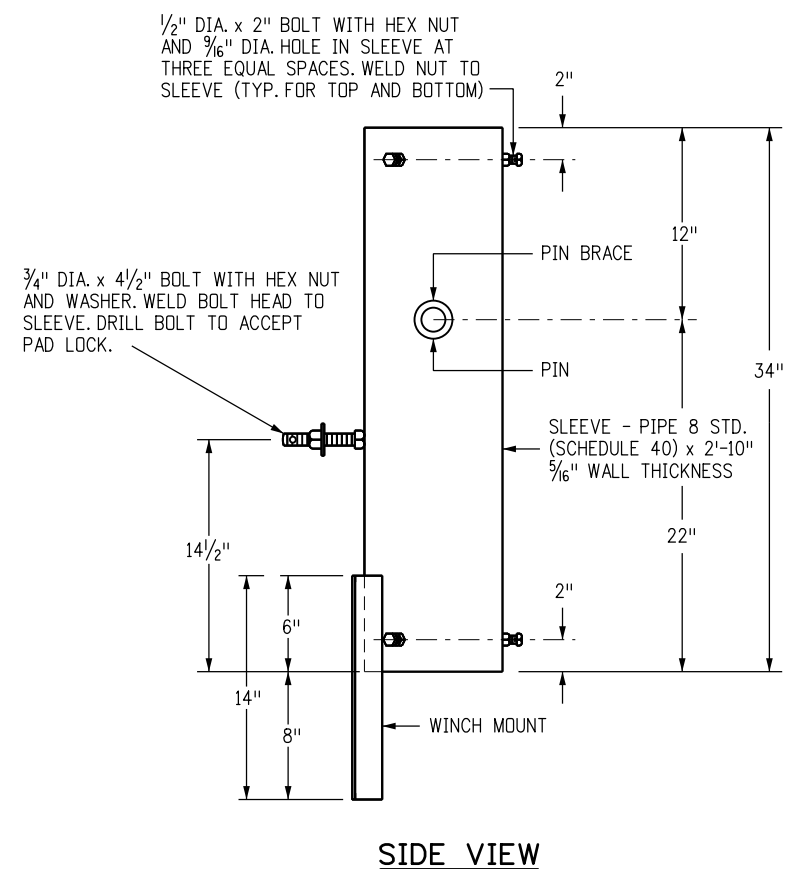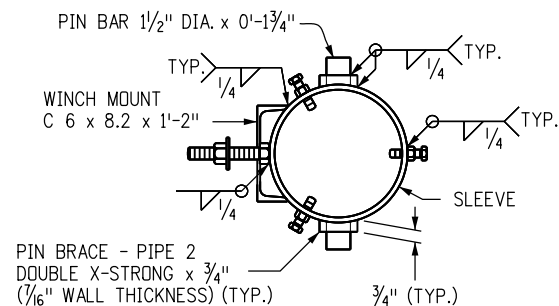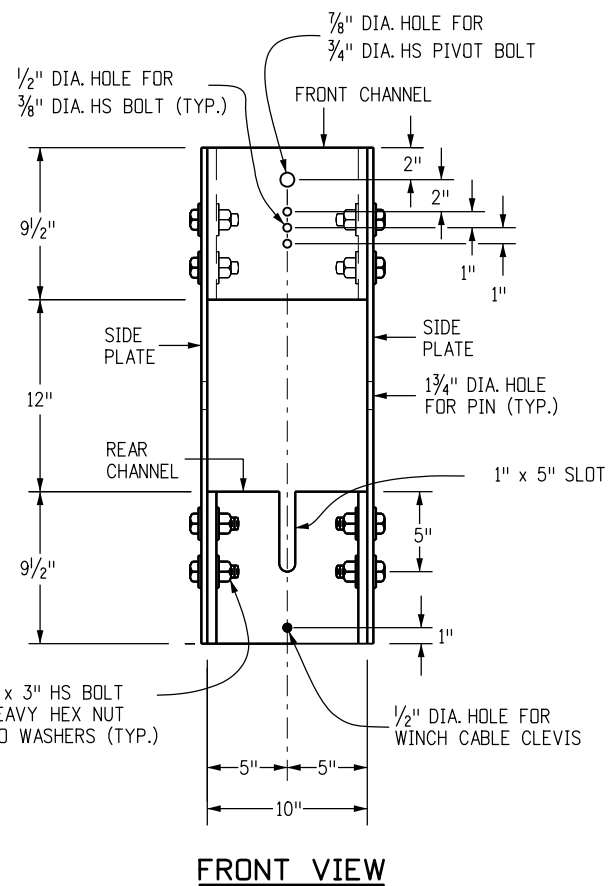


PIVOT SLEEVE DETAIL


Computer File Information		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	Sheet Revisions		ROAD CLOSURE GATE		STANDARD PLAN NO.	
Creation Date: 07/31/19			Date:	Comments	M-607-15		Standard Sheet No. 5 of 9	
Designer Initials: JBK	(R-X)							
Last Modification Date: 07/31/19	(R-X)							
Detailer Initials: LTA	(R-X)							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English			(R-X)		Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:	

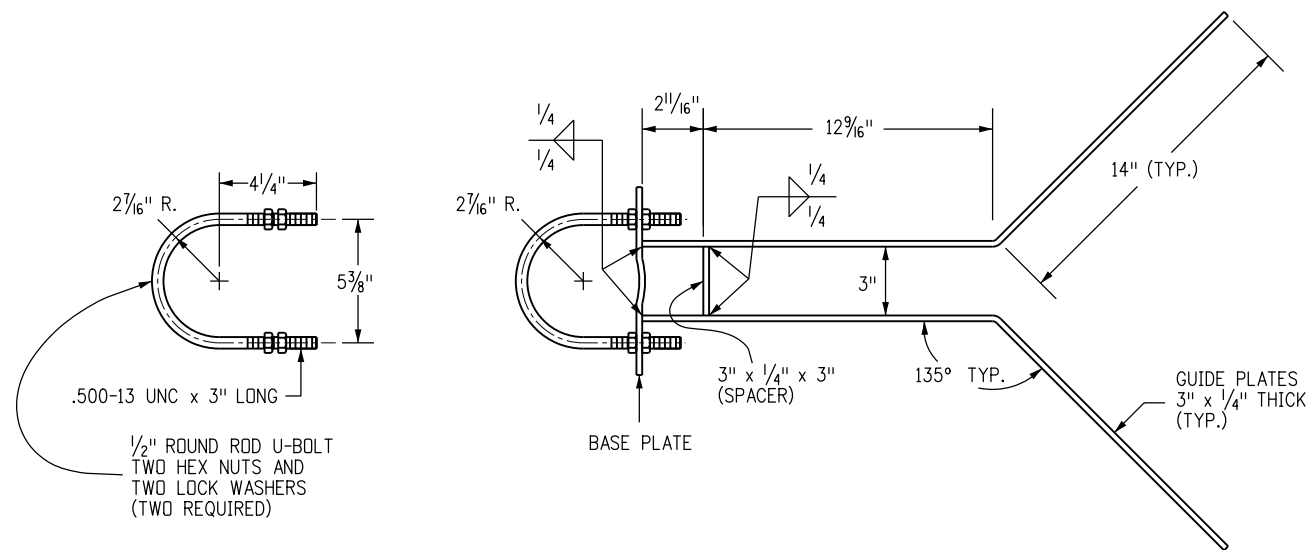


TOP GATE ARM GUIDE

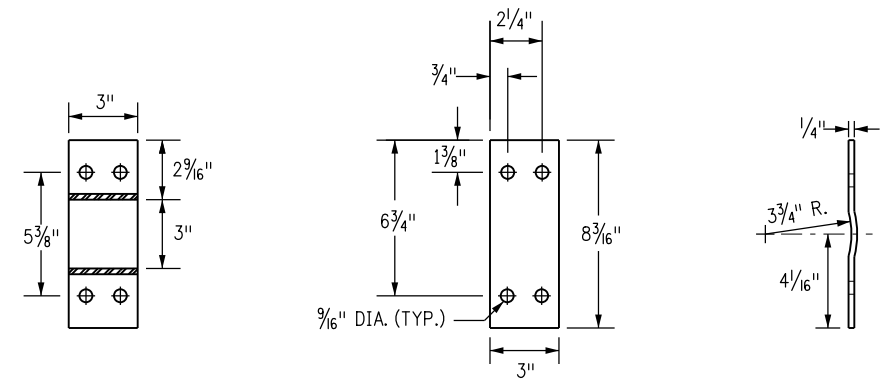

TOP BASE PLATE DETAILS

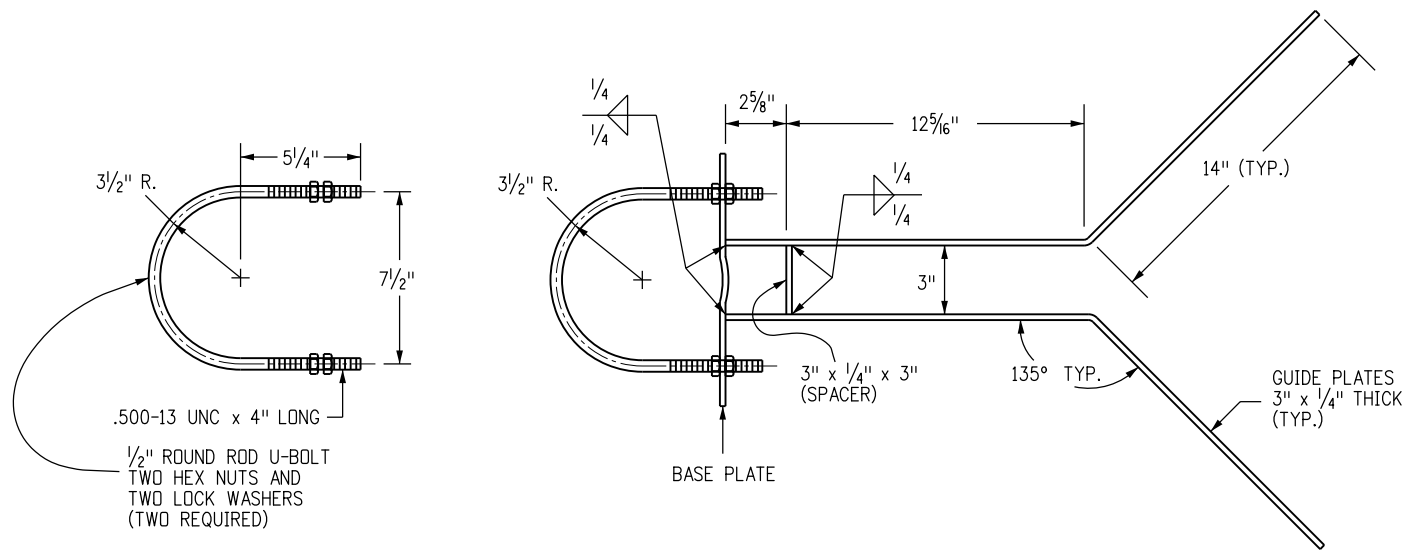


BOTTOM GATE ARM GUIDE

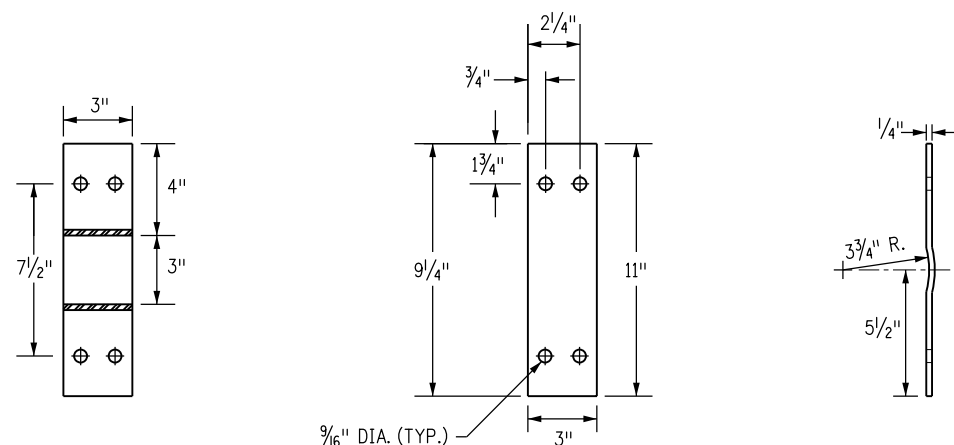


BOTTOM BASE PLATE DETAILS

Computer File Information			Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	ROAD CLOSURE GATE		STANDARD PLAN NO.	
Creation Date: 07/31/19			Date:	Comments		M-607-15			
Designer Initials: JBK	(R-X)					Standard Sheet No. 6 of 9			
Last Modification Date: 07/31/19	(R-X)								
Detailer Initials: LTA	(R-X)								
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)					Issued by the Project Development Branch: July 31, 2019			
						Project Sheet Number:			

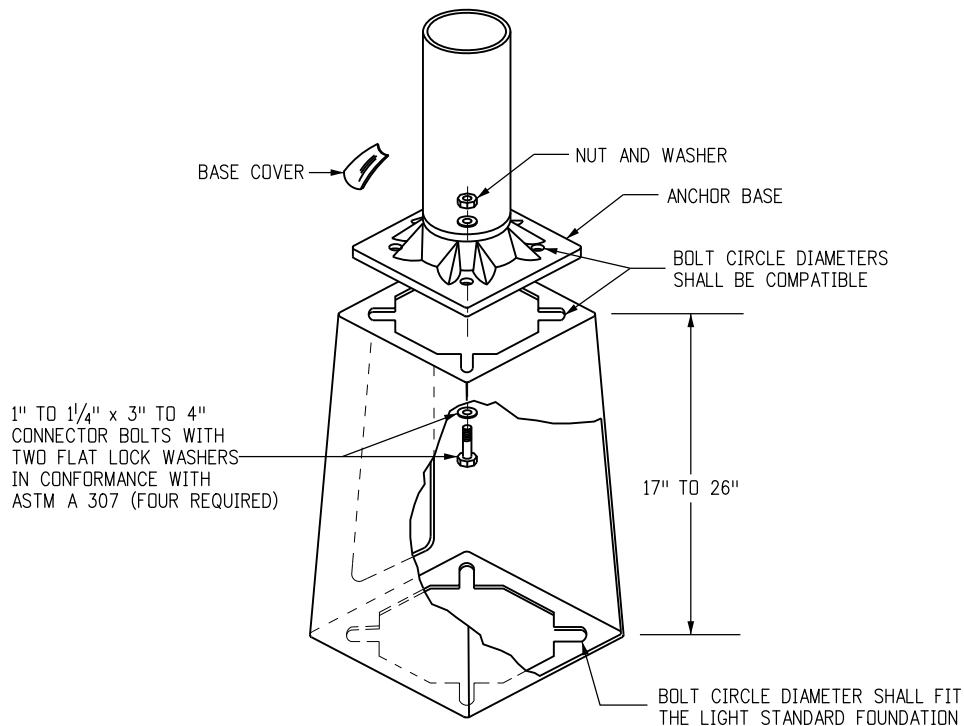


TYPICAL BREAK-AWAY TYPE TRANSFORMER BASE DETAIL

- NOTES:
1. HARDWARE SHALL CONFORM TO MANUFACTURER'S REQUIREMENTS.
 2. A HAND HOLE IS NOT REQUIRED IN POLE IF A BREAK-AWAY TRANSFORMER BASE IS USED.

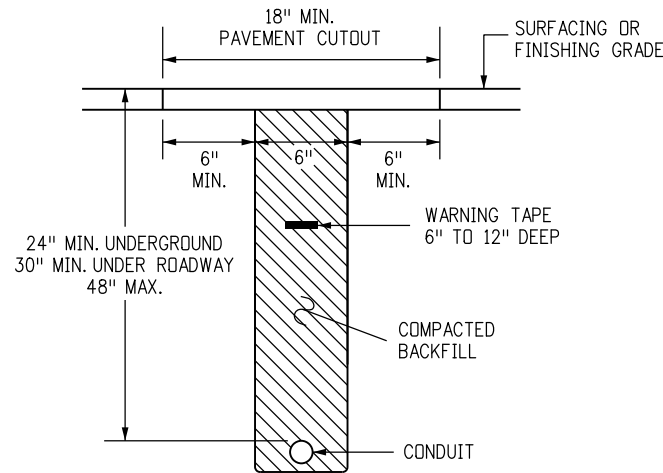


TYPICAL CONDUIT BURIAL SECTION

- NOTES:
1. THE CONTRACTOR SHALL COORDINATE TRENCHING WITH OTHER UNDERGROUND UTILITIES, RAMP METERING, AND IRRIGATION. THE CONTRACTOR SHALL USE COMMON TRENCHES AT ALL ROAD CROSSINGS WHERE POSSIBLE.
 2. ONE #14 AWG LOCATE WIRE AND A NYLON PULL STRING IN ALL EMPTY CONDUITS.

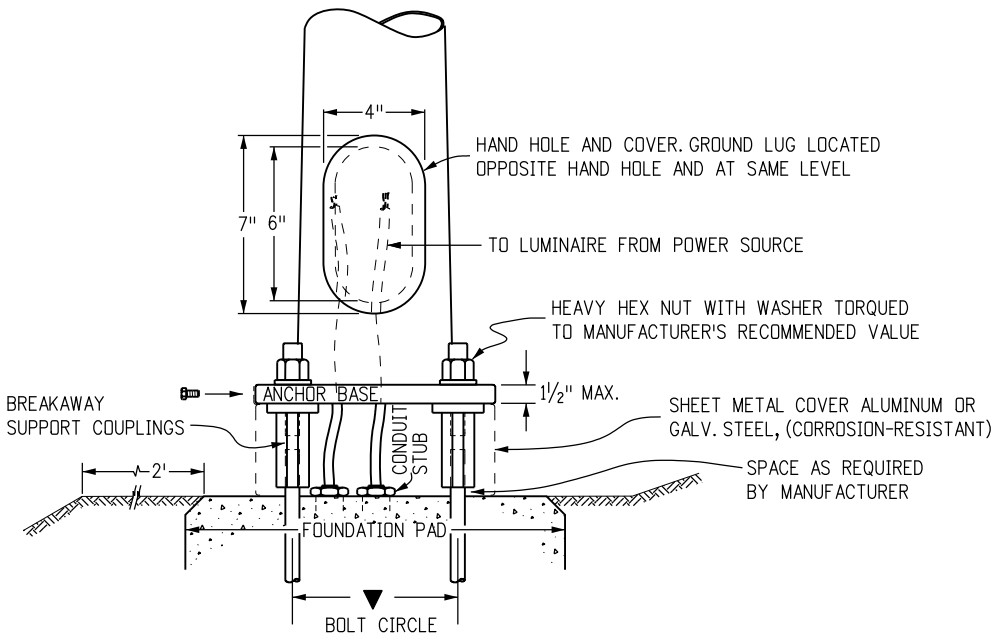


BREAK-AWAY SUPPORT COUPLING

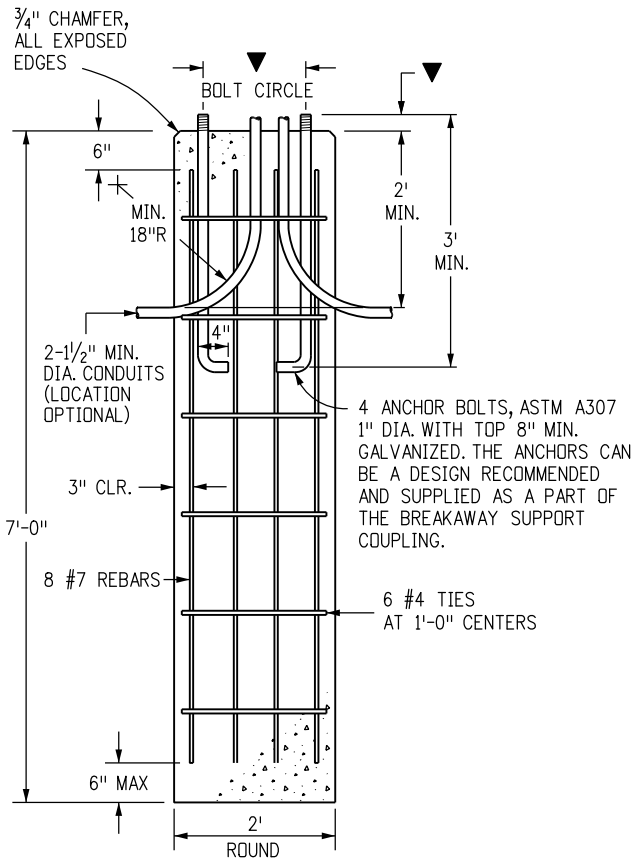

TYPICAL CONCRETE FOUNDATION


FOUNDATION NOTES

1. SEE POLE SUPPLIER DETAILS FOR BOLT CIRCLE AND PROJECTION.
2. ALL BREAKAWAY SUPPORT COUPLINGS SHALL MEET THE BREAKAWAY REQUIREMENTS STATED IN THE LATEST EDITION OF AASHTO "STANDARD SPECIFICATIONS FOR STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINAIRES AND TRAFFIC SIGNALS".
3. BREAKAWAY SUPPORT COUPLINGS SHALL BE INSTALLED IN CONFORMANCE WITH THE MANUFACTURER'S RECOMMENDATIONS. THE CONTRACTOR SHALL HAVE A COUPLING MANUFACTURER'S REPRESENTATIVE ON THE PROJECT PRIOR TO CONSTRUCTION TO INSTRUCT THE CONTRACTOR AND PROJECT PERSONNEL IN THE PROPER INSTALLATION OF THE BREAKAWAY SUPPORT COUPLINGS.
4. LIGHT STANDARD FOUNDATIONS MAY BE PRECAST CONCRETE OR CAST-IN PLACE CONCRETE.
5. CONCRETE SHALL BE CLASS B.
6. EACH LIGHT STANDARD SHALL BE WIRED WITH A BREAKAWAY FUSED CONNECTOR AND BE GROUNDED AS STATED IN THE SPECIFICATIONS.
7. LIGHT STANDARDS SHALL NOT BE PLACED IN DITCHES OR OTHER LOW AREAS. EMBANKMENT AND BACKFILL SHALL BE COMPACTED IN CONFORMANCE WITH SECTION 203.
8. THE PHYSICAL SHAPES OF THE POLE CAPS, BRACKETS, AND CONCRETE PULL BOXES SHALL BE CONSIDERED APPROXIMATE AS SHOWN.
9. ALL NUTS, BOLTS, STUDS AND WASHERS SHALL BE GALVANIZED IN CONFORMANCE WITH AASHTO M 232 (ASTM A 153).

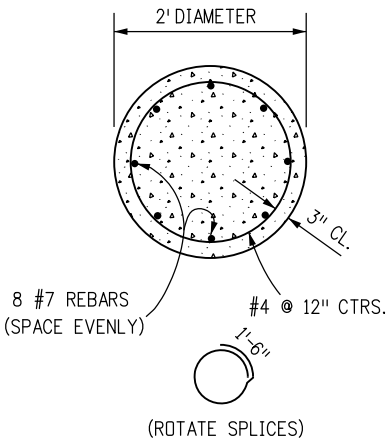

TYPICAL FOUNDATION SECTION

Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	ROAD CLOSURE GATE Issued by the Project Development Branch: July 31, 2019		STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments				M-607-15
Designer Initials: JBK	(R-X)						Standard Sheet No. 7 of 9
Last Modification Date: 07/31/19	(R-X)						Project Sheet Number:
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English							

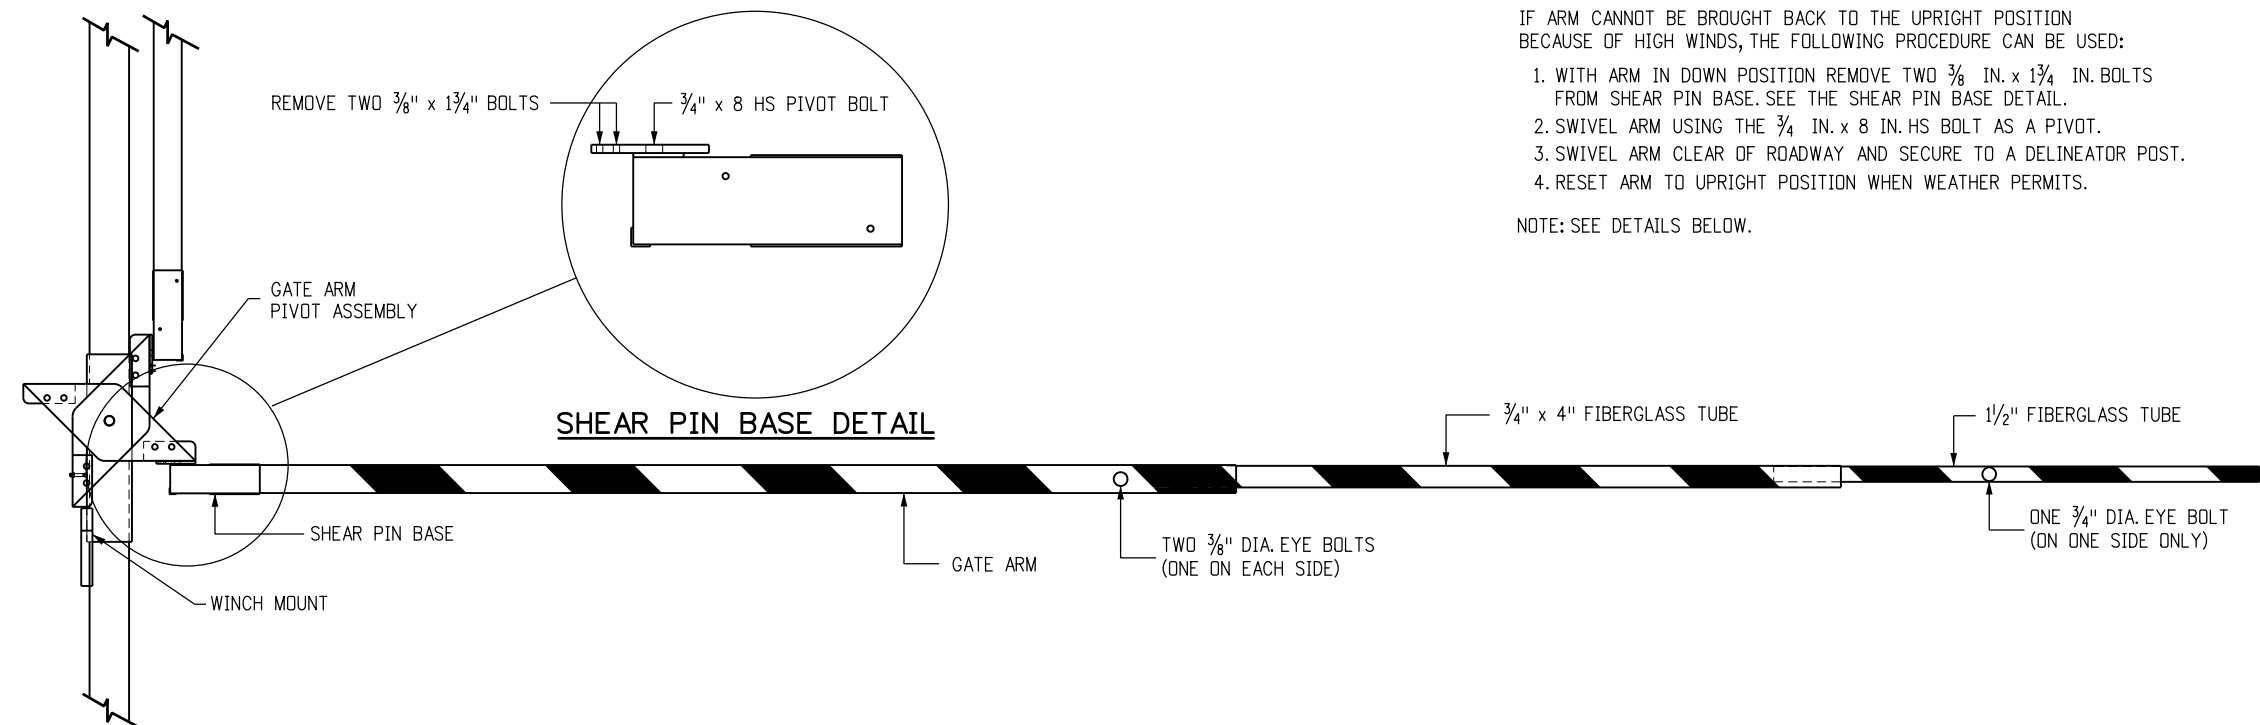


HIGH WIND STOWING PROCEDURE

IF ARM CANNOT BE BROUGHT BACK TO THE UPRIGHT POSITION BECAUSE OF HIGH WINDS, THE FOLLOWING PROCEDURE CAN BE USED:


1. WITH ARM IN DOWN POSITION REMOVE TWO $\frac{3}{8}$ IN. x $1\frac{3}{4}$ IN. BOLTS FROM SHEAR PIN BASE. SEE THE SHEAR PIN BASE DETAIL.
2. SWIVEL ARM USING THE $\frac{3}{4}$ IN. x 8 IN. HS BOLT AS A PIVOT.
3. SWIVEL ARM CLEAR OF ROADWAY AND SECURE TO A DELINEATOR POST.
4. RESET ARM TO UPRIGHT POSITION WHEN WEATHER PERMITS.

NOTE: SEE DETAILS BELOW.


GATE ARM PROFILE

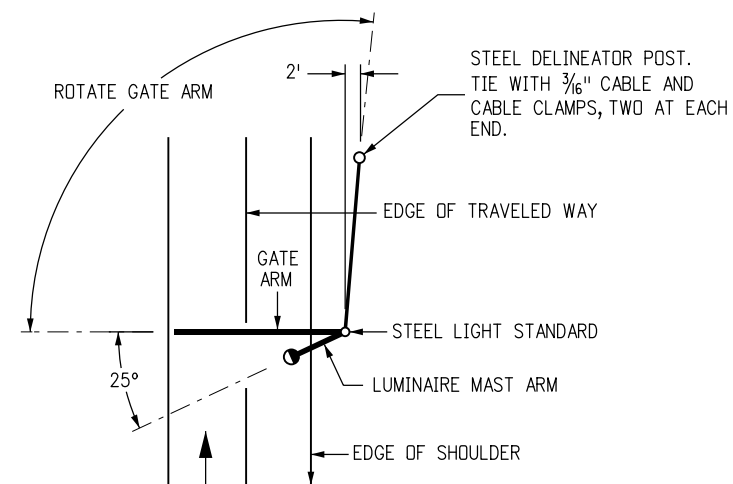


DETAIL FOR HIGH WIND STOW POSITION

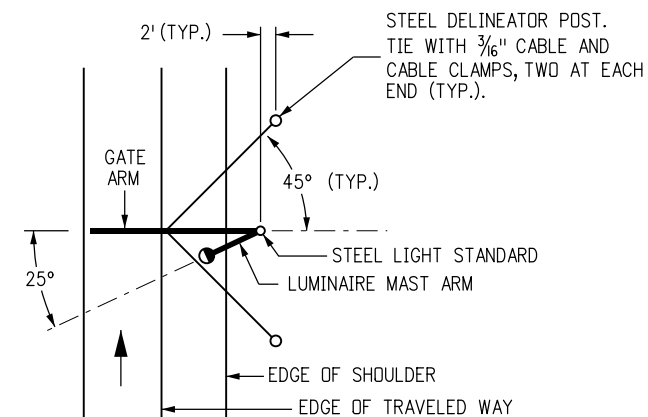

DETAIL TO SECURE GATE IN HIGH WIND


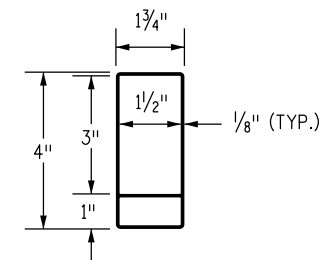


SECTION $1\frac{3}{4}$ IN. x 4 IN. FIBERGLASS TUBE



SECTION $1\frac{1}{2}$ IN. x 3 IN. FIBERGLASS TUBE

Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	ROAD CLOSURE GATE Issued by the Project Development Branch: July 31, 2019		STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments				M-607-15
Designer Initials: JBK	(R-X)						Standard Sheet No. 8 of 9
Last Modification Date: 07/31/19	(R-X)						Project Sheet Number:
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English							



Computer File Information			Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDDT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	ROAD CLOSURE GATE		STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)		Date:	Comments		M-607-15		Standard Sheet No. 9 of 9	
Designer Initials: JBK	(R-X)								
Last Modification Date: 07/31/19	(R-X)								
Detailer Initials: LTA	(R-X)								
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)							Issued by the Project Development Branch: July 31, 2019	
							Project Sheet Number:		

CURB RAMP GENERAL NOTES:

- ①

IN NEW CONSTRUCTION OR FULL-DEPTH RECONSTRUCTION, PROVIDE A SEPARATE CURB RAMP FOR EACH MARKED OR UNMARKED PEDESTRIAN STREET CROSSING. CURB RAMPS SHALL BE CONTAINED WHOLLY WITHIN THE WIDTH OF THE PEDESTRIAN STREET CROSSING OR CROSSWALK THEY SERVE, OR AS SHOWN ON THE CONTRACT PLANS.
- ②

ALTERATIONS ARE DEFINED AS CHANGES TO AN EXISTING HIGHWAY THAT AFFECT PEDESTRIAN ACCESS, CIRCULATION, OR USE. ALTERATIONS INCLUDE, BUT ARE NOT LIMITED TO, RESURFACING, REHABILITATION, RECONSTRUCTION, CURB RAMP RETROFITS, HISTORIC RESTORATION, OR CHANGES OR REARRANGEMENT TO STRUCTURAL PARTS OR ELEMENTS OF A PEDESTRIAN FACILITY.
- ③

A WALKABLE SURFACE IS DEFINED AS A PAVED SURFACE ADJACENT TO A CURB RAMP OR TURNING SPACE, WITHOUT RAISED OBSTACLES, THAT COULD BE MISTAKENLY TRAVERSED BY A USER WHO IS VISUALLY IMPAIRED.
- ④

IN ALTERATIONS, WHERE AN EXISTING PHYSICAL CONSTRAINT PREVENTS PROVIDING A SEPARATE CURB RAMP FOR EACH PEDESTRIAN STREET CROSSING, A SINGLE DIAGONAL RAMP (ON THE APEX) SHALL BE PERMITTED TO SERVE BOTH PEDESTRIAN STREET CROSSINGS. THE USE OF A SINGLE DIAGONAL RAMP SHALL BE APPROVED BY THE ENGINEER PRIOR TO CONSTRUCTION. DIAGONAL RAMPS ARE NOT ACCEPTABLE IN NEW CONSTRUCTION OR FULL-DEPTH RECONSTRUCTION.
- ⑤

Detectable warnings surfaces (DWS) are intended to indicate the boundary between a pedestrian route and vehicular route where there is a flush rather than curbed connection. DWS are not intended to provide wayfinding. DWS shall be provided at the following locations;

1. CURB RAMPS, BLENDED TRANSITIONS, AND DEPRESSED CORNERS AT PEDESTRIAN STREET CROSSINGS;

2. PEDESTRIAN REFUGE ISLANDS (6 FEET IN WIDTH OR GREATER);

3. BOARDING PLATFORMS AT TRANSIT STOPS WHERE THE EDGE OF THE PLATFORM IS NOT PROTECTED TO PEDESTRIAN CROSS TRAFFIC; AND

4. BOARDING AREAS AT SIDEWALK OR STREET LEVEL TRANSIT STOPS WHERE THE AREA IS NOT PROTECTED TO PEDESTRIAN CROSS TRAFFIC.
- ⑥

DETECTABLE WARNING SURFACES SHALL CONTRAST VISUALLY WITH THE ADJACENT GUTTER, HIGHWAY, OR PEDESTRIAN ACCESS ROUTE SURFACE, EITHER LIGHT-ON-DARK OR DARK-ON-LIGHT. FEDERAL YELLOW COLOR IS PREFERRED, HOWEVER, OTHER COLORS MAY BE USED IF APPROVED BY THE ENGINEER.
- ⑦

IN ALTERATIONS, TO AVOID CHASING GRADE INDEFINITELY ON STEEP ROADWAYS, A CURB RAMPS LENGTH IS NOT REQUIRED TO EXCEED 15 FEET REGARDLESS OF THE RESULTING RAMP RUNNING SLOPE.
- ⑧

ALL SLOPES ARE MEASURED WITH RESPECT TO A LEVEL PLANE.
- ⑨

DRAINAGE STRUCTURES, TRAFFIC SIGNAL EQUIPMENT, OR OTHER OBSTRUCTIONS SHALL NOT BE INSTALLED ON THE CURB RAMP, OR TURNING SPACE AREAS.
- ⑩

IN NEW CONSTRUCTION, PULL BOXES, METER BOXES, MAINTENANCE HOLE COVERS, VAULT LIDS, OR SIMILAR, SHALL NOT BE CONSTRUCTED WITHIN ANY PART OF CURB RAMP OR TURNING SPACE. IN ALTERATIONS, WHERE THESE ITEMS CANNOT BE RELOCATED OUTSIDE OF THE CURB RAMP OR TURNING SPACE, THEY MUST NOT CREATE A VERTICAL DISCONTINUITY GRATER THAN 1/2 INCH. ANY VERTICAL DISCONTINUITY BETWEEN 1/4 INCH AND 1/2 INCH SHALL BE BEVELED WITH A SLOPE NOT STEEPER THAN 1V:2H. THE BEVEL SHALL BE APPLIED ACROSS THE ENTIRE SURFACE DISCONTINUITY.
- ⑪

CONSTRUCTION OF ANY REQUIRED PEDESTRIAN CURB SHALL BE INCLUDED IN THE BID PRICE OF THE CONCRETE CURB RAMP AND WILL NOT BE PAID FOR SEPARATELY.
- ⑫

ALL CURB RAMP JOINTS AND GRADE BREAKS SHALL BE FLUSH (0'-1/8"). THE JOINT BETWEEN THE ROADWAY SURFACE AND THE GUTTER PAN SHALL BE FLUSH.
- ⑬

THE CONTRACTOR SHALL VERIFY REMOVAL LIMITS ARE SUFFICIENT TO PROVIDE POSITIVE DRAINAGE, MAINTAIN EXISTING DRAINAGE PATTERNS, AND AVOID PONDING IN THE FINAL CONFIGURATION.
- ⑭

FLARED SIDE SLOPES MAY EXCEED 10.0% ONLY WHERE THEY ABUT A NON-WALKABLE SURFACE, OR WHERE THE ADJACENT RAMP SURFACE IS BLOCKED TO PEDESTRIAN TRAFFIC.
- ⑮

THE CHANGE IN GRADE AT THE BOTTOM OF THE CURB RAMP SHALL NOT EXCEED AN ALGEBRAIC DIFFERENCE OF 13.33%. THE COUNTER SLOPE OF THE GUTTER AT THE FOOT OF A RAMP, TURNING SPACE, OR BLENDED TRANSITION SHALL NOT EXCEED 5.0%.
- ⑯

GRADE BREAKS AT THE TOP AND BOTTOM OF RAMP RUNS SHALL BE PERPENDICULAR TO THE DIRECTION OF THE RAMP RUN. GRADE BREAKS SHALL NOT BE PERMITTED ON THE SURFACE OF THE RAMP RUN OR TURNING SPACE. SURFACE SLOPES THAT MEET AT GRADE BREAKS SHALL BE FLUSH.
- ⑰

A BROOM FINISH, WITH SWEEPS PERPENDICULAR TO THE DIRECTION OF PEDESTRIAN TRAFFIC, SHALL BE APPLIED TO ALL RAMP AND TURNING SPACE SURFACES.
- ⑱

IN ALTERATIONS, WHERE A RAMP OR TURNING SPACE MUST TIE INTO AN EXISTING GRADE THAT CANNOT BE ALTERED, THE RAMP OR TURNING SPACE MAY BE WARPED TO TRANSITION TO THE REQUIRED CROSS SLOPE. THE TRANSITION TO THE REQUIRED CROSS SLOPE SHALL BE SPREAD EVENLY OVER THE LENGTH OF THE RAMP OR TURNING SPACE TO MINIMIZE THE DEGREE OF WARPING. THE RATE OF CHANGE ON A RAMP OR TURNING SPACE SHALL NOT EXCEED 3% PER LINEAR FOOT.
- ⑲

DESIGN AND CONSTRUCT CURB RAMPS, TURNING SPACES, AND FLARE SLOPES WITH THE FLATTEST SLOPES POSSIBLE. THE SLOPES INDICATED IN THESE DETAILS SHOW THE MAXIMUM SLOPES ALLOWABLE. **PREFERRED VALUES** TO BE USED DURING DESIGN, LAYOUT, AND CONSTRUCTION ARE:

- RAMP RUNNING SLOPE 7.5%

- RAMP CROSS SLOPE 1

- TURNING SPACE RUNNING SLOPE 1.5%

- TURNING SPACE CROSS SLOPE 1.5%

- FLARE SLOPE 8.0-9.0%


- ⑳

WHERE SNOW REMOVAL EQUIPMENT WILL BE USED TO CLEAR THE PEDESTRIAN ACCESS ROUTE, CONSULT THE ENGINEER PRIOR TO CONSTRUCTION TO ENSURE THE WIDTH AND THICKNESS OF CURB RAMPS IS SUFFICIENT TO ACCOMODATE SUCH EQUIPMENT.
- ㉑

PROVIDE EXPANSION JOINT MATERIAL 1/2" THICK WHERE CURB RAMPS ADJOIN ANY RIGID PAVEMENT, OR STRUCTURE. THE TOP OF THE JOINT FILLER MATERIAL SHALL BE FLUSH WITH ADJOINING CONCRETE SURFACES. THE EXPANSION JOINT MATERIAL SHALL EXTEND FOR THE FULL DEPTH OF THE CONCRETE SURFACE.
- ㉒


PROVIDE TIE BAR REINFORCING BETWEEN INDEPEDENTLY POURED CONCRETE CURB RAMPS OR TURNING SPACES AND CURB AND GUTTER. DRILL AND GROUT NO. 4 12 INCH LONG REINFORCEMENT BARS (EPOXY COATED) AT 18 INCHES CENTER TO CENTER MINIMUM.

CURB RAMP PAY AREAS

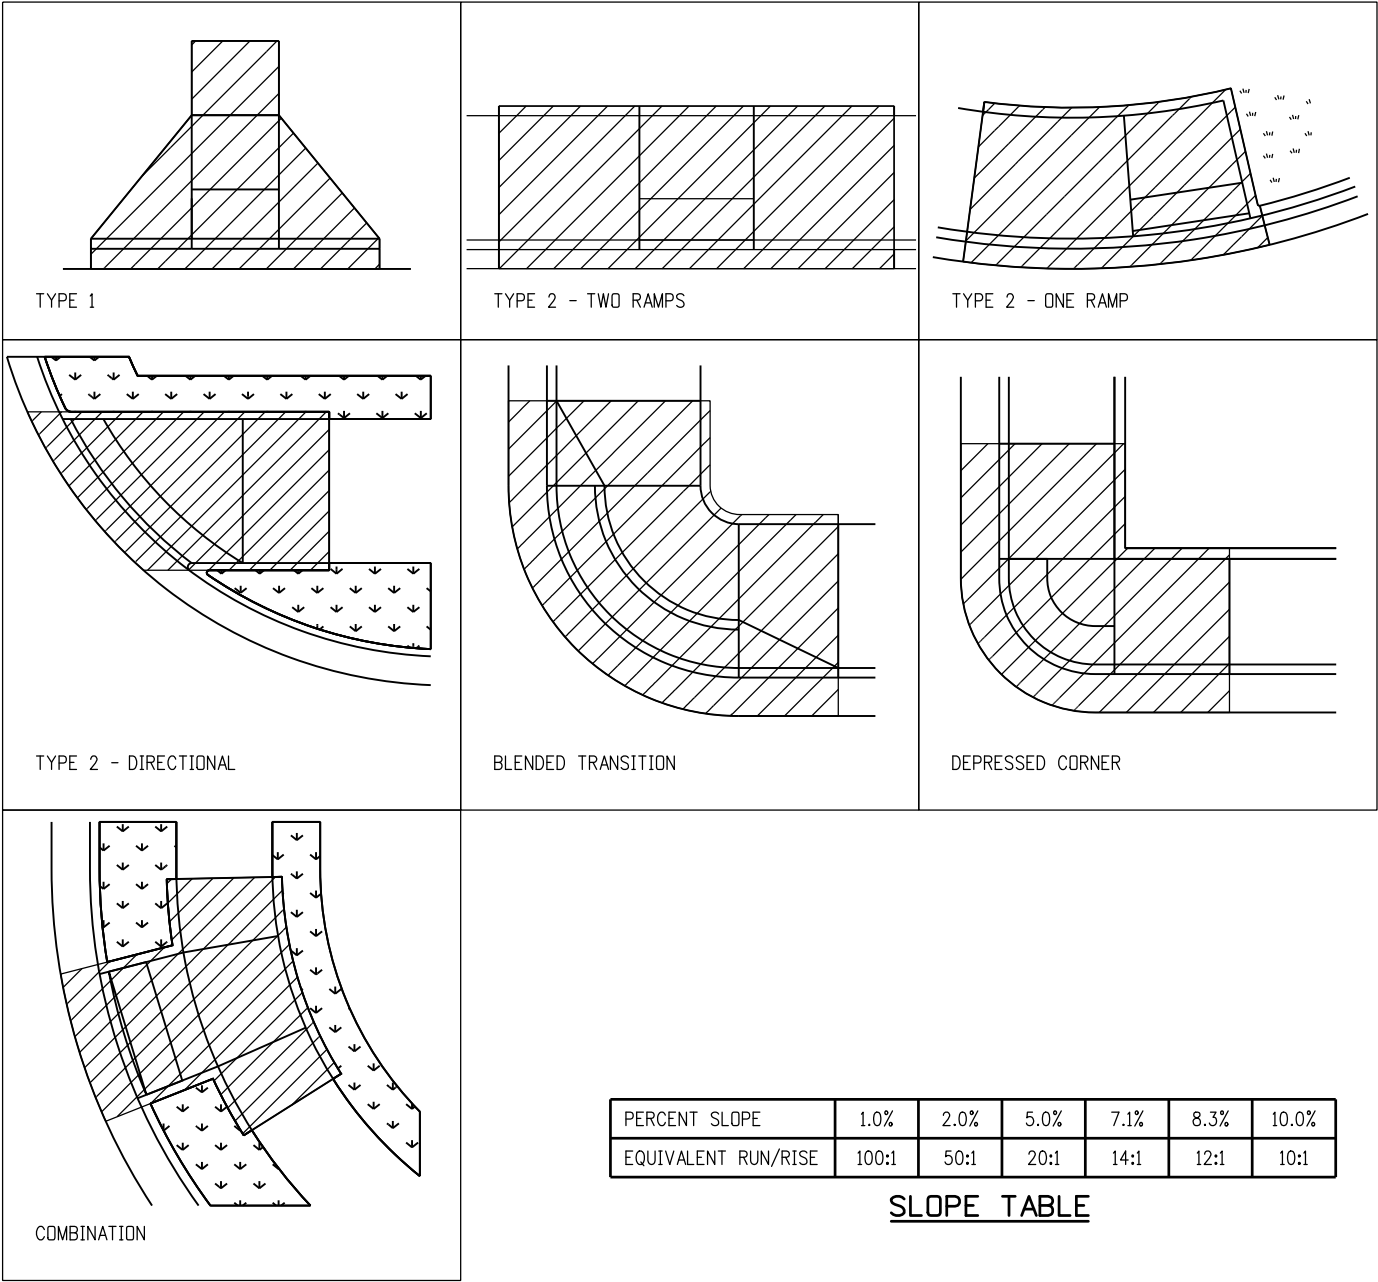


GENERAL NOTES & PAY AREAS


Computer File Information		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development BranchJBK	STANDARD PLAN NO.	
Creation Date: 07/31/19			M-608-1	
Designer Initials: JBK	(R-X)		Standard Sheet No. 1 of 10	
Last Modification Date: 07/31/19	(R-X)			
Detailer Initials: LTA	(R-X)			
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)			
Sheet Revisions		CURB RAMPS		
Date:	Comments	Issued by the Project Development Branch: July 31, 2019		
		Project Sheet Number:		

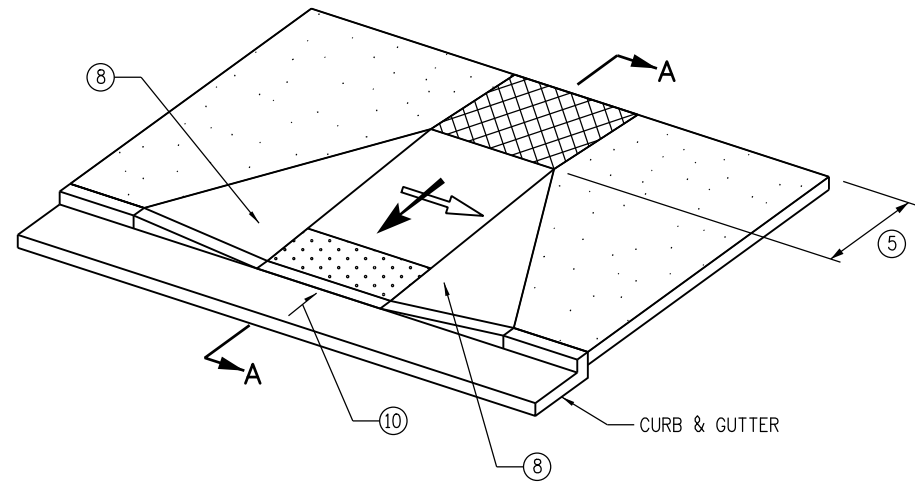

PERPENDICULAR RAMP
(TYPICAL)

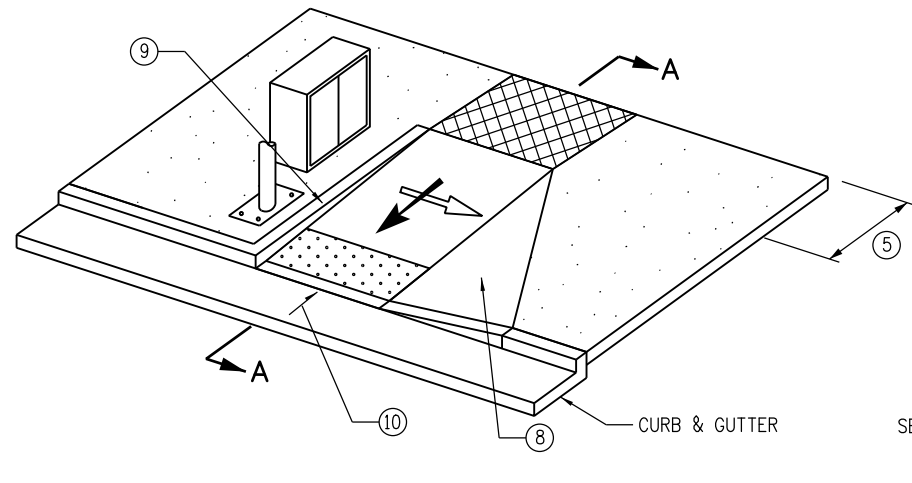


PERPENDICULAR RAMP
(WITH VERTICAL RETURN CURB)

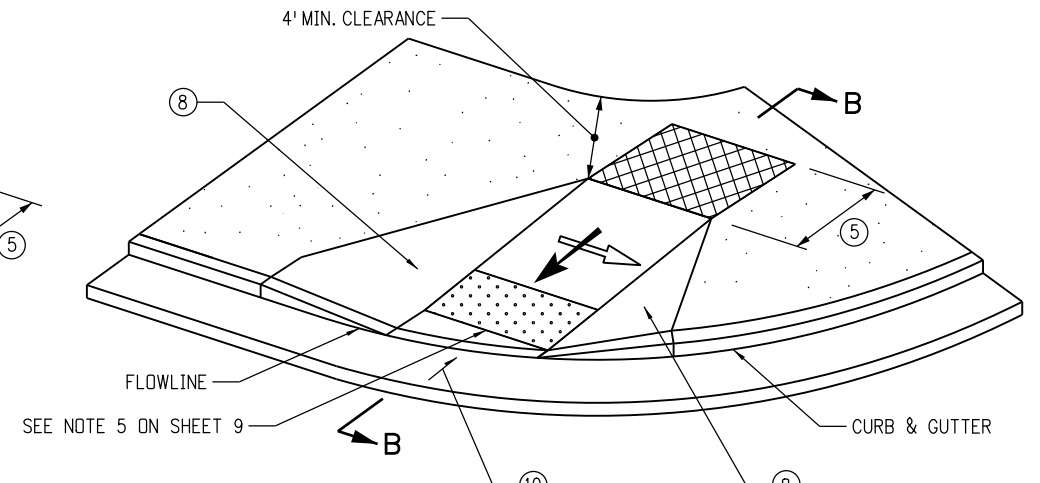


PERPENDICULAR RAMP
(DIRECTIONAL)

PERPENDICULAR RAMP NOTES


- 1 RAMP WIDTH - PROVIDE 5 FT. OR GREATER WHERE POSSIBLE. IF SITE CONSTRAINTS DO NOT PERMIT, PROVIDE 4 FT. MINIMUM. RAMPS SERVICING SHARED USE PATHS SHALL MATCH THE WIDTH OF THE PATH.
- 2 RAMP RUNNING SLOPE - 8.3% MAX.
- 3 TURNING SPACE RUNNING SLOPE - 2.0% MAX. TURNING SPACE RUNNING SLOPE IS MEASURED IN THE SAME DIRECTION AS THE RAMP RUNNING SLOPE.
- 4 RAMP AND TURNING SPACE CROSS SLOPE - 2.0% TYPICAL. AT CROSSINGS WITHOUT YIELD OR STOP CONTROL, OR WITH A SIGNAL WHERE VEHICLES CAN PROCEED THROUGH THE INTERSECTION WITHOUT SLOWING OR STOPPING, THE CROSS SLOPE OF RAMPS AND TURNING SPACES MAY EQUAL THE HIGHWAY GRADE. AT MIDBLOCK PEDESTRIAN STREET CROSSINGS THE RAMP AND TURNING SPACE CROSS SLOPE MAY EQUAL THE HIGHWAY GRADE.
- 5 TURNING SPACE DIMENSIONS - PROVIDE A TURNING SPACE AT THE TOP OF PERPENDICULAR RAMPS WITH A WIDTH EQUAL TO THE WIDTH OF THE CURB RAMP. TURNING SPACE LENGTH MUST BE 4 FT. MINIMUM, MEASURED IN THE DIRECTION OF THE RAMP RUN. WHEN A TURNING SPACE IS CONSTRAINED AT THE BACK OF SIDEWALK, INCREASE LENGTH TO 5 FT. MINIMUM IN THE DIRECTION OF THE RAMP RUN.
- 6 RAMP ALIGNMENT - RAMPS SHALL BE ALIGNED TO BE FULLY CONTAINED WITHIN THE CROSSWALK OR STREET CROSSING THEY SERVE. PROVIDE ONE RAMP FOR EACH STREET CROSSING DIRECTION. IN ALTERATIONS, WHERE EXISTING PHYSICAL CONSTRAINTS PREVENT PROVIDING ONE CURB RAMP FOR EACH CROSSING DIRECTION, A SINGLE DIAGONAL CURB RAMP (ON THE APEX OF A CORNER) SHALL BE PERMITTED TO SERVE BOTH PEDESTRIAN STREET CROSSINGS. IF A DIAGONAL RAMP IS USED, A CLEAR SPACE 4 FT. X 4FT. MUST BE PROVIDED AT THE BASE OF THE RAMP. THE CLEAR SPACE MUST BE WITHIN BOTH CROSSWALKS AND WHOLLY OUTSIDE OF ANY ADJACENT VEHICULAR TRAVEL LANES. DIAGONAL RAMPS ARE NOT ACCEPTABLE IN NEW CONSTRUCTION, OR FULL-DEPTH RECONSTRUCTION.
- 7 RAMP LENGTH - PERPENDICULAR RAMP LENGTH IS DEPENDENT UPON THE RAMP SLOPE, HEIGHT OF CURB, AND ADJACENT SIDEWALK CROSS-SLOPE WHICH MUST BE INTERCEPTED. SEE DETAIL A FOR CALCULATING RAMP LENGTH WHEN CHASING SIDEWALK CROSS-SLOPE. WHERE TERRAIN IS SLOPING A RAMP IS NOT REQUIRED TO CHASE GRADE MORE THAN 15 FT. REGARDLESS OF THE RESULTING RAMP SLOPE.
- 8 RAMP FLARES - WHERE A RAMP EDGE ABUTS A WALKABLE SURFACE, A FLARED SIDE SHALL BE PROVIDED. RAMP FLARE SLOPES SHALL NOT EXCEED 10.0%.
- 9 VERTICAL CURB RETURNS - VERTICAL CURB RETURNS MAY BE USED ONLY WHERE A RAMP ABUTS A NON-WALKABLE SURFACE, OR WHERE A RAMP IS PROTECTED FROM PEDESTRIAN CROSS TRAFFIC (FOR EXAMPLE BY A SIGNAL CABINET OR UTILITY POLE WHICH BLOCKS PASSAGE).
- 10 GUTTER COUNTER SLOPE - 5.0% MAX.

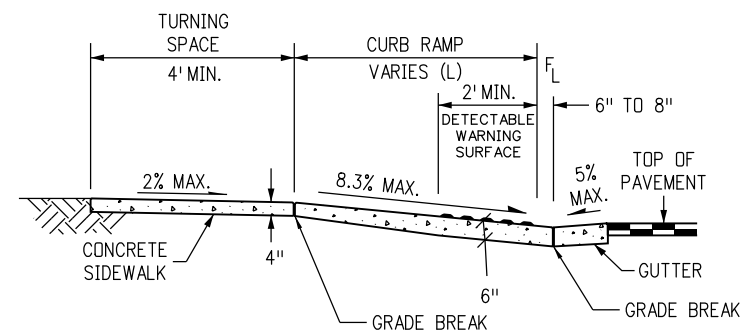


SECTION A-A

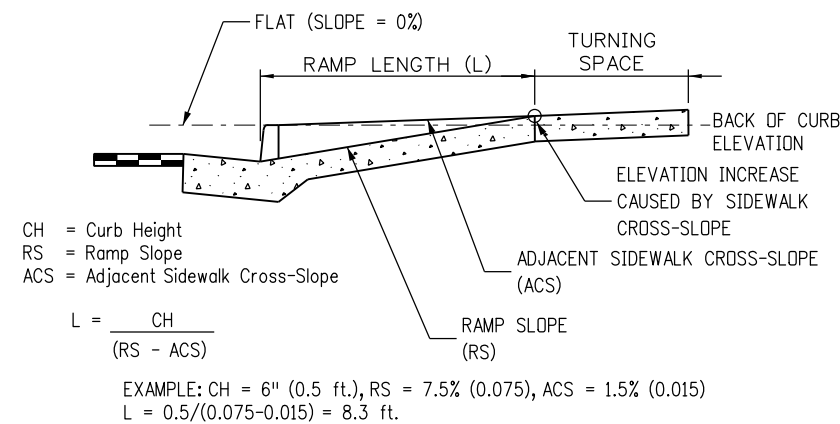

DETAIL A - RAMP LENGTH

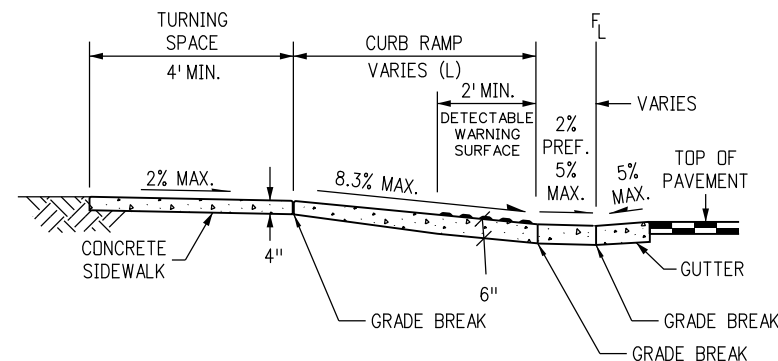


SECTION B-B

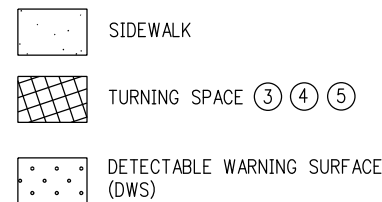


TYPE 1 PERPENDICULAR CURB RAMPS


Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	STANDARD PLAN NO.	
Creation Date: 07/31/19	Date:		Comments	M-608-1			
Designer Initials: JBK				Standard Sheet No. 2 of 10			
Last Modification Date: 07/31/19							
Detailer Initials: LTA							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English				Issued by the Project Development Branch: July 31, 2019			
			Project Sheet Number:				

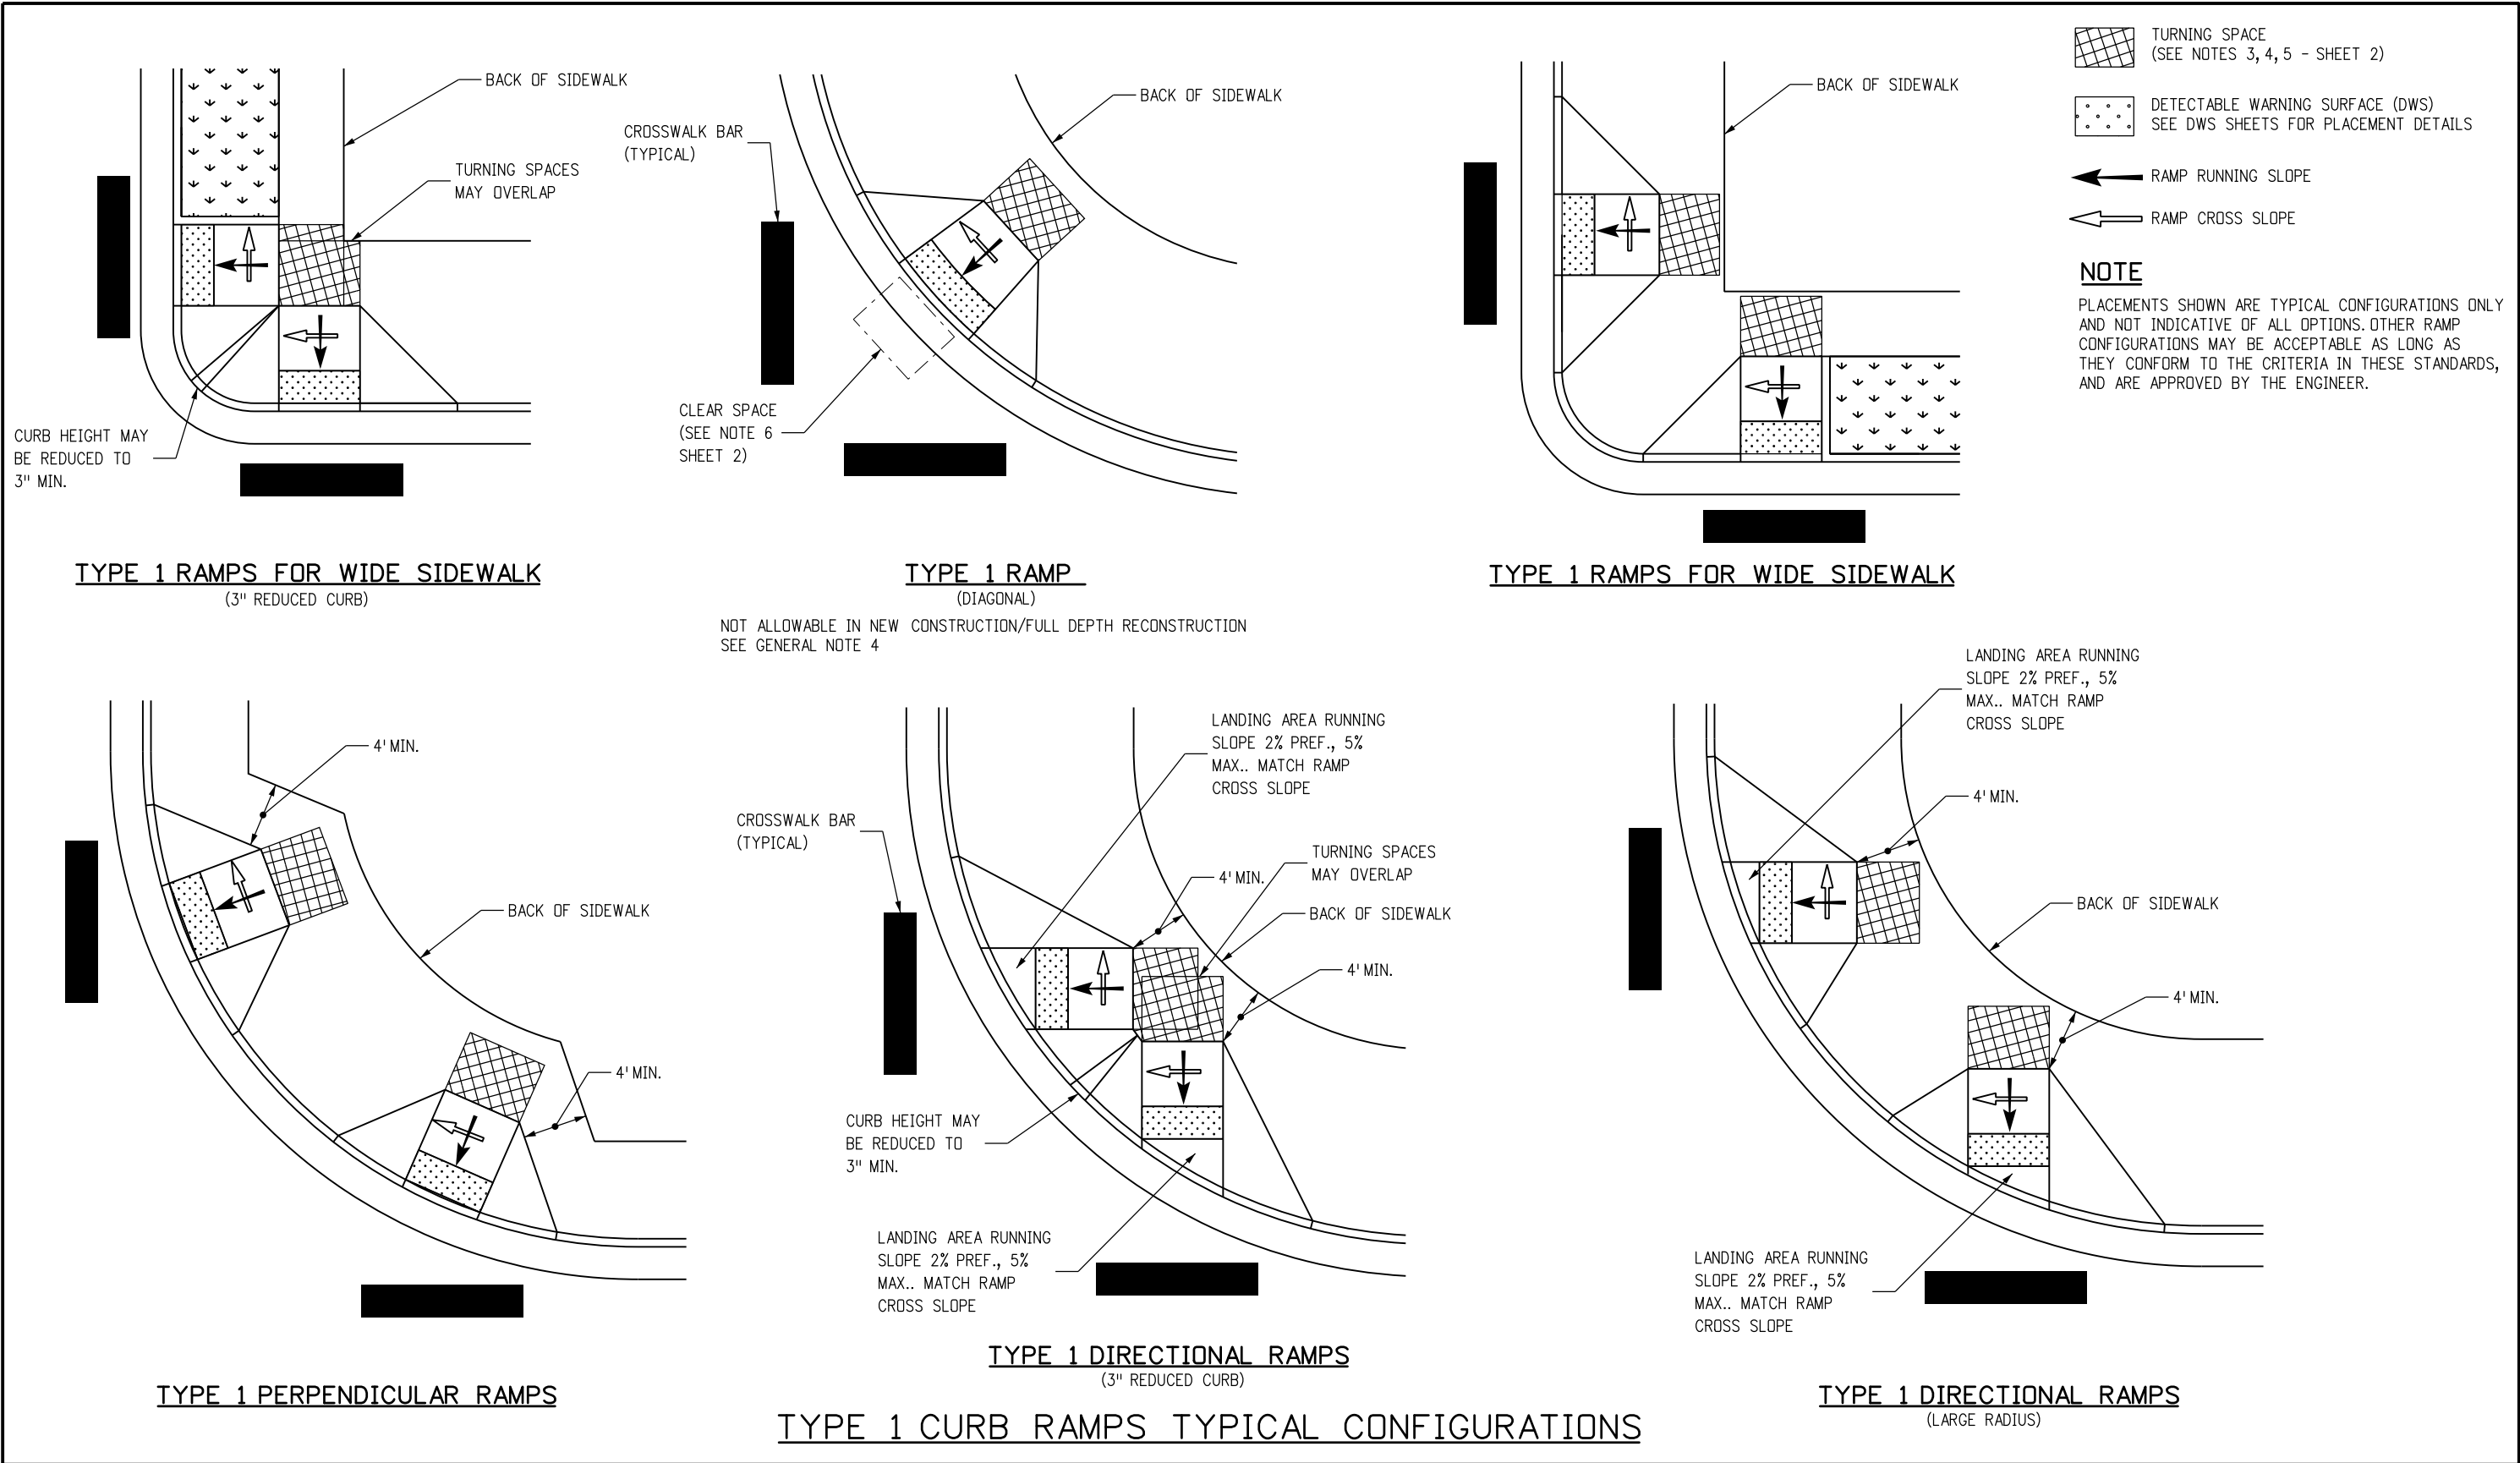


Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments		M-608-1	
Designer Initials: JBK	(R-X)				Standard Sheet No. 3 of 10	
Last Modification Date: 07/31/19	(R-X)				Project Sheet Number:	
Detailer Initials: LTA	(R-X)					
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)			Issued by the Project Development Branch: July 31, 2019		

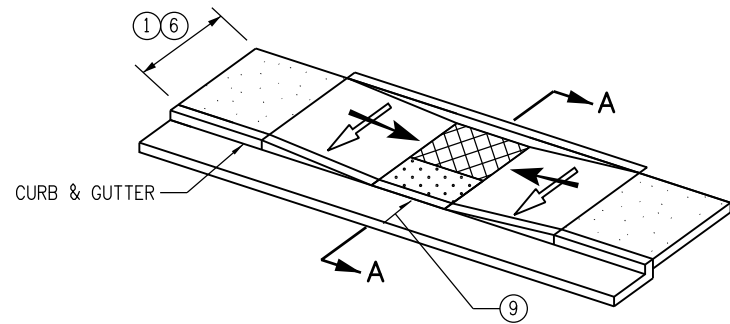


PARALLEL RAMP
(TYPICAL)

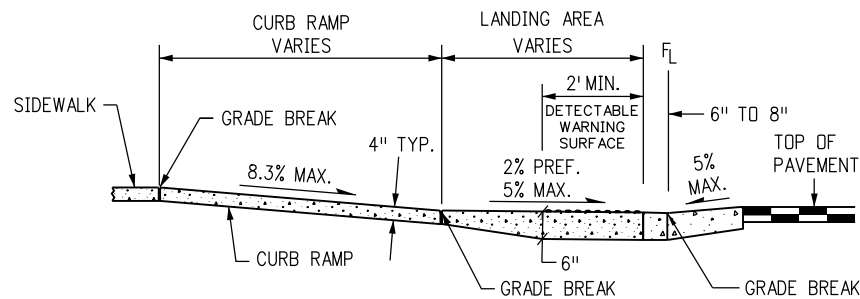


SECTION C-C

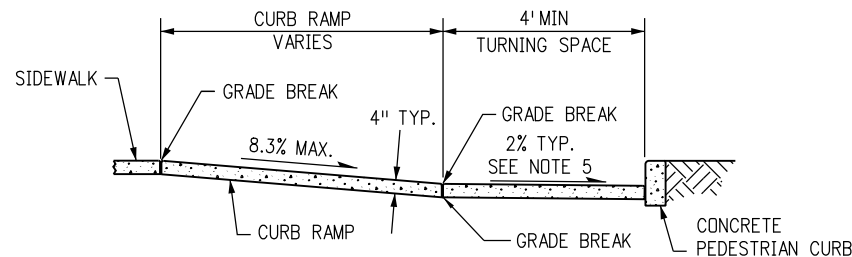


SECTION B-B

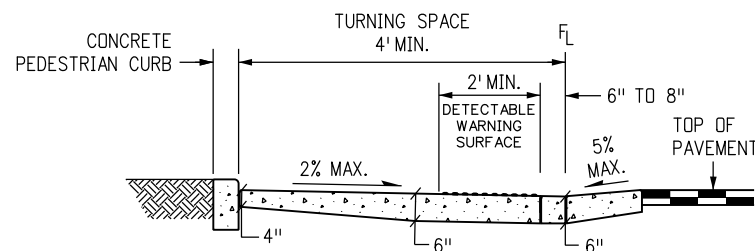


SECTION A-A

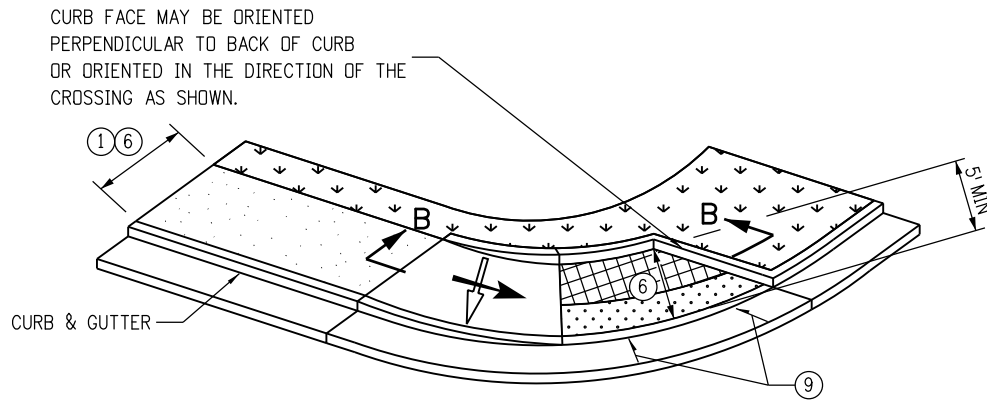

PARALLEL RAMP
(SIDEWALK ENDS)

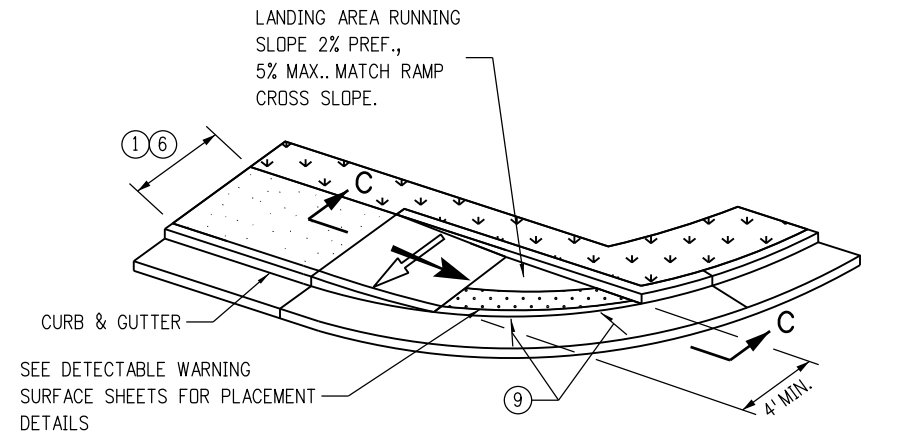


PARALLEL RAMP
(DIRECTIONAL - CROSSING IN ONE DIRECTION ONLY)

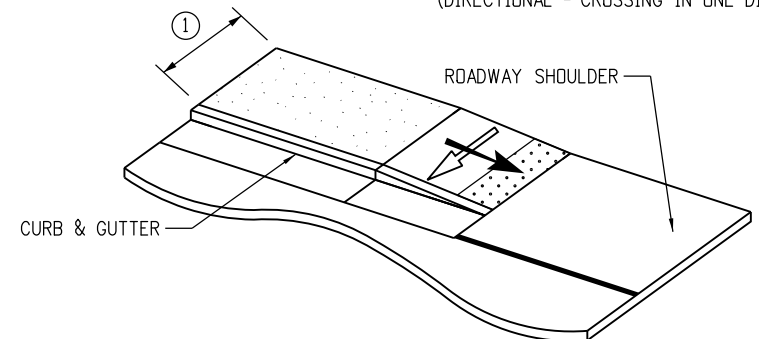

SIDEWALK TO SHOULDER TRANSITION


PARALLEL RAMP NOTES

- 1 RAMP WIDTH - PROVIDE A RAMP WIDTH EQUAL TO THE ADJOINING SIDEWALK, PROVIDE 4 FT. WIDTH MINIMUM. RAMPS SERVICING SHARED USE PATHS SHALL MATCH THE WIDTH OF THE PATH.
- 2 RAMP RUNNING SLOPE - 8.3% MAX.
- 3 RAMP CROSS SLOPE - 2.0% MAX.
- 4 TURNING SPACE RUNNING SLOPE - 2.0% MAX. TURNING SPACE RUNNING SLOPE IS MEASURED PERPENDICULAR TO THE BACK OF CURB.
- 5 TURNING SPACE CROSS SLOPE - 2.0% TYPICAL, AT CROSSINGS WITHOUT YIELD OR STOP CONTROL, OR WITH A SIGNAL WHERE VEHICLES CAN PROCEED THROUGH THE INTERSECTION WITHOUT SLOWING OR STOPPING, THE CROSS SLOPE OF THE TURNING SPACE MAY EQUAL THE HIGHWAY GRADE. AT MIDBLOCK PEDESTRIAN STREET CROSSINGS THE TURNING SPACE CROSS SLOPE MAY EQUAL THE HIGHWAY GRADE. TURNING SPACE CROSS SLOPE IS MEASURED IN THE DIRECTION OF THE RAMP RUN.
- 6 TURNING SPACE DIMENSIONS - PROVIDE A TURNING SPACE AT THE BOTTOM OF PARALLEL RAMPS WITH A WIDTH EQUAL TO THE WIDTH OF THE CURB RAMP. PROVIDE 4 FT. MINIMUM, MEASURED IN THE DIRECTION OF THE RAMP RUN. IF THE TURNING SPACE IS CONSTRAINED ON TWO SIDES, PROVIDE 5 FT. MEASURED IN THE DIRECTION OF PEDESTRIAN STREET CROSSING. THE TURNING SPACE MAY CONTAIN THE DETECTABLE WARNING SURFACE.
- 7 RAMP ALIGNMENT - RAMPS SHALL BE ALIGNED SO THE TURNING SPACE IS FULLY CONTAINED WITHIN THE CROSSWALK OR STREET CROSSING THEY SERVE. PROVIDE ONE RAMP FOR EACH STREET CROSSING DIRECTION. IN ALTERATIONS, WHERE EXISTING PHYSICAL CONSTRAINTS PREVENT PROVIDING ONE CURB RAMP FOR EACH CROSSING DIRECTION, A SINGLE DIAGONAL CURB RAMP (ON THE APEX OF A CORNER) SHALL BE PERMITTED TO SERVE BOTH PEDESTRIAN STREET CROSSINGS. DIAGONAL RAMPS ARE NOT ACCEPTABLE IN NEW CONSTRUCTION, OR FULL-DEPTH RECONSTRUCTION.
- 8 RAMP LENGTH - PARALLEL RAMP LENGTH IS DEPENDENT UPON THE RAMP SLOPE AND THE CHANGE OF ELEVATION FROM THE TURNING SPACE TO THE SIDEWALK. WHERE TERRAIN IS SLOPING A RAMP IS NOT REQUIRED TO CHASE GRADE MORE THAN 15 FT. REGARDLESS OF THE RESULTING RAMP SLOPE.
- 9 GUTTER COUNTER SLOPE - 5.0% MAX.

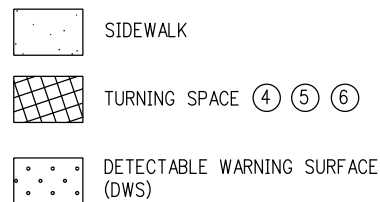


TYPE 2 PARALLEL CURB RAMPS


Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	CURB RAMPS	STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-608-1
Designer Initials: JBK	(R-X)					Standard Sheet No. 4 of 10
Last Modification Date: 07/31/19	(R-X)				Issued by the Project Development Branch: July 31, 2019	Project Sheet Number:
Detailer Initials: LTA	(R-X)					
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)					

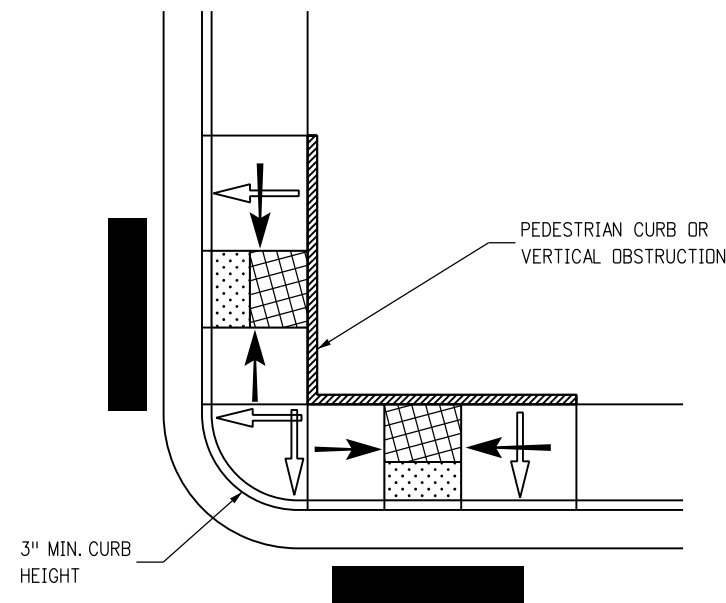


TYPE 2 RAMPS SMALL RADIUS
(3" REDUCED CURB)

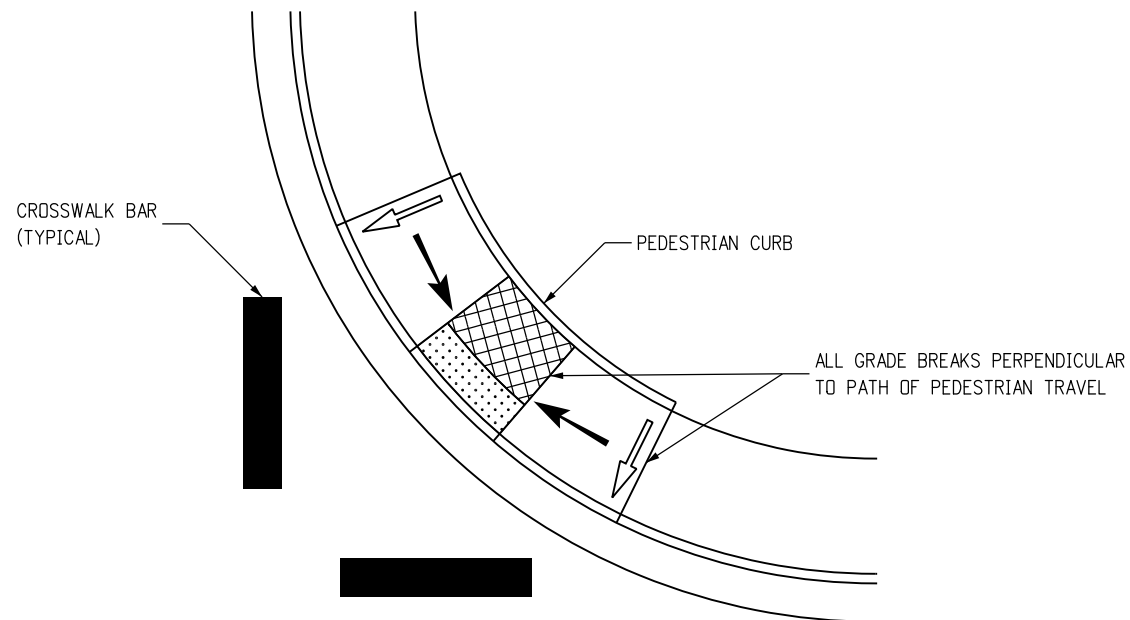


TYPE 2 RAMP (DIAGONAL)
NOT ALLOWABLE IN NEW CONSTRUCTION/FULL-DEPTH RECONSTRUCTION
SEE NOTE GENERAL NOTE 4

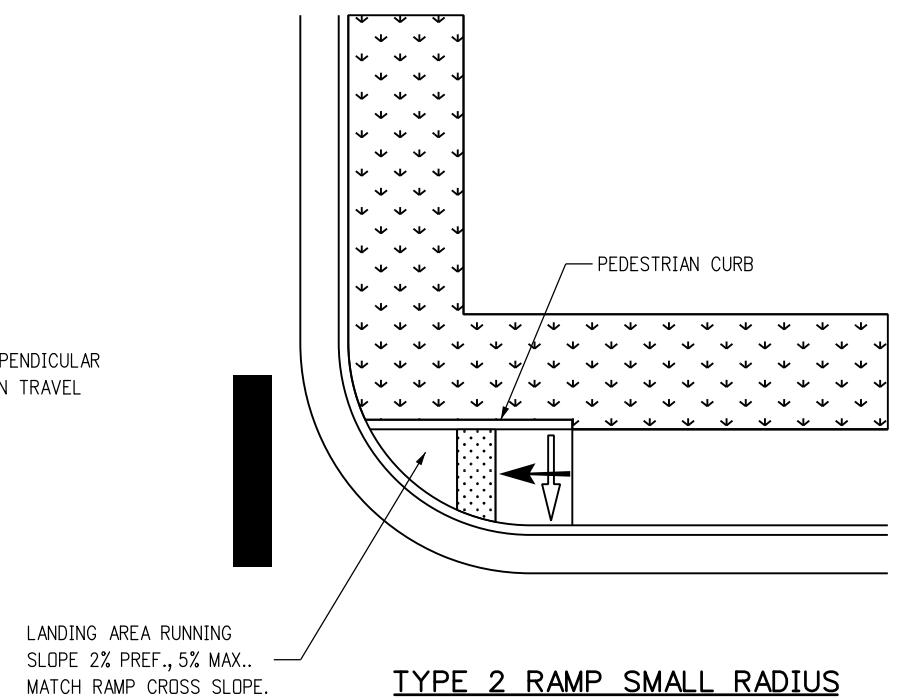

TYPE 2 RAMP SMALL RADIUS
(CROSSING IN ONE DIRECTION)

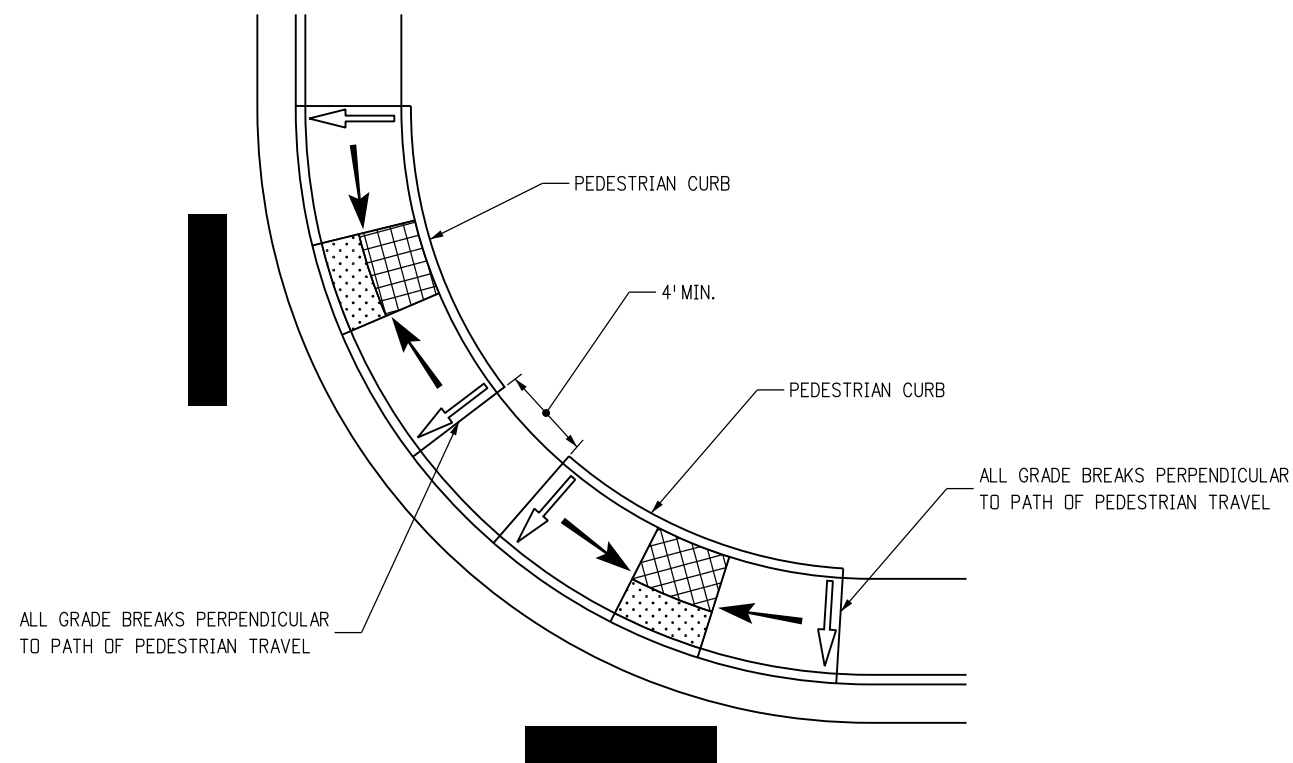

TYPE 2 RAMPS LARGE RADIUS

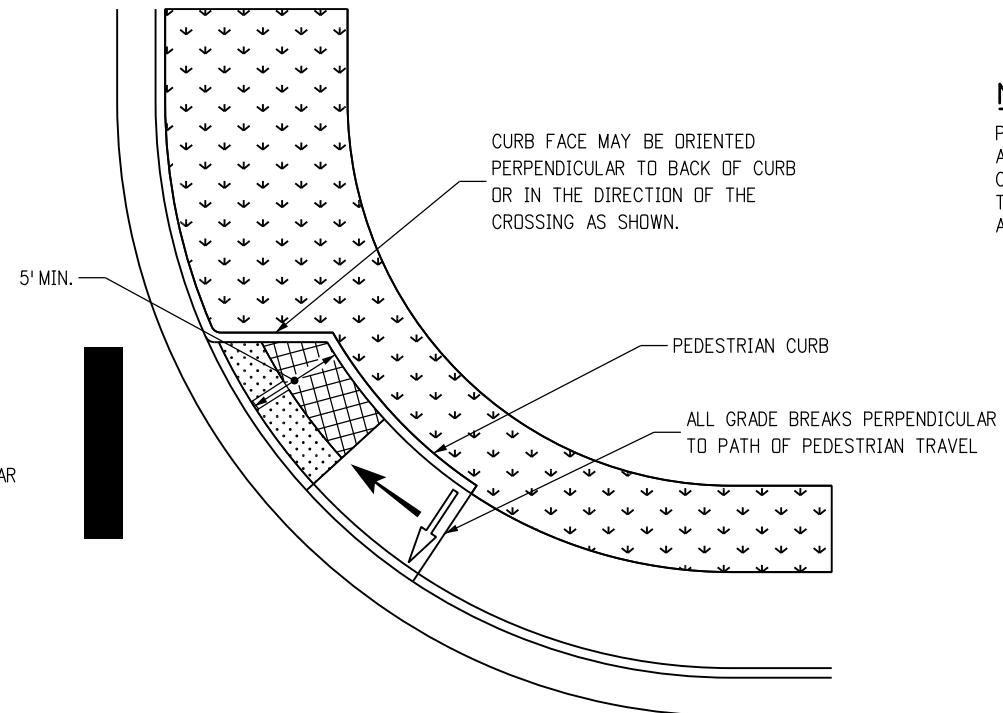

TYPE 2 RAMP LARGE RADIUS
(CROSSING IN ONE DIRECTION)

NOTE

PLACEMENTS SHOWN ARE TYPICAL CONFIGURATIONS ONLY AND NOT INDICATIVE OF ALL OPTIONS. OTHER RAMP CONFIGURATIONS MAY BE ACCEPTABLE AS LONG AS THEY CONFORM TO THE CRITERIA IN THESE STANDARDS, AND ARE APPROVED BY THE ENGINEER.

TURNING SPACE
(SEE NOTE 4, 5, 6 - SHEET 4)




DETECTABLE WARNING SURFACE (DWS)
SEE DWS SHEETS FOR PLACEMENT DETAILS

RAMP RUNNING SLOPE

RAMP CROSS SLOPE




TYPE 2 CURB RAMPS TYPICAL CONFIGURATIONS

Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch	CURB RAMPS Issued by the Project Development Branch: July 31, 2019	STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-608-1
Designer Initials: JBK	(R-X)					Standard Sheet No. 5 of 10
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:
Detailer Initials: LTA	(R-X)					
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)					

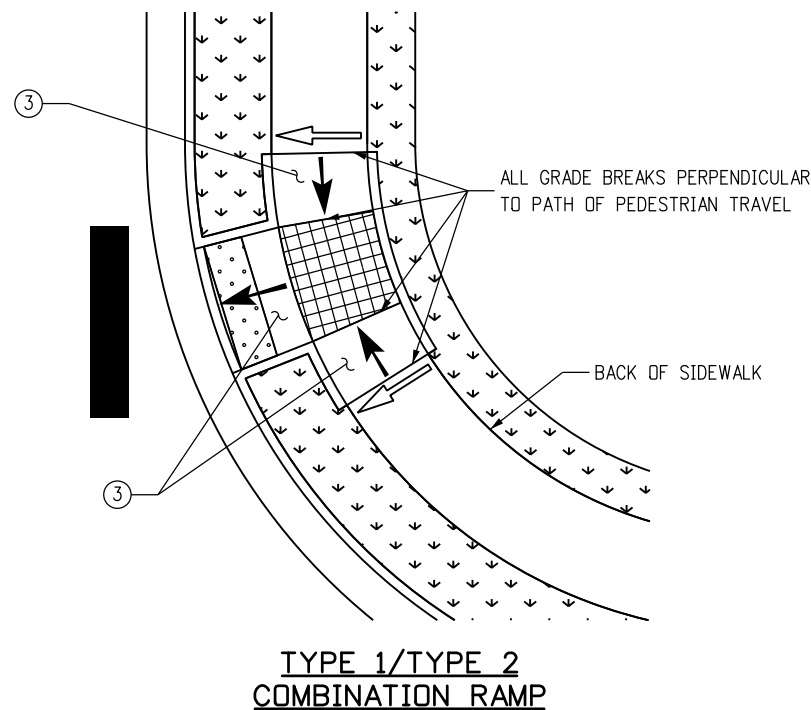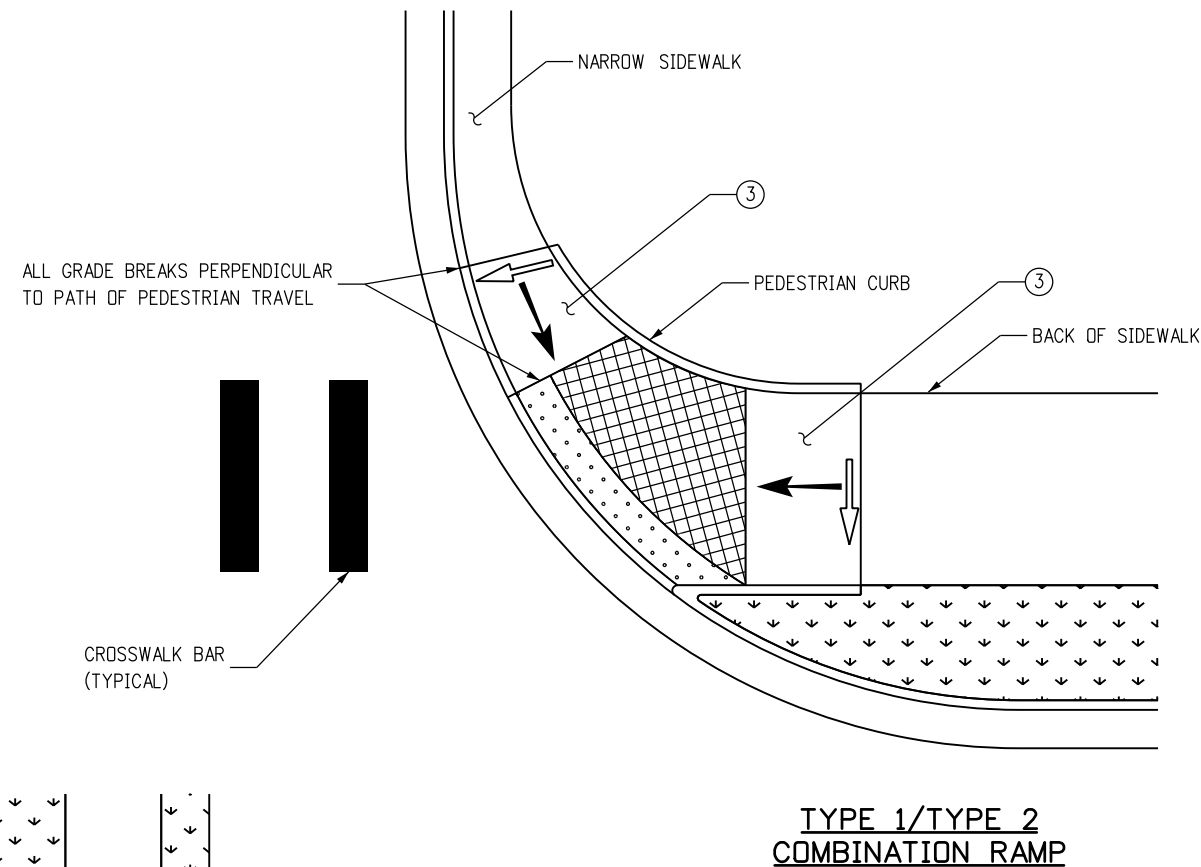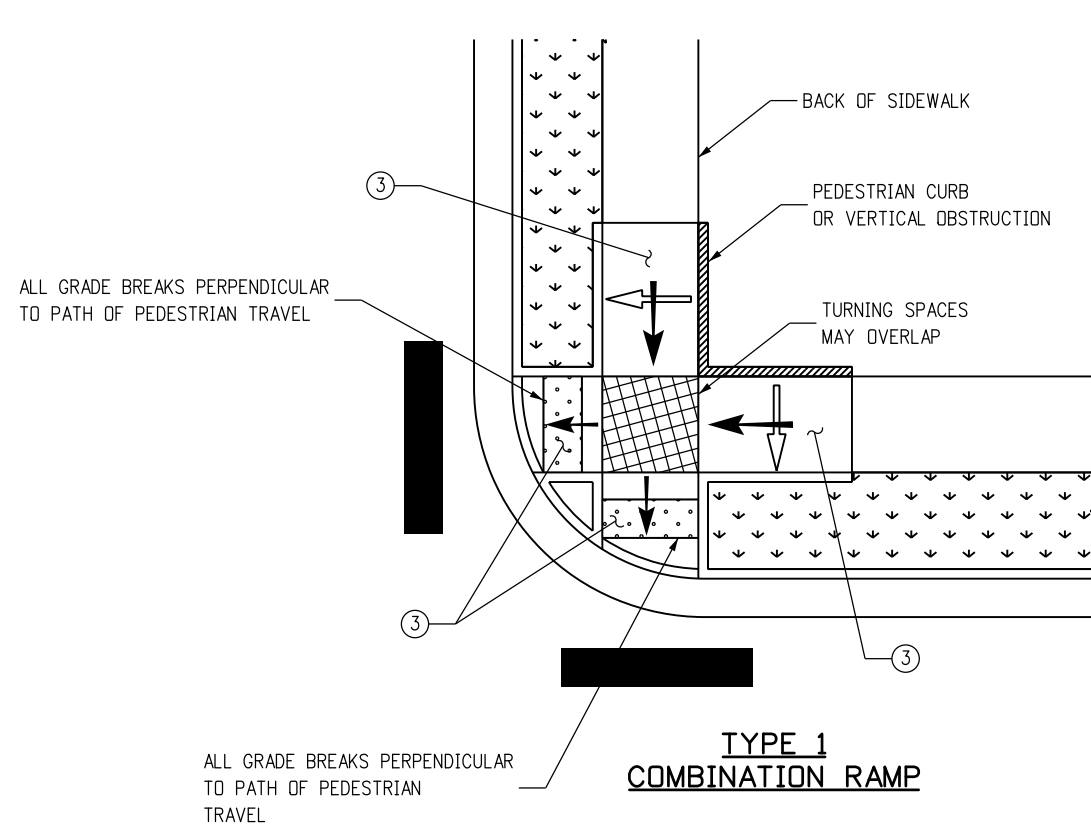


COMBINATION CURB RAMP NOTES:

- ① THE CURB RAMP PLACEMENTS SHOWN ARE TYPICAL CONFIGURATIONS ONLY AND NOT INDICATIVE OF ALL OPTIONS. OTHER CURB RAMP CONFIGURATIONS MAY BE ACCEPTABLE AS LONG AS THEY CONFORM TO THE CRITERIA IN THESE STANDARDS, AND ARE APPROVED BY THE ENGINEER.
- ② RAMP AND TURNING SPACE CROSS SLOPE - 2.0% TYPICAL. AT CROSSINGS WITHOUT YIELD OR STOP CONTROL, OR WITH A SIGNAL WHERE VEHICLES CAN PROCEED THROUGH THE INTERSECTION WITHOUT SLOWING OR STOPPING, THE CROSS SLOPE OF THE RAMP AND TURNING SPACE MAY EQUAL THE HIGHWAY GRADE. AT MIDBLOCK PEDESTRIAN STREET CROSSINGS THE RAMP AND TURNING SPACE CROSS SLOPE MAY EQUAL THE HIGHWAY GRADE.
- ③ WHERE IT IS ACCEPTABLE FOR A RAMP OR TURNING SPACE CROSS SLOPE TO EXCEED 2.0% AND MATCH THE HIGHWAY GRADE, THE RAMP ABOVE THE TURNING SPACE MAY BE WARPED TO TIE INTO THE ADJOINING SIDEWALK CROSS SLOPE. THE TRANSITION TO THE SIDEWALK CROSS SLOPE SHALL BE SPREAD EVENLY OVER THE LENGTH OF THE RAMP TO MINIMIZE WARPING. THE RATE OF CHANGE IN CROSS SLOPE MAY NOT EXCEED 3.0% PER LINEAR FOOT.


-  TURNING SPACE ② ③
-  DETECTABLE WARNING SURFACE (DWS)
SEE DWS SHEETS FOR PLACEMENT DETAILS
-  RAMP RUNNING SLOPE
-  RAMP CROSS SLOPE ② ③

COMBINATION CURB RAMPS TYPICAL CONFIGURATIONS


Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	CURB RAMPS		STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments				M-608-1
Designer Initials: JBK	(R-X)						Standard Sheet No. 6 of 10
Last Modification Date: 07/31/19	(R-X)			Issued by the Project Development Branch: July 31, 2019			Project Sheet Number:
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						

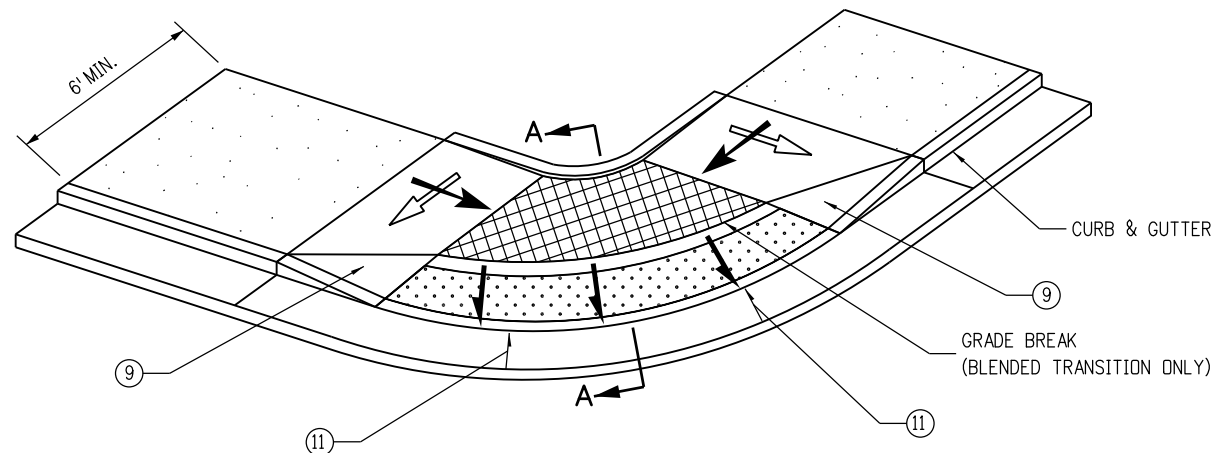


BLENDING TRANSITION

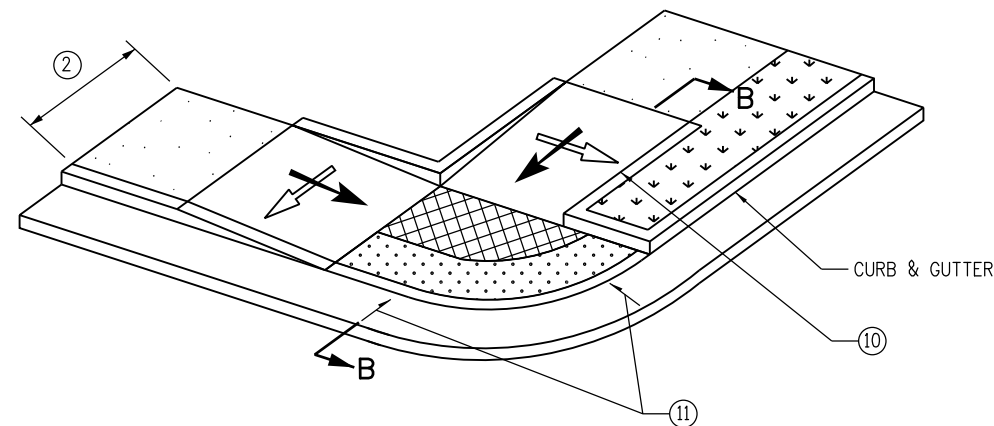


DEPRESSED CORNER

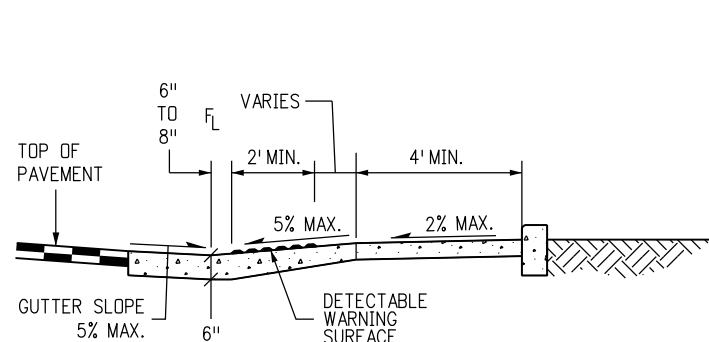


SECTION A-A

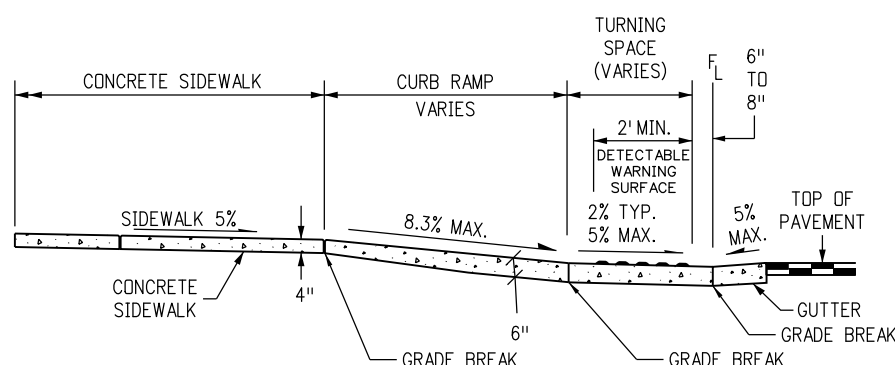

SECTION B-B

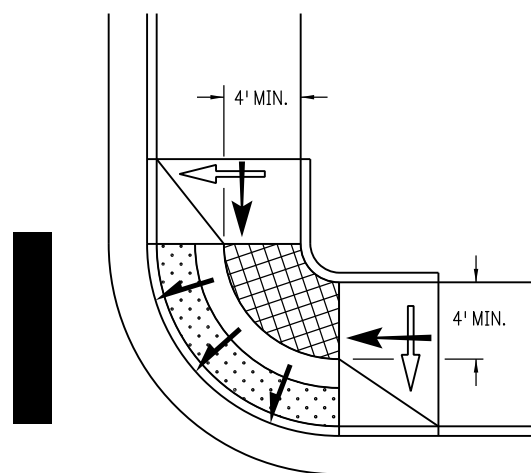

BLENDING TRANSITION

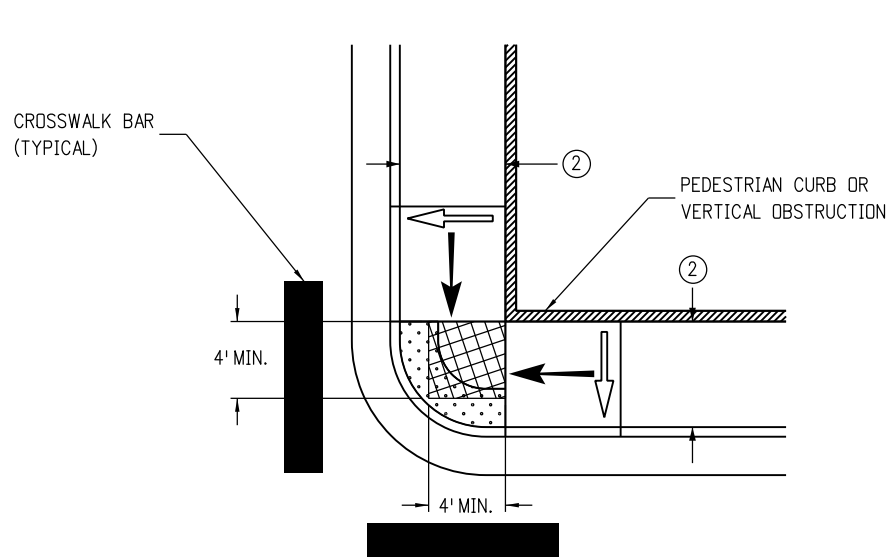

DEPRESSED CORNER




TYPE 5 - DEPRESSED CORNER/BLENDING TRANSITION



BLENDING TRANSITION & DEPRESSED CORNER NOTES

- PERPENDICULAR AND PARALLEL RAMP CONFIGURATIONS ARE PREFERRED. BLENDING TRANSITIONS AND DEPRESSED CORNERS SHOULD ONLY BE USED WHERE SITE CONDITIONS MAKE THEM A MORE APPROPRIATE OPTION, OR WHERE PERPENDICULAR OR PARALLEL RAMP CANNOT BE INSTALLED DUE TO A PHYSICAL SITE CONSTRAINT.
- RAMP WIDTH - PROVIDE 5 FT. OR GREATER WHERE POSSIBLE. IF SITE CONSTRAINTS DO NOT PERMIT, PROVIDE 4 FT. WIDTH MINIMUM. RAMP SERVING SHARED USE PATHS SHALL MATCH THE WIDTH OF THE PATH.
- RAMP RUNNING SLOPE - 8.3% MAX.
- BLENDING TRANSITION RUNNING SLOPE - 5.0% MAX.
- RAMP AND TURNING SPACE CROSS SLOPE - 2.0% TYPICAL. AT CROSSINGS WITHOUT YIELD OR STOP CONTROL, OR WITH A SIGNAL WHERE VEHICLES CAN PROCEED THROUGH THE INTERSECTION WITHOUT SLOWING OR STOPPING, THE CROSS SLOPE OF RAMP AND TURNING SPACES MAY EQUAL THE HIGHWAY GRADE.
- TURNING SPACE DIMENSIONS - PROVIDE A 4 FT. X 4 FT. MIN. TURNING SPACE AT THE BOTTOM OF RAMP RUNS. THE TURNING SPACE MAY CONTAIN THE DETECTABLE WARNING SURFACES.
- RAMP ALIGNMENT - TURNING SPACE SHALL BE ALIGNED TO BE FULLY CONTAINED WITHIN THE CROSSWALK OR STREET CROSSING(S) THEY SERVE.
- RAMP LENGTH - RAMP LENGTH IS DEPENDENT UPON THE RAMP SLOPE AND THE CHANGE OF ELEVATION FROM THE TURNING SPACE TO THE SIDEWALK. WHERE TERRAIN IS SLOPING A RAMP IS NOT REQUIRED TO CHASE GRADE MORE THAN 15 FT. REGARDLESS OF THE RESULTING RAMP SLOPE.
- RAMP FLARES - WHERE A RAMP EDGE ABUTS A WALKABLE SURFACE, A FLARED SIDE MUST BE PROVIDED. RAMP FLARE SLOPES SHALL NOT EXCEED 10.0%.
- VERTICAL CURB RETURNS - VERTICAL CURB RETURNS MAY BE USED ONLY WHERE A RAMP ABUTS A NON-WALKABLE SURFACE, OR WHERE A RAMP IS PROTECTED FROM PEDESTRIAN CROSS TRAFFIC (FOR EXAMPLE BY A SIGNAL CABINET OR UTILITY POLE WHICH BLOCKS PASSAGE).
- GUTTER COUNTER SLOPE - 5.0% MAX.
- DWS PLACEMENT - DWS SHALL BE PLACED AROUND THE RADIUS AND LOCATED AT THE BACK OF CURB ON BLENDING TRANSITION AND DEPRESSED CORNER RAMP.




Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	CURB RAMPS	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-608-1	
Designer Initials: JBK	(R-X)					Standard Sheet No. 7 of 10	
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:	
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English					Issued by the Project Development Branch: July 31, 2019		

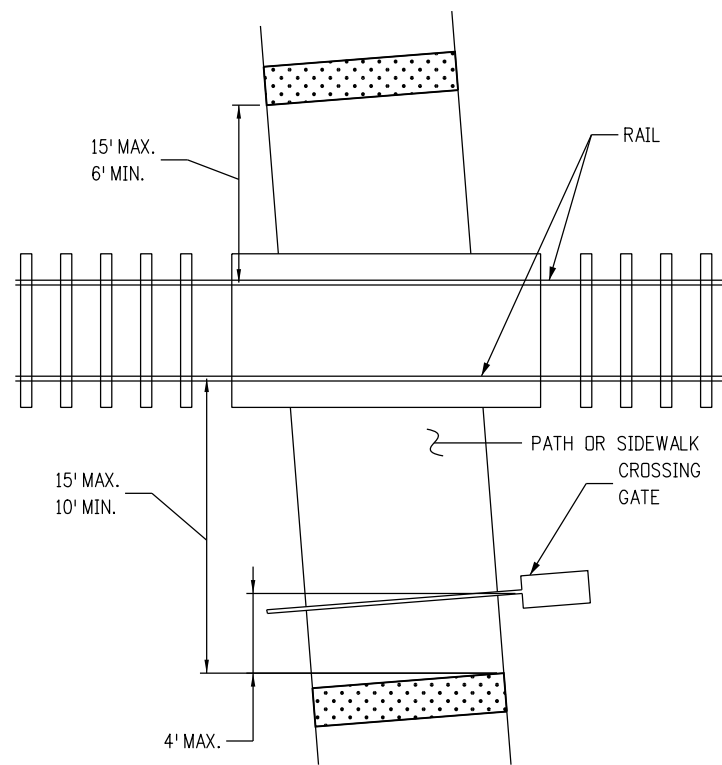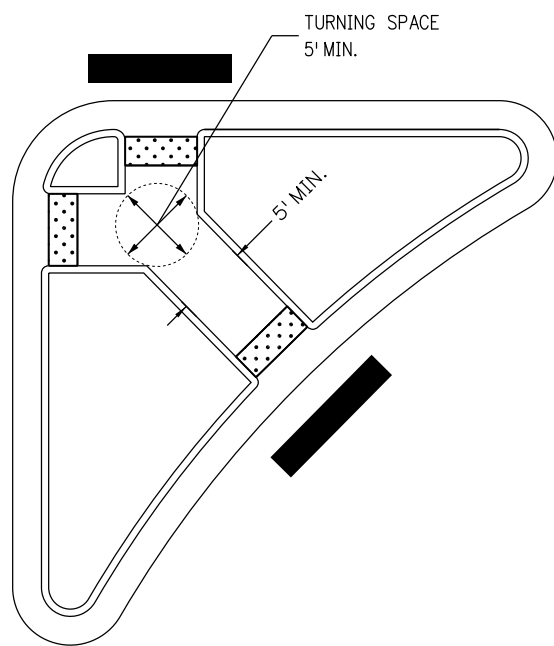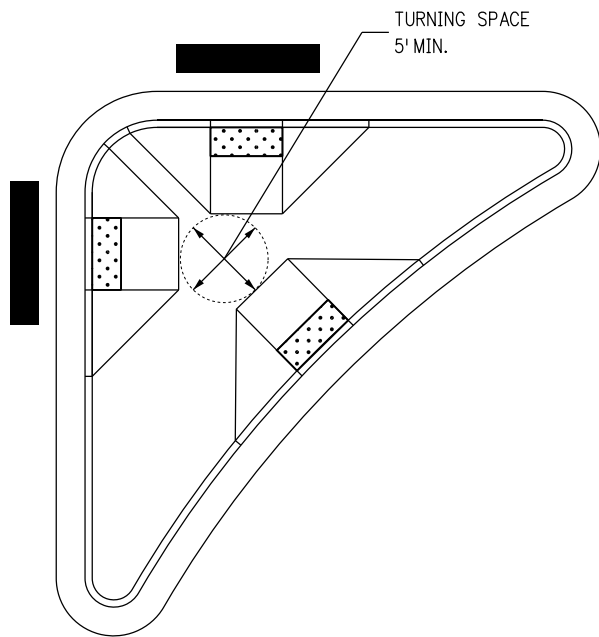

NOTES:



- ① DETECTABLE WARNING SURFACES SHALL BE PLACED IN ALIGNMENT WITH THE BACK OF CURB.
- ② FLARED SIDES ARE PREFERENTIAL ON RAISED INTERSECTION ISLANDS AND SHOULD BE PROVIDED ON ISLANDS WHICH SERVE SHARED USE PATHS, OR AT LOCATIONS WHERE BICYCLE USE IS EXPECTED.
- ③ FOR CUT-THROUGH MEDIAN ISLANDS, DETECTABLE WARNING SURFACES SHALL BE PLACED IN ALIGNMENT WITH THE BACK OF CURB AND BE SEPARATED BY A MINIMUM 2 FOOT SPACE WITHOUT DWS. IF A 2 FOOT SEPARATION BETWEEN DETECTABLE WARNING SURFACES CANNOT BE PROVIDED NO DETECTABLE WARNING SURFACE SHALL BE INSTALLED.
- ④ CURB RAMP AND CUT-THROUGH WIDTHS SHOULD BE THE SAME WIDTH AS ANY SIDEWALK OR SHARED USE PATH WHICH THEY SERVE.

INTERSECTION ISLANDS

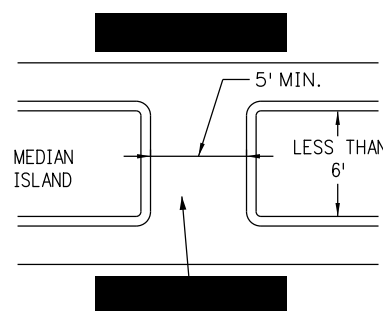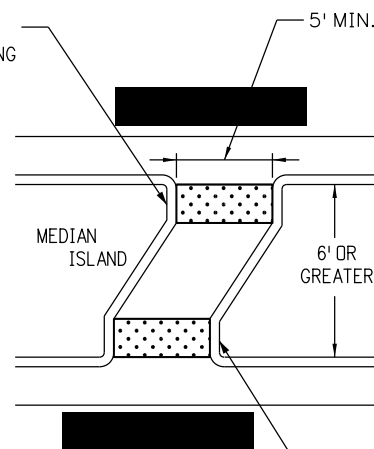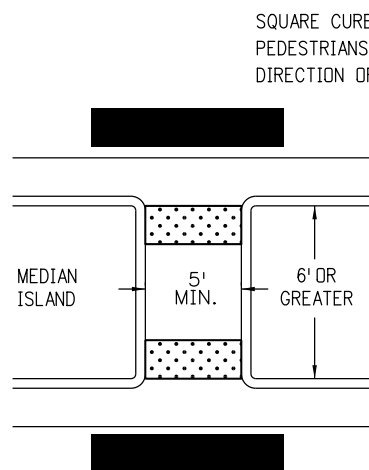


ELIMINATE DWS IF MEDIAN REFUGE IS LESS THAN 6' IN LENGTH IN THE DIRECTION OF PEDESTRIAN TRAVEL

MEDIAN ISLANDS

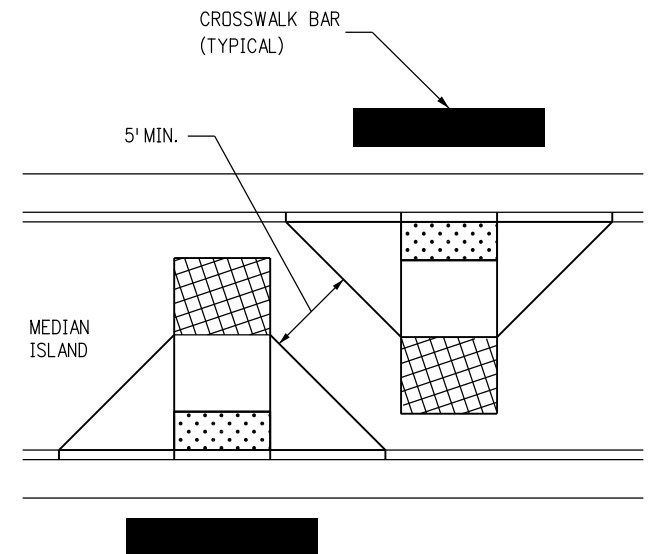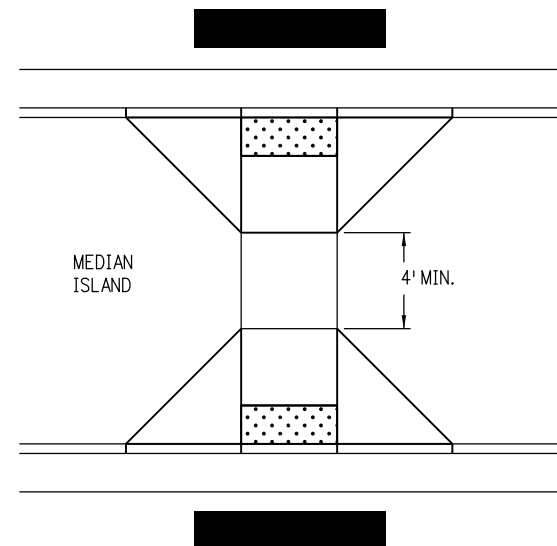


MEDIANS / RAILROADS / ISLANDS


Computer File Information			Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)		Date:	Comments		M-608-1	
Designer Initials: JBK						Standard Sheet No. 8 of 10	
Last Modification Date: 07/31/19						Project Sheet Number:	
Detailer Initials: LTA						Issued by the Project Development Branch: July 31, 2019	
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English							

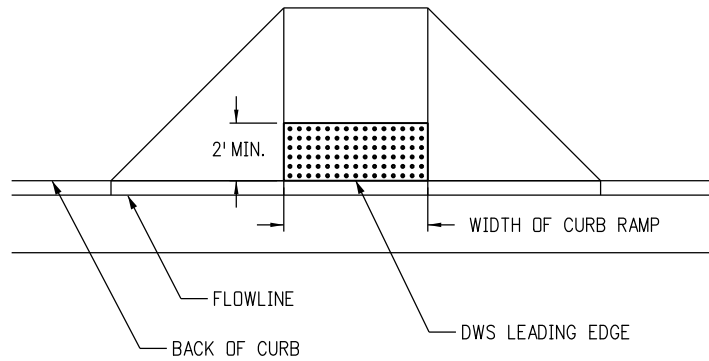


TYPE 1 CURB RAMP
(PERPENDICULAR ON TANGENT)

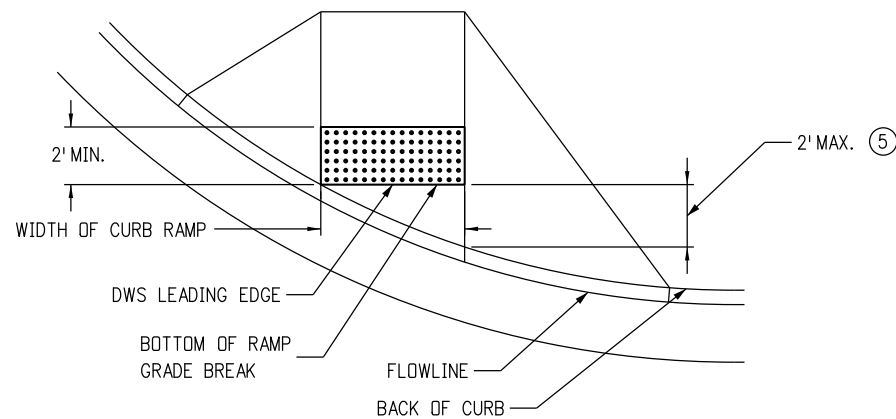


TYPE 1 CURB RAMP
(DIRECTIONAL ON RADIUS)

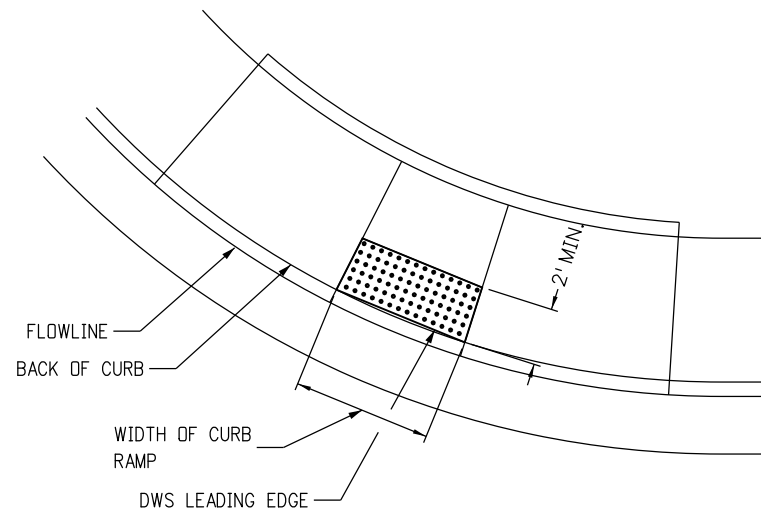


TYPE 2 CURB RAMP

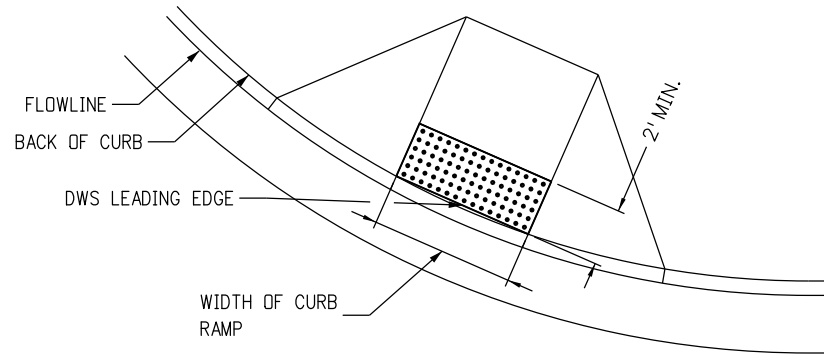

TYPE 1 CURB RAMP
(PERPENDICULAR ON RADIUS)

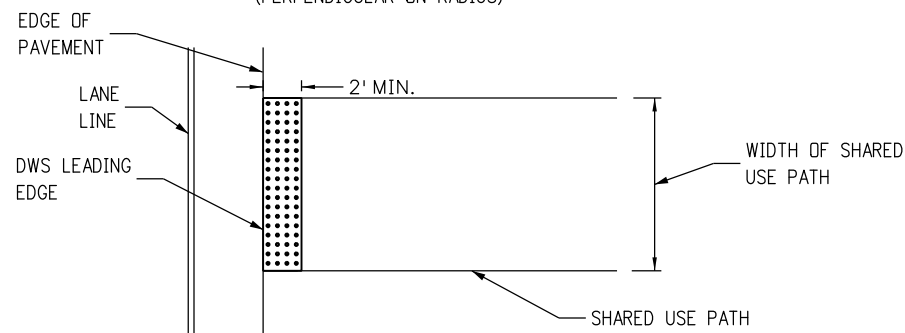


SHARED USE PATH CROSSING

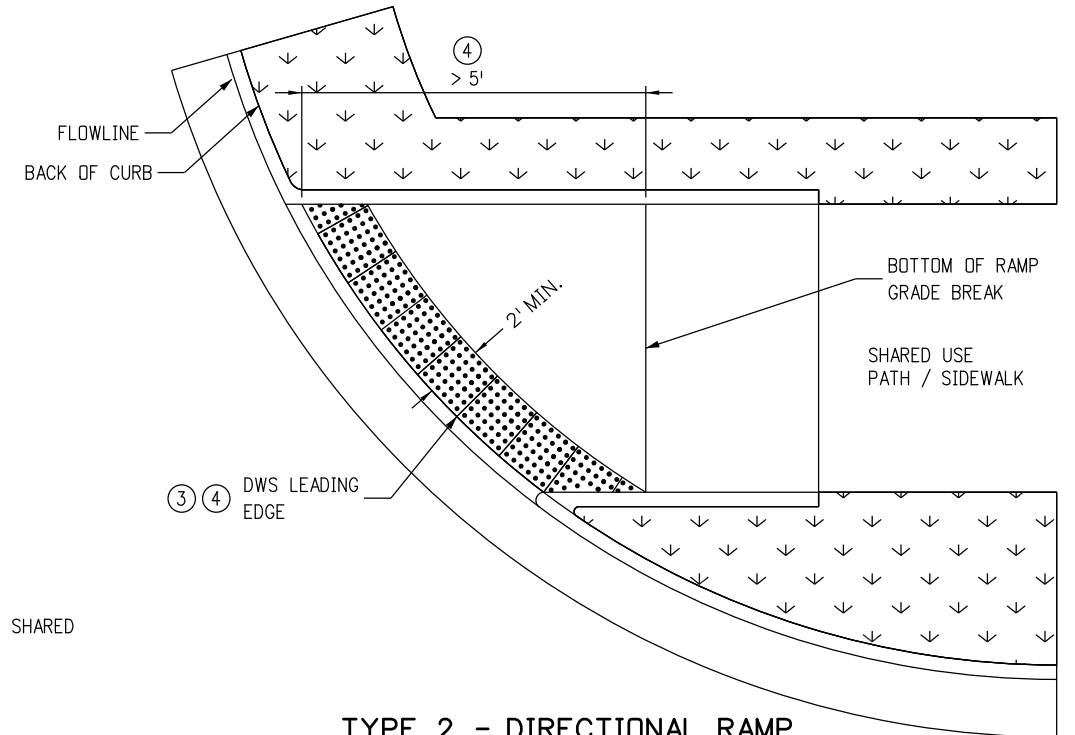

TYPE 2 - DIRECTIONAL RAMP

DETECTABLE WARNING SURFACE NOTES:

- DETECTABLE WARNING SURFACES (DWS) SHALL BE INSTALLED AT SIDEWALK, OR SHARED USE PATH, TO STREET TRANSITIONS, AND SHALL CONSIST OF TRUNCATED DOME SURFACES. ANY TRUNCATED DOME PANELS OR PAVERS WHICH ARE USED MUST BE ON THE CDOT APPROVED PRODUCTS LIST (APL).
- THE DETECTABLE WARNING SURFACE SHALL SPAN THE FULL WIDTH OF THE CURB RAMP, SHARED USE PATH, OR OTHER ROADWAY ENTRANCE AS APPLICABLE. A GAP OF 2 INCHES FROM THE EDGE OF THE DETECTABLE WARNING SURFACE TO THE EDGE OF THE CURB RAMP OR SHARED USE PATH IS PERMITTED.
- WHEN DETECTABLE WARNING SURFACES ARE PLACED ON A SLOPE GREATER THAN 5.0%, TRUNCATED DOMES SHOULD BE ALIGNED IN THE DIRECTION OF THE RAMP RUN; OTHERWISE DOMES ARE NOT REQUIRED TO BE ALIGNED. TRUNCATED DOMES SHALL BE IN A SQUARE GRID OR RADIAL PATTERN. WHEN PLACED RADIALLY, PLACE ADJACENT DWS PLATES EDGE TO EDGE. EDGES OF CUT PLATES SHALL BE STRAIGHT.
- LOCATE ONE CORNER OF THE DWS LEADING EDGE AT THE BACK OF CURB. NO POINT ON THE LEADING EDGE OF THE DWS MAY BE MORE THAN 5 FT. FROM THE BACK OF CURB. WHEN ANY POINT OF THE LEADING EDGE OF THE DWS WILL BE GREATER THAN 5 FT. FROM THE BACK OF CURB, PLACE THE DWS RADIALLY AT THE BACK OF CURB.
- WHERE PERPENDICULAR DIRECTIONAL RAMPS ABUT A WALKABLE SURFACE, THE LEADING EDGE OF THE DWS SHALL NOT BE PLACED FURTHER THAN 2 FEET FROM THE BACK OF CURB. IF THE RADIUS OF A CORNER MAKES THIS IMPOSSIBLE, ORIENT THE CURB RAMP PERPENDICULAR TO THE CURB AND GUTTER.
- IF THE DETECTABLE WARNING SURFACE IS CUT, GRIND OFF THE REMAINING PORTION OF ANY CUT TRUNCATED DOMES. SEAL ALL CUT PANEL EDGES WITH AN APL SEALANT TO PREVENT WATER DAMAGE.
- TRUNCATED DOME PLATES SHALL BE EMBEDDED IN THE CONCRETE CURB RAMP WHILE THE CONCRETE IS PLASTIC.
- DWS SHALL NOT BE PLACED OVER GRADE BREAKS.

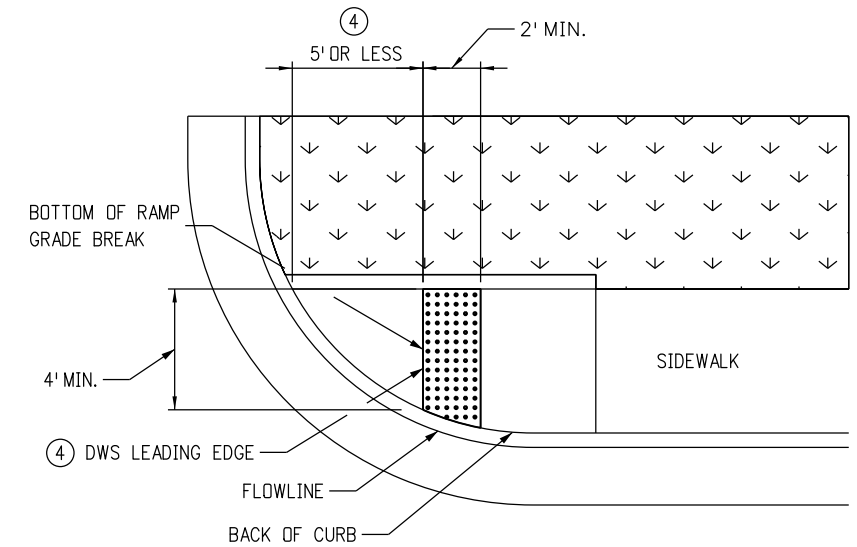


TYPE 2 - DIRECTIONAL RAMP

 DETECTABLE WARNING SURFACE (DWS)


DETECTABLE WARNING SURFACE PLACEMENT

Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	CURB RAMPS		STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments				M-608-1	
Designer Initials: JBK	(R-X)						Standard Sheet No. 9 of 10	
Last Modification Date: 07/31/19	(R-X)						Project Sheet Number:	
Detailer Initials: LTA	(R-X)							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English					Issued by the Project Development Branch: July 31, 2019			

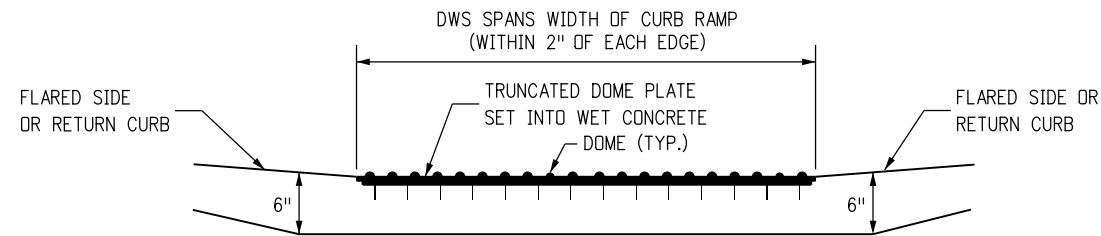


SECTION VIEW OF DETECTABLE WARNING SURFACE PLATE

(LOOKING AT PERPENDICULAR RAMP RUN FROM STREET)

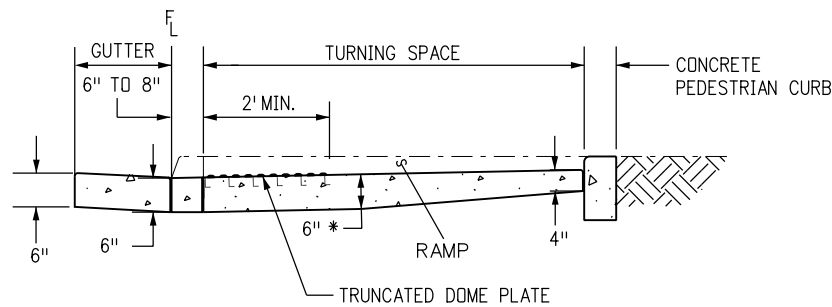

SECTION VIEW FOR PARALLEL CURB RAMP TYPES


(LOOKING PERPENDICULAR TO TURNING SPACE)

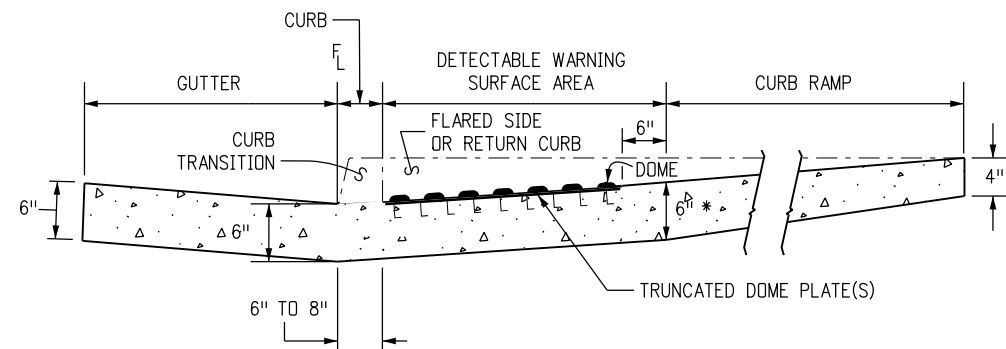


SECTION VIEW FOR PERPENDICULAR CURB RAMP TYPES

(LOOKING PERPENDICULAR TO RAMP RUN)


THE TOP DIAMETER OF THE TRUNCATED DOMES SHALL BE 50% TO 65% OF THE BASE DIAMETER

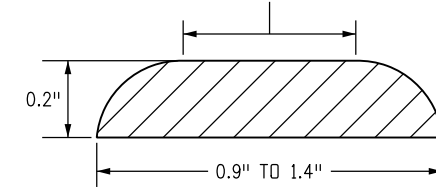

ELEVATION VIEW OF SINGLE TRUNCATED DOME

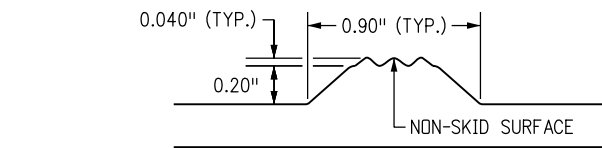


ELEVATION VIEW OF TRUNCATED DOME FOR DETECTABLE WARNING PLATE

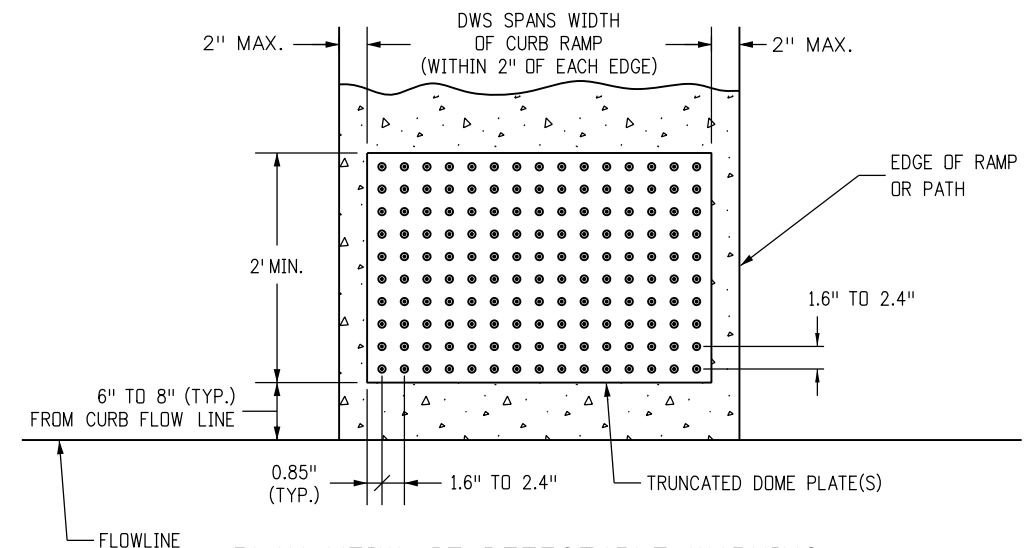


PLAN VIEW OF DETECTABLE WARNING SURFACE PLATE

DETECTABLE WARNING SURFACE DETAILS


Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	CURB RAMPS	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-608-1	
Designer Initials: JBK	(R-X)					Standard Sheet No. 10 of 10	
Last Modification Date: 07/31/19	(R-X)					Issued by the Project Development Branch: July 31, 2019	
Detailer Initials: LTA	(R-X)					Project Sheet Number:	
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English							

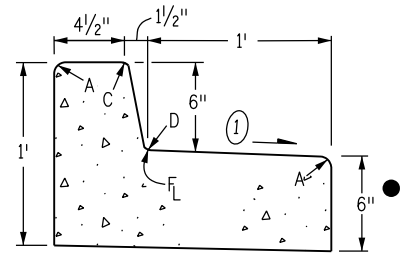


CURB AND GUTTER TYPE 2
(SECTION IB)
(6 IN. BARRIER - 1 FT. GUTTER)

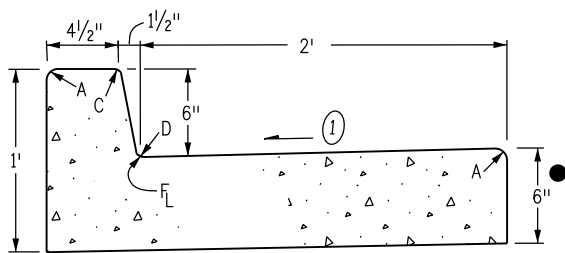


CURB AND GUTTER TYPE 2
(SECTION IIB)
(6 IN. BARRIER - 2 FT. GUTTER)

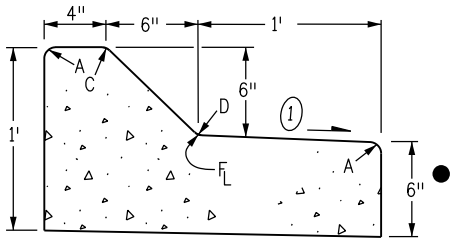


CURB AND GUTTER TYPE 2
(SECTION IM)
(6 IN. MOUNTABLE - 1 FT. GUTTER)

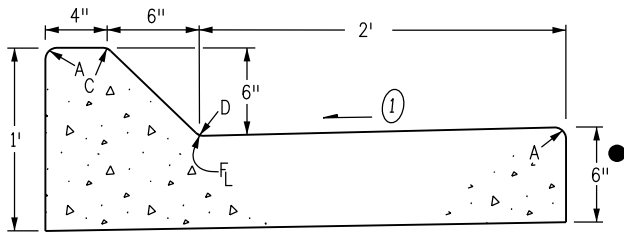


CURB AND GUTTER TYPE 2
(SECTION IIM)
(6 IN. MOUNTABLE - 2 FT. GUTTER)

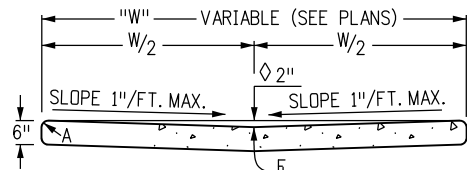


GUTTER TYPE 2

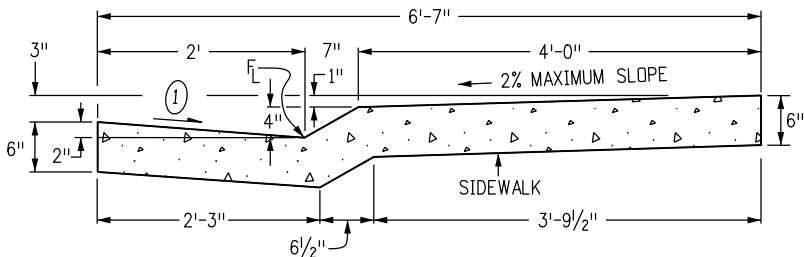

CURB AND GUTTER TYPE 2
(SECTION MS)
(4 IN. MOUNTABLE WITH SIDEWALK)

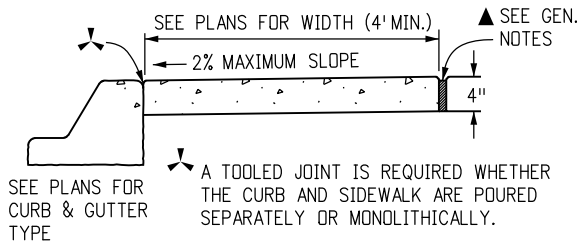

CONCRETE SIDEWALK

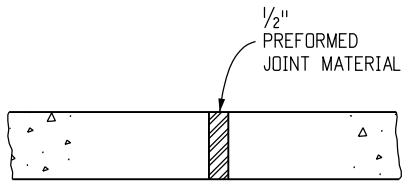

NOTES: 1. EXPANSION JOINTS SHALL BE PLACED IN THE SIDEWALK AT INTERVALS OF NOT MORE THAN 500 FT.
2. EXPANSION JOINTS MAY BE SEALED WHEN SPECIFIED ON THE PLANS.


SIDEWALK EXPANSION JOINT

GENERAL NOTES

- ON ROADWAY CURVES WITH A RADIUS OF 1,900 FT. OR LESS, CURBS AND GUTTERS ARE TO BE PLACED ON THE ARC OF THE CURVE, UNLESS OTHERWISE NOTED ON THE PLANS. A MAXIMUM CHORD LENGTH OF 10 FT. MAY BE USED WHEN THE CURVE RADIUS IS GREATER THAN 1,900 FT.
- CONCRETE SHALL BE CLASS B.
- PROFILE GRADE OF CURBS AND GUTTERS SHALL BE LOCATED AT THE FLOW LINE.
- CURB TYPE 4 (KEY-WAY) MAY BE USED IN LIEU OF CURB AND GUTTER TYPE 2 (SECTIONS IB AND IM) UNLESS OTHERWISE SPECIFIED ON THE PLANS.
- GUTTER CROSS SLOPES MAY BE ADJUSTED TO FACILITATE DRAINAGE FOR PROFILE GRADES AS SHOWN ON THE PLANS.
- THICKNESS OF CURB AND GUTTER SECTION SHALL MATCH CONCRETE PAVEMENT THICKNESS IF SHOWN ON THE PLANS. CURB AND GUTTER SHALL BE CLASS P CONCRETE IF PLACED MONOLITHICALLY WITH CONCRETE PAVEMENT.
- INCREASE SIDEWALK THICKNESS TO 6 IN. AT LOCATIONS SHOWN ON THE PLANS.
- MINIMUM SIDEWALK WIDTH IS 4 FT.

- EXPANSION JOINTS SHALL BE INSTALLED WHEN ABUTTING EXISTING CONCRETE OR FIXED STRUCTURE. EXPANSION JOINT MATERIAL SHALL BE 1/2 IN. THICK AND SHALL EXTEND THE FULL DEPTH OF CONTACT SURFACE.
- GUTTER CROSS SLOPES SHALL BE 1/2 IN./FT. WHEN DRAINING AWAY FROM CURB AND 1 IN./FT. WHEN DRAINING TOWARD CURB (WITH EXCEPTION TO IMMEDIATELY ADJACENT TO CURB RAMPS - SEE STANDARD PLAN M-608-1 FOR SLOPE REQUIREMENTS).
- WHEN TIE BARS ARE REQUIRED, THE GUTTER THICKNESS SHALL BE INCREASED TO THE PAVEMENT THICKNESS (T). BARS SHALL BE EPOXY-COATED #4 CONFORMING TO AASHTO M 284 AND SPACED AT 3 FT. INTERVALS. THEY SHALL BE INSERTED T/2 AND 1#2 LENGTH INTO THE GUTTER.

LEGEND FOR RADII
A = 1/8" TO 1/4"
B = 1"
C = 1 1/2"
D = 1 1/2" TO 2"

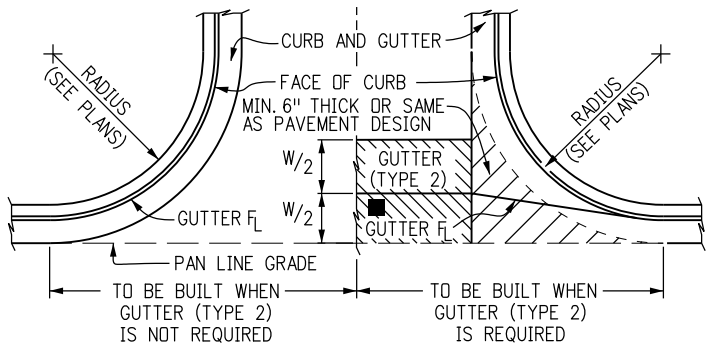

- THIS AREA SHALL BE POURED MONOLITHICALLY WITH CURB AND GUTTER AND PAID FOR AS "CONCRETE PAVEMENT".
- FLOW LINE LOCATION WILL BE ESTABLISHED BY W/2 SHOWN ON PLANS.

CONSTRUCTION OF CONCRETE GUTTERS AT INTERSECTION

Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	CURB, GUTTERS, AND SIDEWALKS Issued by the Project Development Branch: July 31, 2019	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-609-1	
Designer Initials: JBK						Standard Sheet No. 1 of 4	
Last Modification Date: 07/31/19						Project Sheet Number:	
Detailer Initials: LTA							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						

CURB TYPE 2
(SECTION B)
6 IN. BARRIER

CURB TYPE 2
(SECTION M)
6 IN. MOUNTABLE

CURB TYPE 4
(SECTION B)
6 IN. BARRIER

CURB TYPE 4
(SECTION M)
6 IN. MOUNTABLE

3/4" DIA. x 12" DEFORMED REINFORCING BARS AT 6 FT. SPACING SHALL BE GROUTED IN 1/4" DIA. HOLES IN EXISTING CONCRETE. GROUT SHALL CONSIST OF 2 PARTS CLEAN SAND AND 1 PART CEMENT. COST OF INSTALLATION SHALL BE INCLUDED IN THE PRICE BID FOR CURB.

CURB TYPE 6
(SECTION M)
4 IN. MOUNTABLE

ASPHALT OR
CONCRETE PAVEMENT
AT SHOULDER

NOTE: BITUMINOUS OR CONCRETE* UNLESS OTHERWISE SPECIFIED ON THE PLANS.

▲ KEY-WAY MAY BE OMITTED WHEN PLACED UNDER GUARDRAIL.

(SECTION B)

(SECTION M)

* CONCRETE CLASS B SHALL CONTAIN 1.5 POUNDS PER CUBIC YARD OF APPROVED POLYPROPYLENE FIBERS AND MAY HAVE A NOMINAL AGGREGATE SIZE OF $\frac{3}{8}$ IN.

LEGEND FOR RADII
A = $\frac{1}{8}$ TO $\frac{1}{4}$ "
B = 1"
C = $1\frac{1}{2}$ "
D = $1\frac{1}{2}$ " TO 2"

CURB TYPE 4 (KEY-WAY)*


CURB CUT FOR DRIVEWAYS
(WITHOUT ATTACHED SIDEWALK)

SECTION A-A



CONCRETE PAVEMENT (DRIVEWAYS)

TRANSVERSE CONTRACTION JOINT FOR CONCRETE PAVEMENT (DRIVEWAYS)


Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDDT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	CURB, GUTTERS, AND SIDEWALKS		STANDARD PLAN NO.			
Creation Date: 07/31/19			Date:	Comments				M-609-1			
Designer Initials: JBK											
Last Modification Date: 07/31/19											
Detailer Initials: LTA										Standard Sheet No. 2 of 4	
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English						Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:			

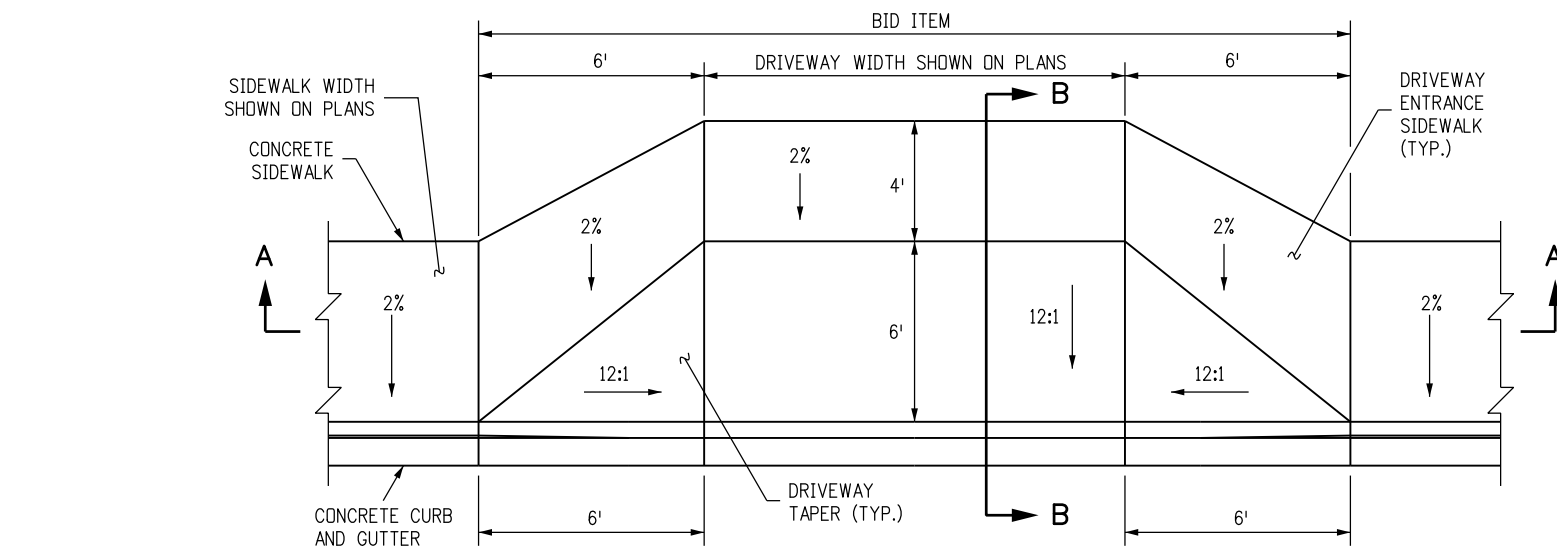


CONCRETE DRIVEWAY ENTRANCE TYPE 1

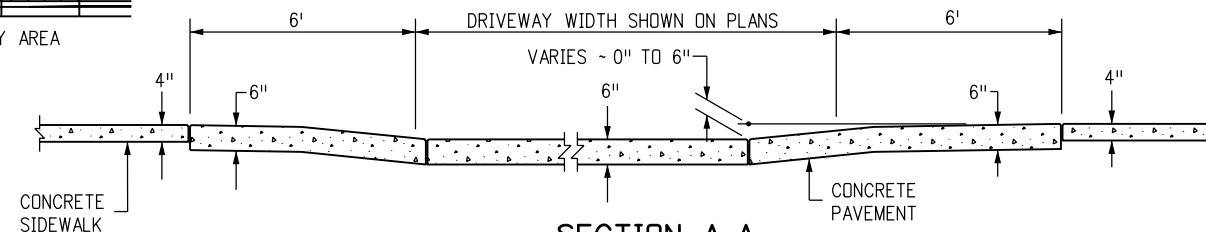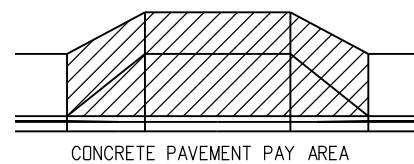



SECTION A-A

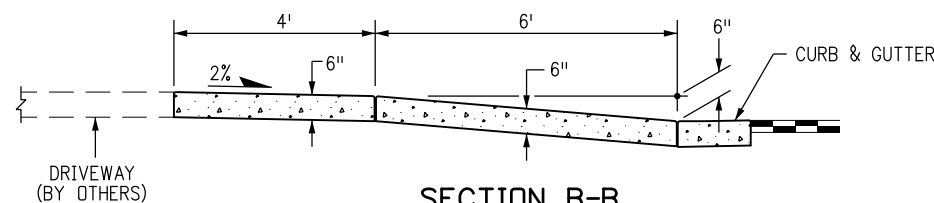


SECTION B-B

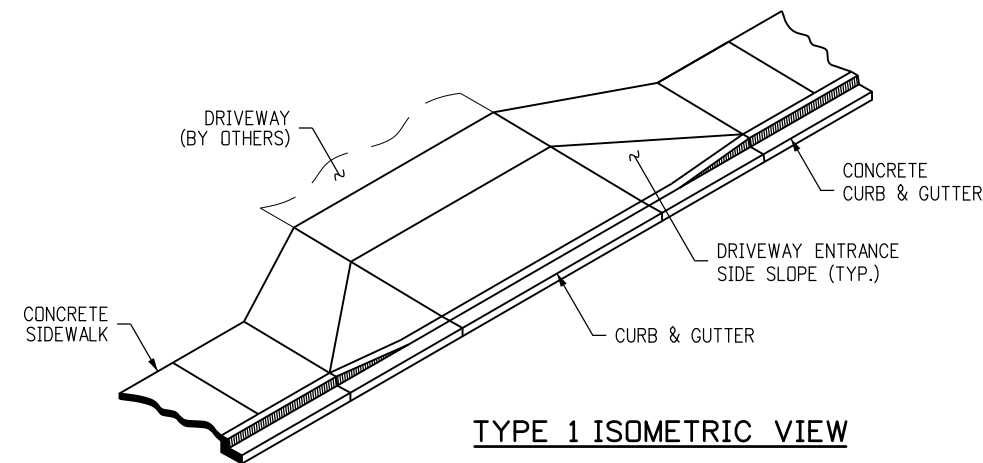


TYPE 1 ISOMETRIC VIEW

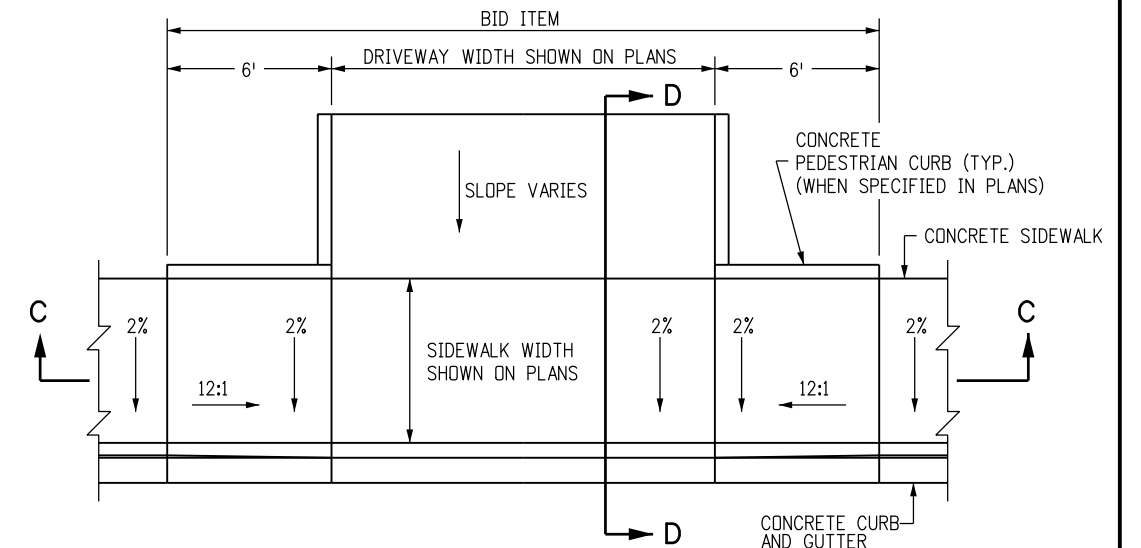

CONCRETE DRIVEWAY ENTRANCE TYPE 2

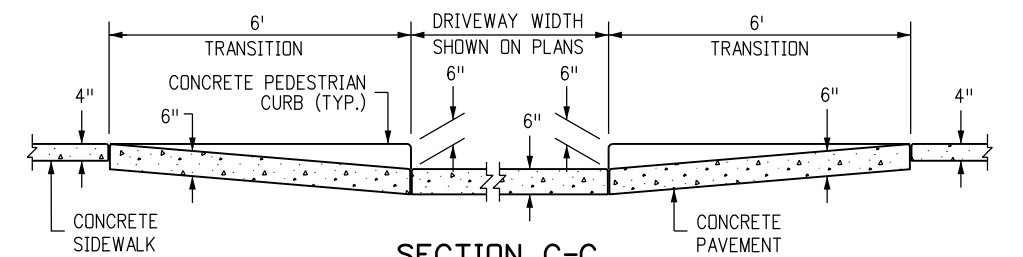

SECTION C-C

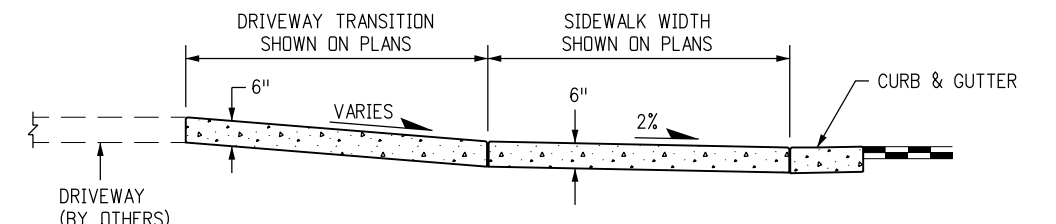

SECTION D-D

NOTES

1. DRAINAGE STRUCTURES, TRAFFIC SIGNAL EQUIPMENT, JUNCTION BOXES, AND OTHER OBSTRUCTIONS SHOULD NOT BE PLACED IN FRONT OF THE DRIVEWAY RAMP ACCESS AREAS.
2. FOR THE CURB AND GUTTER SHOWN, SEE PLANS FOR CURB TYPE.
3. RAMP SLOPES SHALL BE 12:1 OR FLATTER.
4. CONSTRUCTION OF THE CONCRETE PEDESTRIAN CURB SHALL BE INCLUDED IN THE BID PRICE OF THE CONCRETE PAVEMENT.

Colorado Department of Transportation
2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868
Project Development Branch

**CURB, GUTTERS,
AND SIDEWALKS**


Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.
M-609-1
Standard Sheet No. 3 of 4
Project Sheet Number:


Computer File Information	
Creation Date: 07/31/19	
Designer Initials: JBK	
Last Modification Date: 07/31/19	
Detailer Initials: LTA	
CAD Ver.: MicroStation V8	Scale: Not to Scale Units: English

Sheet Revisions	
Date:	Comments
(R-X)	
(R-X)	
(R-X)	
(R-X)	


Project Development Branch	JBK
----------------------------	-----

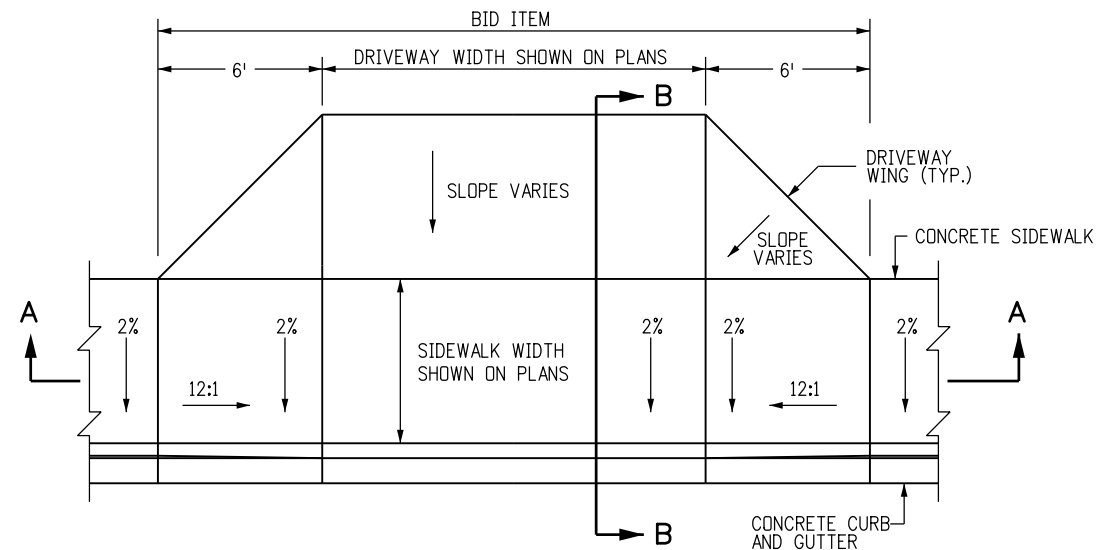


CONCRETE DRIVEWAY ENTRANCE TYPE 3

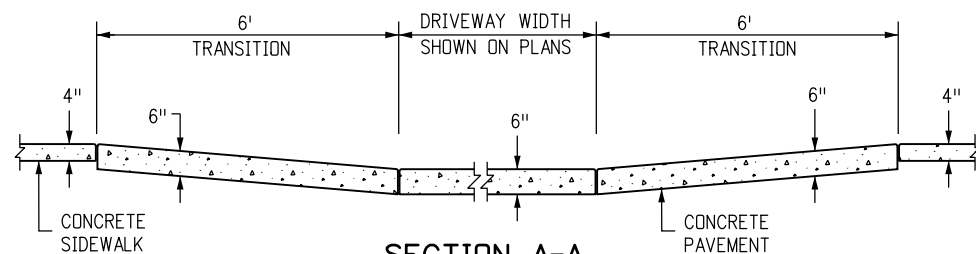

SECTION A-A

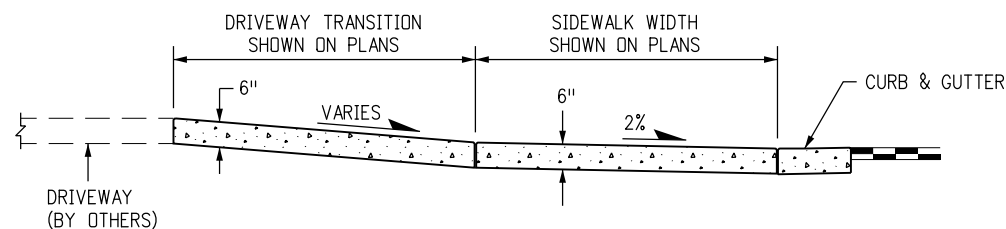


SECTION B-B

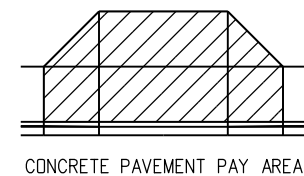


NOTES

1. DRAINAGE STRUCTURES, TRAFFIC SIGNAL EQUIPMENT, JUNCTION BOXES, AND OTHER OBSTRUCTIONS SHOULD NOT BE PLACED IN FRONT OF THE DRIVEWAY RAMP ACCESS AREAS.
2. FOR THE CURB AND GUTTER SHOWN, SEE PLANS FOR CURB TYPE.
3. RAMP SLOPES SHALL BE 12:1 OR FLATTER.




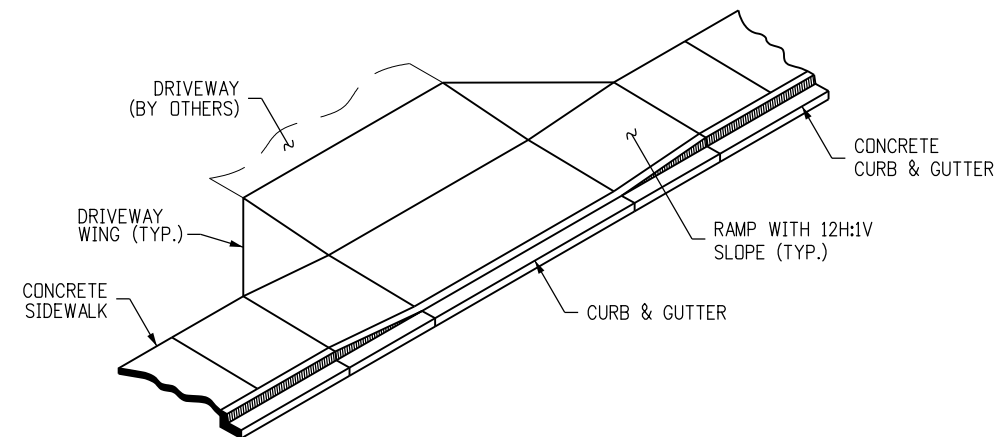


TYPE 3 ISOMETRIC VIEW


Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)	Date:	Comments		M-609-1	
Designer Initials: JBK					Standard Sheet No. 4 of 4	
Last Modification Date: 07/31/19					Project Sheet Number:	
Detailer Initials: LTA						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English				Issued by the Project Development Branch: July 31, 2019		

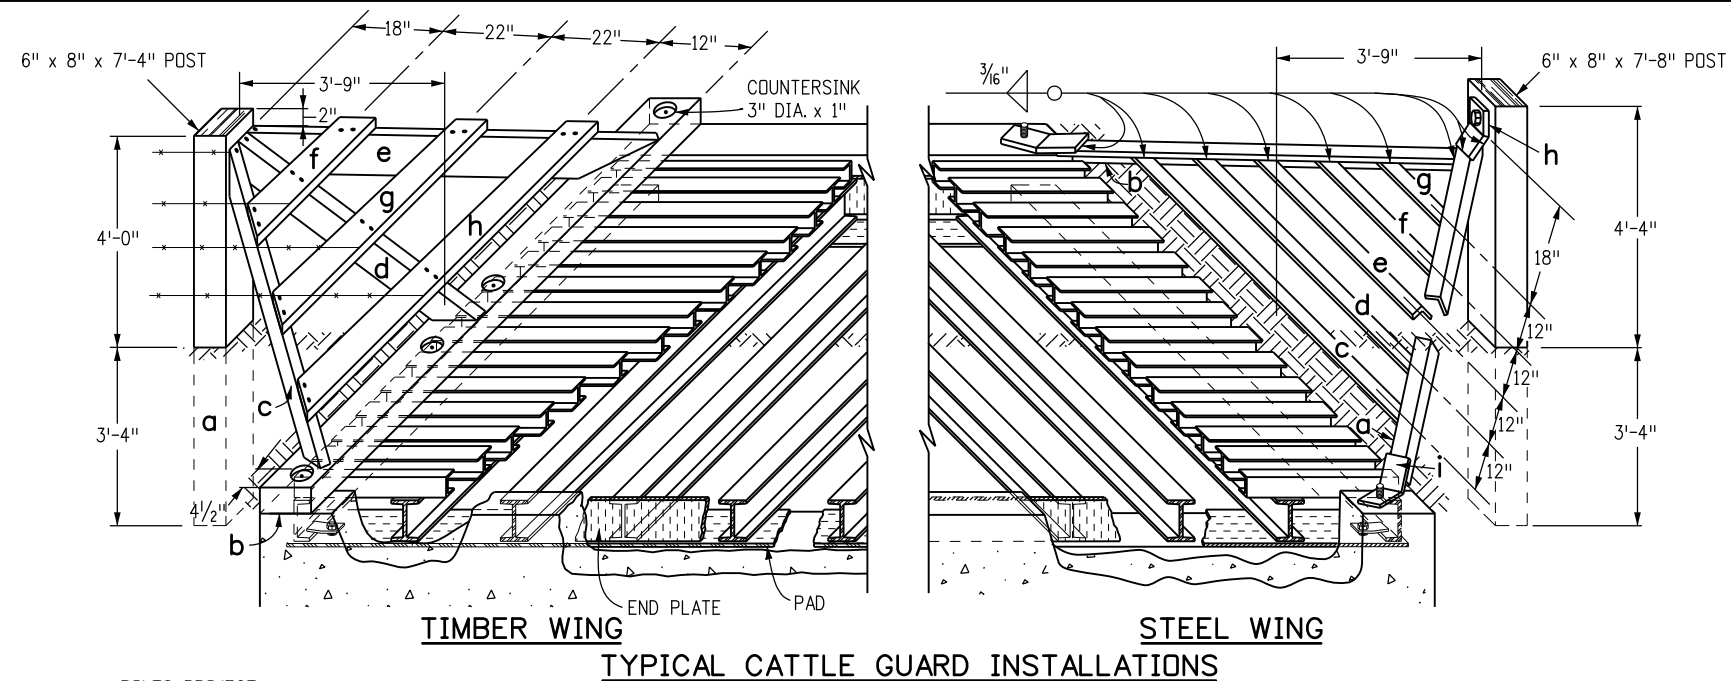

- ## GENERAL NOTES
1. CONCRETE SHALL BE CLASS B. FOUNDATION MAY BE CAST-IN-PLACE OR PRECAST.
 2. REINFORCING BARS SHALL BE #4, GRADE 60.
 3. ALL TIMBER SHALL BE TREATED IN CONFORMANCE WITH ASSHTO M 133 AND AWPA C14.
 4. WING POSTS MAY BE MADE FROM 8 IN. ROUND NATIVE TIMBER.
 5. ALL STRUCTURAL STEEL SHALL BE FABRICATED AND PAINTED WITH ALUMINUM PAINT IN ACCORDANCE WITH SECTION 509. ALL HARDWARE SHALL BE GALVANIZED IN CONFORMANCE WITH AASHTO M 111 OR PAINTED WITH ZINC-RICH PAINT MEETING MILITARY SPECIFICATION DOD-P-21035
 6. ALL STRUCTURAL STEEL SHALL CONFORM TO AASHTO M 270 (ASTM A 709) GRADE 36.
 7. WELDING SHALL CONFORM TO THE AWS STRUCTURAL WELDING CODE AND AASHTO STANDARD SPECIFICATIONS FOR WELDING OF STRUCTURAL STEEL HIGHWAY BRIDGES.
 8. WHEN A CATTLE GUARD IS TO BE INSTALLED IN IMPERVIOUS MATERIAL, ADEQUATE DRAINAGE SHALL BE PROVIDED TO INSURE AGAINST POSSIBLE SUBGRADE DAMAGE. DRAINAGE DETAILS SHALL BE AS SHOWN ON THE PLANS. AN OUTLET PIPE MAY BE CONSIDERED.
 9. TYPE OF WING (TIMBER OR STEEL) SHALL BE STEEL UNLESS OTHERWISE SHOWN ON THE PLANS.
 10. STRUCTURE EXCAVATION AND STRUCTURE BACKFILL WILL NOT BE MEASURED AND PAID FOR SEPARATELY, BUT SHALL BE INCLUDED IN THE WORK.
 11. ALTERNATIVE CATTLE GUARDS MAY BE CONSTRUCTED UPON APPROVAL BY THE PROJECT ENGINEER.

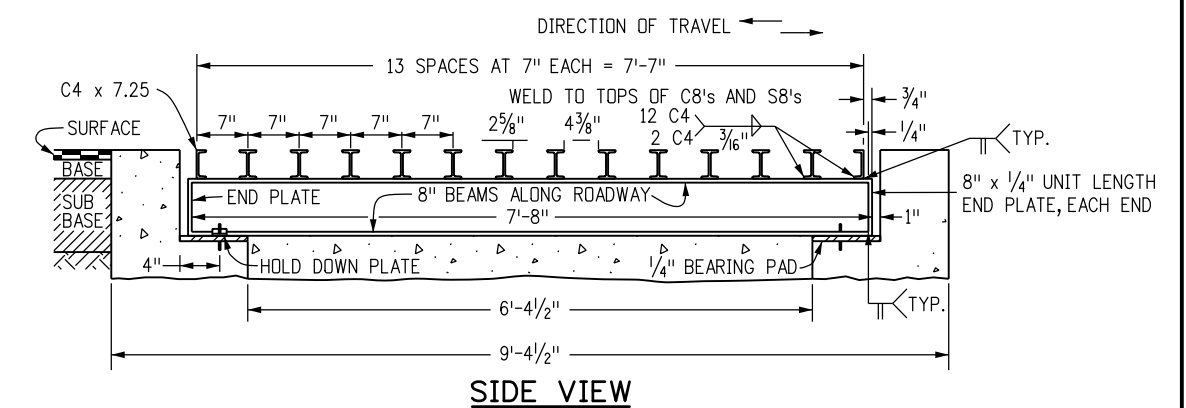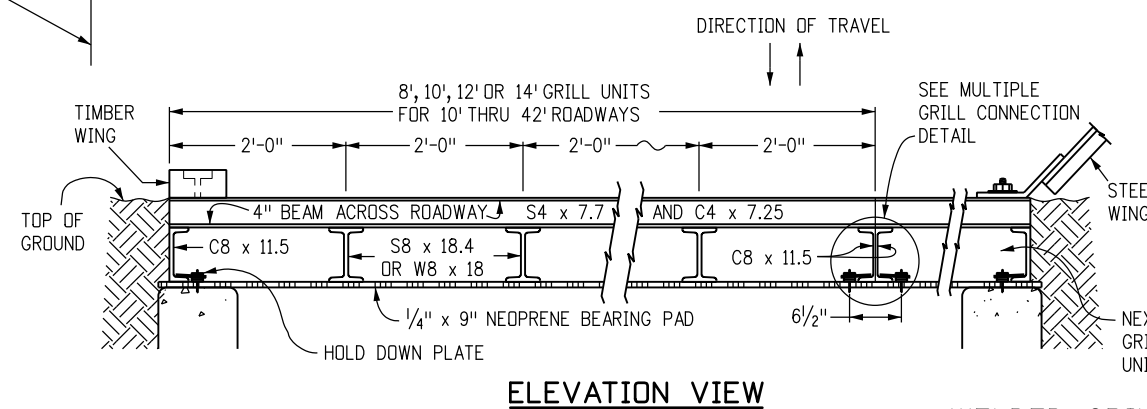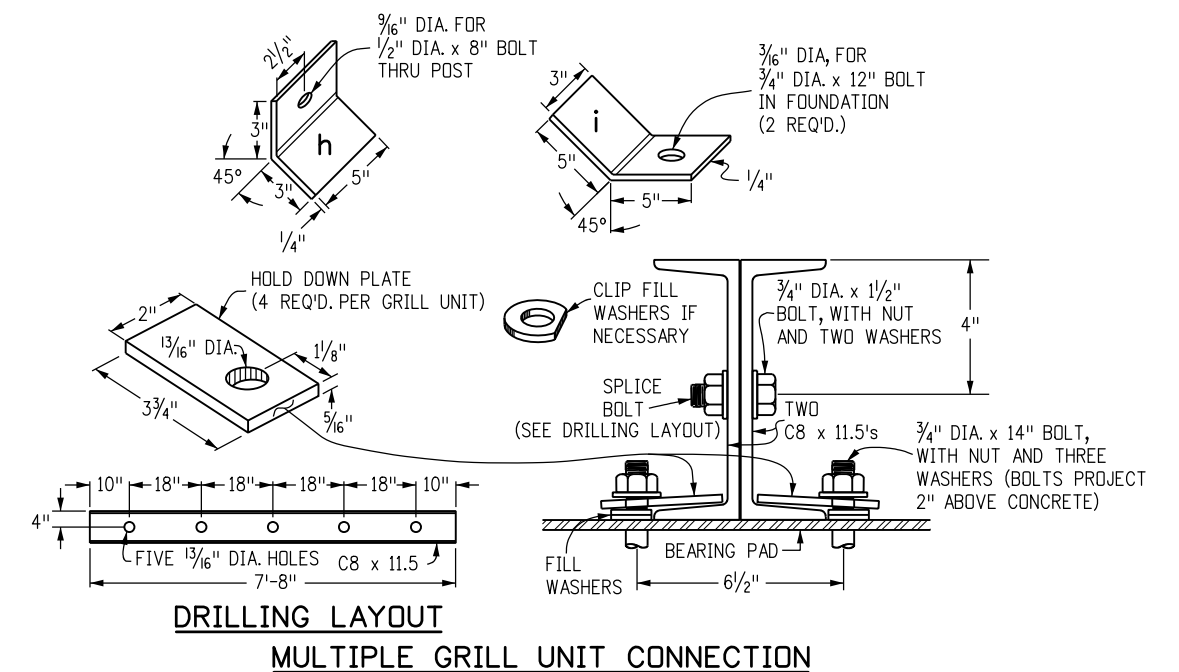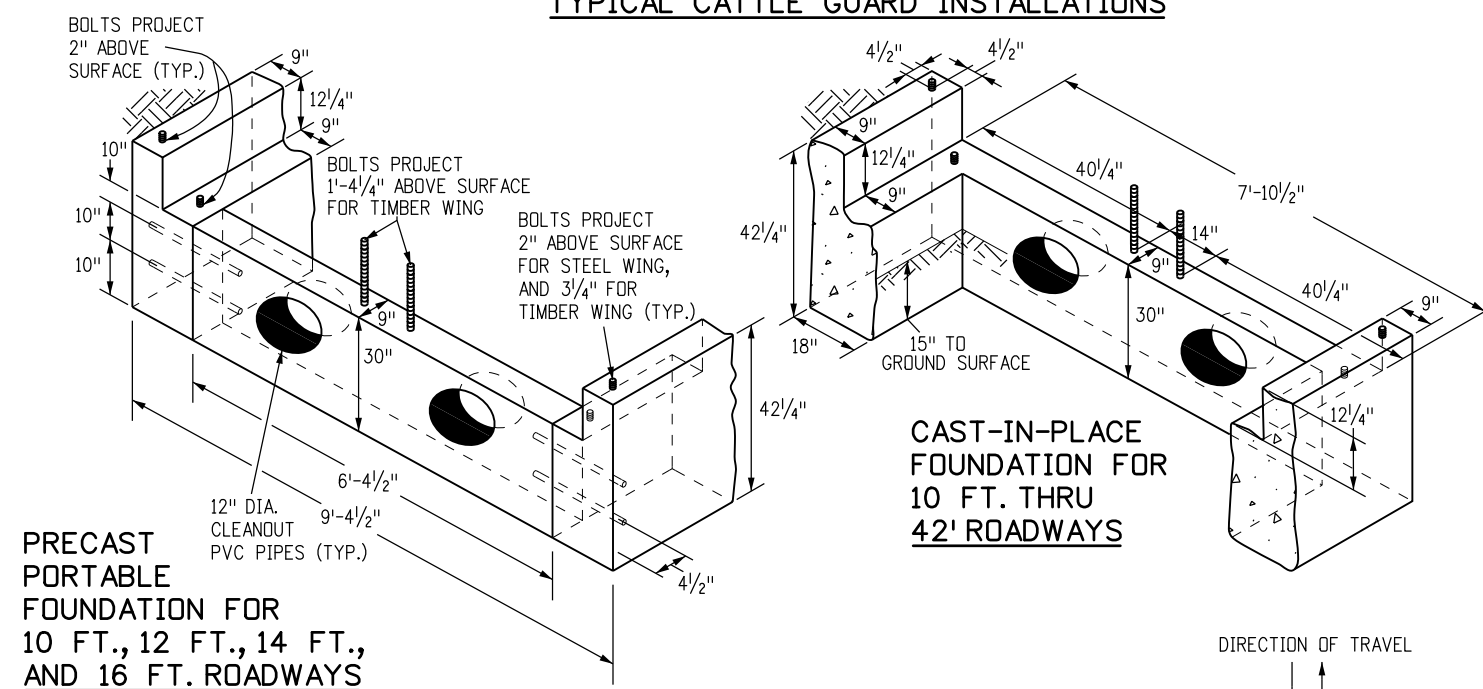

Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation		CATTLE GUARD	STANDARD PLAN NO.	
Creation Date: 07/31/19			Date:	Comments	 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868	M-611-1			
Designer Initials: JBK						Standard Sheet No. 1 of 2			
Last Modification Date: 07/31/19									
Detailer Initials: LTA									
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English					Project Development Branch	JBK	Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:

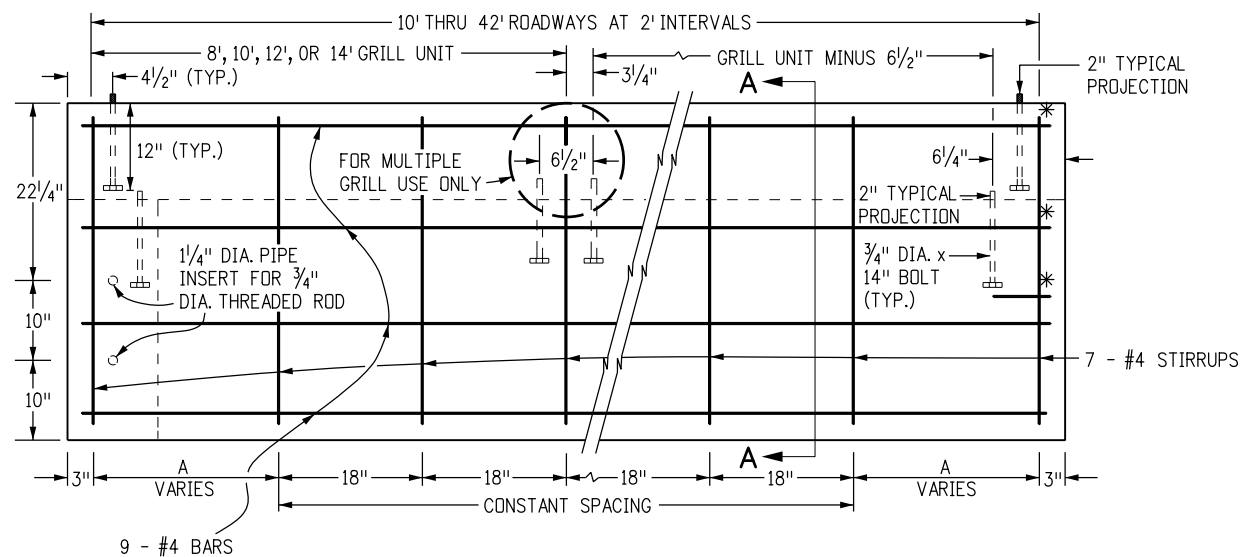

PRECAST PORTABLE FOUNDATION

CAST-IN-PLACE FOUNDATION

ELEVATION OF FOUNDATION

* WHEN CAST IN PLACE, LONGITUDINAL BARS EXTENDING FROM AND INTO THE LATERAL SUPPORT SHALL BE BENT 90° WITH A 2 IN. RADIUS AND CONTINUE PERPENDICULAR 10 IN. FROM THE BEND

a	- 6" x 8" x 7'-4"
b	- 4" x 8" x 9'-4½"
c	- 2" x 6" x 6'-7"
d	- 2" x 6" x 5'-8"
e	- 2" x 6" x 6'-7"
f	- 2" x 6" x 2'-5"
g	- 2" x 6" x 4'-4"
h	- 2" x 6" x 6'-2"
16d NAILS (GALV.) - 2 LB.	

ONE TIMBER WING

a	- 2" x 2" x ¼" x 79"	63.26 LBS.
b	- 2" x 2" x ¼" x 79"	
c	- 2" x 2" x ¼" x 84"	
d	- 1½" x 1½" x ¼" x 69"	36.86 LBS.
e	- 1½" x 1½" x ¼" x 55"	
f	- 1½" x 1½" x ¼" x 40"	
g	- 1½" x 1½" x ¼" x 25"	
h	- 5" x 6" x ¼" x BAR - 2.13 LBS.	TOTAL LBS. STEEL = ~106.5
i	- TWO 3" x 10" x ¼" x BARS - 4.25 LBS.	
6" x 8" x 7'-8" TIMBER POST		


ONE STEEL WING
WING QUANTITIES

ROADWAY WIDTH (FT.)	USE GRILL UNITS (FT.)	PRECAST		CAST-IN-PLACE		A (IN.)	TOTAL GRILL WEIGHT (LBS.)
		CONCRETE (CU. YD.)	REINF. STEEL (LBS.)	CONCRETE (CU. YD.)	REINF. STEEL (LBS.)		
10	10	5.6	295	5.6	316	24	1946
12	12	6.5	342	6.5	364	18	2328
14	14	7.4	378	7.4	399	21	2170
16	8 8	8.1	414	8.1	435	24	3128
18	8 10			9.0	482	18	3434
20	10 10			9.8	518	21	3806
22	10 12			10.6	553	24	4274
24	12 12			11.5	601	18	4656
26	12 14			12.3	636	21	5038
28	14 14			13.1	672	24	5420
30	10 10 10			13.9	719	18	5838
32	10 12 10			14.8	755	21	6220
34	12 10 12			15.5	790	24	6602
36	12 12 12			16.4	838	18	6984
38	12 14 12			17.3	873	21	7366
40	14 12 14			18.0	909	24	7748
42	14 14 14			18.9	956	18	8130


FOUNDATION QUANTITIES

SIZE	WEIGHT (LBS.)
8'	1564
10'	1946
12'	2328
14'	2710


WELDED GRILL UNITS

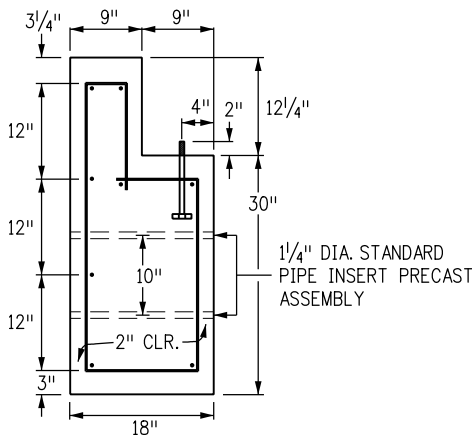

END SECTION OF FOUNDATION
SECTION A-A




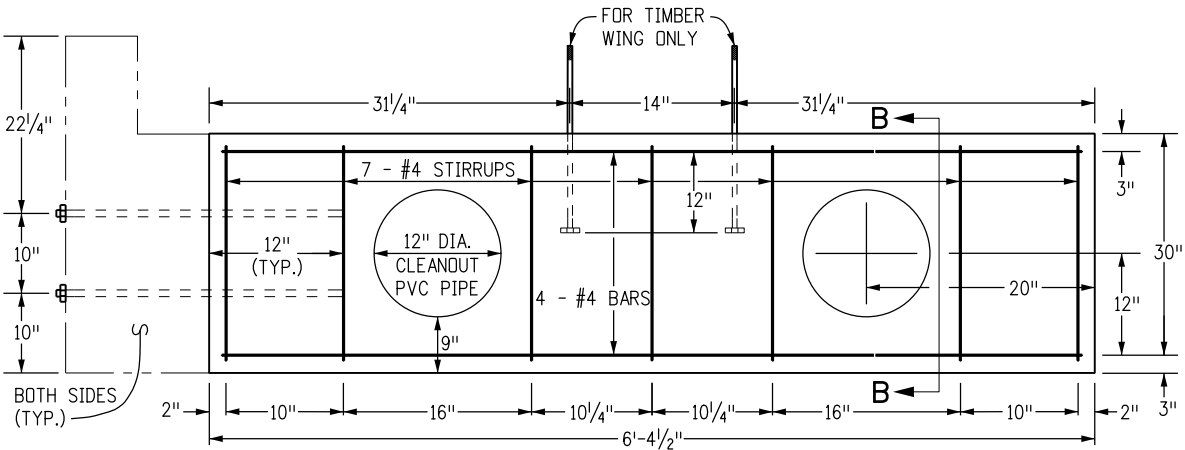


ELEVATION OF LATERAL SUPPORT

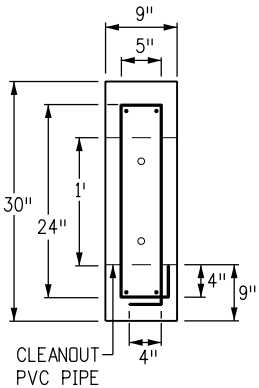


LATERAL SUPPORT
SECTION B-B


Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	CATTLE GUARD Issued by the Project Development Branch: July 31, 2019	STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-611-1
Designer Initials: JBK	(R-X)					Standard Sheet No. 2 of 2
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:
Detailer Initials: LTA	(R-X)					
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)					

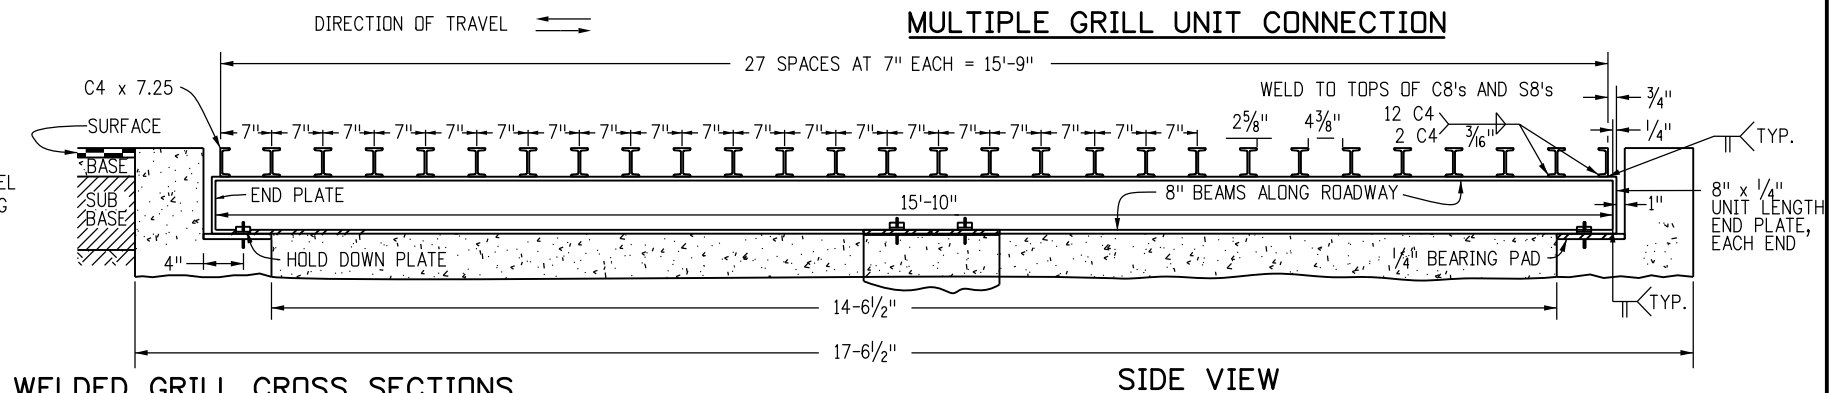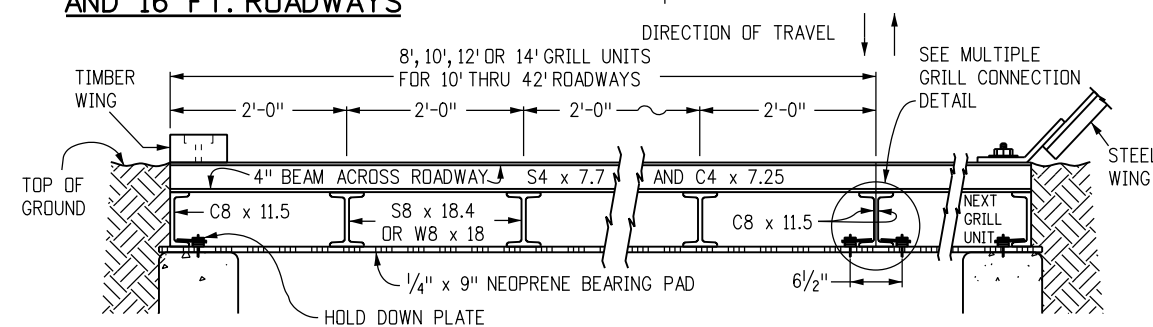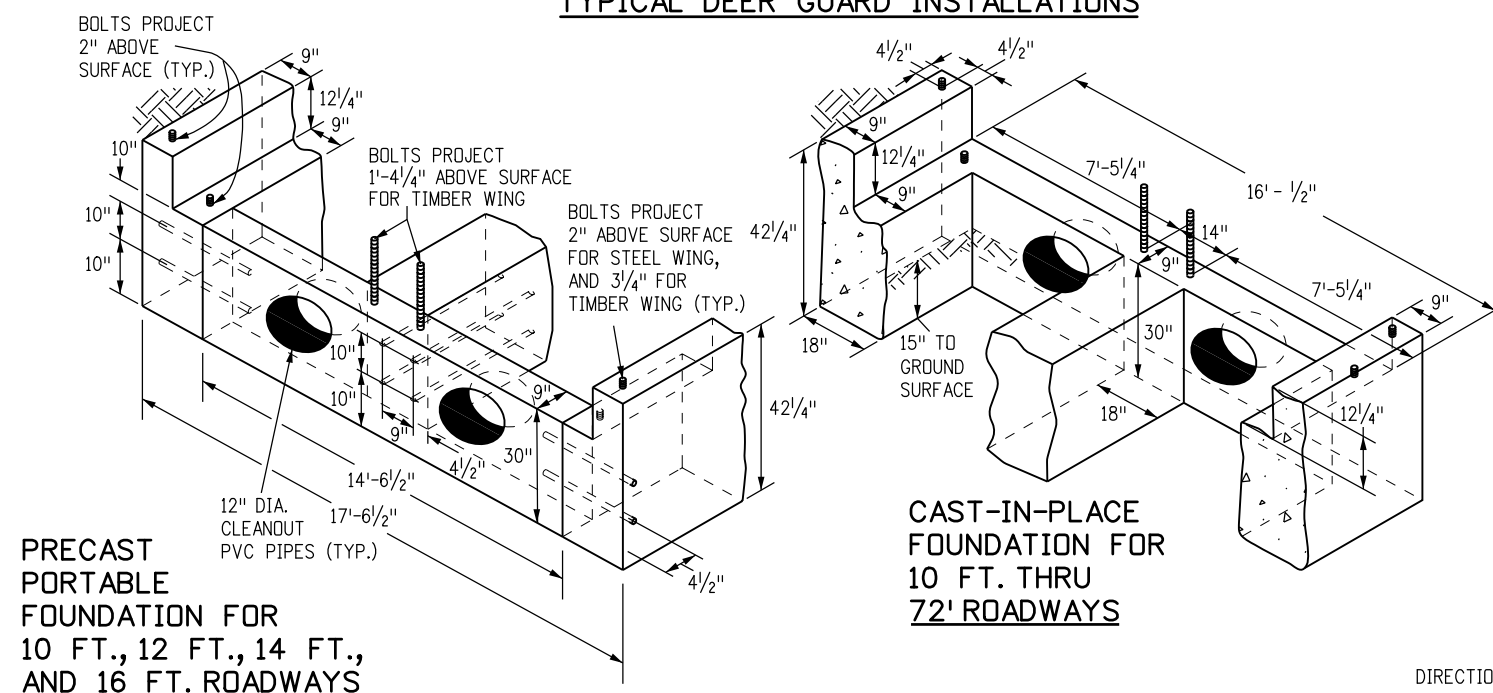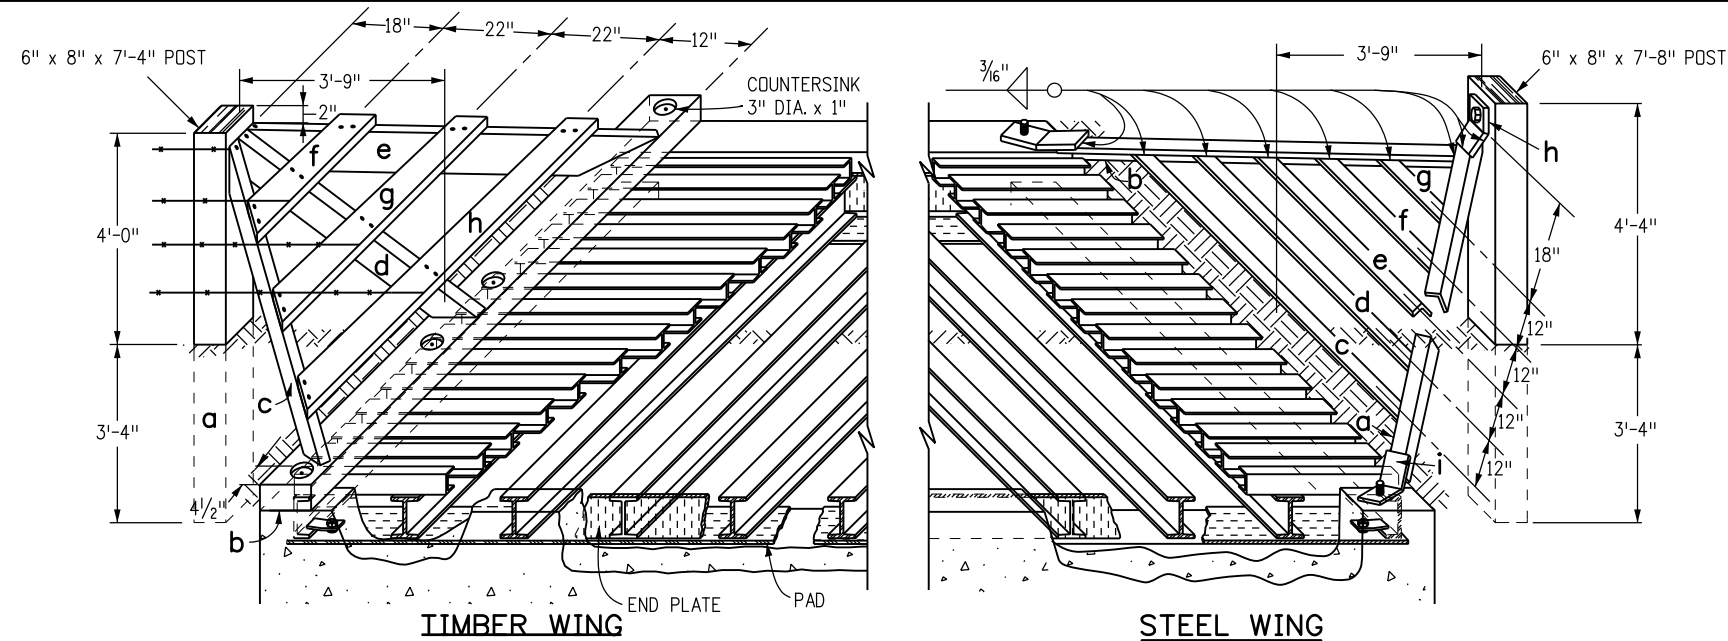

- ## GENERAL NOTES
1. CONCRETE SHALL BE CLASS B. FOUNDATION MAY BE CAST-IN-PLACE OR PRECAST.
 2. REINFORCING BARS SHALL BE #4, GRADE 60.
 3. ALL TIMBER SHALL BE TREATED IN CONFORMANCE WITH ASSHTO M 133 AND AWPAC 14.
 4. WING POSTS MAY BE MADE FROM 6 IN. DIAMETER AND TREATED IN ACCORDANCE WITH 710.07
 5. ALL STRUCTURAL STEEL SHALL BE FABRICATED AND PAINTED WITH ALUMINUM PAINT IN ACCORDANCE WITH SECTION 509. ALL HARDWARE SHALL BE GALVANIZED IN CONFORMANCE WITH AASHTO M 111 OR PAINTED WITH ZINC-RICH PAINT MEETING MILITARY SPECIFICATION DOD-P-21035
 6. ALL STRUCTURAL STEEL SHALL CONFORM TO AASHTO M 270 (ASTM A 709) GRADE 36.
 7. WELDING SHALL CONFORM TO THE AWS STRUCTURAL WELDING CODE AND AASHTO STANDARD SPECIFICATIONS FOR WELDING OF STRUCTURAL STEEL HIGHWAY BRIDGES.
 8. OUTLET PIPES WILL BE REQUIRED AND PAID FOR AS SHOWN IN THE PLANS. A 6 INCH SLEEVE MAY BE USED THROUGH THE CENTRAL SUPPORT TO DRAIN FROM ONE CELL TO THE OTHER TO MINIMIZE THE NUMBER OF OUTLET PIPES.
 9. TYPE OF WING (TIMBER OR STEEL) SHALL BE STEEL UNLESS OTHERWISE SHOWN ON THE PLANS.
 10. STRUCTURE EXCAVATION, STRUCTURE BACKFILL, AND SURVEY WORK WILL NOT BE MEASURED AND PAID FOR SEPARATELY, BUT SHALL BE INCLUDED IN THE WORK.
 11. A 4 IN. CONCRETE FLOOR SHALL BE PLACED IN THE DEER GUARD AND SHALL BE GRADED TO DRAIN. THIS QUANTITY WILL NOT BE PAID FOR SEPARATELY, BUT SHALL BE INCLUDED IN THE WORK.
 12. EXPANSION JOINT MATERIAL SHALL BE USED BETWEEN THE 4 INCH CONCRETE FLOOR AND THE FOUNDATION. THIS QUANTITY WILL NOT BE PAID FOR SEPARATELY, BUT SHALL BE INCLUDED IN THE WORK.
 13. TOOLED OR SAWCUT JOINTS WILL BE REQUIRED IN THE 4 INCH CONCRETE FLOOR AS DIRECTED. DETAIL. THIS WORK WILL NOT BE PAID FOR SEPARATELY, BUT SHALL BE INCLUDED IN THIS WORK
 14. HIGHWAY LOADING DESIGN DATA:
HL-93 (DESIGN TRUCK OR TANDEM, AND DESIGN LANE LOAD)
 15. A TREATED 2X6 MAY BE USED AT THE OPEN END OF THE DEER GUARD TO KEEP FILL MATERIAL FROM FALLING IN.
 16. ALTERNATIVE DEER GUARDS MAY BE CONSTRUCTED UPON APPROVAL BY THE PROJECT ENGINEER.

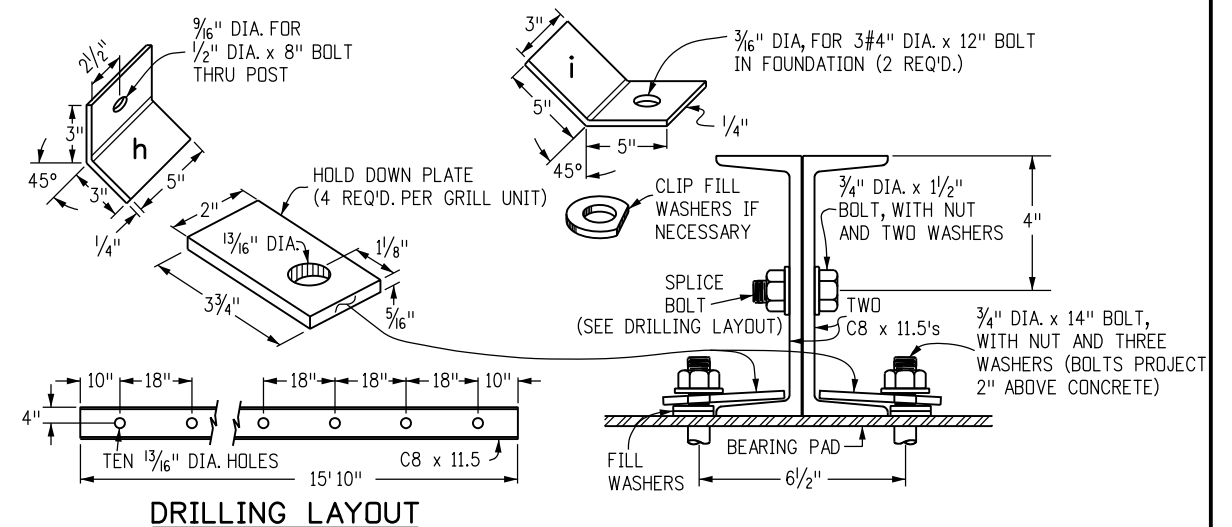

Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		CDOT Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	STANDARD PLAN NO.	
Creation Date: 07/31/19			Date:	Comments		M-611-2	
Designer Initials: JBK							
Last Modification Date: 07/31/19							
Detailer Initials: LTA							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English							
				Issued by the Project Development Branch: July 31, 2019		Standard Sheet No. 1 of 2	
						Project Sheet Number:	

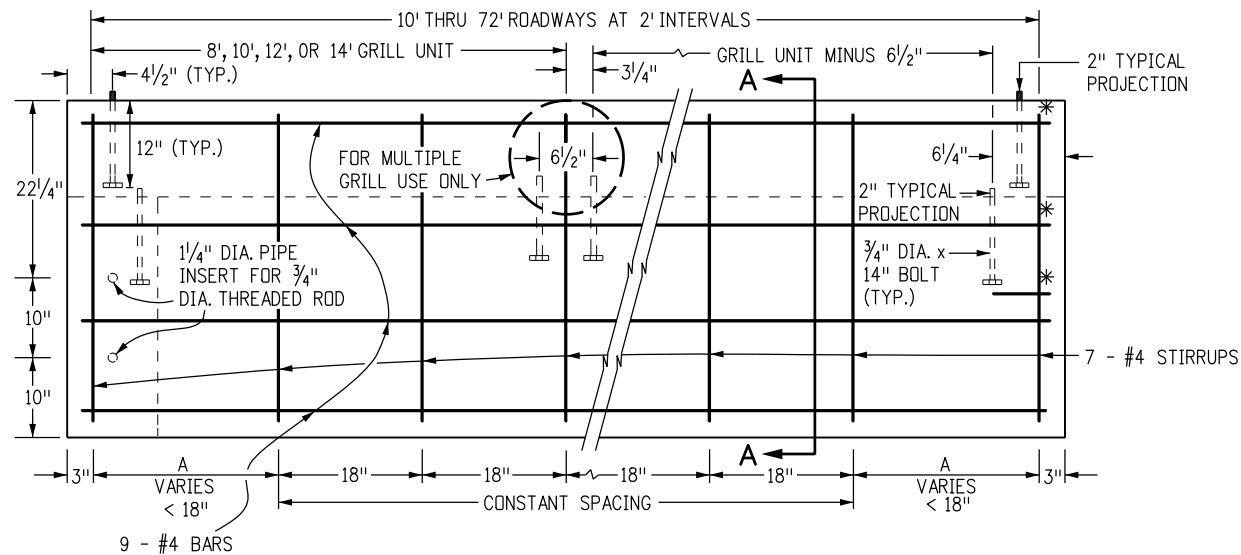


PRECAST PORTABLE FOUNDATION


CAST-IN-PLACE FOUNDATION

ELEVATION OF FOUNDATION


* WHEN CAST IN PLACE, LONGITUDINAL BARS EXTENDING FROM AND INTO THE LATERAL SUPPORT SHALL BE BENT 90° WITH A 2 IN. RADIUS AND CONTINUE PERPENDICULAR 10 IN. FROM THE BEND

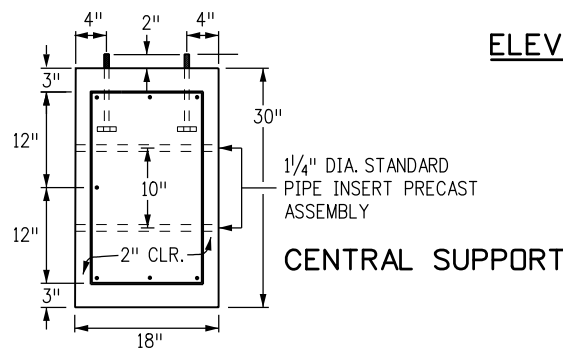


CENTRAL SUPPORT

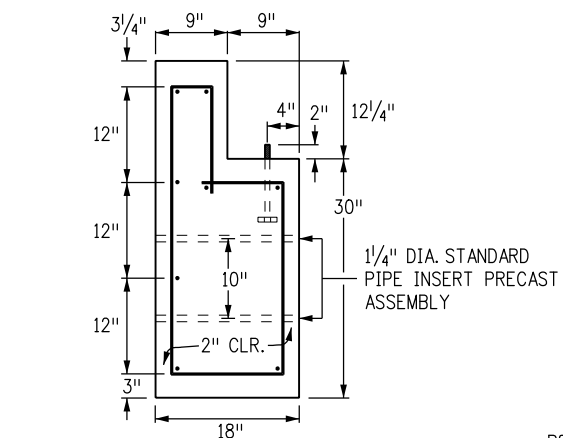

SECTION A-A
END SECTION OF FOUNDATION

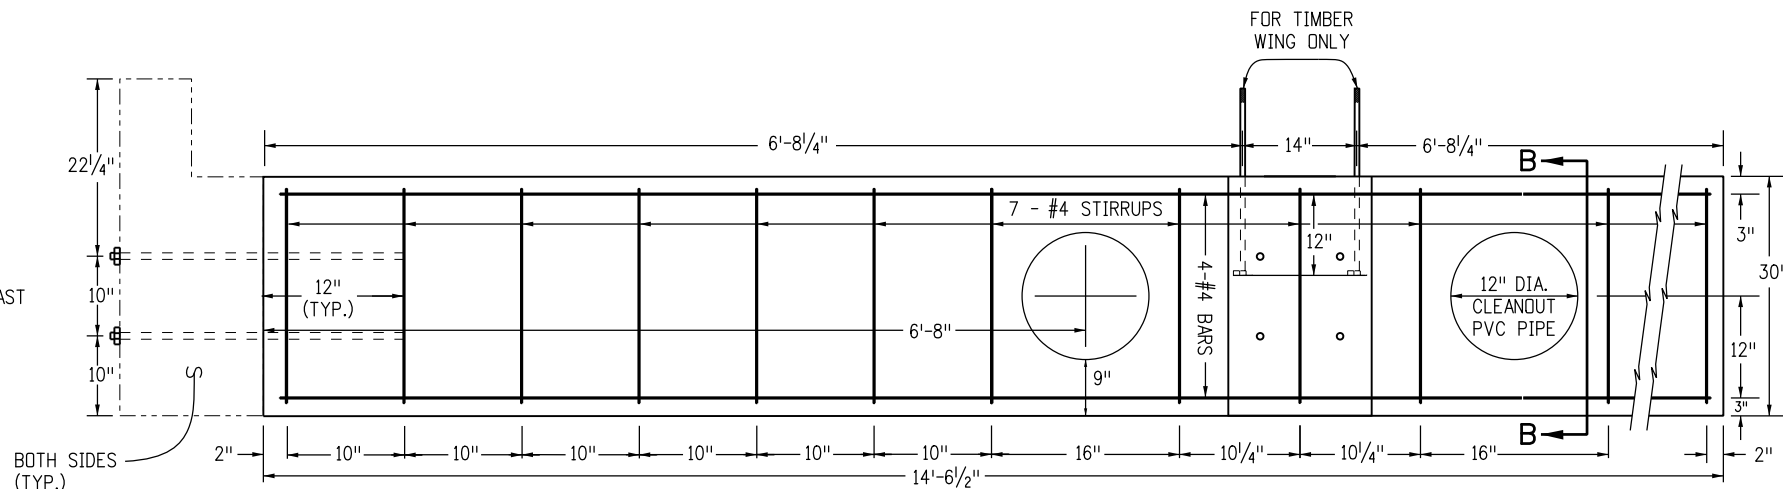

ELEVATION OF LATERAL SUPPORT

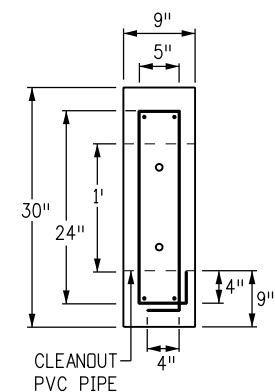

SECTION B-B
LATERAL SUPPORT

a - 6" x 8" x 7'-4"
b - 4" x 8" x 9'-4 1/2"
c - 2" x 6" x 6'-7"
d - 2" x 6" x 5'-8"
e - 2" x 6" x 6'-7"
f - 2" x 6" x 2'-5"
g - 2" x 6" x 4'-4"
h - 2" x 6" x 6'-2"
16d NAILS (GALV.) - 2 LB.

ONE TIMBER WING

a - 2" x 2" x 1/4" x 123.70"	32.88 LBS.
b - 2" x 2" x 1/4" x 123.70"	32.88 LBS.
c - 2" x 2" x 1/4" x 177.93"	47.30 LBS.
d - 1 1/2" x 1 1/2" x 1/4" x 141.99"	43.19 LBS.
e - 1 1/2" x 1 1/2" x 1/4" x 106.04"	32.25 LBS.
f - 1 1/2" x 1 1/2" x 1/4" x 70.09"	21.32 LBS.
g - 1 1/2" x 1 1/2" x 1/4" x 34.15"	10.39 LBS.
h - 5" x 6" x 1/4" x BAR - 2.13 LBS.	
i - TWO 3" x 10" x 1/4" x BARS - 4.25 LBS.	
6" x 8" x 7'-8" TIMBER POST	
TOTAL LBS. STEEL =	~ 226.6

ONE STEEL WING

ROADWAY WIDTH (FT.)	USE GRILL UNITS (FT.)	PRECAST		CAST-IN-PLACE		A (IN.)	TOTAL GRILL WEIGHT (LBS.)
		CONCRETE (CU. YD.)	REINF. STEEL (LBS.)	CONCRETE (CU. YD.)	REINF. STEEL (LBS.)		
16	8 8	9.4	670	9.4	670	15	5905
20	10 10	11.2	821	11.2	821	15	7345
24	12 12	13.1	934	13.1	934	15	8785
28	14 14	15.0	1059	15.0	1059	15	10224
30	10 10 10	14.1	1136	14.1	1136	12	10809
32	10 12 10	16.9	1184	16.9	1184	15	11737
38	12 14 12	17.3	1353	17.3	1353	12	13628
40	14 12 14	20.7	1419	20.7	1419	15	14617

FOUNDATION QUANTITIES

SIZE	WEIGHT (LBS.)
8'	2952
10'	3672
12'	4392
14'	5112

WELDED GRILL UNITS
FULL LENGTH

SIZE	WEIGHT (LBS.)
8'	1476
10'	1836
12'	2196
14'	2556

WELDED GRILL UNITS
HALF LENGTH

HALF GRILLS SHALL BE BOLTED ON 18 INCH CENTERS MAX. (SEE MULTIPLE GRILL UNIT CONNECTION DETAIL ON SHEET ONE)

WING QUANTITIES

Computer File Information

Creation Date: 07/31/19
Designer Initials: JBK
Last Modification Date: 07/31/19
Detailer Initials: LTA
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

(R-X)
(R-X)
(R-X)
(R-X)

Sheet Revisions

Date:	Comments

Colorado Department of Transportation

2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch

JBK

DEER GUARD

Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.

M-611-2

Standard Sheet No. 2 of 2

Project Sheet Number:

GENERAL NOTES

1.

RUMBLE STRIPS SHALL BE OMITTED AT TURN AND AUXILIARY LANES, ROAD APPROACHES, RESIDENCES, 250 FT. BEFORE ROAD INTERSECTIONS, AND OTHER INTERRUPTIONS AS DIRECTED BY THE ENGINEER.
2.


RUMBLE STRIPS MAY BE INSTALLED BY GRINDING, ROLLING, OR FORMING ON CONCRETE PAVEMENT, AND BY GRINDING ONLY ON HMA PAVEMENT. RUMBLE STRIP WIDTH SHALL BE 12 IN. FOR GRIND-IN AND 18 IN. FOR FORMED OR ROLLED.
3.

MINIMIZE THE DISTANCE BETWEEN RUMBLE STRIP AND EDGE LINE ON CONCRETE PAVEMENTS WITH 14 FT. WIDE SLABS.
4.


BEGIN RUMBLE STRIPS ON THE OUTSIDE EDGE OF THE TRAVEL LANE EDGE LINE.
5.

DO NOT INSTALL RUMBLE STRIPS ON SHOULDERS LESS THAN 6 FT. WIDE WHEN GUARDRAIL IS PLACED ALONG THE EDGE OF THE SHOULDER.
6.


APPLY THE 60 FT. GAP PATTERN WHEN RUMBLE STRIPS (GRIND-IN) ARE INSTALLED IN CONCRETE PAVEMENT.

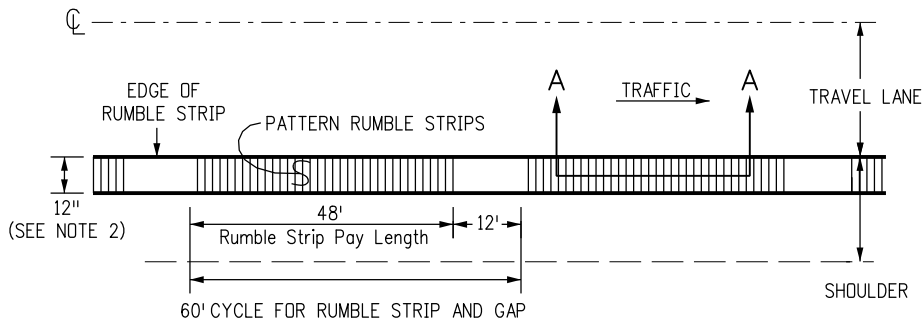


INTERMITTENT RUMBLE STRIP
TWO-LANE ROADWAY (HMA)

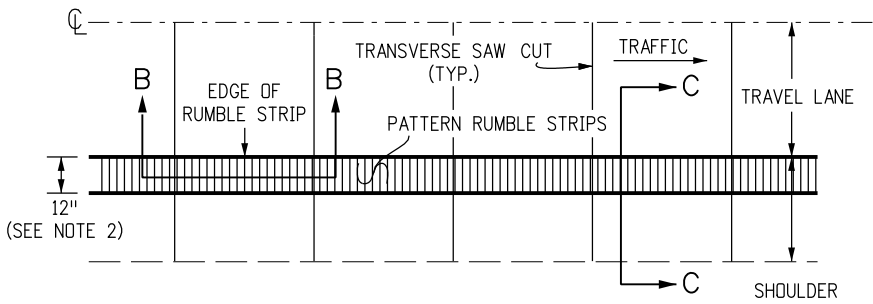


CONTINUOUS RUMBLE STRIP
TWO-LANE ROADWAY (CONCRETE)

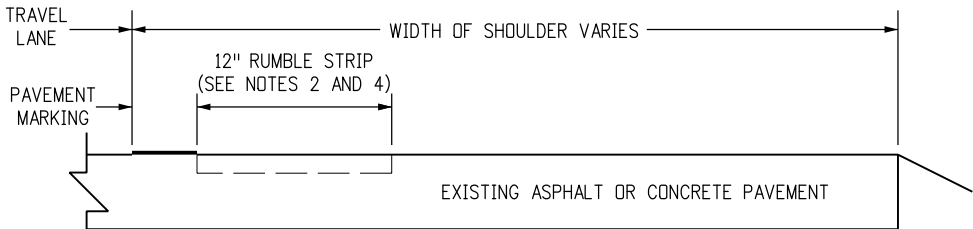


TYPICAL SECTION C-C

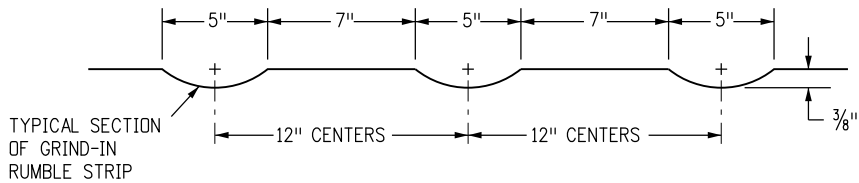


TYPICAL SECTIONS A-A AND B-B
FOR GRIND-IN RUMBLE STRIP
ON EXISTING HMA OR CONCRETE PAVEMENT

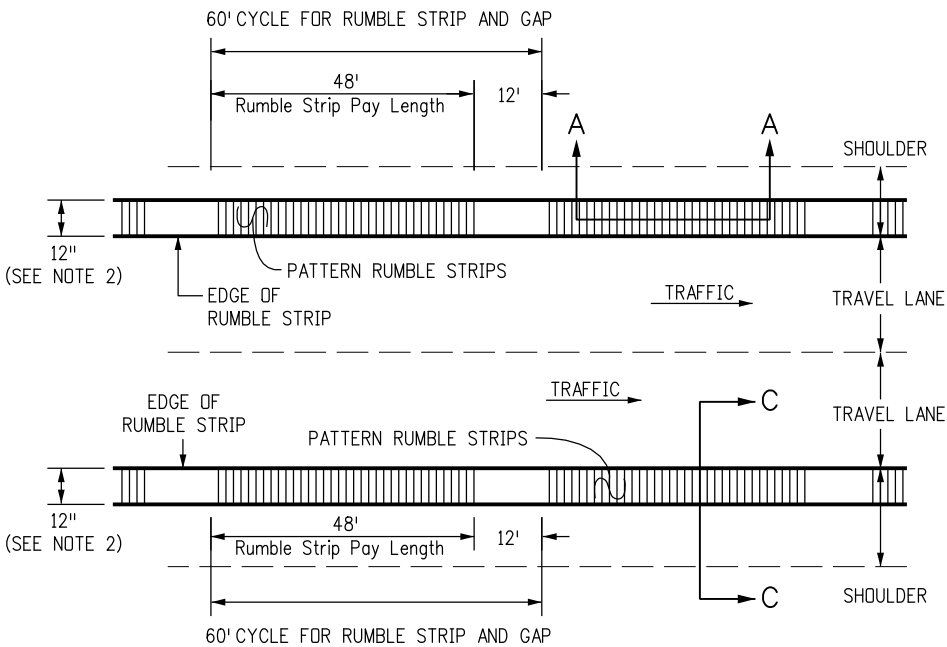

INTERMITTENT RUMBLE STRIP
FOUR-LANE DIVIDED ROADWAY (HMA)

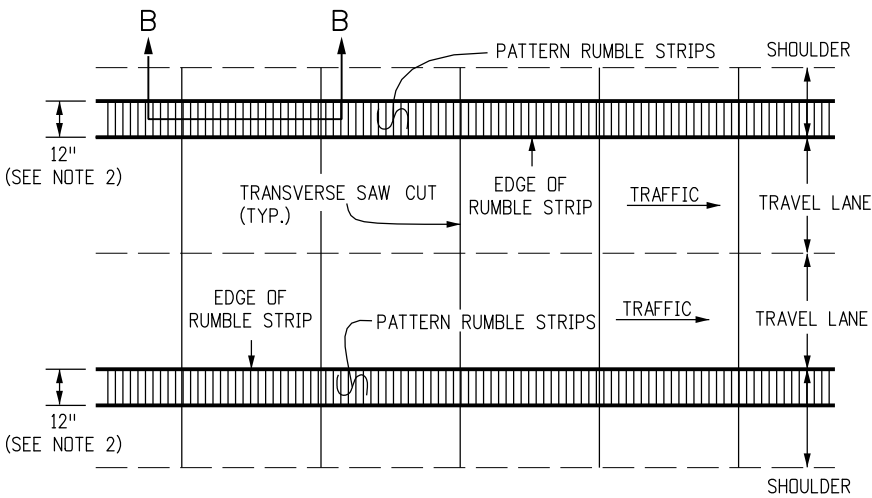


CONTINUOUS RUMBLE STRIP
FOUR-LANE DIVIDED ROADWAY (CONCRETE)

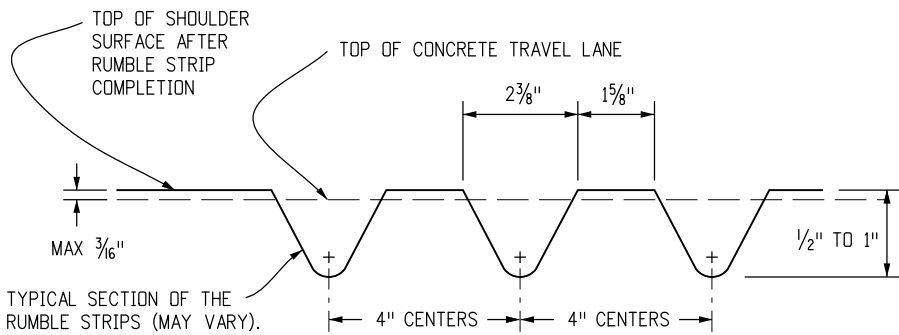


TYPICAL SECTION B-B
FOR FORMED OR ROLLED ON CONCRETE PAVEMENTS ONLY

Computer File Information		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	Sheet Revisions		RUMBLE STRIPS	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)		Date:	Comments		M-614-1	
Designer Initials: JBK						Standard Sheet No. 1 of 3	
Last Modification Date: 07/31/19						Project Sheet Number:	
Detailer Initials: LTA							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English						Issued by the Project Development Branch: July 31, 2019	

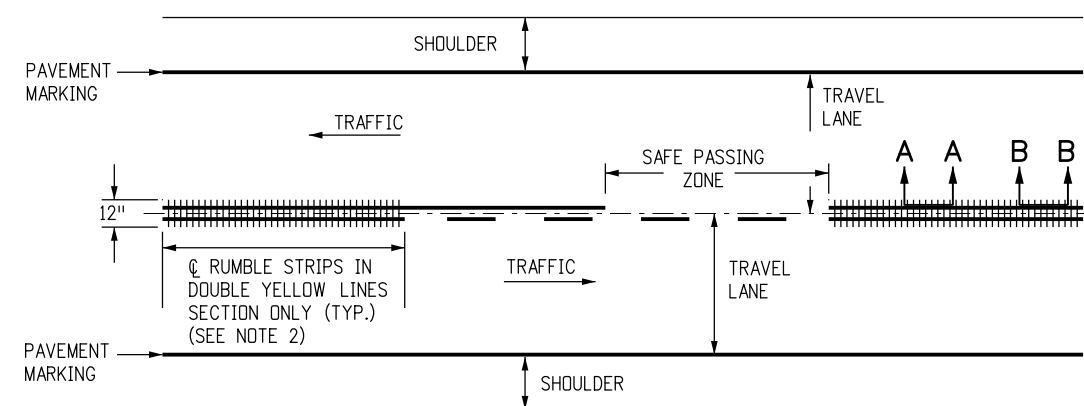


**TWO LANE HIGHWAY (HMA AND CONCRETE)
CONTINUOUS CENTER LINE RUMBLE STRIPS**

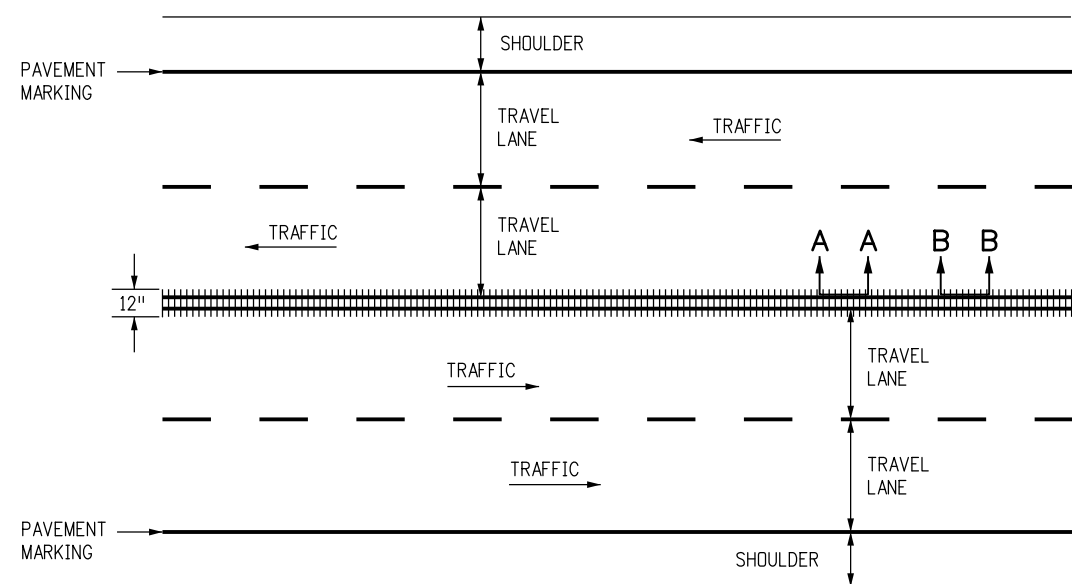

**FOUR LANE UNDIVIDED HIGHWAY (HMA AND CONCRETE)
CONTINUOUS CENTER LINE RUMBLE STRIPS**


NOTES

1. RUMBLE STRIP WIDTH SHALL BE 12 IN. FOR GRIND-IN, FORMED, OR ROLLED.
2. CENTERLINE RUMBLE STRIPS MAY BE CONTINUOUS THROUGH PASSING ZONES AS DETERMINED BY THE ENGINEER AND SHOWN ON THE PLANS.

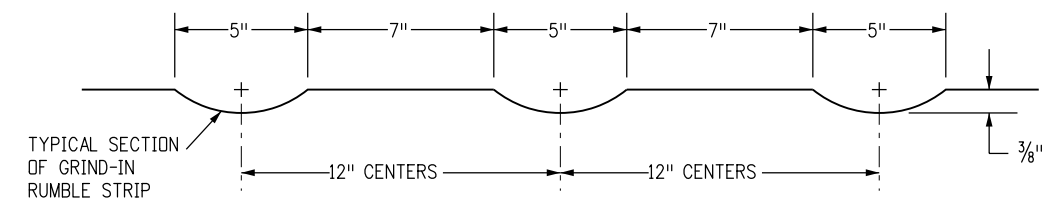

TYPICAL SECTIONS A-A AND B-B

FOR GRIND-IN RUMBLE STRIP
ON EXISTING ASPHALT OR CONCRETE PAVEMENT

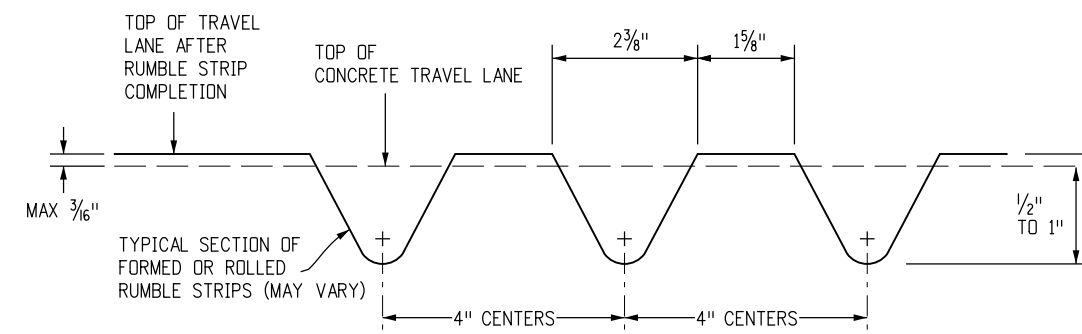

TYPICAL SECTION B-B


FOR FORMED OR ROLLED ON CONCRETE PAVEMENTS ONLY

DETAILS FOR CENTER LINE RUMBLE STRIPS


Computer File Information		Sheet Revisions		 Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)	Date:	Comments		M-614-1	
Designer Initials: JBK					Standard Sheet No. 2 of 3	
Last Modification Date: 07/31/19					Project Sheet Number:	
Detailer Initials: LTA						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English				Issued by the Project Development Branch: July 31, 2019		

NOTES


1. GROOVED RUMBLE STRIP SKEW OR CLUSTER SPACING SHALL BE MODIFIED TO AVOID LOCATING A GROOVE ON A CONCRETE PAVEMENT TRANSVERSE JOINT.
2. PERMANENT TRAVEL LANE RUMBLE STRIPS SHALL BE THE GROOVE DESIGN, AND MAY BE CUT IN EXISTING, NEW HMA, OR CONCRETE PAVEMENT. THE GROOVES MAY BE CUT BY SAWING, GRINDING, OR OTHER METHOD AS APPROVED.
3. TEMPORARY RUMBLE STRIPS SHOULD NORMALLY BE THE RAISED DESIGN. THEY MAY BE GROOVES IF LOCATED IN A PAVEMENT THAT WILL BE REMOVED OR COVERED WITH A PAVEMENT COURSE BEFORE COMPLETION OF THE PROJECT. TYPICAL USES OF TEMPORARY RUMBLE STRIPS ARE FOR LANE CLOSURES OR ALIGNMENT CHANGES IN CONSTRUCTION ZONES.
4. THE HMA (RAISED RUMBLE STRIPS) SHALL BE PLACED ON A CLEAN, TACK COATED TREATED PAVEMENT IN $\frac{3}{8}$ IN. HIGH FORMS. THE FORMS SHALL BE REMOVED AND THE ASPHALT COMPACTED BY ROLLING ALONG THE STRIPS. EPOXY MORTAR SHALL BE FORMED, TROWELED, AND LEVELED WITH A ROLLER AND THE TOP EDGES ROUNDED, THERMOPLASTIC STRIPS SHALL BE APPLIED BY THE EXTRUSION PROCESS. PREFORMED PLASTIC SHALL BE INSTALLED IN CONFORMANCE WITH THE INSTRUCTIONS OF THE MANUFACTURER.

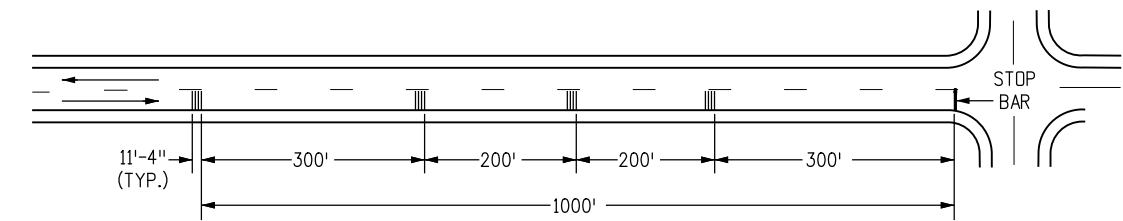

STOP SIGN APPROACH

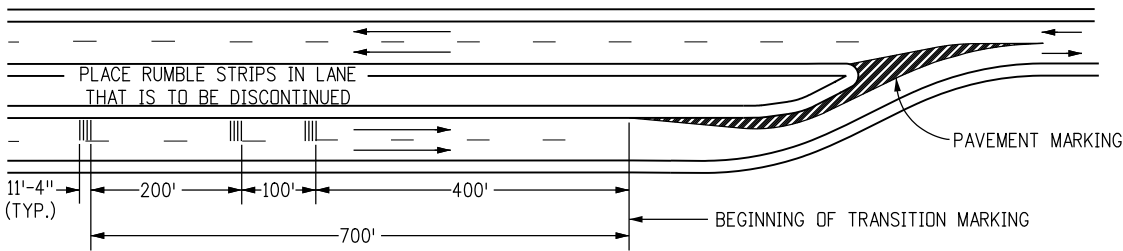


LANE REDUCTION TRANSITION

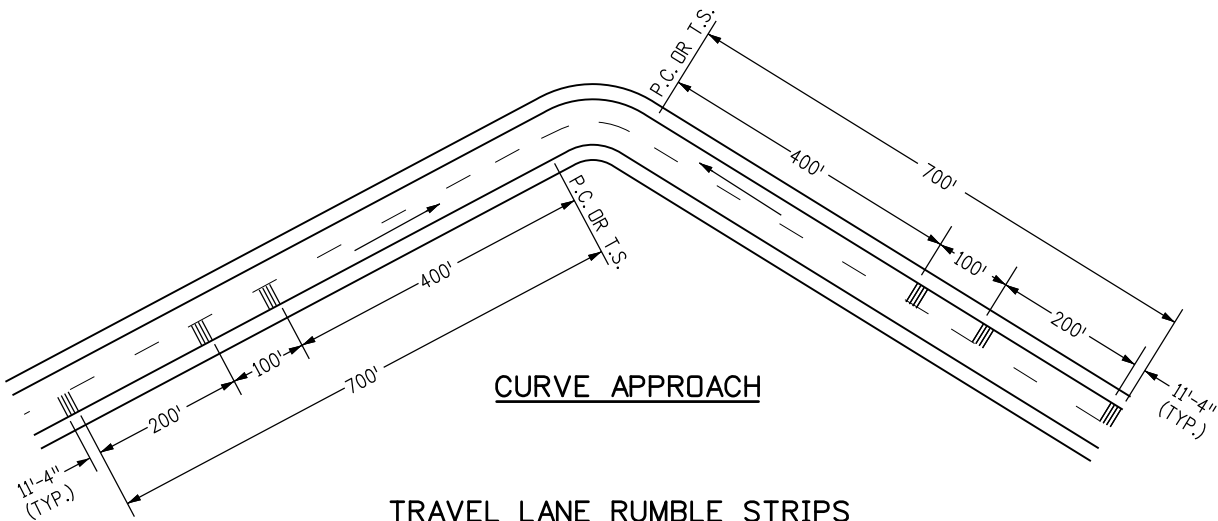


CURVE APPROACH


TRAVEL LANE RUMBLE STRIPS

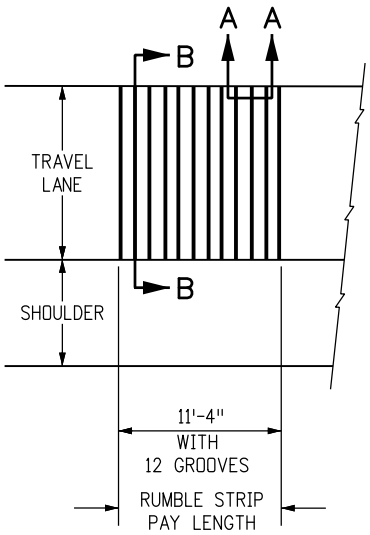

TYPICAL RUMBLE STRIP CLUSTER

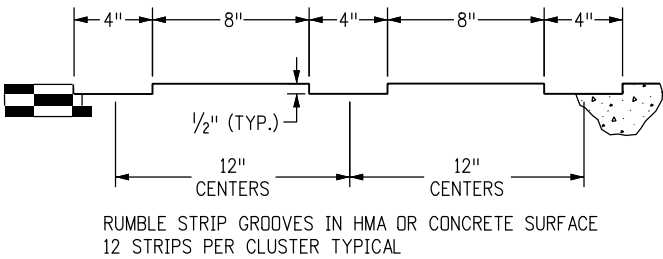


SECTION A-A
(GROOVED)

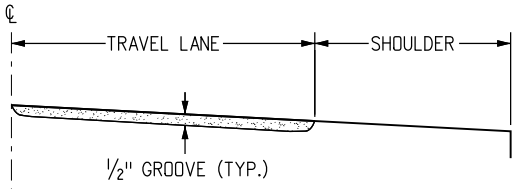


SECTION B-B
(GROOVED)

PERMANENT GROOVED RUMBLE STRIPS

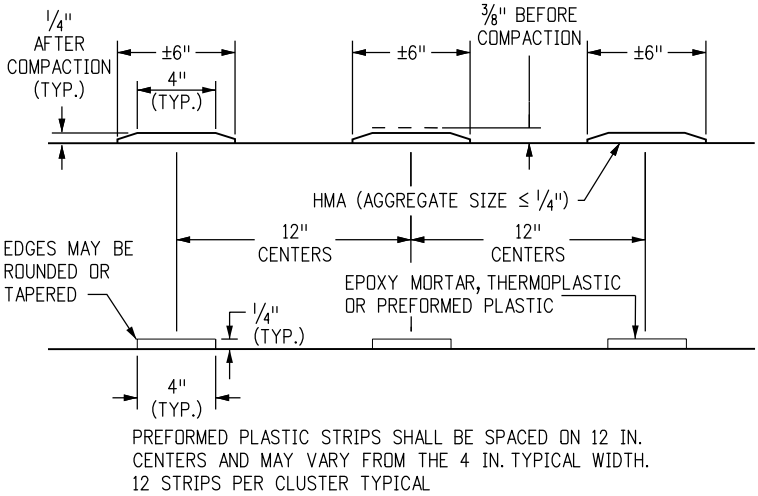


SECTION A-A
(RAISED)

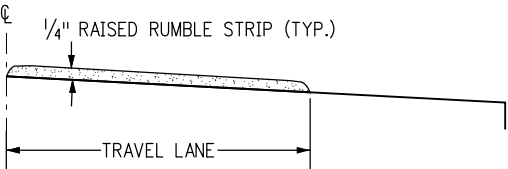


SECTION B-B
(RAISED)

TEMPORARY RAISED RUMBLE STRIPS


Computer File Information		Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	RUMBLE STRIPS	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-614-1	
Designer Initials: JBK						Standard Sheet No. 3 of 3	
Last Modification Date: 07/31/19						Project Sheet Number:	
Detailer Initials: LTA							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)				Issued by the Project Development Branch: July 31, 2019		

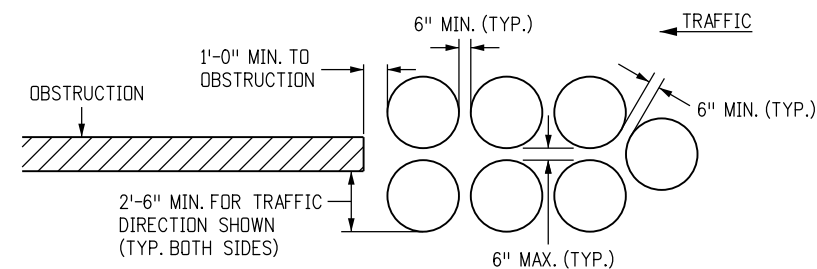

UNIDIRECTIONAL

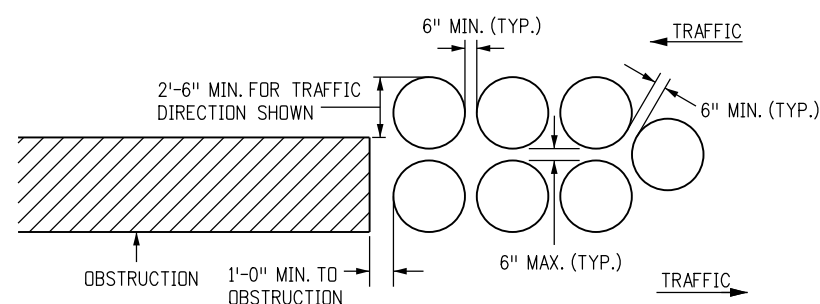


BIDIRECTIONAL

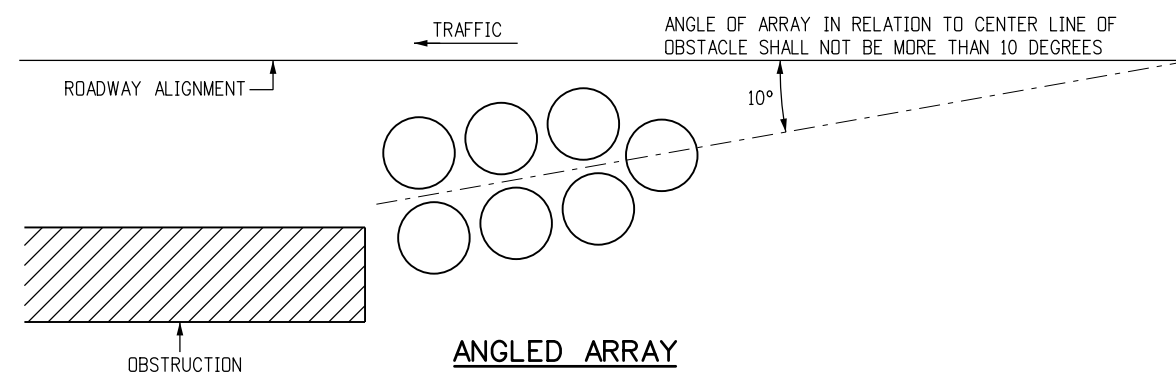

ANGLED ARRAY


GENERAL NOTES

1. SAND SHALL BE MIXED WITH 5% SALT BY WEIGHT.
2. WHEN ARRAYS ARE PLACED ON STRUCTURES WHERE THE VIBRATIONS FROM MOVING TRAFFIC MAY CAUSE THE MODULES TO SHIFT, STEEL OR FORMED-IN-PLACE HMA HALF-RINGS MAY BE PLACED ON THE DOWNHILL SIDE OF THE MODULES TO PREVENT MOVEMENT. NAILS OR BOLTS MAY BE PLACED THROUGH THE BOTTOM OF THE OUTER CONTAINER INTO THE ROADWAY TO PREVENT MODULE MOVEMENT.
3. OFFSET THE ARRAY TO AVOID IMPACT TO THE REAR MODULE FROM WRONG-WAY VEHICLES.
4. ARRAYS SHALL NOT BE PLACED ON SLOPES WITH LATERAL OR HORIZONTAL GRADES OF 5% OR GREATER.
5. CURBS AND RAISED ISLANDS SHALL BE NO MORE THAN 4 IN. HIGH.
6. FOUNDATION PADS SHALL BE FLAT AND MADE OF 6 IN. THICK CONCRETE OR HMA.
7. INTERMIXING OF DIFFERENT BRANDS OF MODULES ARE ACCEPTABLE, IF THE MODULES ARE FHWA APPROVED, AND THE ARRAY MEETS THE DESIGN CRITERIA.
8. ARRAY CONFIGURATION MAY VARY IN LAYOUT AND SAND WEIGHT (LBS) PROVIDED THEY CONFORM TO MANUFACTURER'S DETAILS.

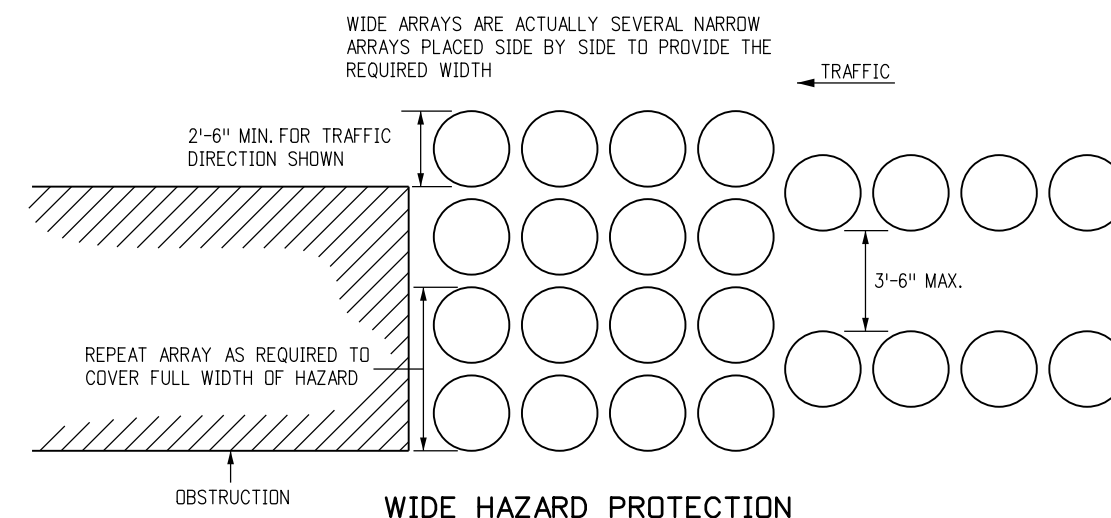


WIDE HAZARD PROTECTION


Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	SAND BARREL ARRAYS		STANDARD PLAN NO.	
Creation Date: 07/31/19	Date:		Comments	M-614-2					
Designer Initials: JBK				Standard Sheet No. 1 of 2					
Last Modification Date: 07/31/19				Project Sheet Number:					
Detailer Initials: LTA									
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English									
			Issued by the Project Development Branch: July 31, 2019						

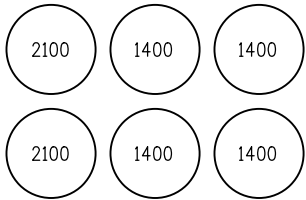


DESIGN SPEED 25 MPH

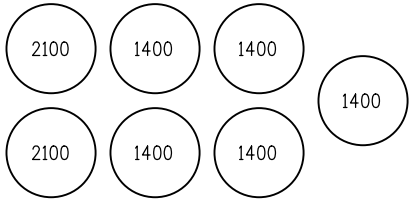


DESIGN SPEED 30 MPH

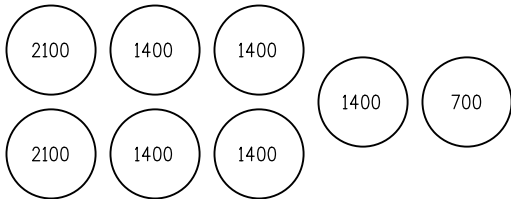


DESIGN SPEED 35 MPH

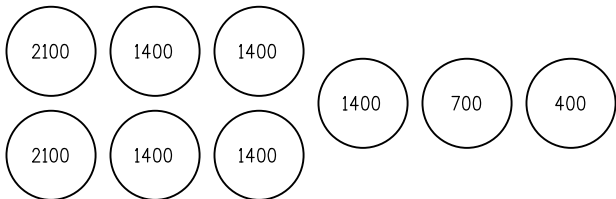

DESIGN SPEED 40 MPH

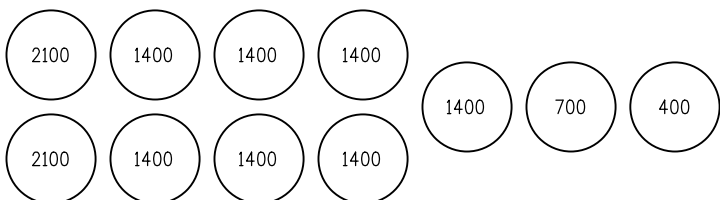


DESIGN SPEED 45 MPH

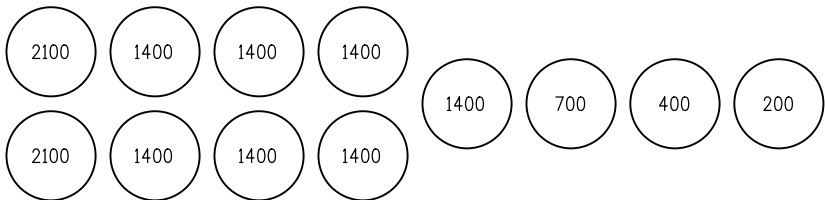


DESIGN SPEED 50 MPH

NOTES


- 1. SAND WEIGHT (LBS) IN MODULES IS DENOTED BY THE NUMBERS IN THE ARRAY DETAILS.
- 2. ARRAY CONFIGURATION MAY VARY IN LAYOUT AND SAND WEIGHT (LBS) PROVIDED THEY CONFORM TO MANUFACTURER'S DETAILS.

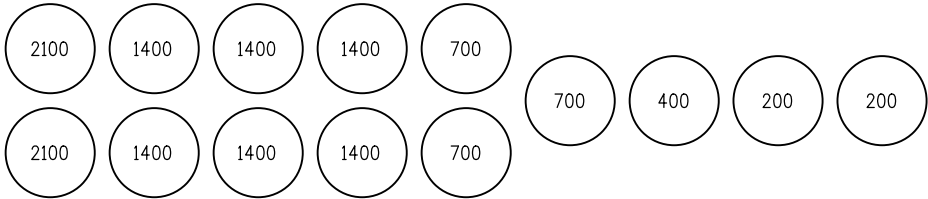


DESIGN SPEED 55 MPH

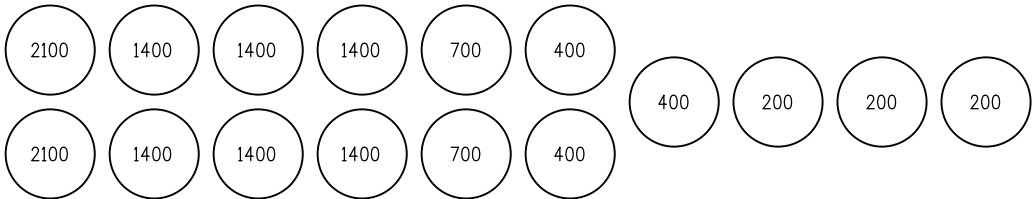


DESIGN SPEED 60 MPH

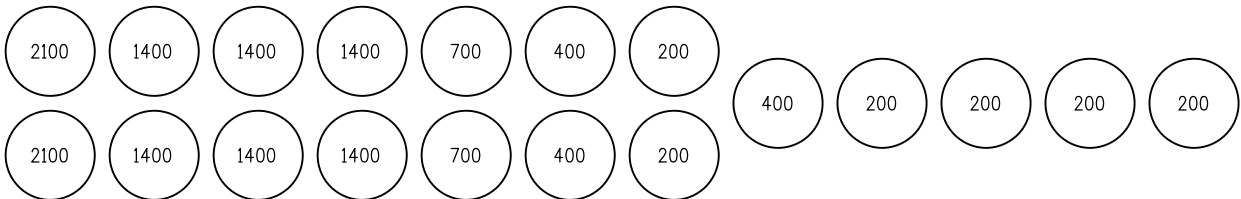


DESIGN SPEED 65 MPH

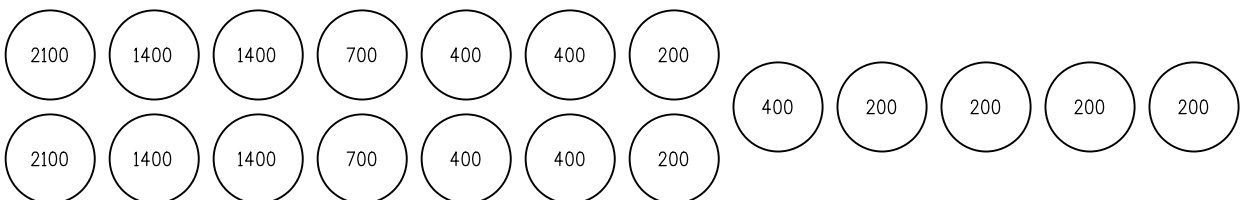


DESIGN SPEED 70 MPH

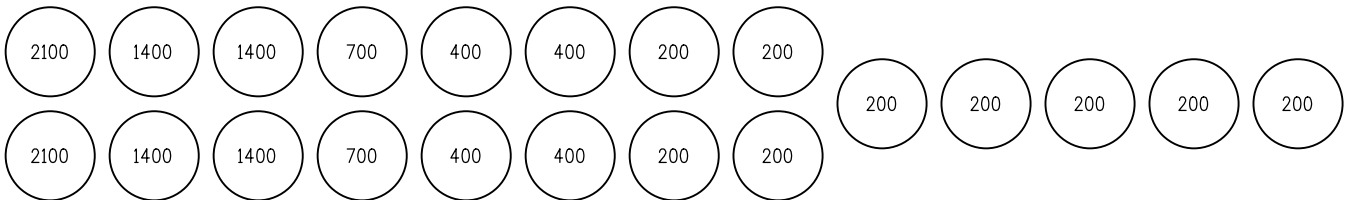

DESIGN SPEED 75 MPH

Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development BranchJBK	SAND BARREL ARRAYS	STANDARD PLAN NO.
Creation Date: 07/31/19	Date:		Comments	M-614-2			
Designer Initials: JBK				Standard Sheet No. 2 of 2			
Last Modification Date: 07/31/19				Issued by the Project Development Branch: July 31, 2019			
Detailer Initials: LTA							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English						Project Sheet Number:	

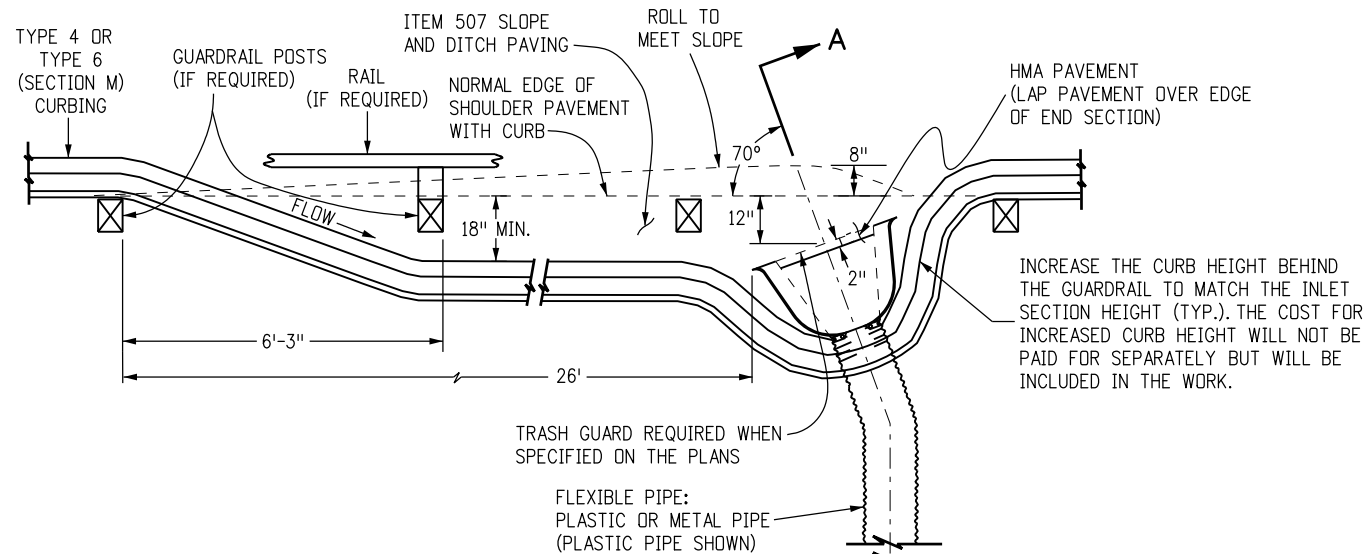

TYPE 3 PLAN VIEW


SHOWING DRAINAGE FLOW FROM LEFT TO RIGHT. REVERSE DETAIL WHEN DRAINAGE FLOW IS RIGHT TO LEFT.

TYPE OF APRON MATERIAL	THICKNESS
	IN.
SLOPE AND DITCH PAVING (507)	
DRY RUBBLE	6
CONCRETE	4
HMA	4
GROUTED RUBBLE	4
RIPRAP (506)	9 (MIN.)


- ### GENERAL NOTES
1. IF THE EMBANKMENT PROTECTOR IS LOCATED IN THE BOTTOM OF A VERTICAL CURVE, FLARE THE CURB ON EACH SIDE OF THE INLET TO ALLOW FOR FLOW FROM BOTH DIRECTIONS.
 2. DETAILS OF GUARD RAIL INSTALLATION ARE SHOWN IN STANDARD PLAN M-606-1.
 3. THE END SECTION-TO-PIPE STUB JOINT FOR CORRUGATED METAL PIPE SHALL BE IN ACCORDANCE WITH THE TYPE 3 TYPICAL CONNECTION DETAILED IN STANDARD PLAN M-603-10. THE TYPE 1 OR TYPE 2 TYPICAL CONNECTIONS ARE NOT ACCEPTABLE. (AS AN OPTION, THE END SECTION MAY BE CONNECTED DIRECTLY TO A SECTION OF PIPE). JOINTS BETWEEN THE STUB AND PIPE, OR SECTIONS OF PIPE, SHALL BE IN ACCORDANCE WITH SECTION 603. CONNECTIONS FOR PLASTIC PIPE SHALL PROVIDE A FIRM DIRECT CONNECTION SIMILAR TO THE TYPE 3. PLASTIC END SECTIONS ARE NOT ALLOWED. ALL PLASTIC PIPE JOINTS SHALL BE AS RECOMMENDED BY THE PIPE MANUFACTURER AND APPROVED BY THE ENGINEER.
 4. PLASTIC PIPE SHALL CONFORM TO AASHTO M 294 TYPE C.
 5. DETAILS OF BITUMINOUS CURBING ARE SHOWN IN STANDARD PLAN M-609-1.
 6. STRUCTURE BACKFILL MATERIAL SHALL NOT BE USED WITH THE EMBANKMENT PROTECTOR (TYPE 3). EMBANKMENT MATERIAL SHALL BE USED WITH CONSTRUCTION REQUIREMENTS IN ACCORDANCE WITH SECTION 203. PAYMENT FOR THIS EMBANKMENT MATERIAL SHALL BE INCLUDED IN THE PAY ITEM FOR EMBANKMENT PROTECTOR (TYPE 3).

PAYMENT FOR THE QUANTITIES SHOWN ON THE PLANS FOR THIS WORK SHALL BE AS FOLLOWS:


- 506 OR 507 - PAY ITEMS AS SPECIFIED ON THE PLANS.
 609 - CURB, TYPE 4 OR TYPE 6 (SECTION M)LINEAR FT.
 615 - EMBANKMENT PROTECTOR (TYPE 3)EACH
 NOTE: THIS PAYMENT INCLUDES THE END SECTION, THE TRASH GUARD (WHEN SPECIFIED ON THE PLANS), PIPE CONNECTION, STRUCTURE EXCAVATION, EMBANKMENT MATERIAL AND ANY EXTRA WORK REQUIRED TO MODIFY OTHER PAY ITEMS.
 603 - 12 IN. TO 18 IN. PIPELINEAR FT.

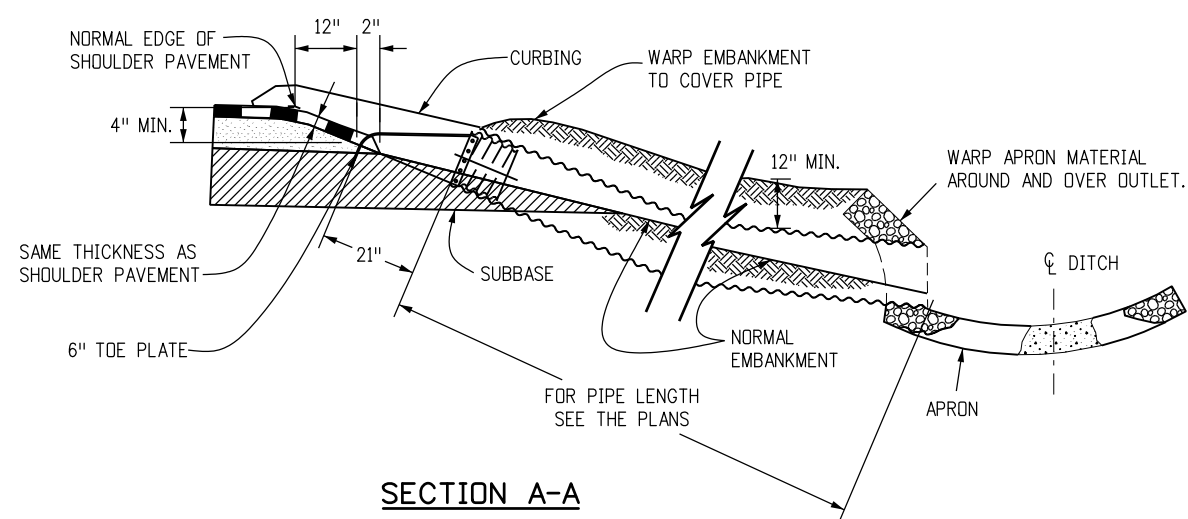

SECTION A-A FOR PLASTIC PIPE

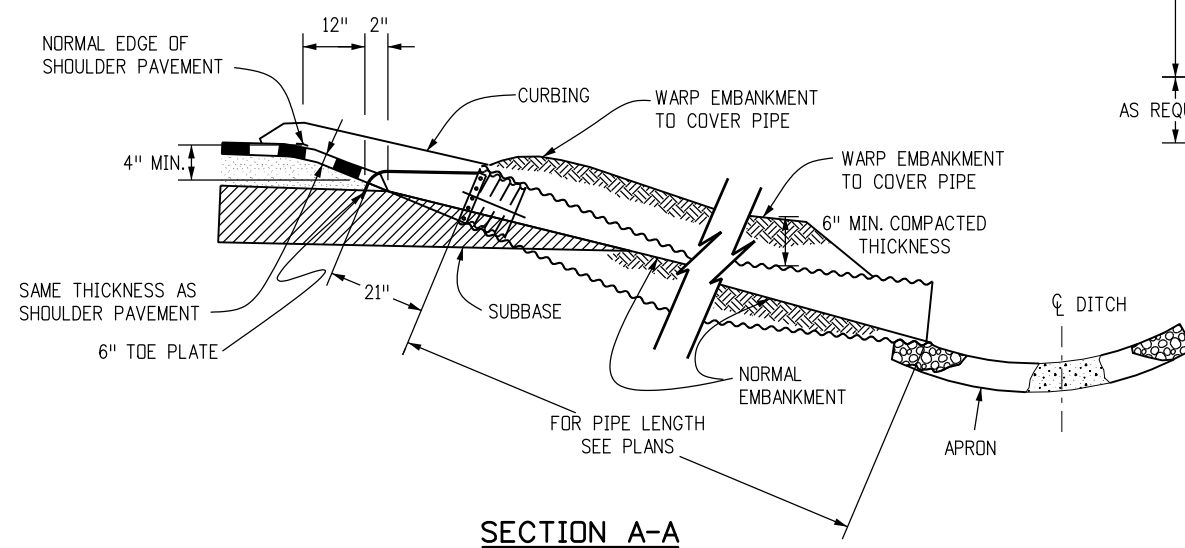


SECTION A-A FOR METAL PIPE

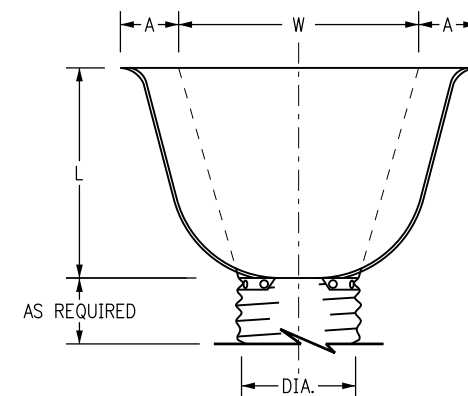

END SECTION OF STUB (SEE STANDARD M-603-10, SHEET 2 OF 2 FOR DIMENSIONS)



Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch	EMBANKMENT PROTECTOR TYPE 3	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X)	Date:	Comments			M-615-1	
Designer Initials: JBK	(R-X)					Standard Sheet No. 1 of 1	
Last Modification Date: 07/31/19	(R-X)					Project Sheet Number:	
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English				JBK	Issued by the Project Development Branch: July 31, 2019		

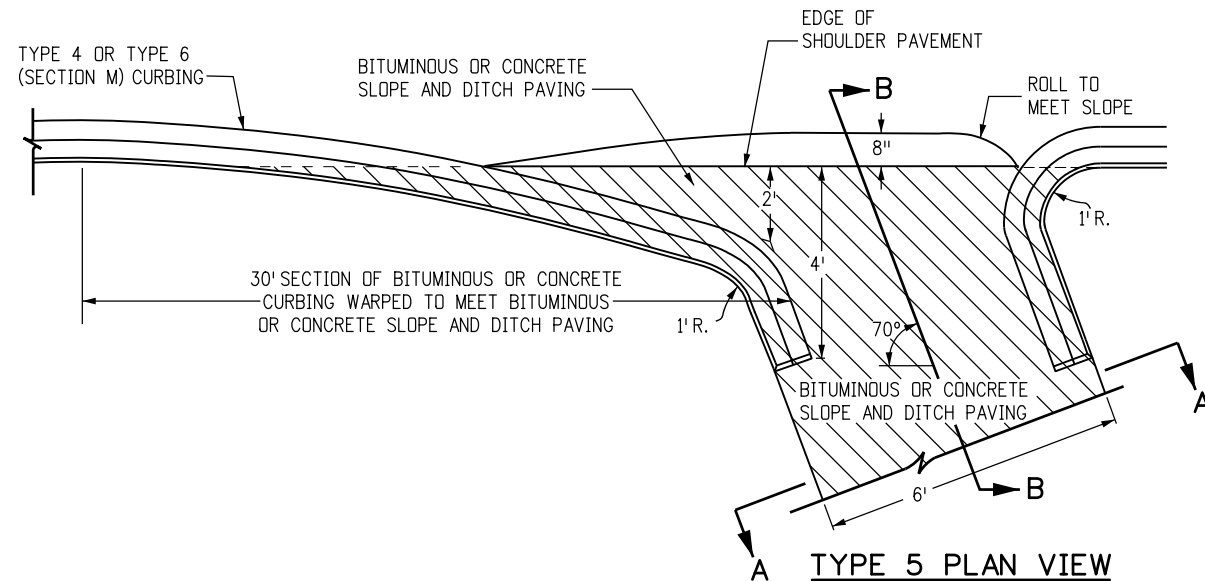

GENERAL NOTES



1. IF THE EMBANKMENT PROTECTOR IS LOCATED IN THE BOTTOM OF A SAG VERTICAL CURVE, FLARE THE CURB ON EACH SIDE OF THE INLET TO ALLOW FOR FLOW FROM BOTH DIRECTIONS.
2. DETAILS OF CURBING ARE SHOWN IN STANDARD PLAN M-609-1.
3. STRUCTURE BACKFILL MATERIAL SHALL NOT BE USED IN THIS WORK. EMBANKMENT MATERIAL SHALL BE USED WITH CONSTRUCTION REQUIREMENTS IN ACCORDANCE WITH SECTION 203. EMBANKMENT MATERIAL WILL NOT BE PAID FOR SEPARATELY, BUT SHALL BE INCLUDED IN THE PAY ITEM FOR EMBANKMENT PROTECTOR (TYPE 5).
4. PAYMENT FOR THE QUANTITIES SHOWN ON THE PLANS FOR THIS WORK SHALL BE AS FOLLOWS:
 - 507 - BITUMINOUS SLOPE AND DITCH PAVING (ASPHALT) TON
 - 507 - CONCRETE SLOPE AND DITCH PAVING CU. YD.
 - 609 - CURB, TYPE 4 OR TYPE 6 (SECTION M) LINEAR FT.
 - 615 - EMBANKMENT PROTECTOR (TYPE 5) EACH

NOTE: THIS PAYMENT INCLUDES THE STRUCTURE EXCAVATION, ANY OTHER EARTHWORK, AND ANY EXTRA WORK REQUIRED TO MODIFY OTHER PAY ITEMS.

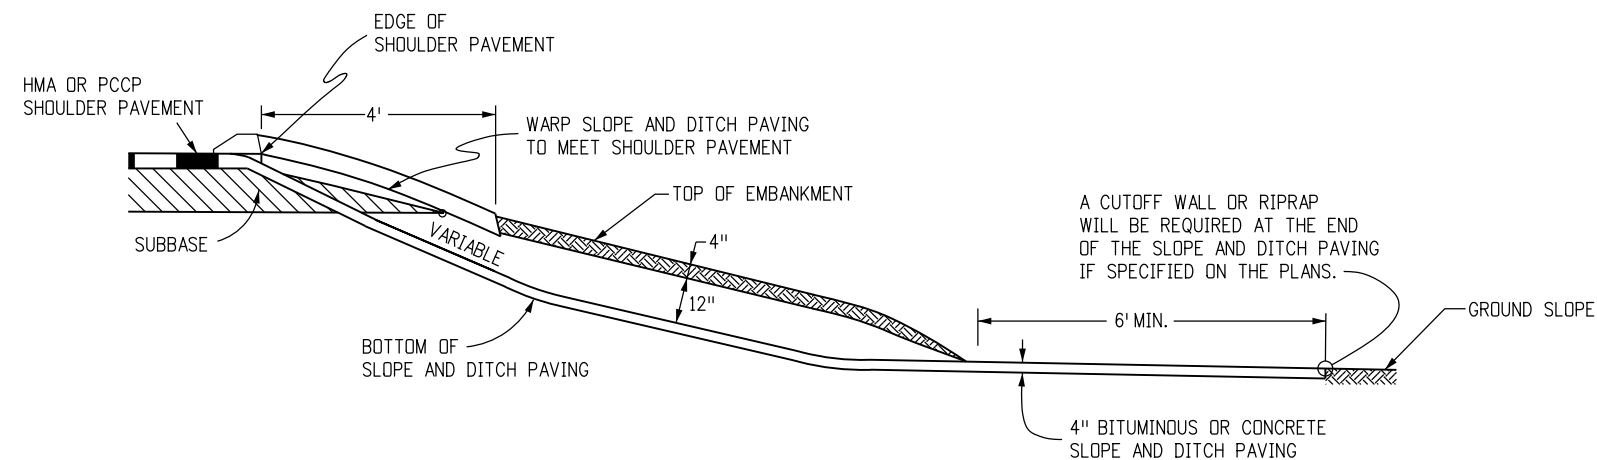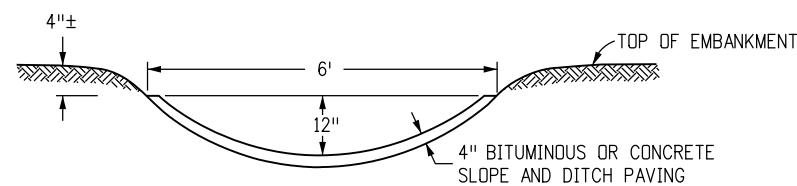

(WITH 4 IN. BITUMINOUS OR CONCRETE SLOPE AND DITCH PAVING)

Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	EMBANKMENT PROTECTOR TYPE 5		STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)	Date:	Comments		M-615-2		Standard Sheet No. 1 of 1	
Designer Initials: JBK								
Last Modification Date: 07/31/19								
Detailer Initials: LTA								
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English					Issued by the Project Development Branch: July 31, 2019		Project Sheet Number:	

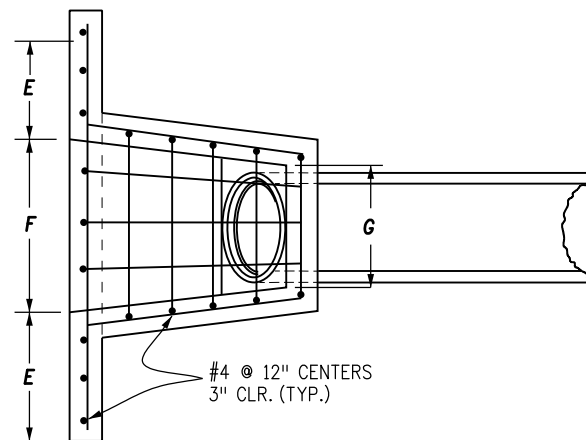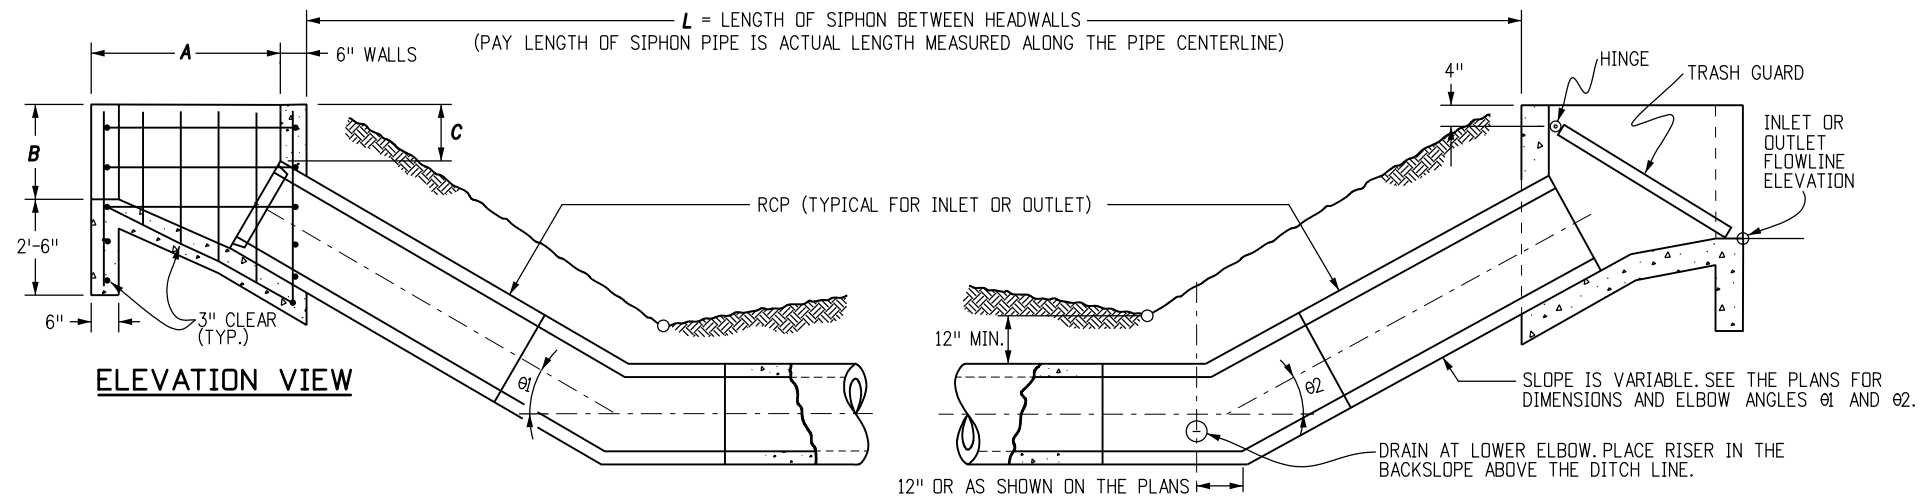

PLAN VIEW


PIPE DIAMETER	DIMENSIONS					
IN.	A	B	C	E	F	G
12	2'-6"	1'-6"	0'-9"	1'-6"	2'-0"	1'-6"
18	3'-9"	2'-0"	1'-2"	2'-3"	3'-0"	2'-1"
24	5'-0"	2'-6"	1'-6"	3'-0"	4'-0"	2'-8"
30	6'-3"	3'-0"	1'-11"	3'-9"	5'-0"	3'-3"
36	7'-6"	3'-6"	2'-3"	4'-6"	6'-0"	3'-10"

HEADWALL DIMENSIONS

PIPE DIAMETER	CONCRETE	REINFORCED STEEL
IN.	CU. YDS.	LBS.
12	0.62	55
18	1.17	88
24	1.92	146
30	2.72	203
36	3.74	275

HEADWALL QUANTITIES


QUANTITIES FOR ONE HEADWALL AFTER DEDUCTION FOR PIPE.

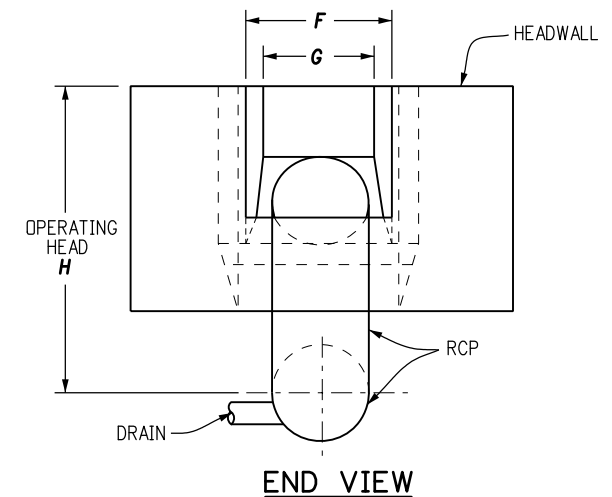


END VIEW

GENERAL NOTES


- SIPHON DRAIN, VALVE AND VALVE BOX, AND TRASH GUARDS ARE TO BE PROVIDED ONLY WHEN CALLED FOR ON THE PLANS.
- CONCRETE SHALL BE CLASS B.
- ALL EXPOSED CONCRETE CORNERS SHALL BE CHAMFERED $\frac{3}{4}$ IN.
- THE LOCATION, SIZE, PIPE MATERIAL AND GOVERNING DIMENSIONS OF SIPHONS WILL BE SHOWN ON THE PLANS.
- TO DETERMINE WALL THICKNESS OR CLASS FOR SIPHON PIPE, SEE APPROPRIATE TABLES ON STANDARD PLAN M-603-2.
- COST OF JOINT SEALERS, GASKETS, FITTINGS AND CONNECTIONS SHALL BE INCLUDED IN THE BID PRICE FOR SIPHON PIPE.
- TRASH GUARDS AND APPURTENANCES SHALL BE GALVANIZED IN CONFORMANCE WITH AASHTO M 111.

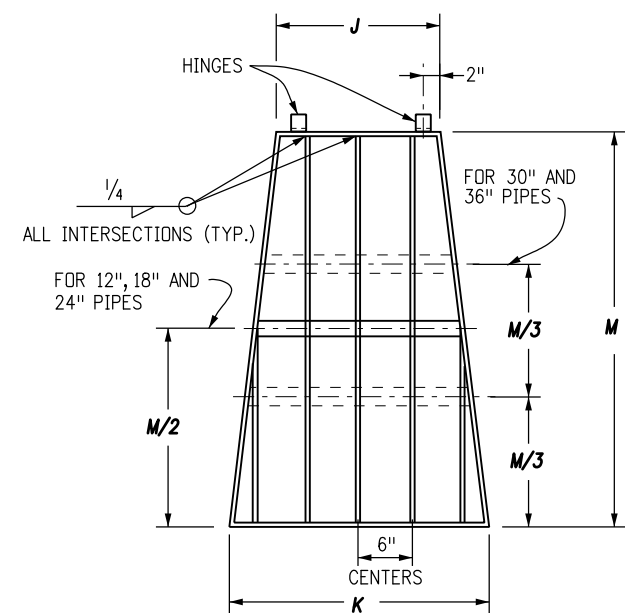

TRASH GUARD DETAILS

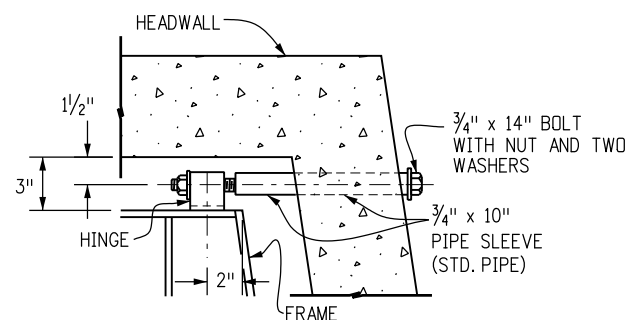


HINGE ASSEMBLY

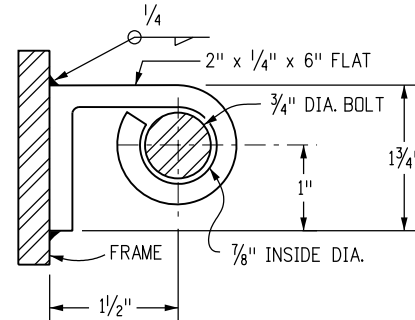

HINGE

PIPE DIAMETER	BAR AND BRACE SIZE	NO. OF BRACES EACH	DIMENSIONS			WEIGHT
INCHES			J	K	M	LBS.
12	$\frac{3}{8}$ " x 2"	1	1'-0"	1'-6"	2'-6"	35.1
18	$\frac{3}{8}$ " x 2"	1	1'-7"	2'-6"	3'-10"	74.4
24	$\frac{3}{8}$ " x 2"	1	2'-2"	3'-6"	5'-2"	120.5
30	$\frac{3}{8}$ " x 2 1/2"	2	2'-9"	4'-6"	6'-6"	235.9
36	$\frac{3}{8}$ " x 2 1/2"	2	3'-4"	5'-6"	7'-10"	317.6

TRASH GUARD DIMENSIONS AND QUANTITIES

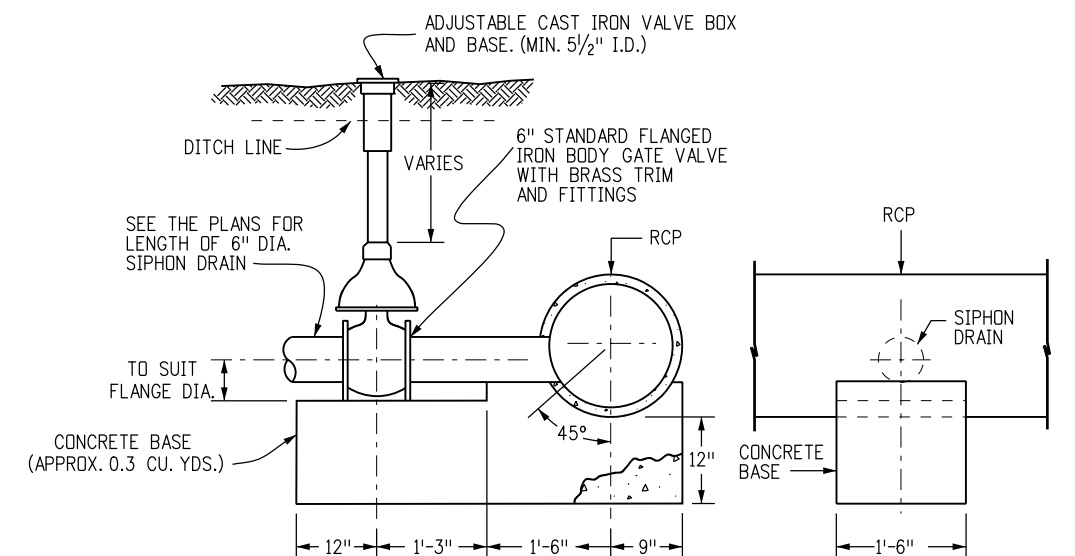

ELEVATION VIEW

PARTIAL END VIEW

DRAIN DETAILS

Computer File Information

Creation Date: 07/31/19
 Designer Initials: JBK
 Last Modification Date: 07/31/19
 Detailer Initials: LTA
 CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

Sheet Revisions

Date:	Comments
(R-X)	
(R-X)	
(R-X)	
(R-X)	

Colorado Department of Transportation



2829 West Howard Place
 CDDT HQ, 3rd Floor
 Denver, CO 80204
 Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch

JBK

INVERTED SIPHON

Issued by the Project Development Branch: July 31, 2019


STANDARD PLAN NO.

M-616-1

Standard Sheet No. 1 of 1

Project Sheet Number:

GENERAL NOTES

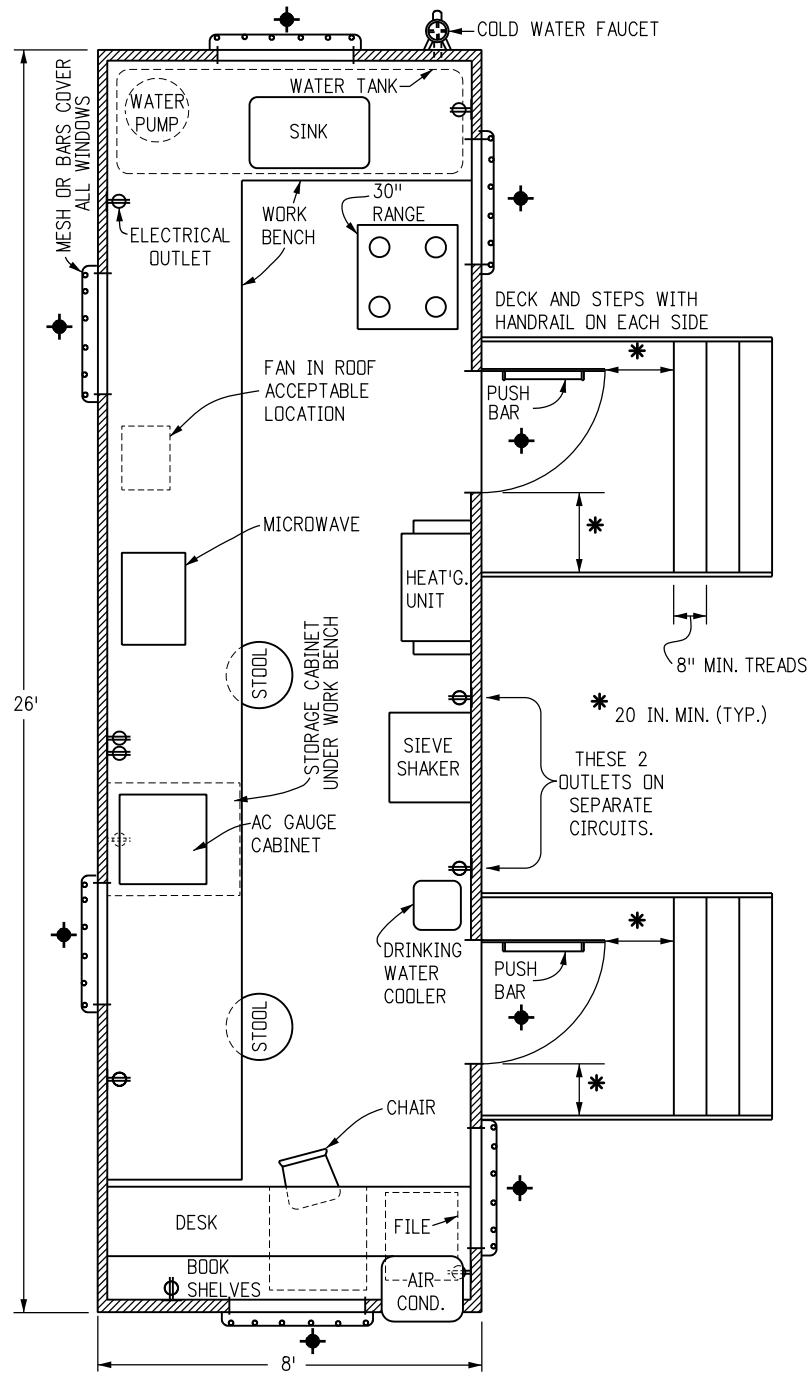

FLOOR PLAN

1. CLASS 1 FIELD LABORATORIES SHALL CONSIST OF A WEATHERPROOF, INSULATED, TEMPORARY OFFICE TYPE TRAILER, CONSTRUCTED TO THE UNIFORM BUILDING CODES SERIES, WITH FLOOR PLAN AND EQUIPMENT LAYOUT SIMILAR TO THE DRAWING ON THIS SHEET. IT SHALL MEET OR EXCEED THE FOLLOWING REQUIREMENTS.
2. **DIMENSIONS:** 26 FT. LONG x 8 FT. WIDE OUTSIDE, 7 FT.-6 IN. HEIGHT INSIDE.
3. **WINDOWS:** A MINIMUM OF 4, WITH PROVISION FOR CROSS VENTILATION AND LOCKING.
4. **DOORS:** TWO, EQUIPPED WITH DEADBOLT LOCKS, 36 IN. x 80 IN., INSULATED STEEL WITH A SMALL CLEAR GLASS WINDOW. EQUIPPED WITH HORIZONTAL PUSH BAR, HEAVY DUTY DOOR CLOSER, AND PULL HANDLE MOUNTED ABOVE PUSH BAR. EACH DOOR SHALL HAVE A SET OF STEPS WITH DECK, AND HANDRAILS. THE STEPS SHALL BE PLACED SO THE DECK CAN BE ACCESSED EITHER FROM THE SIDE OR FROM THE FRONT. THE DECK, RAILS, AND STEPS SHALL MEET OSHA REQUIREMENTS.
5. **FLOOR:** ADEQUATE INSULATION UNDER THE FLOOR. FLOOR COVERING SHALL BE SKID RESISTANT.
6. **HEATING:** FURNACE, 41,000 BTU, FORCED AIR TYPE.
7. **AIR CONDITIONING:** ONE, 8,300 BTU MINIMUM.
8. **ELECTRICAL:** WORK SHALL CONFORM TO THE NATIONAL ELECTRICAL CODE FOR 110/220 VOLTS, 60 HZ, APPLICATIONS AND PROVIDE RELIABLE UNIFORM POWER TO PROPERLY OPERATE ALL FIELD LABORATORY EQUIPMENT. ALL TRAILERS CONSTRUCTED AFTER JULY 1, 2006 SHALL HAVE AN APPROPRIATELY SIZED CIRCUIT BREAKER TO HANDLE THE LOAD OF ALL LABORATORY AND ENVIRONMENTAL EQUIPMENT OPERATING AT ONE TIME. PROVIDE A SEPARATE ELECTRICAL CIRCUIT TO SUPPLY POWER TO THE ASPHALT CONTENT GAUGE AND THE OUTLET IN THE STORAGE CABINET UNDER THE WORK BENCH.
9. **LIGHTING:** ADEQUATE FLUORESCENT LIGHTING DIRECTLY OVER ALL WORK BENCH AND DESK AREAS. THERE SHALL BE ONE 110 VOLT EXTERIOR PORCH LIGHT FIXTURE WITHIN 2 FT. OF EACH EXTERIOR DOOR.
10. **VENT FAN:** ONE, GENERAL VENTILATION WITH 500 CFM CAPACITY AND TWO-SPEED SWITCH. MOUNTED IN THE ROOF OR AT TOP OF WALL NEAR THE RANGE. THE THREE FANS AND TWO WORK BENCH GRILLES PREVIOUSLY REQUIRED MAY BE RETAINED IN THOSE CLASS 1 FIELD LABORATORIES PURCHASED BEFORE THE DATE OF THIS STANDARD.
11. **FURNITURE:** ONE, TWO-DRAWER, LEGAL SIZE FILE CABINET BUILT INTO DESK AREA. DESK SHALL BE BUILT-IN WITH ONE CENTER DRAWER. ONE DESK CHAIR WITH ROLLERS. TWO STOOLS FOR WORK AREA WITH HEIGHT COMPATIBLE WITH WORK BENCHES. ALL CHAIRS SHALL BE ERGONOMICALLY BUILT.
12. **BOOK SHELVES:** MINIMUM 10 LINEAR FT. LONG AND 10 IN. DEEP, BUILT OVER DESK AREA. TOP SHELF SHALL BE AT LEAST 14 IN. BELOW CEILING.
13. **WORK BENCHES:** 30 IN. WIDE x 36 IN. HIGH WITH A DURABLE WORKING SURFACE SUCH AS FORMICA.
14. **STORAGE CABINETS:** TWO, ONE BUILT-IN UNDER THE WORK BENCH WITH A 28 IN. x 28 IN. LOCK EQUIPPED DOOR, WITH ELECTRICAL OUTLET INSIDE. ONE REMOVABLE, WITH OPEN BOTTOM, LOCK EQUIPPED TO SECURE CABINET TO TOP OF WORK BENCH, LARGE ENOUGH TO COVER A 22 IN. x 18 IN. x 18 IN. HIGH ASPHALT CONTENT (AC) GAUGE.
15. **SINK:** ONE, SINGLE TUB, STAINLESS STEEL, 25 IN. x 22 IN. x 6 1/2 IN. EQUIPPED WITH SPRAY NOZZLE, ONE COMBINATION (MIXING) HOT AND COLD WATER FAUCET AND ONE SINGLE COLD WATER FAUCET. ALL FAUCETS SHALL BE EQUIPPED WITH STANDARD HOSE THREAD SPIGOTS. DRAINS SHALL HAVE NO TRAP.
16. **DRINKING WATER SUPPLY:** DRINKING WATER DISPENSED FROM AN ACCEPTABLE WATER COOLING DEVICE.
17. **TESTING WATER SUPPLY:** ONE HUNDRED GALLON WATER CAPACITY, VENTED, WITH MEANS OF DETERMINING WATER LEVEL, WITH ONE PRESSURE PUMP, MINIMUM 30 PSI DELIVERY PRESSURE. ONE COLD WATER FAUCET WITH BACK FLOW PREVENTER LOCATED OUTSIDE OF TRAILER. WATER PIPES SHALL BE LOCATED SO THEY ARE UNEXPOSED AND PROTECTED FROM DAMAGE. WATER SHALL BE SUPPLIED BY THE CONTRACTOR. USE POTABLE WATER ONLY.
18. **TELEPHONES:** TWO TELEPHONES. TWO PRIVATE LINES (1FB) WITH TOUCH TONE SERVICE (IF AVAILABLE) FROM THE LOCAL CARRIER. ONE LINE SHALL BE SHARED BY THE TWO TELEPHONES. THE SECOND LINE SHALL BE SHARED BY A COMPUTER AND A FACSIMILE MACHINE. THE CONTRACTOR SHALL PROVIDE AN EXCLUSION SWITCH (AB SWITCH) FOR THE COMPUTER AND FAX. TRAILER WIRING SHALL INCLUDE FOUR BOXES EQUIPPED WITH RJ-11 JACKS (TWO WIRE PAIRS PER JACK). TWO AT EACH END OF THE TRAILER. LOCATIONS WHERE PRIVATE LINE SERVICE IS NOT AVAILABLE, PROVIDE ONLY ONE TELEPHONE LINE.
19. **FIRE EXTINGUISHER:** ONE, DRY CHEMICAL, 10 LBS. CLASS ABC, UNDERWRITERS LABORATORIES, INC. APPROVED.
20. **SIEVE SHAKER:** ONE MOTOR DRIVEN STANDARD PORTABLE SHAKER INCLUDING:
A. A SAFETY SHIELD ON DRIVE BELT.
B. AN ADJUSTABLE TIMED - ON/OFF SWITCH LOCATED NEAR THE SHAKER.
C. ADAPTERS TO HANDLE EITHER 8 IN. OR 12 IN. SIEVES.

THE SHAKER SHALL BE CAPABLE OF SHAKING A FULL SET OF 8 IN. SIEVES AS WELL AS 12 IN. SIEVES, AND SHALL BE MOUNTED 24 IN. ABOVE THE FLOOR IN A SOUND PROOF, INSULATED ENCLOSURE HAVING HINGED OPENINGS.

THE SIEVE SHAKER SHALL BE A RO-TAP, ENDOCOTT FROM SOILTEST, SS-12R FROM GILSON OR APPROVED EQUAL. THE SHAKER SHALL BE SECURELY BOLTED TO A RIGID AND STURDY SURFACE.
21. **RANGE:** 30 IN. KITCHEN RANGE, ELECTRIC OR GAS, HAVING FOUR SURFACE BURNERS AND A 3.5 CU. FT. OVEN WITH REINFORCED OVEN RACKS.
22. **FORCED AIR OVEN:** IF A FORCED AIR OVEN IS REQUIRED, THE LOCATION WHERE THE OVEN IS PLACED SHALL HAVE A MINIMUM 3 IN. DIAMETER PIPE INSTALLED AND VENTED TO THE OUTSIDE. (SEE M-620-2, SHEET 2 OF 2, GENERAL NOTE 27 FOR MORE REQUIREMENTS.)
23. **MICROWAVE OVEN:** ONE, 1.5 CU. FT. WITH AT LEAST FIVE POWER LEVELS AND A REVOLVING FLOOR OR ROTATING POWER SOURCE.
24. **ELECTRONIC BALANCE:** THE BALANCE SHALL COMPLY WITH AASHTO M 231 FOR GENERAL PURPOSE, CLASS G2 BALANCES, AND THE FOLLOWING:
A. POWER: 115 VAC
B. MODEL: TOP LOADING
C. CAPACITY: MINIMUM OF 35 LBS.
D. READABILITY AND SENSITIVITY: 0.0005 LB.
E. ACCURACY: 0.001 LB. OR 0.1%
F. DISPLAY PANEL SHALL BE EQUIPPED WITH THE FOLLOWING:
LED DISPLAY ON/OFF KEY, PRINT KEY, RE-ZERO KEY, WEIGHING MODE KEY, SAMPLE % KEY, SERIAL RS-232C I/O PORT, AND A CALIBRATION SWITCH.
G. WEIGHING MODES: GRAMS, POUNDS, AND PERCENT OF TARGET MASS (WEIGHT).
H. WEIGHING SURFACE DIMENSION: MINIMUM OF 9 IN. WIDE BY 12 IN. DEEP.
I. BASE: SHALL HAVE ADJUSTABLE LEVELING FEET AND A LEVEL VIAL ATTACHED.

THE BALANCE SHALL BE EQUIPPED WITH AN UNDERHOOK WEIGHING DEVICE AND ONE COPY OF THE OWNER'S MANUAL.
25. **SECURITY:** THIS SYMBOL  ON THE FLOOR PLAN DENOTES AREAS ON THE TRAILER WHERE ADEQUATE PROTECTION AGAINST ILLEGAL ENTRY, VANDALISM AND THEFT SHALL BE PROVIDED.
26. THE REQUIREMENTS LISTED HEREIN ARE INTENDED TO MEET THE NEEDS OF THE CDOT TESTING PERSONNEL CONCERNING TESTING FACILITIES. THERE IS NO INTENT TO SPECIFY ANY STRUCTURAL PORTIONS OF THE LABORATORY EXCEPT AS NEEDED TO SATISFACTORILY PERFORM THE REQUIRED TESTING OF MATERIALS. THE CONTRACTOR MAY SUBSTITUTE CLASS 2 FIELD LABORATORY FOR CLASS 1 FIELD LABORATORY.

Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	FIELD LABORATORY CLASS 1	STANDARD PLAN NO.
Creation Date: 07/31/19	Date:		Comments	M-620-1			
Designer Initials: JBK				Standard Sheet No. 1 of 1			
Last Modification Date: 07/31/19				Project Sheet Number:			
Detailer Initials: LTA							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English							

GENERAL NOTES

1. CLASS 2 FIELD LABORATORIES SHALL CONSIST OF A WEATHERPROOF, INSULATED, TEMPORARY OFFICE TYPE TRAILER, CONSTRUCTED TO THE UNIFORM BUILDING CODE SERIES, WITH FLOOR PLAN AND EQUIPMENT LAYOUT SIMILAR TO THE DRAWING ON THIS SHEET. IT SHALL MEET OR EXCEED THE FOLLOWING REQUIREMENTS.

2. **DIMENSIONS:** 28 FT. LONG x 12 FT. WIDE OUTSIDE, 7 FT.-6 IN. HEIGHT INSIDE.

3. **WINDOWS:** SIX, 30 IN x 27 IN., CAPABLE OF OPENING AND LOCKING.

4. **DOORS:** TWO, EQUIPPED WITH DEADBOLT LOCKS, 36 IN. x 80 IN., INSULATED STEEL WITH SMALL CLEAR GLASS WINDOW. EQUIPPED WITH HORIZONTAL PUSH BAR, HEAVY DUTY DOOR CLOSER, AND PULL HANDLE MOUNTED ABOVE PUSH BAR. EACH DOOR SHALL HAVE A SET OF STEPS WITH DECK, AND HANDRAILS. THE STEPS SHALL BE PLACED SO THE DECK CAN BE ACCESSED EITHER FROM THE SIDE OR FROM THE FRONT. THE DECK, RAILS, AND STEPS SHALL MEET OSHA REQUIREMENTS.

5. **FLOOR:** ADEQUATE INSULATION UNDER THE FLOOR. FLOOR COVERING SHALL BE SKID RESISTANT.

6. **HEATING:** FURNACE, 55,000 BTU, FORCED AIR TYPE.

7. **AIR CONDITIONING:** TWO, 8,300 BTU MINIMUM.

8. **ELECTRICAL:** WORK SHALL CONFORM TO THE NATIONAL ELECTRICAL CODE FOR 110/220 VOLTS, 60 HZ, APPLICATIONS AND PROVIDE RELIABLE UNIFORM POWER TO PROPERLY OPERATE ALL FIELD LABORATORY EQUIPMENT. ALL TRAILERS CONSTRUCTED AFTER JULY 1, 2006 SHALL HAVE AN APPROPRIATELY SIZED CIRCUIT BREAKER TO HANDLE THE LOAD OF ALL LABORATORY AND ENVIRONMENTAL EQUIPMENT OPERATING AT ONE TIME. PROVIDE A SEPARATE ELECTRICAL CIRCUIT TO SUPPLY POWER TO THE ASPHALT CONTENT GAUGE AND THE OUTLET IN THE STORAGE CABINET UNDER THE WORK BENCH.

9. **LIGHTING:** ADEQUATE FLUORESCENT LIGHTING DIRECTLY OVER ALL WORK BENCH AND DESK AREAS. THERE SHALL BE ONE 110 VOLT EXTERIOR PORCH LIGHT FIXTURE WITHIN 2 FT. OF EACH EXTERIOR DOOR.

10. **VENT FAN:** ONE, GENERAL VENTILATION WITH 800 CFM CAPACITY AND 2 SPEED SWITCH. MOUNTED IN THE ROOF OR AT TOP OF WALL NEAR THE RANGE.

11. **FURNITURE:** TWO, TWO-DRAWER, LEGAL SIZE FILE CABINETS BUILT INTO DESK AREA. DESK SHALL BE BUILT-IN WITH ONE CENTER DRAWER. ONE DESK CHAIR WITH ROLLERS, ONE STRAIGHT CHAIR, AND FOUR STOOLS FOR WORK AREA WITH HEIGHT COMPATIBLE WITH WORK BENCHES. ALL CHAIRS SHALL BE ERGONOMICALLY BUILT.

12. **BOOK SHELVES:** A MINIMUM OF 10 LINEAR FT. LONG BUILT OVER DESK AREA AND 8 LINEAR FT. LONG BUILT OVER WORK BENCH. ALL SHELVES SHALL BE 10 IN. DEEP. TOP SHELF SHALL BE AT LEAST 14 IN. BELOW CEILING.

13. **WORK BENCHES:** 30 IN. DEEP x 36 IN. HIGH WITH A DURABLE WORKING SURFACE SUCH AS FORMICA.

14. **STORAGE CABINETS:** TWO, ONE BUILT-IN UNDER THE WORK BENCH WITH A 28 IN. x 28 IN. LOCK EQUIPPED DOOR, WITH ELECTRICAL OUTLET INSIDE. ONE REMOVABLE, WITH OPEN BOTTOM, LOCK EQUIPPED TO SECURE CABINET TO TOP OF WORK BENCH, AND LARGE ENOUGH TO COVER A 22 IN. x 18 IN. x 18 IN. HIGH ASPHALT CONTENT (AC) GAUGE.

15. **SINK:** ONE, SINGLE TUB, STAINLESS STEEL, 25 IN. x 22 IN. x 6 1/2 IN. EQUIPPED WITH SPRAY NOZZLE, ONE COMBINATION (MIXING) HOT AND COLD WATER FAUCET AND ONE SINGLE COLD WATER FAUCET. ALL FAUCETS SHALL BE EQUIPPED WITH STANDARD HOSE THREAD SPIGOTS. DRAIN SHALL HAVE NO TRAP.

16. **DRINKING WATER SUPPLY:** DRINKING WATER DISPENSED FROM AN ACCEPTABLE WATER COOLING DEVICE.

17. **TESTING WATER SUPPLY:** 300 GALLON WATER CAPACITY, IN ONE OR MORE TANKS LOCATED ALONG THE TRAILER END OR ALONG BOTH SIDES OF THE TRAILER END, VENTED WITH MEANS OF DETERMINING WATER LEVEL, WITH ONE PRESSURE PUMP, MINIMUM 30 PSI DELIVERY PRESSURE. TEN GALLON ELECTRIC WATER HEATER. ONE COLD WATER FAUCET WITH BACK FLOW PREVENTER LOCATED ON OUTSIDE OF TRAILER. WATER PIPES SHALL BE LOCATED SO THEY ARE UNEXPOSED AND PROTECTED FROM DAMAGE. WATER SHALL BE SUPPLIED BY THE CONTRACTOR. USE POTABLE WATER ONLY.

18. **TELEPHONES:** TWO TELEPHONES. TWO PRIVATE LINES (1FB) WITH TOUCH TONE SERVICE (IF AVAILABLE) FROM THE LOCAL CARRIER. ONE LINE SHALL BE SHARED BY THE TWO TELEPHONES. THE SECOND LINE SHALL BE SHARED BY A COMPUTER AND FACSIMILE MACHINE. THE CONTRACTOR SHALL PROVIDE AN EXCLUSION SWITCH (AB SWITCH) FOR THE COMPUTER AND FAX. TRAILER WIRING SHALL INCLUDE FOUR BOXES EQUIPPED WITH RJ-11 JACKS (TWO WIRE PAIRS PER JACK). TWO AT EACH END OF THE TRAILER. LOCATIONS WHERE PRIVATE LINE SERVICE IS NOT AVAILABLE, PROVIDE ONLY ONE LINE.

19. **FIRE EXTINGUISHER:** ONE, DRY CHEMICAL, 10 LBS. CLASS ABC, UNDERWRITERS LABORATORIES, INC. APPROVED.

20. **RANGE:** 30 IN. KITCHEN RANGE, ELECTRIC OR GAS, HAVING FOUR SURFACE BURNERS AND A 3.5 CU. FT. OVEN WITH REINFORCED OVEN RACKS.

21. **MICROWAVE OVEN:** ONE, 1.5 CU. FT. WITH AT LEAST FIVE POWER LEVELS AND A REVOLVING FLOOR OR ROTATING POWER SOURCE.

22. **SECURITY:** THIS SYMBOL  ON THE FLOOR PLAN DENOTES AREAS ON THE TRAILER WHERE ADEQUATE PROTECTION AGAINST ILLEGAL ENTRY, VANDALISM AND THEFT SHALL BE PROVIDED.

23. **SIEVE SHAKER:** ONE MOTOR DRIVEN STANDARD PORTABLE SHAKER INCLUDING:
A. A SAFETY SHIELD ON DRIVE BELT.
B. AN ADJUSTABLE TIMED - ON/OFF SWITCH LOCATED NEAR THE SHAKER.
C. ADAPTERS TO HANDLE EITHER 8 IN. OR 12 IN. SIEVES.
THE SHAKER SHALL BE CAPABLE OF SHAKING A FULL SET OF 8 IN. SIEVES AS WELL AS 12 IN. SIEVES, AND SHALL BE MOUNTED 24 IN. ABOVE THE FLOOR IN A SOUND PROOF, INSULATED ENCLOSURE HAVING HINGED OPENINGS.
THE SIEVE SHAKER SHALL BE A RO-TAP, ENDOCOTT FROM SOILTEST, SS-12R FROM GILSON OR APPROVED EQUAL. THE SHAKER SHALL BE SECURELY BOLTED TO A RIGID, STURDY SURFACE.

24. **ELECTRONIC BALANCE:** THE BALANCE SHALL COMPLY WITH ASSHTO M 231 FOR GENERAL PURPOSE, CLASS G2 BALANCES, AND THE FOLLOWING:
A. POWER: 115 VAC
B. MODEL: TOP LOADING
C. CAPACITY: MINIMUM OF 35 LBS.
D. READABILITY AND SENSITIVITY: 0.0005 LB.
E. ACCURACY: 0.001 LB. OR 0.1%
F. DISPLAY PANEL: SHALL BE EQUIPPED WITH THE FOLLOWING: LED DISPLAY, ON/OFF KEY, PRINT KEY, RE-ZERO KEY, WEIGHING MODE KEY, SAMPLE % KEY, SERIAL RS- 232C PORT, AND A CALIBRATION SWITCH.
G. WEIGHING MODES: GRAMS, POUNDS, AND PERCENT OF TARGET MASS (WEIGHT).
H. WEIGHING SURFACE DIMENSION: MINIMUM OF 9 IN. WIDE BY 12 IN. DEEP.
I. BASE: SHALL HAVE ADJUSTABLE LEVELING FEET AND A LEVEL VIAL ATTACHED.
THE BALANCE SHALL BE EQUIPPED WITH AN UNDERHOOK WEIGHING DEVICE AND ONE COPY OF THE OWNER'S MANUAL.

25. **RECORDING THERMOMETER:** RECORDING THERMOMETER FOR CURING TANKS SHALL BE EITHER ELECTRICAL OR MECHANICAL TYPE.
A. THE ELECTRICAL RECORDING THERMOMETER SHALL BE EQUIPPED WITH THE FOLLOWING:
(1) 120 VAC/60 Hz WITH A MINIMUM 3 FT. LONG POWER CORD.
(2) MINIMUM 6 IN. DIAMETER CIRCULAR PAPER CHART WITH A BOX OF BLANK CHARTS.
(3) A SELECTABLE TEMPERATURE SCALE WITH ONE SCALE THAT HAS A RANGE FROM 50° F. TO 120° F.
(4) A SELECTABLE CHART SPEED WITH ONE SPEED OF 24 HOURS AND ONE SPEED OF 7 DAYS. THE SPEED ACCURACY SHALL BE ± 1.5%.
(5) THE DISPLAY SHALL BE A MINIMUM 3 DIGIT LED WITH A MINIMUM DIGIT SIZE OF 0.5 IN.
(6) THE TEMPERATURE ACCURACY OF THE MONITOR SHALL BE ± 1° F
(7) THE MONITOR SHALL HAVE A CHART ADVANCE BUTTON, A TIME POINTER, A PEN ADJUST BUTTON, AND A TEMPERATURE ADJUST KNOB.
THE RECORDING PEN SHALL BE AN INK TYPE WITH A SPARE PEN INCLUDED.
THE TEMPERATURE PROBE SHALL BE SUBMERSIBLE TYPE J THERMOCOUPLE WITH A 15 FT. MINIMUM CORD LENGTH.
B. THE MECHANICAL RECORDING THERMOMETER SHALL BE EQUIPPED WITH THE FOLLOWING:
(1) MINIMUM 3 IN. DIAMETER PRESSURE SENSITIVE PAPER CHART WITH A BOX OF BLANK CHARTS.
(2) THE STEM OF THE THERMOMETER SHALL BE A MINIMUM OF 12 IN. LONG.
(3) THE THERMOMETER SHALL BE A KEY TYPE, WINDING MODEL CAPABLE OF 7 DAY, 24 HOUR RECORDING.
(4) THE DRIVE MECHANISM SHALL BE CAPABLE OF OPERATING BEYOND ITS FULL RECORDING RANGE BY A MINIMUM OF 20%.
(5) THE THERMOMETER SHALL BE CAPABLE OF OPERATING FROM 0° F TO 200° F.
(6) THE CLOCK MECHANISM ACCURACY SHALL BE A MINIMUM OF 2% OF THE FULL-SCALE RANGE BEING USED.
(7) THE RECORDING RANGE SHALL BE A MINIMUM OF 20° F TO 220° F.
THE RECORDING THERMOMETER SHALL BE MOUNTED IN SUCH A WAY THAT A MINIMUM 8 IN. OF THE STEM IS IMMERSSED IN THE CURING TANKS AND IS EASILY ACCESSIBLE TO CHANGE THE RECORDING TEMPERATURE CHARTS.

26. THE REQUIREMENTS LISTED HEREIN ARE INTENDED TO MEET THE NEEDS OF THE CDDT TESTING PERSONNEL CONCERNING TESTING FACILITIES. THERE IS NO INTENT TO SPECIFY ANY STRUCTURAL PORTIONS OF THE SUBJECT LABORATORY EXCEPT AS NEEDED TO SATISFACTORILY PERFORM THE REQUIRED TESTING OF MATERIALS.
- THE GENERAL NOTES ARE CONTINUED ON SHEET 2.
- | Computer File Information | | Sheet Revisions | | Colorado Department of Transportation

2829 West Howard Place
CDDT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868
Project Development Branch JBK | FIELD LABORATORY
CLASS 2 | STANDARD PLAN NO. | |
|--|---|-----------------|----------|---|---|---------------------------|--|
| Creation Date: 07/31/19 | <div>(R-X)</div> <div>(R-X)</div> <div>(R-X)</div> <div>(R-X)</div> | Date: | Comments | | | M-620-2 | |
| Designer Initials: JBK | | | | | | Standard Sheet No. 1 of 2 | |
| Last Modification Date: 07/31/19 | | | | | | Project Sheet Number: | |
| Detailer Initials: LTA | | | | | Issued by the Project Development Branch: July 31, 2019 | | |
| CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English | | | | | | | |

GENERAL NOTES (CONTINUED FROM SHEET 1)


27. **FORCED AIR CONVECTION OVEN:** REQUIRED ON PROJECTS WITH 5,000 OR MORE TONS OF HMA OR WHEN SPECIFIED IN THE PLANS. THE FORCED AIR OVEN REPLACES THE RANGE. THE OVEN SHALL BE RATED TO AT LEAST 1500 WATTS INCLUDING:
- 1. AT LEAST ONE BLOWER TO CIRCULATE AIR INSIDE WITHOUT DISTURBING FINE GRAINED SOILS PLACED IN THE OVEN.
 - 2. A MINIMUM INTERIOR CAPACITY OF 4.8 CUBIC FEET.
 - 3. AN EXHAUST CHAMBER ADAPTER TO CONNECT TO A 3 INCH PIPE WHICH SHALL BE VENTED TO THE OUTSIDE.
 - 4. AT LEAST TWO ADJUSTABLE SHELVES.
 - 5. AN OVER-TEMPERATURE PROTECTION DEVICE.
 - 6. AN ELECTRONIC CONTROL SYSTEM WITH DIGITAL TEMPERATURE READ-OUT AND DIGITAL TEMPERATURE SET POINTS TO PRECISELY READ AND SET THE OVEN TEMPERATURE.

THE OVEN SHALL HAVE A TEMPERATURE RANGE FROM 104 °F TO 464 °F AND HAVE A UNIFORM TEMPERATURE OF ± 3 °F AT 230 °F. THE OVEN SHALL BE CAPABLE OF MAINTAINING A CONSTANT TEMPERATURE, ± 5 °F, THROUGHOUT ITS TEMPERATURE RANGE. THE OVEN HEATING ELEMENTS SHALL NOT BE ALLOWED TO OPERATE WITHOUT THE BLOWER. THE FIELD LABORATORY SHALL BE EQUIPPED WITH A SEPARATE ELECTRICAL CIRCUIT TO SUPPLY POWER TO THE FORCED CONVECTION OVEN. IN ADDITION TO THE ABOVE FORCED AIR CONVECTION OVEN, A HOT PLATE CONFORMING TO THE FOLLOWING SHALL BE PROVIDED:

- 1. TWO BURNER, PORTABLE, ELECTRICAL "CAL-ROD" OR "RANGETTE" TYPE.
- 2. AT LEAST ONE BURNER SHALL BE RATED A MINIMUM OF 800 WATTS.
- 3. EACH HOT PLATE SHALL BE EQUIPPED WITH AN ON-OFF INDICATOR LIGHT.

28. **CURING TANK:** MINIMUM 95 GALLON CAPACITY WITH A CIRCULATING PUMP WITH A 120 GPH RATING. TANK CAPACITY WILL INCREASE FOR LARGE CONCRETE PROJECTS WHEN SPECIFIED IN THE PLANS.

Computer File Information		Colorado Department of Transportation 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development BranchJBK	FIELD LABORATORY CLASS 2		STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)		Date:	Comments	M-620-2
Designer Initials: JBK					Standard Sheet No. 2 of 2
Last Modification Date: 07/31/19					
Detailer Initials: LTA					
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English					
					Project Sheet Number:

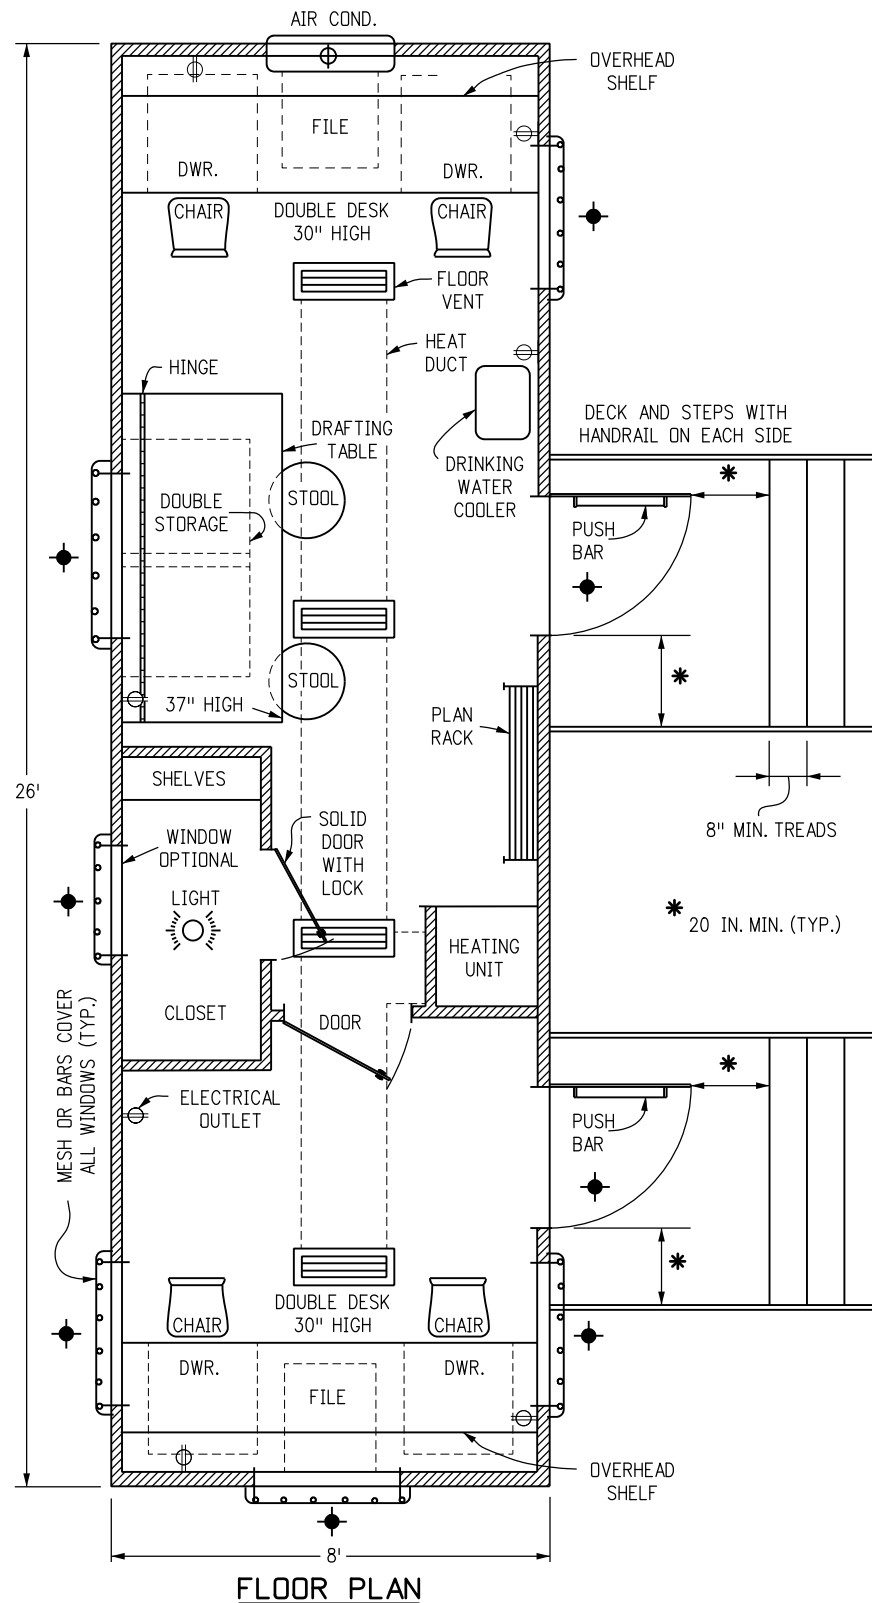

GENERAL NOTES

1. CLASS 1 FIELD OFFICES SHALL CONSIST OF A WEATHERPROOF, INSULATED, TEMPORARY OFFICE TYPE TRAILER, CONSTRUCTED TO THE UNIFORM BUILDING CODE SERIES, WITH FLOOR PLAN AND EQUIPMENT LAYOUT SIMILAR TO THE DRAWING ON THIS SHEET. IT SHALL MEET OR EXCEED THE FOLLOWING REQUIREMENTS.
2. **DIMENSIONS:** 26 FT. LONG x 8 FT. WIDE OUTSIDE, 7 FT.-6 IN. HEIGHT INSIDE.
3. **WINDOWS:** A MINIMUM OF 4, WITH PROVISION FOR CROSS VENTILATION AND LOCKING.
4. **OUTSIDE DOORS:** TWO, REINFORCED WITH DEADBOLT LOCKS. DECK, STEPS, AND HANDRAILS AT EACH DOOR. THE STEPS SHALL BE PLACED SO THE DECK CAN BE ACCESSED EITHER FROM THE SIDE OR FROM THE FRONT. THE DECK, RAILS, AND STEPS SHALL MEET OSHA REQUIREMENTS.
5. **HEATING:** A THERMOSTAT CONTROLLED FORCED AIR UNIT WITH A MINIMUM INPUT CAPACITY OF 200 BTU PER SQUARE FT. OF FLOOR AREA.
6. **AIR CONDITIONING:** ONE, 8,300 BTU MINIMUM.
7. **ELECTRICAL:** WORK SHALL CONFORM TO THE NATIONAL ELECTRICAL CODE FOR 110/220 VOLTS, 60 Hz, APPLICATIONS AND PROVIDE RELIABLE UNIFORM POWER TO PROPERLY OPERATE ALL FIELD OFFICE EQUIPMENT.
8. **LIGHTING:** ADEQUATE FLUORESCENT LIGHTING OVER ALL DRAFTING TABLES AND DESK AREAS. THERE SHALL BE ONE 110 VOLT EXTERIOR PORCH LIGHT FIXTURE WITHIN 2 FT. OF EACH EXTERIOR DOOR.
9. **DESKS:** ONE 30 IN. x FULL INSIDE WIDTH x 30 IN. HIGH, AT EACH END OF THE TRAILER, SUPPORTED BY A LEGAL SIZE 2 DRAWER METAL FILE CENTER PEDESTAL. EACH DESK TOP SHALL HAVE AN OVERHEAD SHELF AND TWO PEN DRAWERS.
10. **DRAFTING TABLES:** ONE 26 IN. x 72 IN. HINGED BOARD WITH DOUBLE STORAGE BELOW. SLOPE BOARD 12:1 DOWN TO 37 IN. HEIGHT AT FRONT EDGE.
11. **FURNITURE:** FOUR CHAIRS WITH ROLLERS AND TWO DRAFTING STOOLS. EACH OF APPROPRIATE HEIGHT. ALL CHAIRS SHALL BE ERGONOMICALLY BUILT.
12. **PLAN STORAGE:** A PLAN RACK OR FILE FOR FULL SIZE PLANS.
13. **CLOSET:** A LOCKED STORAGE AREA OF 15 SQ. FT.
14. **DRINKING WATER SUPPLY:** DRINKING WATER DISPENSED FROM AN ACCEPTABLE WATER COOLING DEVICE.
15. **TELEPHONES:** TWO TELEPHONES. TWO PRIVATE LINES (1FB) WITH TOUCH TONE SERVICE (IF AVAILABLE) FROM THE LOCAL CARRIER. ONE LINE SHALL BE SHARED BY THE TWO TELEPHONES. THE SECOND LINE SHALL BE SHARED BY A COMPUTER AND A FACSIMILE MACHINE. THE CONTRACTOR SHALL PROVIDE AN EXCLUSION SWITCH (AB SWITCH) FOR THE COMPUTER AND FACSIMILE MACHINE. TRAILER WIRING SHALL INCLUDE FOUR BOXES EQUIPPED WITH RJ-11 JACKS (TWO WIRE PAIRS PER JACK), TWO AT EACH END OF THE TRAILER. LOCATIONS WHERE PRIVATE LINE SERVICE IS NOT AVAILABLE, PROVIDE ONLY ONE TELEPHONE LINE.
16. **FIRE EXTINGUISHER:** ONE, DRY CHEMICAL, 10 LBS. CLASS ABC, UNDERWRITERS LABORATORIES, INC. APPROVED.
17. **SECURITY:** THIS SYMBOL  ON THE FLOOR PLAN DENOTES AREAS ON THE TRAILER WHERE ADEQUATE PROTECTION AGAINST ILLEGAL ENTRY, VANDALISM AND THEFT SHALL BE PROVIDED.

Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	FIELD OFFICE CLASS 1		STANDARD PLAN NO.
Creation Date: 07/31/19	(R-X)	Date:	Comments				M-620-11
Designer Initials: JBK	(R-X)						Standard Sheet No. 1 of 1
Last Modification Date: 07/31/19	(R-X)			Issued by the Project Development Branch: July 31, 2019			Project Sheet Number:
Detailer Initials: LTA	(R-X)						
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	(R-X)						

GENERAL NOTES

1. CLASS 2 FIELD OFFICES SHALL CONSIST OF A WEATHERPROOF, INSULATED, TEMPORARY OFFICE TYPE TRAILER, BUILT TO THE UNIFORM BUILDING CODE SERIES OF CODES, WITH FLOOR PLAN AND EQUIPMENT LAYOUT SIMILAR TO THE DRAWING ON THIS SHEET. IT SHALL MEET OR EXCEED THE FOLLOWING REQUIREMENTS.

2. **DIMENSIONS:** 50 FT. LONG x 12 FT. WIDE OUTSIDE, 7 FT.-6 IN. HEIGHT INSIDE.

3. **WINDOWS:** A MINIMUM OF 6, WITH PROVISION FOR CROSS VENTILATION AND LOCKING.

4. **DOORS:** TWO INSIDE DOORS, MAY BE LOCATED EITHER TO ONE SIDE OR AT CENTER OF PARTITION. ONE CLOSET DOOR. TWO OUTSIDE DOORS SHALL BE REINFORCED AND HAVE DEADBOLT LOCKS. DECK, STEPS, AND HANDRAILS AT EACH OUTER DOOR. THE STEPS SHALL BE PLACED SO THE DECK CAN BE ACCESSED EITHER FROM THE SIDE OR FROM THE FRONT. THE DECK, RAILS, AND STEPS SHALL MEET OSHA REQUIREMENTS.

5. **HEATING & AIR CONDITIONING:** THREE TON CAPACITY AIR CONDITIONING AND 80,000 BTU CAPACITY HEATING, CONNECTED TO DUCTING & THERMOSTAT CONTROLLED.

6. **ELECTRICAL:** WORK SHALL CONFORM TO THE NATIONAL ELECTRICAL CODE FOR 110/220 VOLTS, 60 Hz, APPLICATIONS AND PROVIDE RELIABLE UNIFORM POWER TO PROPERLY OPERATE ALL FIELD OFFICE EQUIPMENT.
7. **LIGHTING:** ADEQUATE FLUORESCENT LIGHTING OVER ALL DRAFTING TABLES AND DESK AREAS. THERE SHALL BE ONE 110 VOLT EXTERIOR PORCH LIGHT FIXTURE WITHIN 2 FT. OF EACH EXTERIOR DOOR.

8. **DESKS:** ONE 30 IN. x FULL INSIDE WIDTH x 30 IN. HIGH AT EACH END OF THE TRAILER, SUPPORTED BY A LEGAL SIZE 2 DRAWER METAL FILE CENTER PEDESTAL. EACH DESK TOP SHALL HAVE AN OVERHEAD SHELF AND TWO PEN DRAWERS.

9. **DRAFTING TABLE:** ONE 38 IN. x 96 IN. TABLE, SLOPED 12:1 TO 37 IN. HEIGHT AT FRONT EDGE OR WITH PROVISION FOR ADJUSTING THE SLOPE.

10. **WORK TABLE:** ONE 72 IN. x 36 IN. TABLE. THE TOP OF THE TABLE SHALL BE FREE OF ALL SCRATCHES, CHIPS, AND DENTS.

11. **OFFICE DESK:** ONE 72 IN. x 36 IN. DESK WITH SIX DRAWERS AND ONE CENTER PEN DRAWER. THE TOP OF THE DESK SHALL BE FREE OF ALL SCRATCHES, CHIPS, AND DENTS.

12. **FURNITURE:** EIGHT CHAIRS WITH ROLLERS AND TWO DRAFTING STOOLS. EACH OF APPROPRIATE HEIGHT. ONE WORK TABLE OR DESK. ALL CHAIRS SHALL BE ERGONOMICALLY BUILT.


13. **PLAN STORAGE:** A PLAN RACK OR FILE FOR FULL SIZE PLANS.
14. **CLOSET:** A LOCKED STORAGE AREA OF 15 SQ. FT.

15. **DRINKING WATER SUPPLY:** DRINKING WATER DISPENSED FROM AN ACCEPTABLE WATER COOLING DEVICE.

16. **TELEPHONES:** THREE, 2-LINE TELEPHONES. FOUR PRIVATE LINES (1FB) WITH TOUCH TONE SERVICE. TWO LINES ARE FOR TELEPHONE SERVICES, WITH ROLL-OVER CAPABILITY FOR THE THREE TELEPHONES. ONE LINE SHALL BE USED FOR THE COMPUTER, AND ONE LINE SHALL BE USED FOR THE FACSIMILE MACHINE. TRAILER WIRING SHALL INCLUDE 9 RJ-11 JACKS, ONE JACK EACH FOR A TWO-LINE TELEPHONE, A COMPUTER LINE, AND A FACSIMILE MACHINE LINE AT EACH END OF THE OFFICE, AND IN THE CENTER AREA OF THE OFFICE.


17. **FIRE EXTINGUISHER:** TWO, DRY CHEMICAL, 10 LBS. CLASS ABC, UNDERWRITERS LABORATORIES, INC. APPROVED.

18. **SECURITY:** THIS SYMBOL  ON THE FLOOR PLAN DENOTES AREAS ON THE TRAILER WHERE ADEQUATE PROTECTION AGAINST ILLEGAL ENTRY, VANDALISM AND THEFT SHALL BE PROVIDED.

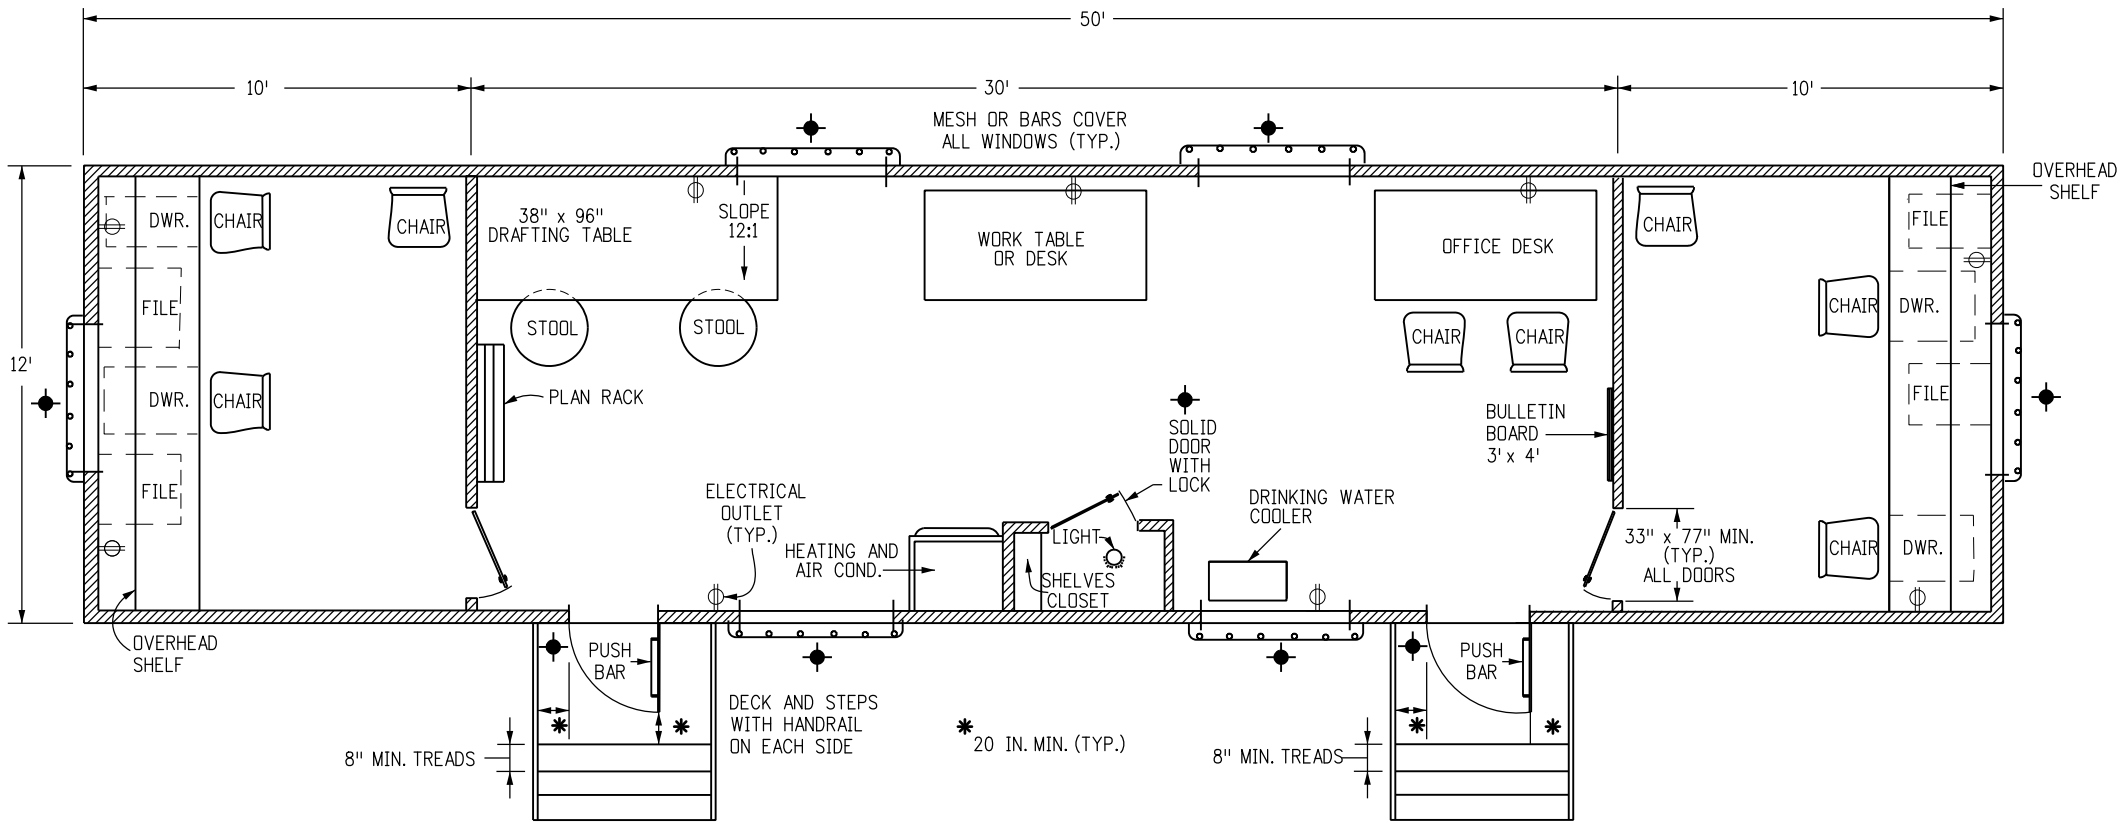

FLOOR PLAN


Computer File Information		Sheet Revisions		Colorado Department of Transportation  2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK	FIELD OFFICE CLASS 2	STANDARD PLAN NO.	
Creation Date: 07/31/19	(R-X) (R-X) (R-X) (R-X)	Date:	Comments			M-620-12	
Designer Initials: JBK						Standard Sheet No. 1 of 1	
Last Modification Date: 07/31/19						Project Sheet Number:	
Detailer Initials: LTA							
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English				Issued by the Project Development Branch: July 31, 2019			

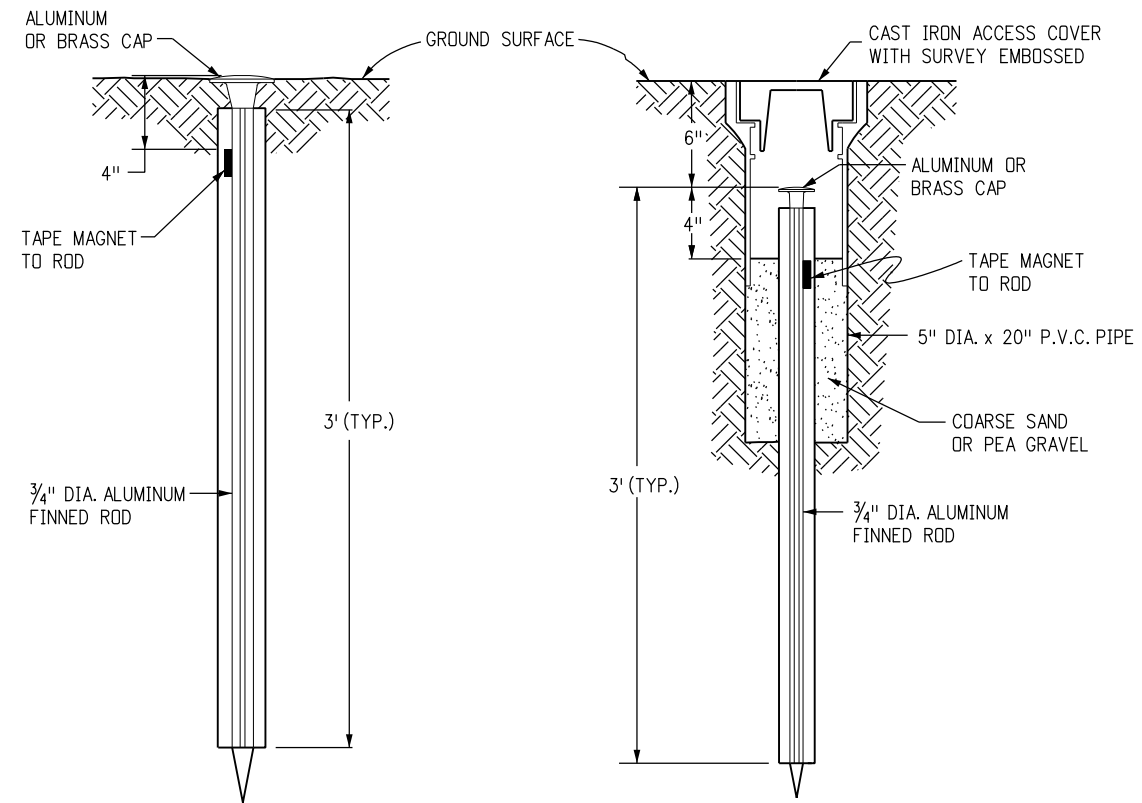


TYPE 1 MONUMENT

TYPE 1A MONUMENT

INCLUDES MONUMENT BOX

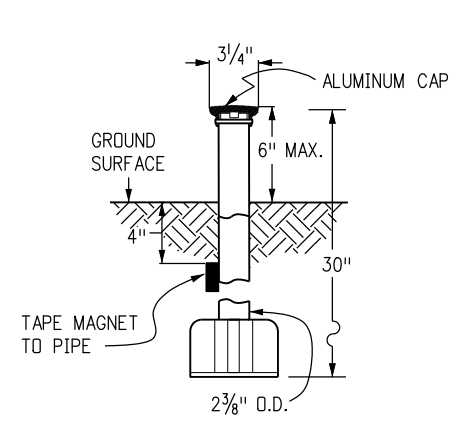


TYPE 3 MONUMENT

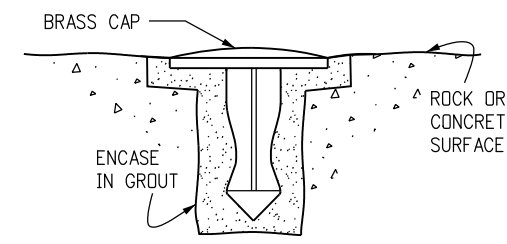


TYPE 5 MONUMENT


ALUMINUM CAP AND TYPE 5(S) DETAILS SHOWN ON SHEET 2




SECTION A-A

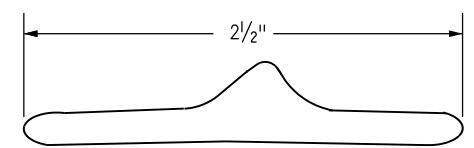

SECTION B-B

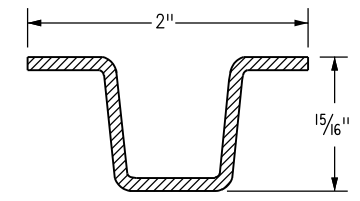


DELINEATOR POST SECTION C-C

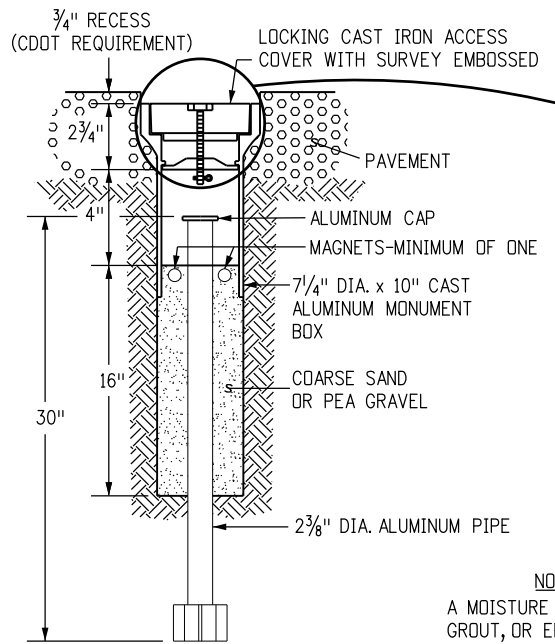


TYPE 3A MONUMENT

ROADWAY INSTALLATION INCLUDES MONUMENT BOX

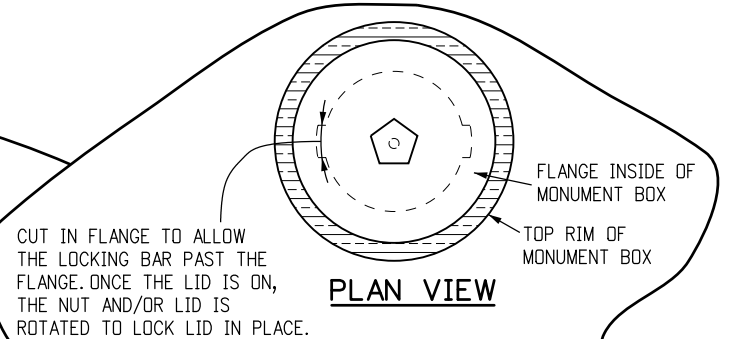


PLAN VIEW

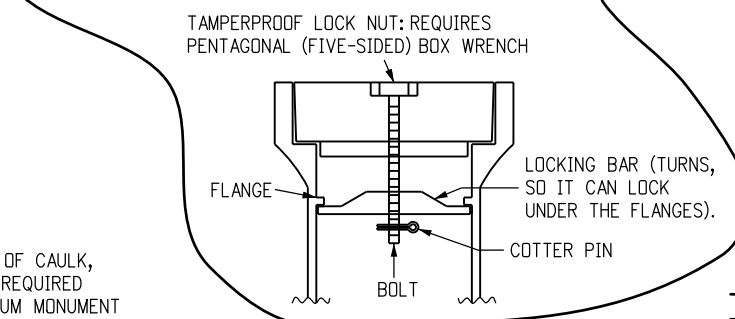


LOCKING CAST IRON ACCESS COVER

NOTE:
A MOISTURE BARRIER OF CAULK, GROUT, OR EPOXY IS REQUIRED BETWEEN THE ALUMINUM MONUMENT BOX AND THE PAVEMENT.

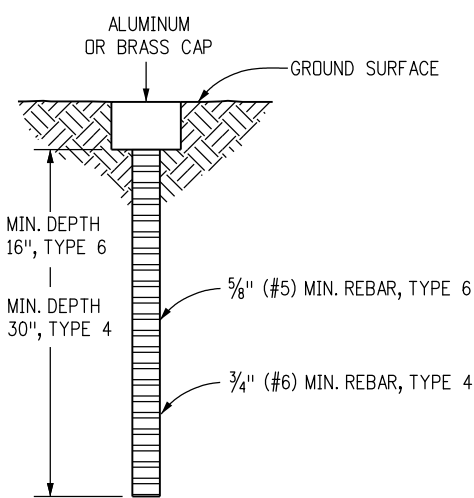


TYPE 4 AND TYPE 6 MONUMENT

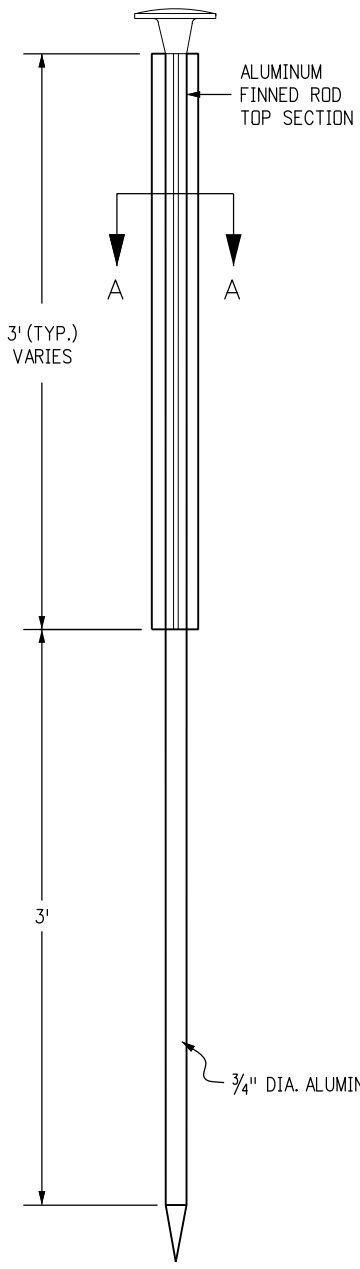


TYPE 2 MONUMENT

TYPE 2A INCLUDES MONUMENT BOX

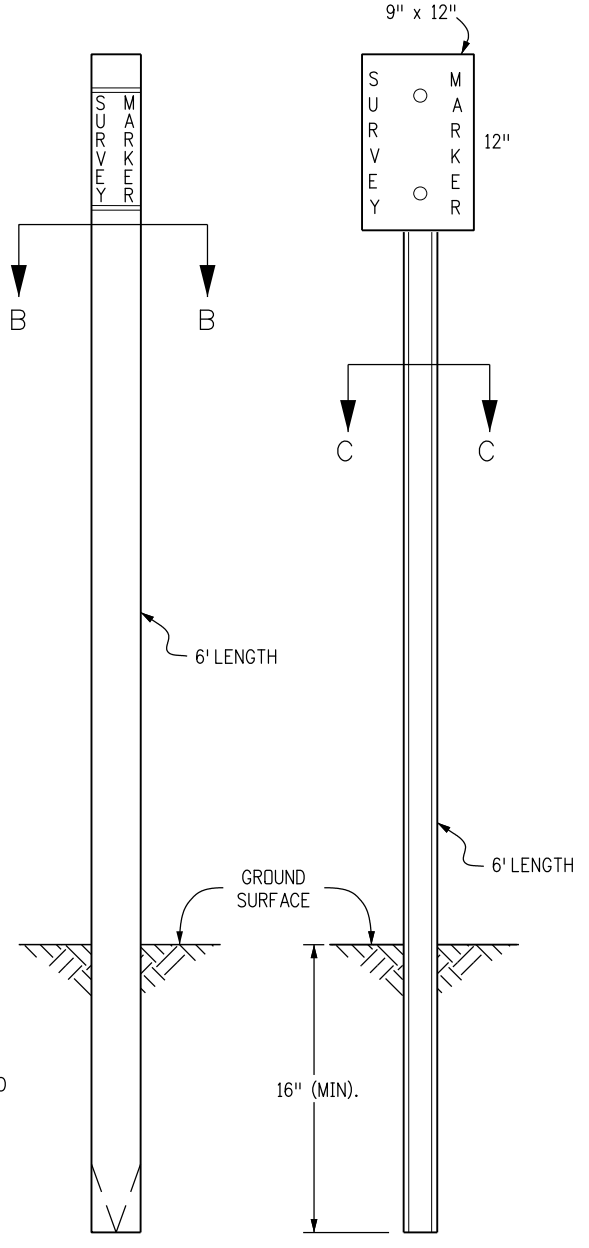


WITNESS POSTS


Computer File Information		(R-X) (R-X) (R-X) (R-X)	Sheet Revisions		Colorado Department of Transportation		SURVEY MONUMENTS		STANDARD PLAN NO.	
Creation Date: 07/31/19			Date:	Comments	 2829 West Howard Place CDOT HQ, 3rd Floor Denver, CO 80204 Phone: 303-757-9021 FAX: 303-757-9868 Project Development Branch JBK				M-629-1	
Designer Initials: JBK									Standard Sheet No. 1 of 2	
Last Modification Date: 07/31/19							Issued by the Project Development Branch: July 31, 2019			
Detailer Initials: LTA										
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English										




REFERENCE
MONUMENT CAP



ROW
MONUMENT CAP



CONTROL
MONUMENT CAP




ALIQUT CORNER
MONUMENT CAP




ALUMINUM CAP

NOTE: A BLANK CAP MAY BE SUBSTITUTED IF THE APPROPRIATE CAP SHOWN ABOVE IS NOT AVAILABLE. IF A BLANK CAP IS USED, ALL INFORMATION NORMALLY INCLUDED ON THE APPROPRIATE STANDARD CAP, SHALL BE STAMPED ON THE BLANK CAP ALONG WITH SPECIFIC PROJECT INFORMATION SUCH AS PROJECT NO., DATE, POINT NO., ETC..

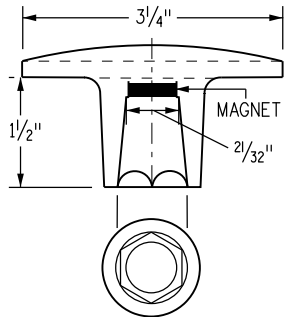


ALUMINUM CAP
USED WITH ALUMINUM ROD

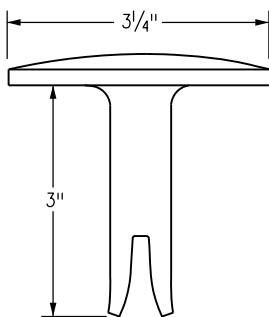


ALUMINUM CAP
TYPE 5

FOR PLACING IN EXISTING
CONCRETE OR ROCK


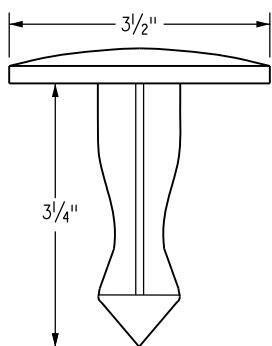


BRASS CAP
TYPE 5

FOR PLACING IN EXISTING
CONCRETE OR ROCK

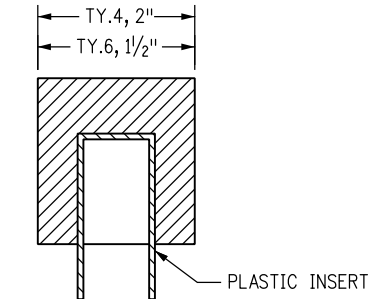

ALUMINUM CAP

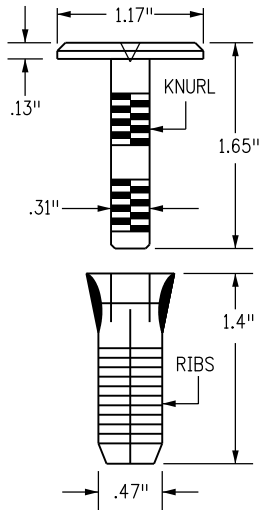

COPPER ALLOY CAP

TYPE 5(S)

FOR PLACING IN EXISTING
SIDEWALK, CURB, OR GUTTER

ALL MONUMENTATION MATERIALS WILL BE FURNISHED BY CDOT

THE MONUMENT TYPE SHALL MEET THE MINIMUM STANDARDS AS DETERMINED BY THE COLORADO STATE BOARD OF REGISTRATION FOR PROFESSIONAL LAND SURVEYORS RULES (STATE BOARD RULES).

THE CDOT SURVEY COORDINATOR SHALL APPROVE ALL EXCEPTIONS FOR STAMPING MONUMENTS DIFFERING FROM THE STANDARDS.

TYPE 1 AND TYPE 1A ALUMINUM FINNED ROD MONUMENTS

THIS MONUMENT SHALL BE USED FOR ROW OR REFERENCE MONUMENTS OR MAY BE USED FOR AN ALIQUOT CORNER MONUMENT. WHEN USED AS AN ALIQUOT CORNER MONUMENT, INSTALLATION AND RECORD FILING REQUIREMENTS SHALL BE AS STATED FOR TYPE 3 AND TYPE 3A MONUMENTS.

MONUMENTS SHALL BE INSTALLED BY ATTACHING THE PROPER SIZE TIP TO ONE END OF A SECTION OF FINNED ROD, AND A 3 IN. LONG X 3/4 IN. DIA. STAINLESS STEEL ADAPTER TO THE OTHER END. THE DRIVER IS THEN PLACED OVER THE STAINLESS STEEL ADAPTER FOR THE HAMMER TO CONTACT. TYPE 1 MONUMENTS SHALL USE A MINIMUM 3 FT. SECTION OF FINNED ROD. WHEN SUBSURFACE ROCK OR CONCRETE IS ENCOUNTERED LESS THAN 3 FT. BELOW THE GROUND SURFACE, THE ROD SHALL BE EMBEDDED IN THE ROCK OR IN CONCRETE AT LEAST 6 IN. AND GROUTED IN PLACE. THE ROD MAY BE SHORTENED TO ACCOMMODATE THE CONDITIONS.

WHEN UNSTABLE SOIL CONDITIONS ARE ENCOUNTERED, ADDITIONAL SECTIONS OF ROD SHALL BE ADDED TO ACHIEVE STABILITY. HORIZONTAL AND VERTICAL STABILITY ARE REQUIRED.

TYPE 1A MONUMENT INCLUDES MONUMENT BOX. A LOCKING CAST IRON ACCESS COVER SHALL BE INSTALLED WHEN THE MONUMENT IS LOCATED IN THE ROADWAY PAVEMENT.

TYPE 2 AND TYPE 2A ALUMINUM FINNED ROD MONUMENTS

THIS MONUMENT SHALL BE USED FOR HORIZONTAL AND VERTICAL CONTROL MONUMENTS. WHEN UNSTABLE SOIL CONDITIONS ARE ENCOUNTERED, ADDITIONAL SECTIONS OF ROD SHALL BE ADDED TO ACHIEVE STABILITY. HORIZONTAL AND VERTICAL STABILITY ARE REQUIRED. IN MOST SOIL CONDITIONS THE TYPE 2 MONUMENT IS EMBEDDED 6 FT. INTO THE GROUND.

THE MONUMENT SHALL BE INSTALLED BY FIRST ATTACHING THE PROPER SIZE TIP TO A 3 FT. LONG X 3/4 IN. DIA. ROD, THEN DRIVING THE ROD AT LEAST 30 IN. INTO THE GROUND. ADDITIONAL 3 FT. LONG X 3/4 IN. FINNED ROD SECTIONS SHALL BE ADDED AND DRIVEN FLUSH WITH THE GROUND UNTIL THE MONUMENT IS IN A STABLE POSITION. THE FINNS ARE BENT OVER USING PLIERS TO ACCOMMODATE INSTALLING THE CAP. THE CAP IS FIRMLY SEATED ONTO THE LAST FINNED SECTION OF ROD USING A DEAD BLOW SLEDGE HAMMER.

TYPE 2A MONUMENT INCLUDES MONUMENT BOX. A LOCKING CAST IRON ACCESS COVER SHALL BE INSTALLED WHEN THE MONUMENT IS LOCATED IN THE ROADWAY PAVEMENT.

TYPE 3 AND TYPE 3A ALUMINUM PIPE MONUMENTS

THIS MONUMENT SHALL BE USED FOR AN ALIQUOT CORNER MONUMENT. THE INSTALLATION OF THIS MONUMENT AND RECORD FILING SHALL BE DONE IN ACCORDANCE WITH THE STATE BOARD RULES. ALSO REFER TO THE CDOT SURVEY MANUAL AND THE BUREAU OF LAND MANAGEMENT REQUIREMENTS FOR MONUMENT INSTALLATION. THE LAND SURVEYOR'S LICENSE NUMBER AND THE YEAR SHALL BE STAMPED ON THE CAP.

TYPE 3A MONUMENT INCLUDES MONUMENT BOX. A LOCKING CAST IRON ACCESS COVER SHALL BE INSTALLED WHEN THE MONUMENT IS LOCATED IN THE ROADWAY PAVEMENT.

TYPE 4 ALUMINUM MONUMENT

THIS MONUMENT MAY BE INSTALLED IN LIEU OF REPLACING THE ENTIRE MONUMENT WHEN REBAR IS IN PLACE AT AN ALIQUOT CORNER LOCATION. REFER TO THE STATE BOARD RULES. A MINIMUM 2 IN. DIA. CAP SHALL BE USED ON 3/4 IN. (#6) REBAR.

TYPE 5 BRASS/ALUMINUM CAP MONUMENT

THIS MONUMENT MAY BE INSTALLED IN LIEU OF ALL OTHER CDOT MONUMENTS, WHEN THE POSITION IS LOCATED IN CONCRETE OR STABLE ROCK FORMATION.

TYPE 5(S) COPPER ALLOY CAP MONUMENT - SMALL

THIS MONUMENT MAY BE INSTALLED IN LIEU OF A TYPE 5 MONUMENT, WHEN THE POSITION IS LOCATED IN A CONCRETE SIDEWALK, CURB OR GUTTER, OR WHEN SETTING A TYPE 5 WOULD COMPROMISE THE INTEGRITY OF THE RECEIVING STRUCTURE.

STAMPING REQUIREMENTS:

- "RP", WHEN THE APPLICATION IS A REFERENCE POINT.
- "ROW", POINT NUMBER, "LS", AND REGISTRATION NUMBER WHEN THE APPLICATION IS A ROW POINT.
- "CP" AND A UNIQUE IDENTIFIER PROVIDED BY THE REGION SURVEY COORDINATOR, WHEN THE APPLICATION IS A CONTROL POINT.
- "PE", POINT NUMBER, "LS", AND REGISTRATION NUMBER, WHEN THE APPLICATION IS A PERMANENT EASEMENT POINT.
- "PP" AND POINT NUMBER, WHEN THE APPLICATION IS A PROJECT POINT.

TYPE 6 ALUMINUM MONUMENT

THIS MONUMENT SHALL BE USED FOR PERMANENT EASEMENTS, PROJECT BENCH MARKS, PROJECT POINTS, AND REFERENCES. AN ALUMINUM CAP WITH A MINIMUM DIAMETER OF 1 1/2 IN., SHALL BE USED ON 5/8 IN. (#5) MINIMUM REBAR.

* WITNESS POSTS

THE WITNESS POST WILL BE SUPPLIED BY CDOT AND INSTALLATION SHALL BE INCLUDED IN THE WORK. IT SHALL BE DRIVEN WITHIN 1 FT. OF THE MONUMENT WHEN POSSIBLE. A DELINEATOR POST WITH A 9 IN. X 12 IN. METAL SIGN PANEL MAY BE USED IN LIEU OF THE PLASTIC POST. THIS POST SHALL CONFORM TO STANDARD PLAN S-612-1. A REQUIRED WITNESS POST MAY BE OMITTED WITH THE APPROVAL OF THE ENGINEER IF THE WITNESS POST LOCATION IS WITHIN A TRAVELED WAY, DRIVEWAY, OR ACCESS OPENING.

MONUMENT APPLICATION

CAP TYPE	MONUMENT TYPE									
	1	1A	2	2A	3	3A	4	5	5(S)	6
REFERENCE	X	X						X	X	X
ROW	X	X						X	X	
CONTROL			X	X				X	X	
ALIQUT CORNER	X	X			X	X	X	X		
PERMANENT EASEMENT								X	X	X
PROJECT POINTS								X	X	X
WITNESS POST* (REQUIRED)	X		X	X	X			X		

Computer File Information

Creation Date: 07/31/19

Designer Initials: JBK

Last Modification Date: 07/31/19

Detailer Initials: LTA

CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English

Sheet Revisions

Date:

Comments

(R-X)

(R-X)

(R-X)

(R-X)

Colorado Department of Transportation



2829 West Howard Place
CDOT HQ, 3rd Floor
Denver, CO 80204
Phone: 303-757-9021 FAX: 303-757-9868

Project Development Branch

JBK

SURVEY MONUMENTS

Issued by the Project Development Branch: July 31, 2019

STANDARD PLAN NO.

M-629-1

Standard Sheet No. 2 of 2

Project Sheet Number: