



Revision Dates (Preliminary Stage Only)	
2/06	3/07
10/13	


Design		Detail		Quantities	
DATE	INITIAL	DATE	INITIAL	DATE	INITIAL
MM/YY	MM/YY	MM/YY	MM/YY	MM/YY	MM/YY
Designed By	Checked By	Detailed By	Checked By	Quantity By	Checked By
XXX	XXX	XXX	XXX	XXX	XXX

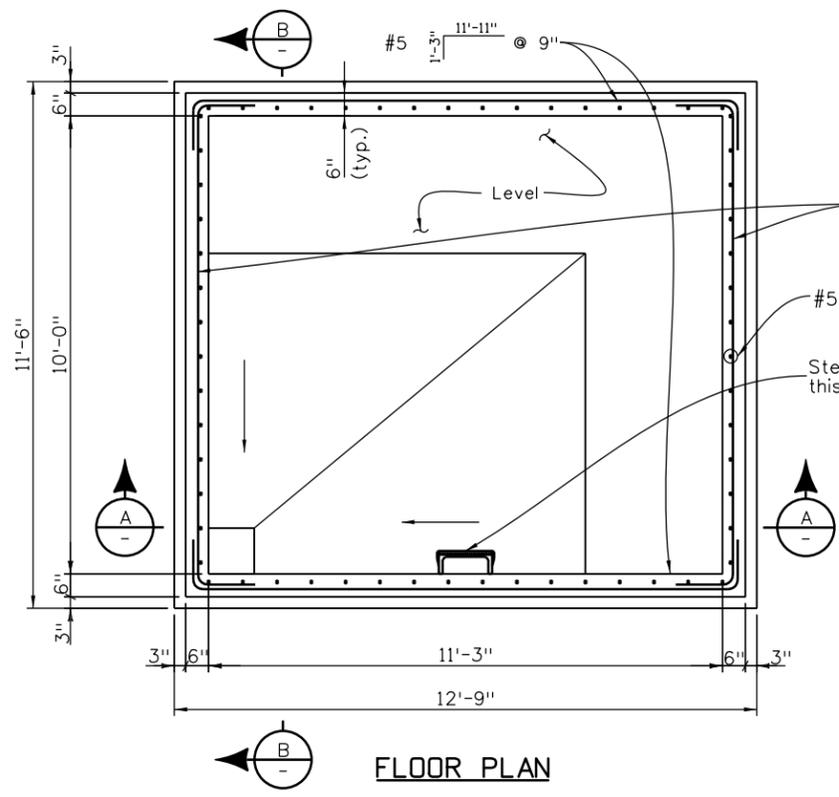

FLOOR PLAN

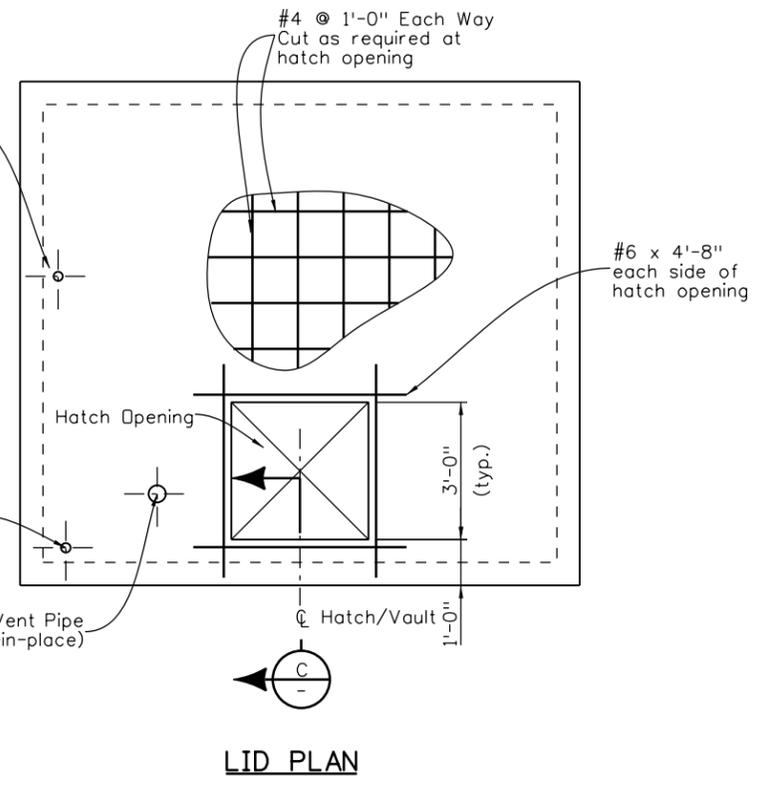

LID PLAN

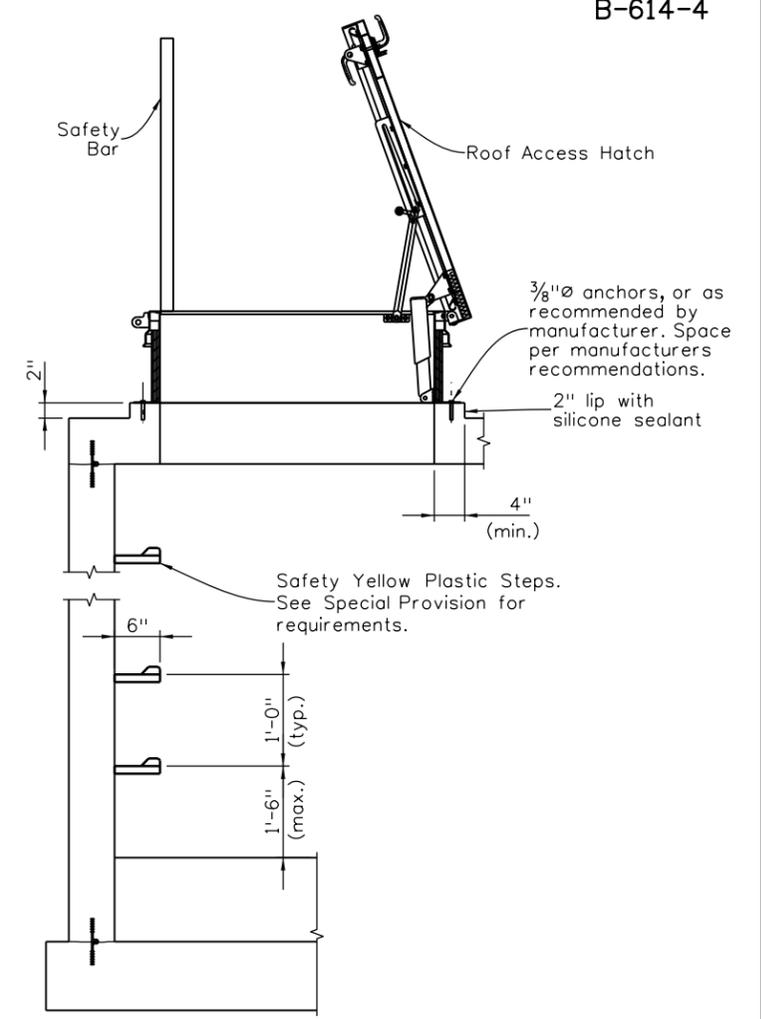


TYPICAL HATCH AND STEP DETAIL


SECTION C-C

NOTES:

1. A Precast Vault is allowed as approved by the Engineer. Independent design calculations stamped by a Professional Engineer licensed in the State of Colorado shall be submitted. Shop drawings shall be submitted in accordance with Section 105 of the Standard Specifications.
2. Precast Joints shall not be located below the water table.
3. The diameter for concrete coring or blockouts for all conduits through walls shall be pipe OD plus 1/2 inch. Any gaps or spaces shall be injected and sealed with a silicone sealant from both the interior and exterior of the wall prior to backfilling operations.

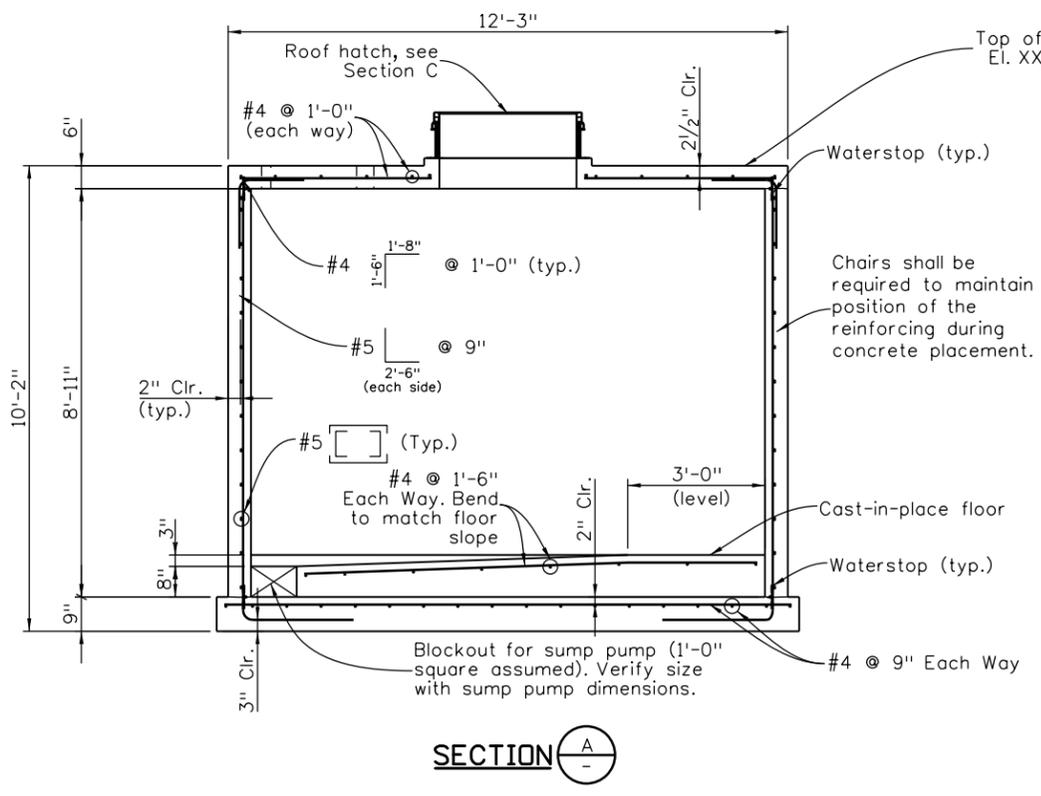

SECTION A-A

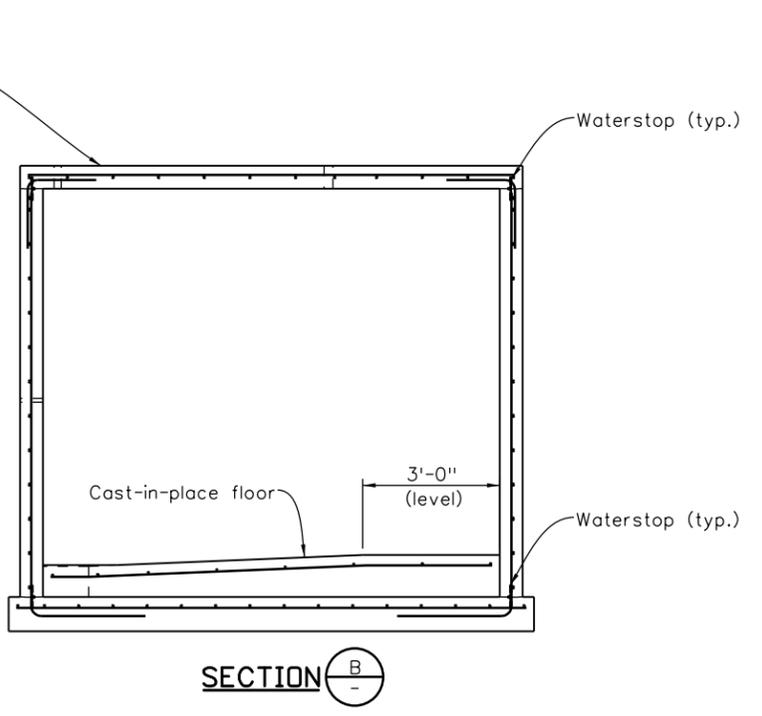

SECTION B-B

Print Date: \$DATE\$
 File Name: Sheet_B-614-4.dgn
 Horiz. Scale: NTS Vert. Scale: As Noted
 Staff Bridge Branch - Unit 022X Unit Leader Initials

Sheet Revisions		
Date:	Comments	Init.

Colorado Department of Transportation
 4201 East Arkansas Avenue
 Room 107
 Denver, CO 80222
 Phone: 303-757-9309 FAX: 303-757-9197
Staff Bridge Branch **Initials**

As Constructed
No Revisions:
Revised:
Void:

ANTI-ICING SYSTEM VAULT STRUCTURAL DETAILS			
Designer:	XXXXXXXX	Structure Numbers	X-XX-XX
Detailer:	XXXXXXXX	Structure Numbers	X-XX-XX
Sheet Subset:	BRIDGE	Subset Sheets:	ICE 4 of 4

Project No./Code
Project Number
Code
Sheet Number