
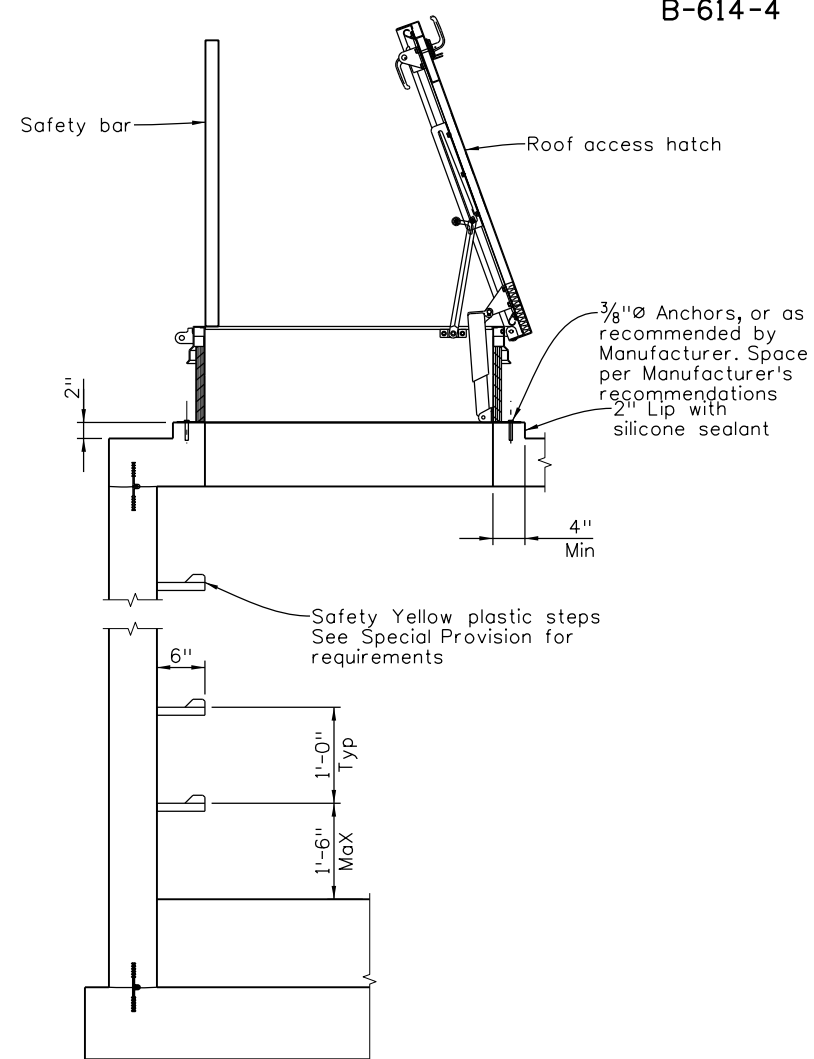
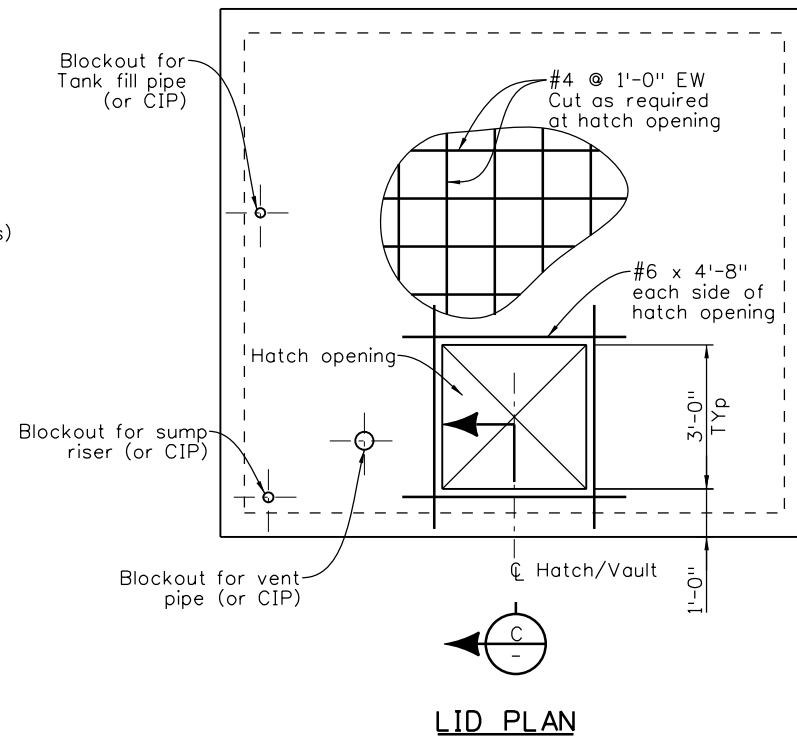


Revision Dates					
2/06	3/07	10/13	3/23	9/24	



INITIALS	DESIGN	DATE	DETAIL	DATE	QUANTITY	DATE
By						
Checked By						

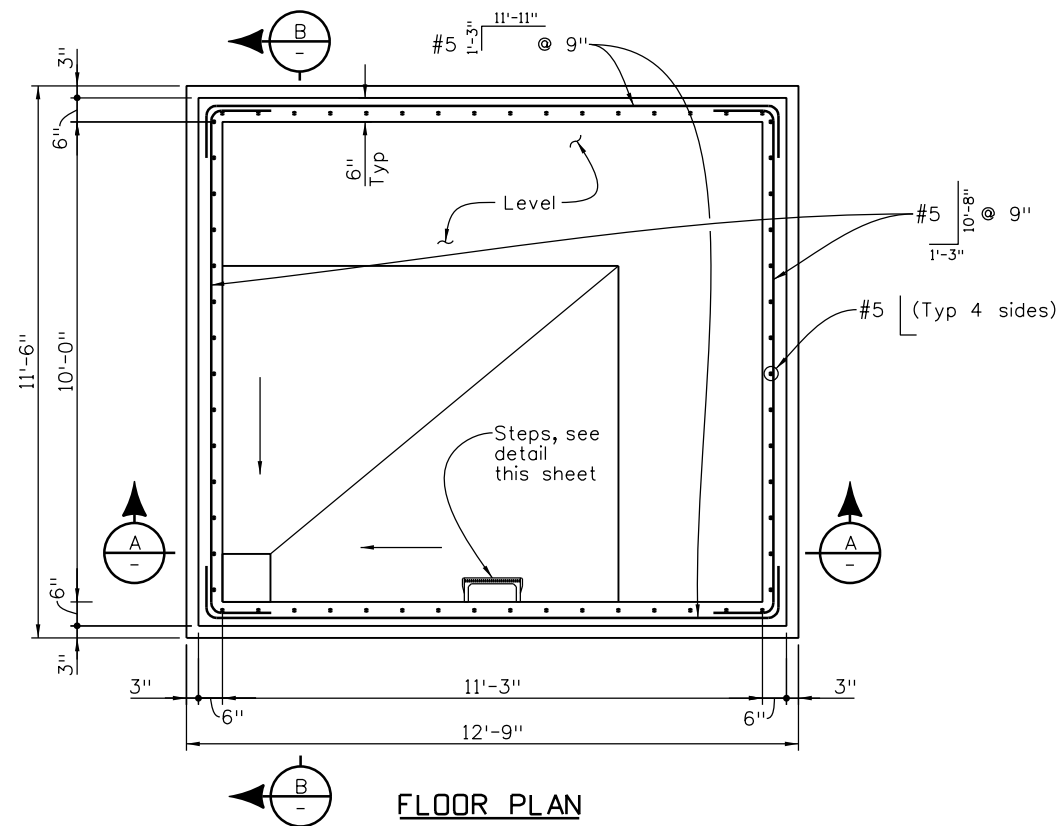

SECTION C-C

NOTES:

1. A Precast Vault is allowed as approved by the Engineer. Independent design calculations stamped by a Professional Engineer licensed in the State of Colorado shall be submitted. Shop drawings shall be submitted in accordance with Section 105 of the Standard Specifications.
2. Precast Joints shall not be located below the water table.
3. The diameter for concrete coring or blockouts for all conduits through walls shall be pipe OD plus 1/2 inch. Any gaps or spaces shall be injected and sealed with a silicone sealant from both the interior and exterior of the wall prior to backfilling operations.

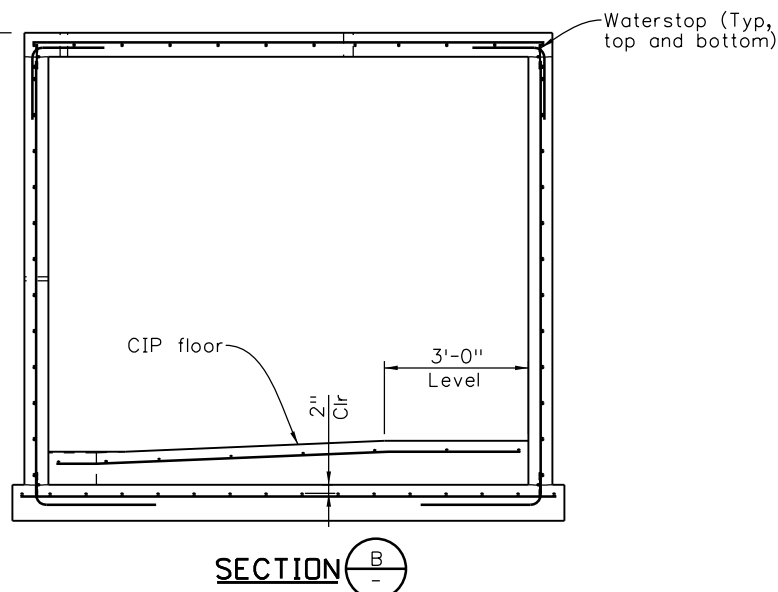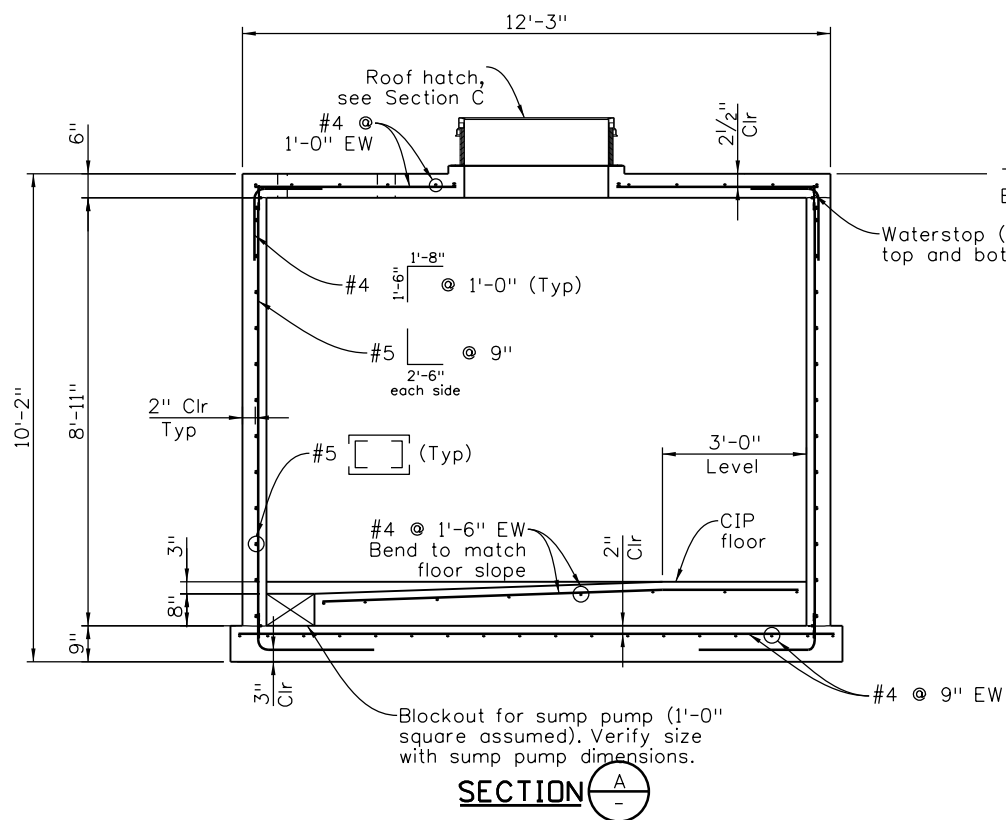


All seals for this set of drawings are applied to the cover page(s)

Print Date: \$DATE\$
File Name: Sheet_B-614-4.dgn
Horiz. Scale: None Vert. Scale: As Noted
Unit Information Unit Leader Initials

Sheet Revisions

Date:	Comments	Init.

Colorado Department of Transportation



2829 West Howard Place, 3rd Floor
Denver, CO 80204
Phone: 303-512-4079
FAX: 303-757-9197

Staff Bridge Branch

Initials

As Constructed

No Revisions:

Revised:

Void:

ANTI-ICING SYSTEM VAULT STRUCTURAL DETAILS

Designer:	XXXXXXXX	Structure	X-XX-XX
Detailer:	XXXXXXXX	Numbers	X-XX-XX
Sheet Subset:	BRIDGE	Subset Sheets:	BXX of XXX

Project No./Code

Project Number

Code

Sheet Number