


Revision Dates			
3/99	11/99	5/00	4/02
		3/07	10/13
		3/23	9/ 24

INITIALS	DESIGN	DATE	DETAIL	DATE	QUANTITY	DATE
By						
Checked By						

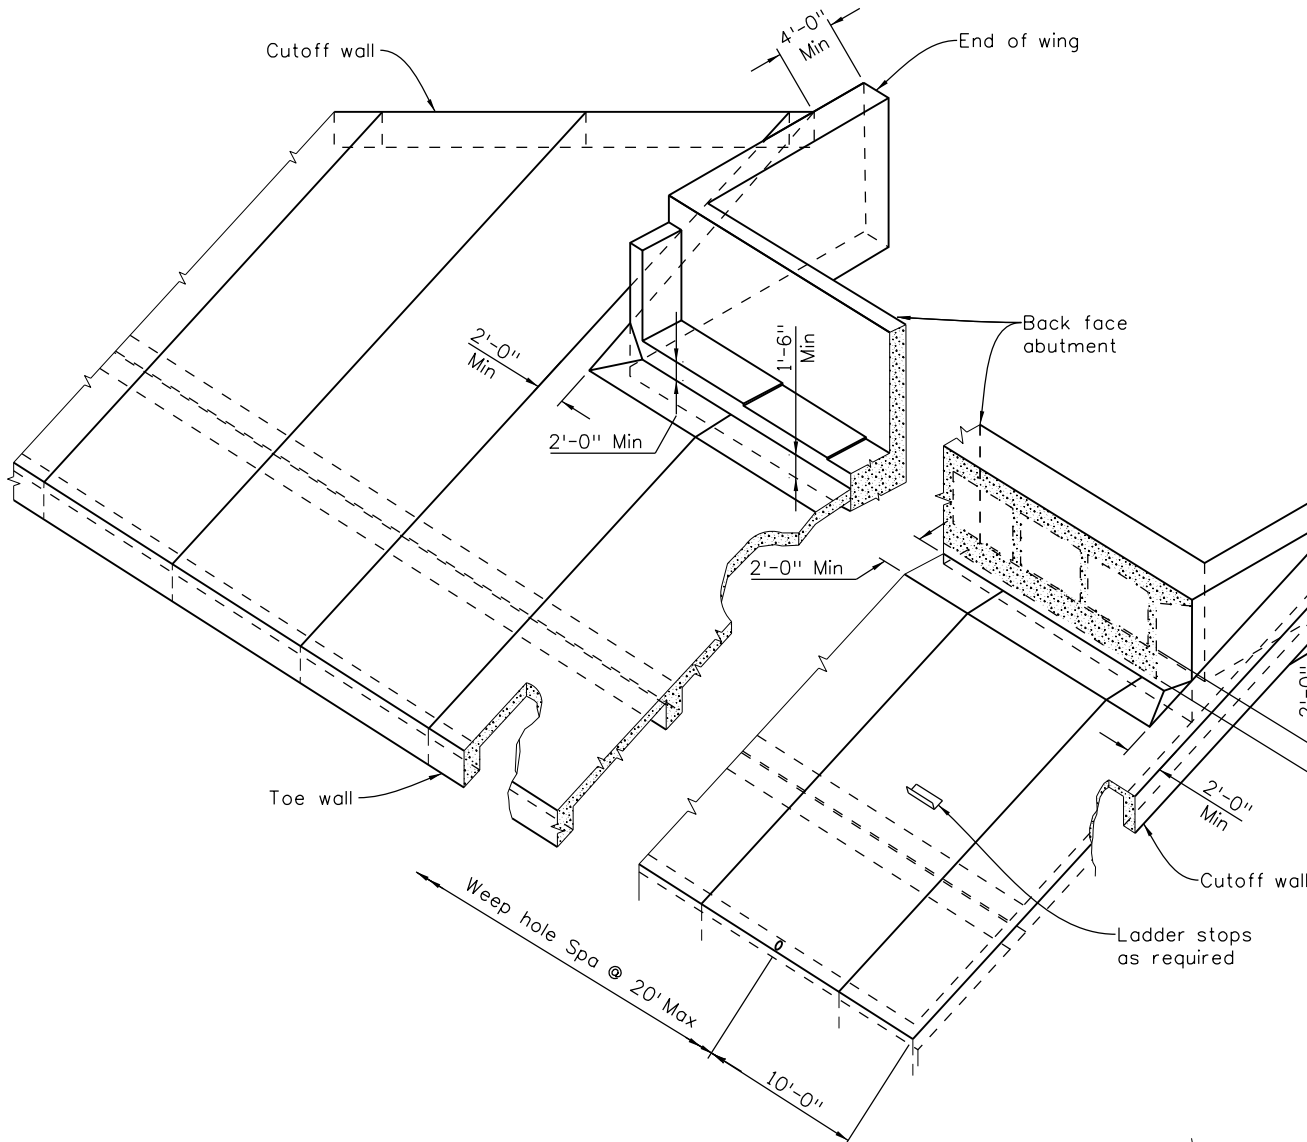


These drawings show general details only.
For limits of slope paving, see General Layout.

NOTES:

1. Slope paving shall be poured in 10-foot transverse sections with a tooled construction joint at each section. Wire fabric shall be 2" from the end of joints and shall lap 8" at splices.
2. Where slope or berm paving butts against structural concrete, separate with 1" expansion joint material.
3. Expansion joint material and welded wire fabric shall not be paid for separately, but shall be included in the work.
4. Structure excavation for concrete slope and ditch paving shall be limited to the actual volume occupied by the slope paving concrete.

■ 4.0 Lb of Macro Fiber Reinforcement meeting ASTM C1116, per CY of concrete, may be substituted for the WWF in this slope paving. If this substitution is made, a continuous #5 reinforcing bar shall be added near the top and bottom of the cutoff wall. The fiber shall be added to the concrete mix in such a fashion that the fibers are uniformly dispersed in the concrete without visible balls or clumps in either the finished slope paving or in the plastic concrete delivered from the concrete truck.

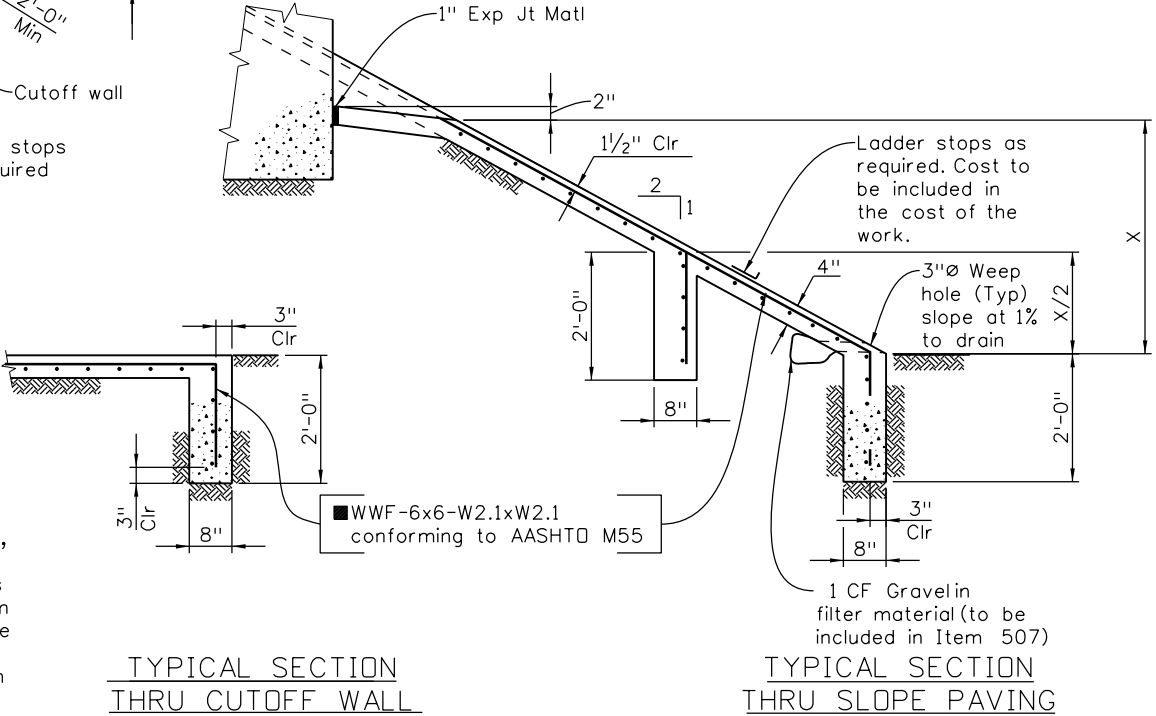

All seals for this set of drawings are applied to the cover page(s)	Print Date: \$DATE\$	Sheet Revisions			Colorado Department of Transportation				As Constructed	SLOPE PAVING DETAILS SINGLE SLOPE				Project No./Code
	File Name: Sheet_B-507-1.dgn	Date:	Comments	Init.		2829 West Howard Place, 3rd Floor Denver, CO 80204 Phone: 303-512-4079 FAX: 303-757-9197	Initials	No Revisions:	Revised:	Designer: XXXXXXXX	Structure Numbers	X-XX-XX	Sheet Number	Project Number
	Horiz. Scale: None Vert. Scale: As Noted									Detailer: XXXXXXXX		X-XX-XX		
	Unit Information Unit Leader Initials									Sheet Subset: BRIDGE	Subset Sheets: BXX of XXX			